



**MITSUBISHI**  
**ELECTRIC**

SPLIT-TYPE, HEAT PUM PAIR CONDITIONERS

*Changes for the Better*

No. OC236  
REVISED EDITION-B

# TECHNICAL & SERVICE MANUAL

## Series PLH

Indoor unit  
[Model names]

PLH-P3AAH

PLH-P4AAH

PLH-P5AAH

PLH-P6AAH

## Ceiling Cassettes R407C

[Service Ref.]

**PLH-P3AAH.UK**  
**PLH-P3AAH<sub>1</sub>.UK**  
**PLH-P4AAH.UK**  
**PLH-P4AAH<sub>1</sub>.UK**  
**PLH-P5AAH.UK**  
**PLH-P5AAH<sub>1</sub>.UK**  
**PLH-P6AAH.UK**  
**PLH-P6AAH<sub>1</sub>.UK**



**Revision:**

- "12. PARTS LIST" has been modified.
- Program timer <PAC-YT32PTA> has been added in "13. OPTIONAL PARTS".

**Note:**

- Refer to the OCT03 REVISED EDITION-E as for control relation. This manual does not cover outdoor units. When servicing them, please refer to the service manual No.OC180 REVISED EDITION-A OC261 and this manual in a set.

- Please void OC236 REVISED EDITION-A.

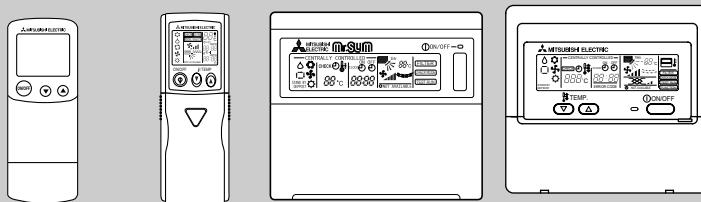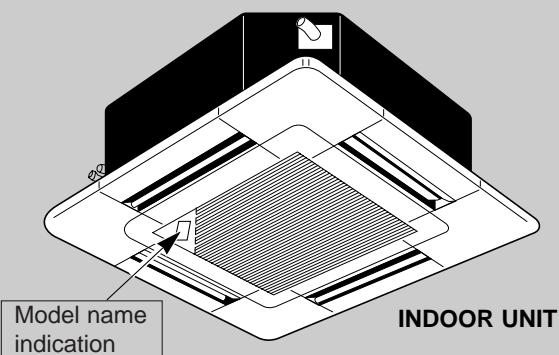

PLH-P•AAH.UK PLH-P•AAH<sub>1</sub>.UK

WIRELESS REMOTE  
CONTROLLER

PLH-P•AAH.UK

WIRED REMOTE  
CONTROLLER

## CONTENTS

1. TECHNICAL CHANGES .....	3
2. COMBINATION OF INDOOR AND OUTDOOR UNITS .....	3
3. SAFETY PRECAUTION .....	4
4. PART NAMES AND FUNCTIONS .....	6
5. SPECIFICATIONS .....	12
6. DATA .....	20
7. OUTLINES AND DIMENSIONS .....	45
8. WIRING DIAGRAM .....	46
9. REFRIGERANT SYSTEM DIAGRAM .....	47
10. TROUBLESHOOTING .....	49
11. DISASSEMBLY PROCEDURE .....	51
12. PARTS LIST .....	54
13. OPTIONAL PARTS .....	59

**Mr. SLIM™**

**Revision:**

1. "12. PARTS LIST" has been modified on page 56, 57 and 58.

Page	Revise point	Service Ref.	Incorrect	Correct
56	FUNCTIONAL PARTS No.8 HEAT EXCHANGE	PLH-P5AAH.UK PLH-P5AAH1.UK	S70 E21 480	S70 E24 480
		PLH-P6AAH.UK PLH-P6AAH1.UK	S70 E22 480	S70 E25 480
57	FUNCTIONAL PARTS No.12 TERMINAL BLOCK	PLH-P3AAH.UK PLH-P3AAH1.UK PLH-P4AAH.UK PLH-P4AAH1.UK	S70 517 716	S70 E01 716
		PLH-P5AAH.UK PLH-P5AAH1.UK PLH-P6AAH.UK PLH-P6AAH1.UK		

Spare INDOOR CONTROLLER BOARD for PLH-P3AAH.UK, PLH-P3AAH1.UK, PLA-P4AAH.UK, PLH-P4AAH1.UK, PLH-P5AAH.UK, PLH-P5AAH1.UK, PLH-P6AAH.UK and PLH-P6AAH1.UK are unified.

Page	Revise point	Service Ref.	Old parts code	New part code
57	FUNCTIONAL PARTS No.7 INDOOR CONTROLLER BOARD	PLH-P3AAH.UK PLH-P3AAH1.UK	S70 E20 310	S70 E20 310*
		PLH-P4AAH.UK PLH-P4AAH1.UK	S70 E21 310	
58	FUNCTIONAL PARTS No.7 INDOOR CONTROLLER BOARD	PLH-P5AAH.UK PLH-P5AAH1.UK	S70 E22 310	S70 E20 310*
		PLH-P6AAH.UK PLH-P6AAH1.UK	S70 E23 310	

DRAIN PUMP has been changed.

Page	Revise point	Service Ref.	Old part code	New part code
57	FUNCTIONAL PARTS No.3 DRAIN PUMP	PLH-P3AAH.UK PLH-P3AAH1.UK PLH-P4AAH.UK PLH-P4AAH1.UK	S70 E01 355	S70 E02 355
		PLH-P5AAH.UK PLH-P5AAH1.UK PLH-P6AAH.UK PLH-P6AAH1.UK		

2. The description "The part name of symbol "I.B" is "SPCB" " is added on both pages of wiring diagram and part list.

**1****TECHNICAL CHANGES**

**PLH-P3AAH.UK → PLH-P3AAH<sub>1</sub>.UK PLH-P4AAH.UK → PLH-P4AAH<sub>1</sub>.UK**

**PLH-P5AAH.UK → PLH-P5AAH<sub>1</sub>.UK PLH-P6AAH.UK → PLH-P6AAH<sub>1</sub>.UK**

- REMOTE CONTROLLER has changed.(PAR-S27A-E → PAR-20MAA-E, PAR-SL95A-E → PAR-SL97A-E)
- Outdoor units which are connected to PLH-P•AAH.UK and PLH-P•AAH<sub>1</sub>.UK have been added.

**2****COMBINATION OF INDOOR AND OUTDOOR UNITS**

Indoor unit	Heat pump type	Outdoor unit											
		PUH-P											
		3				4				5		6	
		VGA	YGA	VGAA.UK	YGAA.UK	YGA	VGAA.UK	YGAA.UK	YGA	YGAA.UK	YGA	YGAA.UK	
		○	○	○	○	—	—	—	—	—	—	—	—
Heat pump with electric heater	PLH-P3AAH.UK	○	○	○	○	—	—	—	—	—	—	—	—
	PLH-P3AAH <sub>1</sub> .UK	—	—	○	○	—	—	—	—	—	—	—	—
	PLH-P4AAH.UK	—	—	—	—	○	○	○	—	—	—	—	—
	PLH-P4AAH <sub>1</sub> .UK	—	—	—	—	—	○	○	—	—	—	—	—
	PLH-P5AAH.UK	—	—	—	—	—	—	—	○	○	—	—	—
	PLH-P5AAH <sub>1</sub> .UK	—	—	—	—	—	—	—	—	○	—	—	—
	PLH-P6AAH.UK	—	—	—	—	—	—	—	—	—	—	○	○
	PLH-P6AAH <sub>1</sub> .UK	—	—	—	—	—	—	—	—	—	—	—	○

## Cautions for devices that use R407C refrigerant.

- **Do not use the existing refrigerant piping.**  
-The old refrigerant and lubricating oil in the existing piping contains a large amount of chlorine which may cause the lubricating oil of the new unit to deteriorate.
- **Use “low residual oil piping”.**  
-If there is a large amount of residual oil (hydraulic oil, etc.) inside the piping and joints, deterioration of the lubricating oil will result.
- **Store the piping to be used during installation indoors and keep both ends of the piping sealed until just before brazing. (Store elbows and other joints in a plastic bag.)**  
-If dust, dirt, or water enters the refrigerant cycle, deterioration of the oil and compressor trouble may result.
- **Use Suniso 4GS or 3GS (small amount) as the lubricating oil to coat flares and flange connection parts.**  
-The lubricating oil used with the air conditioner is highly hygroscopic. If it is used, water may be mixed in and deterioration of the lubricating oil may result.
- **Use liquid refrigerant to charge the system.**  
-If gas refrigerant is used to charge the system, the composition of the refrigerant in the cylinder will change and performance may drop.
- **Do not use a refrigerant other than R407C.**  
-If another refrigerant (R22, etc.) is used, the chlorine in the refrigerant may cause the lubricating oil to deteriorate.
- **Use a vacuum pump with a reverse flow check valve.**  
-The vacuum pump oil may flow back into the refrigerant cycle and cause the lubricating oil to deteriorate.

## [1] Service tools

Use the below service tools as exclusive tools for R407C refrigerant.

No.	Tool name	Specifications
①	Gauge manifold	<ul style="list-style-type: none"> <li>·Only for R407C.</li> <li>·Use the existing fitting SPECIFICATIONS. (UNF7/16)</li> <li>·Use high-tension side pressure of 35kgf/cm<sup>2</sup> or over.</li> </ul>
②	Charge hose	<ul style="list-style-type: none"> <li>·Only for R407C.</li> <li>·Use pressure performance of 52kgf/cm<sup>2</sup> or over.</li> </ul>
③	Electronic scale	
④	Gas leak detector	·Use the detector for R134a or R407C.
⑤	Adapter for reverse flow check.	·Attach on vacuum pump.
⑥	Refrigerant charge base.	
⑦	Refrigerant cylinder.	<ul style="list-style-type: none"> <li>·For R407C</li> <li>·Top of cylinder (Brown)</li> <li>·Cylinder with syphon</li> </ul>
⑧	Refrigerant recovery equipment.	

## [2] Notice on repair service

- After recovering all the refrigerant in the unit, work may be started.
- Do not release the refrigerant in the air.
- After completing the repair service, recharge the system with the specified amount of the liquid refrigerant.


## [3] Refrigerant recharging

### (1) Refrigerant recharging process

Direct charging from the cylinder.

· Confirm that the cylinder is suitable for syphoning.

· Raise the cylinder and recharge the unit by syphoning liquid refrigerant.

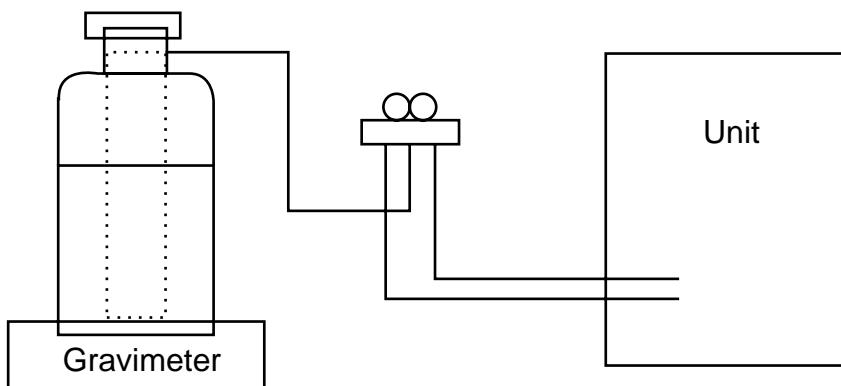

### (2) Recharge when refrigerant leakage has occurred.


· After recovering all the refrigerant in the unit, work may be started.

· Do not release the refrigerant in the air.

· After completing the repair service, recharge the system with the specified amount of the liquid refrigerant.

● Indoor Unit

**PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK  
PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK, PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK**

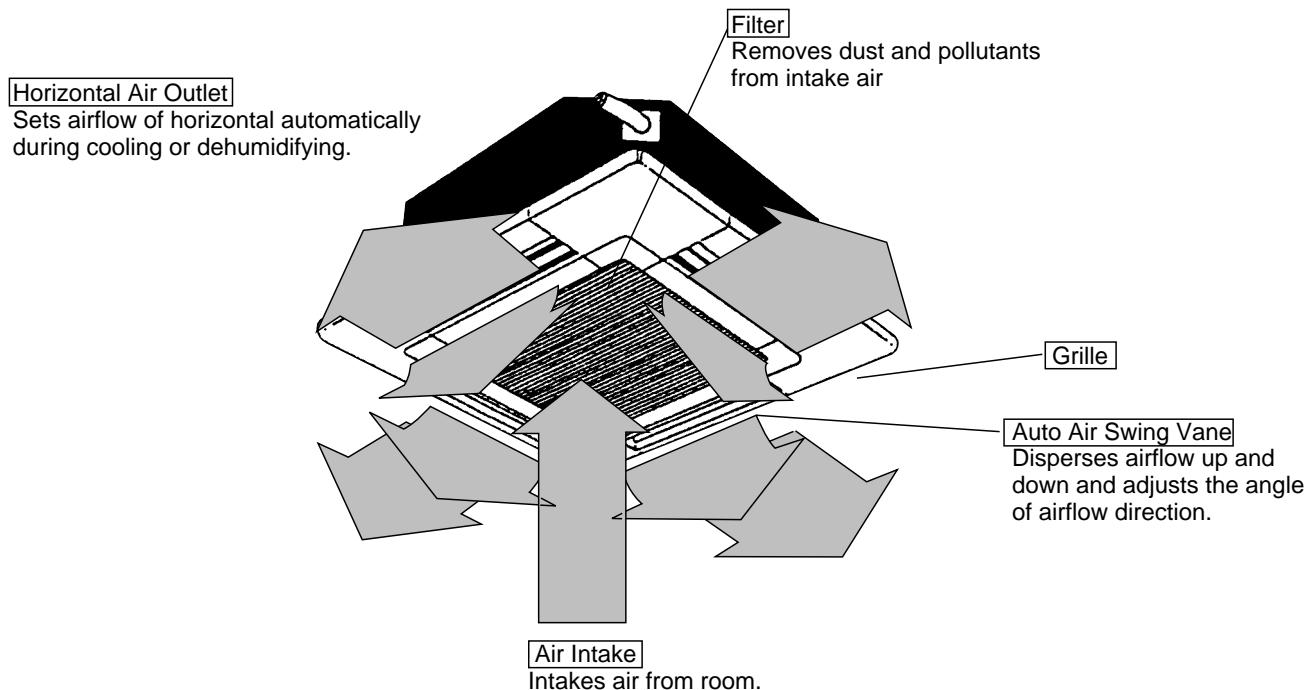


● Wired remote controller

On the controls are set, the same operation mode can be repeated by simply pressing the ON/OFF button.

**PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK**

● Operation buttons [ PAR-S27A-E ]

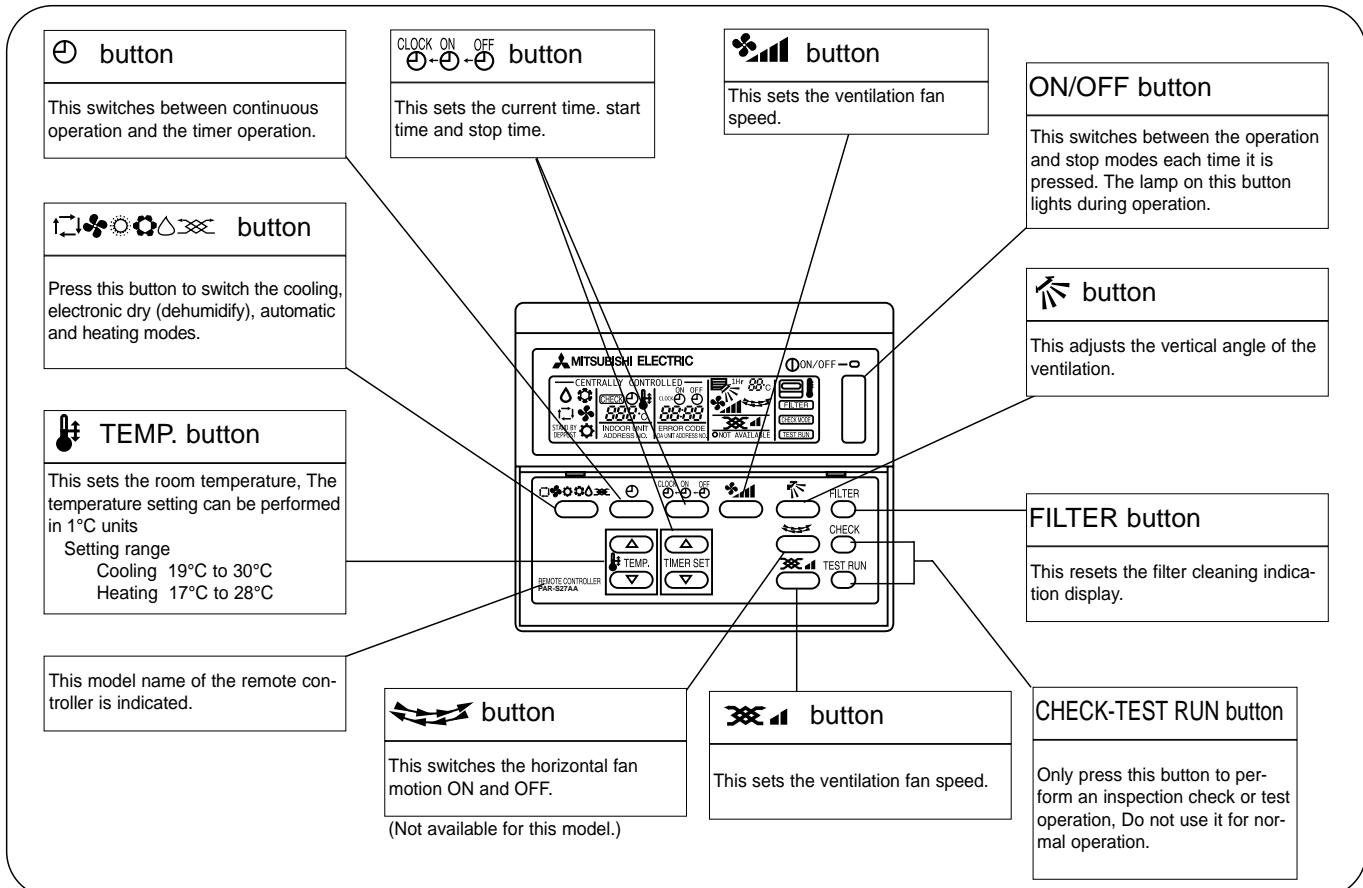

## ● Display

### CENTRALLY CONTROLLED display

This indicates when the unit is controlled by optional features such as central control type remote controller.

### CHECK display

This indicates when a malfunction has occurred in the unit which should be checked.

### OPERATION MODE display

This indicates the operation mode.

### STANDBY display

The [STANDBY] symbol is only displayed from the time the heating operation starts until the heated air begins to blow.

### DEFROST display

This indicates when the defrost operation is performed.

### ⌚ display


This indicates when the continuous operation and time operation modes are set.  
It also display the time for the timer operation at the same time as when it is set.

### ⌚ ON OFF display

The current time , start time and stop time can be displayed in ten second intervals by pressing the time setting button. The start time or stop time is always displayed during the timer operation.

### 伣 display

This displays the air direction.

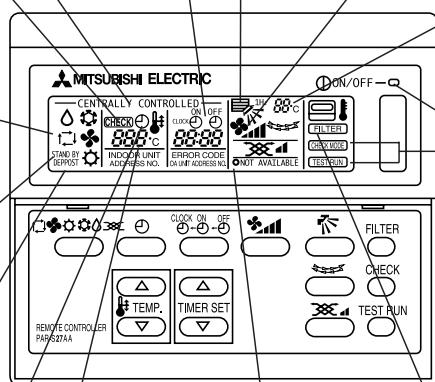

In this display example on the bottom left, a condition where all display lamps light is shown for explanation purposes although this differs from actual operation.

### 伣 display

The selected fan speed is displayed.

### 88°C display

The temperature of the suction air is displayed during operation. The display range is 10° to 35°C. The display flashes 10°C when the actual temperature is less than 10° and flashes 35°C when the actual temperature is greater than 35°C.

### Operation lamp

This lamp lights during operation, goes off when the unit stops and flashes when a malfunction occurs.

### CHECK MODE TEST RUN display

This display lights in the check mode or when a test operation is performed.

### 88°C display

This displays the selected setting temperature.

### ⌚ display

This lamp lights when electricity is supplied to the unit.

### FILTER display


This lamp lights when the filter need to be cleaned.

### Caution


- Only the ⌚ display lights when the unit is stopped and power supplied to the unit.
- When power is turned ON for the first time the (CENTRAL CTRL) display appears to go off momentarily but this is not a malfunction.
- "NOT AVAILABLE" is displayed when the 伣 button are pressed. This indicates that this room unit is not equipped with the fan direction adjustment function and the louver function.
- When power is turned ON for the first time , it is normal that "HO" is displayed on the room temperature indication (For max. 2minutes ).  
Please wait until this "HO" indication disappear than start the operation.

## PLH-P3AAH1.UK, PLH-P4AAH1.UK, PLH-P5AAH1.UK, PLH-P6AAH1.UK

### ● Operation buttons [ PAR-20MAA-E ]

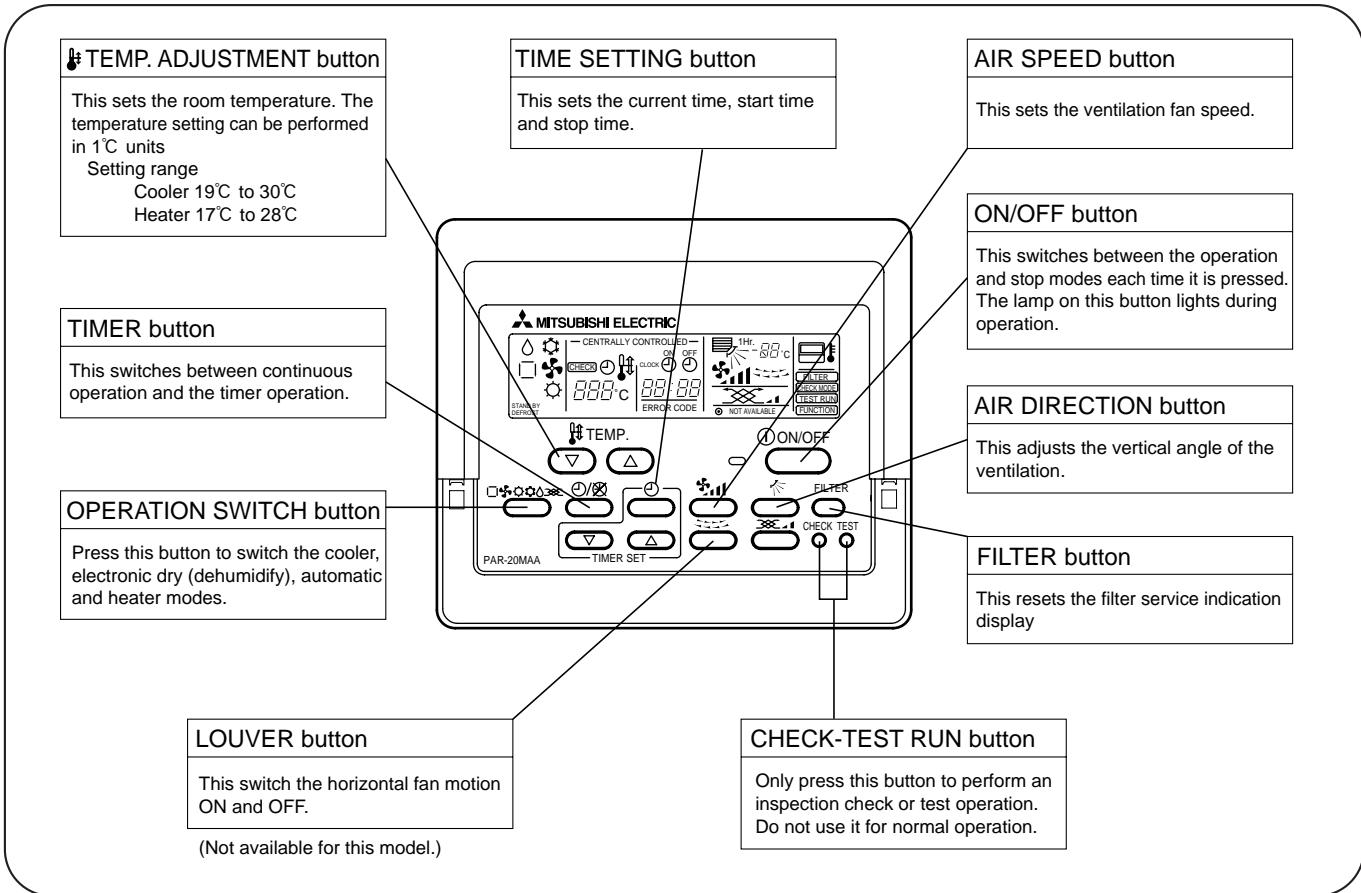

## ● Display

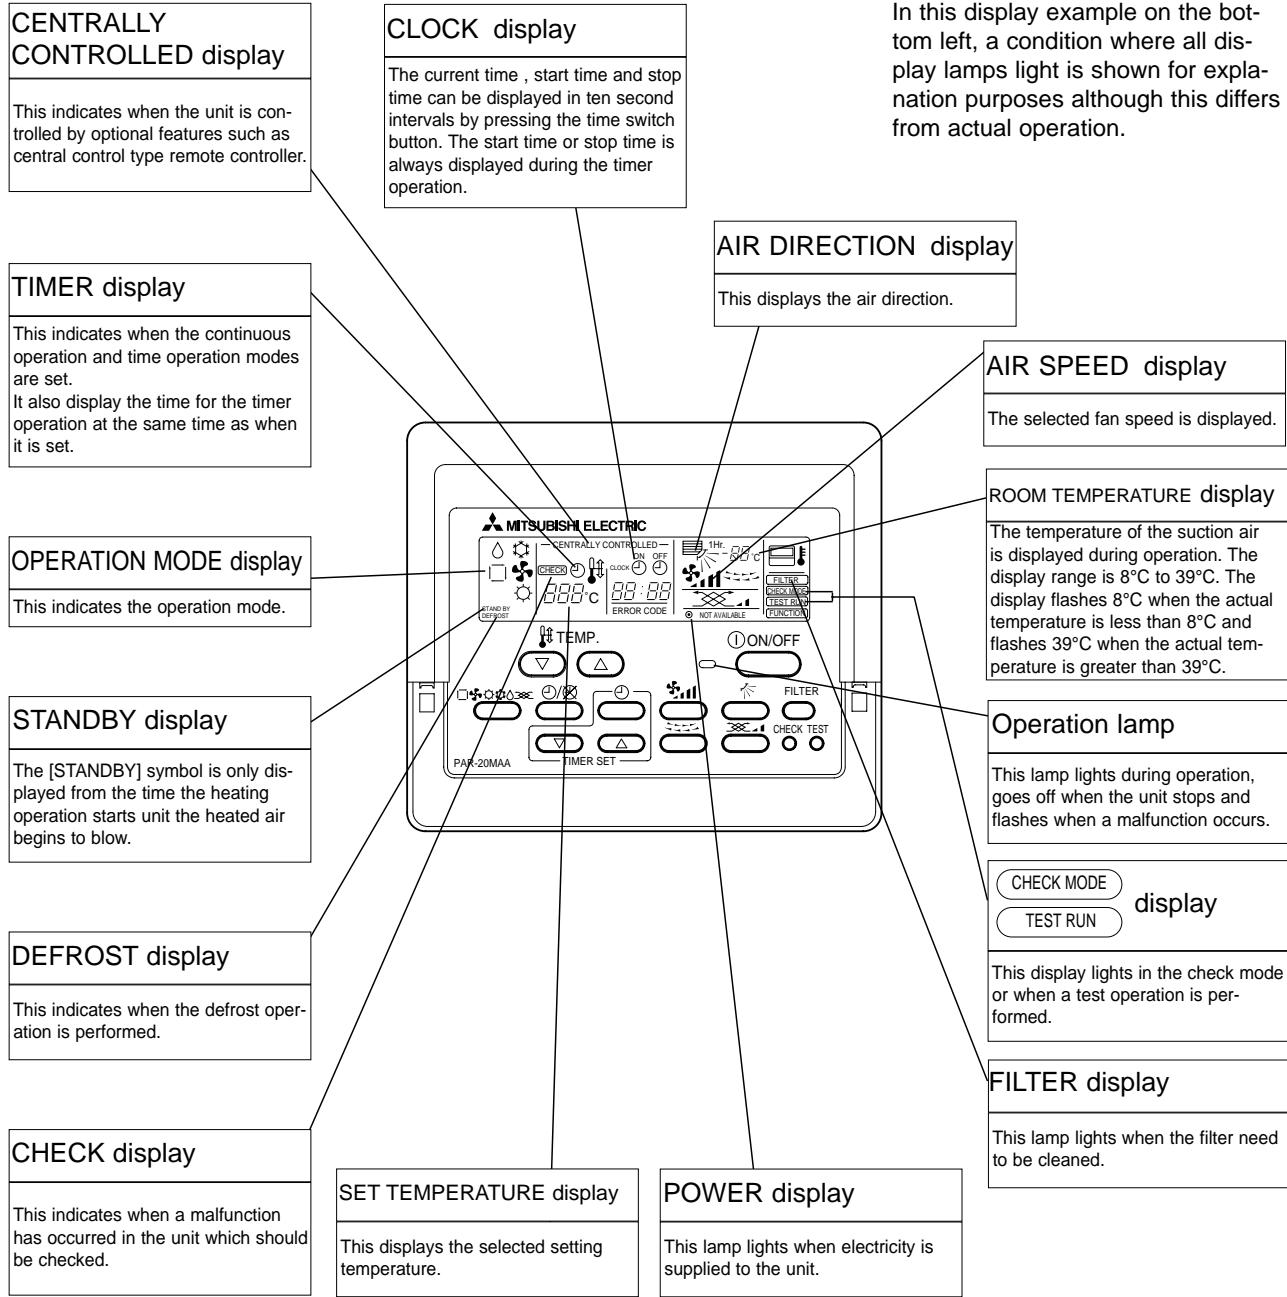


### Caution

- Only the Power display lights when the unit is stopped and power supplied to the unit.
- “NOT AVAILABLE” is displayed when the Air speed button are pressed. This indicates that this room unit is not equipped with the fan direction adjustment function and the louver function.
- When power is turned ON for the first time, it is normal that “H0” is displayed on the room temperature indication (For max. 2minutes). Please wait until this “H0” indication disappear then start the operation.


## ● Wireless remote controller

**PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK**

- When cover is open. [ PAR-SL95A-E ]

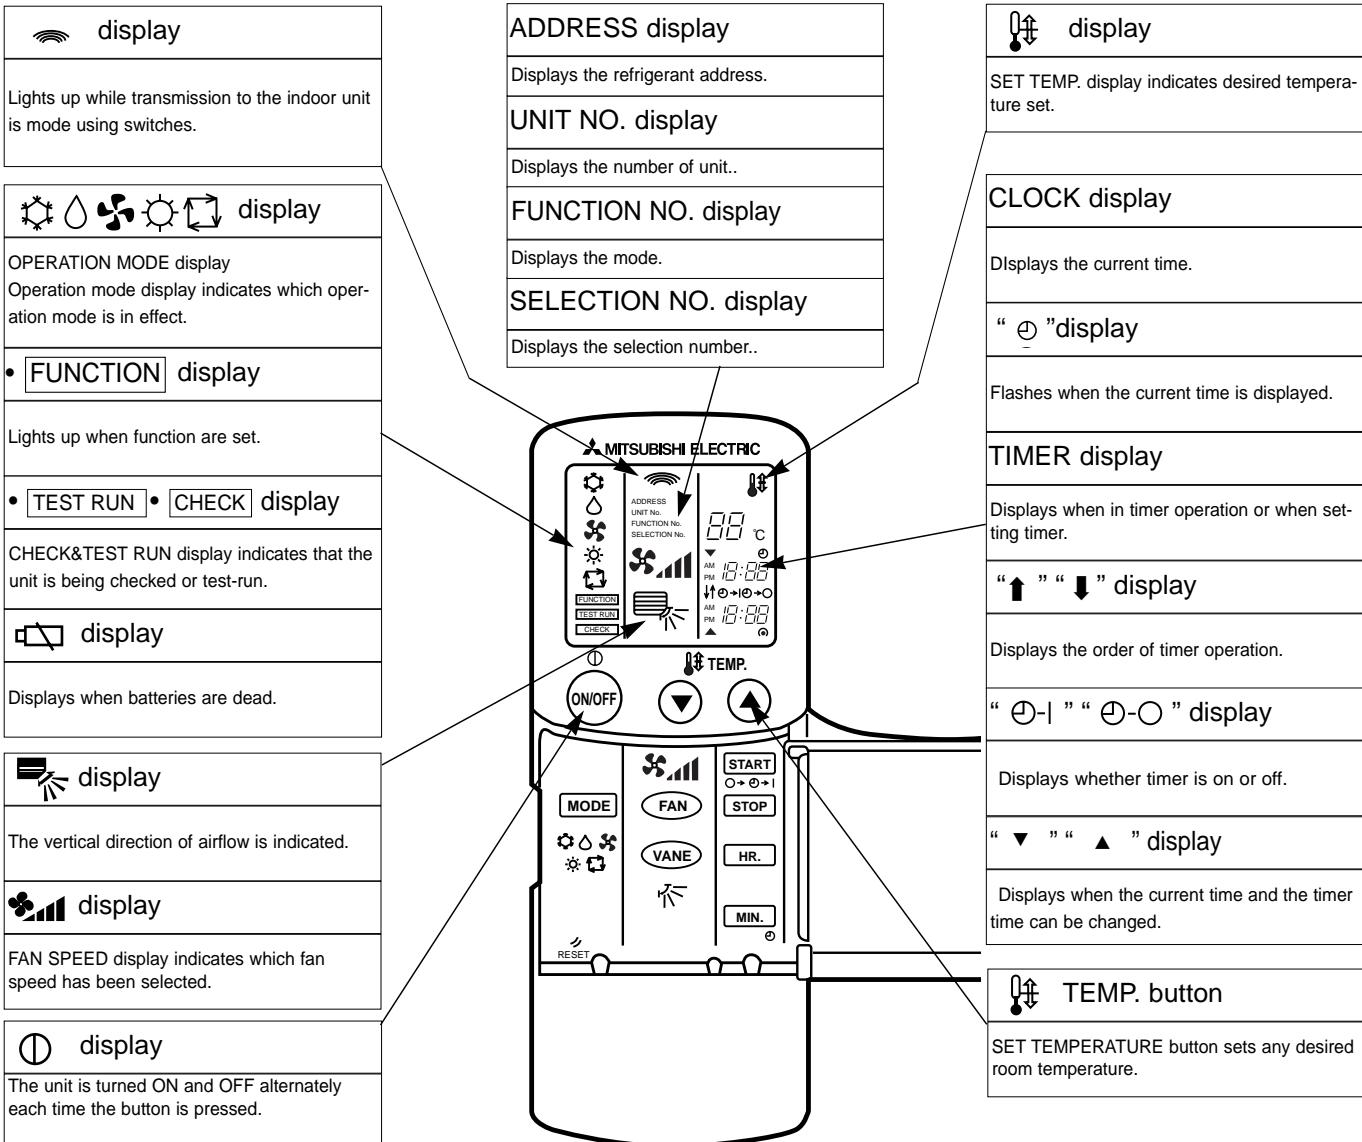


- When cover is open.

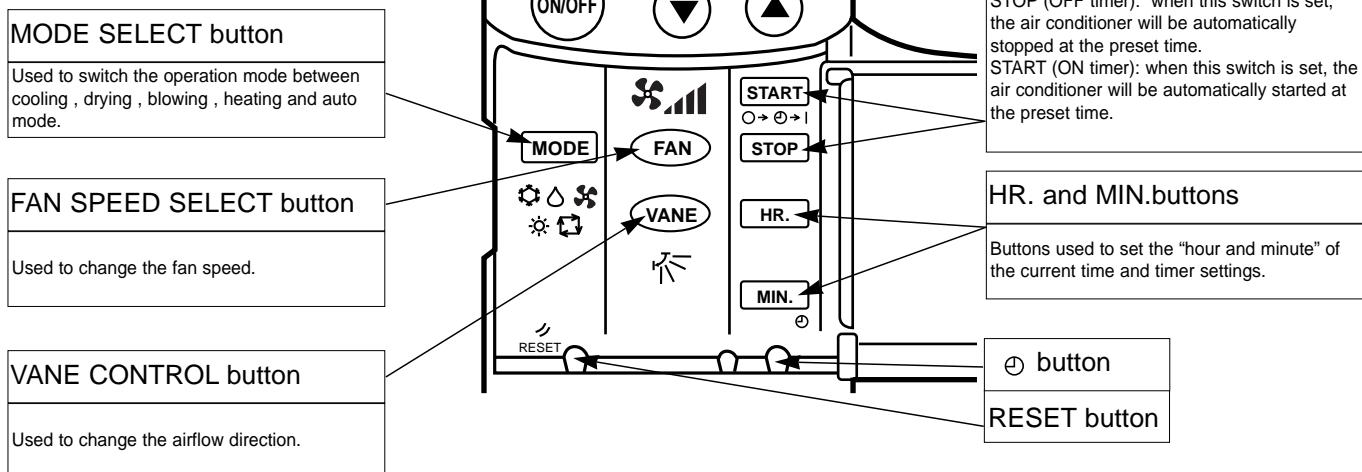

## PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK, PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK

- When cover is open. [ PAR-SL97A-E ]

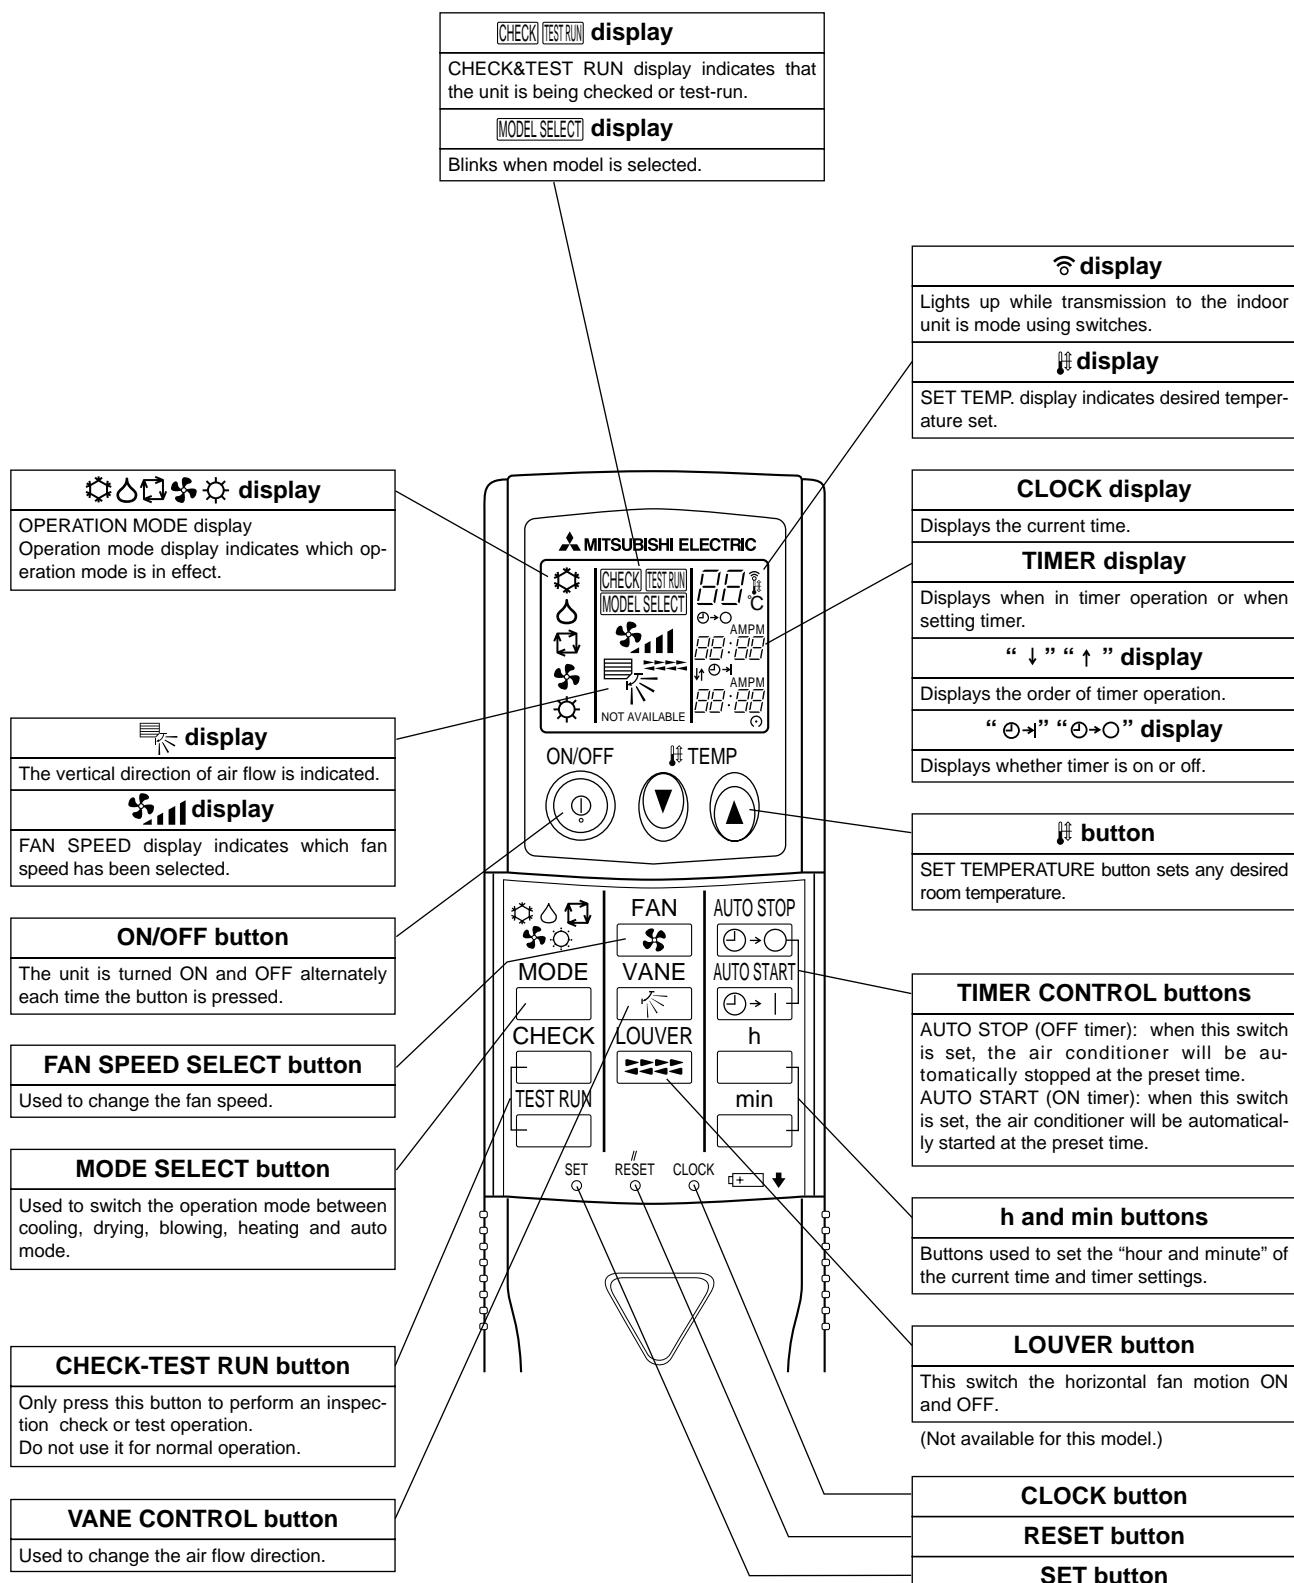

# SPECIFICATIONS

Item		Service Ref.		PLH-P3AAH.UK	
Function				Cooling Heating	
Capacity	*1	Btu/h	26,600	31,700 [38,900]	
		W	7,800	9,300 [11,400]	
Total input	*1	kW	3.51	3.65 [5.75]	
Indoor unit		Service Ref.		PLH-P3AAH.UK	
		Power supply (phase, cycle, voltage)		Single phase, 50Hz, 220–230–240V	
		Input *2	kW	0.17	0.17 <2.10>
		Running current *2	A	0.81	0.81 <8.75>
		Starting current *2	A	1.0	1.0 <8.75>
		External finish		Munsell 0.70Y 8.59/0.97	
		Heat exchanger		Plate fin coil	
		Fan (drive) × No.		Turbo fan (direct) × 1	
		Fan motor output	kW	0.070	
		Airflow (Low-Medium2-Medium1-High)	m³ / min (CFM)	15-16-18-20 (530-565-635-705)	
		External static pressure	Pa (mmAq)	0 (direct blow)	
		Booster heater		<2.1>	
		Operation control & Thermostat		Remote controller & built-in	
		Sound level (Low-Medium2-Medium1-High)	dB	28-30-32-34	
		Unit drain pipe I.D.		32 (1-1/4)	
		Dimensions	W mm (in.)	UNIT : 840 (33-1/16)	PANEL : 950 (37-3/8)
			D mm (in.)	UNIT : 840 (33-1/16)	PANEL : 950 (37-3/8)
			H mm (in.)	UNIT : 258 (10-1/2)	PANEL : 30 (1-3/16)
		Weight		UNIT : 26 (57) PANEL : 5 (11)	
Outdoor unit		Service Ref.		PUH-P3VGA / PUH-P3YGA	
		Power supply (phase, cycle, voltage)		Single phase, 50Hz, 220–230–240V / 3 phases, 50Hz, 380–400–415V (4wires)	
		Running current	A	14.64/5.46	15.43/5.76
		Starting current	A	93/41	
		External finish		Munsell 5Y 8/1	
		Refrigerant control		Linear expansion valve	
		Compressor		Hermetic	
		Model		NE52VNJM / NE52YDJM	
			Motor output	2.5	
			Starter type	Line start	
		Protection devices		Internal thermostat, HP switch, Discharge thermo. / Thermal relay, Discharge thermo., HP switch, Anti-phase protector	
		Heat exchanger		Plate fin coil	
		Fan	Fan (drive) × No.	Propeller (direct) × 1	
			Fan motor output	0.070	
			Airflow	50 (1,770)	
		Crankcase heater		38	
		Defrost method		Reverse cycle	
		Dimensions	Cooling dB	49	
			Heating dB	51	
			W mm (in.)	900 (35-7/16)	
		Dimensions	D mm (in.)	330+20 (13+3/4)	
			H mm (in.)	855 (33-5/8)	
			Weight kg (lbs.)	82 (181)	
Refrigerant piping		Refrigerant		R407C	
		Charge	kg (lbs.)	3.7 (8.2)	
			L	1.6 (MEL56)	
		Pipe size O.D.	Liquid mm (in.)	9.52 (3/8)	
			Gas mm (in.)	15.88 (5/8)	
		Connection method	Indoor side	Flared	
			Outdoor side	Flared	
		Between the indoor & outdoor units		Height difference Max. 50m	
		Piping length		Max. 50m	

## NOTE: 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating : Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

## 2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C, W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19°C, W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C, W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C, W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : &lt;&gt; Shows the only booster heater rating.

## 3. Above data based on indicated voltage

Indoor unit Single phase 240V 50Hz

Outdoor unit Single phase 240V 50Hz / 3 phases 415V 50Hz

Item		Service Ref.		PLH-P4AAH.UK	
Function				Cooling Heating	
Capacity	*1	Btu/h	33,100	36,200 [45,000]	
		W	9,700	10,600 [13,200]	
Total input	*1	kW	3.62	3.80 [6.40]	
Indoor unit	Service Ref.			PLH-P4AAH.UK	
	Power supply (phase, cycle, voltage)			Single phase, 50Hz, 220–230–240V	
	Input	*2	kW	0.26	0.26 <2.60>
	Running current	*2	A	1.25	1.25 <10.83>
	Starting current	*2	A	2.0	2.0 <10.83>
	External finish			Munsell 0.70Y 8.59/0.97	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.		Turbo fan (direct) × 1	
		Fan motor output	kW	0.120	
		Airflow (Low-Medium2-Medium1-High)	m³ / min (CFM)	20-23-26-28 (705-810-920-990)	
		External static pressure	Pa (mmAq)	0 (direct blow)	
	Booster heater			<2.6>	
	Operation control & Thermostat			Remote controller & built-in	
	Sound level (Low-Medium2-Medium1-High)			33-36-39-41	
	Unit drain pipe I.D.			32 (1-1/4)	
	Dimensions	W	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)	
		D	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)	
		H	mm (in.)	UNIT : 298 (11-3/4) PANEL : 30 (1-3/16)	
	Weight			UNIT : 32 (71)	PANEL : 5 (11)
Outdoor unit	Service Ref.			PUH-P4YGA	
	Power supply (phase, cycle, voltage)			3 phases, 50Hz, 380–400–415V (4wires)	
	Running current		A	5.49	5.79
	Starting current		A	45	
	External finish			Munsell 5Y 8/1	
	Refrigerant control			Linear expansion valve	
	Compressor			Hermetic	
	Model	NE56YDJM			
		Motor output	kW	2.7	
		Starter type		Line start	
	Protection devices			Anti-phase protector, Thermal relay, Discharge thermo., HPswitch	
	Heat exchanger			Plate fin coil	
	Fan	Propeller (direct) × 2			
		Fan motor output	kW	0.070+0.070	
		Airflow	m³ / min (CFM)	85 (3,000)	
	Crankcase heater			38	
	Defrost method			Reverse cycle	
	Sound level	Cooling	dB	51	
		Heating	dB	53	
	Dimensions	W	mm (in.)	900 (35-7/16)	
		D	mm (in.)	330+20 (13+3/4)	
		H	mm (in.)	1,260 (49-5/8)	
	Weight			96 (212)	
Refrigerant piping	Refrigerant			R407C	
	Charge		kg (lbs.)	4.0 (8.8)	
	Oil (Model)		L	1.6 (MEL56)	
	Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)	
		Gas	mm (in.)	19.05 (3/4)	
	Connection method	Indoor side		Flared	
		Outdoor side		Flared	
	Between the indoor & outdoor units	Height difference		Max. 50m	
		Piping length		Max. 50m	

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F), W.B. 19°C (66°F)   Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)  
 Heating : Indoor : D.B. 20°C (68°F)   Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C , W.B. 22.5C	D.B. 46°C
	Lower limit	D.B. 19 °C , W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C , W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C , W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : < > Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit   Single phase 240V 50Hz

Outdoor unit   3 phases 415V 50Hz

Service Ref.		PLH-P5AAH.UK	
Item		Cooling	Heating
Function		43,700	54,600 [64,800]
Capacity	*1	W	12,800 16,000 [19,000]
Total input	*1	kW	5.55 5.93 [8.93]
Service Ref.		PLH-P5AAH.UK	
Power supply (phase, cycle, voltage)		Single phase, 50Hz, 220–230–240V	
Input	*2	kW	0.30 0.30 <3.00>
Running current	*2	A	1.43 1.43 <12.50>
Starting current	*2	A	2.0 2.0 <12.50>
External finish			Munsell 0.70Y 8.59/0.97
Heat exchanger			Plate fin coil
Fan	Fan (drive) × No. Fan motor output Airflow (Low-Medium2-Medium1-High) External static pressure		Turbo fan (direct) × 1 0.120 22-25-28-30 (775-880-990-1,060) 0 (direct blow)
Booster heater		kW	<3.0>
Operation control & Thermostat			Remote controller & built-in
Sound level (Low-Medium2-Medium1-High)		dB	35-38-41-43
Unit drain pipe I.D.		mm (in.)	32 (1-1/4)
Dimensions	W	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)
	D	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)
	H	mm (in.)	UNIT : 298 (11-3/4) PANEL : 30 (1-3/16)
Weight		kg (lbs.)	UNIT : 32 (71) PANEL : 5 (11)
Service Ref.		PUH-P5YGA	
Power supply (phase, cycle, voltage)		3 phases, 50Hz, 380–400–415V (4wires)	
Running current	A	8.39	8.74
Starting current	A		79
External finish			Munsell 5Y 8/1
Refrigerant control			Linear expansion valve
Compressor			Hermetic
Model			HE86YAA
Motor output		kW	4.3
Starter type			Line start
Protection devices			Internal thermostat, Anti-phase protector, Thermal relay, HP switch, LP switch, Discharge thermo.
Heat exchanger			Plate fin coil
Fan	Fan (drive) × No. Fan motor output Airflow		Propeller (direct) × 2 0.075+0.075 95 (3,360)
Crankcase heater		W	38
Defrost method			Reverse cycle
Sound level	Cooling	dB	53
	Heating	dB	55
Dimensions	W	mm (in.)	1,050 (41-5/16)
	D	mm (in.)	330+20 (13+3/4)
	H	mm (in.)	1,260 (49-5/8)
Weight		kg (lbs.)	122 (269)
Refrigerant piping	Refrigerant		R407C
	Charge	kg (lbs.)	5.8 (12.8)
	Oil (Model)	L	2.0 (MEL32)
Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)
	Gas	mm (in.)	19.05 (3/4)
Connection method	Indoor side		Flared
	Outdoor side		Flared
Between the indoor & outdoor units	Height difference		Max. 50m
	Piping length		Max. 50m

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F), W.B. 19°C (66°F)   Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating : Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C, W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19°C, W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C, W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C, W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : < > Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit      Single phase 240V 50Hz

Outdoor unit      3 phases 415V 50Hz

Item		Service Ref.		PLH-P6AAH.UK	
Function				Cooling	Heating
Capacity	※1	Btu/h		48,000	57,300 [67,600]
		W		14,300	16,800 [19,800]
Total input	※1	kW		6.70	6.77 [9.77]
Indoor unit	Service Ref.			PLH-P6AAH.UK	
	Power supply (phase, cycle, voltage)			Single phase, 50Hz, 220–230–240V (4wires)	
	Input	※2	kW	0.34	0.34 <3.00>
	Running current	※2	A	1.64	1.64 <12.50>
	Starting current	※2	A	2.0	2.0 <12.50>
	External finish			Munsell 0.70Y 8.59/0.97	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.		Turbo fan (direct) × 1	
		Fan motor output	kW	0.120	
		Airflow (Low-Medium2-Medium1-High)	m³ / min (CFM)	22-25-28-30 (775-880-990-1,060)	
		External static pressure	Pa (mmAq)	0 (direct blow)	
	Booster heater		kW	<3.0>	
	Operation control & Thermostat			Remote controller & built-in	
	Sound level (Low-Medium2-Medium1-High)		dB	37-40-43-45	
	Unit drain pipe I.D.		mm (in.)	32 (1-1/4)	
	Dimensions	W	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)	
		D	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)	
		H	mm (in.)	UNIT : 298 (11-3/4) PANEL : 30 (1-3/16)	
	Weight		kg (lbs.)	UNIT : 34 (75)	PANEL : 5 (11)
Outdoor unit	Service Ref.			PUH-P6YGA	
	Power supply (phase, cycle, voltage)			3 phases, 50Hz, 380–400–415V (4wires)	
	Fan	Running current	A	10.17	10.28
		Starting current	A	84	
	External finish			Munsell 5Y 8/1	
	Refrigerant control			Linear expansion valve	
	Compressor			Hermetic	
	Dimensions	Model		HE101YAA	
		Motor output	kW	5.1	
		Starter type		Line start	
	Protection devices			Internal thermostat, Anit-phase protector, Thermal relay, HP switch, LP switch, Discharge thermo.	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.		Propeller (direct) × 2	
		Fan motor output	kW	0.075+0.075	
		Airflow	m³ / min (CFM)	100 (3,530)	
	Crankcase heater			38	
	Defrost method			Reverse cycle	
	Sound level	Cooling	dB	55	
		Heating	dB	57	
	Dimensions	W	mm (in.)	1,050 (41-5/16)	
		D	mm (in.)	330+20(13+3/4)	
		H	mm (in.)	1,260 (49-5/8)	
	Weight			122 (269)	
Refrigerant piping	Refrigerant			R407C	
	Charge	kg (lbs.)		5.8 (12.8)	
		L		2.0 (MEL32)	
	Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)	
		Gas	mm (in.)	19.05 (3/4)	
	Connection method	Indoor side		Flared	
		Outdoor side		Flared	
	Between the indoor & outdoor units	Height difference		Max. 50m	
		Piping length		Max. 50m	

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F), W.B. 19°C (66°F)    Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating : Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C, W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19°C , W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C , W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C, W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : < > Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit      Single phase 240V 50Hz

Outdoor unit     3 phases 415V 50Hz

Service Ref.			PLH-P3AAH.UK / PLH-P3AAH1.UK		
Item			Cooling	Heating	
Function			26,600	31,700 [38,900]	
Capacity		Btu/h	7,800	9,300 [11,400]	
Total input		kW	3.44	3.50 [5.60]	
Indoor unit	Service Ref.			PLH-P3AAH.UK / PLH-P3AAH1.UK	
	Power supply (phase, cycle, voltage)			Single phase, 50Hz, 220–230–240V	
	Input	kW	0.17	0.17 <2.10>	
	Running current	A	0.81	0.81 <8.75>	
	Starting current	A	1.0	1.0 <8.75>	
	External finish			Munsell 0.70Y 8.59/0.97	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.	Turbo fan (direct) × 1		
	Fan	Fan motor output	0.070		
	Fan	Airflow (Low-Medium2-Medium1-High)	m³ / min (CFM)	15-16-18-20 (530-565-635-705)	
	Fan	External static pressure	Pa (mmAq)	0 (direct blow)	
	Booster heater	kW	<2.1>		
	Operation control & Thermostat			Remote controller & built-in	
	Sound level (Low-Medium2-Medium1-High)			28-30-32-34	
	Unit drain pipe I.D.			32 (1-1/4)	
	Dimensions	W	mm (in.)	UNIT : 840 (33-1/16)	PANEL : 950 (37-3/8)
		D	mm (in.)	UNIT : 840 (33-1/16)	PANEL : 950 (37-3/8)
		H	mm (in.)	UNIT : 258 (10-1/2)	PANEL : 30 (1-3/16)
	Weight		kg (lbs.)	UNIT : 26 (57) PANEL : 5 (11)	
Outdoor unit	Service Ref.			PUH-P3VGAA.UK / PUH-P3YGAA.UK	
	Power supply (phase, cycle, voltage)			Single phase, 50Hz, 220–230–240V / 3 phases, 50Hz, 380–400–415V (4wires)	
	Running current	A	14.81 / 5.29	15.76 / 5.63	
	Starting current	A	93 / 47		
	External finish			Munsell 5Y 7/1	
	Refrigerant control			Linear expansion valve	
	Compressor			Hermetic	
	Model		NE52VNJMT/ NE52YDJMT		
	Motor output	kW	2.5		
	Starter type		Line start		
	Protection devices			Internal thermostat, HP switch, Discharge thermo. / Thermal relay, HPswitch, Discharge thermo.	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.	Propeller (direct) × 1		
	Fan	Fan motor output	0.070		
	Fan	Airflow	50 (1,770)		
	Crankcase heater			38	
	Defrost method			Reverse cycle	
	Dimensions	Cooling	dB	49	
		Heating	dB	51	
		W	mm (in.)	900 (35-7/16)	
		D	mm (in.)	330+20 (13+3/4)	
		H	mm (in.)	855 (33-5/8)	
	Weight		kg (lbs.)	82 (181)	
Refrigerant piping	Refrigerant			R407C	
	Charge		kg (lbs.)	3.3 (7.3)	
	Oil (Model)		L	1.3 (Ester) MEL56	
	Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)	
		Gas	mm (in.)	15.88 (5/8)	
	Connection method		Indoor side	Flared	
			Outdoor side	Flared	
	Between the indoor & outdoor units		Height difference	Max. 50m	
			Piping length	Max. 50m	

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)  
 Heating : Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C, W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19°C, W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C, W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C, W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : < > Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit Single phase 240V 50Hz

Outdoor unit Single phase 240V 50Hz / 3 phases 415V 50Hz

Item		Service Ref.		PLH-P4AAH.UK / PLH-P4AAH1.UK			
Function				Cooling	Heating		
Capacity	*1	Btu/h		33,100	36,200 [43,300]		
		W		9,700	10,600 [12,700]		
Total input		kW		3.69	3.93 [6.03]		
Indoor unit	Service Ref.		PLH-P4AAH.UK / PLH-P4AAH1.UK				
	Power supply (phase, cycle, voltage)		Single phase, 50Hz, 220–230–240V				
	Input	*2	kW	0.26	0.26 <2.60>		
	Running current	*2	A	1.25	1.25 <10.83>		
	Starting current	*2	A	2.0	2.0 <10.83>		
	External finish		Munsell 0.70Y 8.59/0.97				
	Heat exchanger		Plate fin coil				
	Fan	Fan (drive) × No.	Turbo fan (direct) × 1				
		Fan motor output	kW	0.120			
		Airflow (Low-Medium2-Medium1-High)	m³ / min (CFM)	20-23-26-28 (705-810-920-990)			
		External static pressure	Pa (mmAq)	0 (direct blow)			
	Booster heater		kW	<2.6>			
	Operation control & Thermostat		Remote controller & built-in				
	Sound level (Low-Medium2-Medium1-High)		dB	33-36-39-41			
	Unit drain pipe I.D.		mm (in.)	32 (1-1/4)			
	Dimensions	W	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)			
		D	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)			
		H	mm (in.)	UNIT : 298 (11-3/4) PANEL : 30 (1-3/16)			
	Weight		kg (lbs.)	UNIT : 32 (71)	PANEL : 5 (11)		
Outdoor unit	Service Ref.		PUH-P4VGAAH.UK / PUH-P4YGAA.UK				
	Power supply (phase, cycle, voltage)		Single phase, 50Hz, 220–230–240V / 3 phases, 50Hz, 380–400–415V (4wires)				
	Fan	Running current	A	15.71/ 5.55	16.58/ 5.86		
		Starting current	A	99/ 49			
	External finish		Munsell 5Y 7/1				
	Refrigerant control		Linear expansion valve				
	Compressor		Hermetic				
	Model	NE56VNJMT/ NE56YDKMT					
		Motor output	kW	2.7			
		Starter type	Line start				
	Protection devices		Internal thermostat, HP switch, Discharge thermo./ Thermal relay, HP switch, Discharge thermo.				
	Heat exchanger		Plate fin coil				
	Fan	Propeller (direct) × 2					
		Fan motor output	kW	0.070+0.070			
		Airflow	m³ / min (CFM)	85 (3,000)			
	Crankcase heater		W	38			
	Defrost method		Reverse cycle				
	Sound level	Cooling	dB	51			
		Heating	dB	53			
	Dimensions	W	mm (in.)	900 (35-7/16)			
		D	mm (in.)	330+20 (13+3/4)			
		H	mm (in.)	1,260 (49-5/8)			
	Weight		kg (lbs.)	96 (212)			
Refrigerant piping	Refrigerant		R407C				
	Charge	kg (lbs.)		4.0 (8.8)			
		L	1.3 (Ester) MEL56				
	Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)			
		Gas	mm (in.)	19.05 (3/4)			
	Connection method	Indoor side			Flared		
		Outdoor side			Flared		
	Between the indoor & outdoor units		Height difference				
	Piping length		Max. 50m				

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F), W.B. 19°C (66°F)    Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating : Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C , W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19 °C , W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C , W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C , W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : <> Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit      Single phase 240V 50Hz

Outdoor unit      Single phase 240V 50Hz/ 3 phases 415V 50Hz

Item		Service Ref.		PLH-P5AAH.UK / PLH-P5AAH1.UK	
Function				Cooling Heating	
Capacity	*1	Btu/h		43,700	50,800 [61,100]
		W		12,800	14,900 [17,900]
Total input		kW		5.00	5.34 [8.34]
Indoor unit	Service Ref.			PLH-P5AAH.UK / PLH-P5AAH1.UK	
	Power supply (phase, cycle, voltage)			Single phase, 50Hz, 220–230–240V	
	Input *2	kW		0.30	0.30 <3.00>
	Running current *2	A		1.43	1.43 <12.50>
	Starting current *2	A		2.0	2.0 <12.50>
	External finish			Munsell 0.70Y 8.59/0.97	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.		Turbo fan (direct) × 1	
		Fan motor output	kW	0.120	
		Airflow (Low-Medium2-Medium1-High)	m³ / min (CFM)	22-25-28-30 (775-880-990-1,060)	
		External static pressure	Pa (mmAq)	0 (direct blow)	
	Booster heater			<3.0>	
	Operation control & Thermostat			Remote controller & built-in	
	Sound level (Low-Medium2-Medium1-High)			35-38-41-43	
	Unit drain pipe I.D.			32 (1-1/4)	
	Dimensions	W	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)	
		D	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)	
		H	mm (in.)	UNIT : 298 (11-3/4) PANEL : 30 (1-3/16)	
	Weight			UNIT : 32 (71)	PANEL : 5 (11)
Outdoor unit	Service Ref.			PUH-P5YGAA.UK	
	Power supply (phase, cycle, voltage)			3 phases, 50Hz, 380–400–415V (4wires)	
	Running current	A		7.60	8.15
	Starting current	A		65.5	
	External finish			Munsell 5Y 7/1	
	Refrigerant control			Linear expansion valve	
	Compressor			Hermetic	
	Model			ZR61KCE-TFD	
		Motor output	kW	3.5	
		Starter type		Line start	
	Protection devices			Internal thermostat, Thermal relay, HPswitch, Discharge thermo.	
	Heat exchanger			Plate fin coil	
	Fan	Fan (drive) × No.		Propeller (direct) × 2	
		Fan motor output	kW	0.070+0.070	
		Airflow	m³ / min (CFM)	95 (3,360)	
	Crankcase heater			38	
	Defrost method			Reverse cycle	
	Sound level	Cooling	dB	55	
		Heating	dB	56	
	Dimensions	W	mm (in.)	1,050 (41-5/16)	
		D	mm (in.)	330+20 (13+3/4)	
		H	mm (in.)	1,260 (49-5/8)	
	Weight			122 (269)	
Refrigerant piping	Refrigerant			R407C	
	Charge		kg (lbs.)	4.6 (10.1)	
		Oil (Model)	L	1.690 (Ester) MMMA-POE	
	Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)	
		Gas	mm (in.)	19.05 (3/4)	
	Connection method			Flared	
	Between the indoor & outdoor units			Flared	
	Height difference			Max. 50m	
		Piping length		Max. 50m	

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F), W.B. 19°C (66°F)      Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating : Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6 °C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C , W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19°C , W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C , W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C , W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : < > Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit      Single phase 240V 50Hz

Outdoor unit      3 phases 415V 50Hz

Service Ref.		PLH-P6AAH.UK / PLH-P6AAH <sub>1</sub> .UK	
Item		Cooling	Heating
Function		48,000	58,300 [68,600]
Capacity	*1	W	14,300 17,100 [20,100]
Total input	*1	kW	5.94 6.36 [9.36]
Service Ref.		PLH-P6AAH.UK / PLH-P6AAH <sub>1</sub> .UK	
Power supply (phase, cycle, voltage)		Single phase, 50Hz, 220–230–240V	
Input	*2	kW	0.34 0.34 <3.00>
Running current	*2	A	1.64 1.64 <12.50>
Starting current	*2	A	2.0 2.0 <12.50>
External finish			Munsell 0.70Y 8.59/0.97
Heat exchanger			Plate fin coil
Fan	Fan (drive) × No.		Turbo fan (direct) × 1
	Fan motor output	kW	0.120
	Airflow (Low-Medium2-Medium1-High)	m <sup>3</sup> / min (CFM)	22-25-28-30 (775-880-990-1,060)
	External static pressure	Pa (mmAq)	0 (direct blow)
Booster heater		kW	<3.0>
Operation control & Thermostat			Remote controller & built-in
Sound level (Low-Medium2-Medium1-High)		dB	37-40-43-45
Unit drain pipe I.D.		mm (in.)	32 (1-1/4)
Dimensions	W	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)
	D	mm (in.)	UNIT : 840 (33-1/16) PANEL : 950 (37-3/8)
	H	mm (in.)	UNIT : 298 (11-3/4) PANEL : 30 (1-3/16)
Weight		kg (lbs.)	UNIT : 34 (75) PANEL : 5 (11)
Service Ref.		PUH-P6YGAA.UK	
Power supply (phase, cycle, voltage)		3 phases, 50Hz, 380–400–415V (4wires)	
Running current	A	9.03	9.56
Starting current	A		74
External finish			Munsell 5Y 7/1
Refrigerant control			Linear expansion valve
Compressor			Hermetic
Model			ZR72KCE-TFD
Motor output		kW	4.2
Starter type			Line start
Protection devices			Internal thermostat, Thermal relay, HP switch, Discharge thermo.
Heat exchanger			Plate fin coil
Fan	Fan (drive) × No.		Propeller (direct) × 2
	Fan motor output	kW	0.070+0.070
	Airflow	m <sup>3</sup> / min (CFM)	100 (3,530)
Crankcase heater		W	38
Defrost method			Reverse cycle
Sound level	Cooling	dB	57
	Heating	dB	58
Dimensions	W	mm (in.)	1,050 (41-5/16)
	D	mm (in.)	330+20(13+3/4)
	H	mm (in.)	1,260 (49-5/8)
Weight		kg (lbs.)	122 (269)
Refrigerant piping	Refrigerant		R407C
	Charge	kg (lbs.)	4.9 (10.8)
	Oil (Model)	L	1.774 (Ester) MMMA-POE
Pipe size O.D.	Liquid	mm (in.)	9.52 (3/8)
	Gas	mm (in.)	19.05 (3/4)
Connection method	Indoor side		Flared
	Outdoor side		Flared
Between the indoor & outdoor units	Height difference		Max. 50m
	Piping length		Max. 50m

**NOTE:** 1. Rating conditions (ISO T1)

Cooling : Indoor : D.B. 27°C (80°F), W.B. 19°C (66°F)      Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating : Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

		Indoor	Outdoor
Cooling	Upper limit	D.B. 35°C, W.B. 22.5°C	D.B. 46°C
	Lower limit	D.B. 19°C, W.B. 15°C	D.B. -5°C
Heating	Upper limit	D.B. 28°C	D.B. 24°C, W.B. 18°C
	Lower limit	D.B. 17°C	D.B. -11°C, W.B. -12°C

\*1 : [ ] Shows the total rating.

\*2 : < > Shows the only booster heater rating.

3. Above data based on indicated voltage

Indoor unit      Single phase 240V 50Hz

Outdoor unit      3 phases 415V 50Hz

## 1. PERFORMANCE DATA

### 1.1 COOLING CAPACITY (1)

**PLH-P3AAH.UK / PUH-P3VGA, PUH-P3YGA**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	7,722	4,942	0.64	2.81	7,488	4,792	0.64	2.97	7,254	4,643	0.64	3.14
20	18	8,268	4,299	0.52	2.86	8,034	4,178	0.52	3.02	7,761	4,036	0.52	3.23
20	20	8,892	3,557	0.40	2.95	8,697	3,479	0.40	3.09	8,463	3,385	0.40	3.30
22	16	7,722	5,560	0.72	2.81	7,488	5,391	0.72	2.97	7,254	5,223	0.72	3.14
22	18	8,268	4,961	0.60	2.86	8,034	4,820	0.60	3.02	7,761	4,657	0.60	3.23
22	20	8,892	4,268	0.48	2.95	8,697	4,175	0.48	3.09	8,463	4,062	0.48	3.30
24	16	7,722	6,178	0.80	2.81	7,488	5,990	0.80	2.97	7,254	5,803	0.80	3.14
24	18	8,268	5,622	0.68	2.86	8,034	5,463	0.68	3.02	7,761	5,277	0.68	3.23
24	20	8,892	4,980	0.56	2.95	8,697	4,870	0.56	3.09	8,463	4,739	0.56	3.30
24	22	9,477	4,170	0.44	3.02	9,282	4,084	0.44	3.19	9,048	3,981	0.44	3.40
26	16	7,722	6,795	0.88	2.81	7,488	6,589	0.88	2.97	7,254	6,384	0.88	3.14
26	18	8,268	6,284	0.76	2.86	8,034	6,106	0.76	3.02	7,761	5,898	0.76	3.23
26	20	8,892	5,691	0.64	2.95	8,697	5,566	0.64	3.09	8,463	5,416	0.64	3.30
26	22	9,477	4,928	0.52	3.02	9,282	4,827	0.52	3.19	9,048	4,705	0.52	3.40
28	16	7,722	7,413	0.96	2.81	7,488	7,188	0.96	2.97	7,254	6,964	0.96	3.14
28	18	8,268	6,945	0.84	2.86	8,034	6,749	0.84	3.02	7,761	6,519	0.84	3.23
28	20	8,892	6,402	0.72	2.95	8,697	6,262	0.72	3.09	8,463	6,093	0.72	3.30
28	22	9,477	5,686	0.60	3.02	9,282	5,569	0.60	3.19	9,048	5,429	0.60	3.40
30	16	7,722	7,722	1.00	2.81	7,488	7,488	1.00	2.97	7,254	7,254	1.00	3.14
30	18	8,268	7,607	0.92	2.86	8,034	7,391	0.92	3.02	7,761	7,140	0.92	3.23
30	20	8,892	7,114	0.80	2.95	8,697	6,958	0.80	3.09	8,463	6,770	0.80	3.30
30	22	9,477	6,444	0.68	3.02	9,282	6,312	0.68	3.19	9,048	6,153	0.68	3.40
32	16	7,722	7,722	1.00	2.81	7,488	7,488	1.00	2.97	7,254	7,254	1.00	3.14
32	18	8,268	8,268	1.00	2.86	8,034	8,034	1.00	3.02	7,761	7,761	1.00	3.23
32	20	8,892	7,825	0.88	2.95	8,697	7,653	0.88	3.09	8,463	7,447	0.88	3.30
32	22	9,477	7,203	0.76	3.02	9,282	7,054	0.76	3.19	9,048	6,876	0.76	3.40
34	16	7,722	7,722	1.00	2.81	7,488	7,488	1.00	2.97	7,254	7,254	1.00	3.14
34	18	8,268	8,268	1.00	2.86	8,034	8,034	1.00	3.02	7,761	7,761	1.00	3.23
34	20	8,892	8,536	0.96	2.95	8,697	8,349	0.96	3.09	8,463	8,124	0.96	3.30
34	22	9,477	7,961	0.84	3.02	9,282	7,797	0.84	3.19	9,048	7,600	0.84	3.40

NOTE: CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

## COOLING CAPACITY (2)

**PLH-P3AAH.UK / PUH-P3VGA, PUH-P3YGA**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	6,942	4,443	0.64	3.37	6,630	4,243	0.64	3.62	6,318	4,044	0.64	3.91
20	18	7,488	3,894	0.52	3.46	7,254	3,772	0.52	3.72	6,786	3,529	0.52	4.00
20	20	8,112	3,245	0.40	3.55	7,800	3,120	0.40	3.79	7,332	2,933	0.40	4.07
22	16	6,942	4,998	0.72	3.37	6,630	4,774	0.72	3.62	6,318	4,549	0.72	3.91
22	18	7,488	4,493	0.60	3.46	7,254	4,352	0.60	3.72	6,786	4,072	0.60	4.00
22	20	8,112	3,894	0.48	3.55	7,800	3,744	0.48	3.79	7,332	3,519	0.48	4.07
24	16	6,942	5,554	0.80	3.37	6,630	5,304	0.80	3.62	6,318	5,054	0.80	3.91
24	18	7,488	5,092	0.68	3.46	7,254	4,933	0.68	3.72	6,786	4,614	0.68	4.00
24	20	8,112	4,543	0.56	3.55	7,800	4,368	0.56	3.79	7,332	4,106	0.56	4.07
24	22	8,736	3,844	0.44	3.62	8,424	3,707	0.44	3.90	7,956	3,501	0.44	4.14
26	16	6,942	6,109	0.88	3.37	6,630	5,834	0.88	3.62	6,318	5,560	0.88	3.91
26	18	7,488	5,691	0.76	3.46	7,254	5,513	0.76	3.72	6,786	5,157	0.76	4.00
26	20	8,112	5,192	0.64	3.55	7,800	4,992	0.64	3.79	7,332	4,692	0.64	4.07
26	22	8,736	4,543	0.52	3.62	8,424	4,380	0.52	3.90	7,956	4,137	0.52	4.14
28	16	6,942	6,664	0.96	3.37	6,630	6,365	0.96	3.62	6,318	6,065	0.96	3.91
28	18	7,488	6,290	0.84	3.46	7,254	6,093	0.84	3.72	6,786	5,700	0.84	4.00
28	20	8,112	5,841	0.72	3.55	7,800	5,616	0.72	3.79	7,332	5,279	0.72	4.07
28	22	8,736	5,242	0.60	3.62	8,424	5,054	0.60	3.90	7,956	4,774	0.60	4.14
30	16	6,942	6,942	1.00	3.37	6,630	6,630	1.00	3.62	6,318	6,318	1.00	3.91
30	18	7,488	6,889	0.92	3.46	7,254	6,674	0.92	3.72	6,786	6,243	0.92	4.00
30	20	8,112	6,490	0.80	3.55	7,800	6,240	0.80	3.79	7,332	5,866	0.80	4.07
30	22	8,736	5,940	0.68	3.62	8,424	5,728	0.68	3.90	7,956	5,410	0.68	4.14
32	16	6,942	6,942	1.00	3.37	6,630	6,630	1.00	3.62	6,318	6,318	1.00	3.91
32	18	7,488	7,488	1.00	3.46	7,254	7,254	1.00	3.72	6,786	6,786	1.00	4.00
32	20	8,112	7,139	0.88	3.55	7,800	6,864	0.88	3.79	7,332	6,452	0.88	4.07
32	22	8,736	6,639	0.76	3.62	8,424	6,402	0.76	3.90	7,956	6,047	0.76	4.14
34	16	6,942	6,942	1.00	3.37	6,630	6,630	1.00	3.62	6,318	6,318	1.00	3.91
34	18	7,488	7,488	1.00	3.46	7,254	7,254	1.00	3.72	6,786	6,786	1.00	4.00
34	20	8,112	7,788	0.96	3.55	7,800	7,488	0.96	3.79	7,332	7,039	0.96	4.07
34	22	8,736	7,338	0.84	3.62	8,424	7,076	0.84	3.90	7,956	6,683	0.84	4.14

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

**COOLING CAPACITY (3)**  
**PLH-P4AAH.UK / PUH-P4YGA**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	9,603	6,530	0.68	2.90	9,312	6,332	0.68	3.06	9,021	6,134	0.68	3.24
20	18	10,282	5,758	0.56	2.95	9,991	5,595	0.56	3.11	9,652	5,405	0.56	3.33
20	20	11,058	4,866	0.44	3.04	10,816	4,759	0.44	3.19	10,525	4,631	0.44	3.40
22	16	9,603	7,298	0.76	2.90	9,312	7,077	0.76	3.06	9,021	6,856	0.76	3.24
22	18	10,282	6,580	0.64	2.95	9,991	6,394	0.64	3.11	9,652	6,177	0.64	3.33
22	20	11,058	5,750	0.52	3.04	10,816	5,624	0.52	3.19	10,525	5,473	0.52	3.40
24	16	9,603	8,067	0.84	2.90	9,312	7,822	0.84	3.06	9,021	7,578	0.84	3.24
24	18	10,282	7,403	0.72	2.95	9,991	7,194	0.72	3.11	9,652	6,949	0.72	3.33
24	20	11,058	6,635	0.60	3.04	10,816	6,489	0.60	3.19	10,525	6,315	0.60	3.40
24	22	11,786	5,657	0.48	3.11	11,543	5,541	0.48	3.29	11,252	5,401	0.48	3.51
26	16	9,603	8,835	0.92	2.90	9,312	8,567	0.92	3.06	9,021	8,299	0.92	3.24
26	18	10,282	8,226	0.80	2.95	9,991	7,993	0.80	3.11	9,652	7,721	0.80	3.33
26	20	11,058	7,519	0.68	3.04	10,816	7,355	0.68	3.19	10,525	7,157	0.68	3.40
26	22	11,786	6,600	0.56	3.11	11,543	6,464	0.56	3.29	11,252	6,301	0.56	3.51
28	16	9,603	9,603	1.00	2.90	9,312	9,312	1.00	3.06	9,021	9,021	1.00	3.24
28	18	10,282	9,048	0.88	2.95	9,991	8,792	0.88	3.11	9,652	8,493	0.88	3.33
28	20	11,058	8,404	0.76	3.04	10,816	8,220	0.76	3.19	10,525	7,999	0.76	3.40
28	22	11,786	7,543	0.64	3.11	11,543	7,388	0.64	3.29	11,252	7,201	0.64	3.51
30	16	9,603	9,603	1.00	2.90	9,312	9,312	1.00	3.06	9,021	9,021	1.00	3.24
30	18	10,282	9,871	0.96	2.95	9,991	9,591	0.96	3.11	9,652	9,265	0.96	3.33
30	20	11,058	9,289	0.84	3.04	10,816	9,085	0.84	3.19	10,525	8,841	0.84	3.40
30	22	11,786	8,486	0.72	3.11	11,543	8,311	0.72	3.29	11,252	8,101	0.72	3.51
32	16	9,603	9,603	1.00	2.90	9,312	9,312	1.00	3.06	9,021	9,021	1.00	3.24
32	18	10,282	10,282	1.00	2.95	9,991	9,991	1.00	3.11	9,652	9,652	1.00	3.33
32	20	11,058	10,173	0.92	3.04	10,816	9,950	0.92	3.19	10,525	9,683	0.92	3.40
32	22	11,786	9,428	0.80	3.11	11,543	9,234	0.80	3.29	11,252	9,002	0.80	3.51
34	16	9,603	9,603	1.00	2.90	9,312	9,312	1.00	3.06	9,021	9,021	1.00	3.24
34	18	10,282	10,282	1.00	2.95	9,991	9,991	1.00	3.11	9,652	9,652	1.00	3.33
34	20	11,058	11,058	1.00	3.04	10,816	10,816	1.00	3.19	10,525	10,525	1.00	3.40
34	22	11,786	10,371	0.88	3.11	11,543	10,158	0.88	3.29	11,252	9,902	0.88	3.51

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

**COOLING CAPACITY (4)**  
**PLH-P4AAH.UK / PUH-P4YGA**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	8,633	5,870	0.68	3.48	8,245	5,607	0.68	3.73	7,857	5,343	0.68	4.04
20	18	9,312	5,215	0.56	3.57	9,021	5,052	0.56	3.84	8,439	4,726	0.56	4.13
20	20	10,088	4,439	0.44	3.66	9,700	4,268	0.44	3.91	9,118	4,012	0.44	4.20
22	16	8,633	6,561	0.76	3.48	8,245	6,266	0.76	3.73	7,857	5,971	0.76	4.04
22	18	9,312	5,960	0.64	3.57	9,021	5,773	0.64	3.84	8,439	5,401	0.64	4.13
22	20	10,088	5,246	0.52	3.66	9,700	5,044	0.52	3.91	9,118	4,741	0.52	4.20
24	16	8,633	7,252	0.84	3.48	8,245	6,926	0.84	3.73	7,857	6,600	0.84	4.04
24	18	9,312	6,705	0.72	3.57	9,021	6,495	0.72	3.84	8,439	6,076	0.72	4.13
24	20	10,088	6,053	0.60	3.66	9,700	5,820	0.60	3.91	9,118	5,471	0.60	4.20
24	22	10,864	5,215	0.48	3.73	10,476	5,028	0.48	4.02	9,894	4,749	0.48	4.27
26	16	8,633	7,942	0.92	3.48	8,245	7,585	0.92	3.73	7,857	7,228	0.92	4.04
26	18	9,312	7,450	0.80	3.57	9,021	7,217	0.80	3.84	8,439	6,751	0.80	4.13
26	20	10,088	6,860	0.68	3.66	9,700	6,596	0.68	3.91	9,118	6,200	0.68	4.20
26	22	10,864	6,084	0.56	3.73	10,476	5,867	0.56	4.02	9,894	5,541	0.56	4.27
28	16	8,633	8,633	1.00	3.48	8,245	8,245	1.00	3.73	7,857	7,857	1.00	4.04
28	18	9,312	8,195	0.88	3.57	9,021	7,938	0.88	3.84	8,439	7,426	0.88	4.13
28	20	10,088	7,667	0.76	3.66	9,700	7,372	0.76	3.91	9,118	6,930	0.76	4.20
28	22	10,864	6,953	0.64	3.73	10,476	6,705	0.64	4.02	9,894	6,332	0.64	4.27
30	16	8,633	8,633	1.00	3.48	8,245	8,245	1.00	3.73	7,857	7,857	1.00	4.04
30	18	9,312	8,940	0.96	3.57	9,021	8,660	0.96	3.84	8,439	8,101	0.96	4.13
30	20	10,088	8,474	0.84	3.66	9,700	8,148	0.84	3.91	9,118	7,659	0.84	4.20
30	22	10,864	7,822	0.72	3.73	10,476	7,543	0.72	4.02	9,894	7,124	0.72	4.27
32	16	8,633	8,633	1.00	3.48	8,245	8,245	1.00	3.73	7,857	7,857	1.00	4.04
32	18	9,312	9,312	1.00	3.57	9,021	9,021	1.00	3.84	8,439	8,439	1.00	4.13
32	20	10,088	9,281	0.92	3.66	9,700	8,924	0.92	3.91	9,118	8,389	0.92	4.20
32	22	10,864	8,691	0.80	3.73	10,476	8,381	0.80	4.02	9,894	7,915	0.80	4.27
34	16	8,633	8,633	1.00	3.48	8,245	8,245	1.00	3.73	7,857	7,857	1.00	4.04
34	18	9,312	9,312	1.00	3.57	9,021	9,021	1.00	3.84	8,439	8,439	1.00	4.13
34	20	10,088	10,088	1.00	3.66	9,700	9,700	1.00	3.91	9,118	9,118	1.00	4.20
34	22	10,864	9,560	0.88	3.73	10,476	9,219	0.88	4.02	9,894	8,707	0.88	4.27

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

## COOLING CAPACITY (5)

**PLH-P5AAH.UK / PUH-P5YGA**

**(240V)**

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	12,672	7,857	0.62	4.44	12,288	7,619	0.62	4.69	11,904	7,380	0.62	4.97
20	18	13,568	6,784	0.50	4.52	13,184	6,592	0.50	4.77	12,736	6,368	0.50	5.11
20	20	14,592	5,545	0.38	4.66	14,272	5,423	0.38	4.88	13,888	5,277	0.38	5.22
22	16	12,672	8,870	0.70	4.44	12,288	8,602	0.70	4.69	11,904	8,333	0.70	4.97
22	18	13,568	7,869	0.58	4.52	13,184	7,647	0.58	4.77	12,736	7,387	0.58	5.11
22	20	14,592	6,712	0.46	4.66	14,272	6,565	0.46	4.88	13,888	6,388	0.46	5.22
24	16	12,672	9,884	0.78	4.44	12,288	9,585	0.78	4.69	11,904	9,285	0.78	4.97
24	18	13,568	8,955	0.66	4.52	13,184	8,701	0.66	4.77	12,736	8,406	0.66	5.11
24	20	14,592	7,880	0.54	4.66	14,272	7,707	0.54	4.88	13,888	7,500	0.54	5.22
24	22	15,552	6,532	0.42	4.77	15,232	6,397	0.42	5.05	14,848	6,236	0.42	5.38
26	16	12,672	10,898	0.86	4.44	12,288	10,568	0.86	4.69	11,904	10,237	0.86	4.97
26	18	13,568	10,040	0.74	4.52	13,184	9,756	0.74	4.77	12,736	9,425	0.74	5.11
26	20	14,592	9,047	0.62	4.66	14,272	8,849	0.62	4.88	13,888	8,611	0.62	5.22
26	22	15,552	7,776	0.50	4.77	15,232	7,616	0.50	5.05	14,848	7,424	0.50	5.38
28	16	12,672	11,912	0.94	4.44	12,288	11,551	0.94	4.69	11,904	11,190	0.94	4.97
28	18	13,568	11,126	0.82	4.52	13,184	10,811	0.82	4.77	12,736	10,444	0.82	5.11
28	20	14,592	10,214	0.70	4.66	14,272	9,990	0.70	4.88	13,888	9,722	0.70	5.22
28	22	15,552	9,020	0.58	4.77	15,232	8,835	0.58	5.05	14,848	8,612	0.58	5.38
30	16	12,672	12,672	1.00	4.44	12,288	12,288	1.00	4.69	11,904	11,904	1.00	4.97
30	18	13,568	12,211	0.90	4.52	13,184	11,866	0.90	4.77	12,736	11,462	0.90	5.11
30	20	14,592	11,382	0.78	4.66	14,272	11,132	0.78	4.88	13,888	10,833	0.78	5.22
30	22	15,552	10,264	0.66	4.77	15,232	10,053	0.66	5.05	14,848	9,800	0.66	5.38
32	16	12,672	12,672	1.00	4.44	12,288	12,288	1.00	4.69	11,904	11,904	1.00	4.97
32	18	13,568	13,297	0.98	4.52	13,184	12,920	0.98	4.77	12,736	12,481	0.98	5.11
32	20	14,592	12,549	0.86	4.66	14,272	12,274	0.86	4.88	13,888	11,944	0.86	5.22
32	22	15,552	11,508	0.74	4.77	15,232	11,272	0.74	5.05	14,848	10,988	0.74	5.38
34	16	12,672	12,672	1.00	4.44	12,288	12,288	1.00	4.69	11,904	11,904	1.00	4.97
34	18	13,568	13,568	1.00	4.52	13,184	13,184	1.00	4.77	12,736	12,736	1.00	5.11
34	20	14,592	13,716	0.94	4.66	14,272	13,416	0.94	4.88	13,888	13,055	0.94	5.22
34	22	15,552	12,753	0.82	4.77	15,232	12,490	0.82	5.05	14,848	12,175	0.82	5.38

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

## COOLING CAPACITY (6)

**PLH-P5AAH.UK / PUH-P5YGA**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	11,392	7,063	0.62	5.33	10,880	6,746	0.62	5.72	10,368	6,428	0.62	6.19
20	18	12,288	6,144	0.50	5.47	11,904	5,952	0.50	5.88	11,136	5,568	0.50	6.33
20	20	13,312	5,059	0.38	5.61	12,800	4,864	0.38	5.99	12,032	4,572	0.38	6.44
22	16	11,392	7,974	0.70	5.33	10,880	7,616	0.70	5.72	10,368	7,258	0.70	6.19
22	18	12,288	7,127	0.58	5.47	11,904	6,904	0.58	5.88	11,136	6,459	0.58	6.33
22	20	13,312	6,124	0.46	5.61	12,800	5,888	0.46	5.99	12,032	5,535	0.46	6.44
24	16	11,392	8,886	0.78	5.33	10,880	8,486	0.78	5.72	10,368	8,087	0.78	6.19
24	18	12,288	8,110	0.66	5.47	11,904	7,857	0.66	5.88	11,136	7,350	0.66	6.33
24	20	13,312	7,188	0.54	5.61	12,800	6,912	0.54	5.99	12,032	6,497	0.54	6.44
24	22	14,336	6,021	0.42	5.72	13,824	5,806	0.42	6.16	13,056	5,484	0.42	6.55
26	16	11,392	9,797	0.86	5.33	10,880	9,357	0.86	5.72	10,368	8,916	0.86	6.19
26	18	12,288	9,093	0.74	5.47	11,904	8,809	0.74	5.88	11,136	8,241	0.74	6.33
26	20	13,312	8,253	0.62	5.61	12,800	7,936	0.62	5.99	12,032	7,460	0.62	6.44
26	22	14,336	7,168	0.50	5.72	13,824	6,912	0.50	6.16	13,056	6,528	0.50	6.55
28	16	11,392	10,708	0.94	5.33	10,880	10,227	0.94	5.72	10,368	9,746	0.94	6.19
28	18	12,288	10,076	0.82	5.47	11,904	9,761	0.82	5.88	11,136	9,132	0.82	6.33
28	20	13,312	9,318	0.70	5.61	12,800	8,960	0.70	5.99	12,032	8,422	0.70	6.44
28	22	14,336	8,315	0.58	5.72	13,824	8,018	0.58	6.16	13,056	7,572	0.58	6.55
30	16	11,392	11,392	1.00	5.33	10,880	10,880	1.00	5.72	10,368	10,368	1.00	6.19
30	18	12,288	11,059	0.90	5.47	11,904	10,714	0.90	5.88	11,136	10,022	0.90	6.33
30	20	13,312	10,383	0.78	5.61	12,800	9,984	0.78	5.99	12,032	9,385	0.78	6.44
30	22	14,336	9,462	0.66	5.72	13,824	9,124	0.66	6.16	13,056	8,617	0.66	6.55
32	16	11,392	11,392	1.00	5.33	10,880	10,880	1.00	5.72	10,368	10,368	1.00	6.19
32	18	12,288	12,042	0.98	5.47	11,904	11,666	0.98	5.88	11,136	10,913	0.98	6.33
32	20	13,312	11,448	0.86	5.61	12,800	11,008	0.86	5.99	12,032	10,348	0.86	6.44
32	22	14,336	10,609	0.74	5.72	13,824	10,230	0.74	6.16	13,056	9,661	0.74	6.55
34	16	11,392	11,392	1.00	5.33	10,880	10,880	1.00	5.72	10,368	10,368	1.00	6.19
34	18	12,288	12,288	1.00	5.47	11,904	11,904	1.00	5.88	11,136	11,136	1.00	6.33
34	20	13,312	12,513	0.94	5.61	12,800	12,032	0.94	5.99	12,032	11,310	0.94	6.44
34	22	14,336	11,756	0.82	5.72	13,824	11,336	0.82	6.16	13,056	10,706	0.82	6.55

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

**COOLING CAPACITY (7)**  
**PLH-P6AAH.UK / PUH-P6YGA**

(240V)

Indoor DB (°C)	Indoor WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	14,157	8,353	0.59	5.36	13,728	8,100	0.59	5.66	13,299	7,846	0.59	6.00
20	18	15,158	7,124	0.47	5.46	14,729	6,923	0.47	5.76	14,229	6,687	0.47	6.16
20	20	16,302	5,706	0.35	5.63	15,945	5,581	0.35	5.90	15,516	5,430	0.35	6.30
22	16	14,157	9,485	0.67	5.36	13,728	9,198	0.67	5.66	13,299	8,910	0.67	6.00
22	18	15,158	8,337	0.55	5.46	14,729	8,101	0.55	5.76	14,229	7,826	0.55	6.16
22	20	16,302	7,010	0.43	5.63	15,945	6,856	0.43	5.90	15,516	6,672	0.43	6.30
24	16	14,157	10,618	0.75	5.36	13,728	10,296	0.75	5.66	13,299	9,974	0.75	6.00
24	18	15,158	9,550	0.63	5.46	14,729	9,279	0.63	5.76	14,229	8,964	0.63	6.16
24	20	16,302	8,314	0.51	5.63	15,945	8,132	0.51	5.90	15,516	7,913	0.51	6.30
24	22	17,375	6,776	0.39	5.76	17,017	6,637	0.39	6.10	16,588	6,469	0.39	6.50
26	16	14,157	11,750	0.83	5.36	13,728	11,394	0.83	5.66	13,299	11,038	0.83	6.00
26	18	15,158	10,762	0.71	5.46	14,729	10,458	0.71	5.76	14,229	10,102	0.71	6.16
26	20	16,302	9,618	0.59	5.63	15,945	9,407	0.59	5.90	15,516	9,154	0.59	6.30
26	22	17,375	8,166	0.47	5.76	17,017	7,998	0.47	6.10	16,588	7,796	0.47	6.50
28	16	14,157	12,883	0.91	5.36	13,728	12,492	0.91	5.66	13,299	12,102	0.91	6.00
28	18	15,158	11,975	0.79	5.46	14,729	11,636	0.79	5.76	14,229	11,241	0.79	6.16
28	20	16,302	10,922	0.67	5.63	15,945	10,683	0.67	5.90	15,516	10,395	0.67	6.30
28	22	17,375	9,556	0.55	5.76	17,017	9,359	0.55	6.10	16,588	9,123	0.55	6.50
30	16	14,157	14,015	0.99	5.36	13,728	13,591	0.99	5.66	13,299	13,166	0.99	6.00
30	18	15,158	13,187	0.87	5.46	14,729	12,814	0.87	5.76	14,229	12,379	0.87	6.16
30	20	16,302	12,227	0.75	5.63	15,945	11,958	0.75	5.90	15,516	11,637	0.75	6.30
30	22	17,375	10,946	0.63	5.76	17,017	10,721	0.63	6.10	16,588	10,450	0.63	6.50
32	16	14,157	14,157	1.00	5.36	13,728	13,728	1.00	5.66	13,299	13,299	1.00	6.00
32	18	15,158	14,400	0.95	5.46	14,729	13,993	0.95	5.76	14,229	13,517	0.95	6.16
32	20	16,302	13,531	0.83	5.63	15,945	13,234	0.83	5.90	15,516	12,878	0.83	6.30
32	22	17,375	12,336	0.71	5.76	17,017	12,082	0.71	6.10	16,588	11,777	0.71	6.50
34	16	14,157	14,157	1.00	5.36	13,728	13,728	1.00	5.66	13,299	13,299	1.00	6.00
34	18	15,158	15,158	1.00	5.46	14,729	14,729	1.00	5.76	14,229	14,229	1.00	6.16
34	20	16,302	14,835	0.91	5.63	15,945	14,509	0.91	5.90	15,516	14,119	0.91	6.30
34	22	17,375	13,726	0.79	5.76	17,017	13,443	0.79	6.10	16,588	13,105	0.79	6.50

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

## COOLING CAPACITY (8)

PLH-P6AAH.UK / PUH-P6YGA

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	12,727	7,509	0.59	6.43	12,155	7,171	0.59	6.90	11,583	6,834	0.59	7.47
20	18	13,728	6,452	0.47	6.60	13,299	6,251	0.47	7.10	12,441	5,847	0.47	7.64
20	20	14,872	5,205	0.35	6.77	14,300	5,005	0.35	7.24	13,442	4,705	0.35	7.77
22	16	12,727	8,527	0.67	6.43	12,155	8,144	0.67	6.90	11,583	7,761	0.67	7.47
22	18	13,728	7,550	0.55	6.60	13,299	7,314	0.55	7.10	12,441	6,843	0.55	7.64
22	20	14,872	6,395	0.43	6.77	14,300	6,149	0.43	7.24	13,442	5,780	0.43	7.77
24	16	12,727	9,545	0.75	6.43	12,155	9,116	0.75	6.90	11,583	8,687	0.75	7.47
24	18	13,728	8,649	0.63	6.60	13,299	8,378	0.63	7.10	12,441	7,838	0.63	7.64
24	20	14,872	7,585	0.51	6.77	14,300	7,293	0.51	7.24	13,442	6,855	0.51	7.77
24	22	16,016	6,246	0.39	6.90	15,444	6,023	0.39	7.44	14,586	5,689	0.39	7.91
26	16	12,727	10,563	0.83	6.43	12,155	10,089	0.83	6.90	11,583	9,614	0.83	7.47
26	18	13,728	9,747	0.71	6.60	13,299	9,442	0.71	7.10	12,441	8,833	0.71	7.64
26	20	14,872	8,774	0.59	6.77	14,300	8,437	0.59	7.24	13,442	7,931	0.59	7.77
26	22	16,016	7,528	0.47	6.90	15,444	7,259	0.47	7.44	14,586	6,855	0.47	7.91
28	16	12,727	11,582	0.91	6.43	12,155	11,061	0.91	6.90	11,583	10,541	0.91	7.47
28	18	13,728	10,845	0.79	6.60	13,299	10,506	0.79	7.10	12,441	9,828	0.79	7.64
28	20	14,872	9,964	0.67	6.77	14,300	9,581	0.67	7.24	13,442	9,006	0.67	7.77
28	22	16,016	8,809	0.55	6.90	15,444	8,494	0.55	7.44	14,586	8,022	0.55	7.91
30	16	12,727	12,600	0.99	6.43	12,155	12,033	0.99	6.90	11,583	11,467	0.99	7.47
30	18	13,728	11,943	0.87	6.60	13,299	11,570	0.87	7.10	12,441	10,824	0.87	7.64
30	20	14,872	11,154	0.75	6.77	14,300	10,725	0.75	7.24	13,442	10,082	0.75	7.77
30	22	16,016	10,090	0.63	6.90	15,444	9,730	0.63	7.44	14,586	9,189	0.63	7.91
32	16	12,727	12,727	1.00	6.43	12,155	12,155	1.00	6.90	11,583	11,583	1.00	7.47
32	18	13,728	13,042	0.95	6.60	13,299	12,634	0.95	7.10	12,441	11,819	0.95	7.64
32	20	14,872	12,344	0.83	6.77	14,300	11,869	0.83	7.24	13,442	11,157	0.83	7.77
32	22	16,016	11,371	0.71	6.90	15,444	10,965	0.71	7.44	14,586	10,356	0.71	7.91
34	16	12,727	12,727	1.00	6.43	12,155	12,155	1.00	6.90	11,583	11,583	1.00	7.47
34	18	13,728	13,728	1.00	6.60	13,299	13,299	1.00	7.10	12,441	12,441	1.00	7.64
34	20	14,872	13,534	0.91	6.77	14,300	13,013	0.91	7.24	13,442	12,232	0.91	7.77
34	22	16,016	12,653	0.79	6.90	15,444	12,201	0.79	7.44	14,586	11,523	0.79	7.91

NOTE: CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

## **COOLING CAPACITY (9)**

**PLH-P3AAH.UK, PLH-P3AAH<sub>1</sub>.UK / PUH-P3VGAA.UK, PUH-P3YGAA.UK**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	7,722	4,942	0.64	2.75	7,488	4,792	0.64	2.91	7,254	4,643	0.64	3.08
20	18	8,268	4,299	0.52	2.80	8,034	4,178	0.52	2.96	7,761	4,036	0.52	3.16
20	20	8,892	3,557	0.40	2.89	8,697	3,479	0.40	3.03	8,463	3,385	0.40	3.23
22	16	7,722	5,560	0.72	2.75	7,488	5,391	0.72	2.91	7,254	5,223	0.72	3.08
22	18	8,268	4,961	0.60	2.80	8,034	4,820	0.60	2.96	7,761	4,657	0.60	3.16
22	20	8,892	4,268	0.48	2.89	8,697	4,175	0.48	3.03	8,463	4,062	0.48	3.23
24	16	7,722	6,178	0.80	2.75	7,488	5,990	0.80	2.91	7,254	5,803	0.80	3.08
24	18	8,268	5,622	0.68	2.80	8,034	5,463	0.68	2.96	7,761	5,277	0.68	3.16
24	20	8,892	4,980	0.56	2.89	8,697	4,870	0.56	3.03	8,463	4,739	0.56	3.23
26	16	7,722	6,795	0.88	2.75	7,488	6,589	0.88	2.91	7,254	6,384	0.88	3.08
26	18	8,268	6,284	0.76	2.80	8,034	6,106	0.76	2.96	7,761	5,898	0.76	3.16
26	20	8,892	5,691	0.64	2.89	8,697	5,566	0.64	3.03	8,463	5,416	0.64	3.23
28	16	7,722	7,413	0.96	2.75	7,488	7,188	0.96	2.91	7,254	6,964	0.96	3.08
28	18	8,268	6,945	0.84	2.80	8,034	6,749	0.84	2.96	7,761	6,519	0.84	3.16
28	20	8,892	6,402	0.72	2.89	8,697	6,262	0.72	3.03	8,463	6,093	0.72	3.23
30	16	7,722	7,722	1.00	2.75	7,488	7,488	1.00	2.91	7,254	7,254	1.00	3.08
30	18	8,268	7,607	0.92	2.80	8,034	7,391	0.92	2.96	7,761	7,140	0.92	3.16
30	20	8,892	7,114	0.80	2.89	8,697	6,958	0.80	3.03	8,463	6,770	0.80	3.23
32	16	7,722	7,722	1.00	2.75	7,488	7,488	1.00	2.91	7,254	7,254	1.00	3.08
32	18	8,268	8,268	1.00	2.80	8,034	8,034	1.00	2.96	7,761	7,761	1.00	3.16
32	20	8,892	7,825	0.88	2.89	8,697	7,653	0.88	3.03	8,463	7,447	0.88	3.23
34	16	7,722	7,722	1.00	2.75	7,488	7,488	1.00	2.91	7,254	7,254	1.00	3.08
34	18	8,268	8,268	1.00	2.80	8,034	8,034	1.00	2.96	7,761	7,761	1.00	3.16
34	20	8,892	8,536	0.96	2.89	8,697	8,349	0.96	3.03	8,463	8,124	0.96	3.23

**NOTE:** CA: Capacity (W)  
P.C.: Power consumption (kW)

SHC: Sensible heat capacity (W)  
SHF: Sensible heat factor

**COOLING CAPACITY (10)**
**PLH-P3AAH.UK, PLH-P3AAH1.UK / PUH-P3VGAA.UK, PUH-P3YGAA.UK**
**(240V)**

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	6,942	4,443	0.64	3.30	6,630	4,243	0.64	3.54	6,318	4,044	0.64	3.84
20	18	7,488	3,894	0.52	3.39	7,254	3,772	0.52	3.65	6,786	3,529	0.52	3.92
20	20	8,112	3,245	0.40	3.47	7,800	3,120	0.40	3.72	7,332	2,933	0.40	3.99
22	16	6,942	4,998	0.72	3.30	6,630	4,774	0.72	3.54	6,318	4,549	0.72	3.84
22	18	7,488	4,493	0.60	3.39	7,254	4,352	0.60	3.65	6,786	4,072	0.60	3.92
22	20	8,112	3,894	0.48	3.47	7,800	3,744	0.48	3.72	7,332	3,519	0.48	3.99
24	16	6,942	5,554	0.80	3.30	6,630	5,304	0.80	3.54	6,318	5,054	0.80	3.84
24	18	7,488	5,092	0.68	3.39	7,254	4,933	0.68	3.65	6,786	4,614	0.68	3.92
24	20	8,112	4,543	0.56	3.47	7,800	4,368	0.56	3.72	7,332	4,106	0.56	3.99
26	16	6,942	6,109	0.88	3.30	6,630	5,834	0.88	3.54	6,318	5,560	0.88	3.84
26	18	7,488	5,691	0.76	3.39	7,254	5,513	0.76	3.65	6,786	5,157	0.76	3.92
26	20	8,112	5,192	0.64	3.47	7,800	4,992	0.64	3.72	7,332	4,692	0.64	3.99
28	16	6,942	6,664	0.96	3.30	6,630	6,365	0.96	3.54	6,318	6,065	0.96	3.84
28	18	7,488	6,290	0.84	3.39	7,254	6,093	0.84	3.65	6,786	5,700	0.84	3.92
28	20	8,112	5,841	0.72	3.47	7,800	5,616	0.72	3.72	7,332	5,279	0.72	3.99
30	16	6,942	6,942	1.00	3.30	6,630	6,630	1.00	3.54	6,318	6,318	1.00	3.84
30	18	7,488	6,889	0.92	3.39	7,254	6,674	0.92	3.65	6,786	6,243	0.92	3.92
30	20	8,112	6,490	0.80	3.47	7,800	6,240	0.80	3.72	7,332	5,866	0.80	3.99
32	16	6,942	6,942	1.00	3.30	6,630	6,630	1.00	3.54	6,318	6,318	1.00	3.84
32	18	7,488	7,488	1.00	3.39	7,254	7,254	1.00	3.65	6,786	6,786	1.00	3.92
32	20	8,112	7,139	0.88	3.47	7,800	6,864	0.88	3.72	7,332	6,452	0.88	3.99
34	16	6,942	6,942	1.00	3.30	6,630	6,630	1.00	3.54	6,318	6,318	1.00	3.84
34	18	7,488	7,488	1.00	3.39	7,254	7,254	1.00	3.65	6,786	6,786	1.00	3.92
34	20	8,112	7,788	0.96	3.47	7,800	7,488	0.96	3.72	7,332	7,039	0.96	3.99

**NOTE:** CA: Capacity (W)

**SHC:** Sensible heat capacity (W)

**P.C.:** Power consumption (kW)

**SHF:** Sensible heat factor

## **COOLING CAPACITY (11)**

**PLH-P4AAH.UK, PLH-P4AAH<sub>1</sub>.UK / PUH-P4VGAA.UK, PUH-P4YGAA.UK**

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	9,603	6,530	0.68	2.95	9,312	6,332	0.68	3.12	9,021	6,134	0.68	3.30
20	18	10,282	5,758	0.56	3.01	9,991	5,595	0.56	3.17	9,652	5,405	0.56	3.39
20	20	11,058	4,866	0.44	3.10	10,816	4,759	0.44	3.25	10,525	4,631	0.44	3.47
22	16	9,603	7,298	0.76	2.95	9,312	7,077	0.76	3.12	9,021	6,856	0.76	3.30
22	18	10,282	6,580	0.64	3.01	9,991	6,394	0.64	3.17	9,652	6,177	0.64	3.39
22	20	11,058	5,750	0.52	3.10	10,816	5,624	0.52	3.25	10,525	5,473	0.52	3.47
24	16	9,603	8,067	0.84	2.95	9,312	7,822	0.84	3.12	9,021	7,578	0.84	3.30
24	18	10,282	7,403	0.72	3.01	9,991	7,194	0.72	3.17	9,652	6,949	0.72	3.39
24	20	11,058	6,635	0.60	3.10	10,816	6,489	0.60	3.25	10,525	6,315	0.60	3.47
26	16	9,603	8,835	0.92	2.95	9,312	8,567	0.92	3.12	9,021	8,299	0.92	3.30
26	18	10,282	8,226	0.80	3.01	9,991	7,993	0.80	3.17	9,652	7,721	0.80	3.39
26	20	11,058	7,519	0.68	3.10	10,816	7,355	0.68	3.25	10,525	7,157	0.68	3.47
28	16	9,603	9,603	1.00	2.95	9,312	9,312	1.00	3.12	9,021	9,021	1.00	3.30
28	18	10,282	9,048	0.88	3.01	9,991	8,792	0.88	3.17	9,652	8,493	0.88	3.39
28	20	11,058	8,404	0.76	3.10	10,816	8,220	0.76	3.25	10,525	7,999	0.76	3.47
30	16	9,603	9,603	1.00	2.95	9,312	9,312	1.00	3.12	9,021	9,021	1.00	3.30
30	18	10,282	9,871	0.96	3.01	9,991	9,591	0.96	3.17	9,652	9,265	0.96	3.39
30	20	11,058	9,289	0.84	3.10	10,816	9,085	0.84	3.25	10,525	8,841	0.84	3.47
32	16	9,603	9,603	1.00	2.95	9,312	9,312	1.00	3.12	9,021	9,021	1.00	3.30
32	18	10,282	10,282	1.00	3.01	9,991	9,991	1.00	3.17	9,652	9,652	1.00	3.39
32	20	11,058	10,173	0.92	3.10	10,816	9,950	0.92	3.25	10,525	9,683	0.92	3.47
34	16	9,603	9,603	1.00	2.95	9,312	9,312	1.00	3.12	9,021	9,021	1.00	3.30
34	18	10,282	10,282	1.00	3.01	9,991	9,991	1.00	3.17	9,652	9,652	1.00	3.39
34	20	11,058	11,058	1.00	3.10	10,816	10,816	1.00	3.25	10,525	10,525	1.00	3.47

---

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

**COOLING CAPACITY (12)**
**PLH-P4AAH.UK, PLH-P4AAH1.UK / PUH-P4VGAA.UK, PUH-P4YGAA.UK**
**(240V)**

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	8,633	5,870	0.68	3.54	8,245	5,607	0.68	3.80	7,857	5,343	0.68	4.11
20	18	9,312	5,215	0.56	3.63	9,021	5,052	0.56	3.91	8,439	4,726	0.56	4.21
20	20	10,088	4,439	0.44	3.73	9,700	4,268	0.44	3.99	9,118	4,012	0.44	4.28
22	16	8,633	6,561	0.76	3.54	8,245	6,266	0.76	3.80	7,857	5,971	0.76	4.11
22	18	9,312	5,960	0.64	3.63	9,021	5,773	0.64	3.91	8,439	5,401	0.64	4.21
22	20	10,088	5,246	0.52	3.73	9,700	5,044	0.52	3.99	9,118	4,741	0.52	4.28
24	16	8,633	7,252	0.84	3.54	8,245	6,926	0.84	3.80	7,857	6,600	0.84	4.11
24	18	9,312	6,705	0.72	3.63	9,021	6,495	0.72	3.91	8,439	6,076	0.72	4.21
24	20	10,088	6,053	0.60	3.73	9,700	5,820	0.60	3.99	9,118	5,471	0.60	4.28
26	16	8,633	7,942	0.92	3.54	8,245	7,585	0.92	3.80	7,857	7,228	0.92	4.11
26	18	9,312	7,450	0.80	3.63	9,021	7,217	0.80	3.91	8,439	6,751	0.80	4.21
26	20	10,088	6,860	0.68	3.73	9,700	6,596	0.68	3.99	9,118	6,200	0.68	4.28
28	16	8,633	8,633	1.00	3.54	8,245	8,245	1.00	3.80	7,857	7,857	1.00	4.11
28	18	9,312	8,195	0.88	3.63	9,021	7,938	0.88	3.91	8,439	7,426	0.88	4.21
28	20	10,088	7,667	0.76	3.73	9,700	7,372	0.76	3.99	9,118	6,930	0.76	4.28
30	16	8,633	8,633	1.00	3.54	8,245	8,245	1.00	3.80	7,857	7,857	1.00	4.11
30	18	9,312	8,940	0.96	3.63	9,021	8,660	0.96	3.91	8,439	8,101	0.96	4.21
30	20	10,088	8,474	0.84	3.73	9,700	8,148	0.84	3.99	9,118	7,659	0.84	4.28
32	16	8,633	8,633	1.00	3.54	8,245	8,245	1.00	3.80	7,857	7,857	1.00	4.11
32	18	9,312	9,312	1.00	3.63	9,021	9,021	1.00	3.91	8,439	8,439	1.00	4.21
32	20	10,088	9,281	0.92	3.73	9,700	8,924	0.92	3.99	9,118	8,389	0.92	4.28
34	16	8,633	8,633	1.00	3.54	8,245	8,245	1.00	3.80	7,857	7,857	1.00	4.11
34	18	9,312	9,312	1.00	3.63	9,021	9,021	1.00	3.91	8,439	8,439	1.00	4.21
34	20	10,088	10,088	1.00	3.73	9,700	9,700	1.00	3.99	9,118	9,118	1.00	4.28

**NOTE:** CA: Capacity (W)

**SHC:** Sensible heat capacity (W)

**P.C.:** Power consumption (kW)

**SHF:** Sensible heat factor

## **COOLING CAPACITY (13)**

PLH-P5AAH.UK, PLH-P5AAH<sub>1</sub>.UK / PUH-P5YGAA.UK

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	12,672	7,857	0.62	4.00	12,288	7,619	0.62	4.23	11,904	7,380	0.62	4.48
20	18	13,568	6,784	0.50	4.08	13,184	6,592	0.50	4.30	12,736	6,368	0.50	4.60
20	20	14,592	5,545	0.38	4.20	14,272	5,423	0.38	4.40	13,888	5,277	0.38	4.70
22	16	12,672	8,870	0.70	4.00	12,288	8,602	0.70	4.23	11,904	8,333	0.70	4.48
22	18	13,568	7,869	0.58	4.08	13,184	7,647	0.58	4.30	12,736	7,387	0.58	4.60
22	20	14,592	6,712	0.46	4.20	14,272	6,565	0.46	4.40	13,888	6,388	0.46	4.70
24	16	12,672	9,884	0.78	4.00	12,288	9,585	0.78	4.23	11,904	9,285	0.78	4.48
24	18	13,568	8,955	0.66	4.08	13,184	8,701	0.66	4.30	12,736	8,406	0.66	4.60
24	20	14,592	7,880	0.54	4.20	14,272	7,707	0.54	4.40	13,888	7,500	0.54	4.70
26	16	12,672	10,898	0.86	4.00	12,288	10,568	0.86	4.23	11,904	10,237	0.86	4.48
26	18	13,568	10,040	0.74	4.08	13,184	9,756	0.74	4.30	12,736	9,425	0.74	4.60
26	20	14,592	9,047	0.62	4.20	14,272	8,849	0.62	4.40	13,888	8,611	0.62	4.70
28	16	12,672	11,912	0.94	4.00	12,288	11,551	0.94	4.23	11,904	11,190	0.94	4.48
28	18	13,568	11,126	0.82	4.08	13,184	10,811	0.82	4.30	12,736	10,444	0.82	4.60
28	20	14,592	10,214	0.70	4.20	14,272	9,990	0.70	4.40	13,888	9,722	0.70	4.70
30	16	12,672	12,672	1.00	4.00	12,288	12,288	1.00	4.23	11,904	11,904	1.00	4.48
30	18	13,568	12,211	0.90	4.08	13,184	11,866	0.90	4.30	12,736	11,462	0.90	4.60
30	20	14,592	11,382	0.78	4.20	14,272	11,132	0.78	4.40	13,888	10,833	0.78	4.70
32	16	12,672	12,672	1.00	4.00	12,288	12,288	1.00	4.23	11,904	11,904	1.00	4.48
32	18	13,568	13,297	0.98	4.08	13,184	12,920	0.98	4.30	12,736	12,481	0.98	4.60
32	20	14,592	12,549	0.86	4.20	14,272	12,274	0.86	4.40	13,888	11,944	0.86	4.70
34	16	12,672	12,672	1.00	4.00	12,288	12,288	1.00	4.23	11,904	11,904	1.00	4.48
34	18	13,568	13,568	1.00	4.08	13,184	13,184	1.00	4.30	12,736	12,736	1.00	4.60
34	20	14,592	13,716	0.94	4.20	14,272	13,416	0.94	4.40	13,888	13,055	0.94	4.70

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

**COOLING CAPACITY (14)**  
**PLH-P5AAH.UK, PLH-P5AAH1.UK / PUH-P5YGAA.UK** (240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	11,392	7,063	0.62	4.80	10,880	6,746	0.62	5.15	10,368	6,428	0.62	5.58
20	18	12,288	6,144	0.50	4.93	11,904	5,952	0.50	5.30	11,136	5,568	0.50	5.70
20	20	13,312	5,059	0.38	5.05	12,800	4,864	0.38	5.40	12,032	4,572	0.38	5.80
22	16	11,392	7,974	0.70	4.80	10,880	7,616	0.70	5.15	10,368	7,258	0.70	5.58
22	18	12,288	7,127	0.58	4.93	11,904	6,904	0.58	5.30	11,136	6,459	0.58	5.70
22	20	13,312	6,124	0.46	5.05	12,800	5,888	0.46	5.40	12,032	5,535	0.46	5.80
24	16	11,392	8,886	0.78	4.80	10,880	8,486	0.78	5.15	10,368	8,087	0.78	5.58
24	18	12,288	8,110	0.66	4.93	11,904	7,857	0.66	5.30	11,136	7,350	0.66	5.70
24	20	13,312	7,188	0.54	5.05	12,800	6,912	0.54	5.40	12,032	6,497	0.54	5.80
26	16	11,392	9,797	0.86	4.80	10,880	9,357	0.86	5.15	10,368	8,916	0.86	5.58
26	18	12,288	9,093	0.74	4.93	11,904	8,809	0.74	5.30	11,136	8,241	0.74	5.70
26	20	13,312	8,253	0.62	5.05	12,800	7,936	0.62	5.40	12,032	7,460	0.62	5.80
28	16	11,392	10,708	0.94	4.80	10,880	10,227	0.94	5.15	10,368	9,746	0.94	5.58
28	18	12,288	10,076	0.82	4.93	11,904	9,761	0.82	5.30	11,136	9,132	0.82	5.70
28	20	13,312	9,318	0.70	5.05	12,800	8,960	0.70	5.40	12,032	8,422	0.70	5.80
30	16	11,392	11,392	1.00	4.80	10,880	10,880	1.00	5.15	10,368	10,368	1.00	5.58
30	18	12,288	11,059	0.90	4.93	11,904	10,714	0.90	5.30	11,136	10,022	0.90	5.70
30	20	13,312	10,383	0.78	5.05	12,800	9,984	0.78	5.40	12,032	9,385	0.78	5.80
32	16	11,392	11,392	1.00	4.80	10,880	10,880	1.00	5.15	10,368	10,368	1.00	5.58
32	18	12,288	12,042	0.98	4.93	11,904	11,666	0.98	5.30	11,136	10,913	0.98	5.70
32	20	13,312	11,448	0.86	5.05	12,800	11,008	0.86	5.40	12,032	10,348	0.86	5.80
34	16	11,392	11,392	1.00	4.80	10,880	10,880	1.00	5.15	10,368	10,368	1.00	5.58
34	18	12,288	12,288	1.00	4.93	11,904	11,904	1.00	5.30	11,136	11,136	1.00	5.70
34	20	13,312	12,513	0.94	5.05	12,800	12,032	0.94	5.40	12,032	11,310	0.94	5.80

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

## **COOLING CAPACITY (15)**

PLH-P6AAH.UK, PLH-P6AAH<sub>1</sub>.UK / PUH-P6YGAA.UK

(240V)

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		20				25				30			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	14,157	8,353	0.59	4.82	13,728	8,100	0.59	5.10	13,299	7,846	0.59	5.40
20	18	15,158	7,124	0.47	4.91	14,729	6,923	0.47	5.19	14,229	6,687	0.47	5.55
20	20	16,302	5,706	0.35	5.07	15,945	5,581	0.35	5.31	15,516	5,430	0.35	5.67
22	16	14,157	9,485	0.67	4.82	13,728	9,198	0.67	5.10	13,299	8,910	0.67	5.40
22	18	15,158	8,337	0.55	4.91	14,729	8,101	0.55	5.19	14,229	7,826	0.55	5.55
22	20	16,302	7,010	0.43	5.07	15,945	6,856	0.43	5.31	15,516	6,672	0.43	5.67
24	16	14,157	10,618	0.75	4.82	13,728	10,296	0.75	5.10	13,299	9,974	0.75	5.40
24	18	15,158	9,550	0.63	4.91	14,729	9,279	0.63	5.19	14,229	8,964	0.63	5.55
24	20	16,302	8,314	0.51	5.07	15,945	8,132	0.51	5.31	15,516	7,913	0.51	5.67
26	16	14,157	11,750	0.83	4.82	13,728	11,394	0.83	5.10	13,299	11,038	0.83	5.40
26	18	15,158	10,762	0.71	4.91	14,729	10,458	0.71	5.19	14,229	10,102	0.71	5.55
26	20	16,302	9,618	0.59	5.07	15,945	9,407	0.59	5.31	15,516	9,154	0.59	5.67
28	16	14,157	12,883	0.91	4.82	13,728	12,492	0.91	5.10	13,299	12,102	0.91	5.40
28	18	15,158	11,975	0.79	4.91	14,729	11,636	0.79	5.19	14,229	11,241	0.79	5.55
28	20	16,302	10,922	0.67	5.07	15,945	10,683	0.67	5.31	15,516	10,395	0.67	5.67
30	16	14,157	14,015	0.99	4.82	13,728	13,591	0.99	5.10	13,299	13,166	0.99	5.40
30	18	15,158	13,187	0.87	4.91	14,729	12,814	0.87	5.19	14,229	12,379	0.87	5.55
30	20	16,302	12,227	0.75	5.07	15,945	11,958	0.75	5.31	15,516	11,637	0.75	5.67
32	16	14,157	14,157	1.00	4.82	13,728	13,728	1.00	5.10	13,299	13,299	1.00	5.40
32	18	15,158	14,400	0.95	4.91	14,729	13,993	0.95	5.19	14,229	13,517	0.95	5.55
32	20	16,302	13,531	0.83	5.07	15,945	13,234	0.83	5.31	15,516	12,878	0.83	5.67
34	16	14,157	14,157	1.00	4.82	13,728	13,728	1.00	5.10	13,299	13,299	1.00	5.40
34	18	15,158	15,158	1.00	4.91	14,729	14,729	1.00	5.19	14,229	14,229	1.00	5.55
34	20	16,302	14,835	0.91	5.07	15,945	14,509	0.91	5.31	15,516	14,119	0.91	5.67

**NOTE:** CA: Capacity (W)

SHC: Sensible heat capacity (W)

P.C.: Power consumption (kW)

SHF: Sensible heat factor

**COOLING CAPACITY (16)**
**PLH-P6AAH.UK, PLH-P6AAH1.UK / PUH-P6YGAA.UK**
**(240V)**

Indoor intake air DB (°C)	Indoor intake air WB (°C)	Outdoor intake air DB (°C)											
		35				40				45			
		CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.	CA	SHC	SHF	P.C.
20	16	12,727	7,509	0.59	5.79	12,155	7,171	0.59	6.21	11,583	6,834	0.59	6.72
20	18	13,728	6,452	0.47	5.94	13,299	6,251	0.47	6.39	12,441	5,847	0.47	6.87
20	20	14,872	5,205	0.35	6.09	14,300	5,005	0.35	6.51	13,442	4,705	0.35	6.99
22	16	12,727	8,527	0.67	5.79	12,155	8,144	0.67	6.21	11,583	7,761	0.67	6.72
22	18	13,728	7,550	0.55	5.94	13,299	7,314	0.55	6.39	12,441	6,843	0.55	6.87
22	20	14,872	6,395	0.43	6.09	14,300	6,149	0.43	6.51	13,442	5,780	0.43	6.99
24	16	12,727	9,545	0.75	5.79	12,155	9,116	0.75	6.21	11,583	8,687	0.75	6.72
24	18	13,728	8,649	0.63	5.94	13,299	8,378	0.63	6.39	12,441	7,838	0.63	6.87
24	20	14,872	7,585	0.51	6.09	14,300	7,293	0.51	6.51	13,442	6,855	0.51	6.99
26	16	12,727	10,563	0.83	5.79	12,155	10,089	0.83	6.21	11,583	9,614	0.83	6.72
26	18	13,728	9,747	0.71	5.94	13,299	9,442	0.71	6.39	12,441	8,833	0.71	6.87
26	20	14,872	8,774	0.59	6.09	14,300	8,437	0.59	6.51	13,442	7,931	0.59	6.99
28	16	12,727	11,582	0.91	5.79	12,155	11,061	0.91	6.21	11,583	10,541	0.91	6.72
28	18	13,728	10,845	0.79	5.94	13,299	10,506	0.79	6.39	12,441	9,828	0.79	6.87
28	20	14,872	9,964	0.67	6.09	14,300	9,581	0.67	6.51	13,442	9,006	0.67	6.99
30	16	12,727	12,600	0.99	5.79	12,155	12,033	0.99	6.21	11,583	11,467	0.99	6.72
30	18	13,728	11,943	0.87	5.94	13,299	11,570	0.87	6.39	12,441	10,824	0.87	6.87
30	20	14,872	11,154	0.75	6.09	14,300	10,725	0.75	6.51	13,442	10,082	0.75	6.99
32	16	12,727	12,727	1.00	5.79	12,155	12,155	1.00	6.21	11,583	11,583	1.00	6.72
32	18	13,728	13,042	0.95	5.94	13,299	12,634	0.95	6.39	12,441	11,819	0.95	6.87
32	20	14,872	12,344	0.83	6.09	14,300	11,869	0.83	6.51	13,442	11,157	0.83	6.99
34	16	12,727	12,727	1.00	5.79	12,155	12,155	1.00	6.21	11,583	11,583	1.00	6.72
34	18	13,728	13,728	1.00	5.94	13,299	13,299	1.00	6.39	12,441	12,441	1.00	6.87
34	20	14,872	13,534	0.91	6.09	14,300	13,013	0.91	6.51	13,442	12,232	0.91	6.99

**NOTE:** CA: Capacity (W)

**SHC:** Sensible heat capacity (W)

**P.C.:** Power consumption (kW)

**SHF:** Sensible heat factor

--	--	--	--	--	--	--	--	--	--	--	--	--

## 1.2 HEATING CAPACITY

PUH-P3VGA, PUH-P3YGA, PUH-P4YGA, PUH-P5YGA, PUH-P6YGA

(240V)

Service Ref.	Indoor intake air DB (°C)	Outdoor intake air WB (°C)											
		-10		-5		0		5		10		15	
		CA	P.C.	CA	P.C.	CA	P.C.	CA	P.C.	CA	P.C.	CA	P.C.
PLH-P3AAH.UK	15	5,906	2.15	6,417	2.37	7,161	2.74	9,393	3.29	10,602	3.65	11,811	3.94
	20	5,673	2.34	6,138	2.56	6,789	2.96	9,068	3.54	10,230	3.94	11,393	4.23
	25	5,487	2.48	5,952	2.77	6,510	3.21	8,556	3.76	9,858	4.22	10,974	4.54
PLH-P4AAH.UK	15	6,731	2.24	7,314	2.47	8,162	2.85	10,706	3.42	12,084	3.80	13,462	4.10
	20	6,466	2.43	6,996	2.66	7,738	3.08	10,335	3.69	11,660	4.10	12,985	4.41
	25	6,254	2.58	6,784	2.89	7,420	3.34	9,752	3.91	11,236	4.39	12,508	4.73
PLH-P5AAH.UK	15	10,160	3.50	11,040	3.85	12,320	4.45	16,160	5.34	18,240	5.93	20,320	6.40
	20	9,760	3.80	10,560	4.15	11,680	4.80	15,600	5.75	17,600	6.40	19,600	6.88
	25	9,440	4.03	10,240	4.51	11,200	5.22	14,720	6.11	16,960	6.85	18,880	7.38
PLH-P6AAH.UK	15	10,668	3.99	11,592	4.40	12,936	5.08	16,968	6.09	19,152	6.77	21,336	7.31
	20	10,248	4.33	11,088	4.74	12,264	5.48	16,380	6.57	18,480	7.31	20,580	7.85
	25	9,912	4.60	10,752	5.15	11,760	5.96	15,456	6.97	17,808	7.82	19,824	8.43

PUH-P3VGAA.UK, PUH-P3YGAA.UK, PUH-P4VGAA.UK, PUH-4YGAA.UK,

PUH-P5YGAA.UK, PUH-P6YGAA.UK

(240V)

Service Ref.	Indoor intake air DB (°C)	Outdoor intake air WB (°C)											
		-10		-5		0		5		10		15	
		CA	P.C.	CA	P.C.	CA	P.C.	CA	P.C.	CA	P.C.	CA	P.C.
PLH-P3AAH.UK	15	5,906	2.07	6,417	2.28	7,161	2.63	9,393	3.15	10,602	3.50	11,811	3.78
	20	5,673	2.24	6,138	2.45	6,789	2.84	9,068	3.40	10,230	3.78	11,393	4.06
	25	5,487	2.38	5,952	2.66	6,510	3.08	8,556	3.61	9,858	4.04	10,974	4.36
PLH-P4AAH.UK	15	6,731	2.32	7,314	2.55	8,162	2.95	10,706	3.54	12,084	3.93	13,462	4.24
	20	6,466	2.52	6,996	2.75	7,738	3.18	10,335	3.81	11,660	4.24	12,985	4.56
	25	6,254	2.67	6,784	2.99	7,420	3.46	9,752	4.05	11,236	4.54	12,508	4.89
PLH-P5AAH.UK	15	9,462	3.15	10,281	3.47	11,473	4.01	15,049	4.81	16,986	5.34	18,923	5.77
	20	9,089	3.42	9,834	3.74	10,877	4.33	14,528	5.18	16,390	5.77	18,253	6.19
	25	8,791	3.63	9,536	4.06	10,430	4.70	13,708	5.50	15,794	6.17	17,582	6.65
PLH-P6AAH.UK	15	10,859	3.75	11,799	4.13	13,167	4.77	17,271	5.72	19,494	6.36	21,717	6.87
	20	10,431	4.07	11,286	4.45	12,483	5.15	16,673	6.17	18,810	6.87	20,948	7.38
	25	10,089	4.32	10,944	4.83	11,970	5.60	15,732	6.55	18,126	7.35	20,178	7.92

NOTE: CA: Capacity (W)

P.C.: Power consumption (kW)

## 1.3 Correction factors

### Cooling capacity correction factors


Service Ref.	Refrigerant piping length (one way)									
	5m	10m	15m	20m	25m	30m	35m	40m	45m	50m
PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK	1.00	0.981	0.968	0.952	0.940	0.925	0.913	0.900	0.886	0.874
PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK	1.00	0.989	0.980	0.970	0.960	0.950	0.940	0.930	0.920	0.910
PLH-P5AAH.UK PLH-P5AAH <sub>1</sub> .UK	1.00	0.981	0.968	0.952	0.940	0.925	0.913	0.900	0.886	0.874
PLH-P6AAH.UK PLH-P6AAH <sub>1</sub> .UK	1.00	0.975	0.955	0.935	0.918	0.900	0.884	0.869	0.855	0.840

### Heating capacity correction factors


Service Ref.	Refrigerant piping length (one way)									
	5m	10m	15m	20m	25m	30m	35m	40m	45m	50m
PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK	1.00	0.998	0.995	0.993	0.990	0.988	0.985	0.983	0.980	0.978
PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK	1.00	0.998	0.995	0.993	0.990	0.988	0.985	0.983	0.980	0.978
PLH-P5AAH.UK PLH-P5AAH <sub>1</sub> .UK	1.00	0.998	0.995	0.993	0.990	0.988	0.985	0.983	0.980	0.978
PLH-P6AAH.UK PLH-P6AAH <sub>1</sub> .UK	1.00	0.998	0.955	0.993	0.990	0.988	0.985	0.983	0.980	0.978

## 2. PERFORMANCE CURVE

Cooling performance curve(50Hz)

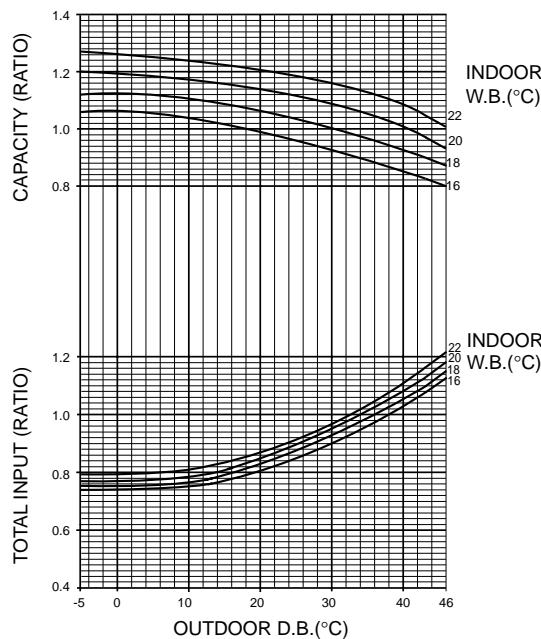

Heating performance curve(50Hz)

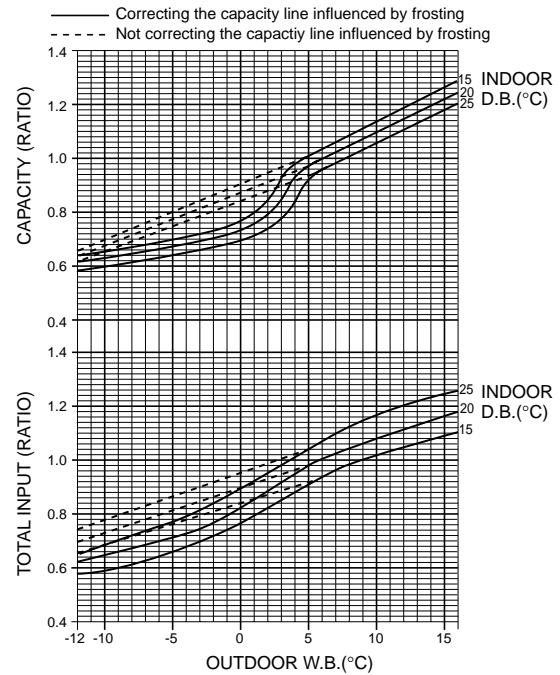

### 3. ELECTRICAL DATA

Indoor unit ..... 220V 50Hz Single phase

Outdoor unit .... 220V 50Hz Single phase / 380V 50Hz 3 phases

Model	Indoor unit	PLH-P3AAH.UK			PLH-P4AAH.UK	
	Outdoor unit	PUH-P3VGA		PUH-P3YGA	PUH-P4YGA	
Mode		Cool	Heat	Cool	Heat	Cool
Capacity (W)	7,600	9,100 (10,860)	7,600	9,100 (10,860)	9,500	10,400 (12,580)
Total Input (kW) (In + Out) (in + Out + Heater)	3.47	3.61 (5.37)	3.47	3.61 (5.37)	3.57	3.75 (5.93)
Indoor unit Input (kW)	0.15	0.15 <1.76>	0.15	0.15 <1.76>	0.24	0.24 <2.18>
Indoor unit Current (A)	0.78	0.78 <8.00>	0.78	0.78 <8.00>	1.25	1.25 <9.91>
Outdoor unit Starting current (A)	84	84	38	38	41	41
Outdoor unit Current (A)	15.55	16.4	5.54	5.84	5.55	5.86

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 230V 50Hz Single phase

Outdoor unit .... 230V 50Hz Single phase / 400V 50Hz 3 phases

Model	Indoor unit	PLH-P3AAH.UK			PLH-P4AAH.UK	
	Outdoor unit	PUH-P3VGA		PUH-P3YGA	PUH-P4YGA	
Mode		Cool	Heat	Cool	Heat	Cool
Capacity (W)	7,700	9,200 (11,130)	7,700	9,200 (11,130)	9,600	10,500 (12,890)
Total Input (kW) (In + Out) (in + Out + Heater)	3.49	3.63 (5.56)	3.49	3.63 (5.56)	3.60	3.78 (6.17)
Indoor unit Input (kW)	0.16	0.16 <1.93>	0.16	0.16 <1.93>	0.25	0.25 <2.39>
Indoor unit Current (A)	0.79	0.79 <8.39>	0.79	0.79 <8.39>	1.25	1.25 <10.39>
Outdoor unit Starting current (A)	89	89	40	40	43	43
Outdoor unit Current (A)	15.08	15.89	5.46	5.75	5.48	5.78

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 240V 50Hz Single phase

Outdoor unit .... 240V 50Hz Single phase / 415V 50Hz 3 phases

Model	Indoor unit	PLH-P3AAH.UK			PLH-P4AAH.UK	
	Outdoor unit	PUH-P3VGA		PUH-P3YGA	PUH-P4YGA	
Mode		Cool	Heat	Cool	Heat	Cool
Capacity (W)	7,800	9,300 (11,400)	7,800	9,300 (11,400)	9,700	10,600 (13,200)
Total Input (kW) (In + Out) (in + Out + Heater)	3.51	3.65 (5.75)	3.51	3.65 (5.75)	3.62	3.80 (6.40)
Indoor unit Input (kW)	0.17	0.17 <2.10>	0.17	0.17 <2.10>	0.26	0.26 <2.60>
Indoor unit Current (A)	0.81	0.81 <8.75>	0.81	0.81 <8.75>	1.25	1.25 <10.83>
Outdoor unit Starting current (A)	93	93	41	41	45	45
Outdoor unit Current (A)	14.64	15.43	5.46	5.76	5.49	5.79

\* ( ) shows the total rating. < > shows the only booster heater rating.

--	--	--	--

Indoor unit ..... 220V 50Hz Single phase

Outdoor unit .... 380V 50Hz 3 phases

Model	Indoor unit	PLH-P5AAH.UK		PLH-P6AAH.UK	
	Outdoor unit	PUH-P5YGA		PUH-P6YGA	
Mode		Cool	Heat	Cool	Heat
Capacity (W)		12,600	15,800 (18,320)	14,100	16,400 (18,920)
Total Input (kW) (In + Out) (in + Out + Heater)		5.51	5.89 (8.41)	6.60	6.73 (9.25)
Indoor unit	Input (kW)	0.28	0.28 <2.52>	0.32	0.32 <2.52>
	Current (A)	1.43	1.43 <11.45>	1.64	1.64 <11.45>
Outdoor Unit	Starting current (A)	72	72	77	77
	Current (A)	8.92	9.29	10.72	10.94

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 230V 50Hz Single phase

Outdoor unit .... 400V 50Hz 3 phases

Model	Indoor unit	PLH-P5AAH.UK		PLH-P6AAH.UK	
	Outdoor unit	PUH-P5YGA		PUH-P6YGA	
Mode		Cool	Heat	Cool	Heat
Capacity (W)		12,700	15,900 (18,660)	14,200	16,600 (19,360)
Total Input (kW) (In + Out) (in + Out + Heater)		5.53	5.91 (8.67)	6.65	6.75 (9.51)
Indoor unit	Input (kW)	0.29	0.29 <2.76>	0.33	0.33 <2.76>
	Current (A)	1.43	1.43 <12.00>	1.64	1.64 <12.00>
Outdoor Unit	Starting current (A)	76	76	81	81
	Current (A)	8.59	8.95	10.36	10.53

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 240V 50Hz Single phase

Outdoor unit .... 415V 50Hz 3 phases

Model	Indoor unit	PLH-P5AAH.UK		PLH-P6AAH.UK	
	Outdoor unit	PUH-P5YGA		PUH-P6YGA	
Mode		Cool	Heat	Cool	Heat
Capacity (W)		12,800	16,000 (19,000)	14,300	16,800 (19,800)
Total Input (kW) (In + Out) (in + Out + Heater)		5.55	5.93 (8.93)	6.70	6.77 (9.77)
Indoor unit	Input (kW)	0.30	0.30 <3.00>	0.34	0.34 <3.00>
	Current (A)	1.43	1.43 <12.50>	1.64	1.64 <12.50>
Outdoor Unit	Starting current (A)	79	79	84	84
	Current (A)	8.39	8.74	10.17	10.28

\* ( ) shows the total rating. < > shows the only booster heater rating.

--	--	--	--	--	--	--	--	--

Indoor unit ..... 220V 50Hz Single phase

Outdoor unit .... 220V 50Hz Single phase / 380V 50Hz 3 phases

Service Ref.	Indoor unit	PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK				PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK			
	Outdoor unit	PUH-P•GAA.UK							
		3V		3Y		4V		4Y	
Mode		Cool	Heat	Cool	Heat	Cool	Heat	Cool	Heat
Capacity (W)		7,600	9,100 (10,860)	7,600	9,100 (10,860)	9,500	10,400 (12,160)	9,500	10,400 (12,160)
Total Input (kW) (In + Out) (in + Out + Heater)	3.40	3.47 (5.23)	3.40	3.47 (5.23)	3.66	3.88 (5.64)	3.66	3.88 (5.64)	
Indoor unit Input (kW)	0.15	0.15 <1.76>	0.15	0.15 <1.76>	0.24	0.24 <2.18>	0.24	0.24 <2.18>	
Indoor unit Current (A)	0.78	0.78 <8.00>	0.78	0.78 <8.00>	1.25	1.25 <9.91>	1.25	1.25 <9.91>	
Outdoor unit Starting current (A)	85	85	43	43	91	91	44	44	
Outdoor unit Current (A)	16.16	17.19	5.78	6.15	17.13	18.08	6.06	6.40	

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 230V 50Hz Single phase

Outdoor unit .... 230V 50Hz Single phase / 400V 50Hz 3 phases

Service Ref.	Indoor unit	PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK				PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK			
	Outdoor unit	PUH-P•GAA.UK							
		3V		3Y		4V		4Y	
Mode		Cool	Heat	Cool	Heat	Cool	Heat	Cool	Heat
Capacity (W)		7,700	9,200 (11,130)	7,700	9,200 (11,130)	9,600	10,500 (12,430)	9,600	10,500 (12,430)
Total Input (kW) (In + Out) (in + Out + Heater)	3.42	3.48 (5.41)	3.42	3.48 (5.41)	3.68	3.91 (5.84)	3.68	3.91 (5.84)	
Indoor unit Input (kW)	0.16	0.16 <1.93>	0.16	0.16 <1.93>	0.25	0.25 <2.39>	0.25	0.25 <2.39>	
Indoor unit Current (A)	0.79	0.79 <8.39>	0.79	0.79 <8.39>	1.25	1.25 <10.39>	1.25	1.25 <10.39>	
Outdoor unit Starting current (A)	89	89	45	45	95	95	47	47	
Outdoor unit Current (A)	15.45	16.45	5.49	5.84	16.39	17.30	5.76	6.08	

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 240V 50Hz Single phase

Outdoor unit .... 240V 50Hz Single phase / 415V 50Hz 3 phases

Service Ref.	Indoor unit	PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK				PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK			
	Outdoor unit	PUH-P•GAA.UK							
		3V		3Y		4V		4Y	
Mode		Cool	Heat	Cool	Heat	Cool	Heat	Cool	Heat
Capacity (W)		7,800	9,300 (11,400)	7,800	9,300 (11,400)	9,700	10,600 (12,700)	9,700	10,600 (12,700)
Total Input (kW) (In + Out) (in + Out + Heater)	3.44	3.50 (5.60)	3.44	3.50 (5.60)	3.69	3.93 (6.03)	3.69	3.93 (6.03)	
Indoor unit Input (kW)	0.17	0.17 <2.10>	0.17	0.17 <2.10>	0.26	0.26 <2.60>	0.26	0.26 <2.60>	
Indoor unit Current (A)	0.81	0.81 <8.75>	0.81	0.81 <8.75>	1.25	1.25 <10.83>	1.25	1.25 <10.83>	
Outdoor unit Starting current (A)	93	93	47	47	99	99	49	49	
Outdoor unit Current (A)	14.81	15.76	5.29	5.63	15.71	16.58	5.55	5.86	

\* ( ) shows the total rating. < > shows the only booster heater rating.

--	--	--	--

Indoor unit ..... 220V 50Hz Single phase

Outdoor unit .... 380V 50Hz 3 phases

Service Ref.	Indoor unit	PLH-P5AAH.UK	PLH-P6AAH.UK
		PLH-P5AAH <sub>1</sub> .UK	PLH-P6AAH <sub>1</sub> .UK
	PUH-P•GAA.UK		
		5Y	6Y
Mode	Cool	Heat	Cool
Capacity (W)	12,600	14,700 (17,210)	14,100
Total Input (kW) (In + Out) (in + Out + Heater)	4.96	5.30 (7.82)	5.85
Indoor unit	Input (kW)	0.28	0.28 <2.52>
Indoor unit	Current (A)	1.43	1.43 <11.45>
Outdoor unit	Starting current (A)	65.5	74
Outdoor unit	Current (A)	8.30	9.86
			10.44

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 230V 50Hz Single phase

Outdoor unit .... 400V 50Hz 3 phases

Service Ref.	Indoor unit	PLH-P5AAH.UK	PLH-P6AAH.UK
		PLH-P5AAH <sub>1</sub> .UK	PLH-P6AAH <sub>1</sub> .UK
	PUH-P•GAA.UK		
		5Y	6Y
Mode	Cool	Heat	Cool
Capacity (W)	12,700	14,800 (17,560)	14,200
Total Input (kW) (In + Out) (in + Out + Heater)	4.98	5.32 (8.08)	5.90
Indoor unit	Input (kW)	0.29	0.29 <2.76>
Indoor unit	Current (A)	1.43	1.43 <12.00>
Outdoor unit	Starting current (A)	65.5	74
Outdoor unit	Current (A)	7.89	8.46
		9.37	9.92

\* ( ) shows the total rating. < > shows the only booster heater rating.

Indoor unit ..... 240V 50Hz Single phase

Outdoor unit .... 415V 50Hz 3 phases

Service Ref.	Indoor unit	PLH-P5AAH.UK	PLH-P6AAH.UK
		PLH-P5AAH <sub>1</sub> .UK	PLH-P6AAH <sub>1</sub> .UK
	PUH-P•GAA.UK		
		5Y	6Y
Mode	Cool	Heat	Cool
Capacity (W)	12,800	14,900 (17,900)	14,300
Total Input (kW) (In + Out) (in + Out + Heater)	5.00	5.34 (8.34)	5.94
Indoor unit	Input (kW)	0.30	0.30 <3.00>
Indoor unit	Current (A)	1.43	1.43 <12.50>
Outdoor unit	Starting current (A)	65.5	74
Outdoor unit	Current (A)	7.60	8.15
		9.03	9.56

\* ( ) shows the total rating. < > shows the only booster heater rating.

#### 4. STANDARD OPERATION DATA

Service Ref.			PLH-P3AAH.UK		PLH-P4AAH.UK		PLH-P5AAH.UK		PLH-P6AAH.UK			
Mode			Cooling	Heating	Cooling	Heating	Cooling	Heating	Cooling	Heating		
Total	Capacity	W	7,800	9,300	9,700	10,600	12,800	16,000	14,300	16,800		
	Input	kW	3.51	3.65	3.62	3.80	5.55	5.93	6.70	6.77		
Electrical circuit	Indoor unit Service Ref.			PLH-P3AAH.UK	PLH-P4AAH.UK	PLH-P5AAH.UK	PLH-P6AAH.UK					
	Phase,Hz			1,50	1,50	1,50	1,50					
	Volts	V	240		240		240		240			
	Amperes	A	0.81		1.25		1.43		1.64			
	Outdoor unit Service Ref.			PUH-P3VGA PUH-P3YGA	PUH-P4YGA	PUH-P5YGA	PUH-P6YGA					
	Phase,Hz			1/3, 50	3, 50	3, 50	3, 50					
	Volts	V	240/415		415		415		415			
Refrigerant circuit	Amperes	A	14.64/5.46	15.43/5.76	5.49	5.79	8.39	8.74	10.17	10.28		
	Discharge pressure	MPa (kgf/cm <sup>2</sup> )	2.30 (23.4)	2.38 (24.3)	1.98 (20.2)	2.12 (21.6)	2.27 (23.2)	2.59 (26.4)	2.27 (23.2)	2.36 (24.1)		
	Suction pressure	MPa (kgf/cm <sup>2</sup> )	0.47 (4.8)	0.39 (4.0)	0.54 (5.5)	0.42 (4.3)	0.46 (4.7)	0.41 (4.21)	0.45 (4.6)	0.41 (4.2)		
	Discharge temperature	°C	81.0	88.0	71.0	7.5	78.6	86.6	80.6	83.5		
	Condensing temperature	°C	44.0	45.0	42.0	47.0	41.0	44.0	45.0	46.0		
	Suction temperature	°C	4.8	0	7.5	0.6	4.4	4.2	2.4	-1.0		
Indoor side	Ref. pipe length	m	5	5	5	5	5	5	5	5		
	Intake air temperature	D.B.	°C	27	20	27	20	27	20	27		
		W.B.	°C	19	15	19	15	19	15	19		
Outdoor side	Discharge air temperature	D.B.	°C	13.4	45.1	14.0	40.1	12.3	49.3	11.3		
	Intake air temperature	D.B.	°C	35	7	35	7	35	7	35		
		W.B.	°C	24	6	24	6	24	6	6		
SHF			0.74	—	0.78	—	0.72	—	0.69	—		
BF			0.13	—	0.12	—	0.10	—	0.09	—		

The unit of pressure has been changed to MPa based on international SI system.

The conversion factor is : 1(MPa)=10.2(kgf/cm<sup>2</sup>)

--	--	--	--	--	--	--	--	--	--

Service Ref.			PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK		PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK		PLH-P5AAH.UK PLH-P5AAH <sub>1</sub> .UK		PLH-P6AAH.UK PLH-P6AAH <sub>1</sub> .UK		
Mode			Cooling	Heating	Cooling	Heating	Cooling	Heating	Cooling	Heating	
Total	Capacity	W	7,800	9,300	9,700	10,600	12,800	14,900	14,300	17,100	
	Input	kW	3.44	3.50	3.69	3.93	5.00	5.34	5.94	6.36	
Electrical circuit	Indoor unit Service Ref.			PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK	PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK	PLH-P5AAH.UK PLH-P5AAH <sub>1</sub> .UK	PLH-P6AAH.UK PLH-P6AAH <sub>1</sub> .UK				
	Phase,Hz			1,50		1,50		1,50		1,50	
	Volts	V	240		240		240		240		
	Amperes	A	0.81		1.25		1.43		1.64		
	Outdoor unit Service Ref.			PUH-P3VGAA.UK PUH-P3YGAA.UK	PUH-P4VGAA.UK PUH-P4YGAA.UK	PUH-P5YGAA.UK	PUH-P6YGAA.UK				
	Phase,Hz			1/3, 50		1/3, 50		3, 50		3, 50	
	Volts	V	240/415		240/415		415		415		
	Amperes	A	14.81/5.29	15.76/5.63	15.71/5.55	16.58/5.86	7.60	8.15	9.03	9.56	
Refrigerant circuit	Discharge pressure		MPa (kgf/cm <sup>2</sup> )	2.30 (23.4)	2.38 (24.3)	1.98 (20.2)	2.12 (21.6)	2.27 (23.2)	2.59 (26.4)	2.27 (23.2)	
	Suction pressure		MPa (kgf/cm <sup>2</sup> )	0.47 (4.8)	0.39 (4.0)	0.54 (5.5)	0.42 (4.3)	0.46 (4.7)	0.41 (4.21)	0.45 (4.6)	
	Discharge temperature		°C	81.0	88.0	71.0	7.5	78.6	86.6	80.6	
	Condensing temperature		°C	44.0	45.0	42.0	47.0	41.0	44.0	45.0	
	Suction temperature		°C	4.8	0	7.5	0.6	4.4	4.2	2.4	
	Ref. pipe length		m	5	5	5	5	5	5	5	
Indoor side	Intake air temperature	D.B.	°C	27	20	27	20	27	20	27	
		W.B.	°C	19	15	19	15	19	15	19	
	Discharge air temperature	D.B.	°C	13.4	45.1	14.0	40.1	12.3	47.3	11.3	
Outdoor side	Intake air temperature	D.B.	°C	35	7	35	7	35	7	35	
		W.B.	°C	24	6	24	6	24	6	24	
SHF			0.74	—	0.78	—	0.72	—	0.69	—	
BF			0.13	—	0.12	—	0.10	—	0.09	—	

The unit of pressure has been changed to MPa based on international SI system.

The conversion factor is : 1(MPa)=10.2(kgf/cm<sup>2</sup>)

## 5. OUTLET AIR SPEED AND COVERAGE RANGE

Service Ref.		PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK	PLH-P4AAH.UK PLH-P4AAH <sub>1</sub> .UK	PLH-P5AAH.UK PLH-P5AAH <sub>1</sub> .UK	PLH-P6AAH.UK PLH-P6AAH <sub>1</sub> .UK
Air flow	m <sup>3</sup> /min	20	28	30	30
Air speed	m/sec.	4.0	4.9	5.2	6.6
Coverage range	m	5.7	7.4	7.9	8.9

\* The air coverage range is the value up to the position where the air speed is 0.25m/sec.


When air is blown out horizontally from the unit at the Hi notch position.

The coverage range should be used only as a general guideline since it varies according to the size of the room and the furniture inside the room.

## 6. NOISE CRITERION CURVES


**PLH-P3AAH.UK**  
**PLH-P3AAH<sub>1</sub>.UK**

NOTCH	SPL(dB)	LINE
High	34	○—○
Medium1	32	△—△
Medium2	30	●—●
Low	28	——

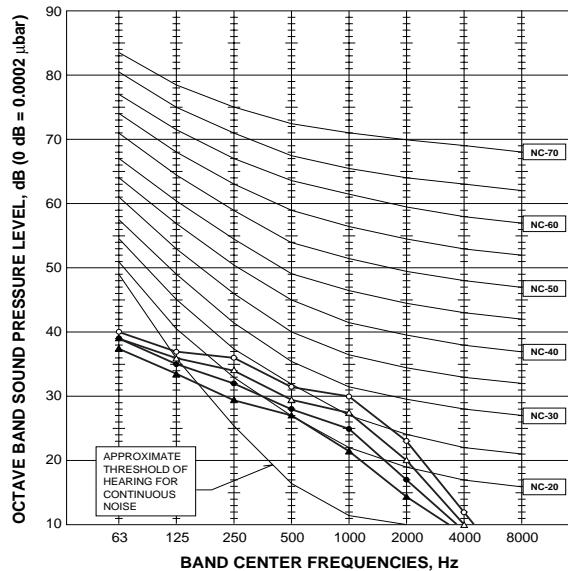


**PLH-P4AAH.UK**  
**PLH-P4AAH<sub>1</sub>.UK**

NOTCH	SPL(dB)	LINE
High	41	○—○
Medium1	39	△—△
Medium2	36	●—●
Low	33	——

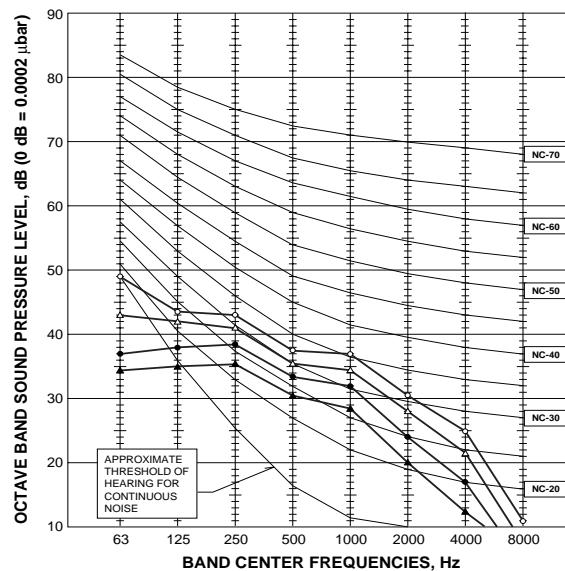



**PLH-P5AAH.UK**  
**PLH-P5AAH<sub>1</sub>.UK**

NOTCH	SPL(dB)	LINE
High	43	○—○
Medium1	41	△—△
Medium2	38	●—●
Low	35	——

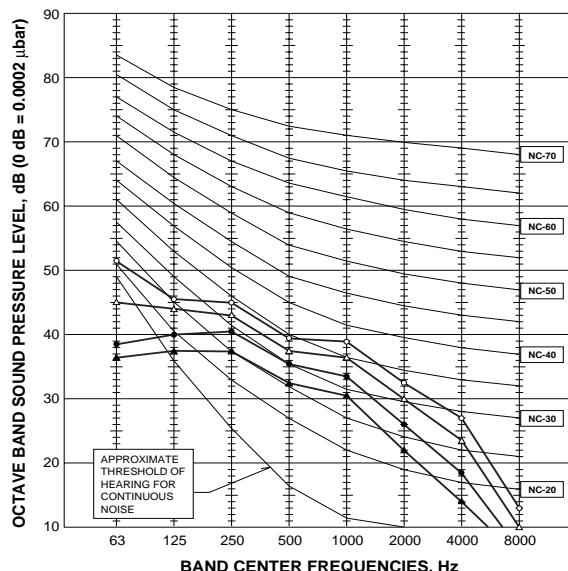

**PLH-P6AAH.UK**  
**PLH-P6AAH<sub>1</sub>.UK**

NOTCH	SPL(dB)	LINE
High	45	○—○
Medium1	43	△—△
Medium2	40	●—●
Low	37	——





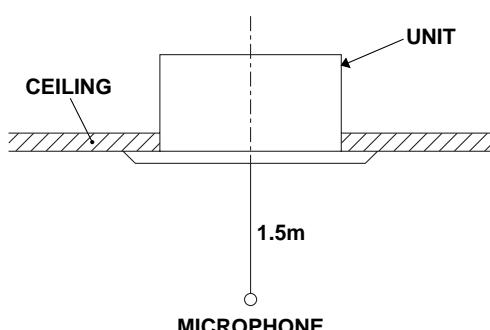
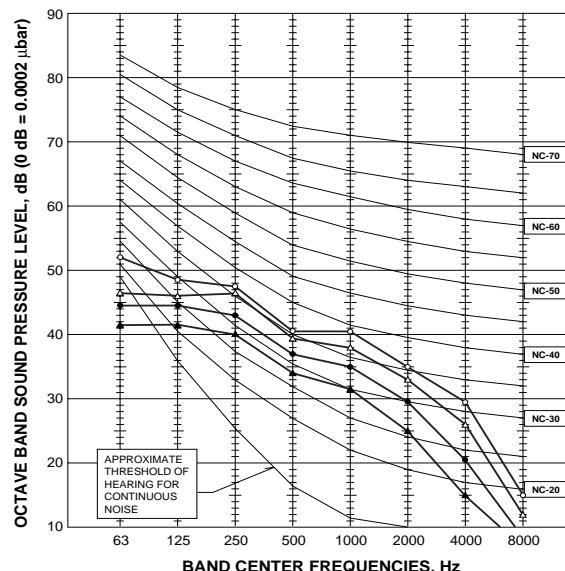


Ambient temperature 27°C

Test conditions are based on JIS Z8731

**PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK  
PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK, PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK**

Unit: mm

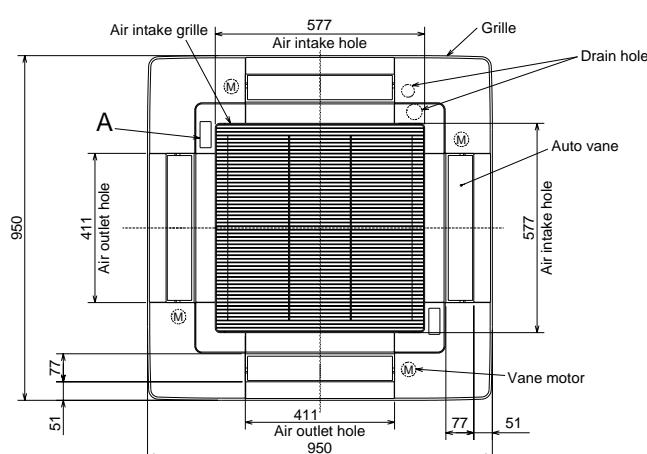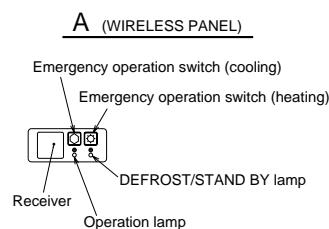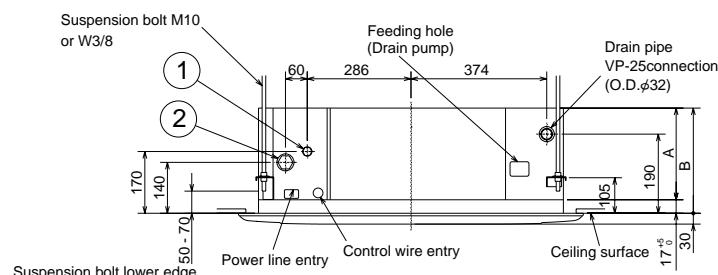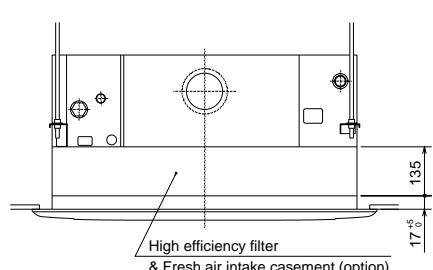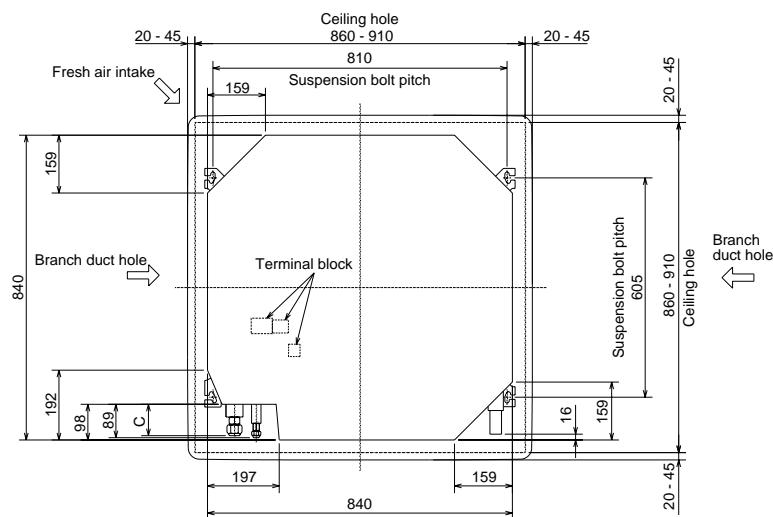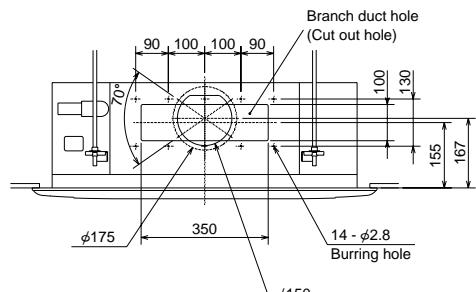


Models	①	②	A	B	C
PLH-P3AAH.UK PLH-P3AAH <sub>1</sub> .UK	Refrigerant pipe (9.52mm dia.) flared connection 3/8F	Refrigerant pipe (15.88mm dia.) flared connection 5/8F	241	258	80
PLH-P4/P5/P6AAH.UK PLH-P4/P5/P6AAH <sub>1</sub> .UK	Refrigerant pipe (9.52mm dia.) flared connection 3/8F	Refrigerant pipe (19.05mm dia.) flared connection 3/4F	281	298	84

**PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK  
PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK, PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK**

\* The part name of symbol "I.B" is "SPCB".

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
P.B	INDOOR POWER BOARD	MV	VANE MOTOR	W.B	WIRELESS REMOTE CONTROLLER BOARD
F1	FUSE(4A)	DP	DRAIN-UP MACHINE	RU	RECEIVING UNIT
ZNR	VARISTOR	DS	DRAIN SENSOR	BZ	BUZZER
I.B	INDOOR CONTROLLER BOARD	H2	DEW PREVENTION HEATER	LED1	LED(RUN INDICATOR)
CN2L	CONNECTOR(LOSSNAY)	TB2	TERMINAL BLOCK(HEATER)	LED2	LED(HOT ADJUST)
CN32	CONNECTOR(REMOTE SWITCH)	TB4	TERMINAL BLOCK(INDOOR/OUTDOOR CONNECTING LINE)	SW1	SWITCH(HEATING ON/OFF)
CN41	CONNECTOR(HA TERMINAL-A)	TB5	TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE)	SW2	SWITCH(COOLING ON/OFF)
SW1	JUMPER WIRE(MODEL SELECTION)	TH1	ROOM TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT)	HEATER	
SW2	JUMPER WIRE(CAPACITY CORD)	TH2	PIPE TEMP.THERMISTOR/LIQUID (0°C/15kΩ,25°C/5.4kΩ DETECT)	FS1	THERMAL FUSE(72°C,16A)
SWE	SWITCH(EMERGENCY OPERATION)	TH5	COND.EVA.TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT)	FS2	THERMAL FUSE(104°C,16A)
X1	RELAY(DRAIN PUMP)	R.B	REMOTE CONTROLLER BOARD	H1	HEATER
X4	RELAY(FAN MOTOR)	CN2	CONNECTOR(PROGRAM TIMER)	26H	HEATER THERMAL SWITCH
FC	FAN PHASE CONTROL	TB6	TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE)	88H	HEATER CONTACTOR
LED1	POWER SUPPLY(I.B)				
LED2	POWER SUPPLY(R.B)				
LED3	TRANSMISSION(INDOOR-OUTDOOR)				
C	CAPACITOR(FAN MOTOR)				
MF	FAN MOTOR				

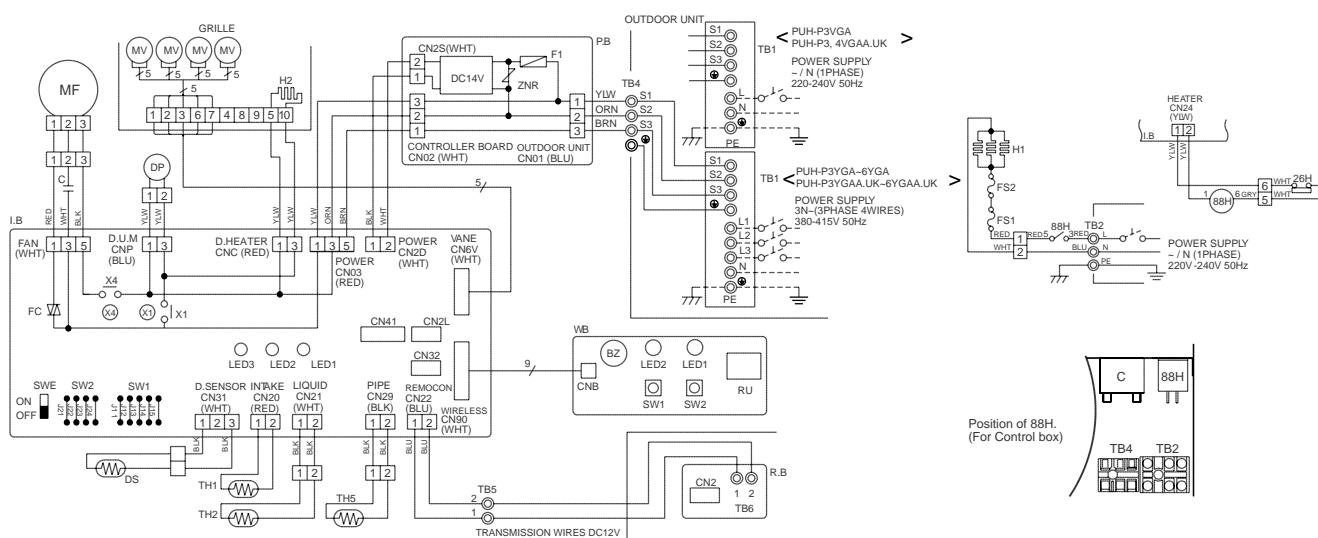


SW1		SW2		Please set the voltage using the remote controller For the setting method, please refer to the indoor unit Installation Manual.	
MODELS	Manufacture	Service board	1 2 3 4	1 2 3 4	ON OFF
PLH-P3,4,5,6AAH.UK		J11J12J13J14J15			
PLH-P3,4,5,6AAH <sub>1</sub> .UK					
PLH-P4AAH.UK		J21J22J23J24			
PLH-P4AAH <sub>1</sub> .UK					
PLH-P5AAH.UK		J21J22J23J24			
PLH-P5AAH <sub>1</sub> .UK					
PLH-P6AAH.UK		J21J22J23J24			
PLH-P6AAH <sub>1</sub> .UK					

**NOTE:**


- Since the outdoor side electric wiring may change be sure to check the outdoor unit electric wiring for servicing.
- Indoor and outdoor connecting wires are made with polarities, make wiring matching terminal numbers (S1, S2, S3).
- Make sure that the main power supply of the booster heater is independent.
- Symbols used in wiring diagram above are,  
◎ : Terminal, □□□ : Connector.

## PLH-P3AAH.UK / PUH-P3VGA, PUH-P3YGA

Unit : mm(inch)

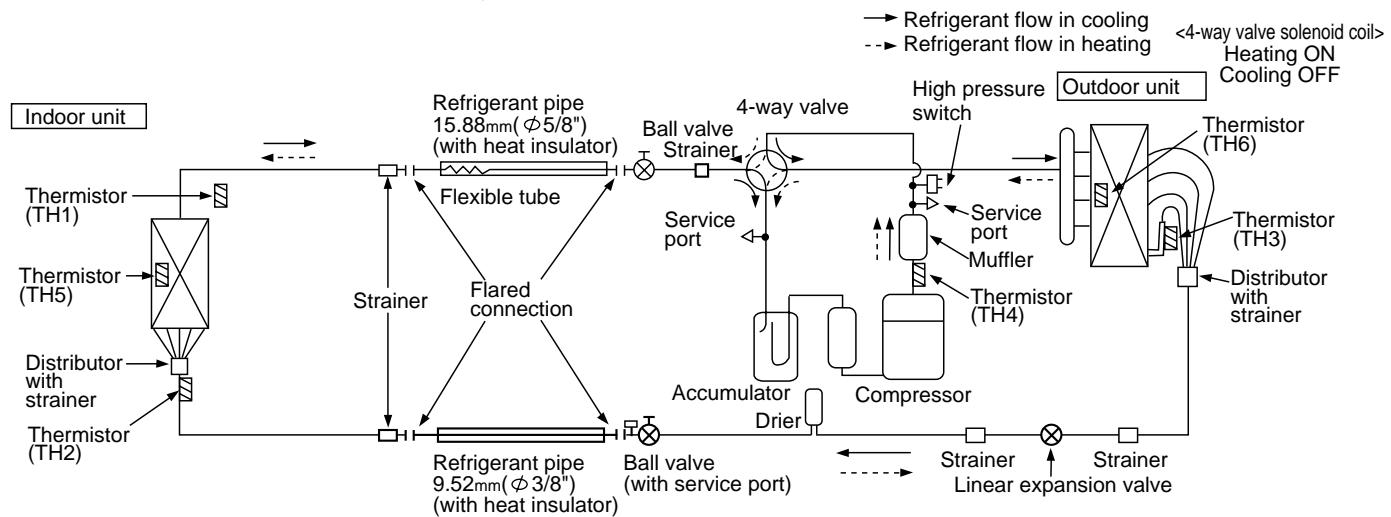


## PLH-P4AAH.UK / PUH-P4YGA

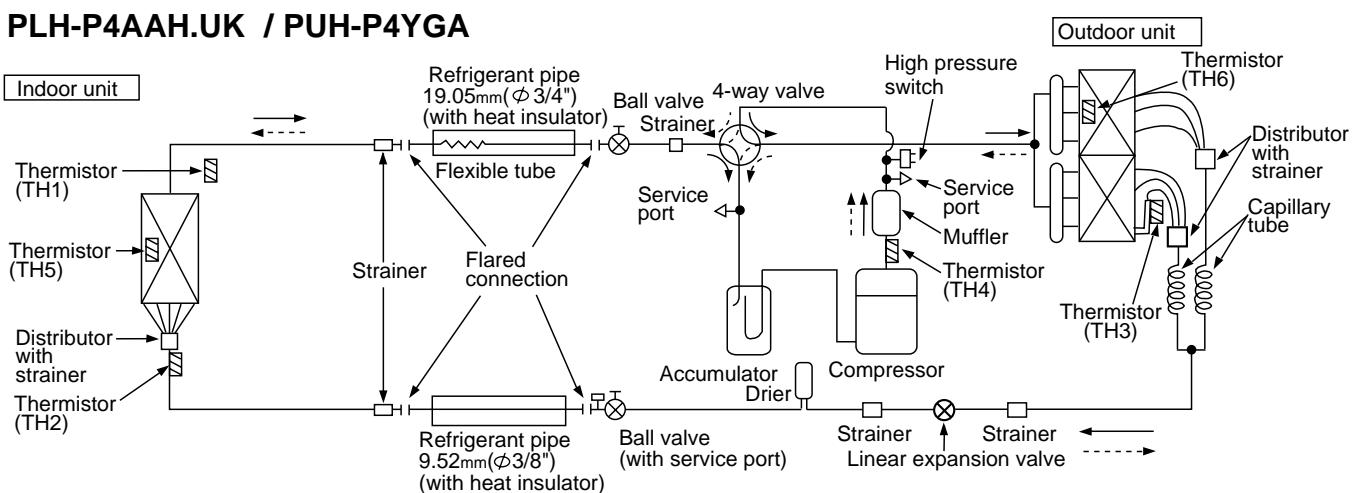


## PLH-P5AAH.UK / PUH-P5YGA

## PLH-P6AAH.UK / PUH-P6YGA

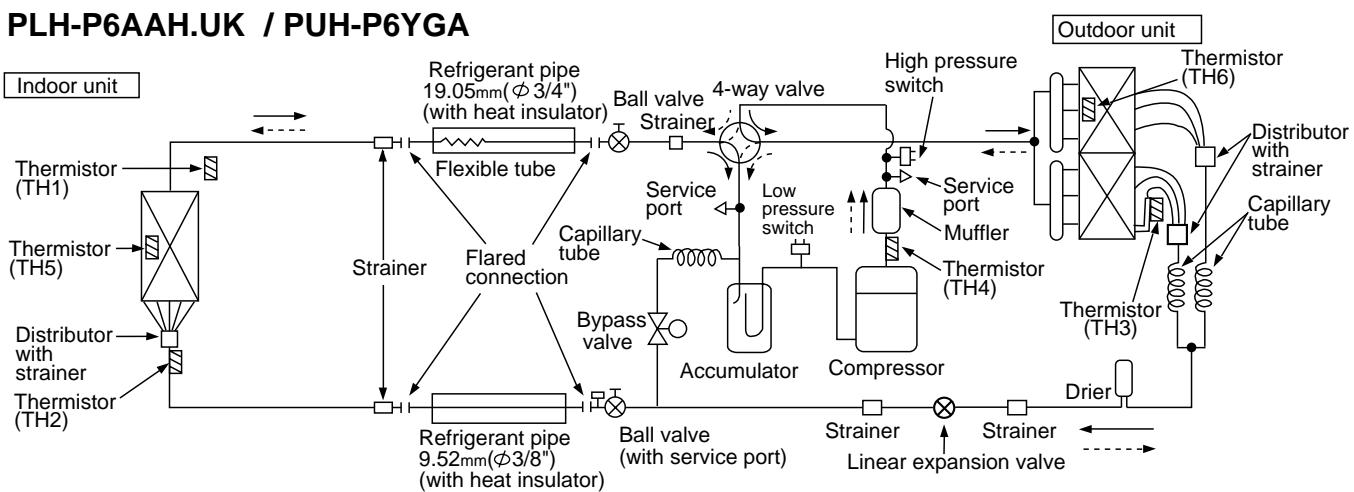


## PLH-P3AAH.UK, PLH-P3AAH<sub>1</sub>.UK / PUH-P3VGAA.UK, PUH-P3YGAA.UK

Unit : mm(inch)

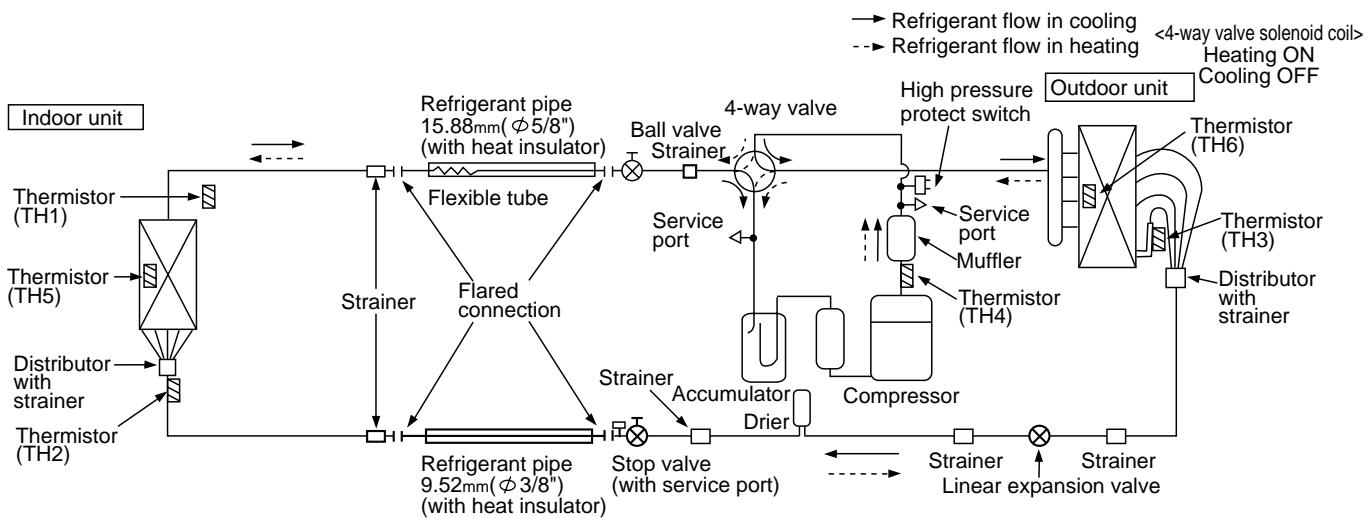


## PLH-P4AAH.UK, PLH-P4AAH<sub>1</sub>.UK / PUH-P4VGAA.UK, PUH-P4YGAA.UK

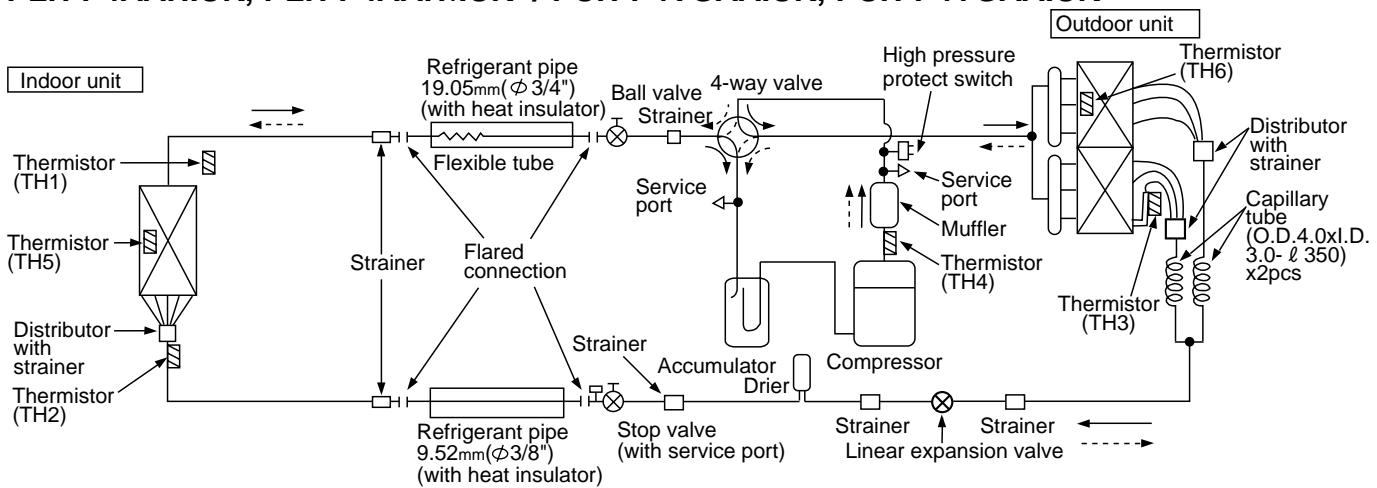




## PLH-P5AAH.UK, PLH-P5AAH<sub>1</sub>.UK / PUH-P5YGAA.UK

## PLH-P6AAH.UK, PLH-P6AAH<sub>1</sub>.UK / PUH-P6YGAA.UK

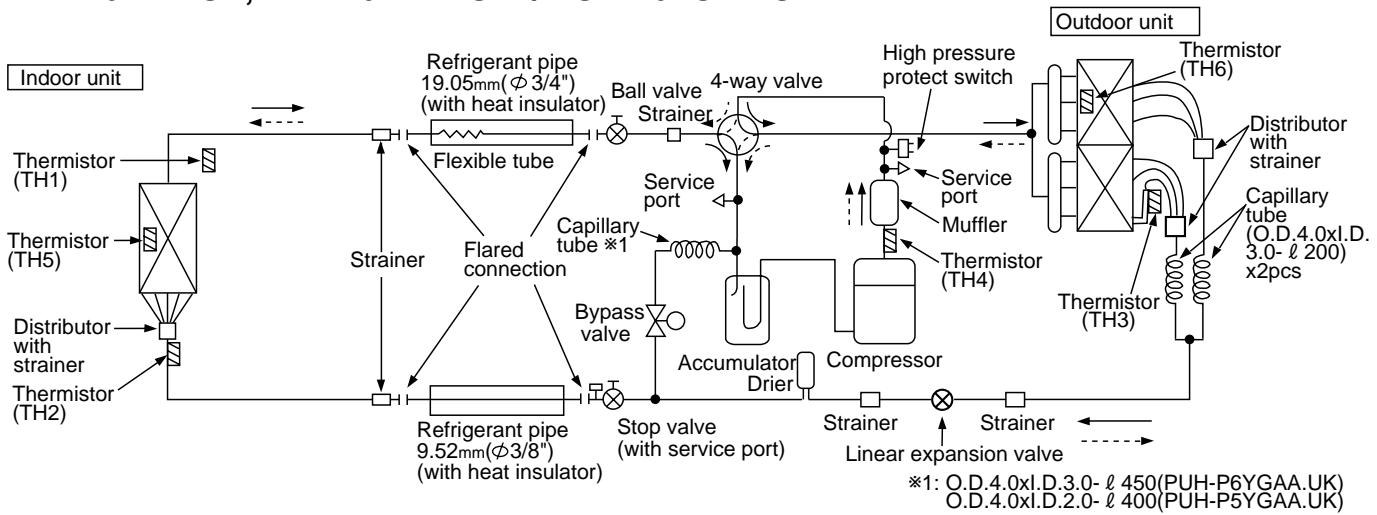

## HOW TO CHECK THE PARTS

PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK  
 PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK, PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK

Parts name	Check points		
Room temperature thermistor (TH1)	Disconnect the connector then measure the resistance using a tester. (Surrounding temperature 10°C ~30°C)		
Pipe temperature thermistor (TH2)	Normal	Abnormal	
Condenser/Evaporator temperature thermistor (TH5)	4.3kΩ~9.6kΩ	Open or short	(Refer to the thermistor)
Vane motor	Measure the resistance between the terminals using a tester. (Surrounding temperature 20°C)		
	Normal	Abnormal	
	15kΩ	Open or short	
Fan motor	Measure the resistance between the terminals using a tester. (Surrounding temperature 20°C)		
	Motor terminal or Relay connector	Normal	Abnormal
	Red-Black	87.2Ω	Open or short
	White-Black	104.1Ω	
Drain pump	Measure the resistance between the terminals using a tester. (Surrounding temperature 20°C)		
	Normal	Abnormal	
	290Ω	Open or short	
Drain sensor	Measure the resistance between the terminals using a tester. Measure the resistance after 3 minutes have passed since the power supply was intercepted. (Surrounding temperature 0°C ~60°C)		
	Normal	Abnormal	
	0.6kΩ~6.0kΩ	Open or short	(Refer to the thermistor)

<Thermistor Characteristic graph>


Thermistor for  
lower temperature

Room temperature thermistor(TH1)  
Pipe temperature thermistor(TH2)  
Condenser/evaporator temperature  
thermistor(TH5)

Thermistor  $R_0=15\text{k}\Omega \pm 3\%$   
Fixed number of  $B=3480\text{K} \pm 2\%$

$$R_t = 15 \exp \left\{ 3480 \left( \frac{1}{273+t} - \frac{1}{273} \right) \right\}$$

0°C	15kΩ
10°C	9.6kΩ
20°C	6.3kΩ
25°C	5.2kΩ
30°C	4.3kΩ
40°C	3.0kΩ

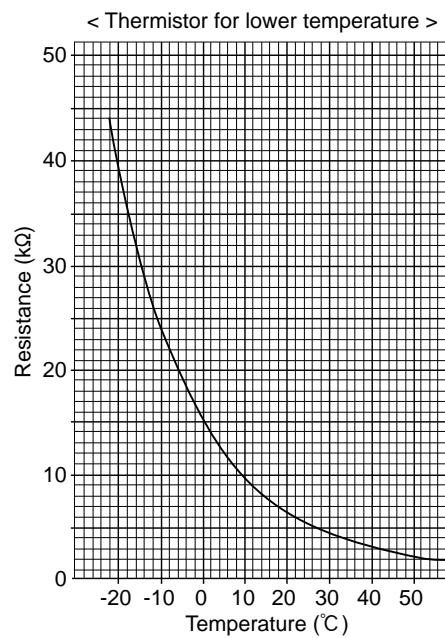


Thermistor for  
drain sensor

Thermistor  $R_0=6.0\text{k}\Omega \pm 5\%$   
Fixed number of  $B=3390\text{K} \pm 2\%$





$$R_t = 6 \exp \left\{ 3390 \left( \frac{1}{273+t} - \frac{1}{273} \right) \right\}$$






0°C	6.0kΩ
10°C	3.9kΩ
20°C	2.6kΩ
25°C	2.2kΩ
30°C	1.8kΩ
40°C	1.3kΩ
60°C	0.6kΩ




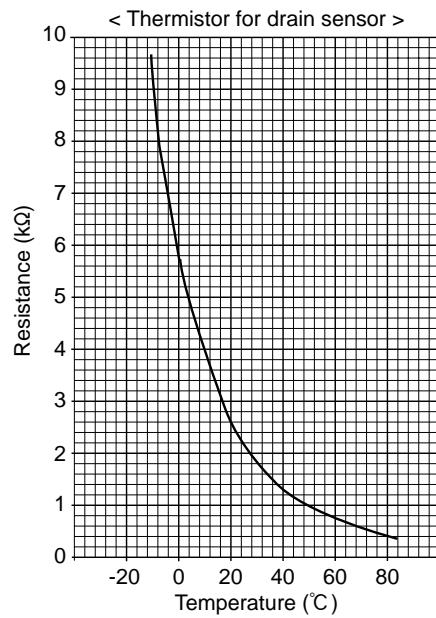


PLH-P3AAH.UK, PLH-P3AAH1.UK


Be careful on removing heavy parts.

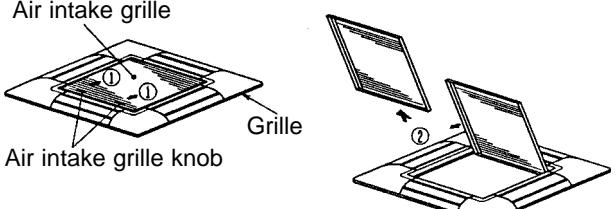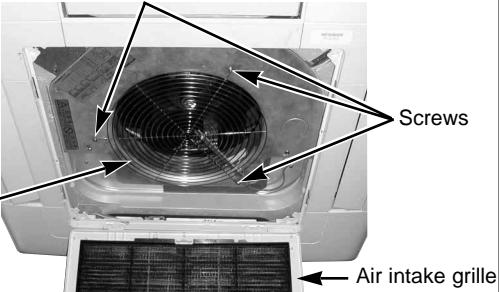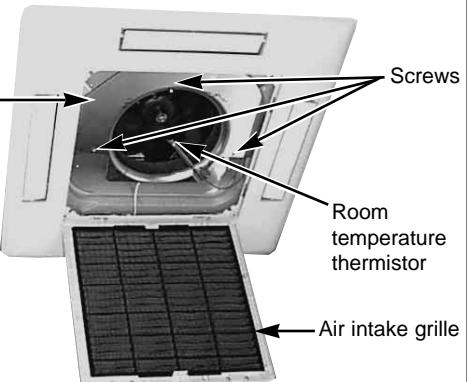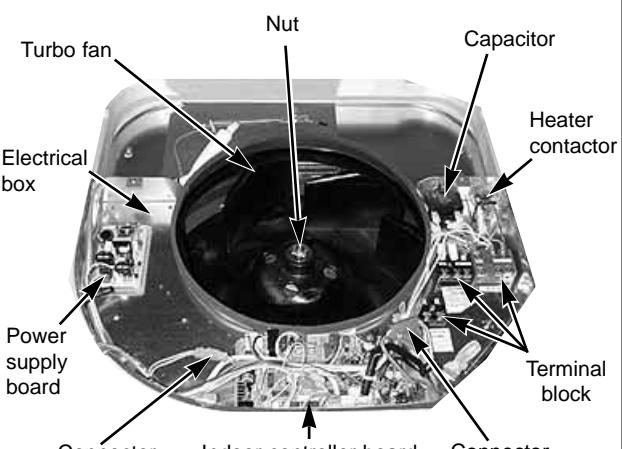OPERATING PROCEDURE	PHOTOS & ILLUSTRATIONS
<b>1. Removing the air intake grille</b> <ol style="list-style-type: none"> <li>(1) Slide the knob of air intake grille toward the arrow ① to open the air intake grille.</li> <li>(2) Remove drop prevention hook from the panel.</li> <li>(3) Slide the shaft in the hinge to the direction of the arrow② and remove the air intake grille.</li> </ol>	<p><b>Figure 1</b></p> 
<b>2. Removing the fan guard</b> <ol style="list-style-type: none"> <li>(1) Open the air intake grille.</li> <li>(2) Remove the 3 screws of fan guard.</li> </ol>	<p><b>Photo 1</b></p> 
<b>3. Removing the room temperature thermistor</b> <ol style="list-style-type: none"> <li>(1) Remove the fan guard.(See photo 1)</li> <li>(2) Remove the screw in the room temperature thermistor holder to remove the holder and the room temperature thermistor.</li> <li>(3) Remove the 1 screw from the bell mouth, and unscrew the other 2 screws (fix to the oval hole which has a different diameter) to remove the bell mouth.</li> <li>(4) Hold the holder claw, and remove the room temperature thermistor and holder.</li> <li>(5) Disconnect the connector (red) from the indoor control board.</li> </ol>	<p><b>Photo 2</b></p> 
<b>4. Removing the electrical box</b> <ol style="list-style-type: none"> <li>(1) Remove the fan guard.(See photo 1)</li> <li>(2) Disconnect the lead wire of the vane motor from the clamp, and disconnect the white connector (8P).</li> <li>(3) Remove the room temperature thermistor with the holder.</li> <li>(4) Remove the bell mouth.(See photo 2)</li> <li>(5) Disconnect the relay connector in the electrical box. Red (3P) for ran motor power supply White (2P) for pipe temperature detecting thermistor Blue (2P) for drain pump White (3P) for drain sensor Green (6P) for auxiliary heater</li> <li>(6) Remove the 3 screws of the electrical box and loosen the other 2 screws to remove the box. &lt;Electrical parts in the electrical box&gt; Indoor controller board Power supply board Terminal block Capacitor Heater contactor</li> </ol>	<p><b>Photo 3</b></p> 

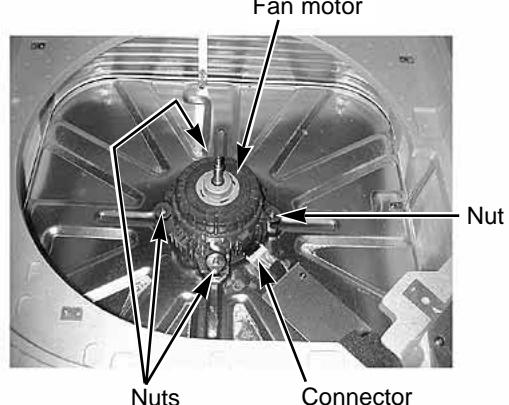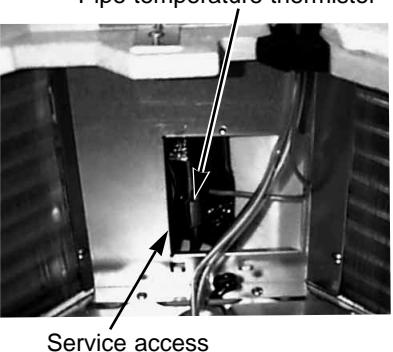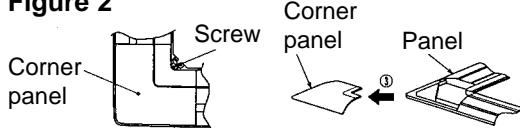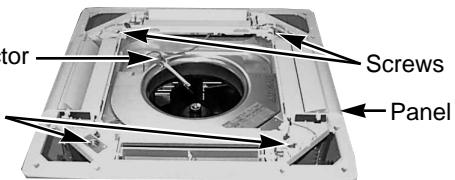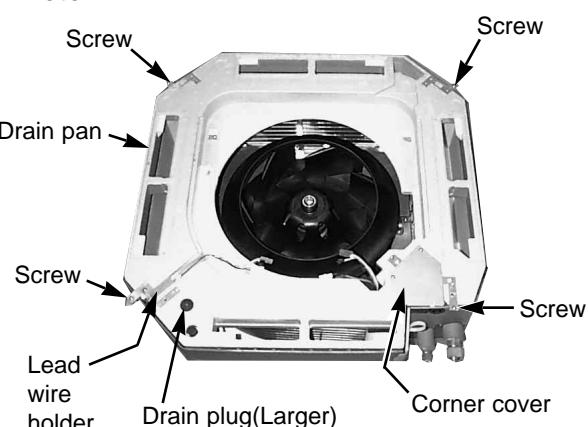OPERATING PROCEDURE	PHOTOS & ILLUSTRATIONS
<p><b>5. Remove the fan motor</b></p> <ul style="list-style-type: none"> <li>(1) Remove the fan guard.(See photo 1)</li> <li>(2) Remove the bell mouth.(See photo 2)</li> <li>(3) Remove the electrical box.(See photo 3)</li> <li>(4) Remove the turbo fan nut.</li> <li>(5) Pull out the turbo fan.</li> <li>(6) Disconnect the connector of the fan motor lead wire.</li> <li>(7) Remove the 4 nuts of the fan motor.</li> </ul>	<p><b>Photo 4</b></p> 
<p><b>6. Removing the pipe temperature thermistor and condenser evaporator temperature thermistor</b></p> <ul style="list-style-type: none"> <li>(1) Remove the fan guard.(See photo 1)</li> <li>(2) Remove the bell mouth.(See photo 2)</li> <li>(3) Remove the electrical box.(See photo 3)</li> <li>(4) Remove the turbo fan.</li> <li>(5) Remove the screw of the service panel.</li> <li>(6) Remove the service panel.</li> <li>(7) Remove the pipe temperature thermistor which is inserted into the holder installed to the thin copper pipe.</li> <li>(8) Disconnect the 2-pin white connector.</li> </ul>	<p><b>Photo 5</b></p> 
<p><b>7. Removing the panel</b></p> <ul style="list-style-type: none"> <li>(1) Remove the air intake grille.(See figure 1)</li> <li><b>Corner panel (See figure 2)</b></li> <ul style="list-style-type: none"> <li>(1) Remove the corner screw.</li> <li>(2) Slide the corner panel to the direction of the arrow③, and remove the corner panel.</li> </ul> <li><b>Panel (See photo 6)</b></li> <ul style="list-style-type: none"> <li>(1) Disconnect the connector that connects with the unit.</li> <li>(2) Remove the 2 screws from the panel and loosen another 2 screws, which fix to the oval holes, have different diameters.</li> <li>(3) Rotate the panel a little to remove the panel.</li> </ul> </ul>	<p><b>Figure 2</b></p>  <p><b>Photo 6</b></p> 
<p><b>8. Removing the drain pan</b></p> <ul style="list-style-type: none"> <li>(1) Remove the panel. (See photo 6)</li> <li>(2) Remove the drain plug (Larger one), drain the remaining water in the drain pan.</li> <li>(3) Remove the corner cover. (2 screws)</li> <li>(4) Remove the bell mouth (See photo 2)</li> <li>(5) Remove the electrical box. (See photo 3)</li> <li>(6) Remove the lead wire holder. (1 screw)</li> <li>(7) Remove the 4 screws and pull out the drain pan.</li> </ul> <p>* Pull out the left and right of the pan gradually. Be careful not to crack or damage the pan.</p>	<p><b>Photo 7</b></p> 

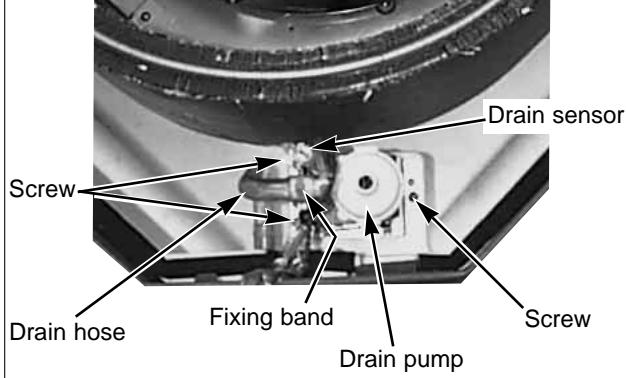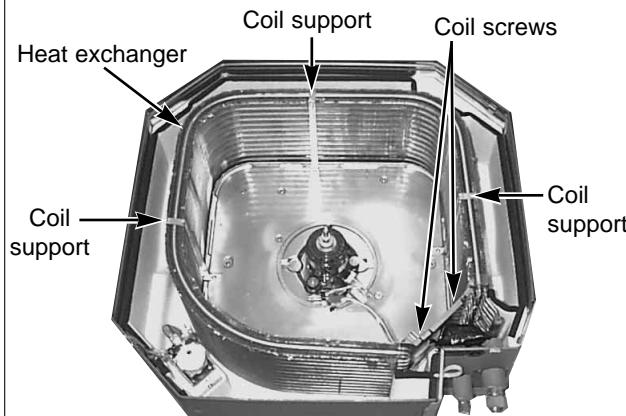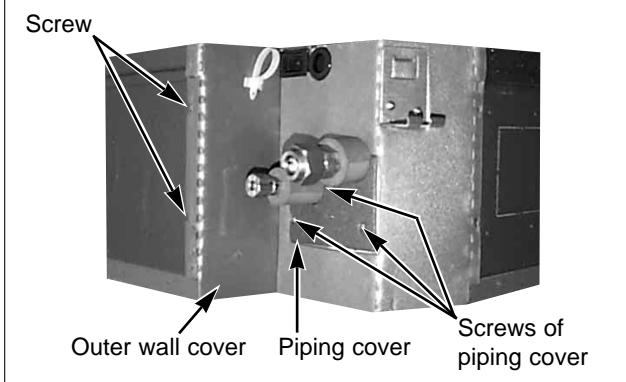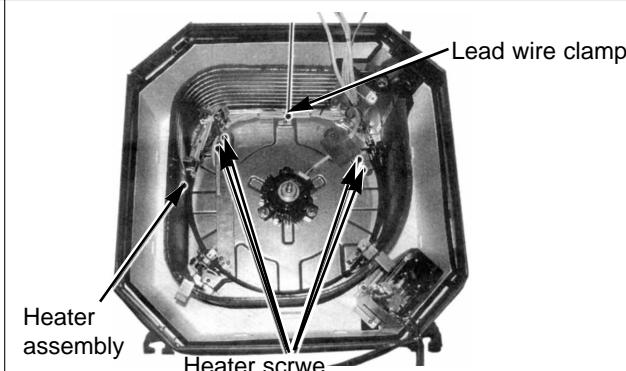OPERATING PROCEDURE	PHOTOS & ILLUSTRATIONS
<p><b>9. Removing the drain pump and drain sensor</b></p> <p>(1) Remove the panel. (See photo 6)  (2) Remove the fan guard. (See photo 1)  (3) Remove the bell mouth. (See photo 2)  (4) Remove the electrical box. (See photo 3)  (5) Remove the drain pan. (See photo 7)  (6) Remove the 3 screws of the drain pump.  (7) Cut the drain hose band, pull out the drain hose from the drain pump.  (8) Pull out the drain pump.  (9) Remove the drain sensor and the holder.</p>	<p><b>Photo 8</b></p> 
<p><b>10. Removing the heat exchanger</b></p> <p>(1) Remove the panel. (See photo 6)  (2) Remove the fan guard. (See photo 1)  (3) Remove the bell mouth. (See photo 2)  (4) Remove the electrical box. (See photo 3)  (5) Remove the drain pan. (See photo 7)  (6) Remove the turbo fan. (See photo 4)  (7) Remove the 3 screws of the piping cover, and pull out piping cover.  (8) Remove the 4 screws of the outer wall cover, and pull out the outer wall cover.  (9) Remove the screw of the coil support.  (10) Remove the 2 screws of the coil.  (11) Pull out the heat exchanger.</p>	<p><b>Photo 9</b></p>  <p><b>Photo 10</b></p> 
<p><b>11. Removing the heater</b></p> <p>(1) Remove the panel. (See photo 6)  (2) Remove the electrical box. (See photo 3)  (3) Remove the bell mouth.(See photo 2)  (4) Remove the drain pan.(See photo 7)  (5) Remove the turbo fan.(See photo 4)  (6) Remove the 5 screws of the heater assembly.  (7) Remove the clamp(1 screw) securing the lead wire.  (8) Pull the heater assembly out..</p>	


PLH-P3AAH.UK, PLH-P4AAH.UK, PLH-P5AAH.UK, PLH-P6AAH.UK  
 PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK, PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK

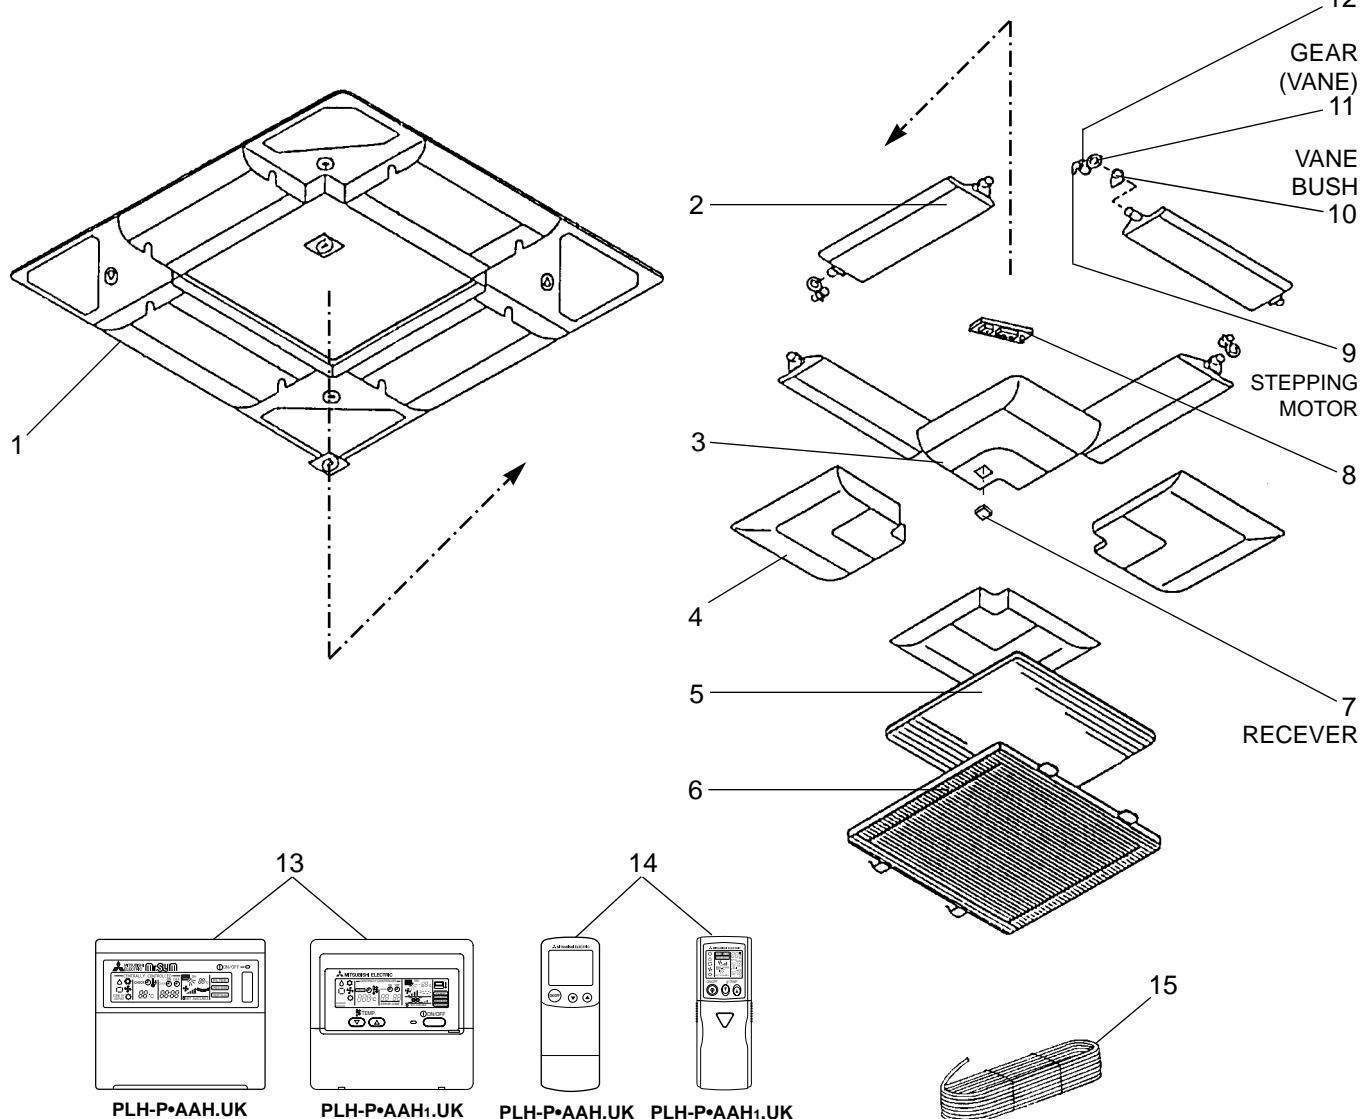

No.	Parts No.	Parts Name	Specification	Q'ty / set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price						
				PLH -P3/4/5/6													
				AAH.UK	AAH <sub>1</sub> .UK	WIRED	WIRELESS										
1	S70 E10 003	AIR OUTLET GRILLE		1	1	1	1										
2	S70 E01 002	VANE ASSY		4	4	4	4										
3	S70 E01 638	CORNER PANEL		1	2	1	2										
4	S70 E00 638	CORNER PANEL		3	2	3	2										
5	S70 E00 500	L.L FILTER-A		1	1	1	1										
6	S70 E00 691	GRILLE ASSY		1	1	1	1										
7	S70 24K 658	RECEIVER			1		1		RU								
8	S70 E00 317	WIRELESS ADAPTER			1		1		W.B								
9	S70 E00 223	STEPPING MOTOR		4	4	4	4		MV								
10	S70 E00 063	VANE BUSH		8	8	8	8										
11	S70 E00 040	GEAR (VANE)		4	4	4	4										
12	S70 E01 040	GEAR		4	4	4	4										
13	S70 E03 713	REMOTE CONTROLLER ASSY	PAR-S27A-E	1					R.B								
13	S70 E13 713	REMOTE CONTROLLER ASSY	PAR-20MAA-E			1			R.B								
14	S70 E05 714	WIRELESS REMOTE CONTROLLER ASSY	PAR-SL95A-E		1												
14	S70 E15 714	WIRELESS REMOTE CONTROLLER ASSY	PAR-SL97A-E				1										
15	S70 58A 246	CORD		1	1	1	1										

## FUNCTIONAL PARTS


PLH-P3AAH.UK, PLH-P4AAH.UK,  
PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK

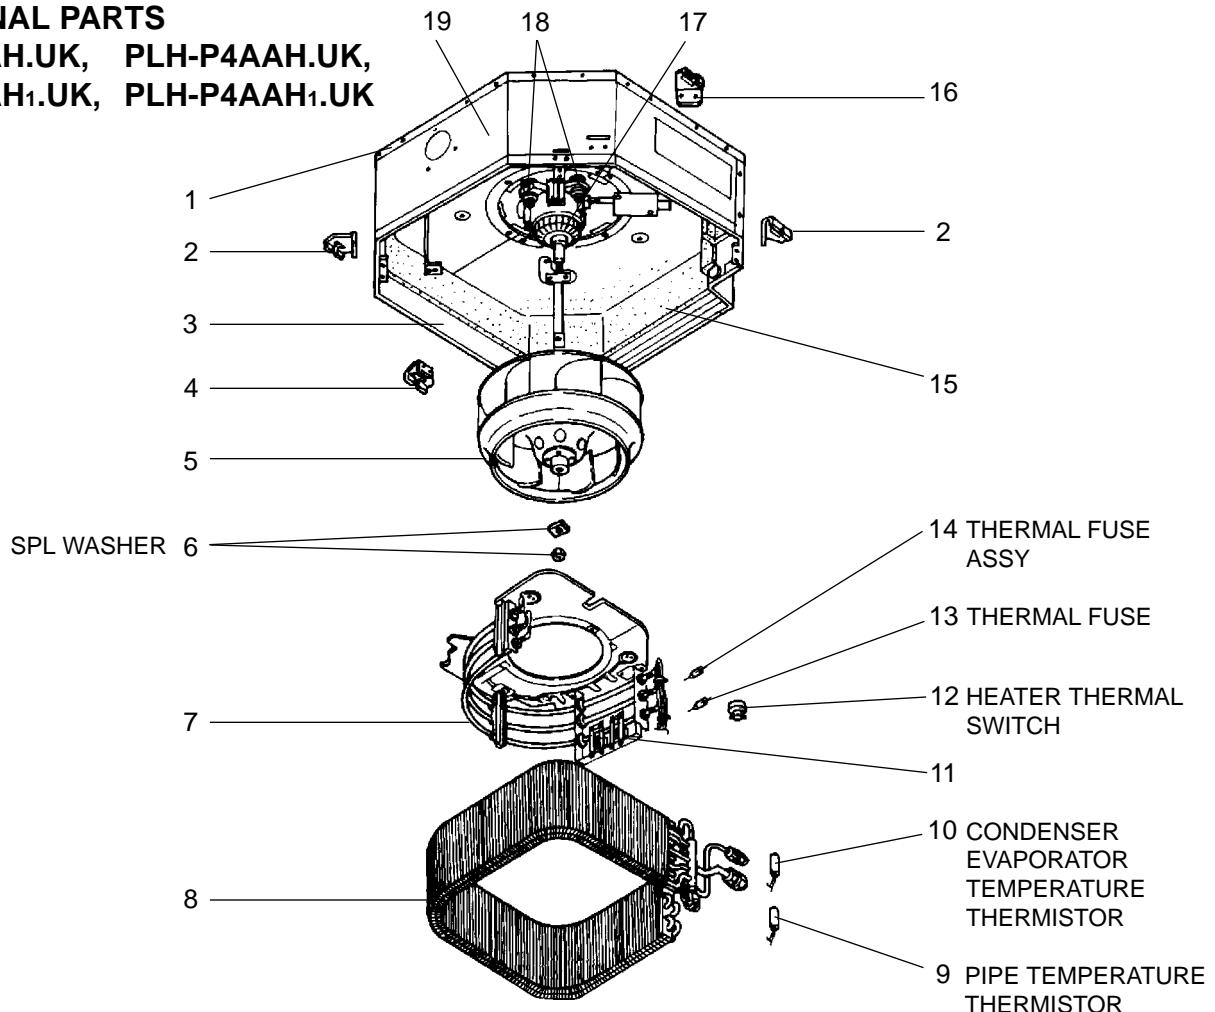

No.	Parts No.	Parts Name	Specification	Q'ty / set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price				
				PLH -P3		PLH -P4					Unit	Amount			
				AAH.UK	AAH <sub>1</sub> .UK	AAH.UK	AAH <sub>1</sub> .UK								
1	S70 003 687	BASE		1	1	1	1								
2	S70 E01 130	LEG		2	2	2	2								
3	S70 005 688	DRUM 1 ASSY		1	1										
	S70 007 688	DRUM 1 ASSY				1	1								
4	S70 E00 130	LEG		1	1	1	1								
5	S70 E00 114	TURBO FAN		1	1										
	S70 E01 114	TURBO FAN				1	1								
6	S70 08K 097	SPL WASHER		1	1	1	1								
7	S70 E07 300	HEATER ELEMENT	240V/700W	3	3					H1					
	S70 E06 300	HEATER ELEMENT	240V/867W			3	3			H1					
8	S70 E20 480	HEAT EXCHANGER		1	1										
	S70 E21 480	HEAT EXCHANGER				1	1								
9	S70 17J 202	PIPE TEMPERATURE THERMISTOR		1	1	1	1			TH2					
10	S70 E20 202	CONDENSER EVAPORATOR TEMPERATURE THERMISTOR		1	1	1	1			TH5					
11	S70 20J 303	INSULATOR		1	1	1	1								
12	S70 46K 700	HEATER THERMAL SWITCH	50°C OFF	1	1	1	1			26H					
13	S70 E02 706	THERMAL FUSE	104°C, 16A	1	1	1	1			FS2					
14	S70 E03 706	THERMAL FUSE	72°C, 16A	1	1	1	1			FS1					
15	S70 E01 659	INNER COVER				1	1								
	S70 E03 659	INNER COVER					1	1							
16	S70 E02 130	LEG		1	1	1	1								
17	S70 E06 762	FAN MOTOR	D17B6P70MS	1	1					MF					
	S70 E07 762	FAN MOTOR	D176P120MS			1	1			MF					
18	S70 A41 105	MOTOR MOUNT		4	4	4	4								
19	S70 006 688	DRUM 2 ASSY		1	1										
	S70 008 688	DRUM 2 ASSY				1	1								

## FUNCTIONAL PARTS


PLH-P5AAH.UK  
PLH-P5AAH1.UK  
PLH-P6AAH.UK  
PLH-P6AAH1.UK

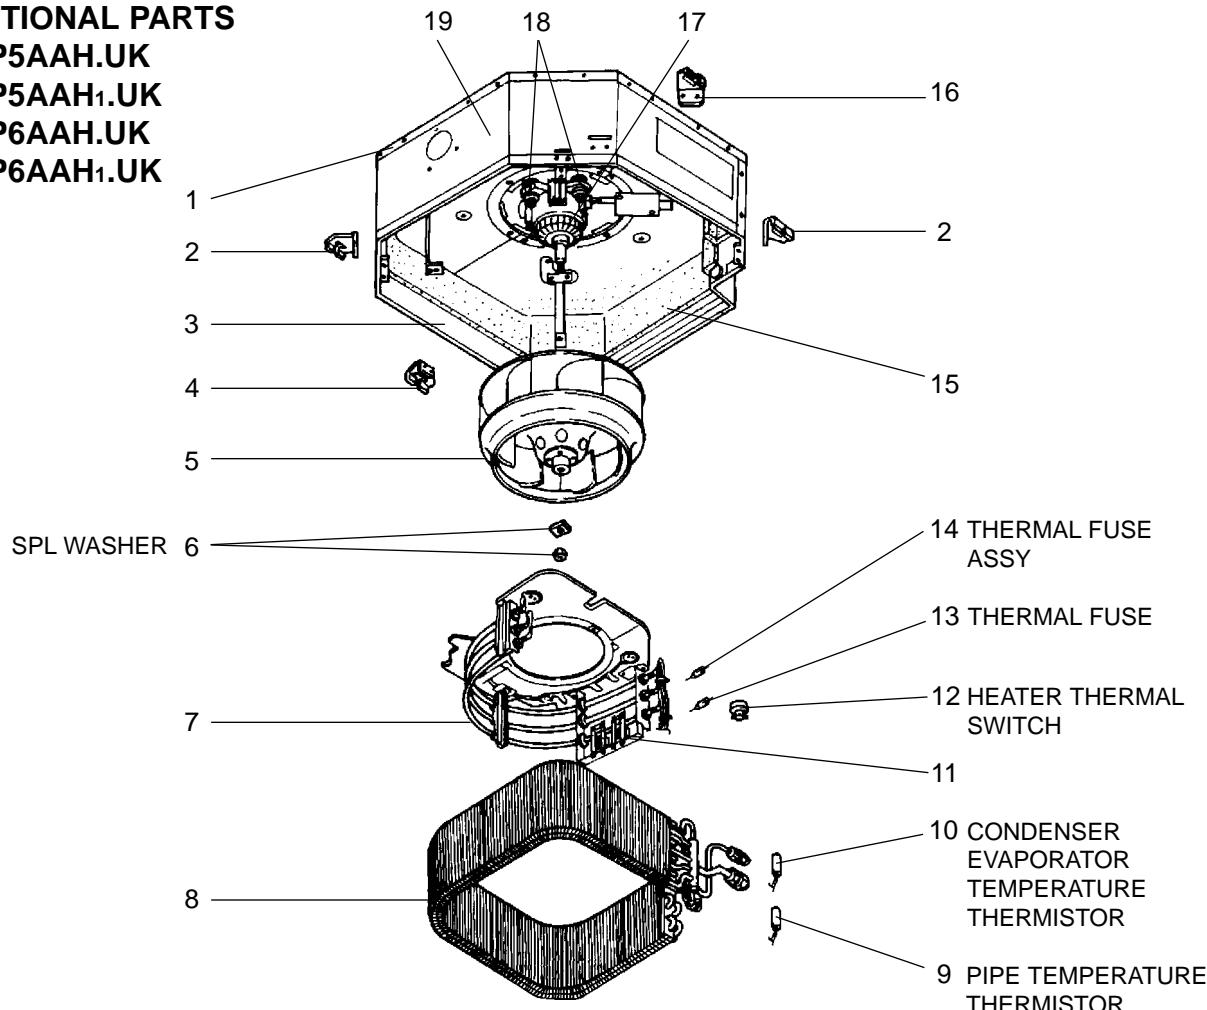

No.	Parts No.	Parts Name	Specification	Q'ty / set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price				
				PLH -P5		PLH -P6					Unit	Amount			
				AAH.UK	AAH.UK	AAH.UK	AAH.UK								
1	S70 003 687	BASE		1	1	1	1								
2	S70 E01 130	LEG		2	2	2	2								
3	S70 007 688	DRUM 1 ASSY		1	1	1	1								
4	S70 E00 130	LEG		1	1	1	1								
5	S70 E01 114	TURBO FAN		1	1	1	1								
6	S70 08K 097	SPL WASHER		1	1	1	1								
7	S70 E05 300	HEATER ELEMENT	240V/1000W	3	3	3	3		H1						
8	S70 E24 480	HEAT EXCHANGER		1	1										
8	S70 E25 480	HEAT EXCHANGER					1	1							
9	S70 17J 202	PIPE TEMPERATURE THERMISTOR		1	1	1	1		TH2						
10	S70 E20 202	CONDENSER EVAPORATOR TEMPERATURE THERMISTOR		1	1	1	1		TH5						
11	S70 20J 303	INSULATOR		1	1	1	1								
12	S70 46K 700	HEATER THERMAL SWITCH	50°C OFF	1	1	1	1		26H						
13	S70 E02 706	THERMAL FUSE	104°C, 16A	1	1	1	1		FS2						
14	S70 E03 706	THERMAL FUSE	72°C, 16A	1	1	1	1		FS1						
15	S70 E03 659	INNER COVER		1	1	1	1								
16	S70 E02 130	LEG		1	1	1	1								
17	S70 E07 762	FAN MOTOR	D176P120MS	1	1	1	1		MF						
18	S70 A41 105	MOTOR MOUNT		4	4	4	4								
19	S70 008 688	DRUM 2 ASSY		1	1	1	1								

## FUNCTIONAL PARTS

PLH-P3AAH.UK, PLH-P4AAH.UK,  
PLH-P3AAH<sub>1</sub>.UK, PLH-P4AAH<sub>1</sub>.UK

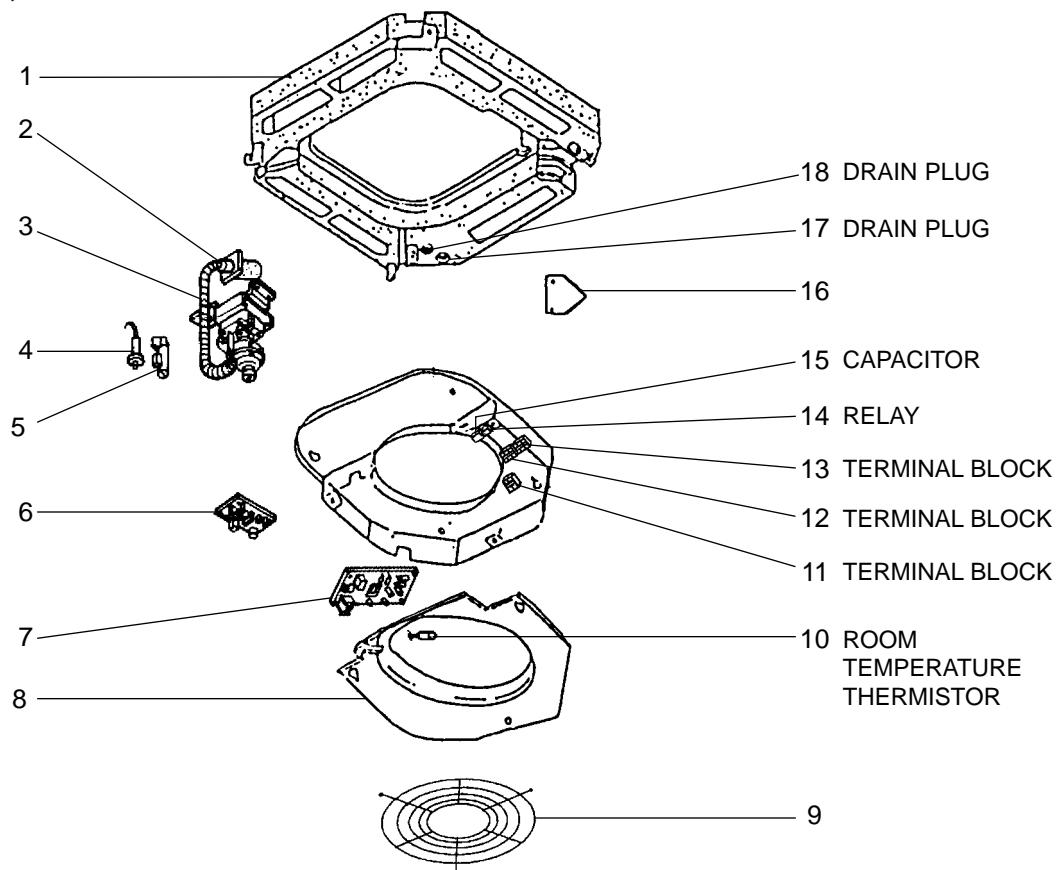


Part number that is circled is not shown in the figure.

No.	Parts No.	Parts Name	Specification	Q'ty / set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price				
				PLH -P3		PLH -P4					Unit	Amount			
				AAH.UK	AAH <sub>1</sub> .UK	AAH.UK	AAH <sub>1</sub> .UK								
1	S70 E02 529	DRAIN PAN		1	1										
	S70 E00 529	DRAIN PAN				1	1								
2	S70 29H 523	DRAIN SOCKET		1	1	1	1								
3	S70 E02 355	DRAIN PUMP		1	1	1	1		DP						
4	S70 E00 266	DRAIN SENSOR		1	1	1	1		DS						
5	S70 31K 241	DRAIN SENSOR HOLDER		1	1	1	1								
6	S70 E20 313	POWER BOARD		1	1	1	1		P.B						
7	S70 E20 310*	INDOOR CONTROLLER BOARD		1	1	1	1		I.B *						
8	S70 003 503	CONTROL COVER ASSY		1	1	1	1								
9	S70 E10 675	FAN GUARD		1	1	1	1								
10	S70 E00 202	ROOM TEMPERATURE THERMISTOR		1	1	1	1		TH1						
11	S70 512 716	TERMINAL BLOCK	2P (1, 2)	1	1	1	1		TB5						
12	S70 E01 716	TERMINAL BLOCK	3P (S1, S2, S3)	1	1	1	1		TB4						
13	S70 A14 716	TERMINAL BLOCK	2P (L, N)	1	1	1	1		TB2						
14	S70 71G 215	RELAY	JC-1A DC12V	1	1	1	1		88H						
15	S70 17T 255	CAPACITOR	3.5μF 440V	1	1				C						
	S70 E02 255	CAPACITOR	7.0μF 440V			1	1		C						
16	S70 001 663	CORNER COVER		1	1	1	1								
17	S70 A48 524	DRAIN PLUG		1	1	1	1								
18	S70 A41 524	DRAIN PLUG		1	1	1	1								
19	S70 W29 527	DRAIN HOSE		1	1	1	1								

\* The part name of symbol "I.B" is "SPCB".

## FUNCTIONAL PARTS

PLH-P5AAH.UK, PLH-P6AAH.UK  
PLH-P5AAH<sub>1</sub>.UK, PLH-P6AAH<sub>1</sub>.UK

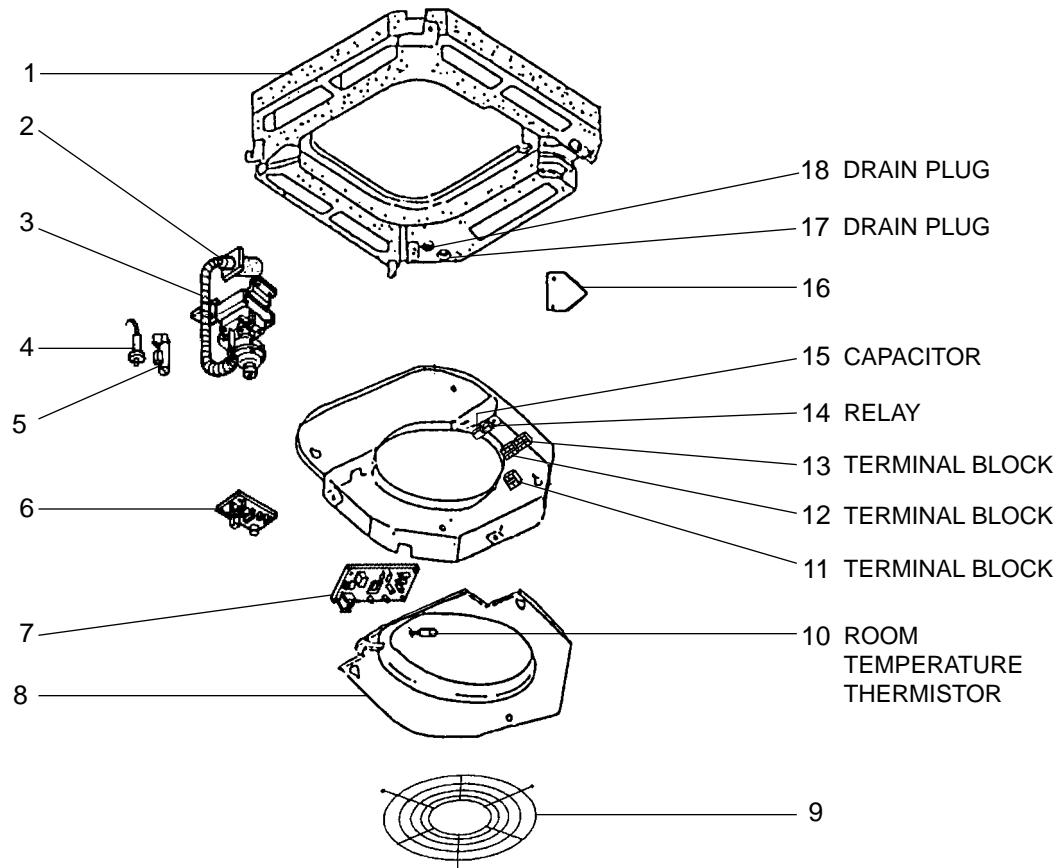

Part number that is circled is not shown in the figure.

No.	Parts No.	Parts Name	Specification	Q'ty / set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price				
				PLH -P5		PLH -P6					Unit	Amount			
				AAH.UK	AAH <sub>1</sub> .UK	AAH.UK	AAH <sub>1</sub> .UK								
1	S70 E00 529	DRAIN PAN		1	1										
	S70 E01 529	DRAIN PAN				1	1								
2	S70 29H 523	DRAIN SOCKET		1	1	1	1								
3	S70 E02 355	DRAIN PUMP		1	1	1	1		DP						
4	S70 E00 266	DRAIN SENSOR		1	1	1	1		DS						
5	S70 31K 241	DRAIN SENSOR HOLDER		1	1	1	1								
6	S70 E20 313	POWER BOARD		1	1	1	1		P.B						
7	S70 E20 310*	INDOOR CONTROLLER BOARD		1	1	1	1		I.B *						
8	S70 003 503	CONTROL COVER ASSY		1	1	1	1								
9	S70 E10 675	FAN GUARD		1	1	1	1								
10	S70 E00 202	ROOM TEMPERATURE THERMISTOR		1	1	1	1		TH1						
11	S70 512 716	TERMINAL BLOCK	2P (1, 2)	1	1	1	1		TB5						
12	S70 E01 716	TERMINAL BLOCK	3P (S1, S2, S3)	1	1	1	1		TB4						
13	S70 A14 716	TERMINAL BLOCK	2P (L, N)	1	1	1	1		TB2						
14	S70 71G 215	RELAY	JC-1A DC12V	1	1	1	1		88H						
15	S70 E02 255	CAPACITOR	7.0μF 440V	1	1	1	1		C						
16	S70 001 663	CORNER COVER		1	1	1	1								
17	S70 A48 524	DRAIN PLUG		1	1	1	1								
18	S70 A41 524	DRAIN PLUG		1	1	1	1								
19	S70 W29 527	DRAIN HOSE		1	1	1	1								

\* The part name of symbol "I.B" is "SPCB".

## 1. Program timer (PLH-P3 / 4 / 5 / 6AAH.UK)

Part No.	PAC-SC32PTA (with set back function)
Applied Service Ref.	PLH-P3 / 4 / 5 / 6AAH.UK

### 1-1 Program timer specifications

Part name	Program timer
Parts No.	PAC-SC32PTA
Exterior dimensions (inch)	5-4/32X4-23/32X23/32 (130X120X18mm)
Installation	Wall mount
Type of clock	Quartz
Clock accuracy	±50 second / month at 25°C
Display-Time	Liquid crystal display
-Week	Liquid crystal display
-Timer setting unit	Liquid crystal display
Program cycle	24 hours
Timer setting unit	30 minutes
No. of set points	48 / day
Power rating	5V DC ±5% (Supplied by Remote Controller)

### 1-2 Feature of program timer

#### (1) Daily timer function

Daily timer can be set in 30 minutes units for up to 24 hours.  
Each unit can be set for unit ON, unit OFF, or setback operation.

#### (2) Setback operation

Set back operation is useful for reducing running costs

e.g. At a hotel with a 24-hour system


8:00~23:00 Cooling operation with set temperature at 26°C

23:00~8:00 Setback operation with 2 degrees of setback

As shown in the chart on the right, the set temperature rises 2 degrees automatically during the setback operation. When the setback operation ends, normal operation will begin.

#### (3) Weekly timer function


Daily timer function can apply to each day of the week.

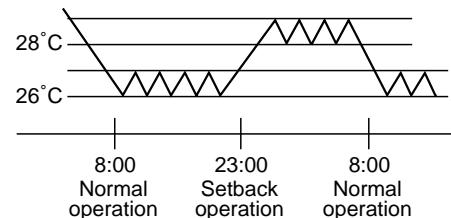

### 1-3. How to connect program timer


(1) Install the program timer next to the remote controller the same way as the remote controller is installed.

(2) Connect the program timer and the remote controller with a 5-wire cable as shown in the figure below.

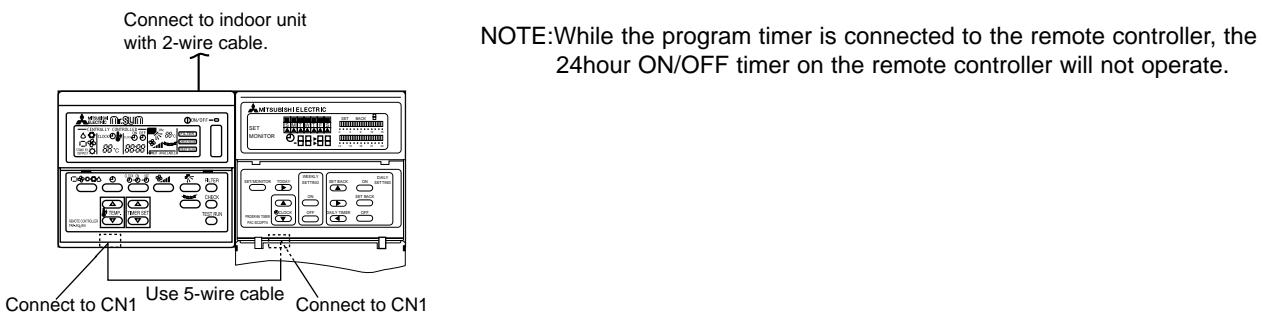

### 1-4. Names and functions

<PAC-SC32PTA>

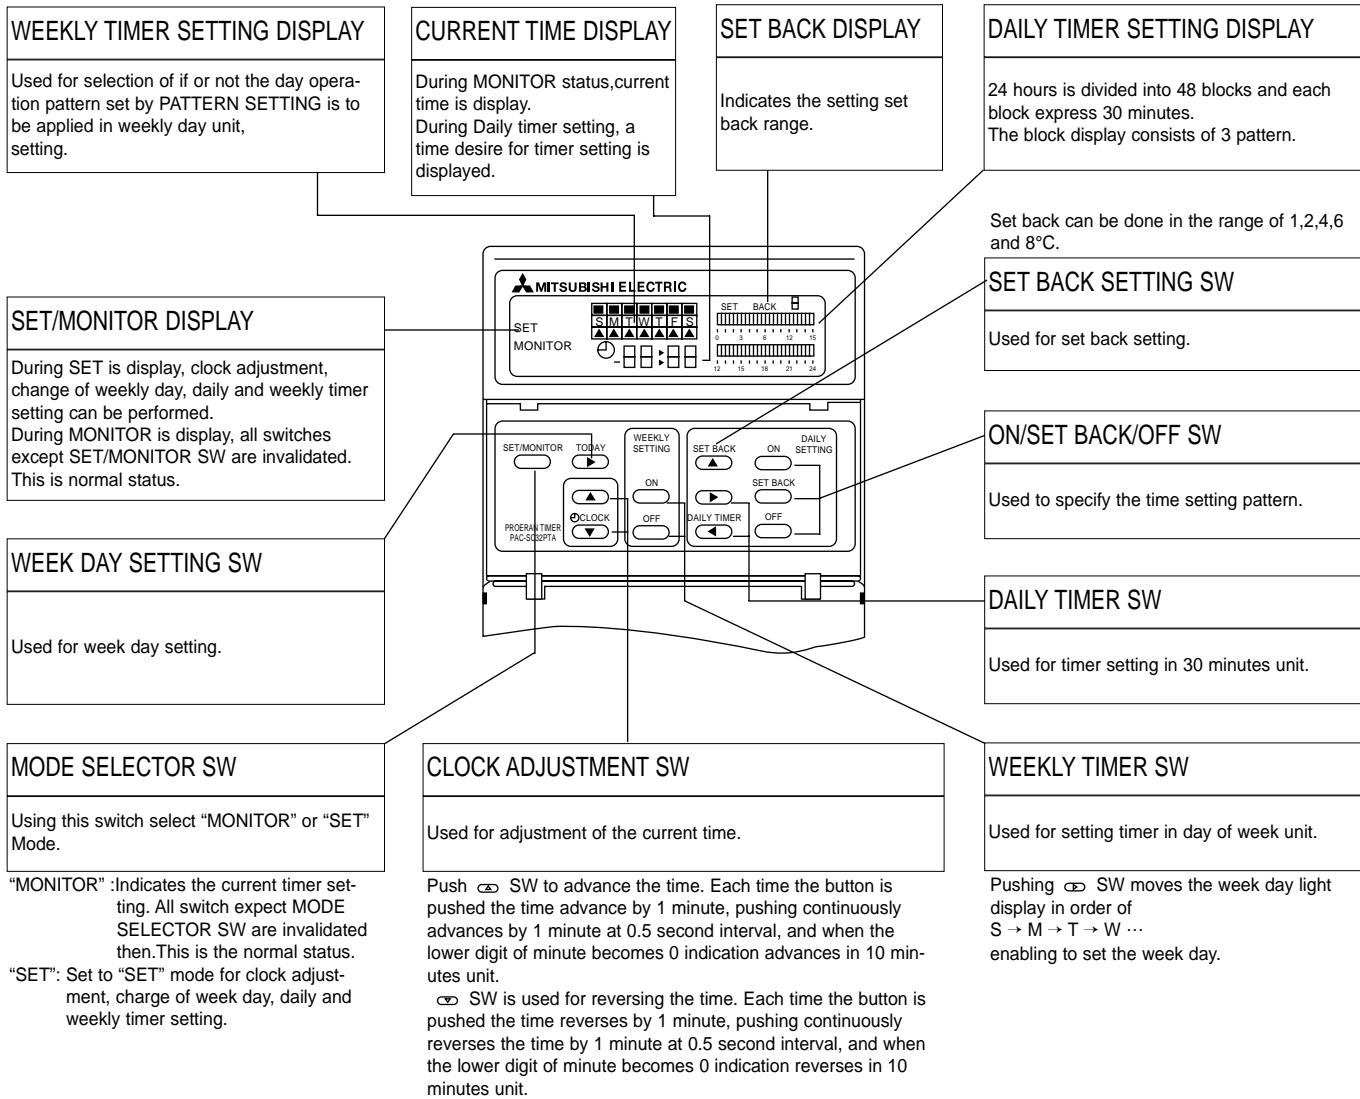


## 2. Program timer (PLH-P3 / 4 / 5 / 6AAH<sub>1</sub>.UK)

Part No.	PAC-YT32PTA
Applied Service Ref.	PLH-P3 / 4 / 5 / 6AAH <sub>1</sub> .UK

### 2-1 Names and functions

<PAC-YT32PTA>

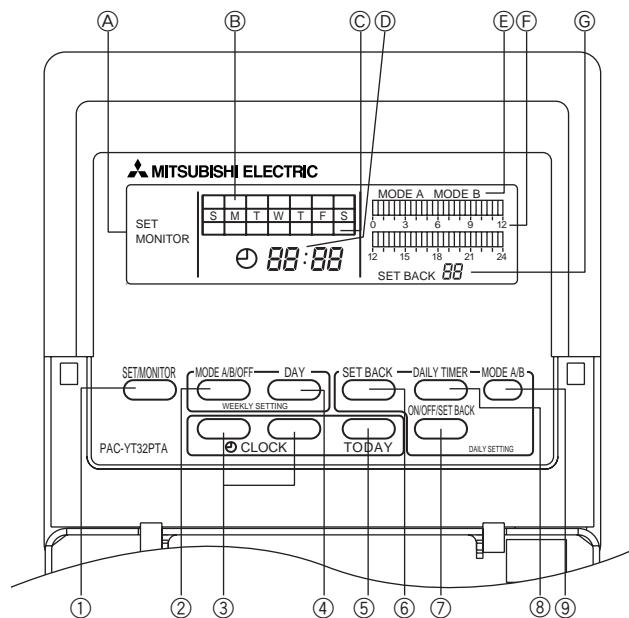

Ⓐ SET/MONITOR DISPLAY:

When SET is displayed, clock adjustment, change of day, and daily and weekly timer settings can be performed. When MONITOR is displayed, all switches except SET/MONITOR SW are invalidated. This is normal status.

Ⓑ WEEKLY TIMER SETTING DISPLAY:

Used to select whether the operation pattern set using the PATTERN SETTING can be applied to different days of the week.

Ⓒ CURRENT DAY DISPLAY:

Indicates the current day.

Ⓓ CURRENT TIME DISPLAY:

During MONITOR status, current time is displayed.

During daily timer setting, a time desire for timer setting is displayed.

Ⓔ OPERATION MODE DISPLAY:

Indicates the operation mode.

Ⓕ DAILY TIMER SETTING DISPLAY:

24 hours is divided into 48 blocks and each block is expressed in 30 minutes. The block display consists of 3 patterns.

Ⓖ SET BACK DISPLAY

Indicates the set back value.

① SET/MONITOR Button

Using this switch, select "MONITOR" or "SET" Mode.

"MONITOR": Indicates the current timer setting. All switches expect MODE SELECTOR SW are invalidated then. This is the normal status.

"SET": Set to "SET" mode for clock adjustment, change of day and daily and weekly timer settings.

② MODE A/B/OFF Button

Used for setting timer in day of week unit.

③ CLOCK ADJUSTMENT Button

Used for adjustment of the current time.

Push [▲] SW to advance the time. Each time the button is pushed the time advances by 1 minute, pushing continuously advances by 1 minute at 0.5 second intervals, and when the lower digit of the minute becomes "0" the time advances in 10 minute units.

[▼] SW is used for reversing the time. Each time the button is pushed the time reverses by 1 minute, pushing continuously reverses the time by 1 minute at 0.5 second intervals, and when the lower digit of the minute becomes "0" the time reverses in 10 minute units.

④ DAY SETTING Button

Used when setting the day.

⑤ WEEK DAY SETTING Button

Used for week day setting.

Pushing [▶] SW moves the week day light display in order of S → M → T → W → ... enabling to set the week day.

⑥ SET BACK SETTING Button

Used for set back setting.

Set back can be done in the range of 1, 2, 4, 6 and 8°C (2, 4, 8, 12 and 16°F).

⑦ ON/OFF/SET BACK Button

Used to specify the time setting pattern.

⑧ DAILY TIMER Button

Used for timer setting in 30 minute units.

⑨ MODE A/B Button

Used to set A Mode or B Mode when specifying the operation time.

--

### 3. Multi-Functional Casement

Part No.	PAC-SG03TM-E
Applied Service Ref.	PLH-P3/4/5/6AAH.UK, PLH-P3/4/5/6AAH1.UK

### 4. High-Efficiency Filter Element (2. Multi-Functional Casement is needed.)

Part No.	PAC-SG01KF
Applied Service Ref.	PLH-P3/4/5/6AAH.UK, PLH-P3/4/5/6AAH1.UK

### 5. Grille + Wireless Remote Controller

Part No.	PLP-6AALA	PLP-6AALM
Applied Service Ref.	PLH-P3/4/5/6AAH.UK	PLH-P3/4/5/6AAH1.UK

### 6. Grille + Wired Remote Controller

Part No.	PLP-6AAA	PLP-6AAM
Applied Service Ref.	PLH-P3/4/5/6AAH.UK	PLH-P3/4/5/6AAH1.UK

### 7. Remote Sensor

Part No.	PAC-SE41TS-E
Applied Service Ref.	PLH-P3/4/5/6AAH.UK, PLH-P3/4/5/6AAH1.UK

### 8. Remote Operation Adapter

Part No.	PAC-SF40RM-E
Applied Service Ref.	PLH-P3/4/5/6AAH.UK, PLH-P3/4/5/6AAH1.UK

### 9. Remote ON/OFF Adapter

Part No.	PAC-SE55RA-E
Applied Service Ref.	PLH-P3/4/5/6AAH.UK, PLH-P3/4/5/6AAH1.UK

### 10. Air Outlet Shutter Plate (20set , 2pcs/set)

Part No.	PAC-SG06SP-E
Applied Service Ref.	PLH-P3/4/5/6AAH.UK, PLH-P3/4/5/6AAH1.UK



**Mr. SLIM™**

 **MITSUBISHI ELECTRIC CORPORATION**  
HEAD OFFICE : MITSUBISHI DENKI BLDG., 2-2-3, MARUNOUCHI CHIYODA-KU, TOKYO100-8310, JAPAN

©Copyright 2001 MITSUBISHI ELECTRIC ENGINEERING CO., LTD.  
Distributed in Sep. 2004 No. OC236 REVISED EDITION-B PDF  
Distributed in Sep. 2001 No. OC236 REVISED EDITION-A 250  
Distributed in Apr. 2001 No. OC236 225  
Made in Japan

New publication, effective Sep. 2004  
Specifications subject to change without notice