
MITSUBISHI ELECTRIC SPLIT-TYPE AIR CONDITIONERS

OPERATING INSTRUCTIONS

CE

MSH-18RV MSH-24RV MSH-C18TV MSH-C24TV

OPERATING INSTRUCTIONS



• To use this unit correctly and safely, be sure to read this operating instructions before use.

Bedienungsanleitung

Für Kunden

• Um diese Einheit richtig und sicher zu verwenden, unbedingt diese Bedienungsanleitung vor der Inbetriebnahme durchlesen.

NOTICE D'UTILISATION

A l'attention des clients

• Pour avoir la certitude d'utiliser cet appareil correctement et en toute sécurité, veuillez lire attentivement cette notice d'instructions avant de mettre l'appareil en fonction.

GEBRUIKSAANWIJZING

Voor de klant

• Om dit apparaat op de juiste manier en veilig te gebruiken, dient u eerst deze gebruiksaanwijzing aandachtig door te lezen.

MANUAL DE INSTRUCCIONES

Para los clientes

• Para emplear correctamente este aparato y por razones de seguridad debe leer este manual de instrucciones de manejo antes de su utilización.

LIBRETTO D'ISTRUZIONI

Per gli utenti

• Per utilizzare correttamente quest'unità, leggere questo libretto d'istruzioni attentamente e per intero.

ΟΔΗΓΙΕΣ ΛΕΙΤΟΥΡΓΙΑΣ

Για τον πελάτη

 Για να χρησιμοποιήσετε αυτή την μονάδα σωστά και με ασφάλεια, βεβαιωθείτε ότι έχετε διαβάσει αυτό το εγχειρίδιο οδηγιών πριν από την χρήση.

INSTRUÇÕES DE OPERAÇÃO

Para os clientes

 Para utilizar esta unidade correctamente, certifique-se de que lê estas instruções de operação antes da utilização.

BRUGSANVISNING

Til kunden

• Læs denne brugsanvisning før brugen så korrekt og forsvarlig anvendelse af klimaanlægget sikres.

• För att använda enheten på rätt och säkert sätt ska denna bruksanvisning läsas

BRUKSANVISNING

innan enheten tas i bruk.

För kunder

Svenska

Français

Nederlands

Español

Italiano

Ελληνικά

Português

Dansk

Türkçe

İŞLETME TALİMATLARI
Bu birimi doğru ve güvenli olarak çalıştırmak için, kullanmadan önce bu işletme talimatlarını mutlaka okuyun.

РУКОВОДСТВО ПО ЭКСПЛУАТАЦИИ Для пользователей

• Для обеспечения правильного и безопасного использования прибора следует до начала его эксплуатации внимательно прочитать данное руководство.

Русский



SAFETY PRECAUTIONS	2
NAME OF EACH PART	5
PREPARATION BEFORE OPERATION	7
I FEEL AUTO OPERATION	8
MANUAL OPERATION (COOL, DRY, HEAT)	9
AIR FLOW VELOCITY AND DIRECTION ADJUSTMENT	10
ECONO COOL OPERATION	11
TIMER OPERATION (ON/OFF TIMER)	12
WHEN THE AIR CONDITIONER IS NOT GOING TO BE USED FOR A	
LONG TIME	12
MAINTENANCE	13
CLEANING THE AIR FILTER AND THE DEODORIZING	
FILTER (OPTION)	13
REPLACEMENT OF THE DEODORIZING FILTER (OPTION)/AIR	
CLEANING FILTER (OPTION)	14
BEFORE CONTACTING THE SERVICE REPRESENTATIVE,	
CHECK THE FOLLOWING AGAIN	
WHEN YOU THINK THAT TROUBLE HAS OCCURRED	
INSTALLATION, RELOCATION AND INSPECTION	16
SPECIFICATIONS	17



- Since rotating parts and parts which could cause an electric shock are used in this product, be sure to read these "Safety Precautions" before use.
- Since the cautionary items shown here are important for safety, be sure to observe them. Marks and their meanings are as shown below.


Incorrect handling could cause a serious hazard, such as death, serious injury, etc. with a high probability.
Incorrect handling could cause a serious hazard depending on the conditions.


Meanings of symbols used in this manual are as shown below.

\bigcirc	Be sure not to do.
0	Be sure to follow the instruction.
(Black)	Never insert your finger or stick, etc.
(Black)	Never step onto the indoor/outdoor unit and do not put anything on them.
(Yellow)	Danger of electric shock, be careful.
(Blue)	Be sure to disconnect the power supply plug from the power outlet.
(Blue)	Be sure to shut off the power.

• After reading this manual, keep it together with the installation manual in a handy place for easy reference.

Warning mark positions and safety devices







SAFETY PRECAUTIONS

• This air conditioner is NOT intended for use by children or infirm persons without supervisions.

Do not use intermediate connection of the power supply cord or the extension cord and do not connect many devices to one AC outlet.


• A fire or an electric shock may result from poor contact, poor insulation, exceeding the permissible current, etc.



Do not scratch or process the power supply cord, etc.

 Do not put heavy object on the power supply cord and do not scratch or process the cord. The cord may be damaged and this may cause a fire or an electric shock.





- This may cause a fire due to spark, etc.
- Be sure to turn off the breaker or disconnect the power supply plug absolutely after switching the indoor unit off with the remote controller.



rectly to cool air for a long time.

• This could damage your health.

When an abnormality (burning smell, etc.) occurs, stop the air conditioner and disconnect the power supply plug or turn off the breaker.

 If the unit continues to be operated in an abnormal condition, it may cause a fire, trouble, etc. In this case, consult your dealer.



Do not insert your finger or a stick, etc. into the air inlet/outlet.

Since the fan rotates at high speed, this may cause an injury.
 Young children should be supervised to ensure that they do not play with the air conditioner.



Repair or relocation should not be done by the customer.

 If this is done incorrectly, it may cause a fire, an electric shock, or injury from the unit falling, water leaking, etc.
 Consult your dealer.



The customer should not install this unit.

 If this is done incorrectly, it may cause a fire, an electric shock, or injury from the unit falling, water leaking, etc.
 Consult your dealer.








SAFETY PRECAUTIONS

∧ CAUTION



 Otherwise, dirt may collect and this may cause a fire.



Do not step or put anything on the indoor/outdoor unit.

• This may cause an injury, etc. if you fall down.



Do not leave the unit on an installation stand which is damaged.

• The unit may fall and this may cause an injury.



Do not operate the unit for a long time in high humidity, e.g. leaving a door or window open.

In the cooling mode, if the unit is operated in a room with high humidity (80% RH or more) for a long time, water condensed in the air conditioner may drop and wet or damage furniture, etc.



Do not step onto an unstable bench when maintaining the unit, etc.

• This may cause an injury, etc. if vou fall down.



Do not pull the power supply cord.

• The core wire of the power supply cord may be disconnected and this may cause a fire.



Replace the 2 batteries with new ones of same type.

 Using an old battery together with a new one may result in heat generation, leakage or an explosion.



- Do not charge or disassemble the batteries and do not throw them into a fire.
- This may result in leakage, fire or an explosion.



If liquid from the alkaline batteries gets onto your skin or clothes, wash it well with clean water.

• If liquid from the alkaline batteries gets into your eyes, wash them well with clean water and consult a doctor at once.



For installation

• Consult your dealer for installation of the air conditioner.

Earth the unit.

• Do not connect the earth to a gas pipe, water pipe, lightning rod or the earth of a telephone. If the earthing is incorrect, it may cause an electric shock.

Do not install the unit where flammable gas could leak.

• If gas leak and collect around the unit, it may cause an explosion.



Install an earth leakage breaker depending on the place where the air conditioner is to be installed (humid places, etc.).

• If the earth leakage breaker is not installed, it may cause an electric shock.

Drain should be fully drained.

• If the drainage route is incomplete, water may drop from the unit. This may wet and damage the furniture.






Δ




Indoor unit

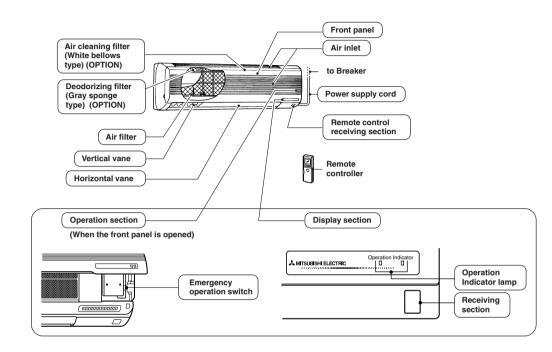


Outdoor unit

MUH-18RV

MUH-C18TV

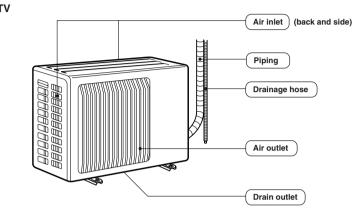


MUH-24RV MUH-C24TV

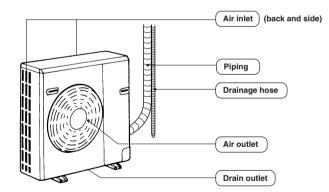




Remote controller

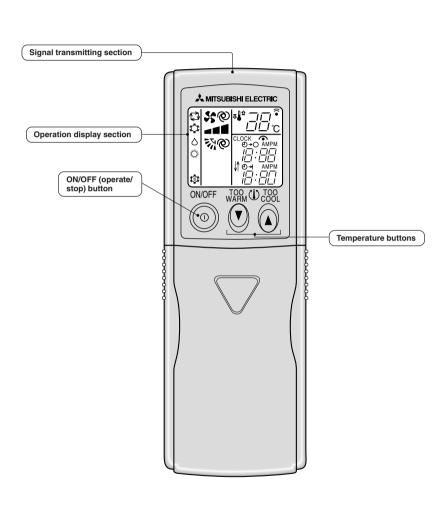

(This diagram shows an overall view.)

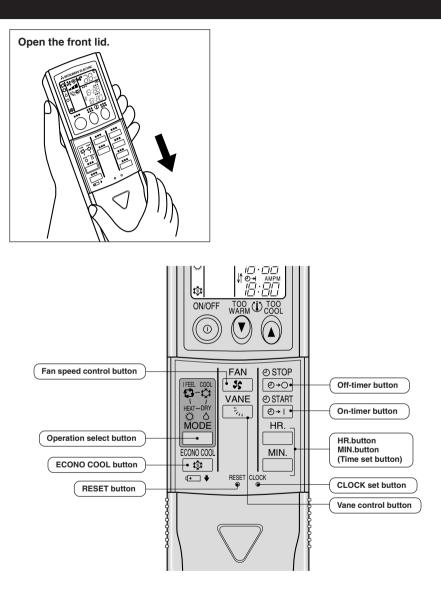



PREPARATION BEFORE OPERATION

Auto restart function

These models are equipped with an auto restart function, but this function is OFF when the units are shipped from the factory. If you want to use the auto restart function, please consult the service representative because the setting of the unit needs to be changed.

- Auto restart function is ... -

When the indoor unit is controlled with the remote controller, the operation mode, the set temperature and the fan speed are stored in the memory. If a power failure occurs or the main power is turned off during operation. "Auto restart function" sets automatically to start operating in the same mode as the one set with the remote controller just before the shutoff of the main power.

3

Indoor unit

Insert the power supply plug into the power outlet and/or turn the breaker on.

Remove dirt from the power supply plug and insert the plug securely. If dirt adheres to the plug or insertion is incomplete,

it may cause a fire or an electric shock.


Press the CLOCK set button.

Remote controller (How to set the batteries and the current time)




Remove the front lid and insert batteries. Then reattach the front lid.

Insert the minus pole of the batteries first. Check if the polarity of the batteries is correct.







Press the RESET button.



If the RESET button is not pressed, the remote controller may not operate correctly.



Press the \square and \square button (TIME SET button) to set the current time.



■ Each time the button is pressed, the set time increases by 1 hour, and each time the button is pressed, the set time increases by 1 minute.

Press the CLOCK set button again 5 and close the front lid.

Handling of the remote controller


- The range that the signal can reach is about 6 m when the remote controller is pointed at the front of the indoor unit.
- When a button is pressed, one or two beeps will be heard from the indoor unit. If no sound is heard, operate again.
- Use the remote controller carefully. If it is dropped, thrown or it gets wet, the remote controller may not operate.


When installing on a wall, etc.

 Install the remote controller installation case in a position where the signal reception sound (beep) can be heard from the indoor unit when the \bigcirc button is pressed.

How to install/remove the remote controller

Installing Insert the remote controller downward.





Dry-cell batteries

Reference for replacing batteries

When the indoor unit does not respond to the signal from the remote controller, or the display becomes dim, replace the batteries with new ones (size AAA).

- Though both alkaline batteries and manganese batteries can be used, alkaline batteries are recommended because their service life is longer than that of manganese batteries.
- The service life of an alkaline battery is about 1 vear.

However, a battery which the time limit is approaching may be exhausted soon. The recommended usable time limit is indicated (month/year) on the bottom of the battery.


- Replace the 2 batteries with new ones of the same type.
- Do not use rechargeable batteries.
- To prevent liquid leakage, take out all batteries when the remote controller is not going to be used for a long time.
- Dispose of exhausted batteries in the correct manner.

When the remote controller cannot be used (emergency operation)

When the batteries of the remote controller run out or the remote controller malfunctions, the emergency operation can be done using the EMERGENCY OPERA-TION switch.

Press the EMERGENCY OPERA-TION switch.

Each time the EMERGENCY OPERATION switch is pressed, the unit will operate in order of EMERGENCY COOL MODE. EMER-GENCY HEAT MODE and STOP MODE. However, when the EMERGENCY OPERA-TION switch is once pressed, the unit will operate in test run for 30 minutes and then the operation mode shifts to EMERGENCY MODE.



Details of EMERGENCY MODE are as shown below. However, the temperature control does not work for 30 minutes in test run and the unit is set to continuous operation. The fan speed is set to Hi in test run and shifts to Medium after 30 minutes.


Operation mode	COOL	HEAT
Set temperature	24°C	24°C
Fan speed	Medium	Medium
Horizontal vane	Auto	Auto

The operation mode is indicated by the Operation Indicator lamp on the indoor unit as following figures.

Operation Indicator lamp




To stop the emergency operation, press the EMERGENCY OPERATION switch once (in case of EMER-**GENCY HEAT MODE) or twice (in** case of EMERGENCY COOL MODE).





I FEEL... AUTO OPERATION

With the "心 (I FEEL...)" auto operation mode, the optimum room condition can be set automatically with a one-touch operation.

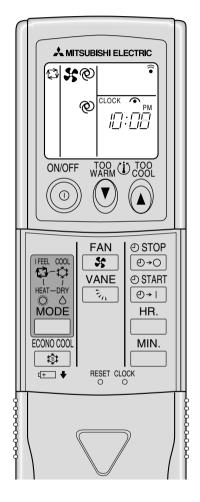

To start operation:

Press the of button.

When the "
(I FEEL...)" mode is selected, the air conditioner is automatically controlled at the optimum temperature.

- To stop operation: Press the obtion.
 - If you feel slightly warm:

Press the 🕥 button to lower the temperature.

One press lowers the temperature by about 1°C.


• If you feel slightly cool:

Press the () button to raise the temperature.

One press raises the temperature by about 1°C.

When "12 (I FEEL...)" is not selected, press the button until it is set.

Each time the button is pressed, the operation mode is changed in sequence: \bigcirc (I FEEL...) \rightarrow \bigcirc (COOL) \rightarrow \bigcirc (DRY) $\rightarrow O$ (HEAT)




Description of "I FEEL..." mode

Details of operation

According to the room temperature when the operation starts. the operation mode is automatically set to COOL. DRY or HEAT. However, when operation is started again within 2 hours after it is stopped, the same operation mode before the operation is stopped is selected. The operation mode selected first is not changed even if the room temperature changes. If the operation mode does not match the room condition, select the appropriate operation mode by pressing the MODE button.

Details of auto operation

Room temperature when started	Operation mode	Target temperature (initial state)
About 25°C or higher	COOL	About 24°C
About 25°C - 23°C	DRY	—
About 23°C or lower	HEAT	About 26°C



- NOTE

Oper

- COOL: When the room temperature is 2°C higher than the set temperature, the set temperature may not be changed since the air conditioner is operating to reach the target (set) temperature. In this case, please wait until the room temperature drops to within 2°C of the set temperature and then change the set temperature.
- HEAT: When the room temperature is 2°C lower than the set temperature, the set temperature may not be changed since the air conditioner is operating to reach the target (set) temperature. In this case, please wait until the room temperature rises to within 2°C of the set temperature and then change the set temperature.

Details of display on the indoor unit

The operation indicator at the right side of the indoor unit indicates the operation state.

	SH4	Limbing
	塛	Lighting
Operation Indicator	湴	Distant t
	- 上:	Blinking *
		Not lighting
		NOUNGIN





Operation indicator lamp

Indication	Operation state	Difference between target temperature and room temperature
業 業	This shows that the air conditioner is operating to reach the target temperature. Please wait until the target temperature is obtained.	About 2°C or more
業 🛛	This shows that the room temperature is approaching the target temperature.	About 2°C or less
業 渋	(In case of outdoor unit MXZ series only) Please refer to INFORMATION FOR MULTI SYSTEM AIR CONDITIONER (page 9). *	_
* MSH-18RV only		



MANUAL OPERATION (COOL, DRY, HEAT)

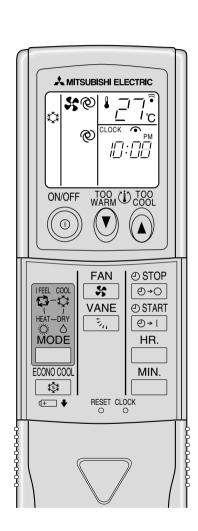

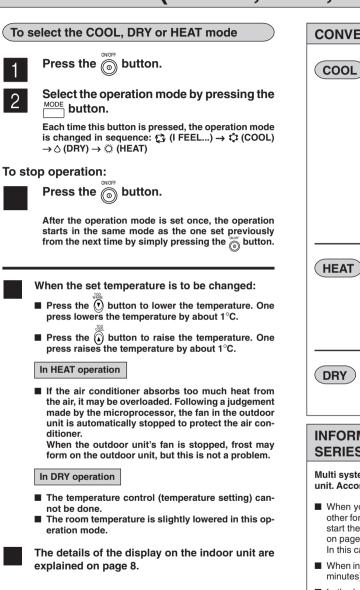

NOTE

When the ambient temperature is too high, the room temperature may not reach the set temperature since the unit operates to cool under high load.

CONVENIENT INFORMATION

For effective cooling

(1) Close the windows and pull (2) Paste a heat shield film (gen- (3) Block the outdoor unit from didown blinds. Sunshine is reduced and cooling efficiency increases.

erally available) on the window. Heat entering the room is reduced.

rect sunlight. This saves energy.







HEAT

Comfortable warmth depends on the temperature difference between the indoor and the outdoor.

It is recommended that the set temperature in the heating operation does not differ from the external temperature too much. Though there is a regional difference, as a reference, a set temperature between about 22°C and 24°C is most suitable.

The humidity at which people feel comfortable

When air contains too much moisture, people feel clammy. Humidity is related to temperature and wind. The humidity at which people feel comfortable is 60% - 75% RH in summer, 55% - 70% RH in winter.

INFORMATION FOR MULTI SYSTEM AIR CONDITIONER (OUTDOOR UNIT: MXZ SERIES)

Multi system air conditioner (Outdoor unit: MXZ series) can connect two or more indoor units with one outdoor unit. According to the capacity, two or more units can operate simultaneously.


When you try to operate two or more indoor units with one outdoor unit simultaneously, one for the cooling and the other for heating, the operation mode of the indoor unit that operates earlier is selected. The other indoor units that will start the operation later cannot operate, indicating an operation state. (Refer to the table of Operation Indicator lamp on page 8.)

In this case, please set all the indoor units to the same operation mode.

- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.

AIR FLOW VELOCITY AND DIRECTION ADJUSTMENT

AIR FLOW velocity and direction can be selected as required.

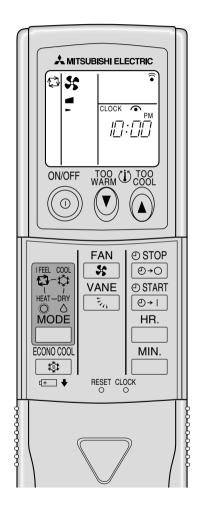

To change the AIR FLOW velocity, press the $\begin{bmatrix} FAN \\ S \end{bmatrix}$ button.


Each time the button is pressed, the fan speed is changed in sequence: $_$ (Lo) $\rightarrow \blacksquare$ (Med) $\rightarrow \blacksquare$ (Hi) \rightarrow O (AUTO)

- Use the definition (Hi) notch to cool/heat the room more.
 If the operating sound of the air conditioner disturbs your sleep, use the definition (Lo) notch.
 - To change the AIR FLOW blowing direction vertically, press the VANE button.

Each time the button is pressed, the angle of the horizontal vane is changed in sequence: $(1) \rightarrow (2)$ $\rightarrow (3) \rightarrow (4) \rightarrow (5) \rightarrow (SWING) \rightarrow (AUTO)$

SWING OPERATION

Use the swing operation for the air flow to reach all corners of the room.




- In the cooling operation, when the air conditioner is operated with setting the horizontal vane to , (4) or , (5) for 1 hour, the AIR FLOW direction is automatically set to horizontal to prevent condensed water from dropping.
- Adjust the vertical AIR FLOW direction using the remote controller. If the horizontal vane is moved manually, it may cause trouble.
- In the heating operation, if the air flow temperature is too low or when defrosting is being done, the horizontal vane position is set to (1).


Auto air flow direction control operation

■ When the AUTO mode is selected with the ^{MME} _→ button, the position of the horizontal vane is automatically set to correspond to the operation mode for effective operation.

(1) HEAT

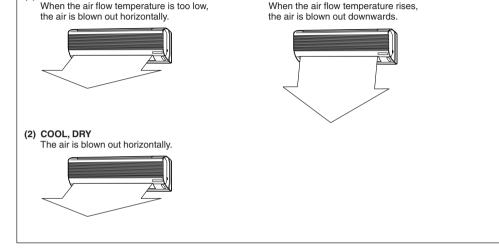

To change the horizontal direction of the air flow, move the vertical vane manually.

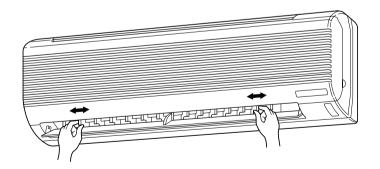


Adjust the vane before operation starts. Since the horizontal vane moves automatically, your fingers may be caught.



ECONO COOL OPERATION

Use this operation when you want to be comfortable in COOL mode even with energy saved.

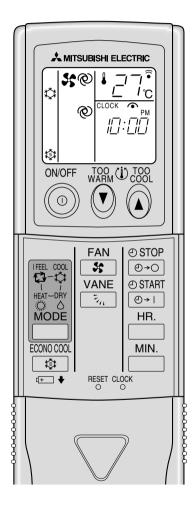

Perform the following operations while the unit is operating.



When the rightarrow (ECONO COOL) operation is selected in COOL mode, the air conditioner performs swing operation in various cycle according to the temperature of air conditioner. Also SET TEMPERATURE is automatically set 2°C higher than in COOL mode.

To release the ECONO COOL operation:



- ECONO COOL operation is available only in MANUAL COOL mode.
- When the ^{VANE} _{5/a} button is pressed or the operation mode is changed during the ECONO COOL operation, ECONO COOL operation is released.
- The solution, the or button and ON/OFF timer (page 12) are available.

— What is "ECONO COOL"? —

Swing air flow (change of air flow) makes you feel cooler than constant air flow. So, even though the set temperature is automatically set 2°C higher, it is possible to operate cooling operation with keeping comfort. As a result, energy can be saved.




TIMER OPERATION (ON/OFF TIMER)

WHEN THE AIR CONDITIONER IS NOT GOING TO BE USED FOR A LONG TIME

TIMER

It is convenient to set the timer when you go to bed, when you get home, when you get up, etc.

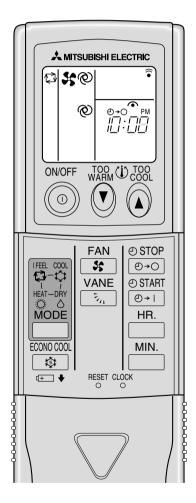

How to set the ON timer

Press the OSTART button during operation.

Each time the button is pressed, the ON timer mode alternates between ON and OFF.

Set the time of the timer using the ____ and ____ buttons.

Each time the button is pressed, the set time increases by 1 hour; each time the button is pressed, the set time increases by 10 minutes.

To release the ON timer:

2

2

Press the OSTART button.

How to set the OFF timer

Press the \bigcirc button during operation.

Each time the button is pressed, the OFF timer mode alternates between ON and OFF.

Set the time of the timer using the $\overset{HR.}{\square}$ and $\overset{MIN.}{\square}$ buttons.

Each time the $\stackrel{\tiny HR}{_}$ button is pressed, the set time increases by 1 hour; each time the $\stackrel{\tiny MNL}{_}$ button is pressed, the set time increases by 10 minutes.

To release the OFF timer:

Press the OSTOP button.

Programming timer operation


The ON timer and the OFF timer can be used in combination. The timer of the set time that is reached first will operate first. (" \downarrow " mark indicates the order of timer operations.)

If the current time has not been set, the timer operation cannot be used.


When it is not going to be used for a long time:

Perform the FAN operation for 3 or 4 hours to dry the inside of the air conditioner.

 To perform FAN operation, set to the highest temperature in the MANUAL COOL OPERATION mode. (Refer to page 9.)




Turn off the breaker and/or disconnect the power supply plug.



- 🕂 CAUTION -

Turn off the breaker or disconnect the power supply plug when the air conditioner is not going to be used for a long time. Dirt may collect and this may cause a fire.

3 Remove the batteries from the remote controller.





CAUTION To prevent liquid leakage, take out all batteries when the remote controller is not going to be used for a long time.


When the air conditioner is to be used again:

Clean the air filter and install it in the indoor unit.

(Refer to page 13 for cleaning instructions.)







3 Check that the earth is connected correctly.

$-\cancel{N}$ CAUTION

Earth the unit.


Do not connect the earth to a gas pipe, water pipe, lightning rod or the earth of a telephone. If the earthing is incorrect, it may cause an electric shock.



MAINTENANCE

Before starting maintenance

Turn off the breaker and/or disconnect the power supply plug.



When the unit is to be cleaned, switch it off and disconnect the power supply plug or turn off the breaker. Since the fan rotates at high speed during operation, it may cause an injury.



Cleaning the indoor unit

Clean the unit using a soft dry cloth.



Do not use gasoline, benzine, polishing powder, detergent and insecticide. The unit may be damaged.



Remove.

- $\underline{/}$ CAUTION

2

3

Cleaning the air filter

(about once every 2 weeks)

When the air filter is to be removed, do not touch the metal parts of the indoor unit. This may cause an injury.

Remove dirt from the air filter using a vacuum cleaner or by washing the filter with water.

- If dirt is conspicuous, wash the filter with a solution of detergent in lukewarm water.
- If hot water (50°C or more) is used, the filter may be deformed.




After washing with water/lukewarm water, dry the air filter well in the shade.

Do not expose the air filter to direct sunlight or heat from a fire when drying it.



4 Install the air filter.




Do not open the front panel up past the level position in order to prevent it from being damaged.

2

3


Cleaning the deodorizing filter (about once every 2 weeks)

- Remove the air filter, and then remove the deodorizing filter (Gray sponge type).
 - The deodorizing filter is harmless to people. However, to keep its effectiveness, be sure to hold the frame and not to touch the surface of the filter with your hand.



Deodorizing filter

- Soak the filter together with its frame in lukewarm water for about 15 minutes.
- If the dirt is conspicuous, use a solution of detergent in lukewarm water.
- If hot water (50°C or more) is used, the filter may be deformed.
- Do not use a scrubbing brush or sponge. This may damage the surface of the filter.





After washing with water/lukewarm water, dry the deodorizing filter well in the shade.


Do not expose the deodorizing filter to direct sunlight or heat from a fire when drying it.



4 Install the deodorizing filter, and then install the air filter.



Install




CLEANING THE AIR FILTER AND



REPLACEMENT OF THE DEODORIZING FILTER (OPTION)/AIR CLEANING FILTER (OPTION)

When the capacity is lowered because of dirt, etc., it is necessary to replace the deodorizing filter/air cleaning filter.

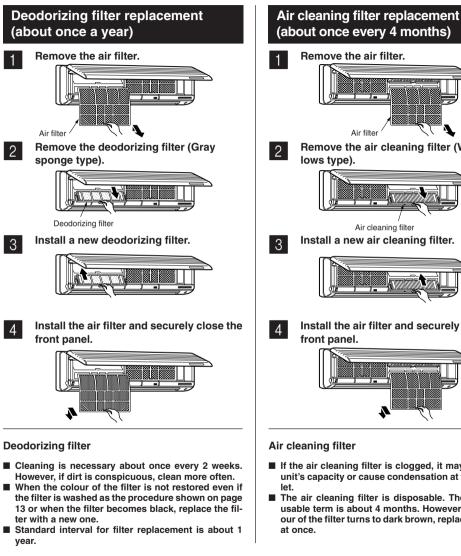

Optional parts

Optional parts are available from your local dealer.

Name of part	Type name
DEODORIZING FILTER	MAC-1600DF
AIR CLEANING FILTER	MAC-1100FT

(about once every 4 months) Remove the air filter. Air filte Remove the air cleaning filter (White bellows type). Air cleaning filter Install a new air cleaning filter. Install the air filter and securely close the front panel.

Air cleaning filter

- If the air cleaning filter is clogged, it may lower the unit's capacity or cause condensation at the air outlet.
- The air cleaning filter is disposable. The standard usable term is about 4 months. However, if the colour of the filter turns to dark brown, replace the filter at once.




1

2

3

BEFORE CONTACTING THE SERVICE REPRE-SENTATIVE, CHECK THE FOLLOWING AGAIN

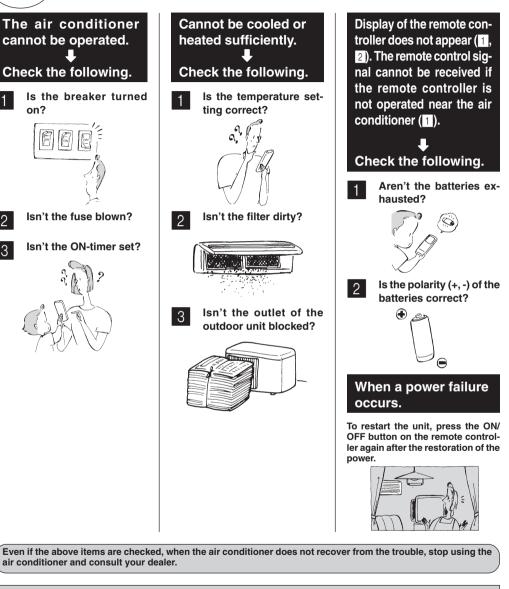


In the following cases, stop operation and consult your dealer.

- The remote control signal may not be received in a room where an electronic ON/OFF type fluorescent lamp (inverter-type fluorescent lamp, etc.) is used.
- In the region where the electric wave is weak, when the air conditioner is operated, noise may be generated in radio reception.
- When thunder is heard, stop operation and disconnect the power supply plug or turn off the breaker. Otherwise, the electrical parts may be damaged.



WHEN YOU THINK THAT TROUBLE HAS OCCURRED

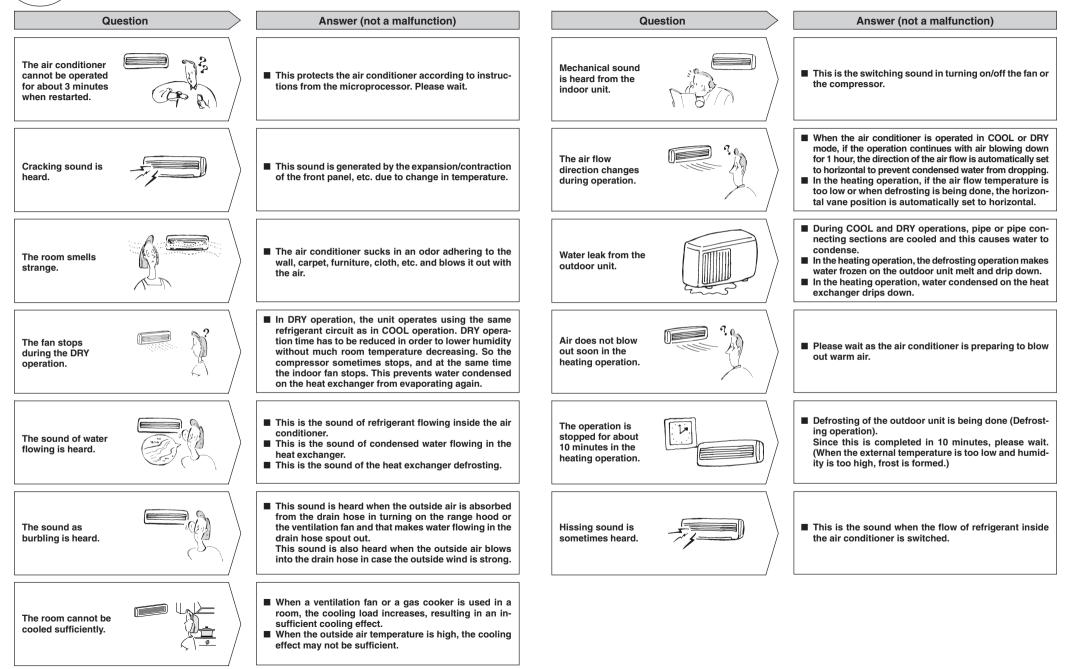



INSTALLATION, RELOCATION AND INSPECTION

Installation place

Avoid installing the air conditioner in the following places.

Do not install the unit where flammable gas could leak.

If gas leak and collect around the unit, it may cause an explosion.

- Where there is much machine oil.
- Salty places such as the seaside.
- Where sulfide gas is generated such as a hot spring.
 Where oil is splashed or where the area is filled with oily smoke.

Electrical work


- Provide an exclusive circuit for the power supply of the air conditioner.
- Be sure to observe the breaker capacity.

- 🕂 WARNING

- The customer should not install this unit. If installation is done incorrectly, it may cause a fire, an electric shock, or injury from the unit falling, water leaking, etc.
- Do not use intermediate connection of the power supply cord or the extension cord and do not connect many devices to one AC outlet. A fire or an electric shock may result from poor contact, poor insulation, exceeding the permissible current, etc. Consult your dealer.

- Earth the unit.
- Do not connect the earth to a gas pipe, water pipe, lightning rod or the earth of a telephone. If the earthing is incorrect, it may cause an electric shock.
- Install an earth leakage breaker depending on the place where the air conditioner is to be installed (humid places, etc.).

If the earth leakage breaker is not installed, it may cause an electric shock.



Inspection and maintenance

- When the air conditioner is used for several seasons, the capacity may be lowered due to dirt inside the unit.
- Depending on the condition, an odor may be generated or dehumidified water may not drain out smoothly due to dirt, dust, etc.
- It is recommended that the unit be inspected and maintained (charged) by specialist in addition to normal maintenance. Consult your dealer.

Operating sound considerations

- Do not put an object around the air outlet of the outdoor unit. This may lower the capacity or increase the volume of the operating sound.
- If an abnormal sound is heard during operation, consult your dealer.

Relocation

When the air conditioner is to be removed or re-installed because of rebuilding, moving, etc., special techniques and work are required.

WARNING -

- Repairs or relocation should not be done by the customer.
- If this is done incorrectly, it may cause a fire, an electric shock, or an injury from the unit falling, water leaking, etc. Consult your dealer.

Disposal

To dispose of this product, consult your dealer.



SPECIFICATIONS

Model		MSH-18RV		MSH-24RV			
Function			Cooling	Heating	Cooling	Heating	
Power supply				~ /N, 220-240V, 50Hz			
Capacity		kW	5.1	5.4	6.0	6.2	
Input		kW	2.03-2.12	1.98-2.07	2.72-2.75	2.47-2.58	
Waight	Indoor kg			1	4		
Weight	Outdoor	kg	5	4	72		
Refrigerant filling capacity (R-22)		kg	1.65		2.40		
ID as da	Indoor			IP2		20	
IP code Outdoor			IP24				
Permissible excessive	LP ps	MPa	1.3				
operating pressure	HP ps	MPa	4.5		4.2		
Noise level	Indoor	dB(A)	4	2	4	5	
(Hi)	Outdoor	dB(A)	5	52 53		3	

MSH-C18TV MSH-C24TV Model Heating Function Cooling Heating Cooling ~ /N, 230V, 50Hz Power supply Capacity kW 5.2 7.5 6.0 6.3 kW 2.11 2.85 3.02 Input 2.18 14 Indoor kg Weight Outdoor kg 54 71 Refrigerant filling capacity (R-407C) kg 1.60 2.00 IP20 Indoor IP code IP24 Outdoor Permissible LP ps MPa 1.7 excessive operating HP ps MPa 5.0 pressure dB(A) Noise level Indoor 42 45 dB(A) 52 53 (Hi) Outdoor

Note:

1. Rating condition Cooling — Indoor: 27°C DB, 19°C WB Outdoor: 35°C DB Heating — Indoor: 20°C DB

Outdoor: 7°C DB, 6°C WB

		Indoor	Outdoor
	Upper limit	32°C DB	43°C DB
Cooling		23°C WB	—
Cooling	Lower limit	21°C DB	21°C DB
		15°C WB	_
	Upper limit	27°C DB	21°C DB
Lipsting		_	15°C WB
Heating	Lower limit	20°C DB	-8.5°C DB
	Lower IImit		-9.5°C WB

2. Guaranteed operating range

This product is designed and intended for use in the residential, commercial and light-industrial environment.

The product at hand is based on the following EU regulations:

- Low Voltage Directive 73/23/ EEC
- Electromagnetic Compatibility Directive 89/336/ EEC



SG79A641H01