

# **SERVICE PARTS LIST FOR MITSUBISHI ELECTRIC PACKAGED AIR-CONDITIONERS**

**Series : PFFY-P·VLRMM-E**


**Dec. 2007**

**BWE07260**

<b>INDEX</b>
<b>PFFY-P20VLRMM-E</b>
<b>PFFY-P25VLRMM-E</b>
<b>PFFY-P32VLRMM-E</b>
<b>PFFY-P40VLRMM-E</b>
<b>PFFY-P50VLRMM-E</b>
<b>PFFY-P63VLRMM-E</b>

PFFY-P20,P25,P32VLRMM-E  
PFFY-P40,P50,P63VLRMM-E


EXTERNAL PARTS

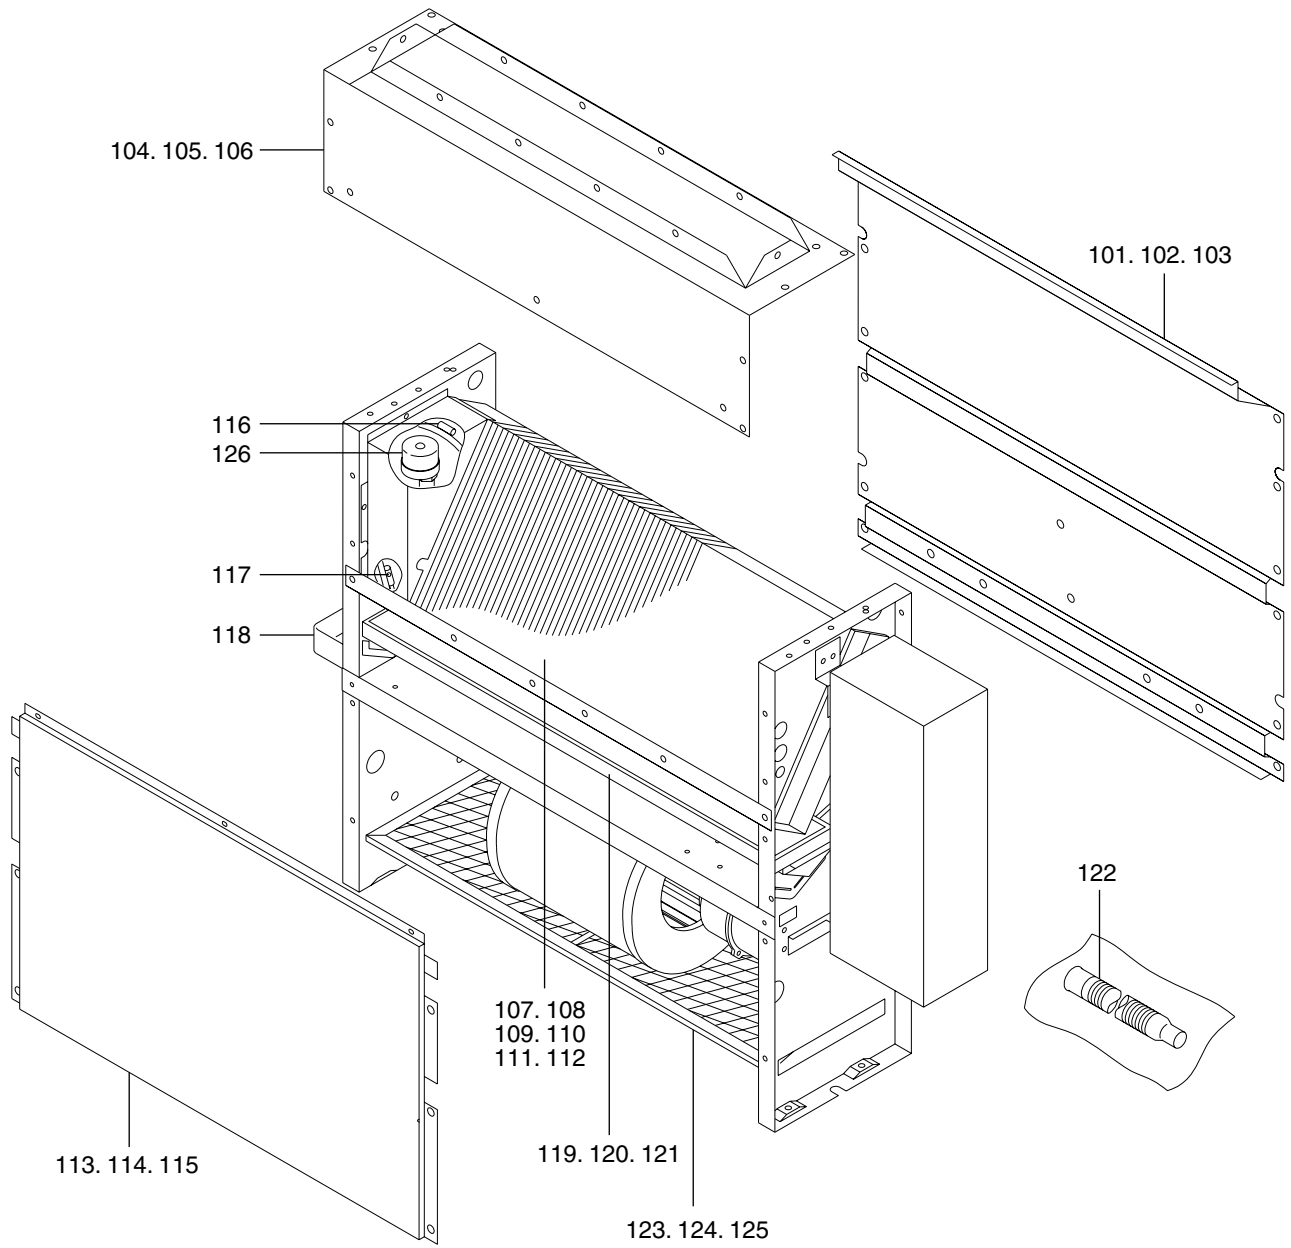



PFFY-P20VLRMM-E  
PFFY-P25VLRMM-E

BLOWER PARTS (1)

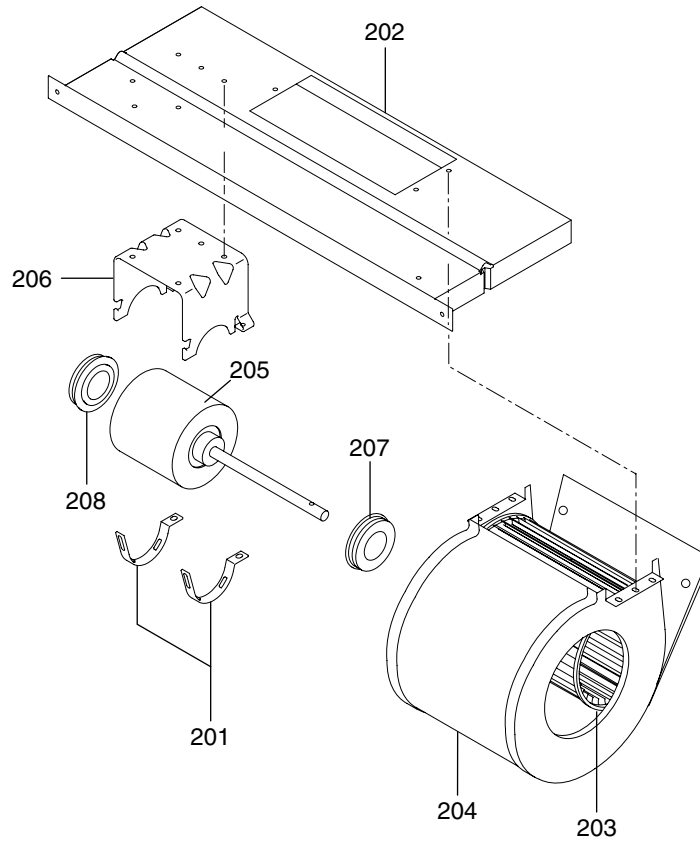


No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change		Spec.	PFFY-P20VLRMM-E	PFFY-P25VLRMM-E				Dwg. No.	Price	Revision History
			Part Name									
201	R63 652 131	G	Fixing plate		2	2				W353715H01		
202	R61 009 126	G	Fan plate		1	1				KB00B706G01		
203	R63 045 103	G	Sirocco fan		1	1				W234904G01		
204	R63 839 675	G	Fan cover		1	1				W234951G01		
205	R61 049 220	G	Motor	<MF>96W,8P,1Phase,360V	1	1				P780128X01		
206	R61 011 128	G	Motor base		1	1				KB00L364G01		
207	R61 001 505	G	Rubber mount L		1	1				KB31D833H01		
208	R61 002 505	G	Rubber mount R		1	1				KB31D833H02		



PFFY-P20,P25,P32VLRMM-E  
PFFY-P40,P50,P63VLRMM-E

CONTROL BOX PARTS

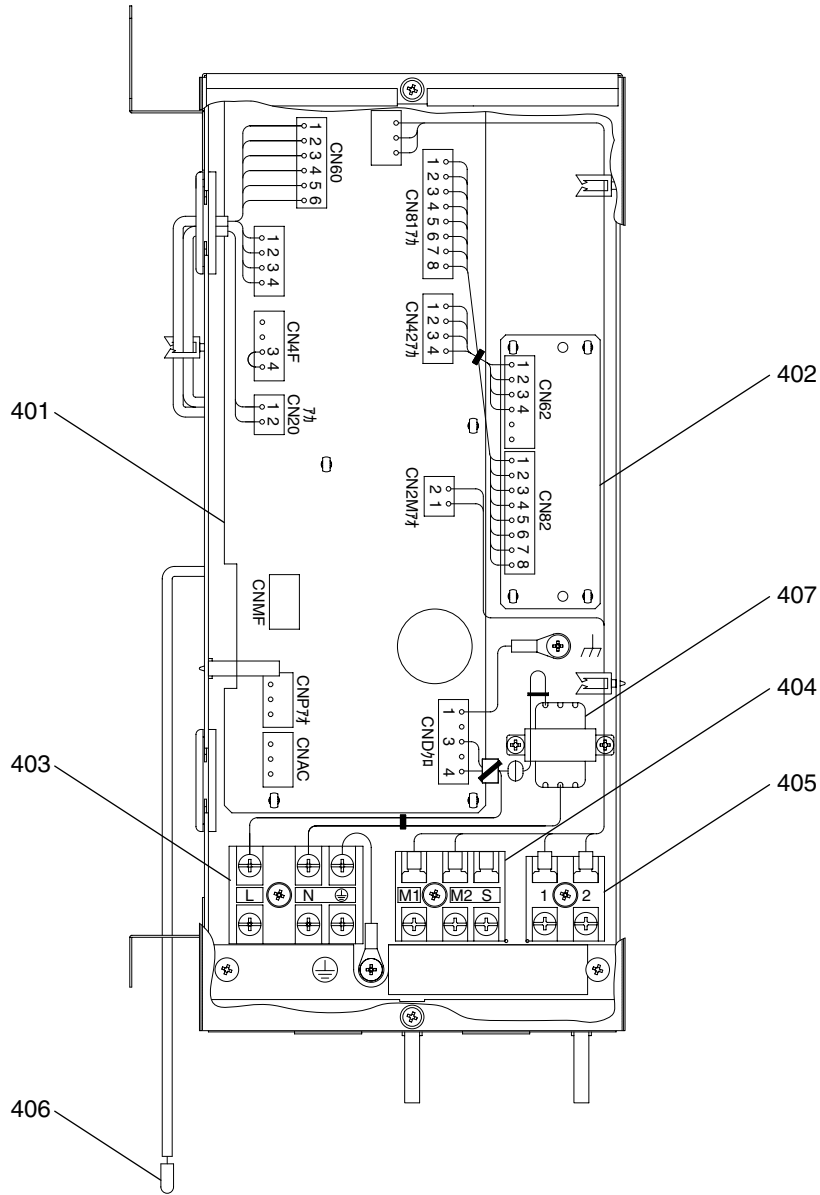

No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change		Spec.	PFFY-P20VLRMM-E	PFFY-P25VLRMM-E	PFFY-P32VLRMM-E	PFFY-P40VLRMM-E	PFFY-P50VLRMM-E	PFFY-P63VLRMM-E	Dwg. No.	Price	Revision History
		Part Name											
401	R61 055 280	G	PCA board assy	INDOOR	1	1	1	1	1	1	KE00D204G09		
402	R61 008 280	G	PCA board assy	AD D	1	1	1	1	1	1	KE00D123G03		
403	R61 002 246	G	Terminal block	<TB2>	1	1	1	1	1	1	BG00R200G26		
404	R61 003 246	G	Terminal block	<TB5>	1	1	1	1	1	1	BG00R200G45		
405	R61 004 246	G	Terminal block	<TB15>	1	1	1	1	1	1	BG00R200G15		
406	R61 042 200	G	Thermistor	inlet <RED>	1	1	1	1	1	1	RG71J628H05		
407	R61 006 259	G	Reactor							1	P715434X01		

