

M series Model List

C.1 WALL-MOUNTED.....C-5

Indoor unit		Outdoor unit	
MSZ-LN18VGW	MSZ-EF18VGW	MUZ-LN25VG	MUZ-WN25VA
MSZ-LN18VGV	MSZ-EF18VGB	MUZ-LN25VGHZ	MUZ-WN35VA
MSZ-LN18VGB	MSZ-EF18VGS	MUZ-LN35VG	MUZ-DM25VA
MSZ-LN18VGR	MSZ-EF22VGW	MUZ-LN35VGHZ	MUZ-DM35VA
MSZ-LN25VGW	MSZ-EF22VGB	MUZ-LN50VG	MUZ-HJ25VA
MSZ-LN25VGV	MSZ-EF22VGS	MUZ-LN50VGHZ	MUZ-HJ35VA
MSZ-LN25VGB	MSZ-EF25VGW	MUZ-LN60VG	MUZ-HJ50VA
MSZ-LN25VGR	MSZ-EF25VGB	MUZ-AP20VG	MUZ-HJ60VA
MSZ-LN35VGW	MSZ-EF25VGS	MUZ-AP25VG	MUZ-HJ71VA
MSZ-LN35VGV	MSZ-EF35VGW	MUZ-AP25VGH	
MSZ-LN35VGB	MSZ-EF35VGB	MUZ-AP35VG	
MSZ-LN35VGR	MSZ-EF35VGS	MUZ-AP35VGH	
MSZ-LN50VGW	MSZ-EF42VGW	MUZ-AP42VG	
MSZ-LN50VGV	MSZ-EF42VGB	MUZ-AP42VGH	
MSZ-LN50VGB	MSZ-EF42VGS	MUZ-AP50VG	
MSZ-LN50VGR	MSZ-EF50VGW	MUZ-AP50VGH	
MSZ-LN60VGW	MSZ-EF50VGB	MUZ-AP60VG	
MSZ-LN60VGV	MSZ-EF50VGS	MUZ-AP71VG	
MSZ-LN60VGB	MSZ-SF15VA	MUZ-HR25VF	
MSZ-LN60VGR	MSZ-SF20VA	MUZ-HR35VF	
MSZ-AP15VG	MSZ-SF25VE3	MUZ-HR42VF	
MSZ-AP20VG	MSZ-SF35VE3	MUZ-HR50VF	
MSZ-AP25VG	MSZ-SF42VE3	MUY-TP35VF	
MSZ-AP25VGK	MSZ-SF50VE3	MUY-TP50VF	
MSZ-AP35VG	MSZ-GF60VE2	MUZ-FH25VE	
MSZ-AP35VGK	MSZ-GF71VE2	MUZ-FH25VEHZ	
MSZ-AP42VG	MSZ-WN25VA	MUZ-FH35VE	
MSZ-AP42VGK	MSZ-WN35VA	MUZ-FH35VEHZ	
MSZ-AP50VG	MSZ-DM25VA	MUZ-FH50VE	
MSZ-AP50VGK	MSZ-DM35VA	MUZ-FH50VEHZ	
MSZ-AP60VG	MSZ-HJ25VA	MUZ-EF25VG	
MSZ-AP60VGK	MSZ-HJ35VA	MUZ-EF25VGH	
MSZ-AP71VG	MSZ-HJ50VA	MUZ-EF35VG	
MSZ-AP71VGK	MSZ-HJ60VA	MUZ-EF35VGH	
MSZ-HR25VF	MSZ-HJ71VA	MUZ-EF42VG	
MSZ-HR35VF		MUZ-EF50VG	
MSZ-HR42VF		MUZ-SF25VE	
MSZ-HR50VF		MUZ-SF25VEH	
MSY-TP35VF		MUZ-SF35VE	
MSY-TP50VF		MUZ-SF35VEH	
MSZ-FH25VE2		MUZ-SF42VE	
MSZ-FH35VE2		MUZ-SF42VEH	
MSZ-FH50VE2		MUZ-SF50VE	
		MUZ-SF50VEH	
		MUZ-GF60VE	
		MUZ-GF71VE	

WALL-MOUNTED

FLOOR-STANDING

CEILING CASSETTE

MULTI-SYSTEM

C.2 FLOOR-STANDING.....C-385

Indoor unit	Outdoor unit
MFZ-KJ25VE2	MUFZ-KJ25VE
MFZ-KJ35VE2	MUFZ-KJ25VEHZ
MFZ-KJ50VE2	MUFZ-KJ35VE
	MUFZ-KJ35VEHZ
	MUFZ-KJ50VE
	MUFZ-KJ50VEHZ

C.3 CEILING CASSETTE.....C-425

Indoor unit
MLZ-KP25VF
MLZ-KP35VF
MLZ-KP50VF

C.4 MULTI SYSTEMC-443

Outdoor unit
MXZ-2F33VF
MXZ-2F42VF
MXZ-2F53VF
MXZ-2F53VFH
MXZ-3F54VF2
MXZ-3F68VF2
MXZ-4F72VF2
MXZ-4F80VF2
MXZ-2D33VA
MXZ-2D42VA2
MXZ-2D53VA2
MXZ-2D53VAH2
MXZ-2E53VAHZ
MXZ-3E54VA
MXZ-3E68VA
MXZ-4E72VA
MXZ-4E83VA
MXZ-4E83VAHZ
MXZ-5E102VA
MXZ-6D122VA2
MXZ-2DM40VA
MXZ-3DM50VA
MXZ-2HA40VF
MXZ-2HA50VF
MXZ-3HA50VF

M series

M series Models

COMBINATION OF SINGLE SPLIT TYPE

Type			Model Name		Type			Model Name	
			Indoor unit	Outdoor unit				Indoor unit	Outdoor unit
M series	Inverter	Heat pump	MSZ-LN18VGW	for MXZ connection only	M series	Inverter	Heat pump	MSZ-HR25VF	MUZ-HR25VF
			MSZ-LN18VGV					MSZ-HR35VF	MUZ-HR35VF
			MSZ-LN18VGB					MSZ-HR42VF	MUZ-HR42VF
			MSZ-LN18VGR					MSZ-HR50VF	MUZ-HR50VF
			MSZ-LN25VGW	MUZ-LN25VG				MSY-TP35VF	MUY-TP35VF
				MUZ-LN25VGHZ				MSY-TP50VF	MUY-TP50VF
			MSZ-LN25VGV	MUZ-LN25VG				MSZ-FH25VE2	MUZ-FH25VE
				MUZ-LN25VGHZ					MUZ-FH25VEHZ
			MSZ-LN25VGB	MUZ-LN25VG				MSZ-FH35VE2	MUZ-FH35VE
				MUZ-LN25VGHZ					MUZ-FH35VEHZ
			MSZ-LN25VGR	MUZ-LN25VG				MSZ-FH50VE2	MUZ-FH50VE
				MUZ-LN25VGHZ					MUZ-FH50VEHZ
			MSZ-LN35VGW	MUZ-LN35VG				MSZ-EF18VGW	for MXZ connection only
				MUZ-LN35VGHZ					
			MSZ-LN35VGV	MUZ-LN35VG					
				MUZ-LN35VGHZ					
			MSZ-LN35VGB	MUZ-LN35VG					
				MUZ-LN35VGHZ					
			MSZ-LN35VGR	MUZ-LN35VG				MSZ-EF25VGW	MUZ-EF25VG
				MUZ-LN35VGHZ					MUZ-EF25VGH
			MSZ-LN50VGW	MUZ-LN50VG				MSZ-EF25VGB	MUZ-EF25VG
				MUZ-LN50VGHZ					MUZ-EF25VGH
			MSZ-LN50VGV	MUZ-LN50VG				MSZ-EF25VGS	MUZ-EF25VG
				MUZ-LN50VGHZ					MUZ-EF25VGH
			MSZ-LN50VGB	MUZ-LN50VG				MSZ-EF35VGW	MUZ-EF35VG
				MUZ-LN50VGHZ					MUZ-EF35VGH
			MSZ-LN50VGR	MUZ-LN50VG				MSZ-EF35VGB	MUZ-EF35VG
				MUZ-LN50VGHZ					MUZ-EF35VGH
			MSZ-LN60VGW	MUZ-LN60VG				MSZ-EF35VGS	MUZ-EF35VG
				MUZ-LN60VGHZ					MUZ-EF35VGH
			MSZ-LN60VGV	MUZ-LN60VG				MSZ-EF42VGW	MUZ-EF42VG
				MUZ-LN60VGHZ					MUZ-EF42VGH
			MSZ-LN60VGB	MUZ-LN60VG				MSZ-EF42VGB	MUZ-EF42VG
				MUZ-LN60VGHZ					MUZ-EF42VGH
			MSZ-LN60VGR	MUZ-LN60VG				MSZ-EF42VGS	MUZ-EF42VG
				MUZ-LN60VGHZ					MUZ-EF42VGH
			MSZ-AP15VG	for MXZ connection only				MSZ-EF50VGW	MUZ-EF50VG
			MSZ-AP20VG	MUZ-AP20VG					MUZ-EF50VGH
			MSZ-AP25VG	MUZ-AP25VG				MSZ-EF50VGB	MUZ-EF50VG
				MUZ-AP25VGH					MUZ-EF50VGH
MSZ-AP25VGK	MUZ-AP25VG	MSZ-EF50VGS	MUZ-EF50VG						
	MUZ-AP25VGH		MUZ-EF50VGH						
MSZ-AP35VG	MUZ-AP35VG	MSZ-SF15VA	for MXZ connection only						
	MUZ-AP35VGH								
MSZ-AP35VGK	MUZ-AP35VG	MSZ-SF20VA	MUZ-SF25VE						
	MUZ-AP35VGH		MUZ-SF25VEH						
MSZ-AP42VG	MUZ-AP42VG	MSZ-SF35VE3	MUZ-SF35VE						
	MUZ-AP42VGH		MUZ-SF35VEH						
MSZ-AP42VGK	MUZ-AP42VG	MSZ-SF42VE3	MUZ-SF42VE						
	MUZ-AP42VGH		MUZ-SF42VEH						
MSZ-AP50VG	MUZ-AP50VG	MSZ-SF50VE3	MUZ-SF50VE						
	MUZ-AP50VGH		MUZ-SF50VEH						
MSZ-AP50VGK	MUZ-AP50VG	MSZ-GF60VE2	MUZ-GF60VE						
	MUZ-AP50VGH		MUZ-GF71VE						
MSZ-AP60VG	MUZ-AP60VG	MSZ-WN25VA	MUZ-WN25VA						
MSZ-AP60VGK			MUZ-WN35VA						
MSZ-AP71VG	MUZ-AP71VG	MSZ-WN35VA	MUZ-WN35VA						
MSZ-AP71VGK			MUZ-DM25VA						
		MSZ-DM35VA	MUZ-DM35VA						
		MSZ-HJ25VA	MUZ-HJ25VA						
		MSZ-HJ35VA	MUZ-HJ35VA						
		MSZ-HJ50VA	MUZ-HJ50VA						
		MSZ-HJ60VA	MUZ-HJ60VA						
		MSZ-HJ71VA	MUZ-HJ71VA						

Type			Model Name	
			Indoor unit	Outdoor unit
Floor- Standing	Inverter	Heat pump	MFZ-KJ25VE2	MUFZ-KJ25VE
				MUFZ-KJ25VEHZ
			MFZ-KJ35VE2	MUFZ-KJ35VE
				MUFZ-KJ35VEHZ
			MFZ-KJ50VE2	MUFZ-KJ50VE
				MUFZ-KJ50VEHZ
Ceiling Cassette	Inverter	Heat pump	MLZ-KP25VF	for MXZ connection only
			MLZ-KP35VF	for MXZ connection only
			MLZ-KP50VF	for MXZ connection only

Indoor Unit Compatibility Table

MXZ Series **R32**

Possible combinations of outdoor units and indoor units are shown below.

Indoor Unit		Outdoor Unit	Inverter Models Heat pump type									
			MXZ-*3 2F33VF	MXZ-*3 2F42VF	MXZ-*3 2F53VF(H)	MXZ-*3 3F54VF2	MXZ-*3 3F68VF2	MXZ-*3 4F72VF2	MXZ-*3 4F80VF2	MXZ-*3 2HA40VF	MXZ-*3 2HA50VF	MXZ-*3 3HA50VF
M series	Wall-Mounted	MSZ-LN18VG(W)(V)(R)(B)	●	●	●	●	●	●	●			
		MSZ-LN25VG(W)(V)(R)(B)	●	●	●	●	●	●	●			
		MSZ-LN35VG(W)(V)(R)(B)		●	●	●	●	●	●			
		MSZ-LN50VG(W)(V)(R)(B)										
		MSZ-AP15VG	●	●	●	●	●	●	●			
		MSZ-AP20VG	●	●	●	●	●	●	●			
		MSZ-AP25VG	●	●	●	●	●	●	●			
		MSZ-AP35VG		●	●	●	●	●	●			
		MSZ-AP42VG			●	●	●	●	●			
		MSZ-AP50VG			●	●	●	●	●			
		MSZ-FH25VE2										
		MSZ-FH35VE2										
		MSZ-FH50VE2										
		MSZ-EF18VG(W)(B)(S)	●	●	●	●	●	●	●			
		MSZ-EF22VG(W)(B)(S)	●	●	●	●	●	●	●			
		MSZ-EF25VG(W)(B)(S)	●	●	●	●	●	●	●			
		MSZ-EF35VG(W)(B)(S)		●	●	●	●	●	●			
		MSZ-EF42VG(W)(B)(S)			●	●	●	●	●			
		MSZ-EF50VG(W)(B)(S)			●	●	●	●	●			
		MSZ-SF15VA										
	MSZ-SF20VA											
	MSZ-SF25VE3											
	MSZ-SF35VE3											
	MSZ-SF42VE3											
	MSZ-SF50VE3											
	MSZ-GF60VE2											
	MSZ-GF71VE2											
	MSZ-DM25VA											
	MSZ-DM35VA											
	MSZ-HJ25VA											
	MSZ-HJ35VA											
	MSZ-HJ50VA											
MSZ-HR25VF									●	●	●	
MSZ-HR35VF									●	●	●	
MSZ-HR42VF										●	●	
MSZ-HR50VF											●	
Floor-Standing	MFZ-KJ25VE2											
	MFZ-KJ35VE2											
	MFZ-KJ50VE2											
1-way Cassette	MLZ-KP25VF	●	●	●	●	●	●	●				
	MLZ-KP35VF		●	●	●	●	●	●				
	MLZ-KP50VF				●	●	●	●				
S series	2x2 Cassette	SLZ-M15FA	●	●	●	●	●	●				
		SLZ-M25FA	●	●	●	●	●	●				
		SLZ-M35FA		●	●	●	●	●	●			
		SLZ-M50FA				●	●	●	●			
	Ceiling-Concealed	SEZ-M25DA*2	●	●	●	●	●	●	●			
		SEZ-M25DAL*2	●	●	●	●	●	●	●			
		SEZ-M35DA		●	●	●	●	●	●			
		SEZ-M35DAL		●	●	●	●	●	●			
		SEZ-M50DA				●	●	●	●			
		SEZ-M50DAL				●	●	●	●			
SEZ-M60DA					●	●	●					
SEZ-M60DAL					●	●	●					
SEZ-M71DA						●	●					
SEZ-M71DAL												
P series	4-way Cassette	PLA-M50EA										
		PLA-M60EA										
		PLA-M71EA										
	Ceiling-Suspended	PCA-M50KA				●	●	●	●			
		PCA-M60KA					●	●	●			
		PCA-M71KA						●	●			
	Ceiling-Concealed	PEAD-M50JA				●*1	●*1	●*1	●*1			
		PEAD-M50JAL				●*1	●*1	●*1	●*1			
		PEAD-M60JA										
		PEAD-M60JAL										
PEAD-M71JA												
PEAD-M71JAL												

*1 Maximum total current of indoor units: 3A or less.
 *2 SEZ-M25 cannot be connected with MXZ-2F/3F/4F when total capacity of connected indoor units is equivalent to outdoor capacity (capacity ratio is 1).
 *3 MXZ outdoor units are not designed to operate with a single indoor unit with one-to-one piping work. Please install at least two indoor units.

MXZ Series R410A

Possible combinations of outdoor units and indoor units are shown below.

Indoor Unit		Outdoor Unit	Inverter Models Heat pump type													
			MXZ- ^{*3} 2D33VA	MXZ- ^{*3} 2D42VA2	MXZ- ^{*3} 2D53VA(H)2	MXZ- ^{*3} 2E53VAHZ	MXZ- ^{*3} 3E54VA	MXZ- ^{*3} 3E68VA	MXZ- ^{*3} 4E72VA	MXZ- ^{*3} 4E83VA	MXZ- ^{*3} 4E83VAHZ	MXZ- ^{*3} 5E102VA	MXZ- ^{*3} 6D122VA2	MXZ- ^{*3} 2DM40VA	MXZ- ^{*3} 3DM50VA	
M series	Wall-Mounted	MSZ-LN18VG(W)(V)(R)(B)														
		MSZ-LN25VG(W)(V)(R)(B)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-LN35VG(W)(V)(R)(B)		●	●	●	●	●	●	●	●	●	●			
		MSZ-LN50VG(W)(V)(R)(B)														
		MSZ-AP15VG	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-AP20VG	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-AP25VG ^{*7}	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-AP35VG ^{*7}		●	●	●	●	●	●	●	●	●	●			
		MSZ-AP42VG ^{*7}			●	●	●	●	●	●	●	●	●			
		MSZ-AP50VG ^{*7}			●	●	●	●	●	●	●	●	●			
		MSZ-FH25VE2	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-FH35VE2		●	●	●	●	●	●	●	●	●	●			
		MSZ-FH50VE2					●	●	●	●	●	●	●			
		MSZ-EF18VE3(W)(B)(S)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-EF22VE3(W)(B)(S)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-EF25VE3(W)(B)(S)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-EF35VE3(W)(B)(S)		●	●	●	●	●	●	●	●	●	●			
		MSZ-EF42VE3(W)(B)(S)			●	●	●	●	●	●	●	●	●			
		MSZ-EF50VE3(W)(B)(S)			●	●	●	●	●	●	●	●	●			
		MSZ-EF18VG(W)(B)(S)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-EF22VG(W)(B)(S)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-EF25VG(W)(B)(S)	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-EF35VG(W)(B)(S)		●	●	●	●	●	●	●	●	●	●			
		MSZ-EF42VG(W)(B)(S)			●	●	●	●	●	●	●	●	●			
		MSZ-EF50VG(W)(B)(S)			●	●	●	●	●	●	●	●	●			
		MSZ-SF15VA	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-SF20VA	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-SF25VE3	●	●	●	●	●	●	●	●	●	●	●			
		MSZ-SF35VE3		●	●	●	●	●	●	●	●	●	●			
		MSZ-SF42VE3			●	●	●	●	●	●	●	●	●			
		MSZ-SF50VE3			●	●	●	●	●	●	●	●	●			
		MSZ-GF60VE2						●	●	●	●	●	●			
		MSZ-GF71VE2							●	●	●	●	●			
		MSZ-DM25VA													●	●
		MSZ-DM35VA													●	●
		MSZ-HJ25VA													●	●
		MSZ-HJ35VA													●	●
		MSZ-HJ50VA													●	●
MSZ-HR25VF																
MSZ-HR35VF																
MSZ-HR42VF																
MSZ-HR50VF																
Floor-Standing	MFZ-KJ25VE2	● ^{*4*5}	● ^{*4}	● ^{*4}	●	● ^{*4}	● ^{*4}	●	●	●	●	●				
	MFZ-KJ35VE2		● ^{*4}	● ^{*4}	●	● ^{*4}	● ^{*4}	●	●	●	●	●				
	MFZ-KJ50VE2				●	● ^{*4}	● ^{*4}	●	●	●	●	●				
1-way Cassette	MLZ-KP25VF	●	●	●	●	●	●	●	●	●	●	●				
	MLZ-KP35VF		●	●	●	●	●	●	●	●	●	●				
	MLZ-KP50VF				●	●	●	●	●	●	●	●				
S series	2x2 Cassette	SLZ-M15FA					●	●	●	●	●	●				
		SLZ-M25FA	●	●	●	●	●	●	●	●	●	●				
		SLZ-M35FA		●	●	●	●	●	●	●	●	●				
	SLZ-M50FA					●	●	●	●	●	●	●				
	Ceiling-Concealed	SEZ-M25DA ^{*2}	●	●	●	●	●	●	●	●	●	●	●			
		SEZ-M25DAL ^{*2}	●	●	●	●	●	●	●	●	●	●	●			
		SEZ-M35DA		●	●	●	●	●	●	●	●	●	●			
		SEZ-M35DAL		●	●	●	●	●	●	●	●	●	●			
		SEZ-M50DA					●	●	●	●	●	●	●			
		SEZ-M50DAL					●	●	●	●	●	●	●			
		SEZ-M60DA					●	●	●	●	●	●	●			
		SEZ-M60DAL					●	●	●	●	●	●	●			
SEZ-M71DA						●	●	●	●	●	●					
SEZ-M71DAL							●	●	●	●	●					
P series	4-way Cassette	PLA-M50EA					●	●	●	●	●	●				
		PLA-M60EA						●	●	●	●	●	●			
		PLA-M71EA							●	●	●	●	●	●		
	Ceiling-Suspended	PCA-M50KA					●	●	●	●	●	●	●			
		PCA-M60KA						●	●	●	●	●	●	●		
		PCA-M71KA							●	●	●	●	●	●	●	
	Ceiling-Concealed	PEAD-M50JA					● ^{*1}	● ^{*1}	● ^{*1}	● ^{*1}	● ^{*1*6}	● ^{*1}	● ^{*1}			
		PEAD-M50JAL					● ^{*1}	● ^{*1}	● ^{*1}	● ^{*1}	● ^{*1*6}	● ^{*1}	● ^{*1}			
		PEAD-M60JA								● ^{*1}	● ^{*1*6}	● ^{*1}	● ^{*1}			
		PEAD-M60JAL								● ^{*1}	● ^{*1*6}	● ^{*1}	● ^{*1}			
		PEAD-M71JA								● ^{*1}	● ^{*1*6}	● ^{*1}	● ^{*1}			
		PEAD-M71JAL								● ^{*1}	● ^{*1*6}	● ^{*1}	● ^{*1}			

*1 Maximum total current of indoor units: 3A or less.

*2 SEZ-KD25 cannot be connected with MXZ-2D(E)/3E/4E/5E when total capacity of connected indoor units is equivalent to outdoor capacity (capacity ratio is 1).

*3 MXZ outdoor units are not designed to operate with a single indoor unit with one-to-one piping work. Please install at least two indoor units.

*4 When connecting the MFZ-KJ Series indoor unit, additional refrigerant is required. For details, please refer to page 102.

*5 Regarding MXZ-2D33, the second unit should be a different type in the case of selecting one MFZ-KJ.

*6 P series cannot be connected with MXZ-4E83VAHZ when ampere limit adjustment function is operated.

*7 Connectable outdoor unit are MXZ-2D33VA-E4, MXZ-2D42VA2-E4, MXZ-2D53VA2-E4, MXZ-2E53VAHZ-E2, MXZ-3E54VA-E2, MXZ-3E68VA-E2, MXZ-4E72VA-E2, MXZ-4E83VA-E4, MXZ-4E83VAHZ-E3, MXZ-5E102VA-E4.

C.1 WALL-MOUNTED

C.1.1	SPECIFICATIONS	C-6
	C.1.1.1 Inverter.....	C-6
C.1.2	OUTLINES AND DIMENSIONS.....	C-26
	C.1.2.1 Indoor Unit.....	C-26
	C.1.2.2 Outdoor Unit.....	C-36
C.1.3	WIRING DIAGRAM.....	C-46
	C.1.3.1 Indoor Unit.....	C-46
	C.1.3.2 Outdoor Unit.....	C-57
C.1.4	REFRIGERANT SYSTEM DIAGRAM	C-78
	C.1.4.1 Inverter.....	C-78
C.1.5	PERFORMANCE CURVES	C-96
	C.1.5.1 Inverter.....	C-97
	C.1.5.2 Powerful Heating Heat Pump.....	C-119
	C.1.5.3 Inverter/Powerful Heating Heat Pump.....	C-127
C.1.6	PERFORMANCE DATA.....	C-145
	C.1.6.1 Inverter.....	C-145
C.1.7	NOISE CRITERIA CURVES	C-230
	C.1.7.1 Indoor Unit.....	C-230
	C.1.7.2 Outdoor Unit.....	C-241
C.1.8	TEMPERATURE AND AIR FLOW DISTRIBUTIONS.....	C-253
C.1.9	OPERATION AND ACTUATOR CONTROL	C-297
	C.1.9.1 MSZ-LN·VGW/V/B/R Series	C-297
	C.1.9.2 MSZ-AP·VG Series	C-308
	C.1.9.3 MSZ-AP·VG(K) Series	C-316
	C.1.9.4 MSZ-HR·VF Series.....	C-325
	C.1.9.5 MSY-TP·VF Series	C-330
	C.1.9.6 MSZ-FH·VE2 Series.....	C-337
	C.1.9.7 MSZ-EF·VGW/B/S, SF·VE3 Series.....	C-346
	C.1.9.8 MSZ-SF·VA Series	C-354
	C.1.9.9 MSZ-GF·VE2 Series.....	C-361
	C.1.9.10 MSZ-WN·VA Series.....	C-369
	C.1.9.11 MSZ-DM·VA Series	C-374
	C.1.9.12 MSZ-HJ·VA Series	C-379
C.1.10	CAPACITY CORRECTION RATIO CURVE FOR PIPING LENGTH	C-384

C.1.1 SPECIFICATIONS

C.1.1.1 Inverter

Indoor Unit			MSZ-LN18VG	MSZ-LN25VG	MSZ-LN35VG	MSZ-LN50VG	MSZ-LN60VG	
Outdoor Unit			for MXZ connection	MUZ-LN25VG	MUZ-LN35VG	MUZ-LN50VG	MUZ-LN60VG	
Refrigerant			R32 (*1)	R32 (*1)	R32 (*1)	R32 (*1)	R32 (*1)	
Power Supply			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	
Outdoor (V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	-	2.5	3.5	5.0	6.1
		Min. - Max.	kW	-	1.0 - 3.5	0.8 - 4.0	1.0 - 6.0	1.4 - 6.9
	SHF			-	0.97	0.9	0.77	0.75
	Total Input	Rated	kW	-	0.485	0.820	1.380	1.790
		EER		-	5.15	4.27	3.62	3.41
	Design load	EEL Rank		-	A	A	A	A
		Annual electricity consumption (*2)	kWh/a	-	83	128	205	285
	SEER			-	10.5	9.5	8.5	7.5
		Energy efficiency class		-	A+++	A+++	A+++	A++
	Heating (Average Season)	Capacity	Rated	kW	-	3.2	4.0	6.0
Min. - Max.			kW	-	0.8 - 5.4	1.0 - 6.3	1.0 - 8.2	1.8 - 9.3
Total Input		Rated	kW	-	0.580	0.800	1.480	1.810
		COP		-	5.52	5.00	4.05	3.76
Design load		EEL Rank		-	A	A	A	A
		Declared Capacity	at reference design temperature	kW	-	3.0(-10°C)	3.6(-10°C)	4.5(-10°C)
Back up heating capacity		at bivalent temperature	kW	-	3.0(-10°C)	3.6(-10°C)	4.5(-10°C)	6.0(-10°C)
		at operation limit temperature	kW	-	2.5(-15°C)	3.2(-15°C)	4.2(-15°C)	6.0(-15°C)
Annual electricity consumption (*2)		kWh/a	-	-	794	974	1369	1826
		SCOP		-	5.2	5.1	4.6	4.6
Operating Current (Max.)	Energy efficiency class		-	A+++	A+++	A++	A++	
			-	7.1	9.9	13.9	15.2	
Indoor Unit	Input	Rated	kW	0.029	0.029	0.029	0.034	0.040
		Operating Current (Max.)	A	0.3	0.3	0.3	0.4	0.4
	Dimensions	H x W x D	mm	307 x 890 x 233	307 x 890 x 233	307 x 890 x 233	307 x 890 x 233	307 x 890 x 233
		Weight	kg	15.5	15.5	15.5	15.5	15.5
	Air Volume (SLo-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	4.3 - 5.8 - 7.1 - 8.8 - 11.9	4.3 - 5.8 - 7.1 - 8.8 - 11.9	4.3 - 5.8 - 7.1 - 8.8 - 12.8	5.7 - 7.6 - 8.8 - 10.6 - 13.9	7.1 - 8.8 - 10.6 - 12.7 - 15.7
		Heating	m ³ /min.	4.0 - 5.7 - 7.1 - 8.5 - 14.4	4.0 - 5.7 - 7.1 - 8.5 - 14.4	4.3 - 5.7 - 7.1 - 8.5 - 13.7	5.4 - 6.4 - 8.5 - 10.7 - 15.7	6.6 - 9.5 - 11.5 - 13.6 - 15.7
	Sound Level (SPL) (SLo-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	19 - 23 - 29 - 36 - 42	19 - 23 - 29 - 36 - 42	19 - 24 - 29 - 36 - 43	27 - 31 - 35 - 39 - 46	29 - 37 - 41 - 45 - 49
		Heating	dB(A)	19 - 24 - 29 - 36 - 45	19 - 24 - 29 - 36 - 45	19 - 24 - 29 - 36 - 45	25 - 29 - 34 - 39 - 47	29 - 37 - 41 - 45 - 49
	Sound Level (PWL)	Cooling	dB(A)	58	58	58	60	65
		Heating	dB(A)	-	-	-	-	-
Outdoor Unit	Dimensions	H x W x D	mm	-	550 x 800 x 285	550 x 800 x 285	714 x 800 x 285	880 x 840 x 330
		Weight	kg	-	35	35	40	55
	Air Volume	Cooling	m ³ /min.	-	31.4	31.4	40.0	50.1
		Heating	m ³ /min.	-	26.6	29.8	40.5	51.3
	Sound Level (SPL)	Cooling	dB(A)	-	46	49	51	55
		Heating	dB(A)	-	49	50	54	55
	Sound Level (PWL)	Cooling	dB(A)	-	60	61	64	65
		Heating	dB(A)	-	-	-	-	-
	Operating Current (Max.)	A	-	6.8	9.6	13.5	14.8	
		Breaker Size	A	-	10	10	16	16
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/9.52	6.35/9.52	6.35/12.7
	Max.Length	Out-In	m	-	20	20	20	30
	Max.Height	Out-In	m	-	12	12	12	15
Guaranteed Operating Range (Outdoor)	Cooling	°C	-	-10 ~ +46	-10 ~ +46	-10 ~ +46	-10 ~ +46	
	Heating	°C	-	-15 ~ +24	-15 ~ +24	-15 ~ +24	-15 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-LN25VG	MSZ-LN35VG	MSZ-LN50VG	
Outdoor Unit				MUZ-LN25VGHZ	MUZ-LN35VGHZ	MUZ-LN50VGHZ	
Refrigerant				R32 (*1)	R32 (*1)	R32 (*1)	
Power Supply				Outdoor Power supply 230V/SinglePhase/50Hz	Outdoor Power supply 230V/SinglePhase/50Hz	Outdoor Power supply 230V/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	2.5	3.5	5.0	
		Min-Max.	kW	0.8 - 3.5	0.8 - 4.0	1.4 - 5.8	
	SHF				0.97	0.90	0.77
	Total Input		Rated	kW	0.485	0.820	1.380
	EER				5.15	4.27	3.62
			EEL Rank		A	A	A
	Design load			kW	2.5	3.5	5.0
	Annual electricity consumption (*2)			kWh/a	83	130	230
	SEER				10.5	9.4	7.6
			Energy efficiency class		A+++	A+++	A++
Heating (Average Season)	Capacity	Rated	kW	3.2	4.0	6.0	
		Min-Max.	kW	1.0 - 6.3	1.0 - 6.6	1.8 - 8.7	
	Total Input		Rated	kW	0.580	0.800	1.480
	COP				5.52	5.00	4.05
			EEL Rank		A	A	A
	Design load			kW	3.2(-10°C)	4.0(-10°C)	6.0(-10°C)
	Declared Capacity		at reference design temperature	kW	3.2(-10°C)	4.0(-10°C)	6.0(-10°C)
			at bivalent temperature	kW	3.2(-10°C)	4.0(-10°C)	6.0(-10°C)
			at operation limit temperature	kW	2.3(-25°C)	3.1(-25°C)	4.7(-25°C)
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)
Annual electricity consumption (*2)			kWh/a	849	1082	1826	
SCOP				5.2	5.1	4.6	
		Energy efficiency class		A+++	A+++	A++	
Operating Current (Max.)			A	9.9	10.5	15.2	
Indoor Unit	Input	Rated	kW	0.029	0.029	0.034	
	Operating Current (Max.)		A	0.3	0.3	0.4	
	Dimensions		H × W × D	mm	307 × 890 × 233	307 × 890 × 233	307 × 890 × 233
	Weight			kg	15.5	15.5	15.5
	Air Volume (SLo-Lo-Mid-Hi-SHi (*3) (Dry/Wet))		Cooling	m ³ /min.	4.3 - 5.8 - 7.1 - 8.8 - 11.9	4.3 - 5.8 - 7.1 - 8.8 - 12.8	5.7 - 7.6 - 8.9 - 10.6 - 13.9
			Heating	m ³ /min.	4.0 - 5.7 - 7.1 - 8.5 - 14.4	4.3 - 5.7 - 7.1 - 8.5 - 13.7	5.4 - 6.4 - 8.5 - 10.7 - 15.7
	Sound Level (SPL) (SLo-Lo-Mid-Hi-SHi (*3))		Cooling	dB(A)	19 - 23 - 29 - 36 - 42	19 - 24 - 29 - 36 - 43	27 - 31 - 35 - 39 - 46
Heating			dB(A)	19 - 24 - 29 - 36 - 45	19 - 24 - 29 - 36 - 45	25 - 29 - 34 - 39 - 47	
Sound Level (PWL)		Cooling	dB(A)	58	58	60	
Outdoor Unit	Dimensions		H × W × D	mm	550 × 800 × 285	550 × 800 × 285	880 × 840 × 330
	Weight			kg	35	36	55
	Air Volume		Cooling	m ³ /min.	31.4	33.8	48.8
			Heating	m ³ /min.	27.4	27.4	51.3
	Sound Level (SPL)		Cooling	dB(A)	46	49	51
			Heating	dB(A)	49	50	54
	Sound Level (PWL)		Cooling	dB(A)	60	61	64
	Operating Current (Max.)		A	9.6	10.2	14.8	
Breaker Size		A	10	12	16		
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/9.52	
	Max.Length	Out-In	m	20	20	30	
	Max.Height	Out-In	m	12	12	15	
Guaranteed Operating Range (Outdoor)		Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	
		Heating	°C	-25 ~ +24	-25 ~ +24	-25 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-AP15VG	MSZ-AP20VG	
Outdoor Unit				for MXZ connection	MUZ-AP20VG	
Refrigerant				R32 ^(*)	R32 ^(*)	
Power Supply	Source			Outdoor Power supply	Outdoor Power supply	
	Outdoor(V/Phase/Hz)			230/SinglePhase/50Hz	230V/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	-	2.0	
		Min-Max	kW	-	0.6-2.7	
	Total Input	Rated	kW	-	0.460	
		EER		-	4.40	
			EEL Rank		A	
	Design load		kW	-	2.0	
	Annual electricity consumption ^(*)		kWh/a	-	81	
	SEER			-	8.6	
			Energy efficiency class	-	A+++	
	Heating (Average Season)	Capacity	Rated	kW	-	2.5
Min-Max			kW	-	0.5-3.5	
Total Input		Rated	kW	-	0.600	
		COP		-	4.17	
		EEL Rank		A		
Design load		kW	-	2.3(-10°C)		
Declared Capacity		at reference design temperature	kW	-	2.3(-10°C)	
		at bivalent temperature	kW	-	2.3(-10°C)	
		at operation limit temperature	kW	-	2.2(-15°C)	
Back up heating capacity		kW	-	0.0(-10°C)		
Annual electricity consumption ^(*)		kWh/a	-	766		
SCOP			-	4.2		
		Energy efficiency class	-	A+		
Operating Current(Max)			A	7.0		
Indoor Unit	Input	Rated	kW	0.017	0.019	
	Operating Current(Max)		A	0.17	0.2	
	Dimensions		H x W x D	mm	250 x 760 x 178	250 x 760 x 178
	Weight		kg		8.2	8.2
	Air Volume (SLo-Lo-Mid-Hi-Shi ^(*) (Dry/Wet))	Cooling	m ³ /min	3.5 - 3.9 - 4.6 - 5.5 - 6.4	3.5 - 3.9 - 4.6 - 5.5 - 6.9	
		Heating	m ³ /min	3.7 - 4.4 - 5.0 - 6.0 - 6.8	3.7 - 4.4 - 5.0 - 6.0 - 7.3	
	Sound Level (SPL) (SLo-Lo-Mid-Hi-Shi ^(*))	Cooling	dB(A)	21 - 26 - 30 - 35 - 40	21 - 26 - 30 - 35 - 42	
		Heating	dB(A)	21 - 26 - 30 - 35 - 40	21 - 26 - 30 - 35 - 42	
	Sound Level (PWL)		Cooling	dB(A)	59	60
Outdoor Unit	Dimensions		H x W x D	mm	550 x 800 x 285	
	Weight		kg		31	
	Air Volume	Cooling	m ³ /min		32.2	
		Heating	m ³ /min		29.8	
	Sound Level (SPL)	Cooling	dB(A)		47	
		Heating	dB(A)		48	
	Sound Level (PWL)		Cooling	dB(A)	59	
	Operating Current(Max)		A		6.8	
	Breaker Size		A		10	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35 / 9.52	6.35 / 9.52	
	Max.Length	Out-In	m	-	20	
	Max.Height	Out-In	m	-	12	
Guaranteed Operating Range(Outdoor)		Cooling	°C	-	-10~+46	
		Heating	°C	-	-15~+24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

SPECIFICATIONS WALL-MOUNTED

Indoor Unit				MSZ-AP25VG(K)	MSZ-AP25VG(K)	MSZ-AP35VG(K)	MSZ-AP35VG(K)	
Outdoor Unit				MUZ-AP25VGH	MUZ-AP25VGH	MUZ-AP35VGH	MUZ-AP35VGH	
Refrigerant				R32	R32	R32	R32	
Power Supply				Outdoor Power supply 230/SinglePhase/50Hz	Outdoor Power supply 230/SinglePhase/50Hz	Outdoor Power supply 230/SinglePhase/50Hz	Outdoor Power supply 230/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	2.5	2.5	3.5	3.5	
		Min.-Max.	kW	0.9-3.4	0.9-3.4	1.1-3.8	1.1-3.8	
	Total Input	Rated	kW	0.600	0.600	0.990	0.990	
		EER		4.17	4.17	3.54	3.54	
	EEL Rank			A	A	A	A	
	Design load			2.5	2.5	3.5	3.5	
	Annual electricity consumption (*2)		kWh/a	101	101	142	142	
	SEER			8.6	8.6	8.6	8.6	
	Energy efficiency class			A+++	A+++	A+++	A+++	
	Heating (Average Season)	Capacity	Rated	kW	3.2	3.2	4.0	4.0
Min.-Max.			kW	1.0-4.1	1.0-4.1	1.3-4.6	1.3-4.6	
Total Input		Rated	kW	0.780	0.780	1.030	1.030	
		COP		4.10	4.10	3.88	3.88	
EEL Rank			A	A	A	A		
Design load			2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	2.9(-10°C)		
Declared Capacity		at reference design temperature	kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	2.9(-10°C)	
		at bivalent temperature	kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	2.9(-10°C)	
		at operation limit temperature	kW	2.4(-15°C)	2.2(-20°C)	2.6(-15°C)	2.4(-20°C)	
Back up heating capacity		kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)		
Annual electricity consumption (*2)		kWh/a	698	703	862	873		
SCOP			4.8	4.7	4.7	4.6		
Energy efficiency class			A++	A++	A++	A++		
Operating Current(Max)			A	7.1	7.1	8.5	8.5	
Indoor Unit	Input	Rated	kW	0.026	0.026	0.026	0.026	
		Operating Current (Max.)	A	0.3	0.3	0.3	0.3	
	Dimensions		H x W x D	mm	299 x 798 x 219	299 x 798 x 219	299 x 798 x 219	299 x 798 x 219
	Weight			kg	10.5	10.5	10.5	10.5
	Air Volume (SLo-Lo-Mid-Hi-Shi (*3) (Dry/Wet))	Cooling	m ³ /min	4.9 - 5.9 - 7.1 - 8.7 - 11.4	4.9 - 5.9 - 7.1 - 8.7 - 11.4	4.9 - 5.9 - 7.1 - 8.7 - 11.4	4.9 - 5.9 - 7.1 - 8.7 - 11.4	
		Heating	m ³ /min	4.9 - 5.9 - 7.3 - 8.9 - 12.9	4.9 - 5.9 - 7.3 - 8.9 - 12.9	4.9 - 5.9 - 7.3 - 8.9 - 12.9	4.9 - 5.9 - 7.3 - 8.9 - 12.9	
	Sound Level (SPL) (SLo-Lo-Mid-Hi-Shi) (*3)	Cooling	dB(A)	19 - 24 - 30 - 36 - 42	19 - 24 - 30 - 36 - 42	19 - 24 - 30 - 36 - 42	19 - 24 - 30 - 36 - 42	
		Heating	dB(A)	19 - 24 - 34 - 39 - 45	19 - 24 - 34 - 39 - 45	19 - 24 - 31 - 38 - 45	19 - 24 - 31 - 38 - 45	
	Sound Level (PWL)		Cooling	dB(A)	57	57	57	57
	Outdoor Unit	Dimensions		H x W x D	mm	550 x 800 x 285	550 x 800 x 285	550 x 800 x 285
Weight			kg	31	31	31		
Air Volume		Cooling	m ³ /min	32.2	32.2	32.2	32.2	
		Heating	m ³ /min	29.8	29.8	33.8	33.8	
Sound Level (SPL)		Cooling	dB(A)	47	47	49	49	
		Heating	dB(A)	48	48	50	50	
Sound Level (PWL)		Cooling	dB(A)	59	59	61	61	
Operating Current (Max.)			A	6.8	6.8	8.2	8.2	
Breaker Size			A	10	10	10	10	
Ext.Piping		Diameter	Liquid/Gas	mm	6.35 / 9.52	6.35 / 9.52	6.35 / 9.52	6.35 / 9.52
	Max.Length		Out-In	m	20	20	20	20
	Max.Height		Out-In	m	12	12	12	12
Guaranteed Operating Range (Outdoor)		Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	-10 ~ +46	
		Heating	°C	-15 ~ +24	-20 ~ +24	-15 ~ +24	-20 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

WALL-MOUNTED SPECIFICATIONS

Indoor Unit			MSZ-AP42VG(K)	MSZ-AP42VG(K)	MSZ-AP50VG(K)	MSZ-AP50VG(K)	
Outdoor Unit			MUZ-AP42VG	MUZ-AP42VGH	MUZ-AP50VG	MUZ-AP50VGH	
Refrigerant			R32	R32	R32	R32	
Power Supply	Source		Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	
	Outdoor(V/Phase/Hz)		230/SinglePhase/50Hz	230/SinglePhase/50Hz	230/SinglePhase/50Hz	230/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	4.2	4.2	5.0	5.0
		Min.-Max.	kW	0.9-4.5	0.9-4.5	1.4-5.4	1.4-5.4
	Total Input	Rated	kW	1.300	1.300	1.550	1.550
		EER		3.23	3.23	3.23	3.23
		EEL Rank		A	A	A	A
	Design load		kW	4.2	4.2	5.0	5.0
		Annual electricity consumption (*2)	kWh/a	188	188	236	236
	SEER		7.8	7.8	7.4	7.4	
		Energy efficiency class		A++	A++	A++	A++
	Heating (Average Season)	Capacity	Rated	kW	5.4	5.4	5.8
Min.-Max.			kW	1.3-6.0	1.3-6.0	1.4-7.3	1.4-7.3
Total Input		Rated	kW	1.490	1.490	1.600	1.600
		COP		3.62	3.62	3.63	3.63
		EEL Rank		A	A	A	A
Design load			kW	3.8(-10°C)	3.8(-10°C)	4.2(-10°C)	4.2(-10°C)
		Declared Capacity	at reference design temperature	kW	3.8(-10°C)	3.8(-10°C)	4.2(-10°C)
		at bivalent temperature	kW	3.8(-10°C)	3.8(-10°C)	4.2(-10°C)	4.2(-10°C)
		at operation limit temperature	kW	4.2(-15°C)	3.8(-20°C)	4.7(-15°C)	4.2(-20°C)
Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)
Annual electricity consumption (*2)		kWh/a	1120	1134	1250	1275	
SCOP		4.7	4.6	4.7	4.6		
	Energy efficiency class		A++	A++	A++	A++	
Operating Current(Max)			A	9.9	13.6	13.6	
Indoor Unit	Input	Rated	kW	0.032	0.032	0.032	0.032
		Operating Current (Max.)	A	0.3	0.3	0.3	0.3
	Dimensions	H x W x D	mm	299 x 798 x 219	299 x 798 x 219	299 x 798 x 219	299 x 798 x 219
	Weight		kg	10.5	10.5	10.5	10.5
	Air Volume	Cooling	m ³ /min	5.4 - 6.5 - 7.7 - 9.3 - 11.4	5.4 - 6.5 - 7.7 - 9.3 - 11.4	6.0 - 7.2 - 8.4 - 10.0 - 12.6	6.0 - 7.2 - 8.4 - 10.0 - 12.6
	(SLo-Lo-Mid-Hi-Shi (*3) (Dry/Wet))	Heating	m ³ /min	5.3 - 6.1 - 7.7 - 9.4 - 14.0	5.3 - 6.1 - 7.7 - 9.4 - 14.0	5.6 - 6.5 - 8.2 - 10.0 - 14.0	5.6 - 6.5 - 8.2 - 10.0 - 14.0
	Sound Level (SPL)	Cooling	dB(A)	21 - 29 - 34 - 38 - 42	21 - 29 - 34 - 38 - 42	28 - 33 - 36 - 40 - 44	28 - 33 - 36 - 40 - 44
	(SLo-Lo-Mid-Hi-Shi) (*3)	Heating	dB(A)	21 - 29 - 35 - 40 - 45	21 - 29 - 35 - 40 - 45	28 - 33 - 38 - 43 - 48	28 - 33 - 38 - 43 - 48
	Sound Level (PWL)	Cooling	dB(A)	57	57	58	58
	Outdoor Unit	Dimensions	H x W x D	mm	550 x 800 x 285	550 x 800 x 285	714 x 800 x 285
Weight			kg	35	35	40	40
Air Volume		Cooling	m ³ /min	30.4	30.4	40.5	40.5
		Heating	m ³ /min	32.7	32.7	40.5	40.5
Sound Level (SPL)		Cooling	dB(A)	50	50	52	52
		Heating	dB(A)	51	51	52	52
Sound Level (PWL)		Cooling	dB(A)	61	61	64	64
Operating Current (Max.)			A	9.6	9.6	13.3	13.3
Breaker Size			A	10	10	16	16
Ext.Piping		Diameter	Liquid/Gas	mm	6.35 / 9.52	6.35 / 9.52	6.35 / 9.52
	Max.Length	Out-In	m	20	20	20	20
	Max.Height	Out-In	m	12	12	12	12
Guaranteed Operating Range (Outdoor)	Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	-10 ~ +46	
	Heating	°C	-15 ~ +24	-20 ~ +24	-15 ~ +24	-20 ~ +24	

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.

SPECIFICATIONS WALL-MOUNTED

Indoor Unit				MSZ-AP60VG(K)	MSZ-AP71VG(K)		
Outdoor Unit				MUZ-AP60VG	MUZ-AP71VG		
Refrigerant				R32 ^(*)	R32 ^(*)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply		
	Outdoor(V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz		
Cooling	Capacity	Rated	kW	6.1	7.1		
		Min-Max	kW	1.4-7.3	2.0-8.7		
	Total Input	Rated	kW	1.590	2.010		
	EER			3.84	3.53		
	EEL Rank			A	A		
	Design load			kW	6.1	7.1	
	Annual electricity consumption ^(*)			kWh/a	288	345	
	SEER			7.4	7.2		
	Energy efficiency class			A++	A++		
	Heating (Average Season)	Capacity	Rated	kW	6.8	8.1	
Min-Max			kW	2.0-8.6	2.2-10.3		
Total Input		Rated	kW	1.670	2.120		
COP			4.07	3.82			
EEL Rank			A	A			
Design load			kW	4.6(-10°C)	6.7(-10°C)		
Declared Capacity		at reference design temperature		kW	4.6(-10°C)	6.7(-10°C)	
		at bivalent temperature		kW	4.6(-10°C)	6.7(-10°C)	
		at operation limit temperature		kW	3.7(-15°C)	5.4(-15°C)	
Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)		
Annual electricity consumption ^(*)			kWh/a	1398	2132		
SCOP			4.6	4.4			
Energy efficiency class			A++	A+			
Operating Current(Max)			A	14.1	16.4		
Indoor Unit	Input	Rated	kW	0.049	0.045		
	Operating Current(Max)			A	0.5	0.4	
	Dimensions			H x W x D	mm	325 x 1100 x 257	325 x 1100 x 257
	Weight			kg	16	17	
	Air Volume	Cooling	m ³ /min	9.4 - 11.0 - 13.2 - 16.0 - 18.9	9.6 - 11.5 - 13.2 - 15.3 - 18.6		
		Heating	m ³ /min	10.8 - 13.4 - 15.4 - 17.4 - 20.3	10.2 - 11.5 - 13.2 - 15.3 - 19.2		
	Sound Level (SPL) (SLo-Lo-Mid-Hi-Shi ^(*))	Cooling	dB(A)	29 - 37 - 41 - 45 - 48	30 - 37 - 41 - 45 - 49		
		Heating	dB(A)	30 - 37 - 41 - 45 - 48	30 - 37 - 41 - 45 - 51		
	Sound Level (PWL)	Cooling	dB(A)	65	65		
	Outdoor Unit	Dimensions			H x W x D	mm	714 x 800 x 285
Weight			kg	40	55		
Air Volume		Cooling	m ³ /min	52.1	54.1		
		Heating	m ³ /min	52.1	47.9		
Sound Level (SPL)		Cooling	dB(A)	56	56		
		Heating	dB(A)	57	55		
Sound Level (PWL)		Cooling	dB(A)	69	69		
Operating Current(Max)			A	13.6	16.0		
Breaker Size			A	16	20		
Ext.Piping		Diameter	Liquid/Gas	mm	6.35 / 12.7	6.35 / 12.7	
	Max.Length	Out-In	m	30	30		
	Max.Height	Out-In	m	15	15		
Guaranteed Operating Range(Outdoor)	Cooling	°C	-10~+46	-10~+46			
	Heating	°C	-15~+24	-15~+24			

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit			MSZ-HR25VF	MSZ-HR35VF	MSZ-HR42VF	MSZ-HR50VF		
Outdoor Unit			MUZ-HR25VF	MUZ-HR35VF	MUZ-HR42VF	MUZ-HR50VF		
Refrigerant			R32 ^(*)	R32 ^(*)	R32 ^(*)	R32 ^(*)		
Power Supply			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
Source			230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz		
Cooling	Design load	kW	2.5	3.4	4.2	5.0		
	Annual electricity consumption ^(*)	kWh/a	141	191	226	269		
	SEER		6.2	6.2	6.5	6.5		
	Energy efficiency class			A++	A++	A++	A++	
	Capacity	Rated	kW	2.5	3.4	4.2	5.0	
		Min-Max	kW	0.5-2.9	0.9-3.4	1.1-4.6	1.3-5.0	
	Total Input	Rated	kW	0.800	1.210	1.340	2.050	
		EER		3.13	2.81	3.13	2.44	
	EEL Rank			B	C	B	D or less	
	Heating (Average Season)	Design load	kW	1.9(-10°C)	2.4(-10°C)	2.9(-10°C)	3.8(-10°C)	
Declared Capacity		at reference design temperature	kW	1.9(-10°C)	2.4(-10°C)	2.9(-10°C)	3.8(-10°C)	
		at bivalent temperature	kW	1.9(-10°C)	2.4(-10°C)	2.9(-10°C)	3.8(-10°C)	
		at operation limit temperature	kW	1.9(-10°C)	2.4(-10°C)	2.9(-10°C)	3.8(-10°C)	
Back up heating capacity		kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)		
Annual electricity consumption ^(*)		kWh/a	614	781	928	1224		
SCOP			4.3	4.3	4.3	4.3		
Energy efficiency class			A+	A+	A+	A+		
Capacity		Rated	kW	3.15	3.6	4.7	5.4	
		Min-Max	kW	0.7-3.5	0.9-3.7	0.9-5.4	1.4-6.5	
Total Input		Rated	kW	0.850	0.975	1.300	1.550	
		COP		3.71	3.69	3.62	3.48	
EEL Rank			A	A	A	B		
Heating (Warmer Season)	Design load	kW	1.1(2°C)	1.3(2°C)	1.6(2°C)	2.1(2°C)		
	Declared Capacity	at reference design temperature	kW	1.1(2°C)	1.3(2°C)	1.6(2°C)	2.1(2°C)	
		at bivalent temperature	kW	1.1(2°C)	1.3(2°C)	1.6(2°C)	2.1(2°C)	
		at operation limit temperature	kW	1.9(-10°C)	2.4(-10°C)	2.9(-10°C)	3.8(-10°C)	
	Back up heating capacity	kW	0.0(2°C)	0.0(2°C)	0.0(2°C)	0.0(2°C)		
	Annual electricity consumption ^(*)	kWh/a	289	344	427	558		
	SCOP		5.3	5.2	5.2	5.2		
	Energy efficiency class			A+++	A+++	A+++	A+++	
	Capacity	Rated	kW	3.2	3.6	4.7	5.4	
		Min-Max	kW	0.7-3.5	0.9-3.7	0.9-5.4	1.4-6.5	
	Total Input	Rated	kW	0.850	0.975	1.300	1.550	
		COP		3.71	3.69	3.62	3.48	
	EEL Rank			A	A	A	B	
Operating Current(Max)			A	5.0	6.7	8.5	10.0	
Indoor Unit	Input	Rated	kW	0.020	0.028	0.032	0.039	
	Operating Current(Max)		A	0.2	0.27	0.3	0.36	
	Dimensions		H x W x D	mm	280 x 838 x 228	280 x 838 x 228	280 x 838 x 228	280 x 838 x 228
	Weight		kg	8.5	8.5	9	9	
	Air Volume	Cooling	m ³ /min	3.6 - 5.4 - 7.2 - 9.7	3.6 - 5.6 - 7.8 - 11.7	6.0 - 8.7 - 10.8 - 13.1	6.4 - 9.2 - 11.2 - 13.1	
		(Lo-Mid-Hi-Shi ^(*))(Dry/Wet)	m ³ /min	3.3 - 5.4 - 7.4 - 10.1	3.3 - 5.4 - 7.4 - 10.5	5.6 - 7.9 - 10.8 - 13.4	6.1 - 8.3 - 11.2 - 14.5	
	Sound Level (SPL)	Cooling	dB(A)	21 - 30 - 37 - 43	22 - 31 - 38 - 46	24 - 34 - 39 - 45	28 - 36 - 40 - 45	
		(Lo-Mid-Hi-Shi ^(*))	dB(A)	21 - 30 - 37 - 43	21 - 30 - 37 - 44	24 - 32 - 40 - 46	27 - 34 - 41 - 47	
	Sound Level (PWL)	Cooling	dB(A)	57	60	60	60	
Outdoor Unit	Dimensions		H x W x D	mm	538 x 699 x 249	538 x 699 x 249	550 x 800 x 285	550 x 800 x 285
	Weight		kg	23	24	34	35	
	Air Volume	Cooling	m ³ /min	30.3	32.2	30.4	30.4	
		Heating	m ³ /min	30.3	32.2	32.7	32.7	
	Sound Level (SPL)	Cooling	dB(A)	50	51	50	50	
		Heating	dB(A)	50	51	51	51	
	Sound Level (PWL)	Cooling	dB(A)	63	64	64	64	
	Operating Current(Max)		A	4.8	6.4	8.2	9.6	
	Breaker Size		A	10	10	10	12	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/9.52	6.35/9.52	
	Max.Length	Out-In	m	20	20	20	20	
	Max.Height	Out-In	m	12	12	12	12	
Guaranteed Operating Range(Outdoor)	Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	-10 ~ +46		
	Heating	°C	-10 ~ +24	-10 ~ +24	-10 ~ +24	-10 ~ +24		

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSY-TP35VF	MSY-TP50VF
Outdoor Unit				MUY-TP35VF	MUZ-TP50VF
Refrigerant				R32 ^(*)	R32 ^(*)
Power Supply	Source			Indoor Power supply	Indoor Power supply
	Outdoor(V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz
Cooling	Capacity	Rated	kW	3.5	5.0
		Min-Max	kW	1.5 - 4.0	1.5 - 5.7
	Total Input	Rated	kW	0.760	1.450
	EER			4.61	3.45
	EEL Rank			A	A
	Design load		kW	3.5	5.0
	Annual electricity consumption ^(*)		kWh/a	136	218
	SEER			9.0	8.0
	Energy efficiency class			A+++	A++
	Operating Current(Max)			A	9.6
Indoor Unit	Input	Rated	kW	0.033	0.034
	Operating Current(Max)		A	0.4	0.4
	Dimensions	H x W x D	mm	305 x 923 x 250	305 x 923 x 250
	Weight		kg	12.5	12.5
	Air Volume (Lo-Mid-Hi-Shi ^(*) (Dry/Wet))	Cooling	m ³ /min	10.1 - 11.6 - 13.7 - 16.4	10.1 - 11.6 - 13.7 - 16.4
	Sound Level (SPL) (Lo-Mid-Hi-Shi ^(*))	Cooling	dB(A)	31 - 36 - 40 - 45	31 - 36 - 40 - 45
	Sound Level (PWL)	Cooling	dB(A)	60	60
	Breaker Size		A	10	10
Outdoor Unit	Dimensions	H x W x D	mm	550 x 800 x 285	550 x 800 x 285
	Weight		kg	34	34
	Air Volume	Cooling	m ³ /min	29.3	29.3
	Sound Level (SPL)	Cooling	dB(A)	45	47
	Sound Level (PWL)	Cooling	dB(A)	58	61
	Operating Current(Max)		A	9.2	9.2
	Breaker Size		A	12	12
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52
	Max.Length	Out-In	m	20	20
	Max.Height	Out-In	m	12	12
Guaranteed Operating Range(Outdoor)		Cooling	°C	-25 ~ +46	-25 ~ +46

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-FH25VE2	MSZ-FH35VE2	MSZ-FH50VE2		
Outdoor Unit				MUZ-FH25VE	MUZ-FH35VE	MUZ-FH50VE		
Refrigerant				R410A (*1)	R410A (*1)	R410A(*1)		
Power Supply				Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
Source				230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz		
Outdoor (V/Phase/Hz)				230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz		
Cooling	Capacity	Rated	kW	2.5	3.5	5.0		
		Min. - Max.	kW	1.4 - 3.5	0.8 - 4.0	1.9 - 6.0		
	SHF			0.95	0.84	0.73		
	Total Input			Rated	kW	0.485	0.820	1.38
	EER			5.15	4.27	3.62		
	EEL Rank			A	A	A		
	Design load			kW	2.5	3.5	5	
	Annual electricity consumption (*2)			kWh/a	96	138	244	
	SEER			9.1	8.9	7.2		
	Energy efficiency class			A+++	A+++	A++		
Heating (Average Season)	Capacity	Rated	kW	3.2	4.0	6.0		
		Min. - Max.	kW	1.8 - 5.5	1.0 - 6.3	1.7 - 8.7		
	Total Input			Rated	kW	0.580	0.800	1.48
	COP			5.52	5.00	4.05		
	EEL Rank			A	A	A		
	Design load			kW	3.0(-10°C)	3.6(-10°C)	4.5(-10°C)	
	Declared Capacity	at reference design temperature		kW	3.0(-10°C)	3.6(-10°C)	4.5(-10°C)	
		at bivalent temperature		kW	3.0(-10°C)	3.6(-10°C)	4.5(-10°C)	
		at operation limit temperature		kW	2.5(-15°C)	3.2(-15°C)	5.2(-15°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	
	Annual electricity consumption (*2)			kWh/a	819	986	1372	
	SCOP			5.1	5.1	4.6		
	Energy efficiency class			A+++	A+++	A++		
Operating Current (Max.)			A	10.0	10.0	14.0		
Indoor Unit	Input	Rated	kW	0.029	0.029	0.031		
		Operating Current (Max.)	A	0.4	0.4	0.4		
	Dimensions			H x W x D	mm	305(+17) x 925 x 234	305(+17) x 925 x 234	305(+17) x 925 x 234
	Weight			kg	13.5	13.5	13.5	
	Air Volume (Silent-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	3.9 - 4.7 - 6.3 - 8.6 - 11.6(10.5)	3.9 - 4.7 - 6.3 - 8.6 - 11.6(10.5)	6.4 - 7.4 - 8.6 - 10.1 - 12.4		
		Heating	m ³ /min.	4.0 - 4.7 - 6.4 - 9.2 - 13.2	4.0 - 4.7 - 6.4 - 9.2 - 13.2	5.7 - 7.2 - 9.0 - 11.2 - 14.6		
	Sound Level (SPL) (Silent-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	20 - 23 - 29 - 36 - 42	21 - 24 - 29 - 36 - 42	27 - 31 - 35 - 39 - 44		
		Heating	dB(A)	20 - 24 - 29 - 36 - 44	21 - 24 - 29 - 36 - 44	25 - 29 - 34 - 39 - 46		
	Sound Level (PWL)	Cooling	dB(A)	58	58	60		
		Heating	dB(A)	58	58	60		
Outdoor Unit	Dimensions			H x W x D	mm	550 x 800 x 285	550 x 800 x 285	880 x 840 x 330
	Weight			kg	37	37	55	
	Air Volume	Cooling	m ³ /min.	31.3	33.6	48.8		
		Heating	m ³ /min.	31.3	33.6	51.3		
	Sound Level (SPL)	Cooling	dB(A)	46	49	51		
		Heating	dB(A)	49	50	54		
	Sound Level (PWL)	Cooling	dB(A)	60	61	64		
		Heating	dB(A)	60	61	64		
	Operating Current (Max.)			A	9.6	9.6	13.6	
	Breaker Size			A	10	10	16	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7		
	Max.Length	Out-In	m	20	20	30		
	Max.Height	Out-In	m	12	12	15		
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	
			Heating	°C	-15 ~ +24	-15 ~ +24	-15 ~ +24	

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.

SPECIFICATIONS WALL-MOUNTED

Indoor Unit				MSZ-FH25VE2	MSZ-FH35VE2	MSZ-FH50VE2		
Outdoor Unit				MUZ-FH25VEHZ	MUZ-FH35VEHZ	MUZ-FH50VEHZ		
Refrigerant				R410A (*1)	R410A (*1)	R410A(*1)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
	Outdoor (V/Phase/Hz)			230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz		
Cooling	Capacity	Rated	kW	2.5	3.5	5.0		
		Min. - Max.	kW	0.8 - 3.5	0.8 - 4.0	1.9 - 6.0		
	SHF			0.95	0.84	0.73		
	Total Input	Rated	kW	0.485	0.820	1.38		
	EER			5.15	4.27	3.62		
	EEL Rank			A	A	A		
	Design load		kW	2.5	3.5	5		
	Annual electricity consumption (*2)			96	138	244		
	SEER			9.1	8.9	7.2		
	Energy efficiency class			A+++	A+++	A++		
Heating (Average Season)	Capacity	Rated	kW	3.2	4.0	6.0		
		Min. - Max.	kW	1.0 - 6.3	1.0 - 6.6	1.7 - 8.7		
	Total Input	Rated	kW	0.580	0.800	1.48		
	COP			5.52	5.00	4.05		
	EEL Rank			A	A	A		
	Design load		kW	3.2(-10°C)	4.0(-10°C)	6.0(-10°C)		
	Declared Capacity	at reference design temperature	kW	3.2(-10°C)	4.0(-10°C)	6.0(-10°C)		
		at bivalent temperature	kW	3.2(-10°C)	4.0(-10°C)	6.0(-10°C)		
		at operation limit temperature	kW	1.7(-25°C)	2.6(-25°C)	3.8(-25°C)		
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	
Annual electricity consumption (*2)			924	1173	2006			
SCOP			4.9	4.8	4.2			
Energy efficiency class			A++	A++	A+			
Operating Current (Max.)			A	10.0	10.5	14.0		
Indoor Unit	Input	Rated	kW	0.029	0.031	0.031		
	Operating Current (Max.)			A	0.4	0.4		
	Dimensions			H x W x D	mm	305(+17) x 925 x 234	305(+17) x 925 x 234	305(+17) x 925 x 234
	Weight			kg	13.5	13.5	13.5	
	Air Volume	Cooling	m ³ /min.	3.9 - 4.7 - 6.3 - 8.6 - 11.6(10.5)	3.9 - 4.7 - 6.3 - 8.6 - 11.6(10.5)	6.4 - 7.4 - 8.6 - 10.1 - 12.4		
		Heating	m ³ /min.	4.0 - 4.7 - 6.4 - 9.2 - 13.2	4.0 - 4.7 - 6.4 - 9.2 - 13.2	5.7 - 7.2 - 9.0 - 11.2 - 14.6		
	Sound Level (SPL)	Cooling	dB(A)	20 - 23 - 29 - 36 - 42	21 - 24 - 29 - 36 - 42	27 - 31 - 35 - 39 - 44		
		Heating	dB(A)	20 - 24 - 29 - 36 - 44	21 - 24 - 29 - 36 - 44	25 - 29 - 34 - 39 - 46		
	Sound Level (PWL)			Cooling	dB(A)	58	58	60
	Outdoor Unit	Dimensions			H x W x D	mm	550 x 800 x 285	550 x 800 x 285
Weight			kg	37	37	55		
Air Volume		Cooling	m ³ /min.	31.3	31.3	48.8		
		Heating	m ³ /min.	31.3	31.3	51.3		
Sound Level (SPL)		Cooling	dB(A)	46	46	51		
		Heating	dB(A)	49	49	54		
Sound Level (PWL)			Cooling	dB(A)	60	61	64	
Operating Current (Max.)			A	9.6	10.1	13.6		
Breaker Size			A	10	12	16		
Ext.Piping		Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7	
	Max.Length	Out-In	m	20	20	30		
	Max.Height	Out-In	m	12	12	15		
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	
			Heating	°C	-25 ~ +24	-25 ~ +24	-25 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-EF25VG	MSZ-EF25VG	MSZ-EF35VG		
Outdoor Unit				MUZ-EF25VG	MUZ-EF25VGH	MUZ-EF35VG		
Refrigerant				R32 ^(*)	R32 ^(*)	R32 ^(*)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
	Outdoor(V/Phase/Hz)			230/Single/50	230/Single/50	230/Single/50		
Cooling	Capacity	Rated	kW	2.5	2.5	3.5		
		Min-Max	kW	0.9-3.4	0.9-3.4	1.1-4.0		
	Total Input	Rated	kW	0.540	0.540	0.910		
	EER			4.63	4.63	3.85		
		EEL Rank			A	A	A	
	Design load		kW	2.5	2.5	3.5		
	Annual electricity consumption ^(*)			kWh/a	96	96	139	
	SEER				9.1	9.1	8.8	
	Energy efficiency class				A+++	A+++	A+++	
	Heating (Average Season)	Capacity	Rated	kW	3.2	3.2	4.0	
Min-Max			kW	1.0-4.2	1.0-4.2	1.3-5.1		
Total Input		Rated	kW	0.700	0.700	0.950		
COP				4.57	4.57	4.21		
		EEL Rank			A	A	A	
Design load			kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)		
Declared Capacity		at reference design temperature		kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	
		at bivalent temperature		kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	
		at operation limit temperature		kW	2.0(-15°C)	1.6(-20°C)	2.4(-15°C)	
Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)		
Annual electricity consumption ^(*)			kWh/a	713	727	882		
SCOP				4.7	4.6	4.6		
Energy efficiency class				A++	A++	A++		
Operating Current(Max)			A	7.1	7.1	7.1		
Indoor Unit	Input	Rated	kW	0.026	0.026	0.030		
		Operating Current(Max)			A	0.3	0.3	0.3
	Dimensions			H x W x D	mm	299 x 885 x 195	299 x 885 x 195	299 x 885 x 195
	Weight				kg	11.5	11.5	11.5
	Air Volume (SLo-Lo-Mid-Hi-Shi ^(*) (Dry/Wet))	Cooling	m ³ /min	4.0 - 4.6 - 6.3 - 8.3 - 10.5	4.0 - 4.6 - 6.3 - 8.3 - 10.5	4.0 - 4.6 - 6.3 - 8.3 - 10.5		
		Heating	m ³ /min	4.0 - 4.6 - 6.2 - 8.9 - 11.9	4.0 - 4.6 - 6.2 - 8.9 - 11.9	4.0 - 4.6 - 6.2 - 8.9 - 12.7		
	Sound Level (SPL) (SLo-Lo-Mid-Hi-Shi ^(*))	Cooling	dB(A)	19 - 23 - 29 - 36 - 42	19 - 23 - 29 - 36 - 42	21 - 24 - 30 - 36 - 42		
		Heating	dB(A)	21 - 24 - 29 - 37 - 45	21 - 24 - 29 - 37 - 45	21 - 24 - 30 - 38 - 46		
	Sound Level (PWL)	Cooling	dB(A)	60	60	60		
		Heating	dB(A)	60	60	60		
Dimensions			H x W x D	mm	550 x 800 x 285	550 x 800 x 285	550 x 800 x 285	
Weight				kg	31	34	34	
Air Volume	Cooling	m ³ /min	27.8	27.8	34.3			
	Heating	m ³ /min	29.8	29.8	32.7			
Sound Level (SPL)	Cooling	dB(A)	47	47	49			
	Heating	dB(A)	48	48	50			
Sound Level (PWL)	Cooling	dB(A)	58	58	62			
	Heating	dB(A)	58	58	62			
Operating Current(Max)			A	6.8	6.8	6.8		
Breaker Size			A	10	10	10		
Ext.Piping	Diameter	Liquid/Gas	mm	6.35 / 9.52	6.35 / 9.52	6.35 / 9.52		
	Max.Length	Out-In	m	20	20	20		
	Max.Height	Out-In	m	12	12	12		
Guaranteed Operating Range(Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	
			Heating	°C	-15 ~ +24	-20 ~ +24	-15 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂ over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-EF35VG	MSZ-EF42VG	MSZ-EF50VG		
Outdoor Unit				MUZ-EF35VGH	MUZ-EF42VG	MUZ-EF50VG		
Refrigerant				R32 ^(*)	R32 ^(*)	R32 ^(*)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
	Outdoor(V/Phase/Hz)			230/Single/50	230/Single/50	230/Single/50		
Cooling	Capacity	Rated	kW	3.5	4.2	5.0		
		Min-Max	kW	1.1-4.0	0.9-4.6	1.4-5.4		
	Total Input	Rated	kW	0.910	1.200	1.540		
		EER		3.85	3.50	3.25		
	EEL Rank			A	A	A		
	Design load		kW	3.5	4.2	5.0		
		Annual electricity consumption ^(*)	kWh/a	139	186	233		
	SEER			8.8	7.9	7.5		
	Energy efficiency class			A+++	A++	A++		
	Heating (Average Season)	Capacity	Rated	kW	4.0	5.4	5.8	
Min-Max			kW	1.3-5.1	1.3-6.3	1.4-7.5		
Total Input		Rated	kW	0.950	1.455	1.560		
		COP		4.21	3.71	3.72		
EEL Rank			A	A	A			
Design load			kW	2.9(-10°C)	3.8(-10°C)	4.2(-10°C)		
		Declared Capacity	at reference design temperature	kW	2.9(-10°C)	3.8(-10°C)	4.2(-10°C)	
		at bivalent temperature	kW	2.9(-10°C)	3.8(-10°C)	4.2(-10°C)		
		at operation limit temperature	kW	1.7(-20°C)	3.4(-15°C)	3.5(-15°C)		
Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)		
Annual electricity consumption ^(*)			kWh/a	900	1151	1304		
SCOP			4.5	4.6	4.5			
Energy efficiency class			A+	A++	A+			
Operating Current(Max)			A	7.1	10.0	14		
Indoor Unit		Input	Rated	kW	0.030	0.033	0.043	
	Operating Current(Max)		A	0.3	0.4	0.4		
	Dimensions			H x W x D	mm	299 x 885 x 195	299 x 885 x 195	299 x 885 x 195
	Weight			kg	11.5	11.5	11.5	
	Air Volume (SLo-Lo-Mid-Hi-Shi ^(*) (Dry/Wet))	Cooling	m ³ /min	4.0 - 4.6 - 6.3 - 8.3 - 10.5	5.8 - 6.6 - 7.7 - 8.9 - 11.2	5.8 - 6.8 - 7.9 - 9.2 - 11.3		
		Heating	m ³ /min	4.0 - 4.6 - 6.2 - 8.9 - 12.7	5.5 - 6.3 - 7.8 - 9.9 - 13.2	6.4 - 7.2 - 9.0 - 11.1 - 14.6		
	Sound Level (SPL) (SLo-Lo-Mid-Hi-Shi ^(*))	Cooling	dB(A)	21 - 24 - 30 - 36 - 42	28 - 31 - 35 - 39 - 43	30 - 33 - 36 - 40 - 43		
		Heating	dB(A)	21 - 24 - 30 - 38 - 46	28 - 30 - 35 - 41 - 48	30 - 33 - 37 - 43 - 49		
	Sound Level (PWL)			Cooling	dB(A)	60	60	60
	Outdoor Unit	Dimensions			H x W x D	mm	550 x 800 x 285	550 x 800 x 285
Weight			kg	34	35	40		
Air Volume		Cooling	m ³ /min	34.3	32.0	40.2		
		Heating	m ³ /min	32.7	32.7	40.2		
Sound Level (SPL)		Cooling	dB(A)	49	50	52		
		Heating	dB(A)	50	51	52		
Sound Level (PWL)			Cooling	dB(A)	62	62	65	
Operating Current(Max)			A	6.8	9.6	13.6		
Breaker Size			A	10	12	16		
Ext.Piping		Diameter	Liquid/Gas	mm	6.35 / 9.52	6.35 / 9.52	6.35 / 9.52	
	Max.Length	Out-In	m	20	20	30		
	Max.Height	Out-In	m	12	12	15		
Guaranteed Operating Range(Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	
			Heating	°C	-20 ~ +24	-15 ~ +24	-15 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂ over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-SF15VA	MSZ-SF20VA		
Outdoor Unit				for MXZ connection	for MXZ connection		
Refrigerant				R410A (*1)	R410A (*1)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply		
	Outdoor (V/Phase/Hz)			230V/Single/50Hz	230V/Single/50Hz		
Cooling	Capacity	Rated	kW	-	-		
		Min. - Max.	kW	-	-		
	SHF			-	-		
	Total Input	Rated	kW	-	-		
		EER			-	-	
	EEL Rank			-	-		
	Design load			kW	-		
	Annual electricity consumption (*2)			kWh/a	-		
	SEER			-	-		
	Energy efficiency class			-	-		
Heating	Capacity	Rated	kW	-	-		
		Min. - Max.	kW	-	-		
	Total Input	Rated	kW	-	-		
		COP			-	-	
	EEL Rank			-	-		
	Design load			kW	-		
	Declared Capacity	at reference design temperature		kW	-		
		at bivalent temperature		kW	-		
		at operation limit temperature		kW	-		
	Back up heating capacity			kW	-		
	Annual electricity consumption (*2)			kWh/a	-		
	SCOP			-	-		
	Energy efficiency class			-	-		
Operating Current (Max.)			A	-			
Indoor Unit	Input	Rated	kW	0.017	0.019		
		Operating Current (Max.)			A	0.17	
	Dimensions			H x W x D	mm	250 x 760 x 168	250 x 760 x 168
	Weight			kg	7.7	7.7	
	Air Volume (Silent-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	3.5 - 3.9 - 4.6 - 5.5 - 6.4	3.5 - 3.9 - 4.6 - 5.5 - 6.9		
		Heating	m ³ /min.	3.7 - 4.4 - 5.0 - 6.0 - 6.8	3.7 - 4.4 - 5.0 - 6.0 - 7.3		
	Sound Level (SPL) (Silent-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	21 - 26 - 30 - 35 - 40	21 - 26 - 30 - 35 - 42		
		Heating	dB(A)	21 - 26 - 30 - 35 - 40	21 - 26 - 30 - 35 - 42		
	Sound Level (PWL)	Cooling	dB(A)	59	60		
Outdoor Unit	Dimensions			H x W x D	mm	-	-
	Weight			kg	-	-	
	Air Volume	Cooling	m ³ /min.	-	-		
		Heating	m ³ /min.	-	-		
	Sound Level (SPL)	Cooling	dB(A)	-	-		
		Heating	dB(A)	-	-		
	Sound Level (PWL)	Cooling	dB(A)	-	-		
	Operating Current (Max.)			A	-	-	
Breaker Size			A	-	-		
Ext.Piping	Diameter	Liquid/Gas	mm	-	-		
	Max.Length	Out-In	m	-	-		
	Max.Height	Out-In	m	-	-		
Guaranteed Operating Range (Outdoor)		Cooling	°C	-	-		
		Heating	°C	-	-		

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

SPECIFICATIONS WALL-MOUNTED

Indoor Unit				MSZ-SF25VE3	MSZ-SF25VE3	MSZ-SF35VE3	MSZ-SF35VE3		
Outdoor Unit				MUZ-SF25VE	MUZ-SF25VEH	MUZ-SF35VE	MUZ-SF35VEH		
Refrigerant				R410A (*1)	R410A (*1)	R410A (*1)	R410A (*1)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
	Outdoor (V/Phase/Hz)			230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz		
Cooling	Capacity	Rated	kW	2.5	2.5	3.5	3.5		
		Min. - Max.	kW	0.9 - 3.4	0.9 - 3.4	1.1 - 3.8	1.1 - 3.8		
	SHF			0.92	0.92	0.8	0.8		
	Total Input	Rated	kW	0.600	0.600	1.080	1.080		
	EER			4.17	4.17	3.24	3.24		
	EEL Rank			A	A	A	A		
	Design load			kW	2.5	2.5	3.5	3.5	
	Annual electricity consumption (*2)			kWh/a	116	116	171	171	
	SEER			7.6	7.6	7.2	7.2		
	Energy efficiency class			A++	A++	A++	A++		
Heating	Capacity	Rated	kW	3.2	3.2	4.0	4.0		
		Min. - Max.	kW	1.0 - 4.1	1.0 - 4.1	1.3 - 4.6	1.3 - 4.6		
	Total Input	Rated	kW	0.780	0.780	1.030	1.030		
	COP			4.10	4.10	3.88	3.88		
	EEL Rank			A	A	A	A		
	Design load			kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	2.9(-10°C)	
	Declared Capacity	at reference design temperature		kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	2.9(-10°C)	
		at bivalent temperature		kW	2.4(-10°C)	2.4(-10°C)	2.9(-10°C)	2.9(-10°C)	
		at operation limit temperature		kW	2.0(-15°C)	1.6(-20°C)	2.2(-15°C)	1.6(-20°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	
	Annual electricity consumption (*2)			kWh/a	764	790	923	948	
	SCOP			4.4	4.3	4.4	4.3		
	Energy efficiency class			A+	A+	A+	A+		
	Operating Current (Max.)			A	8.4	8.4	8.5	8.5	
Indoor Unit	Input	Rated	kW	0.024	0.024	0.027	0.027		
	Operating Current (Max.)			A	0.2	0.2	0.3	0.3	
	Dimensions			H x W x D	mm	299 x 798 x 195	299 x 798 x 195	299 x 798 x 195	299 x 798 x 195
	Weight			kg	10	10	10	10	
	Air Volume (Silent-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	3.2 - 4.1 - 5.6 - 7.2 - 9.1	3.2 - 4.1 - 5.6 - 7.2 - 9.1	3.2 - 4.1 - 5.6 - 7.2 - 9.1	3.2 - 4.1 - 5.6 - 7.2 - 9.1		
		Heating	m ³ /min.	3.0 - 4.1 - 6.7 - 8.2 - 10.3	3.0 - 4.1 - 6.7 - 8.2 - 10.3	3.0 - 4.1 - 6.7 - 8.3 - 11.0	3.0 - 4.1 - 6.7 - 8.3 - 11.0		
	Sound Level (SPL) (Silent-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	19 (*4) - 24 - 30 - 36 - 42	19 (*4) - 24 - 30 - 36 - 42	19 (*4) - 24 - 30 - 36 - 42	19 (*4) - 24 - 30 - 36 - 42		
		Heating	dB(A)	19 (*4) - 24 - 34 - 39 - 45	19 (*4) - 24 - 34 - 39 - 45	19 (*4) - 24 - 34 - 40 - 46	19 (*4) - 24 - 34 - 40 - 46		
	Sound Level (PWL)			Cooling	dB(A)	57	57	57	57
Outdoor Unit	Dimensions			H x W x D	mm	550 x 800 x 285	550 x 800 x 285	550 x 800 x 285	550 x 800 x 285
	Weight			kg	31	31	31	31	
	Air Volume	Cooling	m ³ /min.	31.1	31.1	35.9	35.9		
		Heating	m ³ /min.	30.7	30.7	35.9	35.9		
	Sound Level (SPL)	Cooling	dB(A)	47	47	49	49		
		Heating	dB(A)	48	48	50	50		
	Sound Level (PWL)			Cooling	dB(A)	58	58	62	62
	Operating Current (Max.)			A	8.2	8.2	8.2	8.2	
	Breaker Size			A	10	10	10	10	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/9.52	6.35/9.52		
	Max.Length	Out-In	m	20	20	20	20		
	Max.Height	Out-In	m	12	12	12	12		
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	-10 ~ +46	
			Heating	°C	-15 ~ +24	-20 ~ +24	-15 ~ +24	-20 ~ +24	

WALL-MOUNTED SPECIFICATIONS

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.
- (*4) SF25 - 35 For single use: only 19dB(A). For multi use (MXZ): 21dB(A)

Indoor Unit				MSZ-SF42VE3	MSZ-SF42VE3	MSZ-SF50VE3	MSZ-SF50VE3
Outdoor Unit				MUZ-SF42VE	MUZ-SF42VEH	MUZ-SF50VE	MUZ-SF50VEH
Refrigerant				R410A (*1)	R410A (*1)	R410A (*1)	R410A (*1)
Power Supply				Outdoor Power supply	Outdoor Power supply	Outdoor Power supply	Outdoor Power supply
Source				230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz
Outdoor (V/Phase/Hz)							
Cooling	Capacity	Rated	kW	4.2	4.2	5.0	5.0
		Min. - Max.	kW	0.8 - 4.5	0.8 - 4.5	1.4 - 5.4	1.4 - 5.4
	SHF			0.72	0.72	0.7	0.7
	Total Input	Rated	kW	1.340	1.340	1.660	1.660
	EER			3.13	3.13	3.01	3.01
	EEL Rank			B	B	B	B
	Design load		kW	4.2	4.2	5.0	5.0
	Annual electricity consumption (*2)			196	196	246	246
	SEER			7.5	7.5	7.2	7.2
	Energy efficiency class			A++	A++	A++	A++
Heating	Capacity	Rated	kW	5.4	5.4	5.8	5.8
		Min. - Max.	kW	1.3 - 6.0	1.3 - 6.0	1.4 - 7.3	1.4 - 7.3
	Total Input	Rated	kW	1.580	1.580	1.700	1.700
	COP			3.42	3.42	3.41	3.41
	EEL Rank			B	B	B	B
	Design load		kW	3.8(-10°C)	3.8(-10°C)	4.2(-10°C)	4.2(-10°C)
	Declared Capacity	at reference design temperature	kW	3.8(-10°C)	3.8(-10°C)	4.2(-10°C)	4.2(-10°C)
		at bivalent temperature	kW	3.8(-10°C)	3.8(-10°C)	4.2(-10°C)	4.2(-10°C)
		at operation limit temperature	kW	3.4(-15°C)	2.2(-20°C)	3.4(-15°C)	2.3(-20°C)
	Back up heating capacity			0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)
	Annual electricity consumption (*2)			1215	1242	1351	1380
	SCOP			4.4	4.3	4.4	4.3
	Energy efficiency class			A+	A+	A+	A+
	Operating Current (Max.)			A	9.5	9.5	12.3
Indoor Unit	Input	Rated	kW	0.027	0.027	0.035	0.035
	Operating Current (Max.)			A	0.3	0.3	0.3
	Dimensions			H x W x D	299 x 798 x 195	299 x 798 x 195	299 x 798 x 195
	Weight			kg	10	10	10
	Air Volume	Cooling	m ³ /min.	4.7 - 5.8 - 6.7 - 7.9 - 9.1	4.7 - 5.8 - 6.7 - 7.9 - 9.1	5.1 - 6.2 - 7.0 - 8.2 - 9.9	5.1 - 6.2 - 7.0 - 8.2 - 9.9
		(Silent-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Heating	m ³ /min.	4.7 - 5.8 - 7.2 - 9.1 - 11.4	4.7 - 5.8 - 7.2 - 9.1 - 11.4	5.1 - 6.4 - 8.0 - 9.8 - 12.0
	Sound Level (SPL)	Cooling	dB(A)	26 (*4) - 31 - 34 - 38 - 42	26 (*4) - 31 - 34 - 38 - 42	28 (*5) - 33 - 36 - 40 - 45	28 (*5) - 33 - 36 - 40 - 45
		(Silent-Lo-Mid-Hi-SHi (*3))	Heating	dB(A)	26 (*4) - 31 - 36 - 42 - 47	26 (*4) - 31 - 36 - 42 - 47	28 (*5) - 33 - 38 - 43 - 49
	Sound Level (PWL)			Cooling	dB(A)	57	57
Outdoor Unit	Dimensions			H x W x D	550 x 800 x 285	550 x 800 x 285	880 x 840 x 330
	Weight			kg	35	35	55
	Air Volume	Cooling	m ³ /min.	35.2	35.2	44.6	44.6
		Heating	m ³ /min.	33.6	33.6	44.6	44.6
	Sound Level (SPL)	Cooling	dB(A)	50	50	52	52
		Heating	dB(A)	51	51	52	52
	Sound Level (PWL)			Cooling	dB(A)	63	63
	Operating Current (Max.)			A	9.2	9.2	12.0
	Breaker Size			A	10	10	16
	Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7
Max.Length		Out-In	m	20	20	30	30
Max.Height		Out-In	m	12	12	15	15
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46
			Heating	°C	-15 ~ +24	-20 ~ +24	-15 ~ +24

SPECIFICATIONS WALL-MOUNTED

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

(*4) SF42 For single use: only 26dB(A). For multi use (MXZ): 28dB(A)

(*5) SF50 For single use: only 28dB(A). For multi use (MXZ): 30dB(A)

Indoor Unit				MSZ-GF60VE2	MSZ-GF71VE2		
Outdoor Unit				MUZ-GF60VE	MUZ-GF71VE		
Refrigerant				R410A (*1)	R410A (*1)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply		
	Outdoor (V/Phase/Hz)			230V/Single/50Hz	230V/Single/50Hz		
Cooling	Capacity	Rated	kW	6.1	7.1		
		Min. - Max.	kW	1.4 - 7.5	2.0 - 8.7		
	SHF			0.79	0.78		
	Total Input	Rated	kW	1.79	2.13		
	EER			3.41	3.33		
	EEL Rank			A	A		
	Design load			kW	6.1	7.1	
	Annual electricity consumption (*2)			kWh/a	311	364	
	SEER			6.8	6.8		
	Energy efficiency class			A++	A++		
Heating	Capacity	Rated	kW	6.8	8.1		
		Min. - Max.	kW	2.0 - 9.3	2.2 - 9.9		
	Total Input	Rated	kW	1.81	2.23		
	COP			3.76	3.63		
	EEL Rank			A	A		
	Design load			kW	4.6(-10°C)	6.7(-10°C)	
	Declared Capacity	at reference design temperature		kW	4.6(-10°C)	6.7(-10°C)	
		at bivalent temperature		kW	4.6(-10°C)	6.7(-10°C)	
		at operation limit temperature		kW	3.7(-15°C)	5.4(-15°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	
	Annual electricity consumption (*2)			kWh/a	1489	2204	
	SCOP			4.3	4.2		
	Energy efficiency class			A+	A+		
Operating Current (Max.)			A	14.5	16.6		
Indoor Unit	Input	Rated	kW	0.062	0.058		
	Operating Current (Max.)			A	0.5	0.5	
	Dimensions			H x W x D	mm	325 x 1100 x 238	325 x 1100 x 238
	Weight			kg	16	16	
	Air Volume (Silent-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	9.8 - 11.3 - 13.4 - 15.6 - 18.3	9.7 - 11.5 - 13.3 - 15.4 - 17.8		
		Heating	m ³ /min.	9.8 - 11.3 - 13.4 - 15.6 - 18.3	10.2 - 11.5 - 13.3 - 15.4 - 17.8		
	Sound Level (SPL) (Silent-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	29-37-41-45-49	30-37-41-45-49		
		Heating	dB(A)	29-37-41-45-49	30-37-41-45-49		
Sound Level (PWL)	Cooling	dB(A)	65	65			
Outdoor Unit	Dimensions			H x W x D	mm	880 x 840 x 330	880 x 840 x 330
	Weight			kg	50	53	
	Air Volume	Cooling	m ³ /min.	49.2	50.1		
		Heating	m ³ /min.	49.2	48.2		
	Sound Level (SPL)	Cooling	dB(A)	55	55		
		Heating	dB(A)	55	55		
	Sound Level (PWL)	Cooling	dB(A)	65	65		
Operating Current (Max.)			A	14.0	16.1		
Breaker Size			A	20	20		
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/15.88	9.52/15.88		
	Max.Length	Out-In	m	30	30		
	Max.Height	Out-In	m	15	15		
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10~+46	-10~+46	
			Heating	°C	-15~+24	-15~+24	

WALL-MOUNTED SPECIFICATIONS

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.

Indoor Unit				MSZ-WN25VA	MSZ-WN35VA
Outdoor Unit				MUZ-WN25VA	MUZ-WN35VA
Refrigerant				R410A (*1)	R410A (*1)
Power Supply	Source			Indoor Power supply	Indoor Power supply
	Outdoor (V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz
Cooling	Capacity	Rated	kW	2.5	3.15
		Min. - Max.	kW	1.3 - 3.0	1.4 - 3.5
	SHF			0.89	0.87
	Total Input	Rated	kW	0.710	1.020
	EER			3.52	3.09
		EEL Rank		A	B
	Design load		kW	2.5	3.1
	Annual electricity consumption (*2)		kWh/a	141	173
	SEER			6.2	6.2
		Energy efficiency class		A++	A++
Heating (Average Season)	Capacity	Rated	kW	3.15	3.6
		Min. - Max.	kW	0.9 - 3.5	1.1 - 4.1
	Total Input	Rated	kW	0.850	0.975
	COP			3.71	3.69
		EEL Rank		A	A
	Design load		kW	1.9(-10°C)	2.4(-10°C)
	Declared Capacity	at reference design temperature	kW	1.9(-10°C)	2.4(-10°C)
		at bivalent temperature	kW	1.9(-10°C)	2.4(-10°C)
		at operation limit temperature	kW	1.6(-15°C)	2.0(-15°C)
	Back up heating capacity		kW	0.0(-10°C)	0.0(-10°C)
	Annual electricity consumption (*2)		kWh/a	628	793
	SCOP			4.2	4.3
		Energy efficiency class		A+	A+
Operating Current (Max.)			A	5.8	6.5
Indoor Unit	Input	Rated	kW	0.020	0.026
	Operating Current (Max.)		A	0.3	0.3
	Dimensions	H × W × D	mm	290 × 799 × 232	290 × 799 × 232
	Weight		kg	9	9
	Air Volume (SLO-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	3.8 - 5.5 - 7.3 - 9.5	3.8 - 5.7 - 7.8 - 11.4
		Heating	m ³ /min.	3.5 - 5.5 - 7.5 - 10.0	3.5 - 5.5 - 7.5 - 10.3
	Sound Level (SPL) (SLO-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	22 - 30 - 37 - 43	22 - 31 - 38 - 46
		Heating	dB(A)	23 - 30 - 37 - 43	23 - 30 - 37 - 44
Sound Level (PWL)	Cooling	dB(A)	57	60	
Outdoor Unit	Dimensions	H × W × D	mm	538 × 699 × 249	538 × 699 × 249
	Weight		kg	24	25
	Air Volume	Cooling	m ³ /min.	31.5	31.5
		Heating	m ³ /min.	31.5	31.5
	Sound Level (SPL)	Cooling	dB(A)	50	52
		Heating	dB(A)	50	52
	Sound Level (PWL)	Cooling	dB(A)	63	64
	Operating Current (Max.)		A	5.5	6.2
Breaker Size		A	10	10	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52
	Max.Length	Out-In	m	20	20
	Max.Height	Out-In	m	12	12
Guaranteed Operating Range (Outdoor)	Cooling		°C	-10 ~ +46	-10 ~ +46
	Heating		°C	-15 ~ +24	-15 ~ +24

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-DM25VA	MSZ-DM35VA		
Outdoor Unit				MUZ-DM25VA	MUZ-DM35VA		
Refrigerant				R410A ^(*)	R410A ^(*)		
Power Supply	Source			Indoor Power supply	Indoor Power supply		
	Outdoor(V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz		
Cooling	Capacity	Rated	kW	2.5	3.15		
		Min-Max	kW	1.3 - 3.0	1.4 - 3.5		
	SHF			0.89	0.87		
	Total Input	Rated	kW	0.710	1.020		
	EER			3.52	3.09		
	EEL Rank			A	B		
	Design load			kW	2.5	3.1	
	Annual electricity consumption ^(*)			kWh/a	149	190	
	SEER			5.8	5.7		
	Energy efficiency class			A+	A+		
Heating (Average Season)	Capacity	Rated	kW	3.15	3.6		
		Min-Max	kW	0.9 - 3.5	1.1 - 4.1		
	Total Input	Rated	kW	0.850	0.975		
	COP			3.71	3.69		
	EEL Rank			A	A		
	Design load			kW	1.9(-10°C)	2.4(-10°C)	
	Declared Capacity	at reference design temperature		kW	1.9(-10°C)	2.4(-10°C)	
		at bivalent temperature		kW	1.9(-10°C)	2.4(-10°C)	
		at operation limit temperature		kW	1.9(-10°C)	2.4(-10°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	
	Annual electricity consumption ^(*)			kWh/a	647	809	
	SCOP			4.1	4.1		
	Energy efficiency class			A+	A+		
Operating Current(Max)			A	5.8	6.5		
Indoor Unit	Input	Rated	kW	0.020	0.021		
	Operating Current(Max)			A	0.3	0.3	
	Dimensions			H*W*D	mm	290 x 799 x 232	290 x 799 x 232
	Weight			kg	9	9	
	Air Volume (SLo-Lo-Mid-Hi-SHi ^(*) (Dry/Wet))	Cooling	m ³ /min	3.8 - 5.5 - 7.3 - 9.5	3.8 - 5.7 - 7.8 - 10.9		
		Heating	m ³ /min	3.5 - 5.5 - 7.5 - 10.0	3.5 - 5.5 - 7.5 - 10.3		
	Sound Level (SPL) (SLo-Lo-Mid-Hi-SHi)	Cooling	dB(A)	22 - 30 - 37 - 43	22 - 31 - 38 - 45		
		Heating	dB(A)	23 - 30 - 37 - 43	23 - 30 - 37 - 44		
Sound Level (PWL*3)			Cooling	dB(A)	57	60	
Outdoor Unit	Dimensions			H*W*D	mm	538 x 699 x 249	538 x 699 x 249
	Weight			kg	24	25	
	Air Volume	Cooling	m ³ /min	31.5	31.5		
		Heating	m ³ /min	31.5	31.5		
	Sound Level (SPL)	Cooling	dB(A)	50	51		
		Heating	dB(A)	50	51		
	Sound Level (PWL)			Cooling	dB(A)	63	64
	Operating Current(Max)			A	5.5	6.2	
Breaker Size			A	10	10		
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52		
	Max.Length	Out-In	m	20	20		
	Max.Height	Out-In	m	12	12		
Guaranteed Operating Range(Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	
			Heating	°C	-10 ~ +24	-10 ~ +24	

WALL-MOUNTED SPECIFICATIONS

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.

Indoor Unit				MSZ-HJ25VA	MSZJH35VA	MSZ-HJ50VA	
Outdoor Unit				MUZ-HJ25VA	MUZ-HJ35VA	MUZ-HJ50VA	
Refrigerant				R410A (*1)	R410A (*1)	R410A (*1)	
Power Supply	Source			Indoor Power supply	Indoor Power supply	Indoor Power supply	
	Outdoor(V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	2.5	3.15	5.0	
		Min. - Max.	kW	1.3 - 3.0	1.4 - 3.5	1.3 - 5.0	
	SHF			0.89	0.87	0.70	
	Total Input	Rated	kW	0.730	1.040	2.050	
	EER			3.42	3.03	2.44	
	EEL Rank			A	B	E	
	Design load			kW	2.5	3.1	5.0
	Annual electricity consumption (*2)			kWh/a	171	212	292
	SEER			5.1	5.1	6.0	
	Energy efficiency class			A	A	A+	
Heating (Average Season)	Capacity	Rated	kW	3.15	3.6	5.4	
		Min. - Max.	kW	0.9 - 3.5	1.1 - 4.1	1.4 - 6.5	
	Total Input	Rated	kW	0.870	0.995	1.480	
	COP			3.62	3.62	3.65	
	EEL Rank			A	A	A	
	Design load			kW	1.9(-10°C)	2.4(-10°C)	3.8(-10°C)
	Declared Capacity	at reference design temperature		kW	1.9(-10°C)	2.4(-10°C)	3.8(-10°C)
		at bivalent temperature		kW	1.9(-10°C)	2.4(-10°C)	3.8(-10°C)
		at operation limit temperature		kW	1.9(-10°C)	2.4(-10°C)	3.8(-10°C)
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)
	Annual electricity consumption (*2)			kWh/a	698	885	1267
	SCOP			3.8	3.8	4.2	
	Energy efficiency class			A	A	A+	
Operating Current (Max.)			A	5.8	6.5	9.8	
Indoor Unit	Input	Rated	kW	0.020	0.021	0.037	
	Operating Current (Max.)			A	0.3	0.4	
	Dimensions			H x W x D	mm 290 x 799 x 232	290 x 799 x 232	290 x 799 x 232
	Weight			kg	9	9	9
	Air Volume (Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	3.8 - 5.5 - 7.3 - 9.5	3.8 - 5.7 - 7.8 - 10.9	6.3 - 9.1 - 11.1 - 12.9	
		Heating	m ³ /min.	3.5 - 5.5 - 7.5 - 10.0	3.5 - 5.5 - 7.5 - 10.3	6.1 - 8.3 - 11.1 - 14.3	
	Sound Level (SPL) (Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	22 - 30 - 37 - 43	22 - 31 - 38 - 45	28 - 36 - 40 - 45	
		Heating	dB(A)	23 - 30 - 37 - 43	23 - 30 - 37 - 44	27 - 34 - 41 - 47	
Sound Level (PWL)	Cooling	dB(A)	57	60	60		
Outdoor Unit	Dimensions			H x W x D	mm 538 x 699 x 249	538 x 699 x 249	550 x 800 x 285
	Weight			kg	24	25	36
	Air Volume	Cooling	m ³ /min.	31.5	31.5	36.3	
		Heating	m ³ /min.	31.5	31.5	34.8	
	Sound Level (SPL)	Cooling	dB(A)	50	50	50	
		Heating	dB(A)	50	50	51	
	Sound Level (PWL)	Cooling	dB(A)	63	64	64	
	Operating Current (Max.)			A	5.5	6.2	9.4
Breaker Size			A	10	10	12	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7	
	Max.Length	Out-In	m	20	20	20	
	Max.Height	Out-In	m	12	12	12	
Guaranteed Operating Range (Outdoor)			Cooling	°C	+15~+46	+15~+46	+15~+46
			Heating	°C	-10~+24	-10~+24	-10~+24

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MSZ-HJ60VA	MSZ-HJ71VA	
Outdoor Unit				MUZ-HJ60VA	MUZ-HJ71VA	
Refrigerant				R410A (*1)	R410A (*1)	
Power Supply	Source			Indoor Power supply	Indoor Power supply	
	Outdoor(V/Phase/Hz)			230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	
Cooling	Capacity	Rated	kW	6.1	7.1	
		Min. - Max.	kW	1.7 - 7.1	1.8 - 7.1	
	SHF			0.82	0.77	
	Total Input	Rated	kW	1.900	2.330	
	EER			3.21	3.05	
	EEL Rank			A	B	
	Design load		kW	6.1	7.1	
	Annual electricity consumption (*2)			kWh/a	354	441
	SEER			6.0	5.6	
	Energy efficiency class			A+	A+	
Heating (Average Season)	Capacity	Rated	kW	6.8	8.1	
		Min. - Max.	kW	1.5 - 8.4	1.5 - 8.5	
	Total Input	Rated	kW	1.970	2.440	
	COP			3.45	3.32	
	EEL Rank			B	C	
	Design load		kW	4.6(-10°C)	5.4(-10°C)	
	Declared Capacity	at reference design temperature	kW	4.6(-10°C)	5.4(-10°C)	
		at bivalent temperature	kW	4.6(-10°C)	5.4(-10°C)	
		at operation limit temperature	kW	4.6(-10°C)	5.4(-10°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)
	Annual electricity consumption (*2)			kWh/a	1544	1854
	SCOP			4.1	4.0	
	Energy efficiency class			A+	A+	
Operating Current (Max.)			A	12.5	12.5	
Indoor Unit	Input	Rated	kW	0.055	0.055	
	Operating Current (Max.)		A	0.5	0.5	
	Dimensions		H x W x D	mm	305 x 923 x 250	305 x 923 x 250
	Weight			kg	13	13
	Air Volume (Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	9.3 - 12.2 - 15.0 - 19.9	10.0 - 12.2 - 15.0 - 19.9	
		Heating	m ³ /min.	9.4 - 12.5 - 16.0 - 19.9	10.3 - 12.7 - 16.4 - 19.9	
	Sound Level (SPL) (Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	31 - 38 - 44 - 50	33 - 38 - 44 - 50	
		Heating	dB(A)	31 - 38 - 44 - 49	33 - 38 - 44 - 49	
Sound Level (PWL)		Cooling	dB(A)	65	65	
Outdoor Unit	Dimensions		H x W x D	mm	880 x 840 x 330	880 x 840 x 330
	Weight			kg	55	55
	Air Volume	Cooling	m ³ /min.	47.9	49.3	
		Heating	m ³ /min.	47.9	47.9	
	Sound Level (SPL)	Cooling	dB(A)	55	55	
		Heating	dB(A)	55	55	
	Sound Level (PWL)		Cooling	dB(A)	65	66
	Operating Current (Max.)			A	12	12
Breaker Size			A	16	16	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/15.88	9.52/15.88	
	Max.Length	Out-In	m	30	30	
	Max.Height	Out-In	m	15	15	
Guaranteed Operating Range (Outdoor)		Cooling	°C	+15~+46	+15~+46	
		Heating	°C	-10~+24	-10~+24	

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂ over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.

WALL-MOUNTED SPECIFICATIONS



C.1.2 OUTLINES AND DIMENSIONS

C.1.2.1 Indoor Unit

Unit: mm

MSZ-LN18VGW	MSZ-LN25VGW	MSZ-LN35VGW	MSZ-LN50VGW	MSZ-LN60VGW
MSZ-LN18VGV	MSZ-LN25VGV	MSZ-LN35VGV	MSZ-LN50VGV	MSZ-LN60VGV
MSZ-LN18VGB	MSZ-LN25VGB	MSZ-LN35VGB	MSZ-LN50VGB	MSZ-LN60VGB
MSZ-LN18VGR	MSZ-LN25VGR	MSZ-LN35VGR	MSZ-LN50VGR	MSZ-LN60VGR

INDOOR UNIT

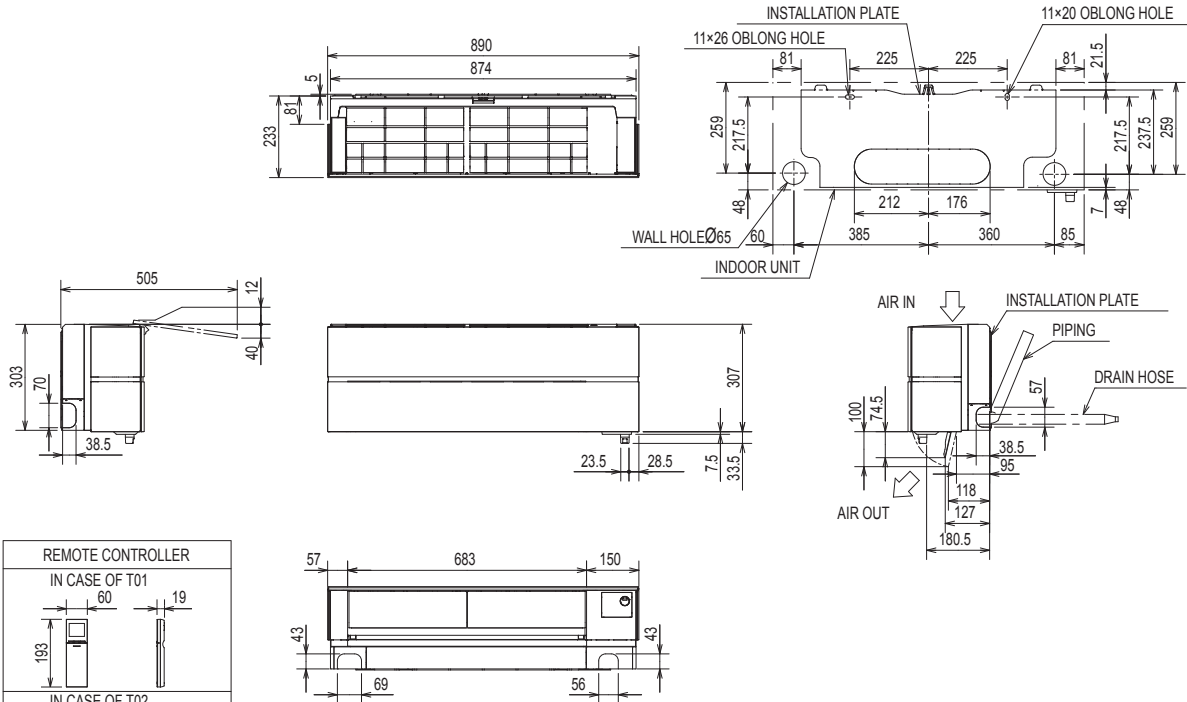

MSZ-LN18/25/35/50VGW		MSZ-LN18/25/35/50VGV,VGB,VGR	
PIPING	INSULATION	Ø35 O.D	Ø35 O.D
	LIQUID LINE	Ø6.35 - 0.5m (FLARED CONNECTION Ø6.35)	Ø6.35 - 0.5m (FLARED CONNECTION Ø6.35)
	GAS LINE	Ø9.52 - 0.45m (FLARED CONNECTION Ø9.52)	Ø9.52 - 0.45m (FLARED CONNECTION Ø9.52)
DRAIN HOSE	INSULATION Ø28 CONNECTED PART Ø16 O.D		INSULATION Ø28 CONNECTED PART Ø16 O.D
REMOTE CONTROLLER	T01		T02


MSZ-LN60VGW		MSZ-LN60VGV,VGB,VGR	
PIPING	INSULATION	Ø37 O.D	Ø37 O.D
	LIQUID LINE	Ø6.35 - 0.5m (FLARED CONNECTION Ø6.35)	Ø6.35 - 0.5m (FLARED CONNECTION Ø6.35)
	GAS LINE	Ø9.52 - 0.45m (FLARED CONNECTION Ø12.7)	Ø9.52 - 0.45m (FLARED CONNECTION Ø12.7)
DRAIN HOSE	INSULATION Ø28 CONNECTED PART Ø16 O.D		INSULATION Ø28 CONNECTED PART Ø16 O.D
REMOTE CONTROLLER	T01		T02

OUTLINES AND DIMENSIONS WALL-MOUNTED

Unit: mm


MSZ-AP15VG MSZ-AP20VG

INDOOR UNIT

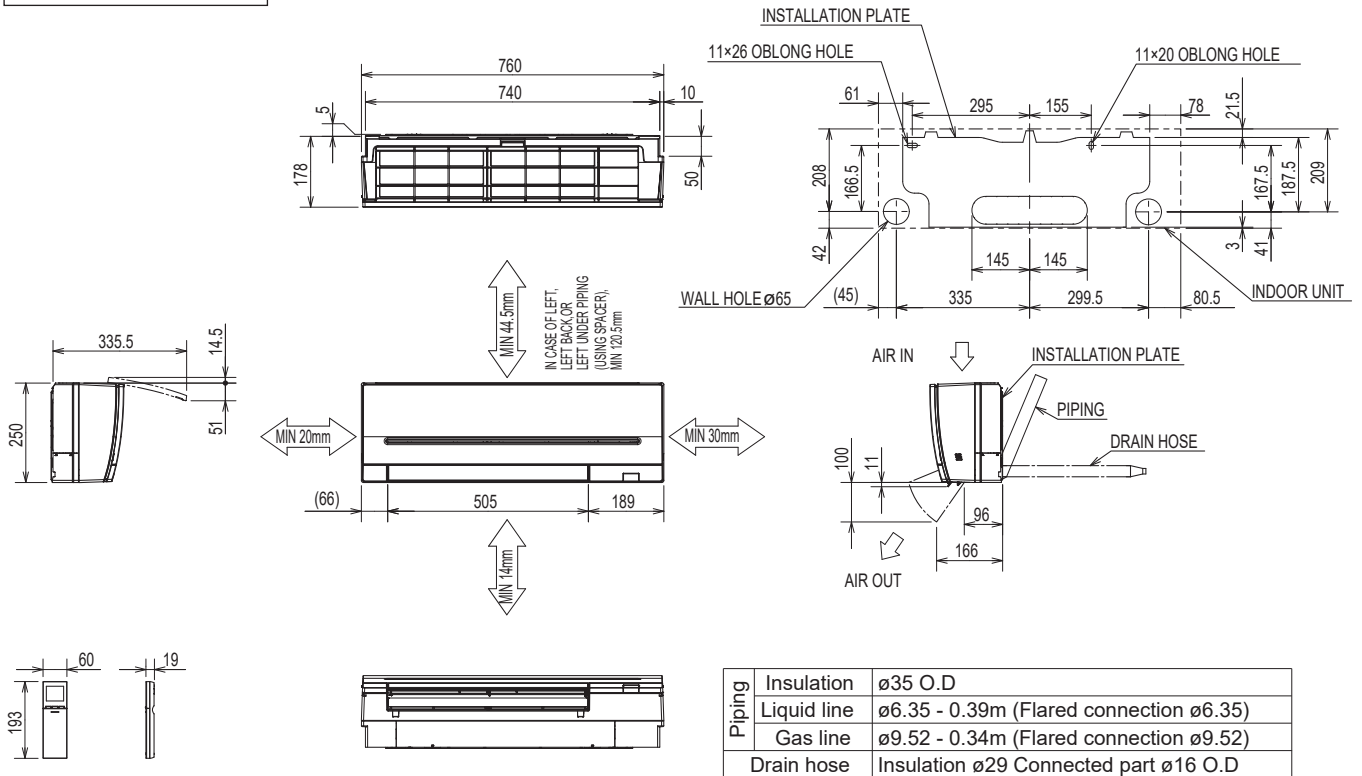

MSZ-AP25VG MSZ-AP35VG MSZ-AP42VG MSZ-AP50VG
MSZ-AP25VGK MSZ-AP35VGK MSZ-AP42VGK MSZ-AP50VGK


INDOOR UNIT

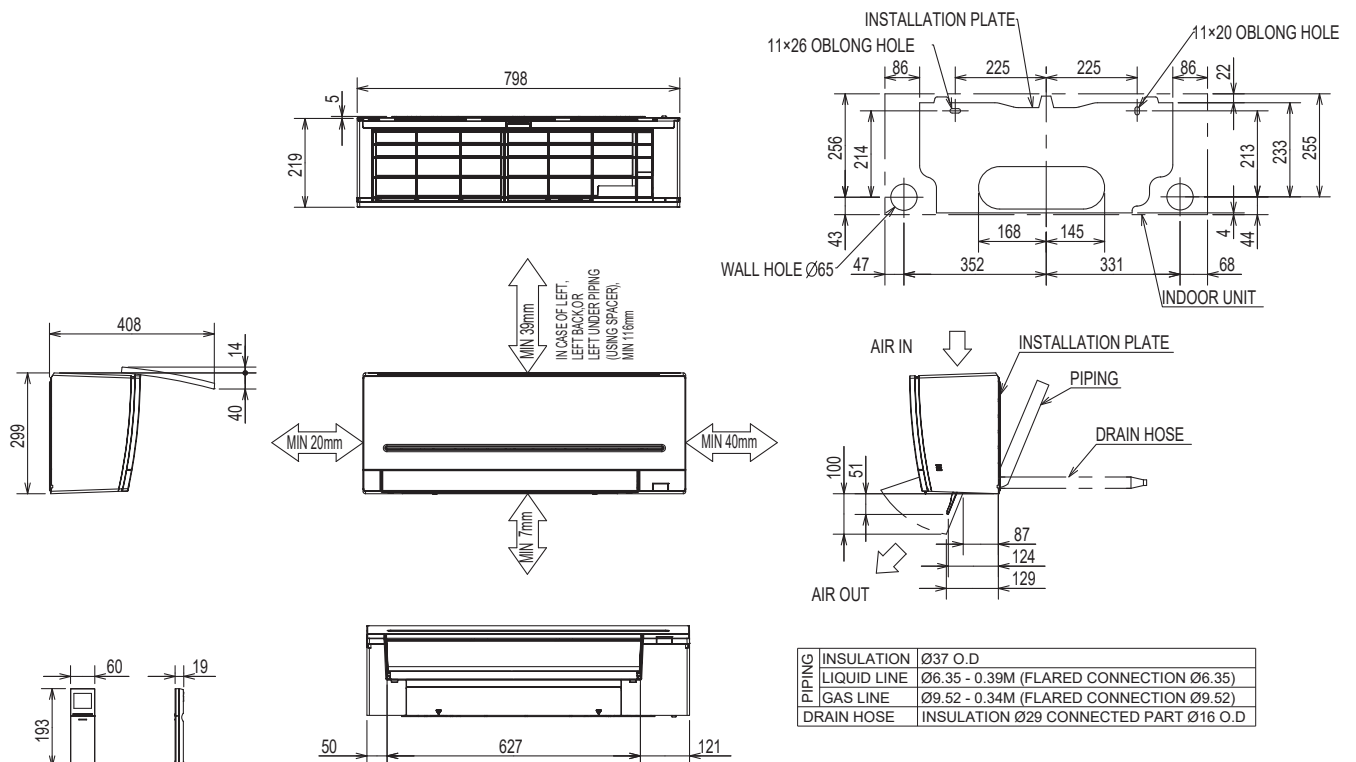

Unit: mm

MSZ-AP60VG MSZ-AP71VG MSZ-AP60VGK MSZ-AP71VGK


INDOOR UNIT

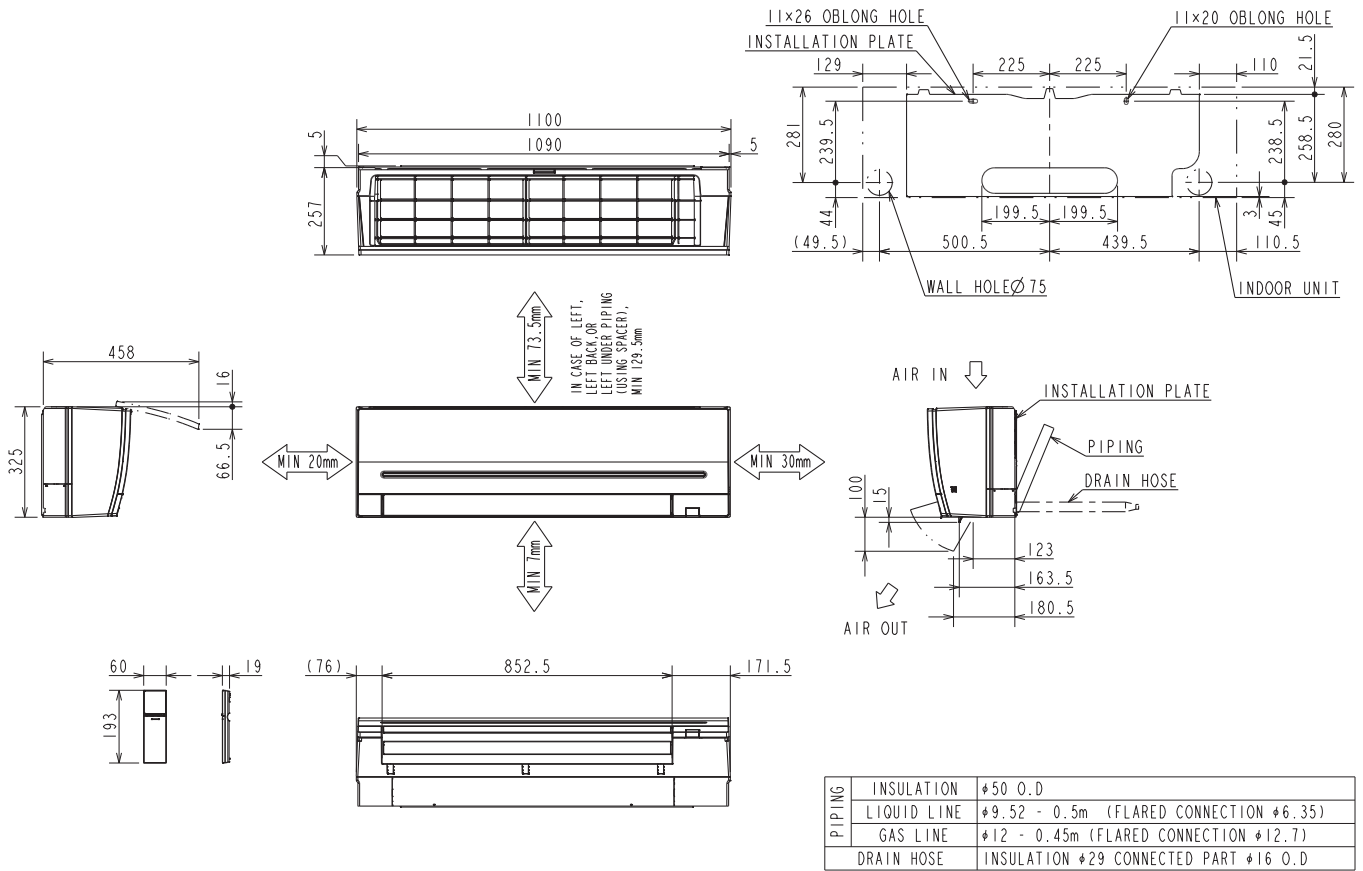

Unit: mm


MSZ-HR25VF MSZ-HR35VF MSZ-HR42VF MSZ-HR50VF

INDOOR UNIT

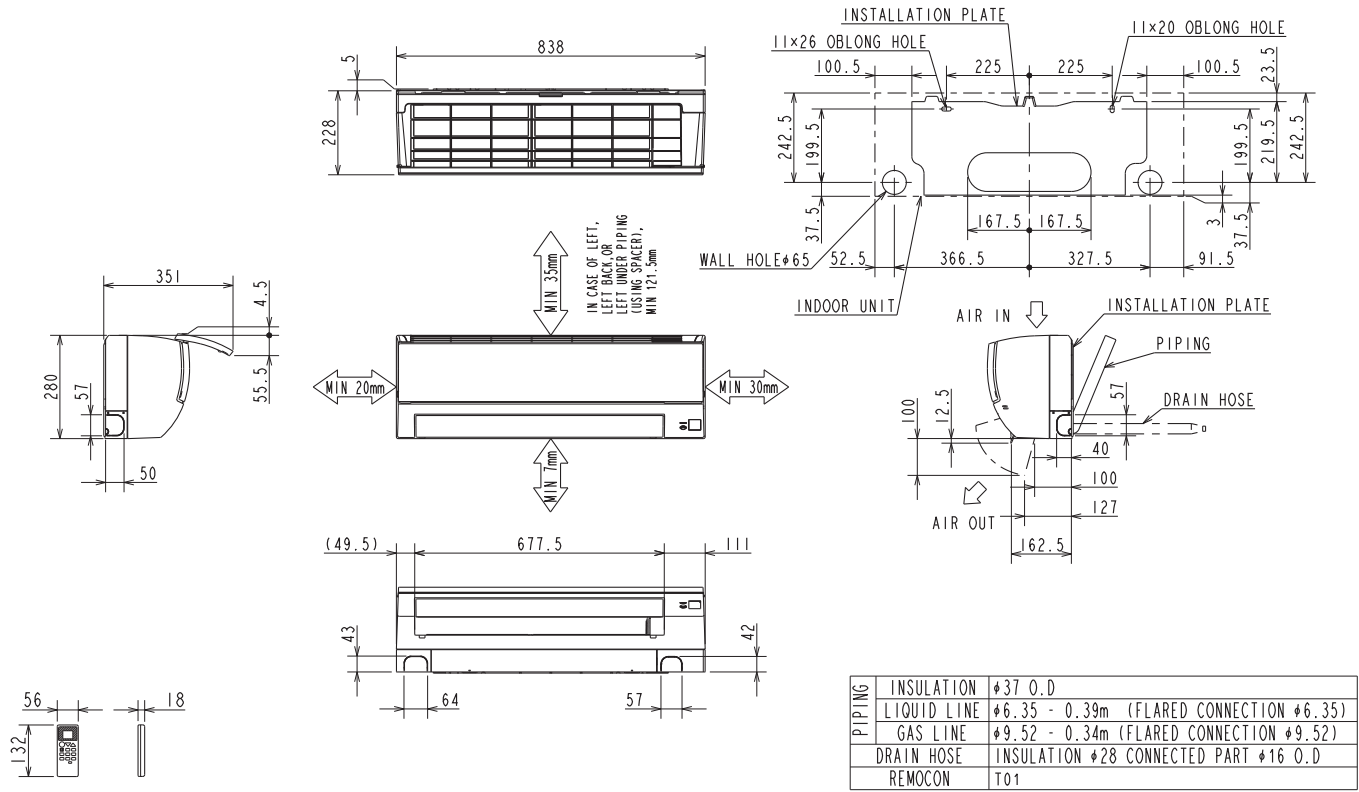

MSY-TP35VF MSY-TP50VF


INDOOR UNIT

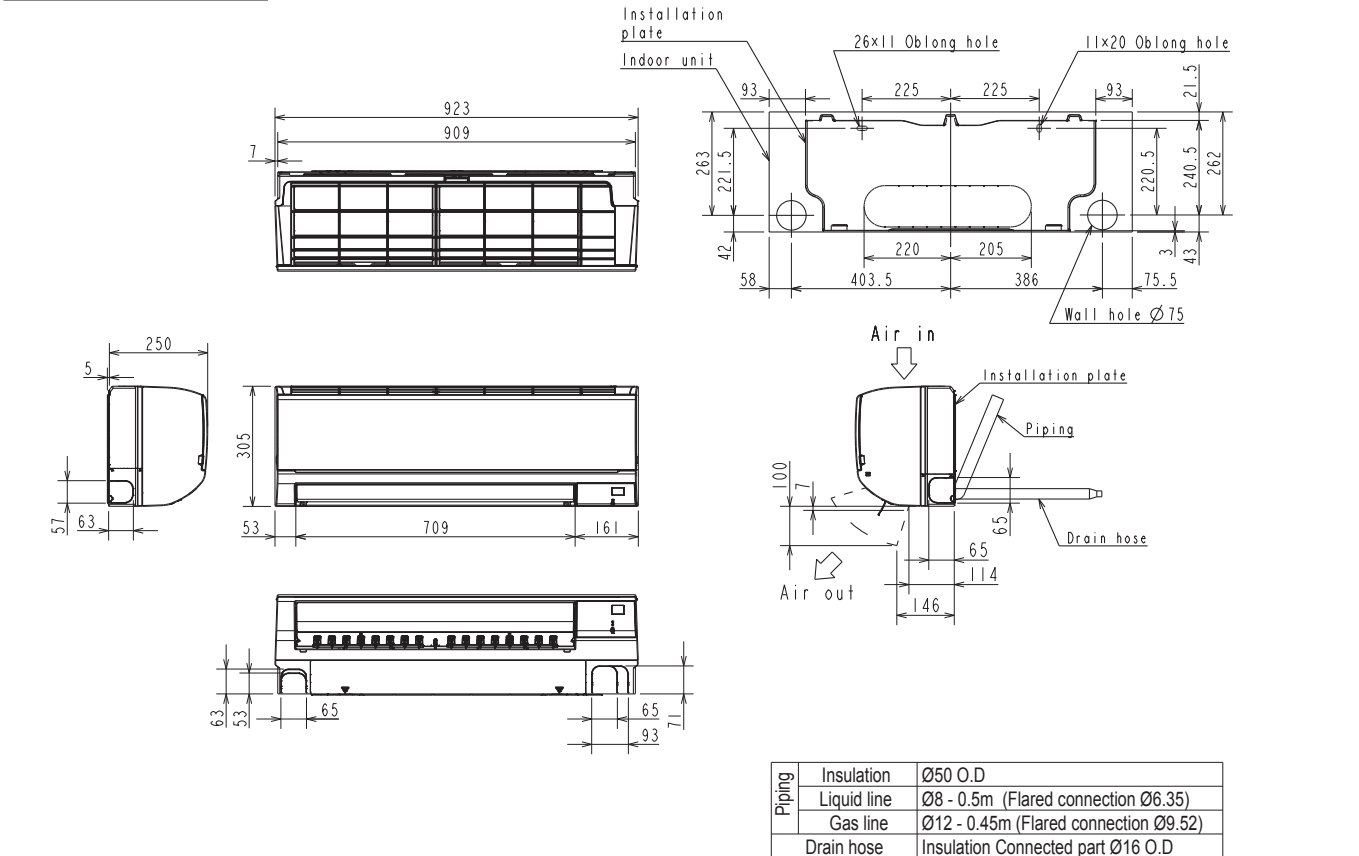

Unit: mm

MSZ-FH25VE2 MSZ-FH35VE2 MSZ-FH50VE2

INDOOR UNIT

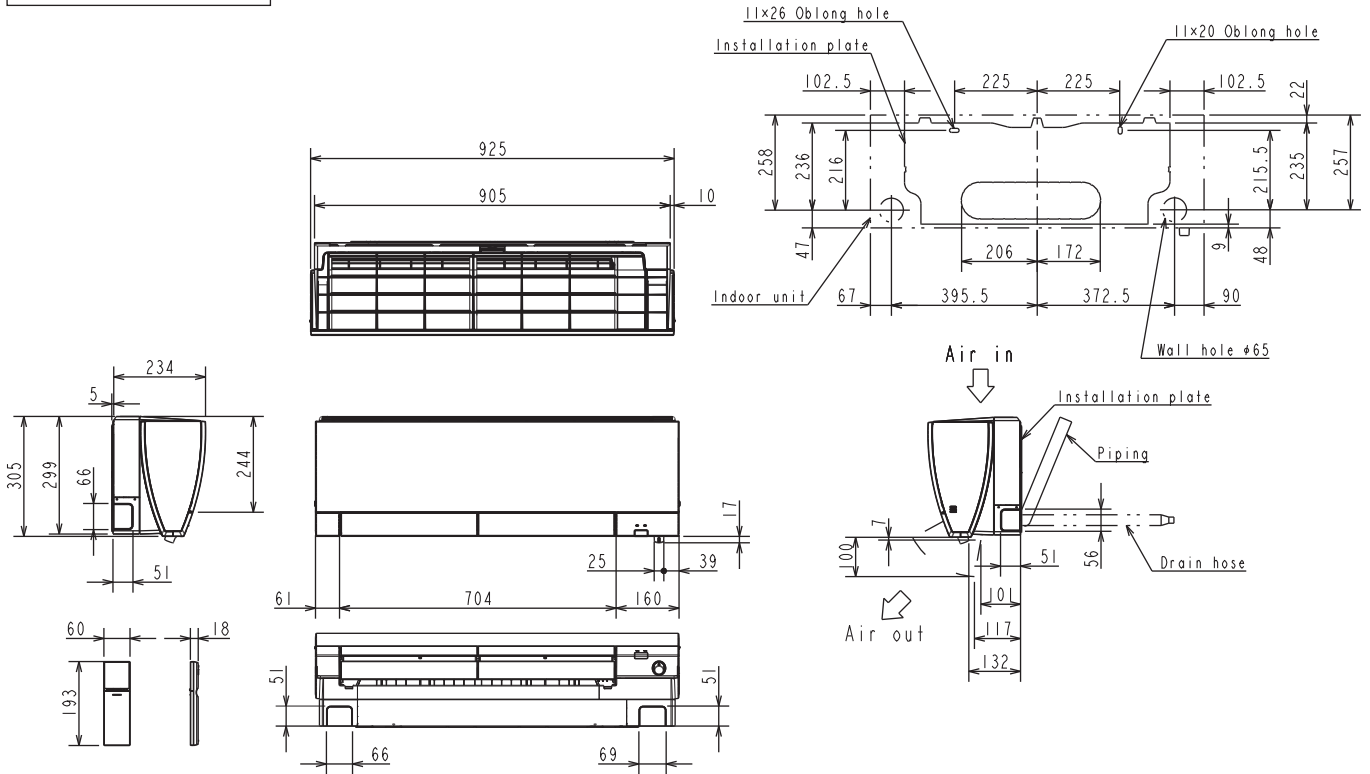

MSZ-FH25VE2 MSZ-FH35VE2

Piping	Insulation	ø37 O.D
	Liquid line	ø6.35 - 0.50 m (Flared connection ø6.35)
	Gas line	ø9.52 - 0.43 m (Flared connection ø9.52)
Drain hose	Insulation ø28 O.D Connected part ø16 O.D	

MSZ-FH50VE2


Piping	Insulation	ø37 O.D
	Liquid line	ø6.35 - 0.50 m (Flared connection ø6.35)
	Gas line	ø9.52 - 0.43 m (Flared connection ø12.7)
Drain hose	Insulation ø28 O.D Connected part ø16 O.D	

OUTLINES AND DIMENSIONS WALL-MOUNTED

Unit: mm

MSZ-EF18VGW MSZ-EF22VGW MSZ-EF25VGW MSZ-EF35VGW MSZ-EF42VGW MSZ-EF50VGW
 MSZ-EF18VGB MSZ-EF22VGB MSZ-EF25VGB MSZ-EF35VGB MSZ-EF42VGB MSZ-EF50VGB
 MSZ-EF18VGS MSZ-EF22VGS MSZ-EF25VGS MSZ-EF35VGS MSZ-EF42VGS MSZ-EF50VGS

INDOOR UNIT

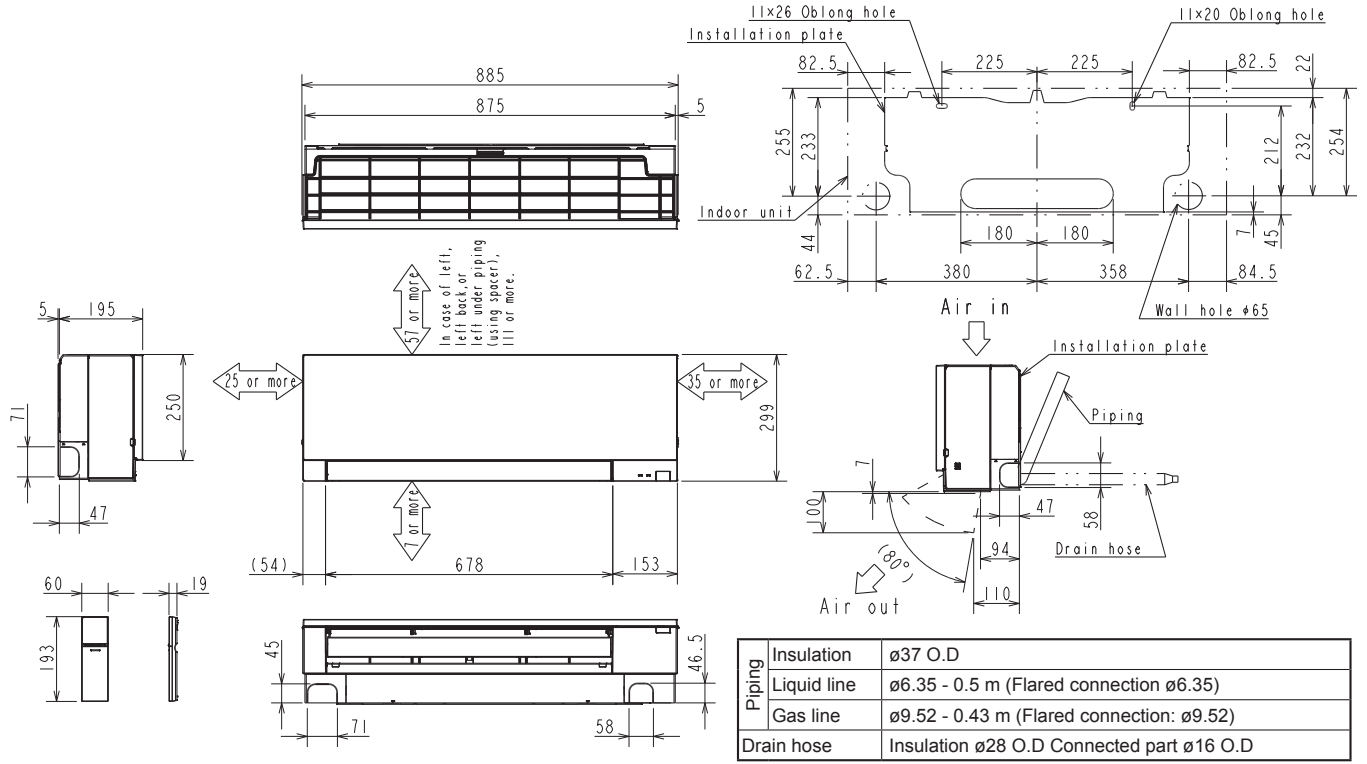


WALL-MOUNTED OUTLINES AND DIMENSIONS

Unit: mm

MSZ-SF15VA MSZ-SF20VA

INDOOR UNIT

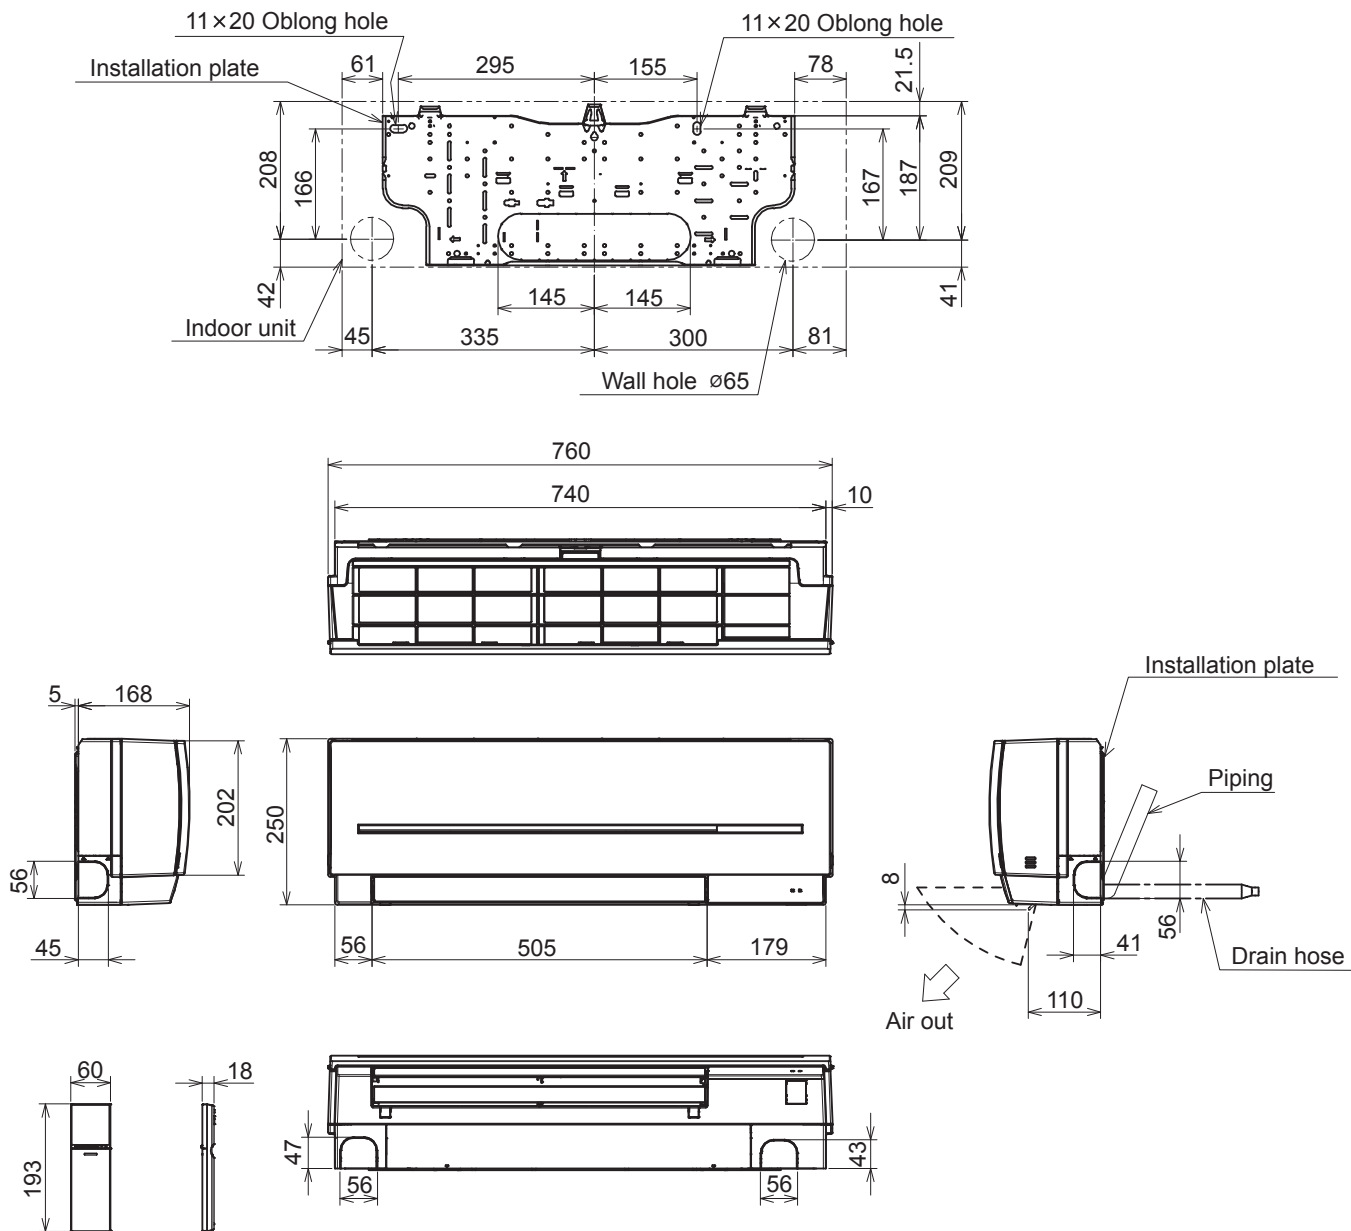


Piping	Insulation	ø35 O.D
	Liquid line	ø6.35-0.39m (Flared connection ø6.35)
	Gas line	ø9.52-0.34m (Flared connection ø9.52)
	Drain hose	Insulation ø28 Connected part ø16 O.D

OUTLINES AND DIMENSIONS WALL-MOUNTED

Unit: mm

MSZ-SF25VE3 MSZ-SF35VE3 MSZ-SF42VE3 MSZ-SF50VE3

INDOOR UNIT

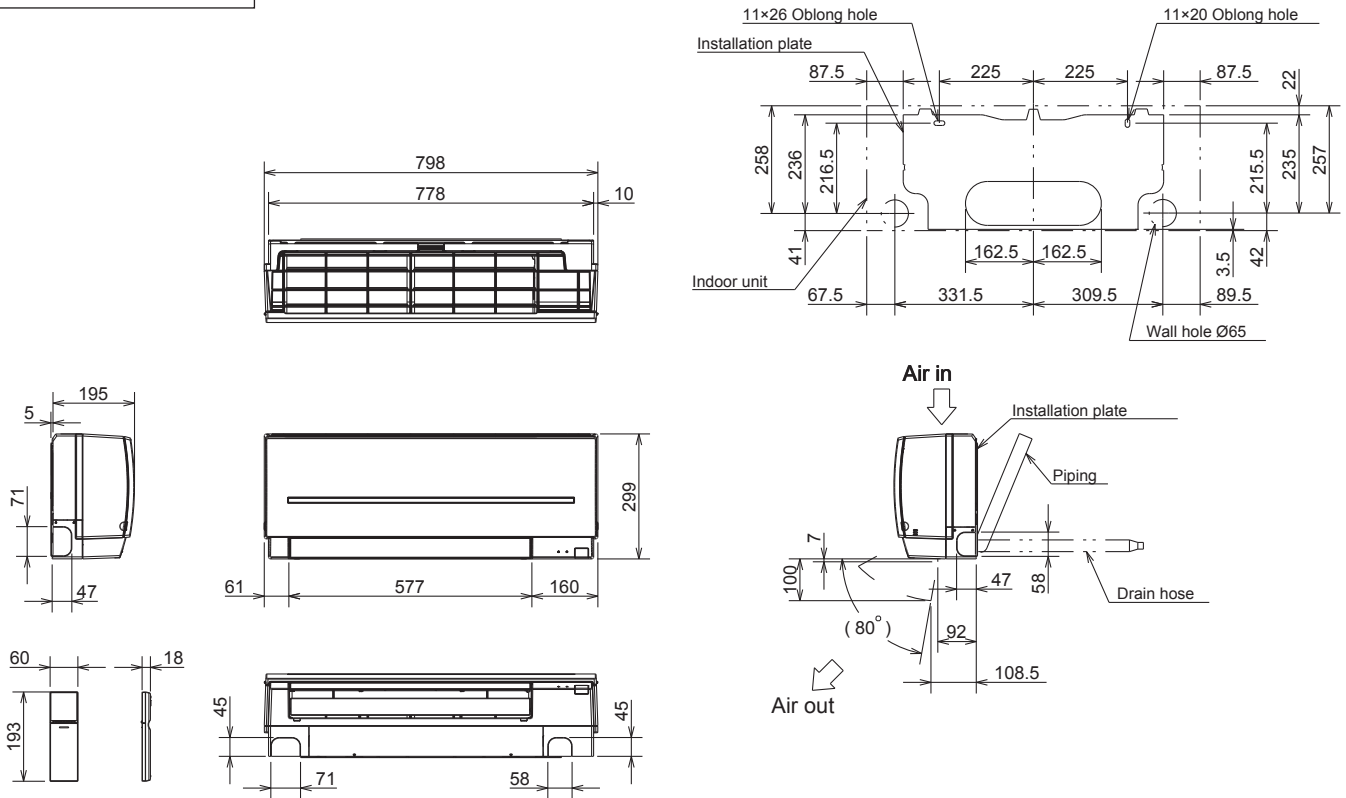


Piping	Insulation	Ø37 O.D
	Liquid line	Ø6.35 - 0.39m (Flared connection Ø6.35)
	Gas line	Ø9.52 - 0.34m [Flared connection Ø9.52 (MSZ-SF25/35/42VE3), Ø12.7 (MSZ-SF50VE3)]
Drain hose	Insulation Ø28 Connected part Ø16 O.D	

Unit: mm

MSZ-GF60VE2 MSZ-GF71VE2

INDOOR UNIT

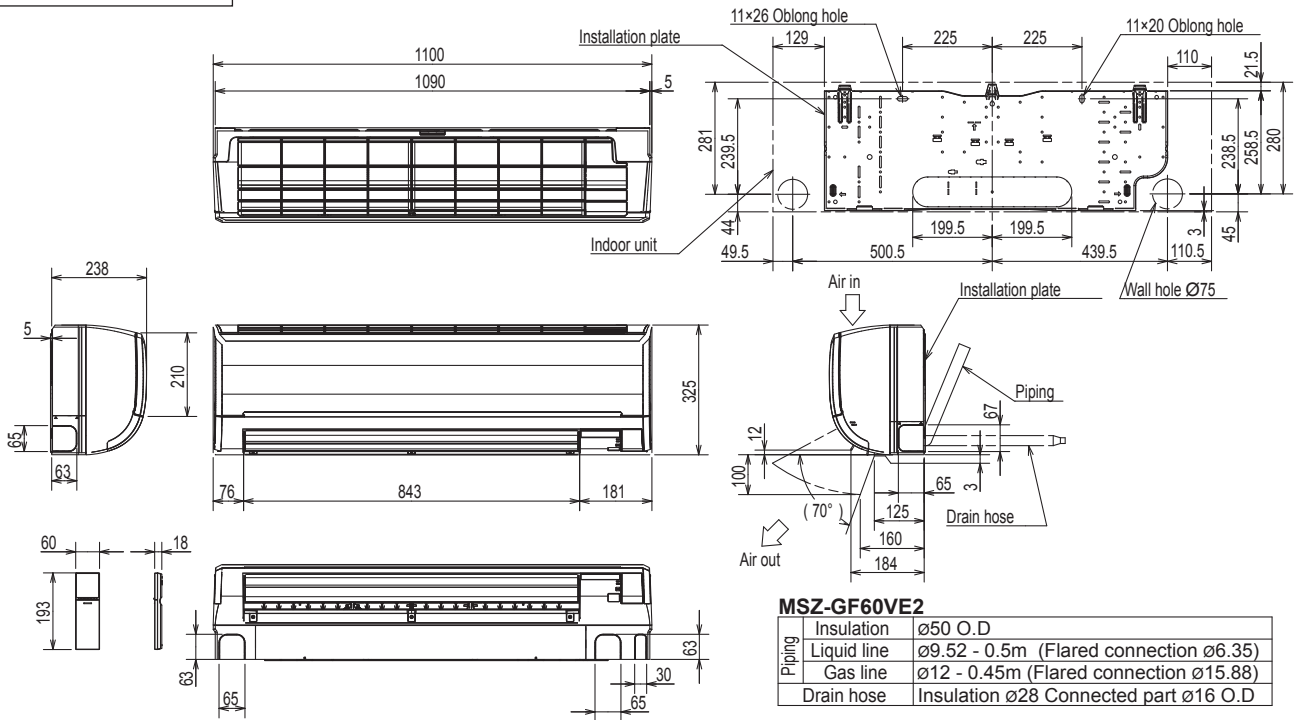

MSZ-GF60VE2

Insulation	ø50 O.D
Piping	Liquid line ø9.52 - 0.5m (Flared connection ø6.35)
	Gas line ø12 - 0.45m (Flared connection ø15.88)
Drain hose	Insulation ø28 Connected part ø16 O.D


MSZ-GF71VE2

Insulation	ø50 O.D
Piping	Liquid line ø9.52 - 0.5m (Flared connection ø9.52)
	Gas line ø12 - 0.45m (Flared connection ø15.88)
Drain hose	Insulation ø28 Connected part ø16 O.D

Unit: mm


MSZ-WN25VA MSZ-WN35VA

INDOOR UNIT

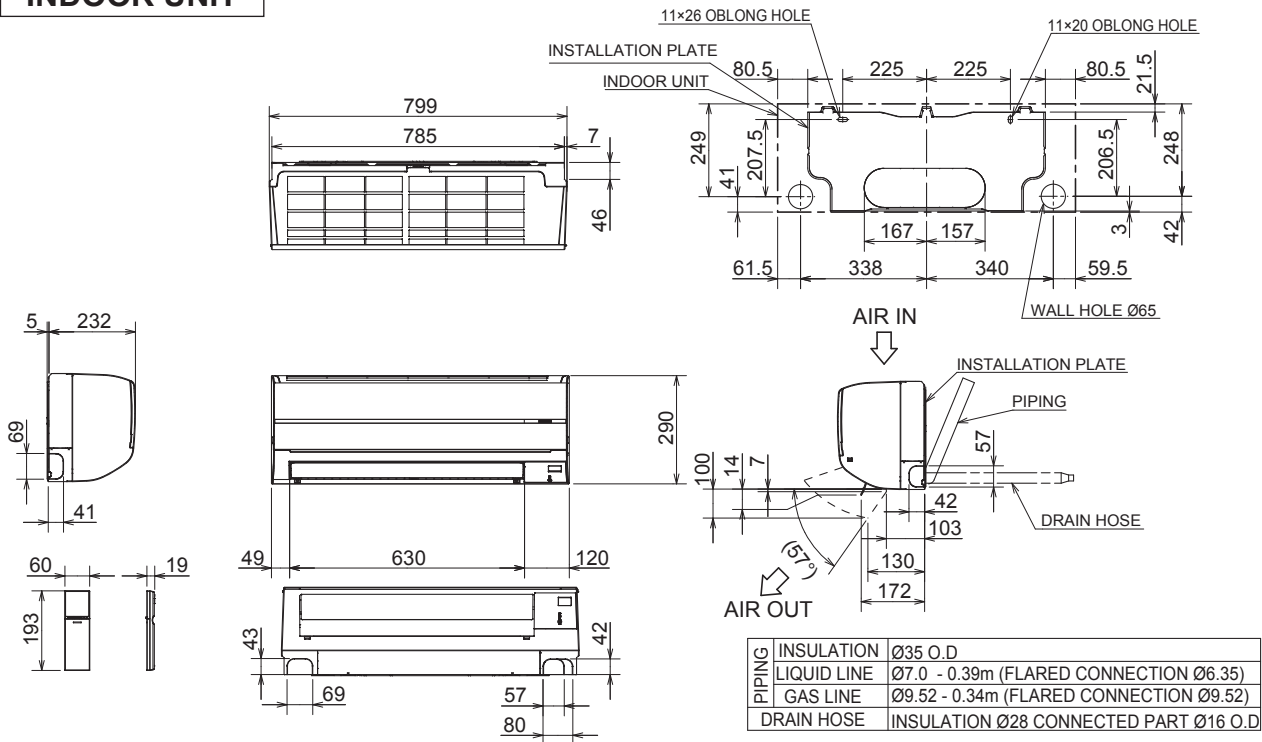

MSZ-DM25VA MSZ-DM35VA MSZ-HJ25VA MSZ-HJ35VA MSZ-HJ50VA

INDOOR UNIT

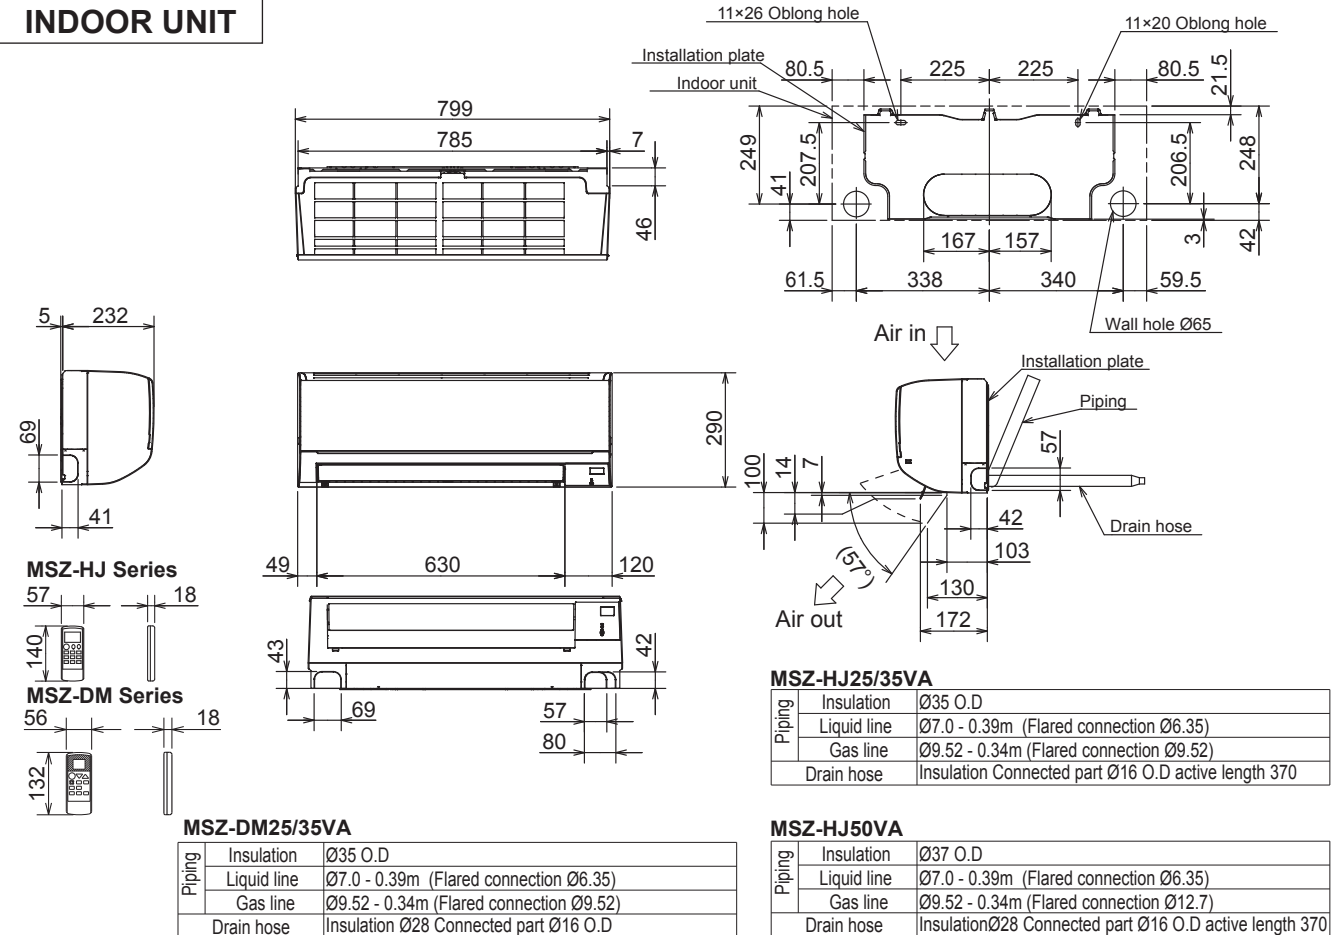


WALL-MOUNTED OUTLINES AND DIMENSIONS

Unit: mm

MSZ-HJ60VA MSZ-HJ71VA

INDOOR UNIT

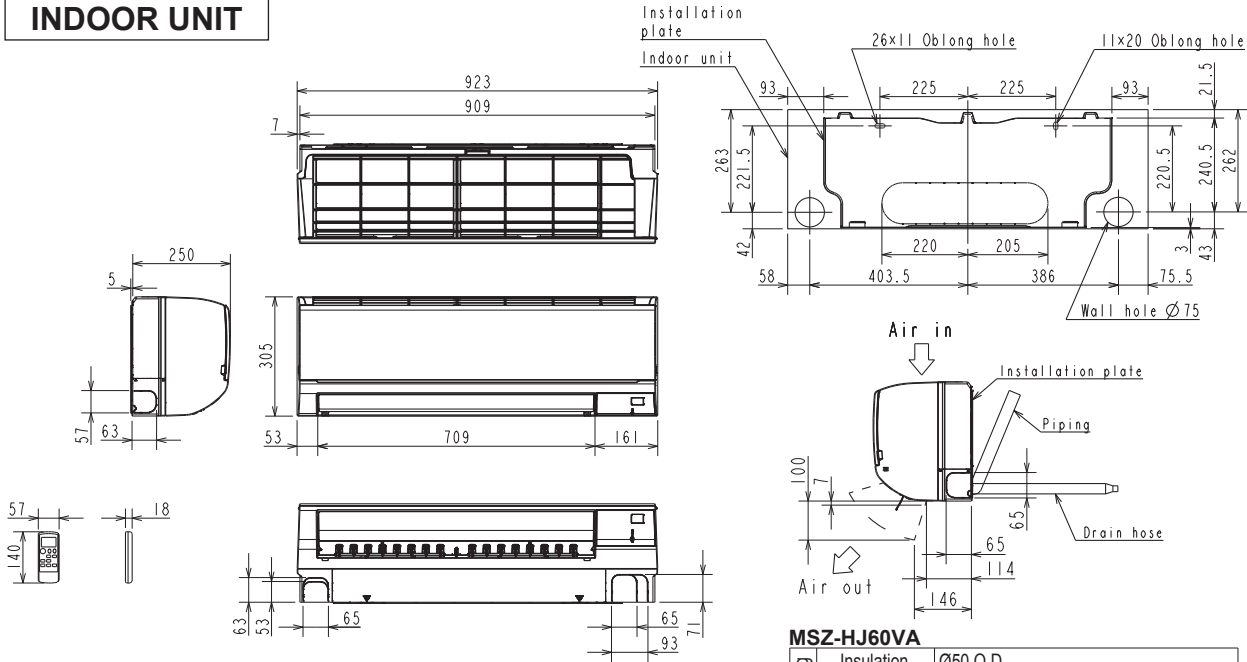

MSZ-HJ60VA


Piping	Insulation	Ø50 O.D
	Liquid line	Ø8 - 0.39m (Flared connection Ø6.35)
	Gas line	Ø12 - 0.34m (Flared connection Ø15.88)
	Drain hose	Insulation Connected part Ø16 O.D

MSZ-HJ71VA

Piping	Insulation	Ø50 O.D
	Liquid line	Ø8 - 0.39m (Flared connection Ø9.52)
	Gas line	Ø12 - 0.34m (Flared connection Ø15.88)
	Drain hose	Insulation Connected part Ø16 O.D

**C.1.2.2 Outdoor Unit
MUZ-AP20VG**

OUTDOOR UNIT

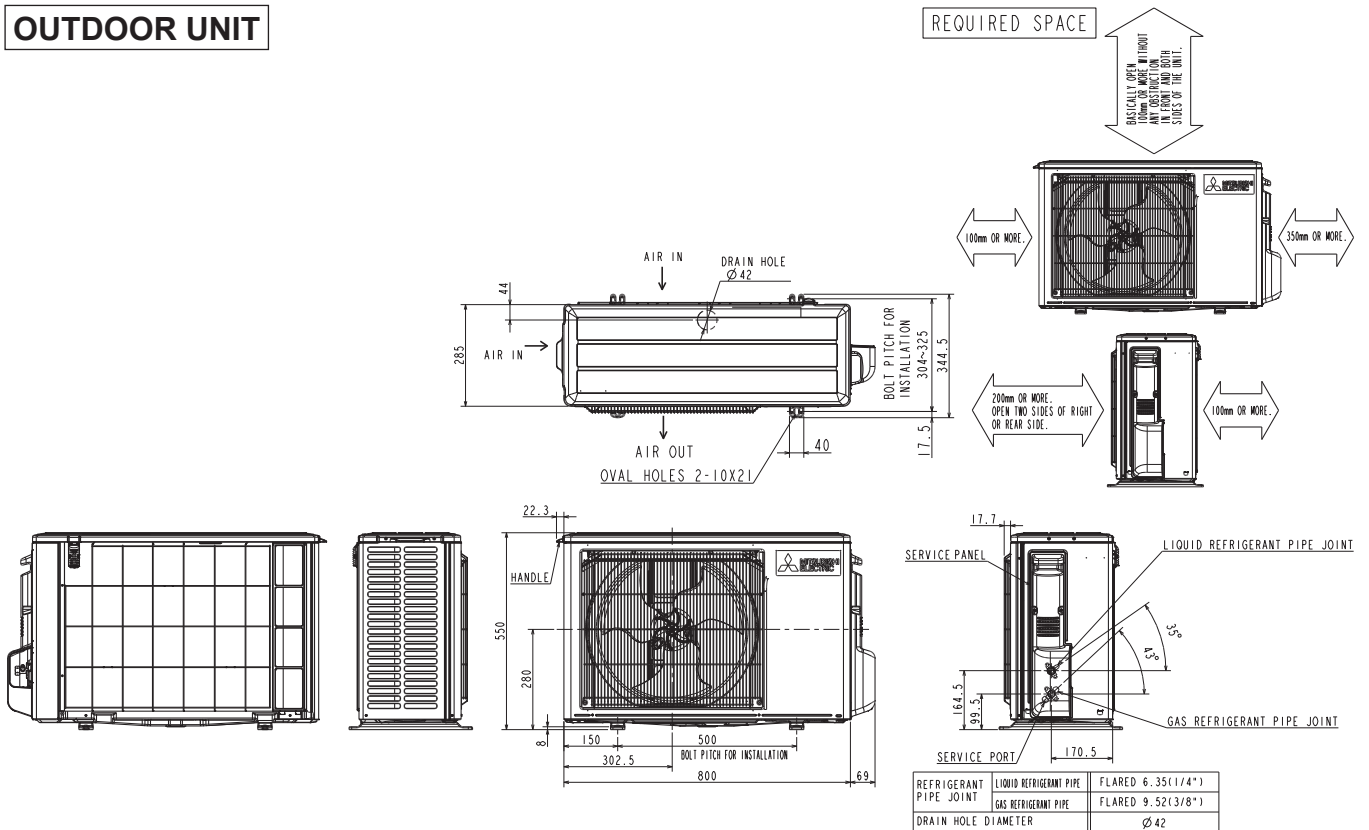


REFRIGERANT PIPE JOINT	LIQUID REFRIGERANT PIPE	FLARED 6.35(1/4")
	GAS REFRIGERANT PIPE	FLARED 9.52(3/8")
	DRAIN HOLE DIAMETER	Ø42


OUTLINES AND DIMENSIONS
WALL-MOUNTED

Unit: mm

MUY-TP35VF MUY-TP50VF
OUTDOOR UNIT

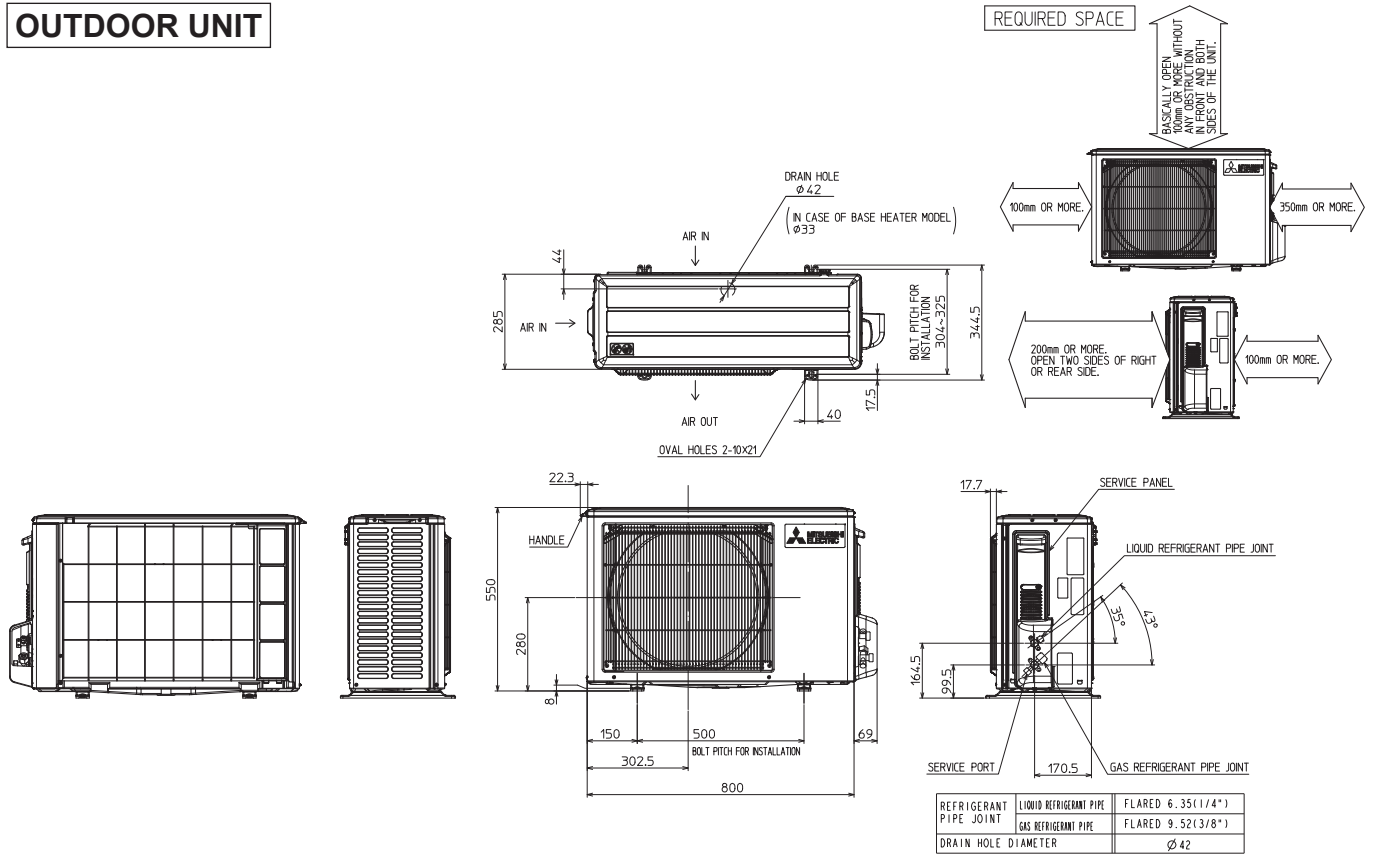


MUZ-LN25VG MUZ-LN35VG MUZ-AP25VG MUZ-AP35VG MUZ-AP25VGH MUZ-AP35VGH MUZ-EF25VG MUZ-EF35VG MUZ-AP42VG MUZ-AP42VGH MUZ-EF42VG MUZ-EF25VGH MUZ-EF35VGH
OUTDOOR UNIT

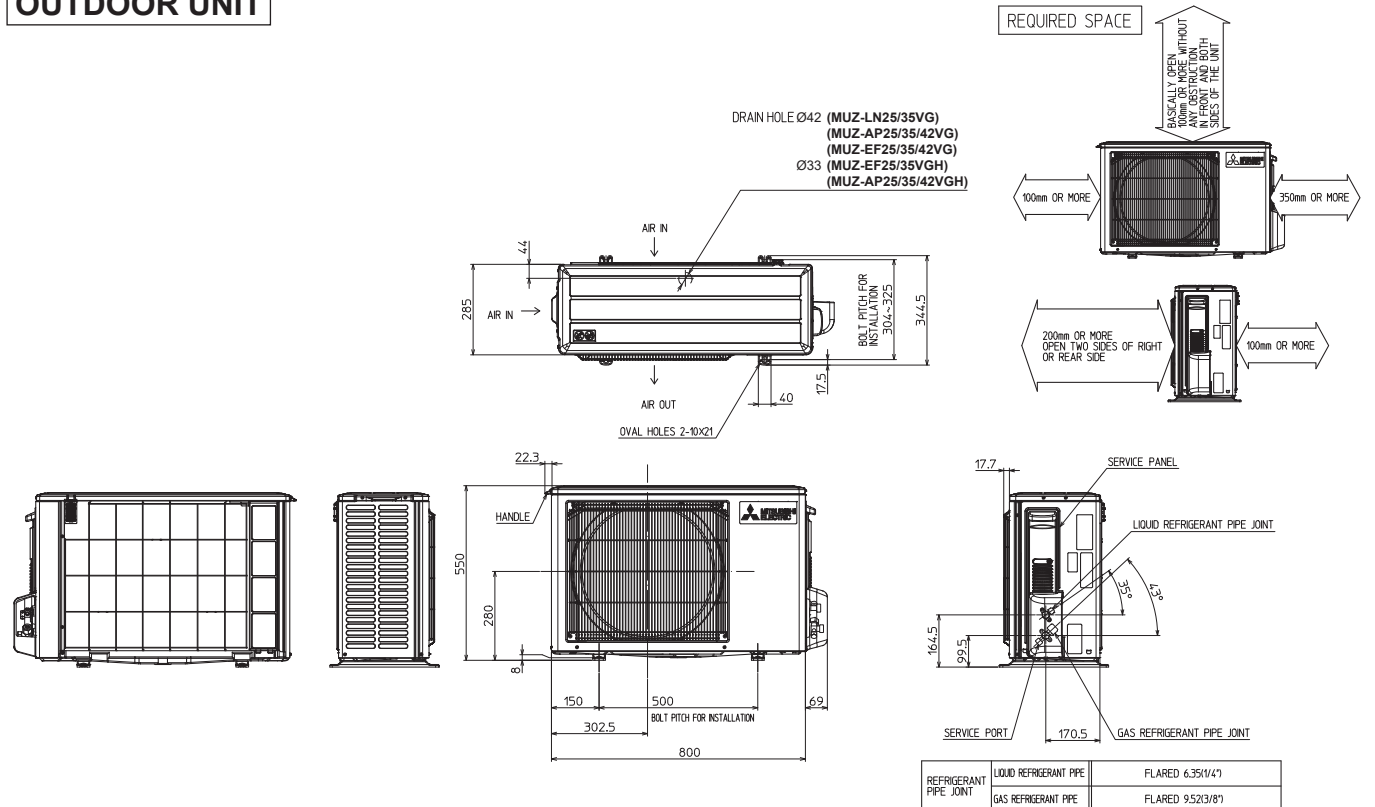


WALL-MOUNTED OUTLINES AND DIMENSIONS

Unit: mm

MUZ-LN25VGHZ MUZ-LN35VGHZ
OUTDOOR UNIT

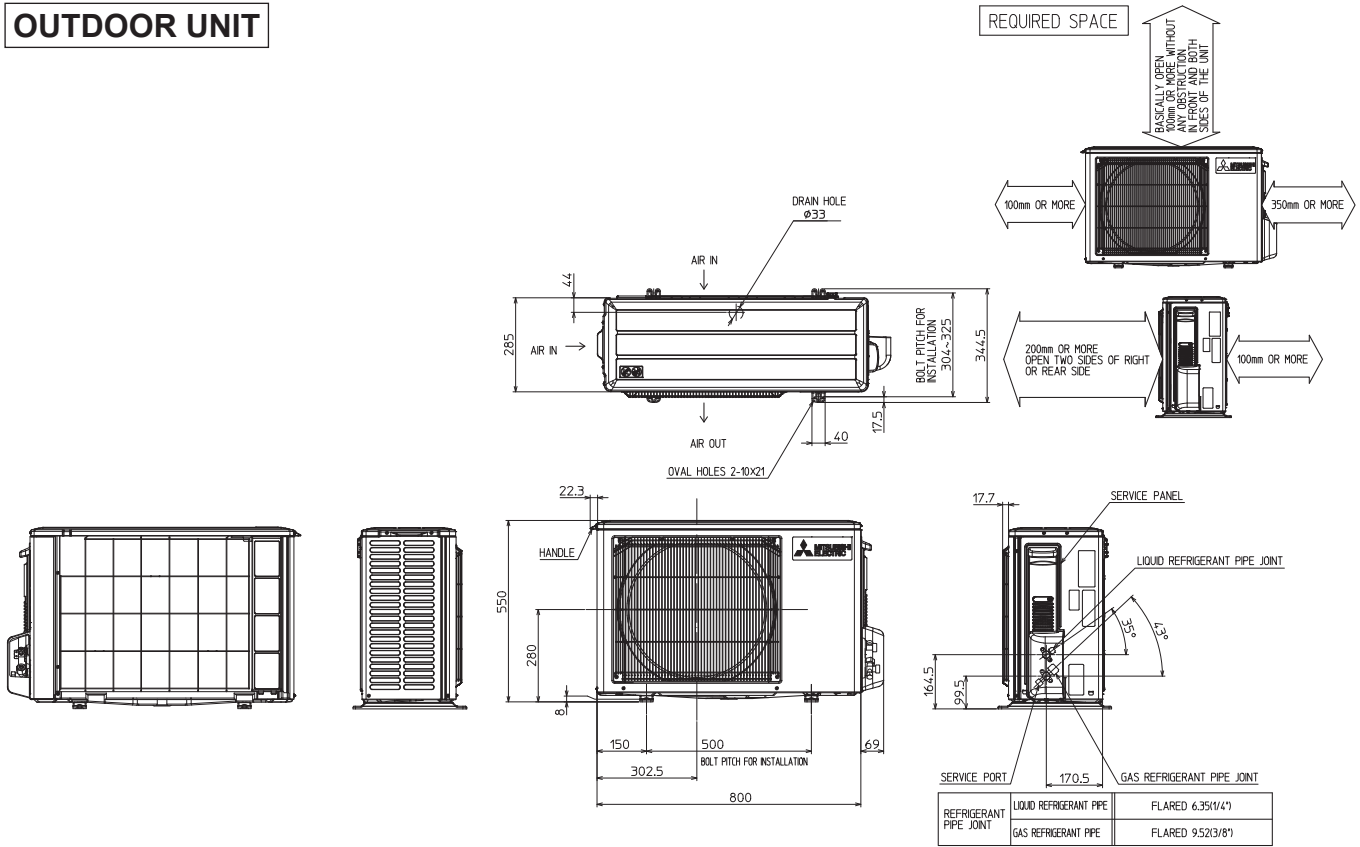



MUZ-LN50VG
MUZ-AP50VG MUZ-AP60VG MUZ-AP50VGH MUZ-EF50VG
OUTDOOR UNIT

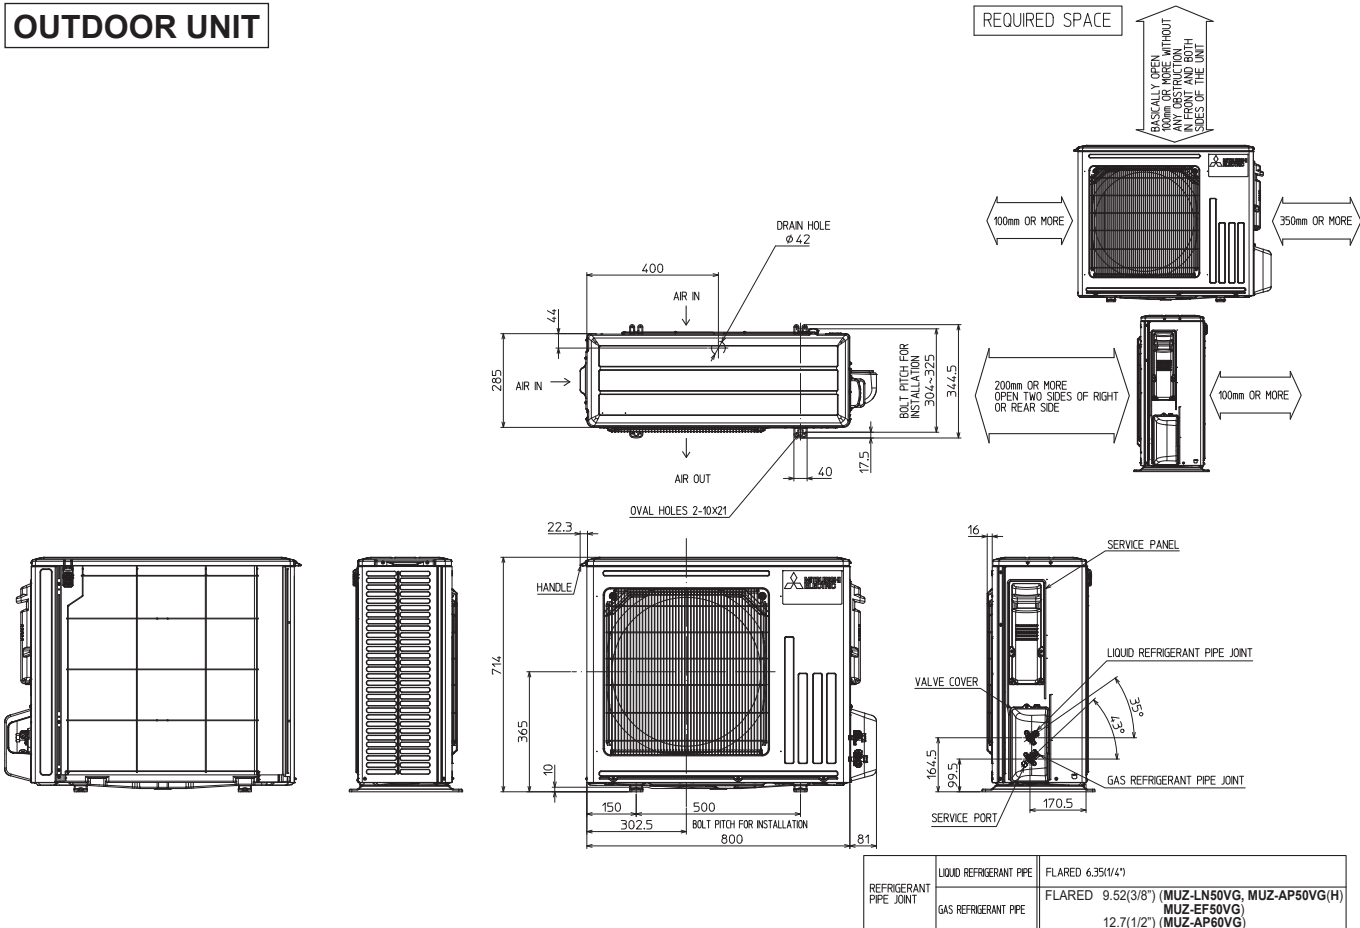

OUTLINES AND DIMENSIONS
WALL-MOUNTED


Unit: mm

MUZ-LN50VGHZ
OUTDOOR UNIT

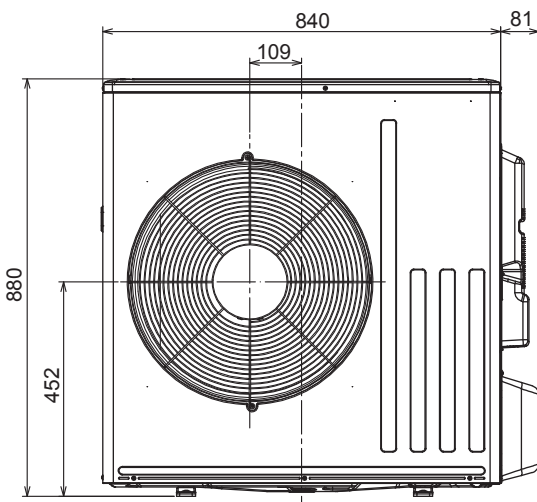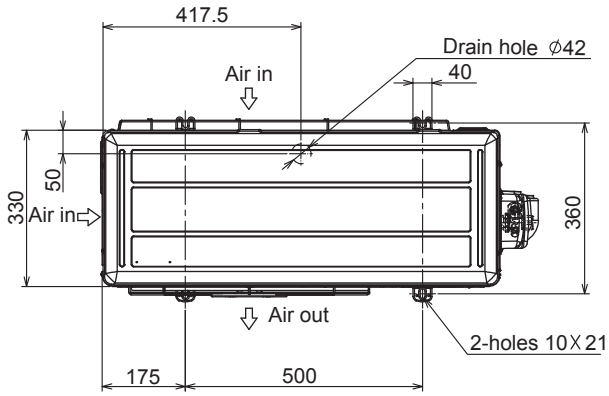


REQUIRED SPACE

*1 500 mm or more when front and sides of the unit are clear

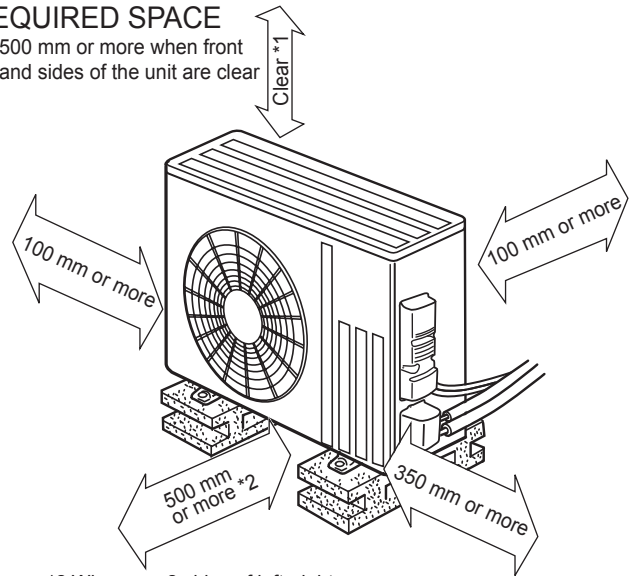








*2 When any 2 sides of left, right and rear of the unit are clear

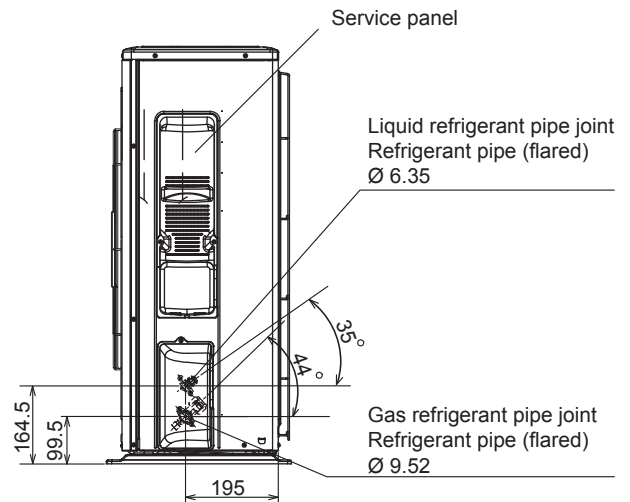

Unit: mm

MUZ-HR25VF MUZ-HR35VF
OUTDOOR UNIT

REQUIRED SPACE

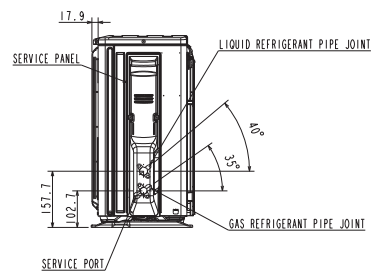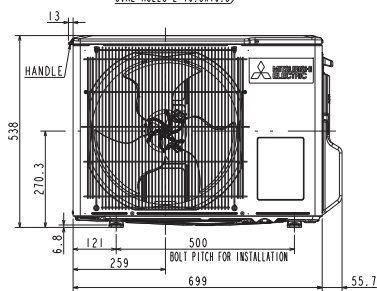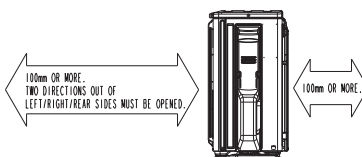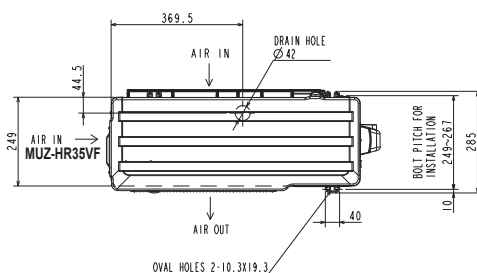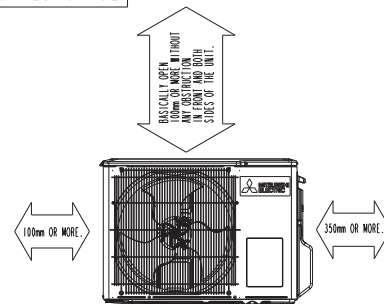


REFRIGERANT PIPE JOINT	LIQUID REFRIGERANT PIPE	FLARED 6.35(1/4")
	GAS REFRIGERANT PIPE	FLARED 9.52(3/8")

OUTLINES AND DIMENSIONS WALL-MOUNTED

Unit: mm

MUZ-HR42VF MUZ-HR50VF
OUTDOOR UNIT


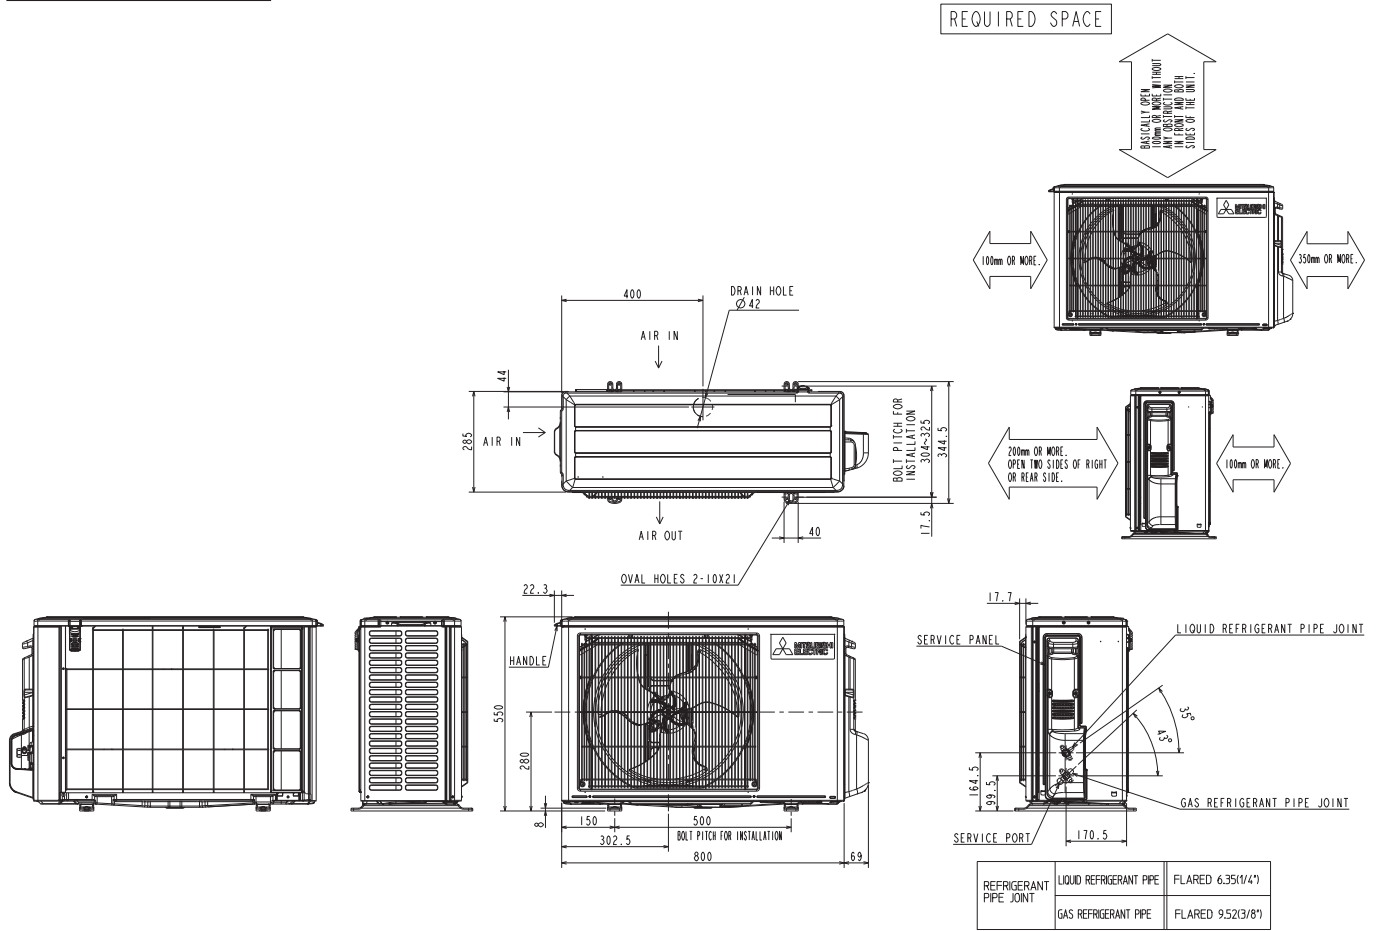


WALL-MOUNTED OUTLINES AND DIMENSIONS

Unit: mm


- MUZ-LN60VG
- MUZ-FH50VE MUZ-FH50VEHZ
- MUZ-SF50VE MUZ-SF50VEH
- MUZ-GF60VE MUZ-GF71VE
- MUZ-HJ60VA MUZ-HJ71VA
- MUZ-AP71VG

OUTDOOR UNIT

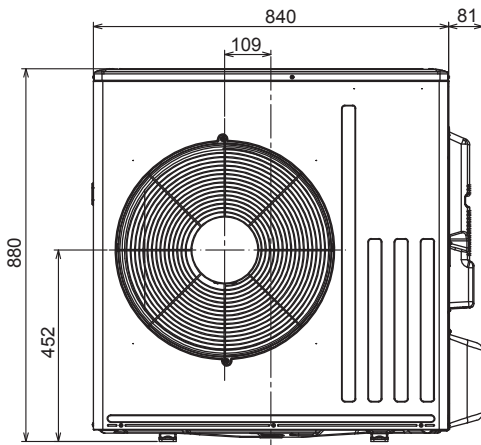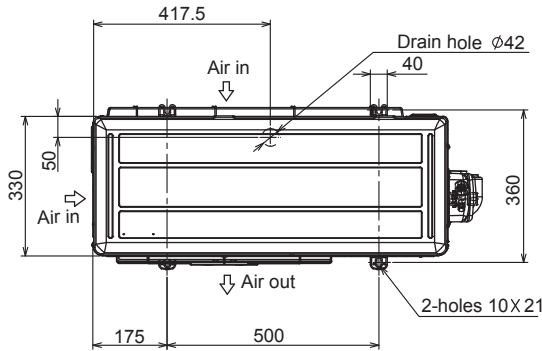


REQUIRED SPACE

*1 500 mm or more when front and sides of the unit are clear

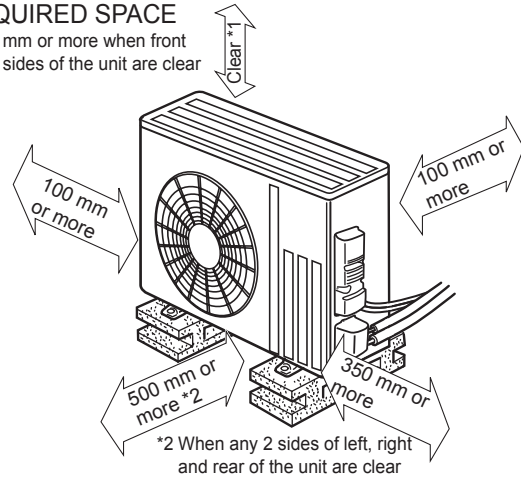

*2 When any 2 sides of left, right and rear of the unit are clear

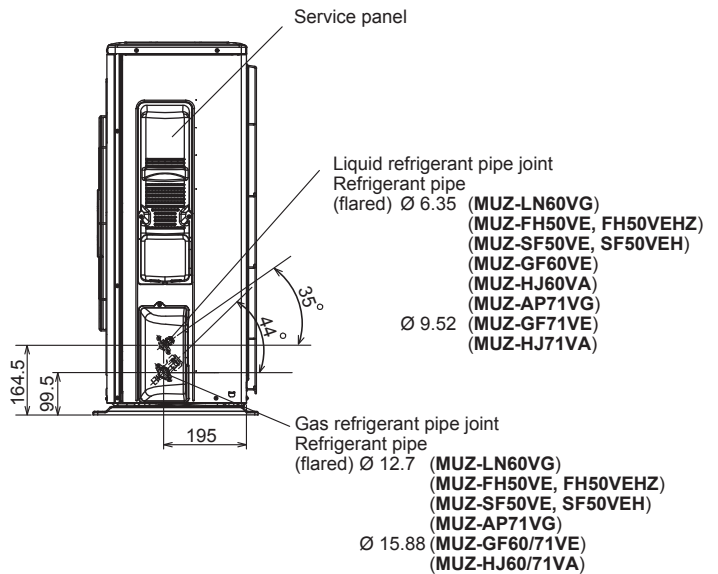




OUTLINES AND DIMENSIONS WALL-MOUNTED

Unit: mm

**MUZ-FH25VE MUZ-FH35VE MUZ-FH25VEHZ MUZ-FH35VEHZ
 MUZ-SF25VE MUZ-SF25VEH MUZ-SF35VE MUZ-SF35VEH MUZ-SF42VE MUZ-SF42VEH
 MUZ-HJ50VA**

OUTDOOR UNIT







REQUIRED SPACE

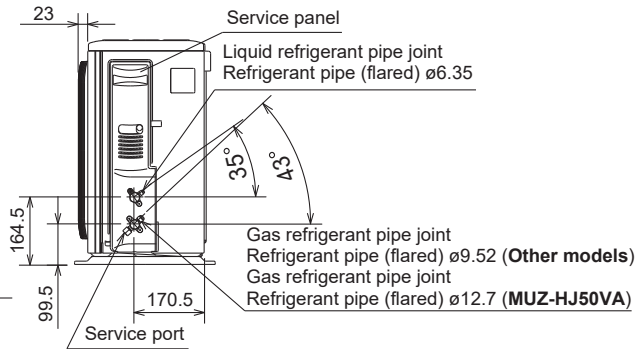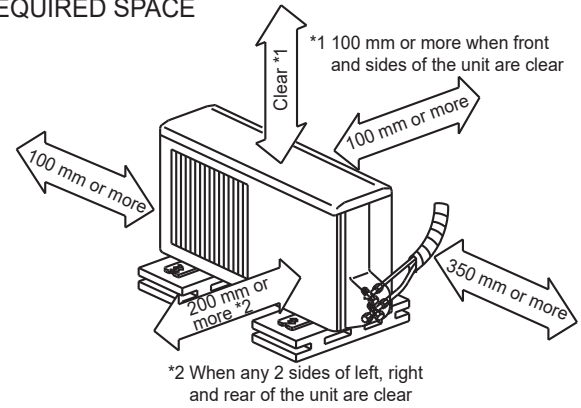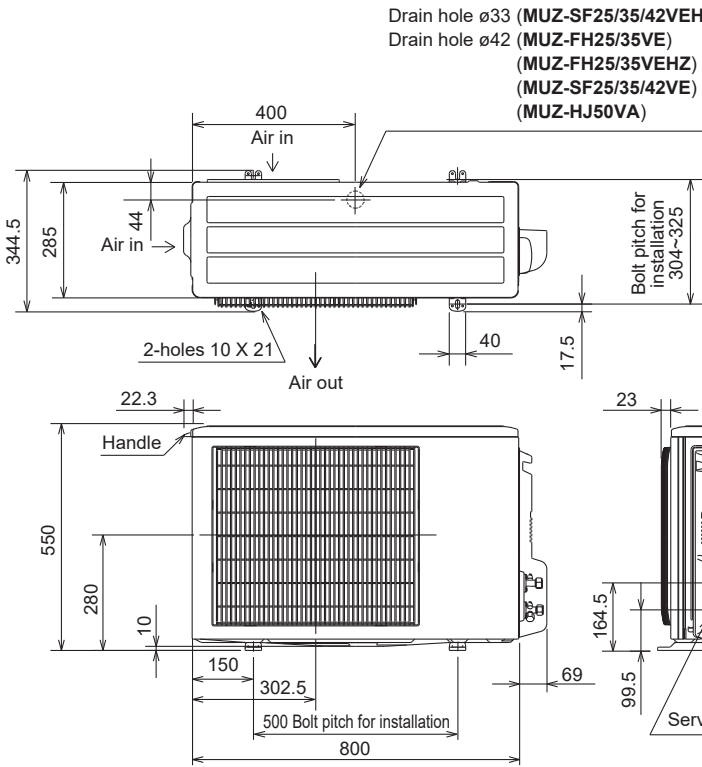


Unit: mm

MUZ-WN25VA MUZ-WN35VA
OUTDOOR UNIT

Necessary space of around the outdoor unit (Basic)

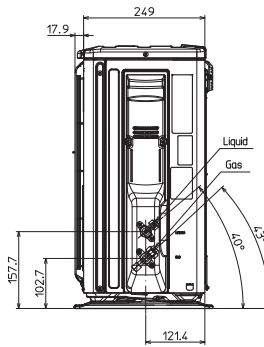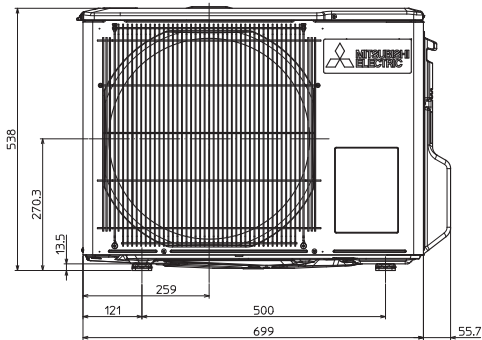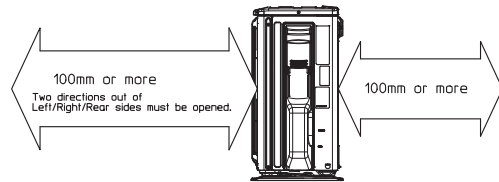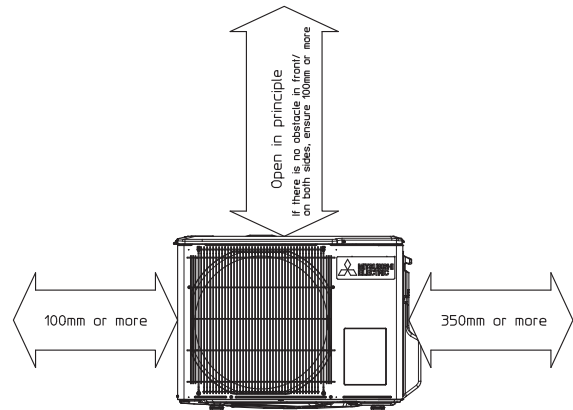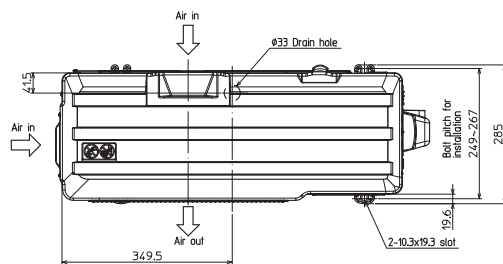

Rear view

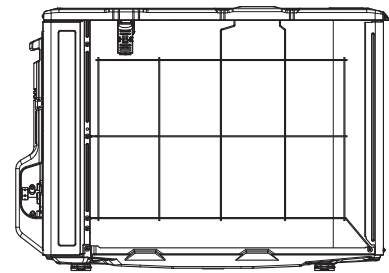


Refrigerant pipe joint	Liquid	Flared 6.35 (1/4")
	Gas	Flared 9.52 (3/8")

OUTLINES AND DIMENSIONS
WALL-MOUNTED

Unit: mm


MUZ-DM25VA MUZ-DM35VA
 MUZ-HJ25VA MUZ-HJ35VA

OUTDOOR UNIT


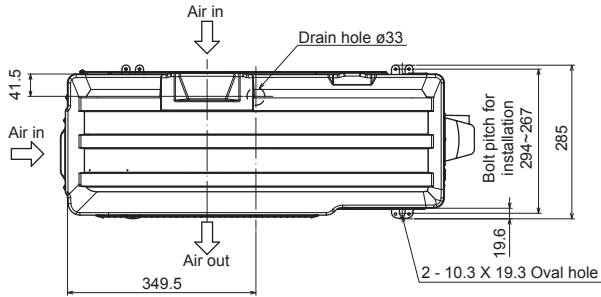


REQUIRED SPACE

*1 100 mm or more when front and sides of the unit are clear

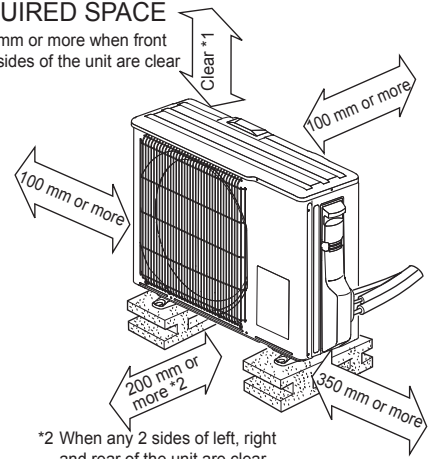


*2 When any 2 sides of left, right and rear of the unit are clear

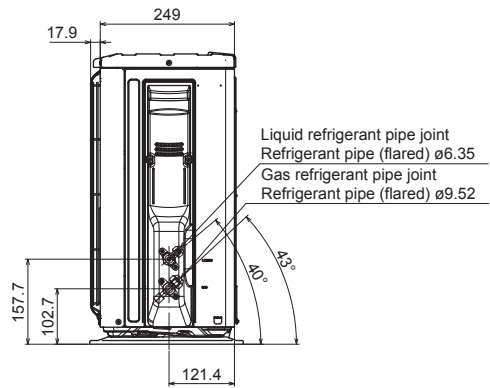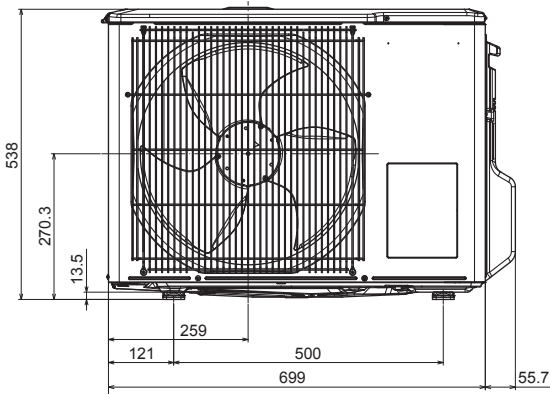

C.1.3 WIRING DIAGRAM

C.1.3.1 Indoor Unit


MSZ-LN18VGW MSZ-LN25VGW MSZ-LN35VGW MSZ-LN60VGW
 MSZ-LN18VGV MSZ-LN25VGV MSZ-LN35VGV MSZ-LN60VGV
 MSZ-LN18VGB MSZ-LN25VGB MSZ-LN35VGB MSZ-LN60VGB
 MSZ-LN18VGR MSZ-LN25VGR MSZ-LN35VGR MSZ-LN60VGR

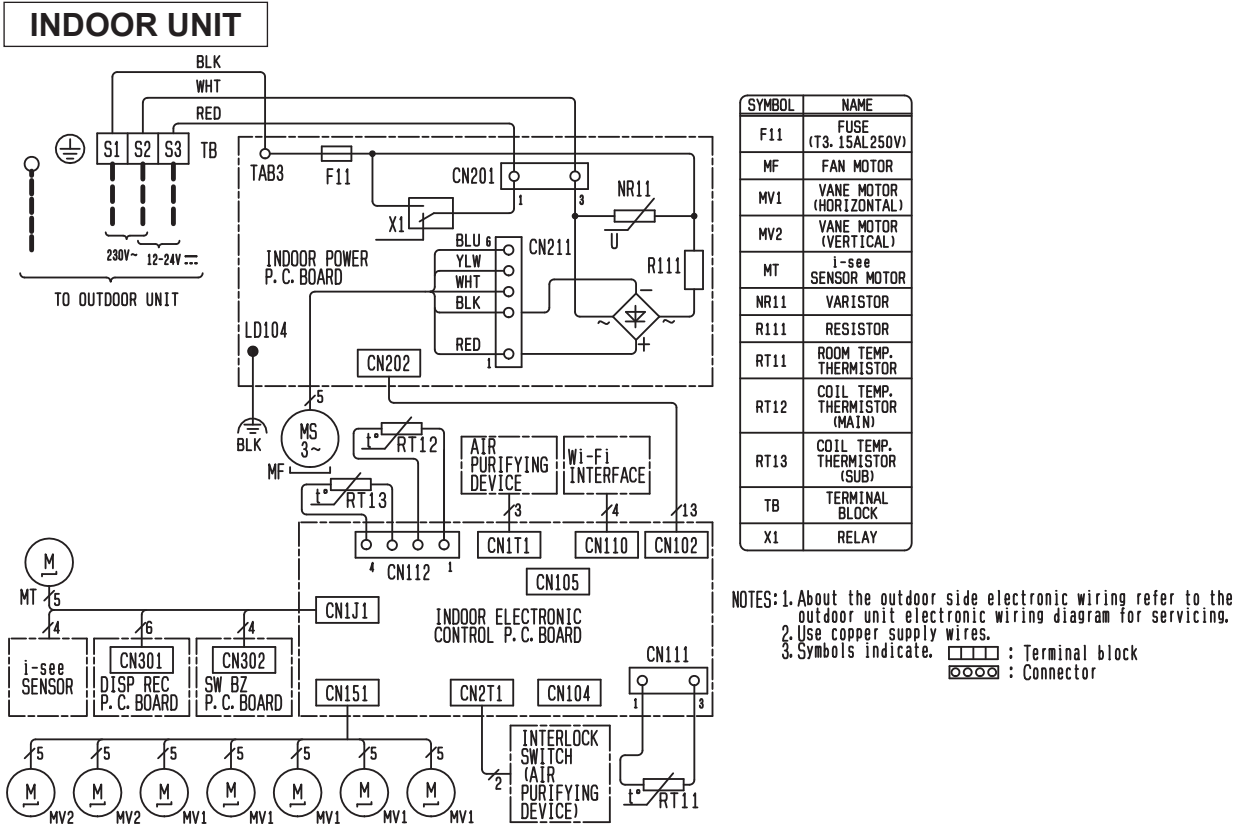

WALL-MOUNTED WIRING DIAGRAM

**MSZ-LN50VGW
MSZ-LN50GVV
MSZ-LN50VGB
MSZ-LN50VGR**

INDOOR UNIT

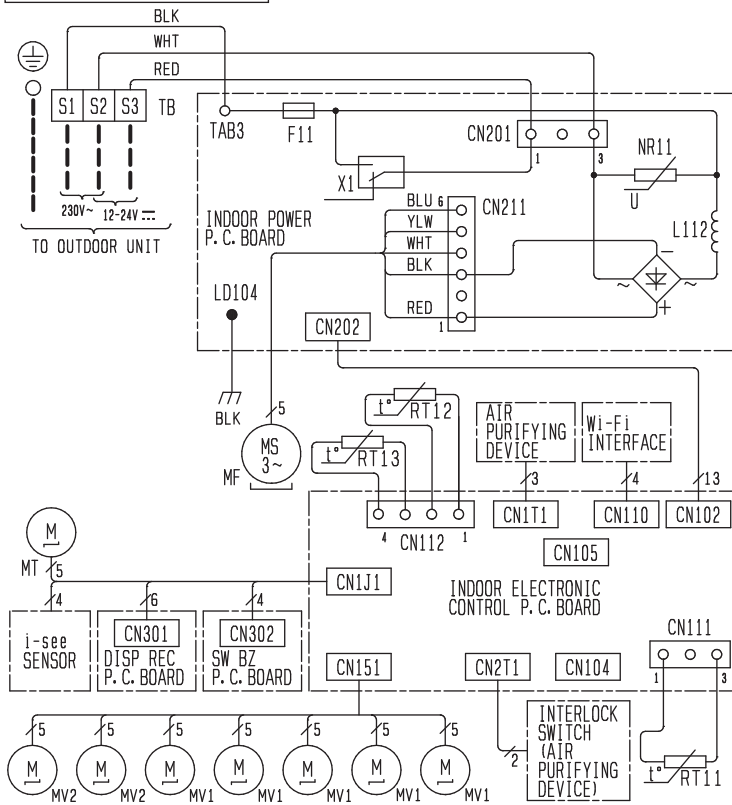


SYMBOL	NAME
F11	FUSE (T3. 15AL250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL)
MV2	VANE MOTOR (VERTICAL)
MT	i-see SENSOR MOTOR
NR11	VARISTOR
L112	REACTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
2. Use copper conductors only. (For field wiring)
3. Symbols indicate. □ : Terminal block
⊞ : Connector

MSZ-AP15VG MSZ-AP20VG

INDOOR UNIT

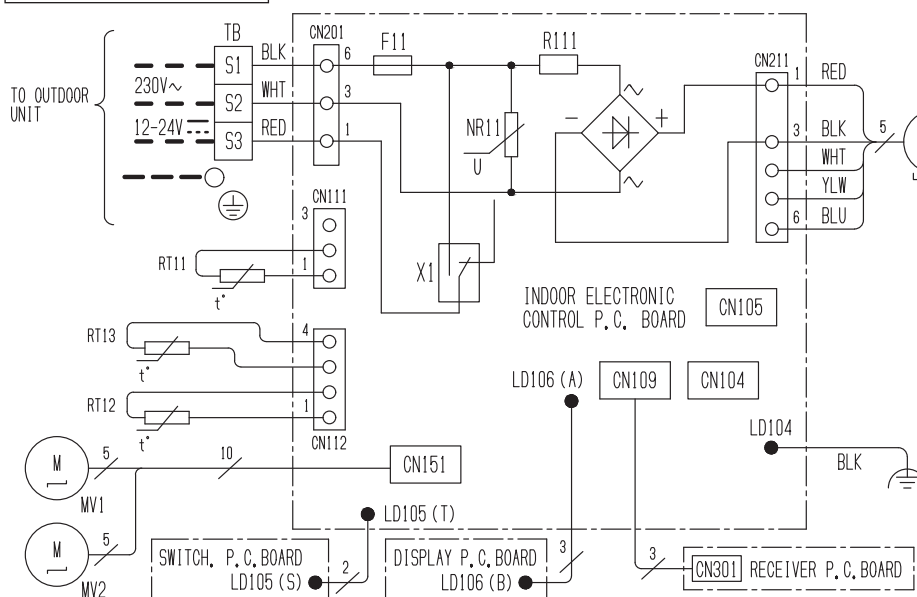


SYMBOL	NAME	SYMBOL	NAME
F11	FUSE (T3. 15AL250V)	RT11	ROOM TEMP. THERMISTOR
MF	FAN MOTOR	RT12	COIL TEMP. THERMISTOR (MAIN)
MV1	VANE MOTOR (HORIZONTAL UPPER)	RT13	COIL TEMP. THERMISTOR (SUB)
MV2	VANE MOTOR (HORIZONTAL LOWER)	TB	TERMINAL BLOCK
NR11	VARISTOR	R111	RESISTOR
X1	RELAY		

1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
2. Use copper supply wires.
3. Symbols indicate.
□ : Terminal block
⊞ : Connector

MSZ-AP25VG MSZ-AP35VG MSZ-AP42VG

INDOOR UNIT

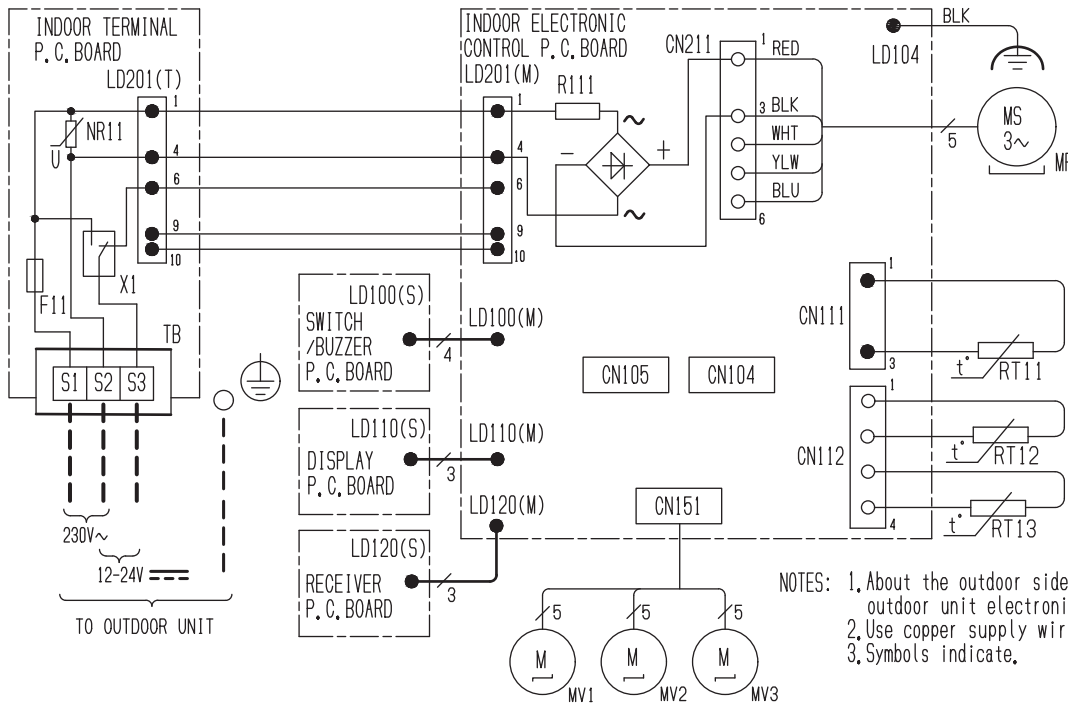


SYMBOL	NAME
F11	FUSE (T3, 15A/250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL UPPER)
MV2	VANE MOTOR (HORIZONTAL LOWER)
MV3	VANE MOTOR (VERTICAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate.

□□□□ : Terminal block
 ○○○○ : Connector

MSZ-AP25VGK MSZ-AP35VGK MSZ-AP42VGK

INDOOR UNIT

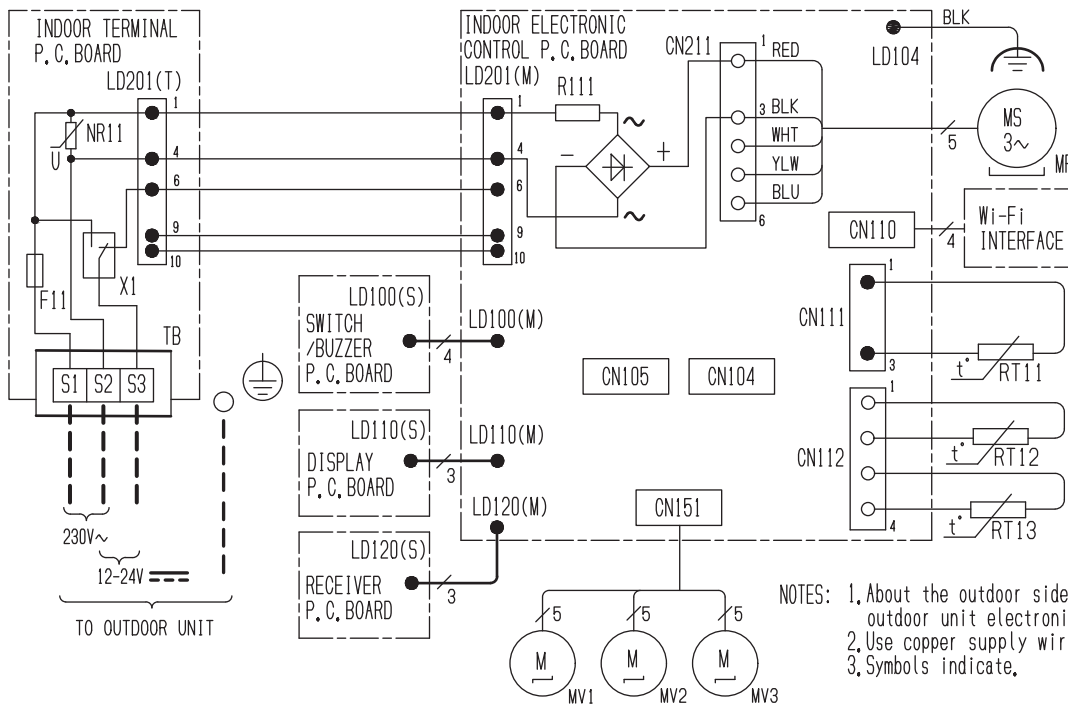


SYMBOL	NAME
F11	FUSE (T3, 15A/250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL UPPER)
MV2	VANE MOTOR (HORIZONTAL LOWER)
MV3	VANE MOTOR (VERTICAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate.

□□□□ : Terminal block
 ○○○○ : Connector

WALL-MOUNTED WIRING DIAGRAM

MSZ-AP50VG
INDOOR UNIT

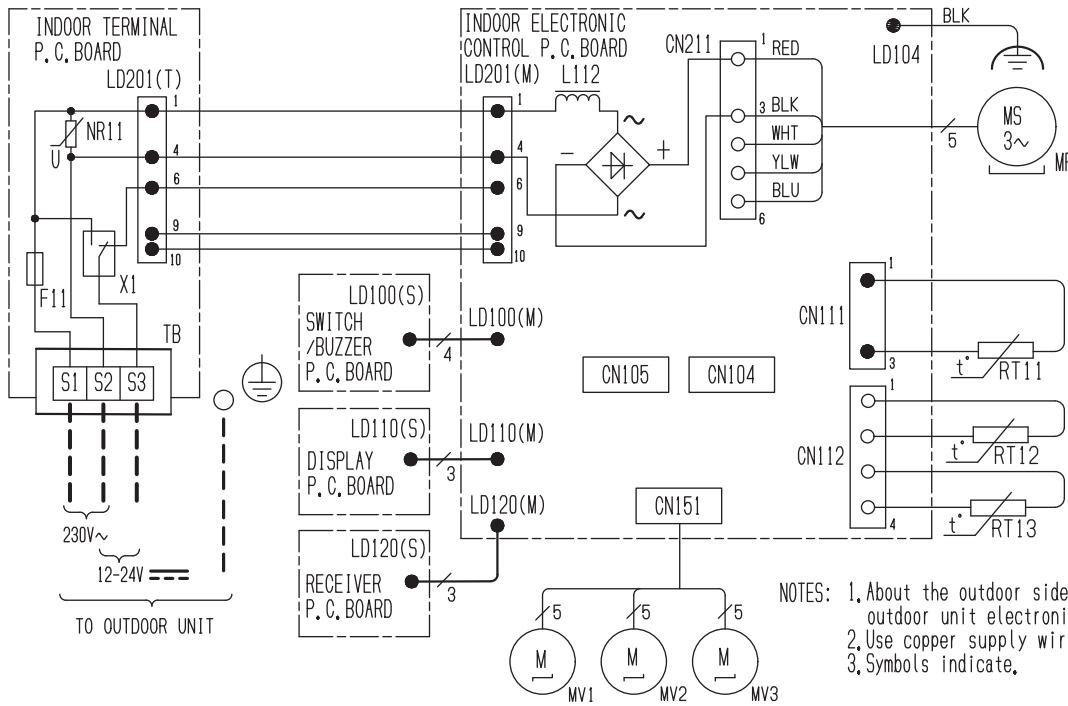


SYMBOL	NAME
F11	FUSE (T3, 15AL250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL UPPER)
MV2	VANE MOTOR (HORIZONTAL LOWER)
MV3	VANE MOTOR (VERTICAL)
NR11	VARISTOR
L112	REACTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
2. Use copper supply wires.
3. Symbols indicate.

□□□□ : Terminal block
○○○○ : Connector

MSZ-AP50VGK
INDOOR UNIT

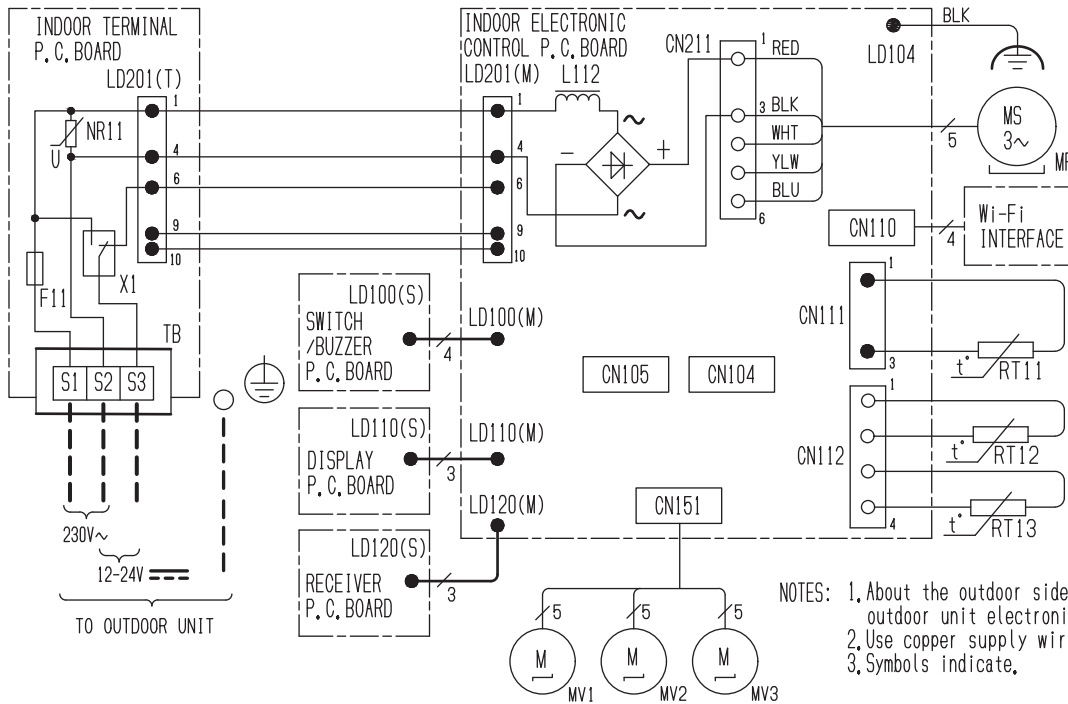


SYMBOL	NAME
F11	FUSE (T3, 15AL250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL UPPER)
MV2	VANE MOTOR (HORIZONTAL LOWER)
MV3	VANE MOTOR (VERTICAL)
NR11	VARISTOR
L112	REACTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
2. Use copper supply wires.
3. Symbols indicate.

□□□□ : Terminal block
○○○○ : Connector

MSZ-AP60VG MSZ-AP71VG


INDOOR UNIT

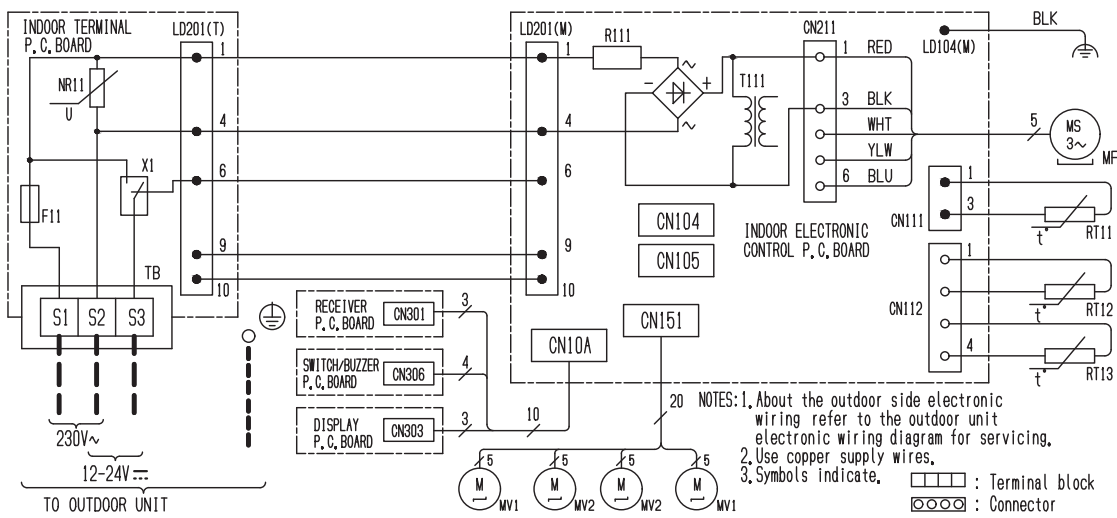

SYMBOL	NAME
F11	FUSE (T3, 15A/250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL)
MV2	VANE MOTOR (VERTICAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
X1	RELAY

MSZ-AP60VGK MSZ-AP71VGK

INDOOR UNIT

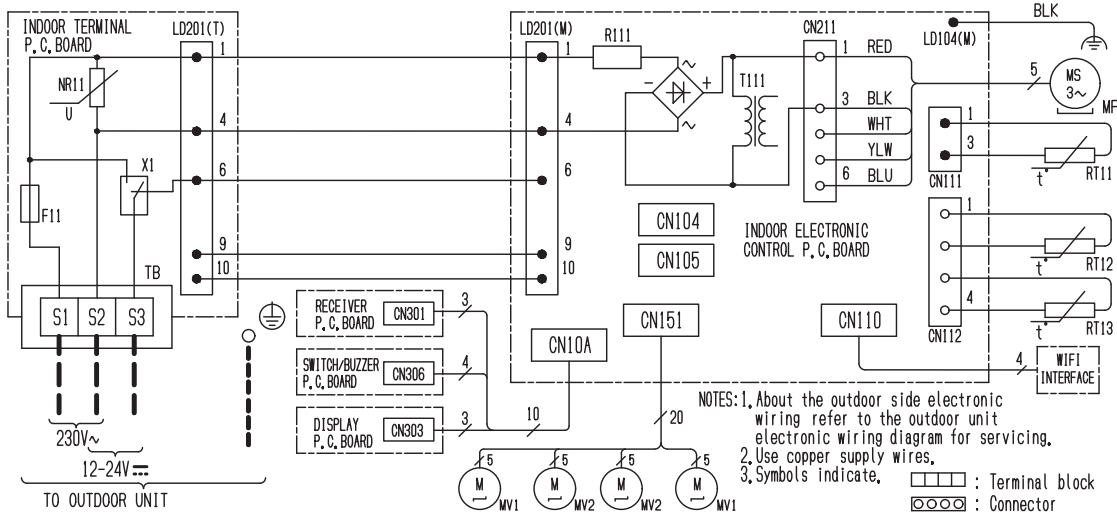


SYMBOL	NAME
F11	FUSE (T3, 15A/250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL)
MV2	VANE MOTOR (VERTICAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
X1	RELAY

WALL-MOUNTED WIRING DIAGRAM

MSZ-HR25VF MSZ-HR35VF MSZ-HR42VF MSZ-HR50VF

INDOOR UNIT

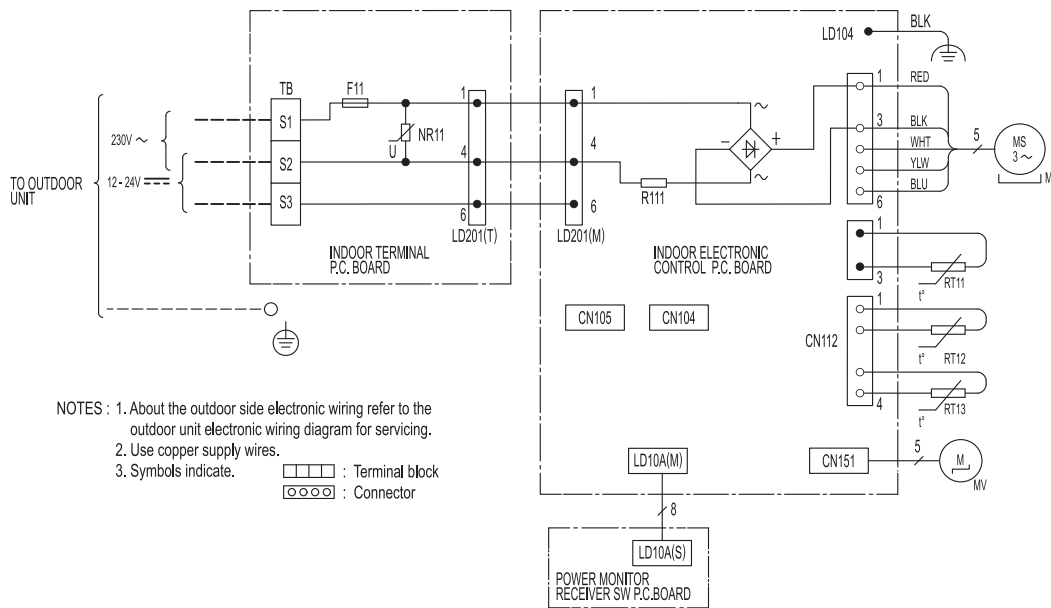


- NOTES : 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate.

□ □ □ □ : Terminal block
 ○ ○ ○ ○ : Connector

SYMBOL	NAME
F11	FUSE (T3, 15AL250V)
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
TB	TERMINAL BLOCK

MSY-TP35VF MSY-TP50VF

INDOOR UNIT

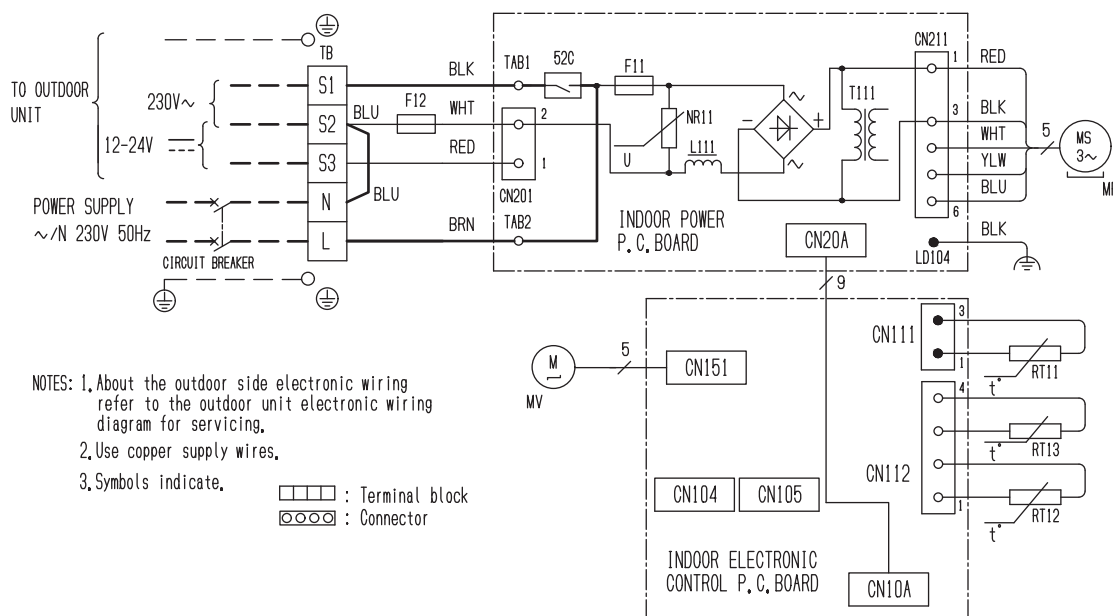


- NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate.

□ □ □ □ : Terminal block
 ○ ○ ○ ○ : Connector

SYMBOL	NAME
F11	FUSE (T3, 15AL250V)
F12	THERMAL FUSE (102°C 4.5A)
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
L111	REACTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
TAB1, TAB2	TAB
52C	CONTACTOR

MSZ-FH25VE2 MSZ-FH35VE2 MSZ-FH50VE2

INDOOR UNIT

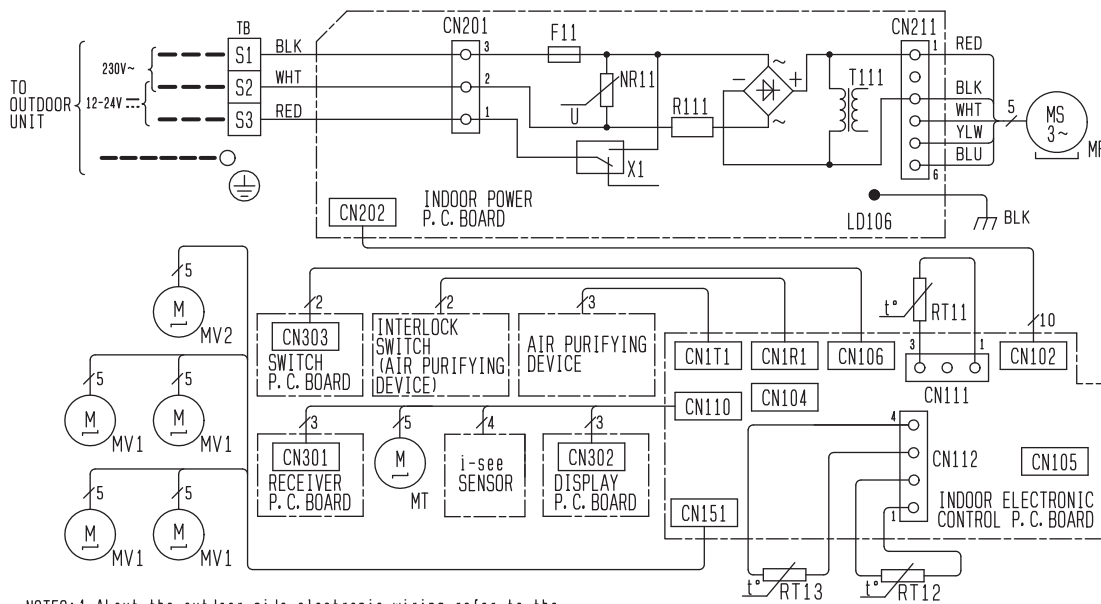


SYMBOL	NAME
F11	FUSE (T3, 15A/250V)
MF	FAN MOTOR
MV1	VANE MOTOR (HORIZONTAL)
MV2	VANE MOTOR (VERTICAL)
MT	i-see SENSOR MOTOR
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper conductors only.
 (For field wiring) □ : Terminal block
 3. Symbols indicate. ○ : Connector

MSZ-EF18VGW MSZ-EF22VGW MSZ-EF25VGW MSZ-EF35VGW MSZ-EF42VGW MSZ-EF50VGW
 MSZ-EF18VGB MSZ-EF22VGB MSZ-EF25VGB MSZ-EF35VGB MSZ-EF42VGB MSZ-EF50VGB
 MSZ-EF18VGS MSZ-EF22VGS MSZ-EF25VGS MSZ-EF35VGS MSZ-EF42VGS MSZ-EF50VGS

INDOOR UNIT

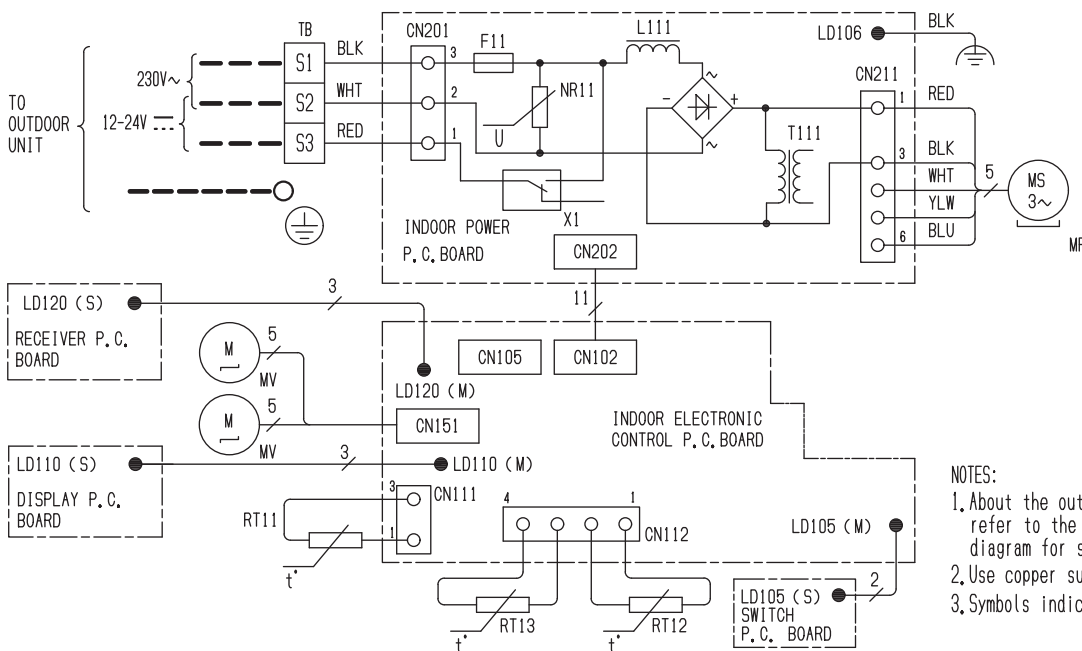


SYMBOL	NAME
F11	FUSE (T3, 15A/250V)
L111	REACTOR
MF	FAN MOTOR
MV	VANE MOTOR
NR11	VARISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
X1	RELAY

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper supply wires
 3. Symbols indicate. □ : Terminal block
 ○ : Connector

WALL-MOUNTED WIRING DIAGRAM


MSZ-SF15VA MSZ-SF20VA
INDOOR UNIT

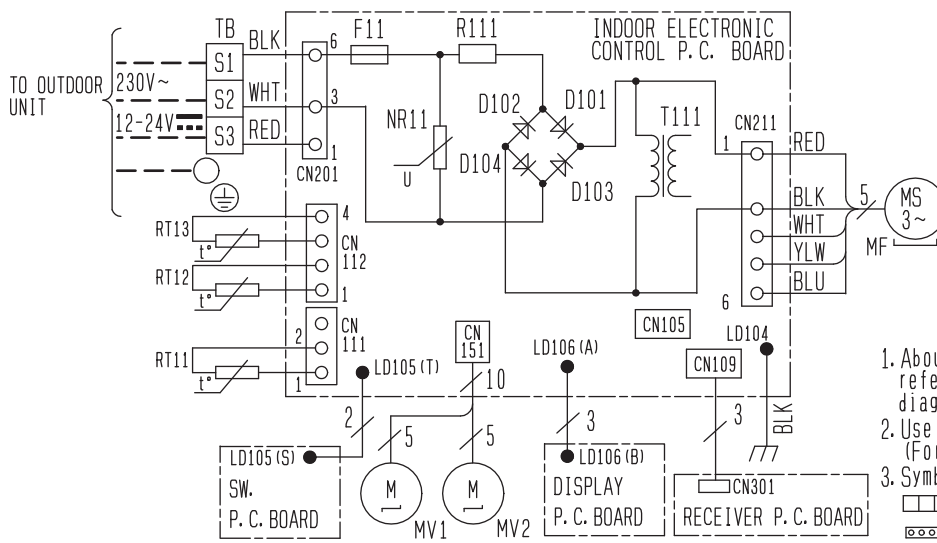

SYMBOL	NAME	SYMBOL	NAME
D101~D104	DIODE	RT11	ROOM TEMP. THERMISTOR
F11	FUSE (T3. 15A/250V)	RT12	COIL TEMP. THERMISTOR (MAIN)
MF	FAN MOTOR	RT13	COIL TEMP. THERMISTOR (SUB)
MV1	VANE MOTOR (HORIZONTAL)	T111	TRANSFORMER
MV2	VANE MOTOR (HORIZONTAL)	TB	TERMINAL BLOCK
NR11	VARISTOR	R111	RESISTOR

1. About the outdoor side electric wiring refer to the outdoor unit electric wiring diagram for servicing.
2. Use copper conductors only. (For field wiring)
3. Symbols below indicate.
 : Terminal block
 : Connector

MSZ-SF25VE3 MSZ-SF42VE3
INDOOR UNIT

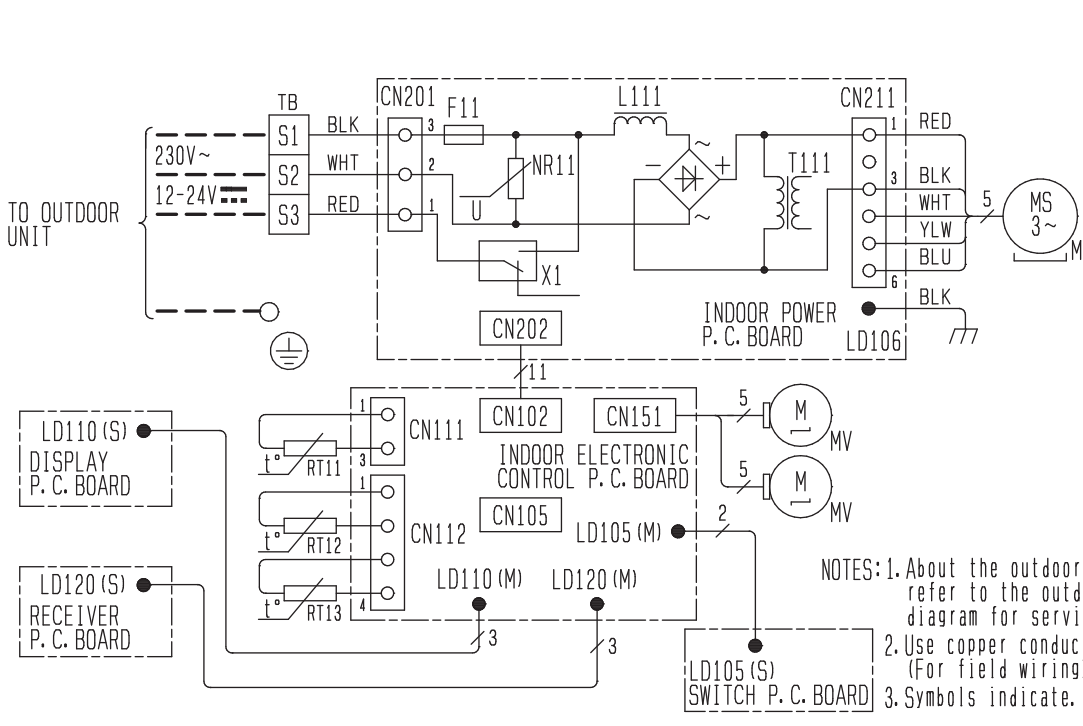


SYMBOL	NAME
F11	FUSE (T3. 15A/250V)
L111	REACTOR
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
X1	RELAY

- NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
2. Use copper conductors only. (For field wiring)
 3. Symbols indicate.
 : Terminal block
 : Connector


MSZ-SF35VE3 MSZ-SF50VE3

INDOOR UNIT

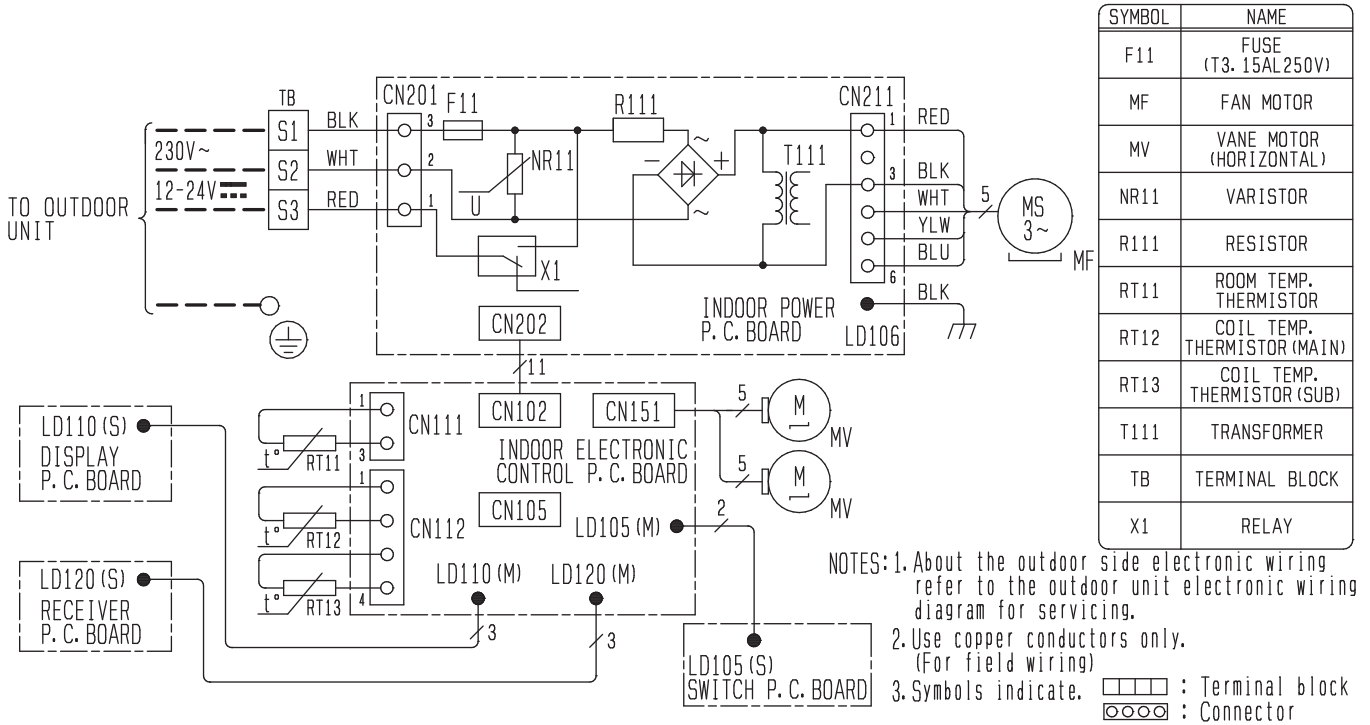


MSZ-GF60VE2 MSZ-GF71VE2

INDOOR UNIT

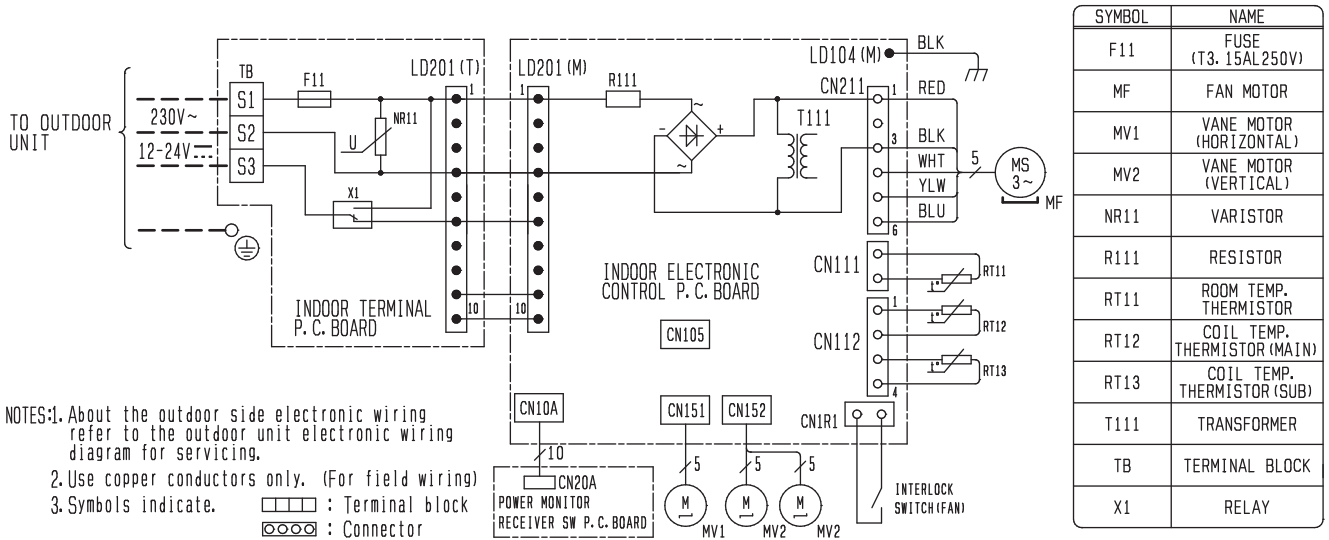

MSZ-WN25VA MSZ-WN35VA

INDOOR UNIT

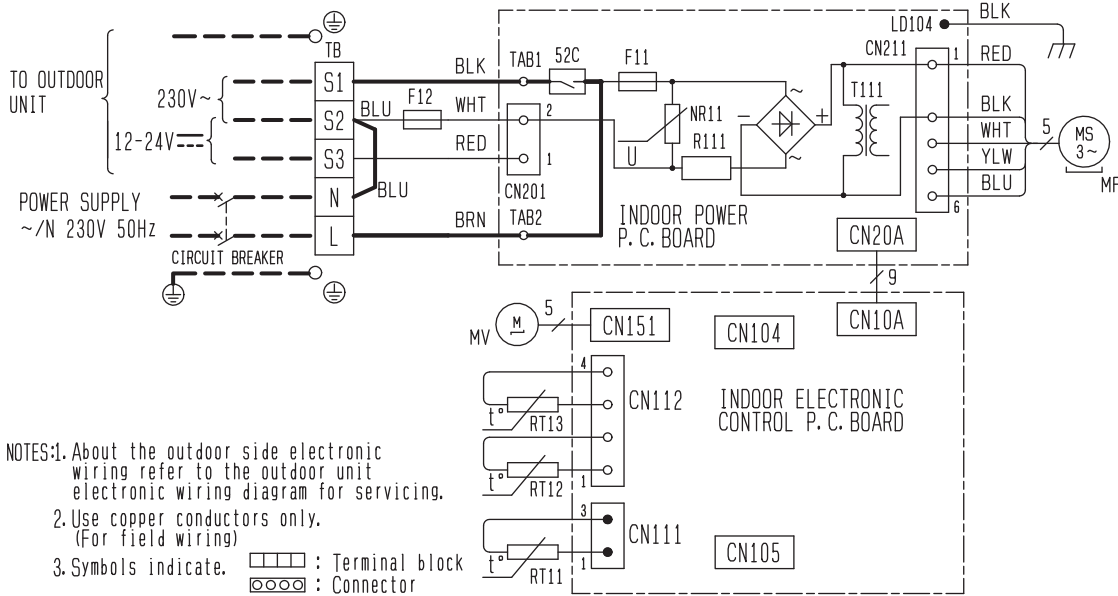


SYMBOL	NAME
F11	FUSE (T3. 15AL250V)
F12	THERMAL FUSE (102°C 5A)
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
52C	CONTACTOR
TAB1, TAB2	TAB

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper conductors only. (For field wiring)
 3. Symbols indicate. □ : Terminal block
○ : Connector

MSZ-DM25VA MSZ-DM35VA

INDOOR UNIT

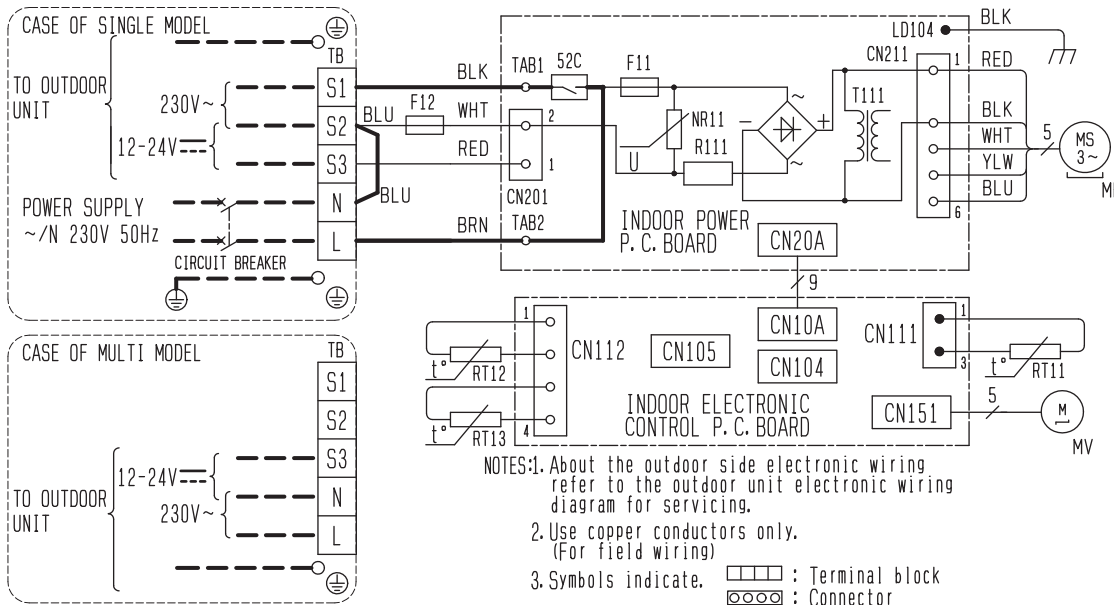


SYMBOL	NAME
F11	FUSE (T3. 15AL250V)
F12	THERMAL FUSE (102°C 5A)
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
52C	CONTACTOR
TAB1, TAB2	TAB

NOTES: 1. About the outdoor side electronic wiring refer to the outdoor unit electronic wiring diagram for servicing.
 2. Use copper conductors only. (For field wiring)
 3. Symbols indicate. □ : Terminal block
○ : Connector

MSZ-HJ25VA MSZ-HJ35VA MSZ-HJ50VA


INDOOR UNIT

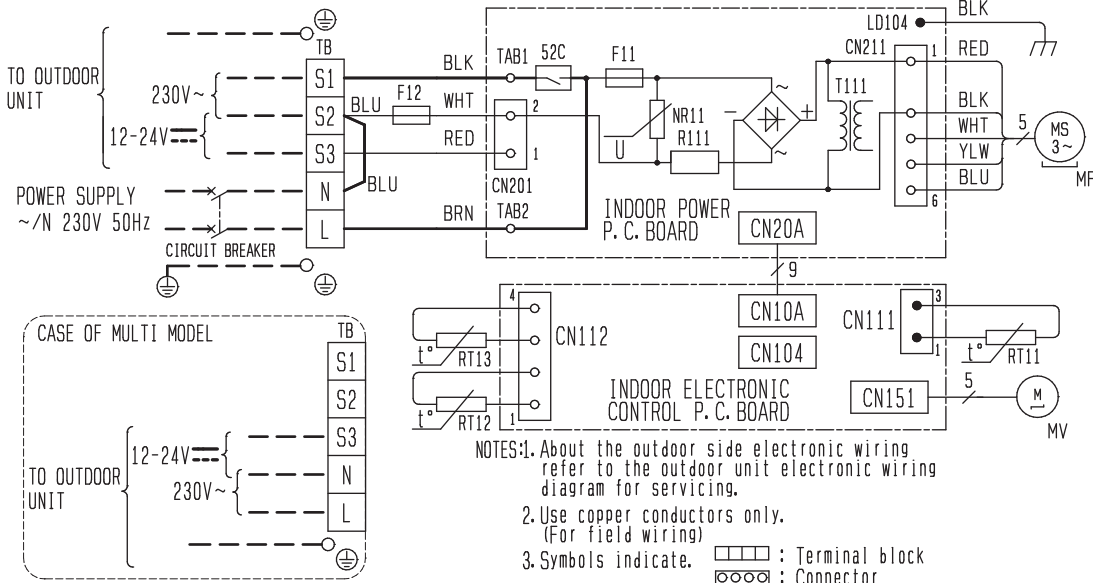

SYMBOL	NAME
F11	FUSE (T3. 15AL 250V)
F12	THERMAL FUSE (102°C 5A)
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
R111	RESISTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
52C	CONTACTOR
TAB1, TAB2	TAB

MSZ-HJ60VA MSZ-HJ71VA

INDOOR UNIT

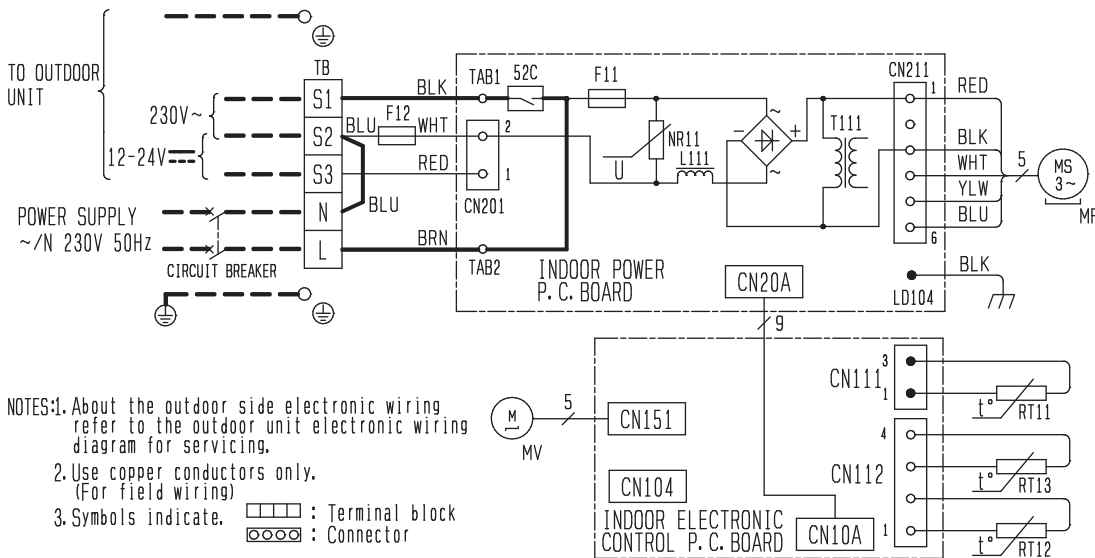


SYMBOL	NAME
F11	FUSE (T3. 15AL 250V)
F12	THERMAL FUSE (102°C 4.5A)
MF	FAN MOTOR
MV	VANE MOTOR (HORIZONTAL)
NR11	VARISTOR
L111	REACTOR
RT11	ROOM TEMP. THERMISTOR
RT12	COIL TEMP. THERMISTOR (MAIN)
RT13	COIL TEMP. THERMISTOR (SUB)
T111	TRANSFORMER
TB	TERMINAL BLOCK
TAB1, TAB2	TAB
52C	CONTACTOR

WALL-MOUNTED WIRING DIAGRAM

C.1.3.2 Outdoor Unit
MUZ-LN25VG MUZ-LN35VG


OUTDOOR UNIT

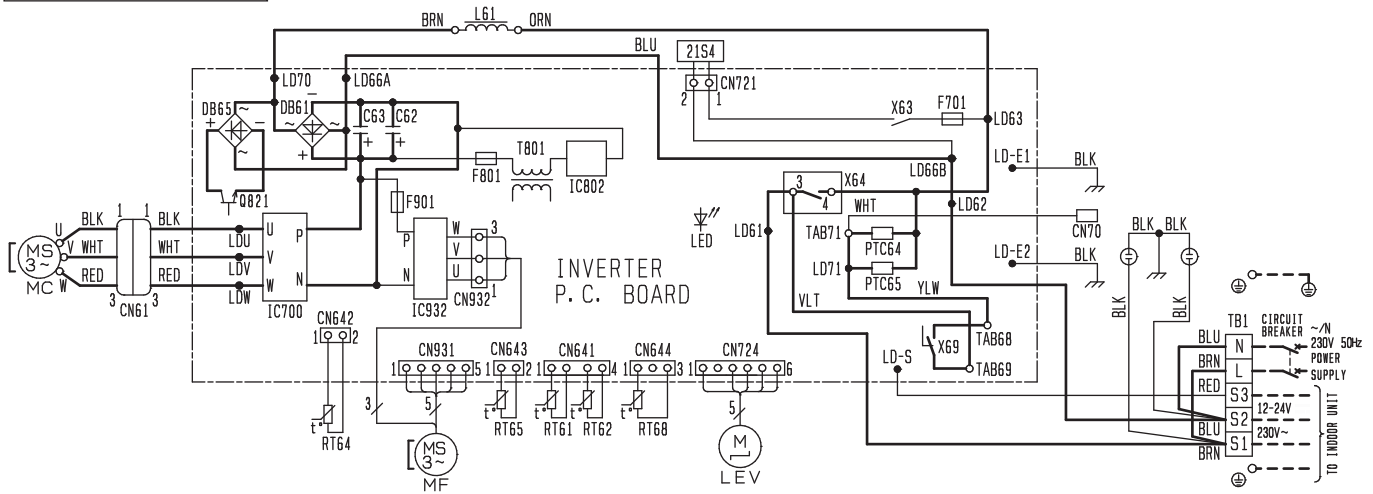

- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	L61	REACTOR	RT64	FIN TEMP. THERMISTOR
C62, C63	SMOOTHING CAPACITOR	MC	COMPRESSOR	RT65	AMBIENT TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MF	FAN MOTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F701, F801, F901	FUSE (T3: 15A/250V)	PTC64, PTC65	CIRCUIT PROTECTION	TB1	TERMINAL BLOCK
IC700, IC932	POWER MODULE	Q821	SWITCHING POWER TRANSISTOR	T801	TRANSFORMER
IC802	POWER DEVICE	RT61	DEFROST THERMISTOR	X63, X64	RELAY
LED	LED	RT62	DISCHARGE TEMP. THERMISTOR	21S4	REVERSING VALVE COIL
LEV	EXPANSION VALVE COIL				


MUZ-LN25VGHZ
OUTDOOR UNIT

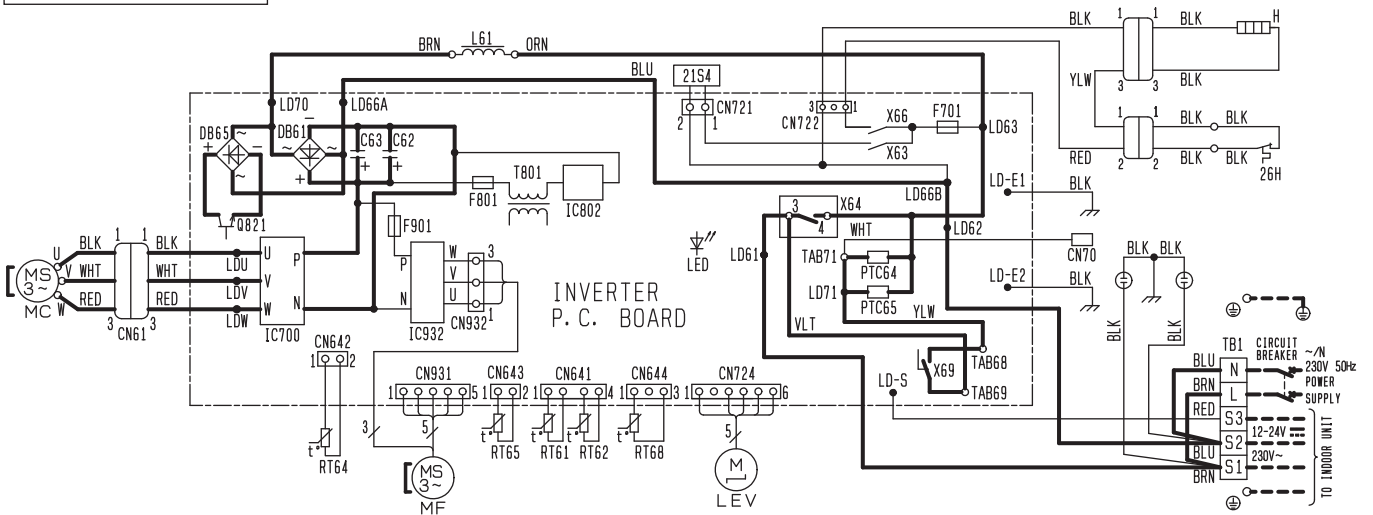

- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
C62, C63	SMOOTHING CAPACITOR	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MF	FAN MOTOR	TB1	TERMINAL BLOCK
F701, F801, F901	FUSE (T3: 15A/250V)	PTC64, PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER
H	DEFROST HEATER	Q821	SWITCHING POWER TRANSISTOR	X63, X64	RELAY
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	X66, X69	RELAY
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR	21S4	REVERSING VALVE COIL
LED	LED	RT64	FIN TEMP. THERMISTOR	26H	HEATER PROTECTOR

MUZ-LN35VGHZ
OUTDOOR UNIT

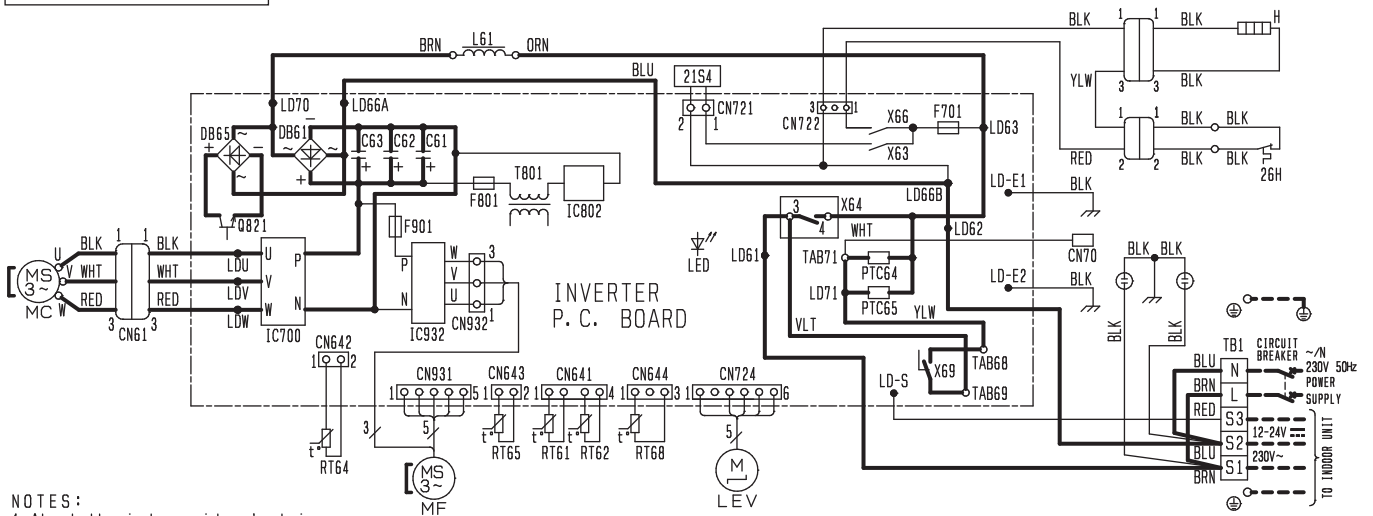


NOTES:

- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
- Use copper supply wires.
- Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
DB61, DB65	DIODE MODULE	MF	FAN MOTOR	TB1	TERMINAL BLOCK
F701, F801, F901	FUSE (T3, 15A/250V)	PTC64, PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER
H	DEFROST HEATER	Q821	SWITCHING POWER TRANSISTOR	X63, X64	RELAY
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	X66, X69	RELAY
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR	21S4	REVERSING VALVE COIL
LED	LED	RT64	FIN TEMP. THERMISTOR	26H	HEATER PROTECTOR

MUZ-LN50VG
OUTDOOR UNIT

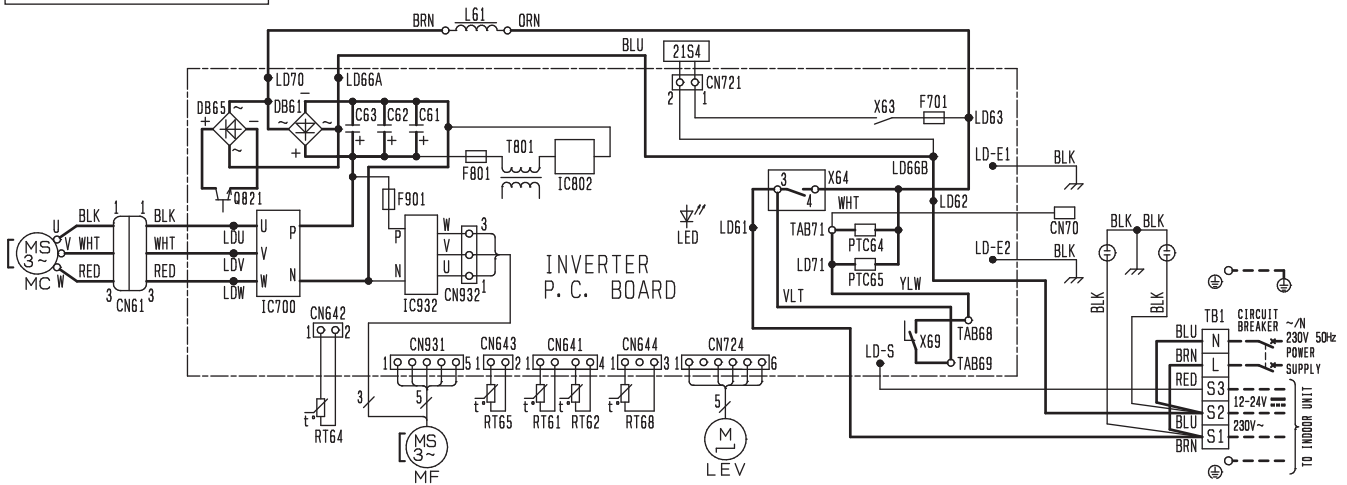


NOTES:

- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
- Use copper supply wires.
- Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	L61	REACTOR	RT64	FIN TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	MC	COMPRESSOR	RT65	AMBIENT TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MF	FAN MOTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
F701, F801, F901	FUSE (T3, 15A/250V)	PTC64, PTC65	CIRCUIT PROTECTION	TB1	TERMINAL BLOCK
IC700, IC932	POWER MODULE	Q821	SWITCHING POWER TRANSISTOR	T801	TRANSFORMER
IC802	POWER DEVICE	RT61	DEFROST THERMISTOR	X63, X64, X69	RELAY
LED	LED	RT62	DISCHARGE TEMP. THERMISTOR	21S4	REVERSING VALVE COIL
LEV	EXPANSION VALVE COIL				

MUZ-LN50VGHZ
OUTDOOR UNIT

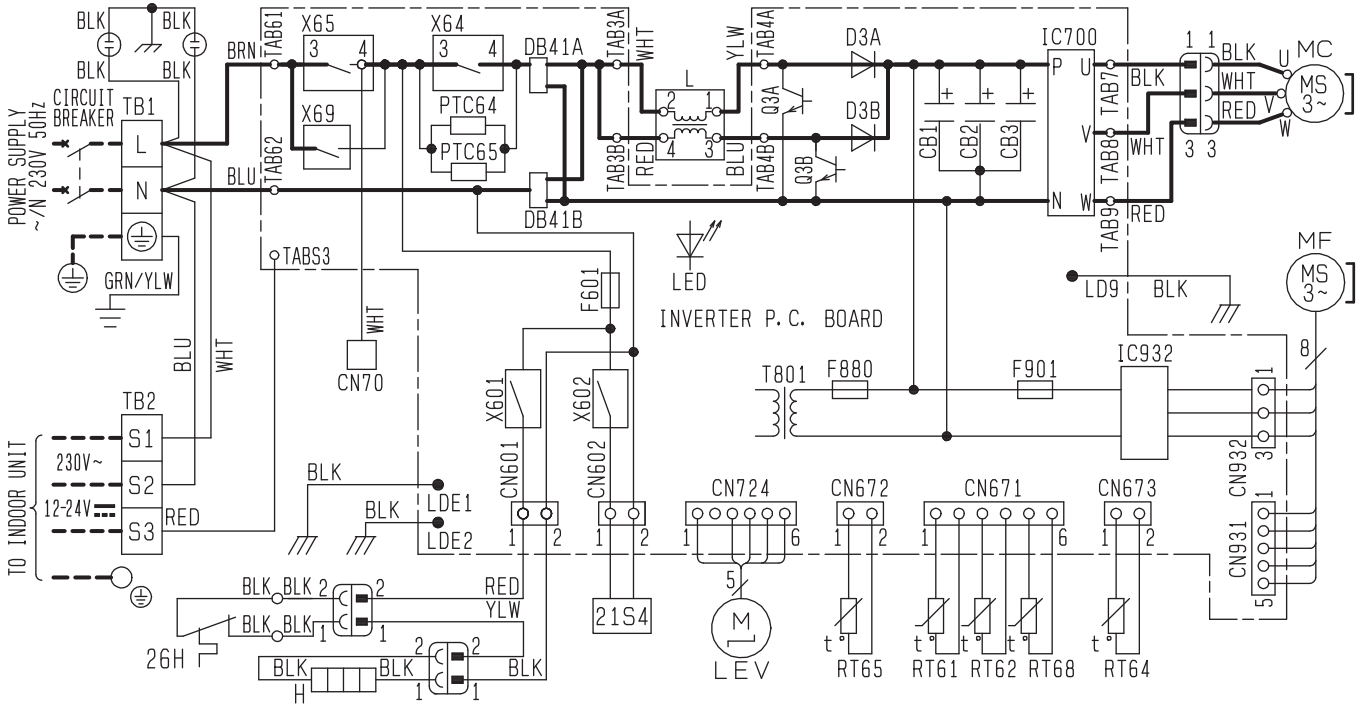


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1, CB2, CB3	SMOOTHING CAPACITOR	IC700, IC932	POWER MODULE	Q3A, Q3B	SWITCHING POWER TRANSISTOR	TB1, TB2	TERMINAL BLOCK
DB41A, DB41B	DIODE MODULE	L	REACTOR	RT61	DEFROST THERMISTOR	T801	TRANSFORMER
D3A, D3B	DIODE	LED	LED	RT62	DISCHARGE TEMP. THERMISTOR	X64, X65, X69	RELAY
F601	FUSE (T3. 15A/250V)	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR	X601, X602	RELAY
F880	FUSE (T3. 15A/250V)	MC	COMPRESSOR	RT65	AMBIENT TEMP. THERMISTOR	21S4	REVERSING VALVE COIL
F901	FUSE (T3. 15A/250V)	MF	FAN MOTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR	26H	HEATER PROTECTOR
H	DEFROST HEATER	PTC64, PTC65	CIRCUIT PROTECTION				

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
2. Use copper supply wires. 3. Symbols indicate, :Terminal block :Connector

MUZ-LN60VG

OUTDOOR UNIT

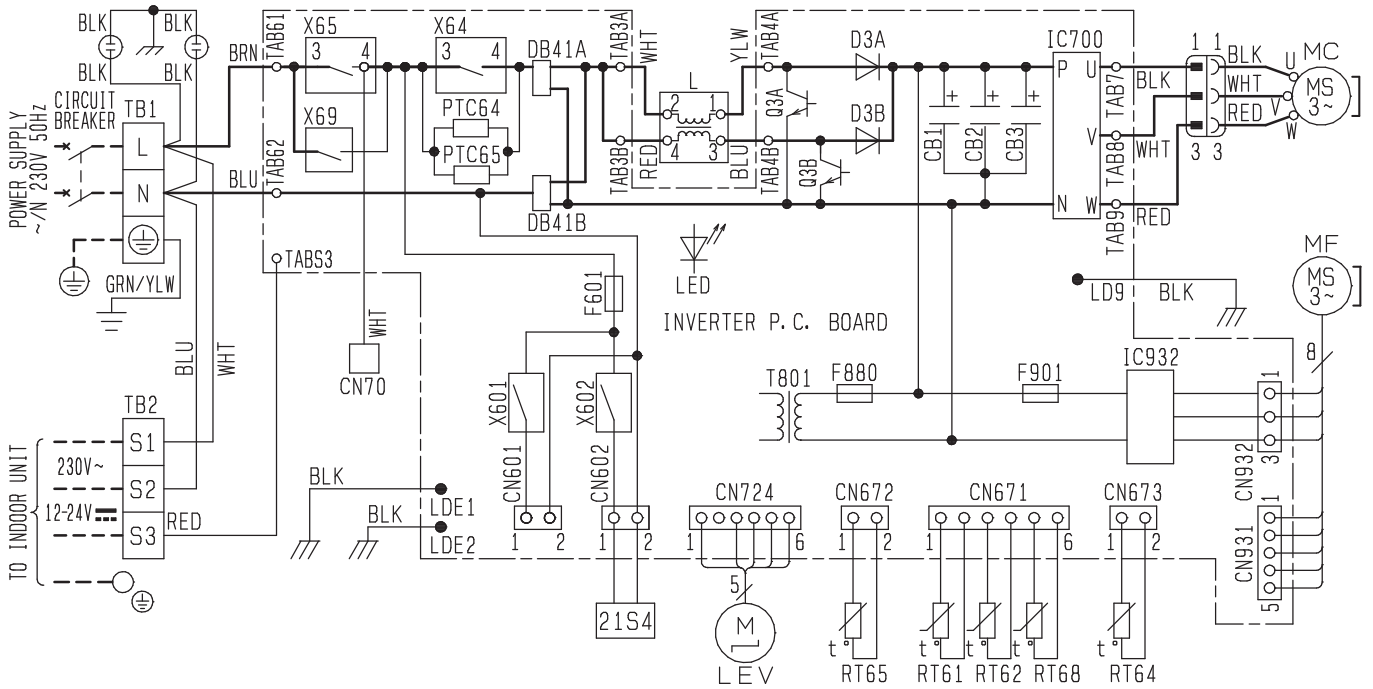


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1, CB2, CB3	SMOOTHING CAPACITOR	L	REACTOR	RT61	DEFROST THERMISTOR	T801	TRANSFORMER
DB41A, DB41B	DIODE MODULE	LED	LED	RT62	DISCHARGE TEMP. THERMISTOR	X64, X65, X69	RELAY
D3A, D3B	DIODE	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR	X601, X602	RELAY
F601	FUSE (T3, 15A/250V)	MC	COMPRESSOR	RT65	AMBIENT TEMP. THERMISTOR	21S4	REVERSING VALVE COIL
F880	FUSE (T3, 15A/250V)	MF	FAN MOTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR		
F901	FUSE (T3, 15A/250V)	PTC64, PTC65	CIRCUIT PROTECTION				
IC700, IC932	POWER MODULE	Q3A, Q3B	SWITCHING POWER TRANSISTOR	TB1, TB2	TERMINAL BLOCK		

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires. 3. Symbols indicate, : Terminal block : Connector

MUZ-AP20VG


OUTDOOR UNIT

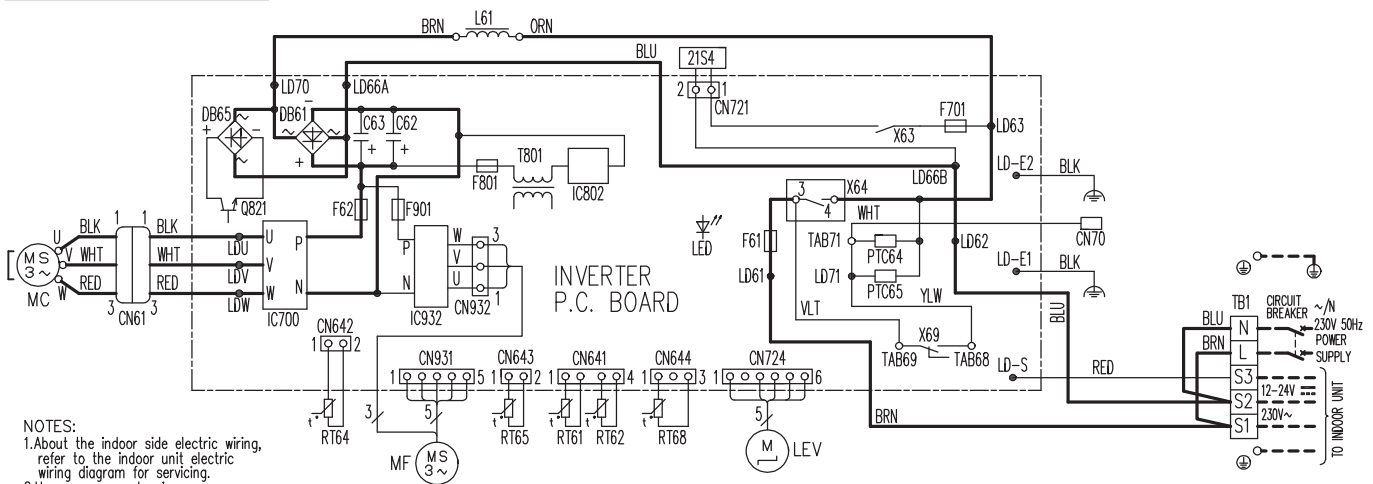

NOTES: 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate, : Terminal block : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X69	RELAY
F701, F801, F901	FUSE (T3, 15A/250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		


MUZ-AP25VG MUZ-AP35VG
OUTDOOR UNIT

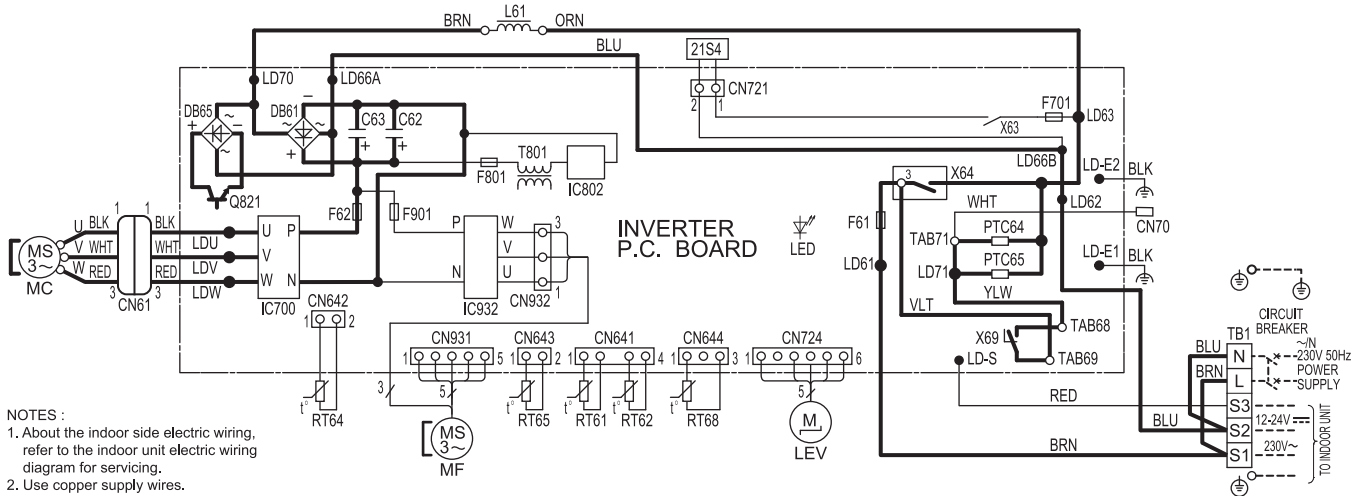

- NOTES :
1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate, : Terminal block
 : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C62,C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64,PTC65	CIRCUIT PROTECTION	X63,X64,X69	RELAY
F701,F801,F901	FUSE (T3, 15AL250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700,IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-AP25VGH MUZ-AP35VGH
OUTDOOR UNIT

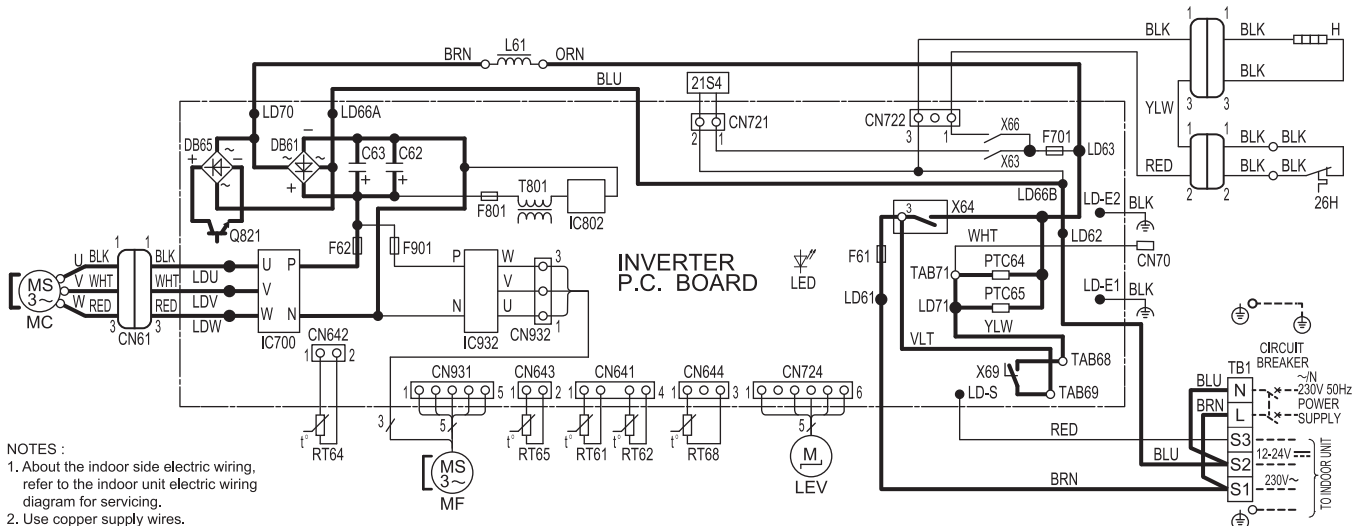


- NOTES :
1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate, : Terminal block
 : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR
C62,C63	SMOOTHING CAPACITOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F61	FUSE (25A 250V)	MF	FAN MOTOR	TB1	TERMINAL BLOCK
F62	FUSE (15A 250V)	PTC64,PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER
F701,F801,F901	FUSE (T3, 15AL250V)	Q821	SWITCHING POWER TRANSISTOR	X63,X64,X66,X69	RELAY
H	DEFROST HEATER	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC700,IC932	POWER MODULE	RT62	DISCHARGE TEMP. THERMISTOR		
IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR	26H	HEATER PROTECTOR

WALL-MOUNTED WIRING DIAGRAM


MUZ-AP42VG
OUTDOOR UNIT

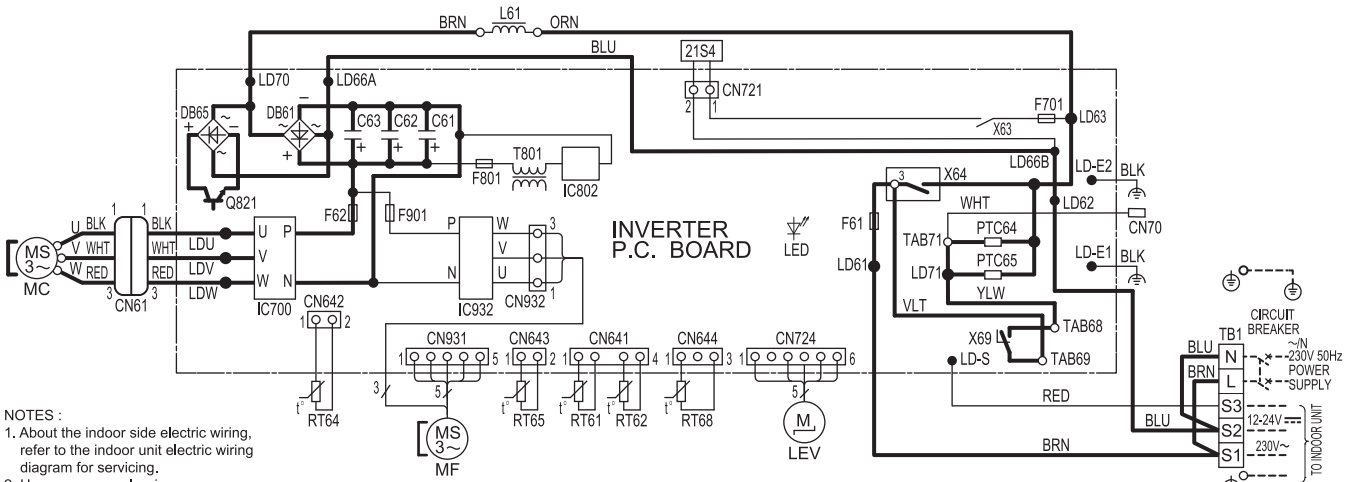

- NOTES :
- About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61,C62,C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T81	TRANSFORMER
F62	FUSE (15A 250V)	PTC64,PTC65	CIRCUIT PROTECTION	X63,X64,X69	RELAY
F701,F801,F901	FUSE (T3, 15AL250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700,IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-AP42VGH
OUTDOOR UNIT

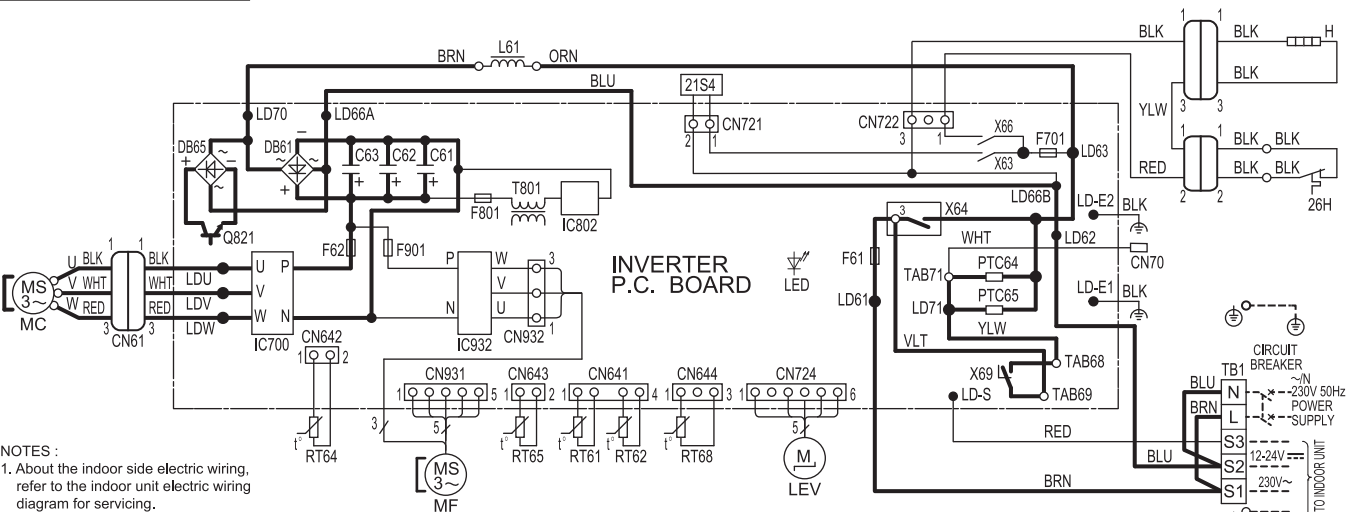


- NOTES :
- About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR
C61,C62,C63	SMOOTHING CAPACITOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F61	FUSE (25A 250V)	MF	FAN MOTOR	TB1	TERMINAL BLOCK
F62	FUSE (15A 250V)	PTC64,PTC65	CIRCUIT PROTECTION	T81	TRANSFORMER
F701,F801,F901	FUSE (T3, 15AL250V)	Q821	SWITCHING POWER TRANSISTOR	X63,X64,X66,X69	RELAY
H	DEFROST HEATER	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC700,IC932	POWER MODULE	RT62	DISCHARGE TEMP. THERMISTOR		
IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR	26H	HEATER PROTECTOR

WIRING DIAGRAM WALL-MOUNTED


MUZ-AP50VG
OUTDOOR UNIT

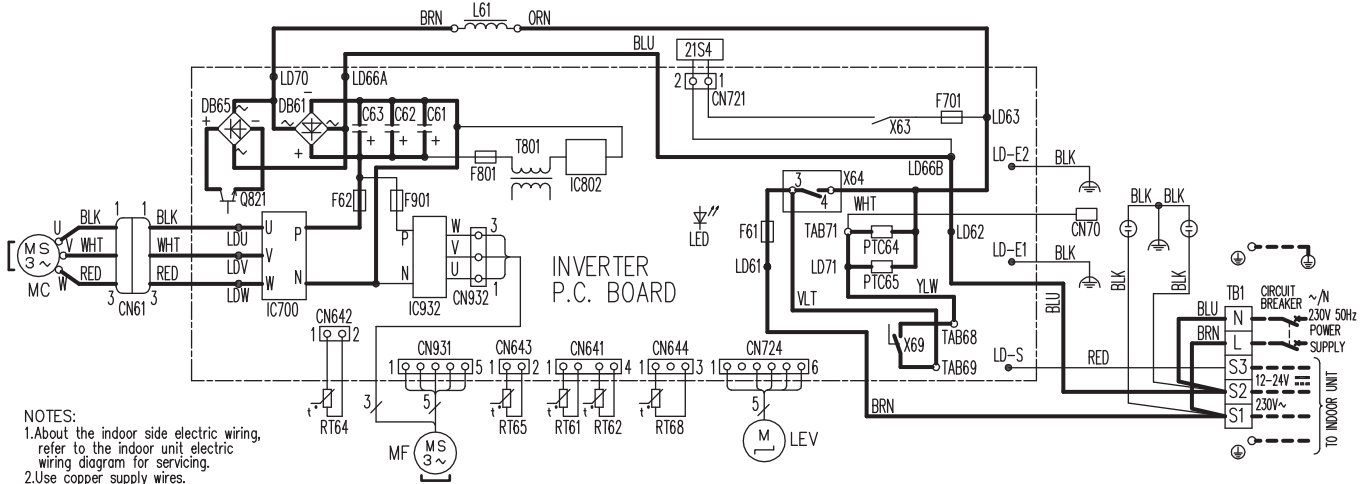

- NOTES:
 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2.Use copper supply wires.
 3.Symbols indicate, □ : Terminal block
○ : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61,C62,C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64,PTC65	CIRCUIT PROTECTION	X63,X64,X69	RELAY
F701,F801,F901	FUSE (T3.15AL250V)	Q821	SWITCHING POWER TRANSISTOR	Z1S4	REVERSING VALVE COIL
IC700,IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-AP50VGH
OUTDOOR UNIT

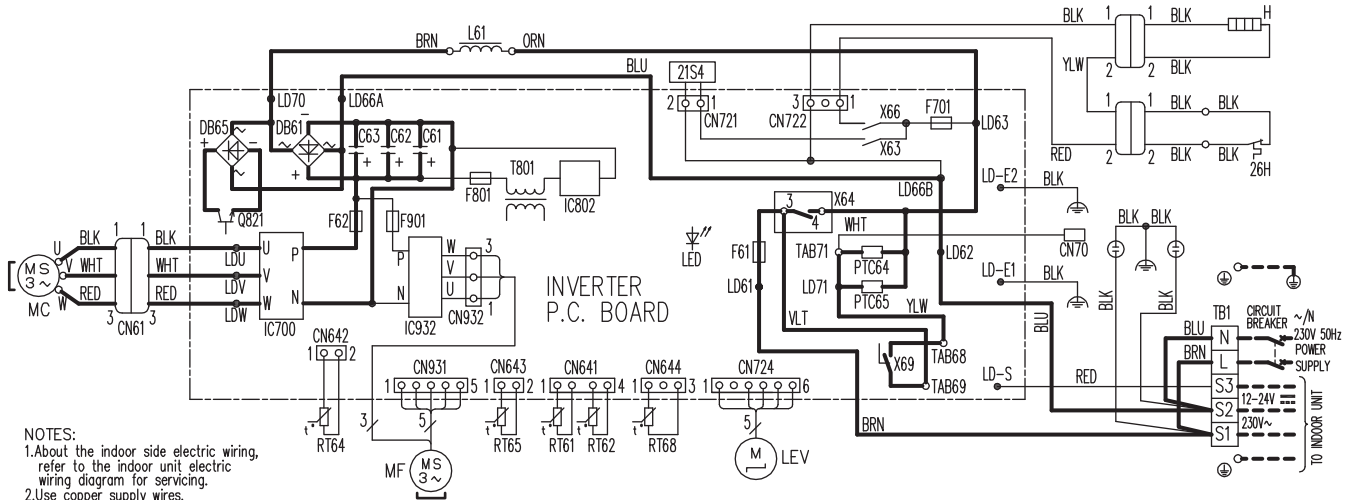


- NOTES:
 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2.Use copper supply wires.
 3.Symbols indicate, □ : Terminal block
○ : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR
C61,C62,C63	SMOOTHING CAPACITOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F61	FUSE (25A 250V)	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F62	FUSE (15A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F701,F801,F901	FUSE (T3.15AL250V)	PTC64,PTC65	CIRCUIT PROTECTION	X63,X64,X66,X69	RELAY
H	DEFROST HEATER	Q821	SWITCHING POWER TRANSISTOR	Z1S4	REVERSING VALVE COIL
IC700,IC932	POWER MODULE	RT61	DEFROST THERMISTOR	26H	HEATER PROTECTOR
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		

WALL-MOUNTED WIRING DIAGRAM


MUZ-AP60VG
OUTDOOR UNIT

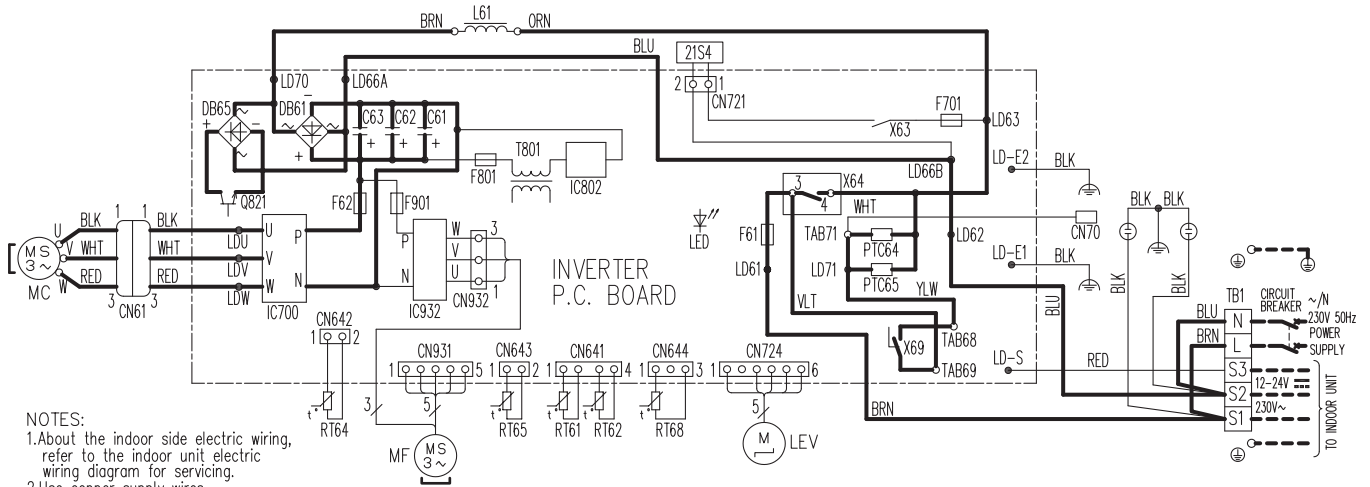

- NOTES:
 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2.Use copper supply wires.
 3.Symbols indicate, : Terminal block
 : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	RT61	DEFROST THERMISTOR
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X69	RELAY
F701, F801, F901	FUSE (T3.15AL250V)	Q821	SWITCHING POWER TRANSISTOR	Z1S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-AP71VG
OUTDOOR UNIT

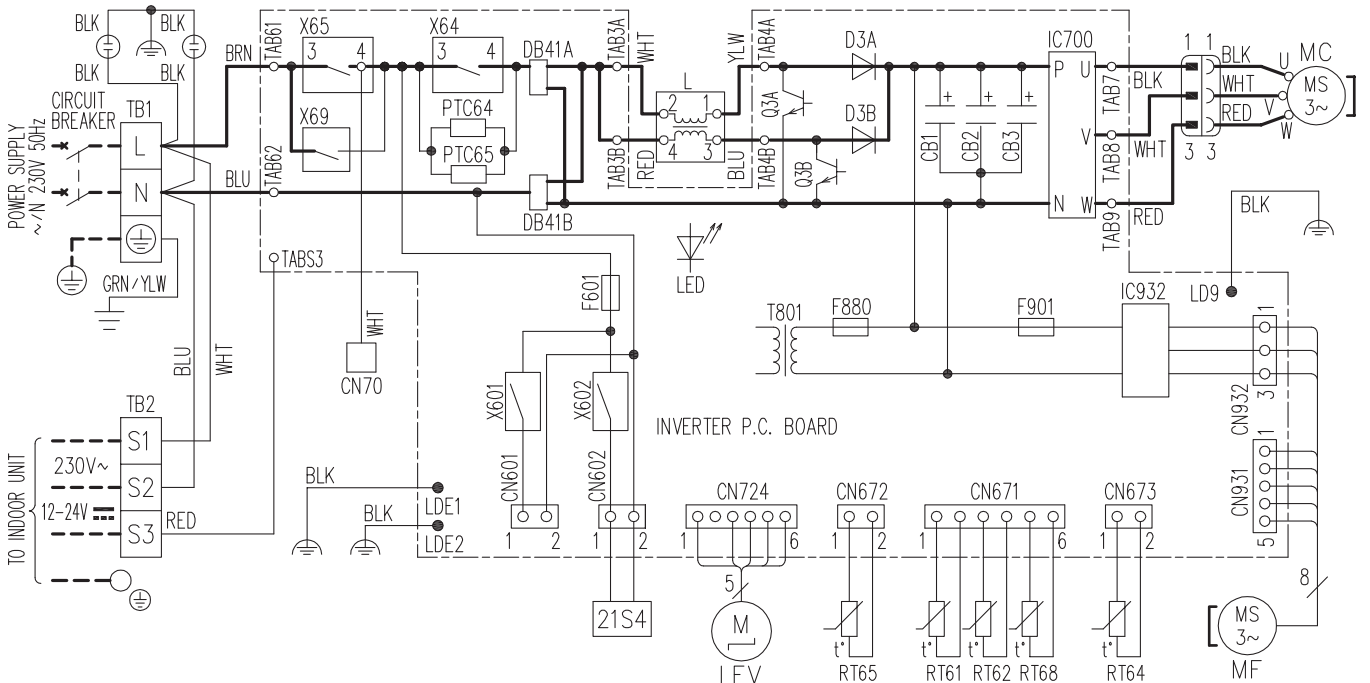


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1, CB2, CB3	SMOOTHING CAPACITOR	L	REACTOR	RT61	DEFROST THERMISTOR	T801	TRANSFORMER
DB41A, DB41B	DIODE MODULE	LED	LED	RT62	DISCHARGE TEMP.THERMISTOR	X64, X65, X69	RELAY
D3A, D3B	DIODE	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP.THERMISTOR	X601, X602	RELAY
F601	FUSE (T3.15AL250V)	MC	COMPRESSOR	RT65	AMBIENT TEMP.THERMISTOR	Z1S4	REVERSING VALVE COIL
F880	FUSE (T3.15AL250V)	MF	FAN MOTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP.THERMISTOR		
F901	FUSE (T3.15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION				
IC700, IC932	POWER MODULE	Q3A, Q3B	SWITCHING POWER TRANSISTOR	TB1, TB2	TERMINAL BLOCK		

- NOTES
 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2.Use copper supply wires. 3.Symbols indicate, : Terminal block : Connector

WIRING DIAGRAM WALL-MOUNTED


MUZ-HR25VF MUZ-HR35VF
OUTDOOR UNIT

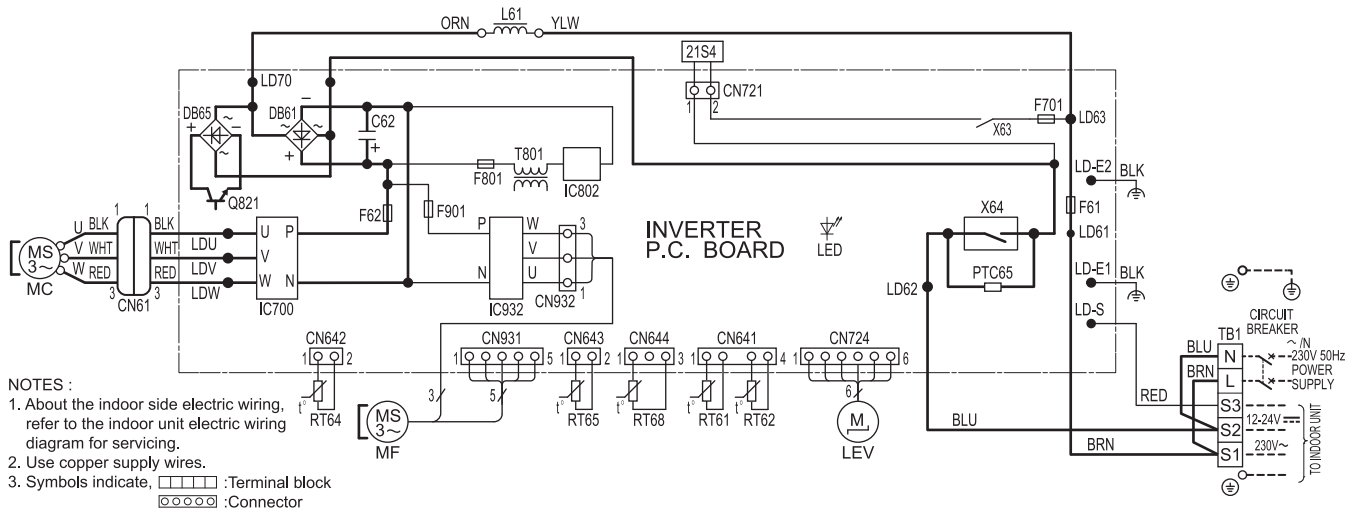

- NOTES :
- About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR
C62	SMOOTHING CAPACITOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F61, F62	FUSE (15A 250V)	MF	FAN MOTOR	TB1	TERMINAL BLOCK
F701, F801, F901	FUSE (T3, 15AL250V)	PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER
IC700, IC932	POWER MODULE	Q821	SWITCHING POWER TRANSISTOR	X63, X64	RELAY
IC802	POWER DEVICE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
LED	LED	RT62	DISCHARGE TEMP. THERMISTOR		

MUZ-HR42VF MUZ-HR50VF
OUTDOOR UNIT

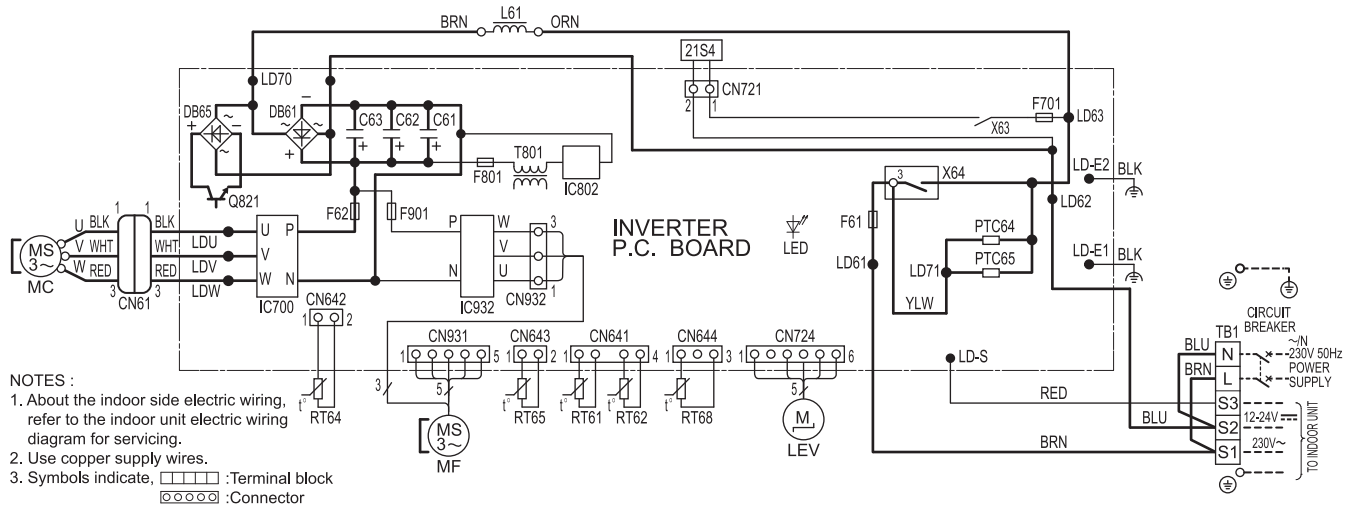


- NOTES :
- About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64	RELAY
F701, F801, F901	FUSE (T3, 15AL250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

WALL-MOUNTED WIRING DIAGRAM

MUY-TP35VF MUY-TP50VF
OUTDOOR UNIT

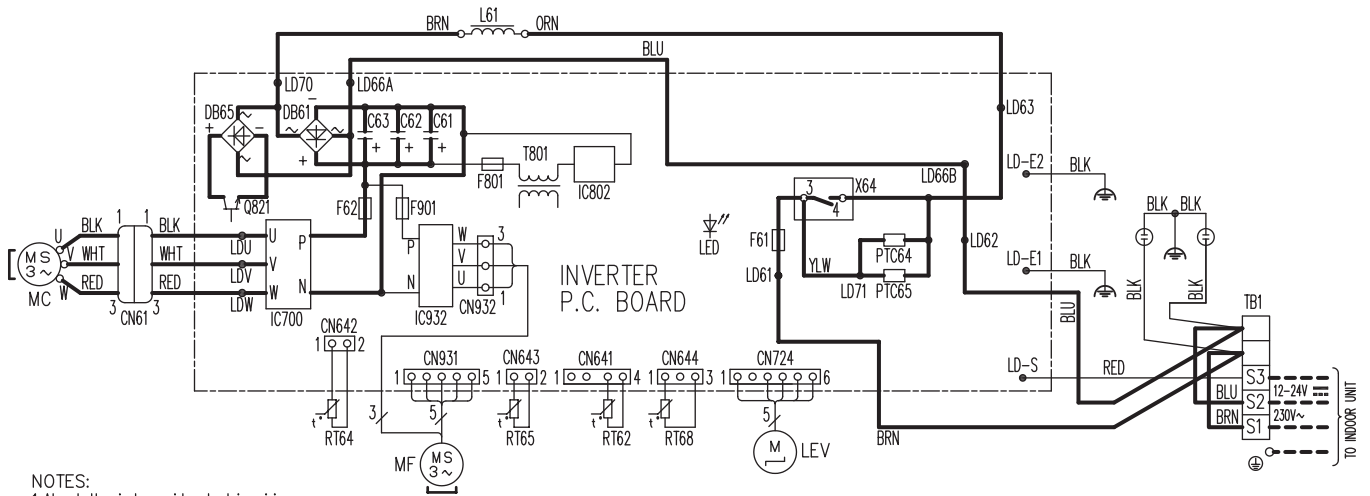


- NOTES:
- 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 - 2.Use copper supply wires.
 - 3.Symbols indicate, □ : Terminal block
○ : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR
C61,C62,C63	SMOOTHING CAPACITOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
DB61,DB65	DIODE MODULE	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F61	FUSE (25A 250V)	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F62	FUSE (15A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F801,F901	FUSE (T3.15A/250V)	PTC64,PTC65	CIRCUIT PROTECTION	X64	RELAY
IC700,IC932	POWER MODULE	Q821	SWITCHING POWER TRANSISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		

WIRING DIAGRAM WALL-MOUNTED

MUZ-FH25VE MUZ-FH35VE

OUTDOOR UNIT

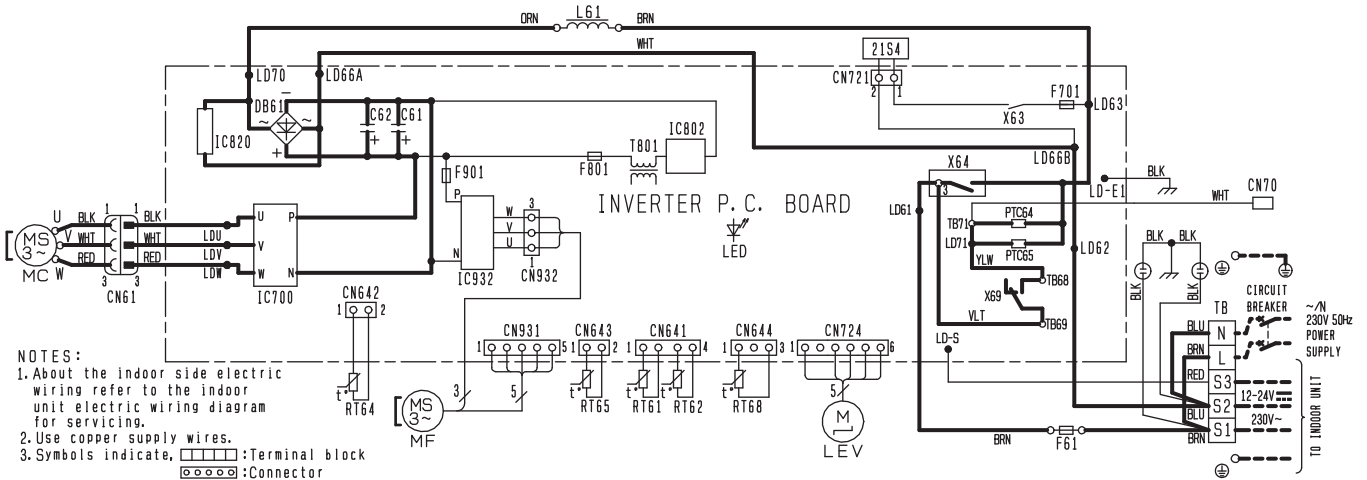


- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
DB61	DIODE MODULE	MC	COMPRESSOR	TB	TERMINAL BLOCK
F61	FUSE (T20AL250V)	MF	FAN MOTOR	T801	TRANSFORMER
F701, F801, F901	FUSE (T3.15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X69	RELAY
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-FH25VEHZ MUZ-FH35VEHZ

OUTDOOR UNIT

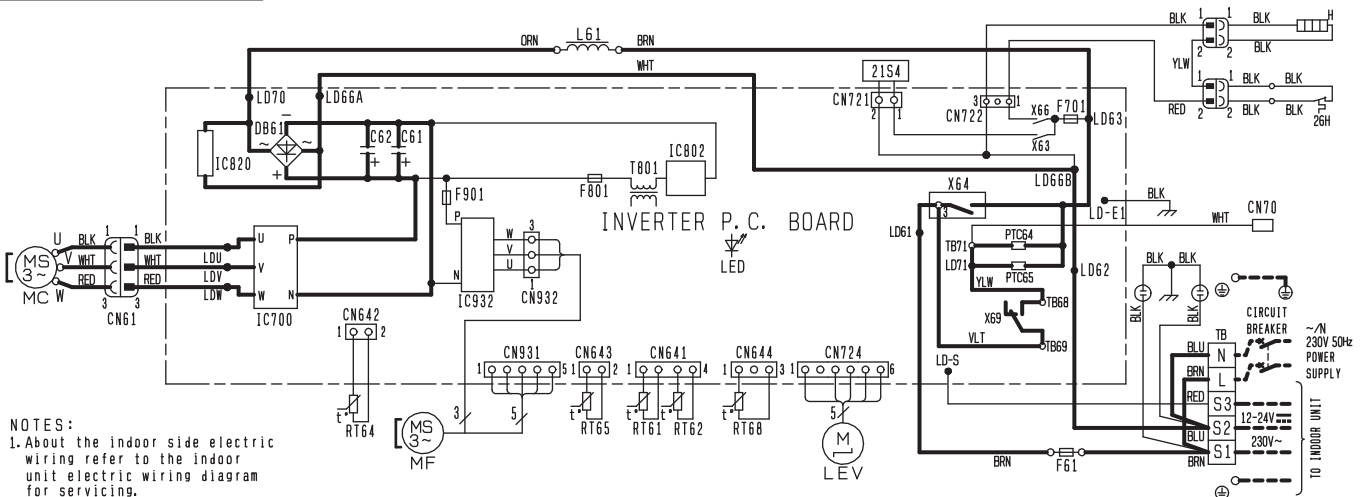


- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LEV	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
C61, C62	SMOOTHING CAPACITOR	L61	REACTOR	TB	TERMINAL BLOCK
DB61	DIODE MODULE	MC	COMPRESSOR	T801	TRANSFORMER
F61	FUSE (T20AL250V)	MF	FAN MOTOR	X63, X64, X66, X69	RELAY
F701, F801, F901	FUSE (T3.15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	21S4	REVERSING VALVE COIL
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	26H	HEATER PROTECTOR
IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR		
LED	LED	RT65	AMBIENT TEMP. THERMISTOR		

WALL-MOUNTED WIRING DIAGRAM

MUZ-FH50VE
OUTDOOR UNIT

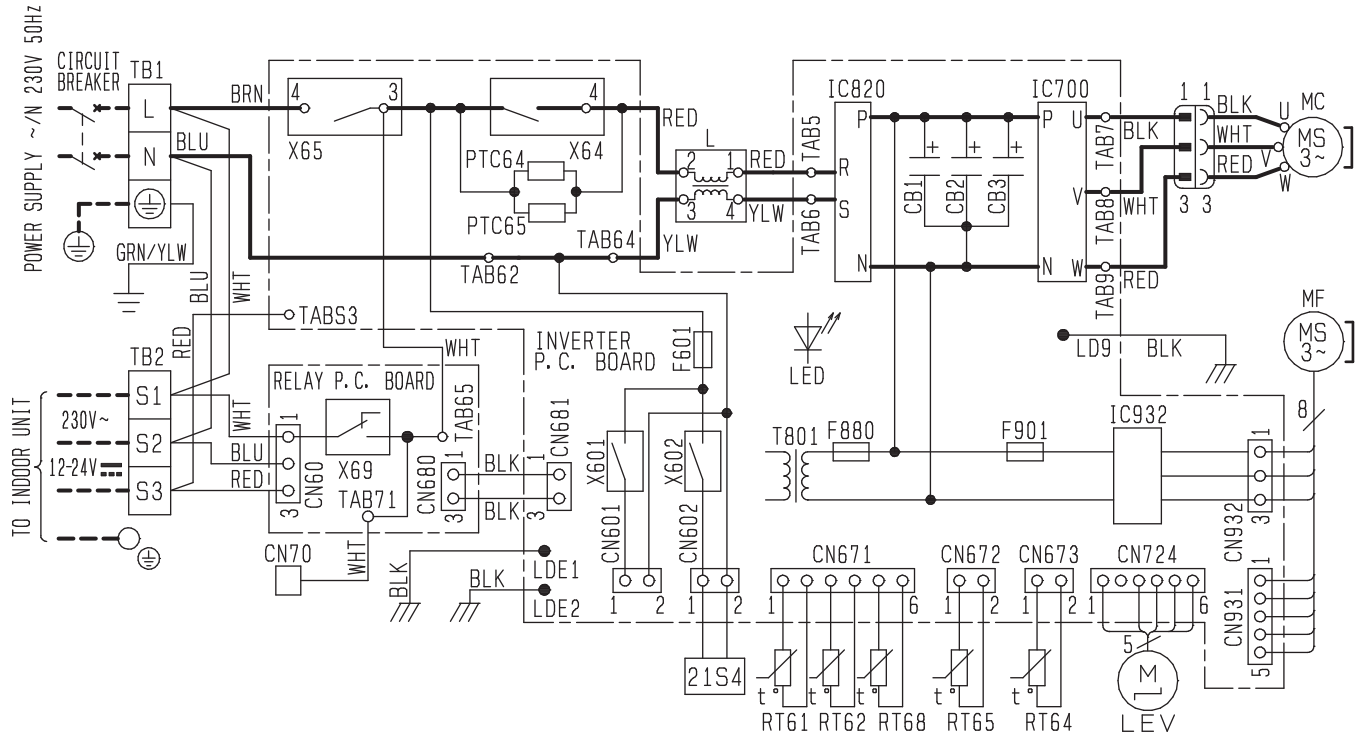


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1 ~ 3	SMOOTHING CAPACITOR	L	REACTOR	RT62	DISCHARGE TEMP. THERMISTOR	X602	RELAY
CN70	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR	X64	RELAY
F601	FUSE (T3. 15AL250V)	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR	X65	RELAY
F880	FUSE (T3. 15AL250V)	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR	X69	RELAY
F901	FUSE (T3. 15AL250V)	MF	FAN MOTOR			21S4	REVERSING VALVE COIL
IC700	IGBT Module	PTC64	CIRCUIT PROTECTION	TB1, TB2	TERMINAL BLOCK		
IC820	DIODE Module	PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER		
IC932	IGBT Module	RT61	DEFROST THERMISTOR	X601	RELAY		

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
2. Use copper conductors only (for field wiring). 3. Symbols indicate, : Terminal block

WIRING DIAGRAM MOUNTED WALL-

MUZ-FH50VEHZ


OUTDOOR UNIT

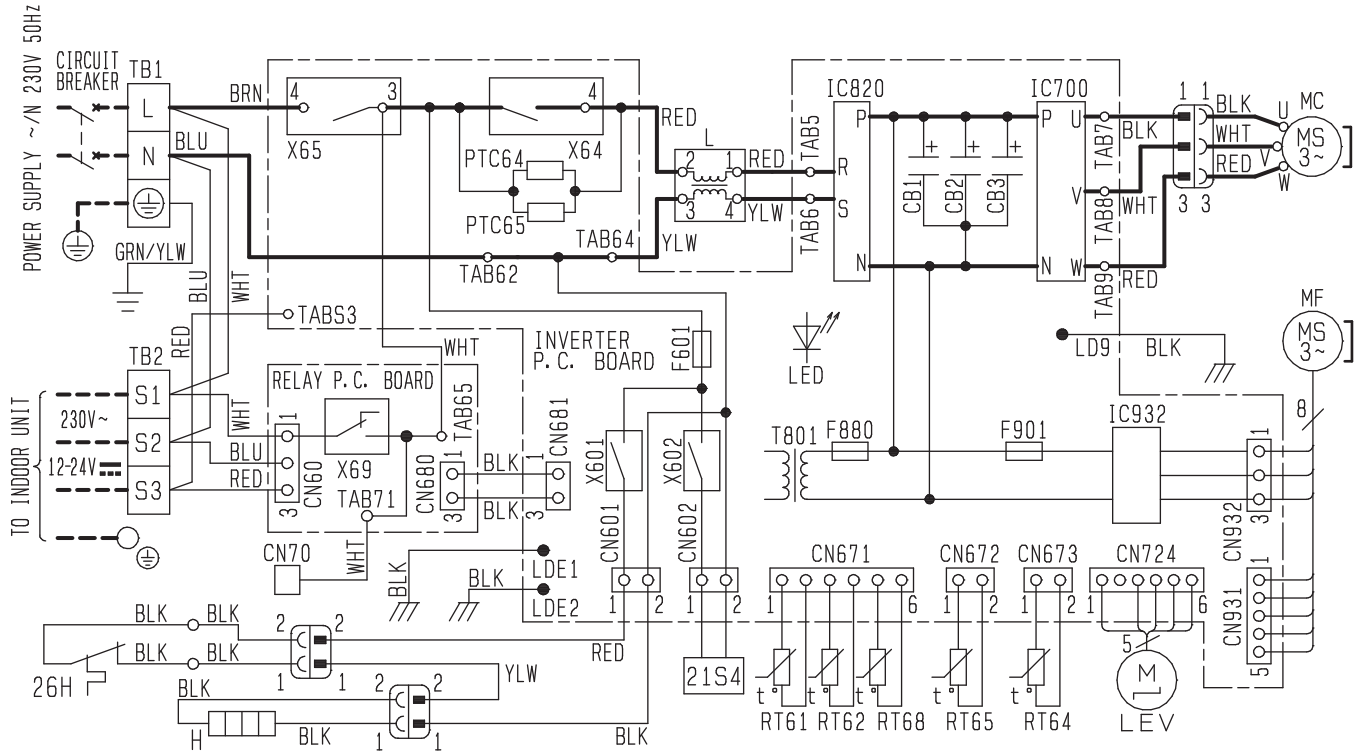

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1~3	SMOOTHING CAPACITOR	IC932	IGBT Module	RT61	DEFROST THERMISTOR	X601	RELAY
CN70	CONNECTOR	L	REACTOR	RT62	DISCHARGE TEMP. THERMISTOR	X602	RELAY
F601	FUSE (T3. 15A/250V)	LED	LED	RT64	FIN TEMP. THERMISTOR	X64	RELAY
F880	FUSE (T3. 15A/250V)	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR	X65	RELAY
F901	FUSE (T3. 15A/250V)	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR	X69	RELAY
H	DEFROST HEATER	MF	FAN MOTOR	T801	TRANSFORMER	21S4	REVERSING VALVE COIL
IC700	IGBT Module	PTC64	CIRCUIT PROTECTION	TB1, TB2	TERMINAL BLOCK	26H	HEATER PROTECTOR
IC820	DIODE Module	PTC65	CIRCUIT PROTECTION				

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only (for field wiring). 3. Symbols indicate, : terminal block


MUZ-EF25VG MUZ-EF35VG
OUTDOOR UNIT

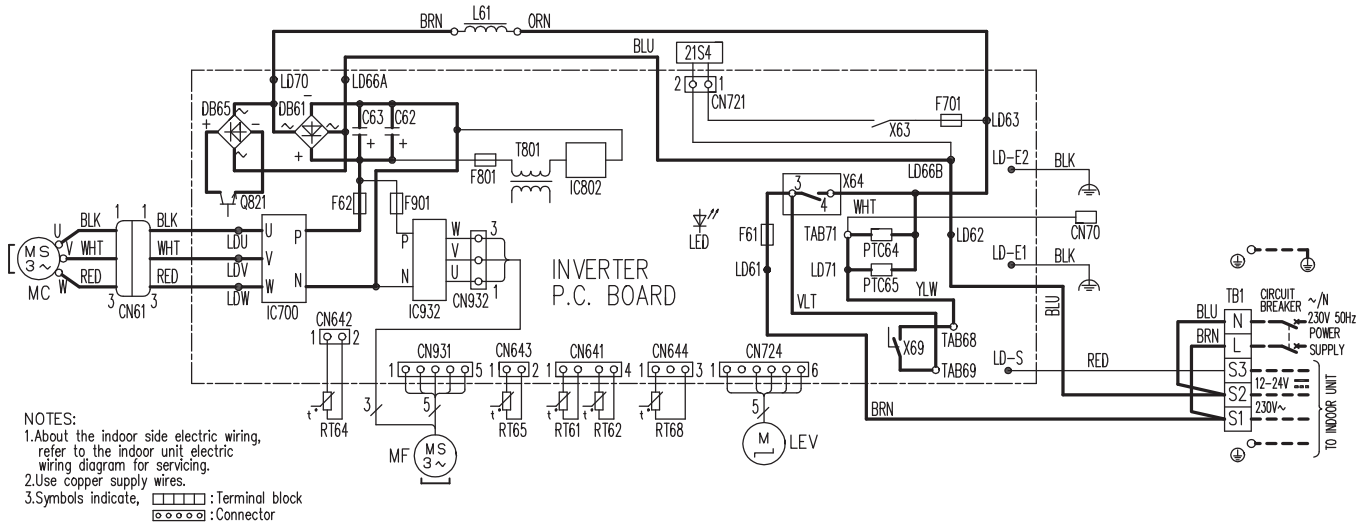

- NOTES:
 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2.Use copper supply wires.
 3.Symbols indicate, : Terminal block
 : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X69	RELAY
F701, F801, F901	FUSE (T3.15AL250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-EF25VGH MUZ-EF35VGH
OUTDOOR UNIT

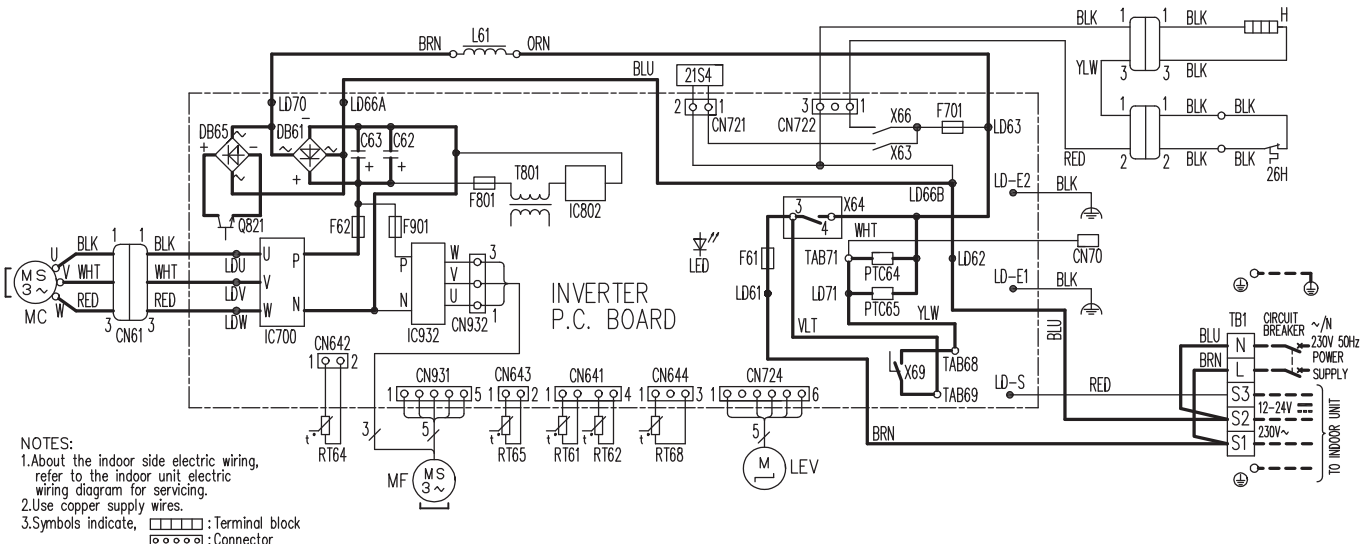


- NOTES:
 1.About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2.Use copper supply wires.
 3.Symbols indicate, : Terminal block
 : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR
C62, C63	SMOOTHING CAPACITOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F61	FUSE (25A 250V)	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F62	FUSE (15A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F701, F801, F901	FUSE (T3.15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X66, X69	RELAY
H	DEFROST HEATER	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	26H	HEATER PROTECTOR
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		

WIRING DIAGRAM MOUNTED WALL-

MUZ-EF42VG


OUTDOOR UNIT

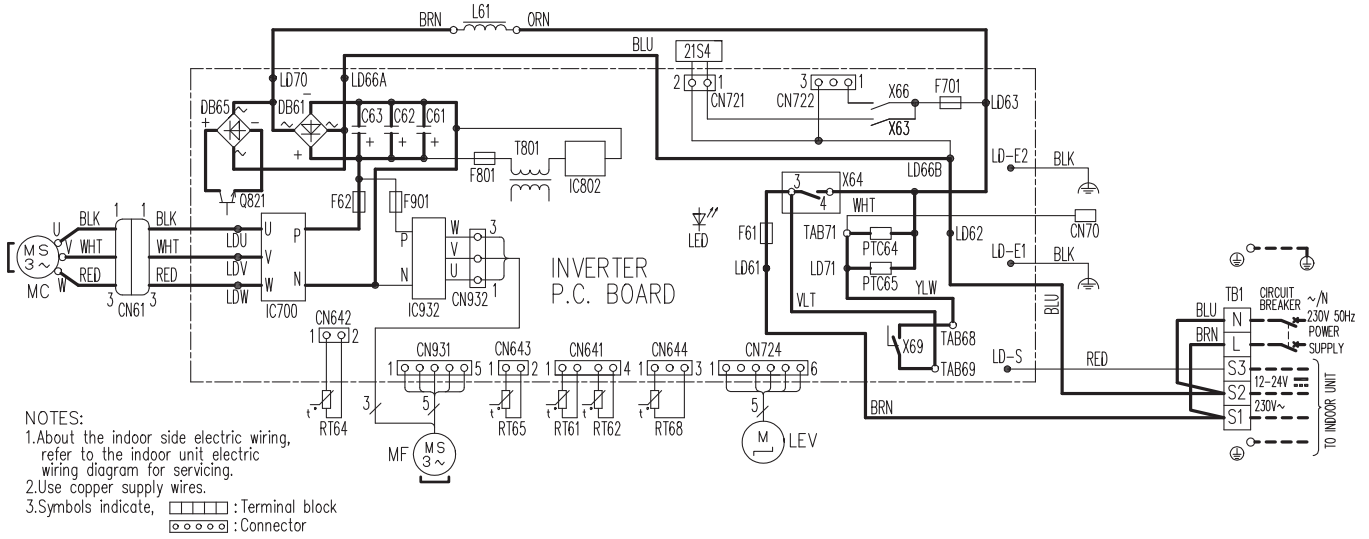

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X66, X69	RELAY
F701, F801, F901	FUSE (T3.15AL250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-EF50VG


OUTDOOR UNIT

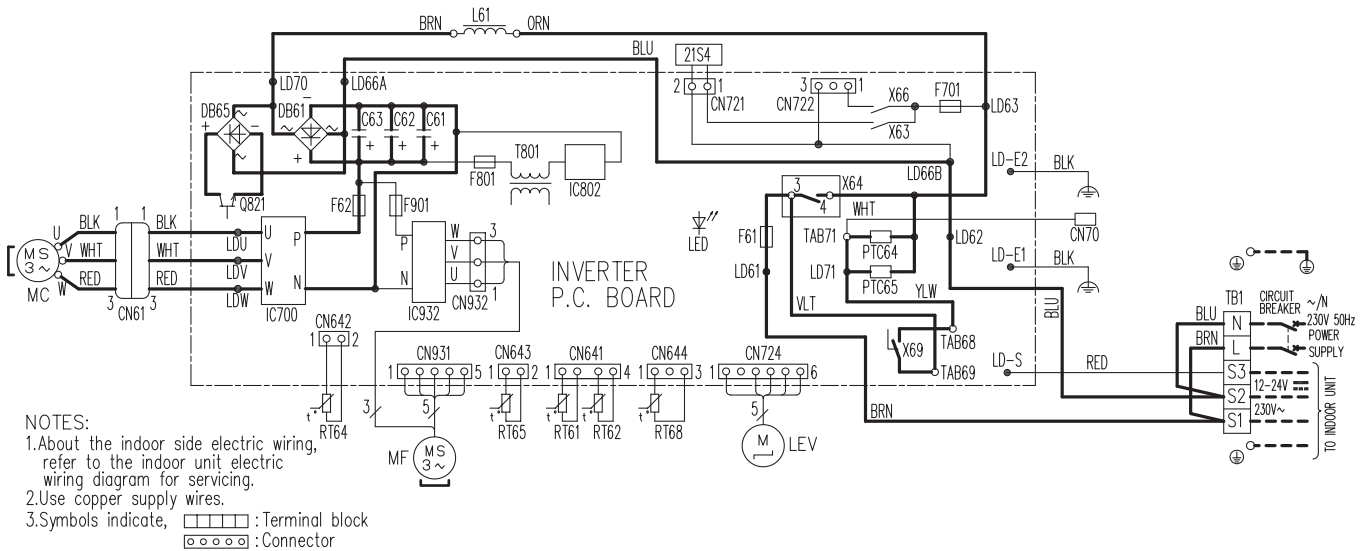

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MC	COMPRESSOR	TB1	TERMINAL BLOCK
F61	FUSE (25A 250V)	MF	FAN MOTOR	T801	TRANSFORMER
F62	FUSE (15A 250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X66, X69	RELAY
F701, F801, F901	FUSE (T3.15AL250V)	Q821	SWITCHING POWER TRANSISTOR	21S4	REVERSING VALVE COIL
IC700, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-SF25VE MUZ-SF35VE

OUTDOOR UNIT

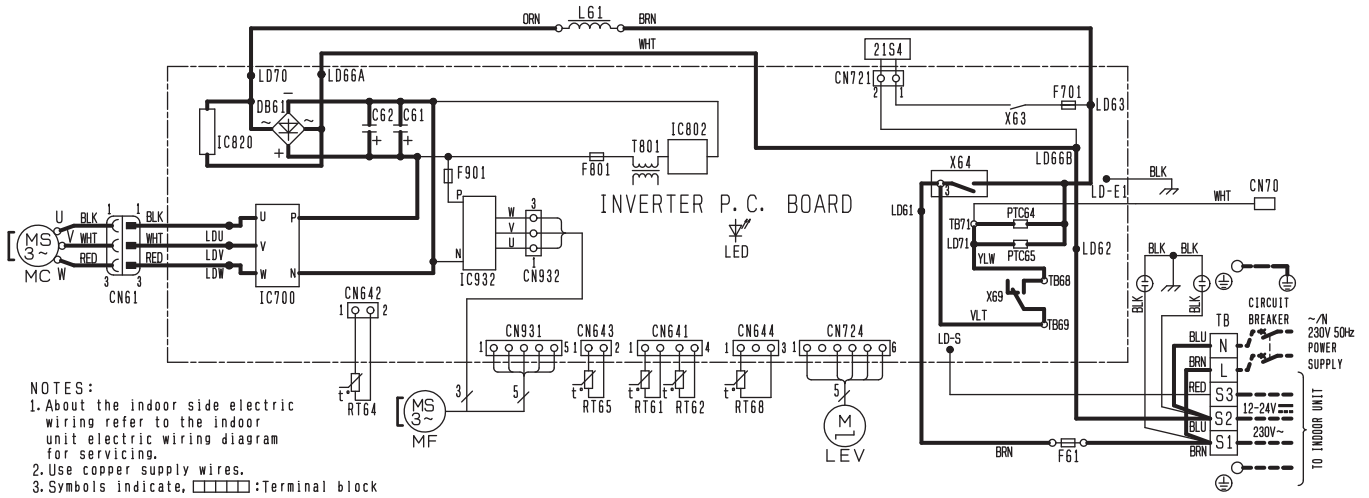


- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
:Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
DB61	DIODE MODULE	MC	COMPRESSOR	TB	TERMINAL BLOCK
F61	FUSE (T20AL250V)	MF	FAN MOTOR	T801	TRANSFORMER
F701, F801, F901	FUSE (T3. 15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X69	RELAY
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-SF25VEH MUZ-SF35VEH


OUTDOOR UNIT

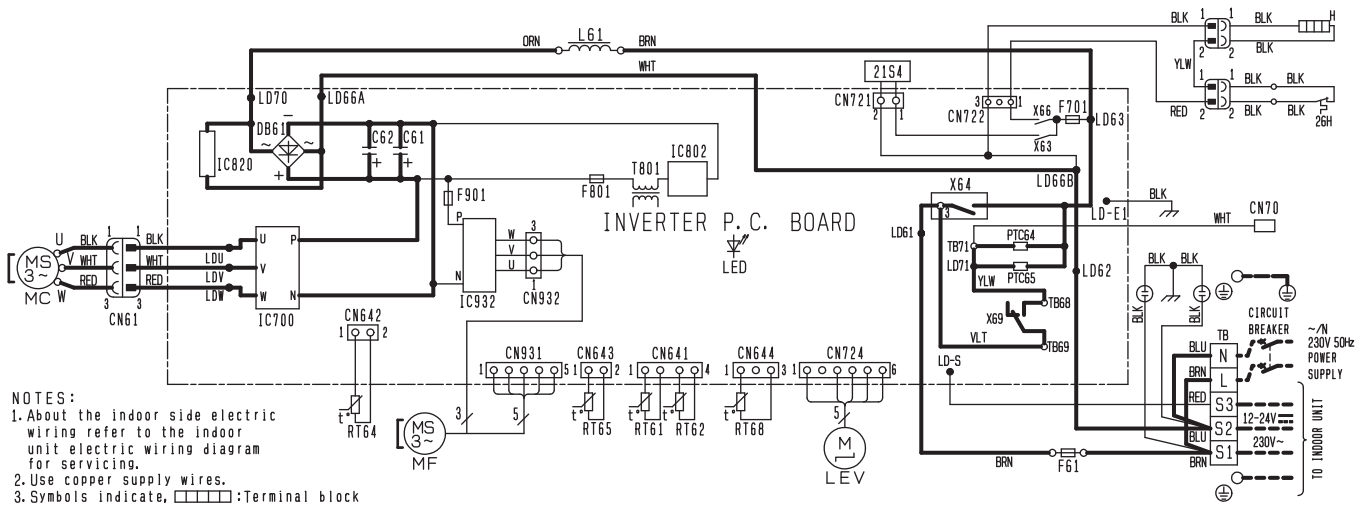

- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
:Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LEV	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
C61, C62	SMOOTHING CAPACITOR	L61	REACTOR	TB	TERMINAL BLOCK
DB61	DIODE MODULE	MC	COMPRESSOR	T801	TRANSFORMER
F61	FUSE (T20AL250V)	MF	FAN MOTOR	X63, X64, X66, X69	RELAY
F701, F801, F901	FUSE (T3. 15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	21S4	REVERSING VALVE COIL
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	26H	HEATER PROTECTOR
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		
		RT65	AMBIENT TEMP. THERMISTOR		


MUZ-SF42VE MUZ-SF50VE
OUTDOOR UNIT

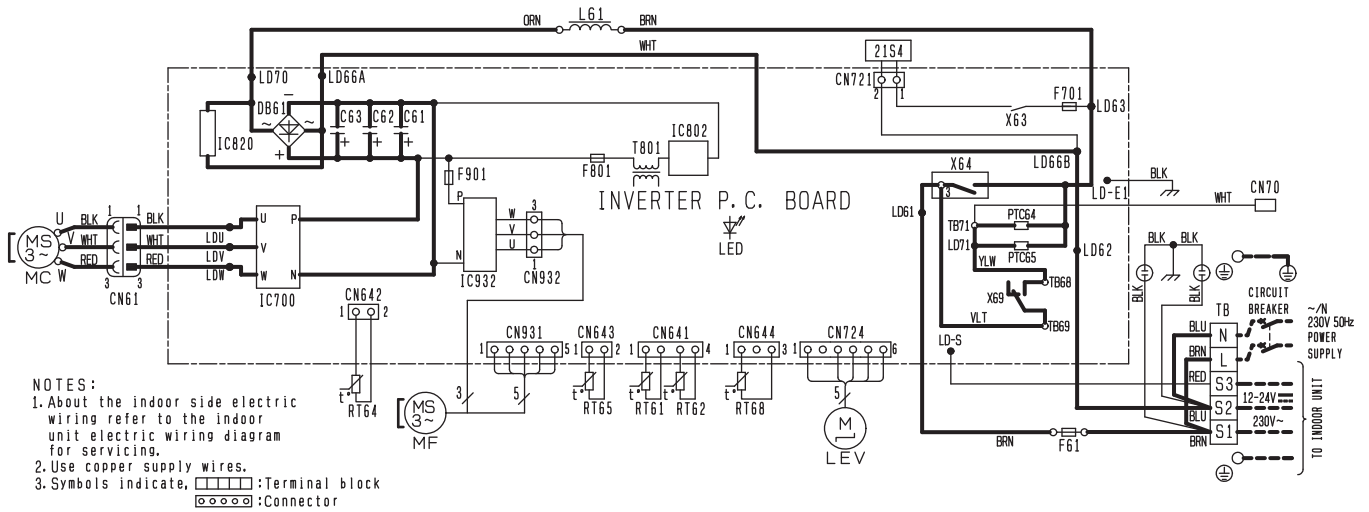

- NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate, □: Terminal block
○: Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
DB61	DIODE MODULE	MC	COMPRESSOR	TB	TERMINAL BLOCK
F61	FUSE (T20AL250V)	MF	FAN MOTOR	T801	TRANSFORMER
F701, F801, F901	FUSE (T3. 15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	XG3, XG4, XG9	RELAY
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		

MUZ-SF42VEH MUZ-SF50VEH
OUTDOOR UNIT

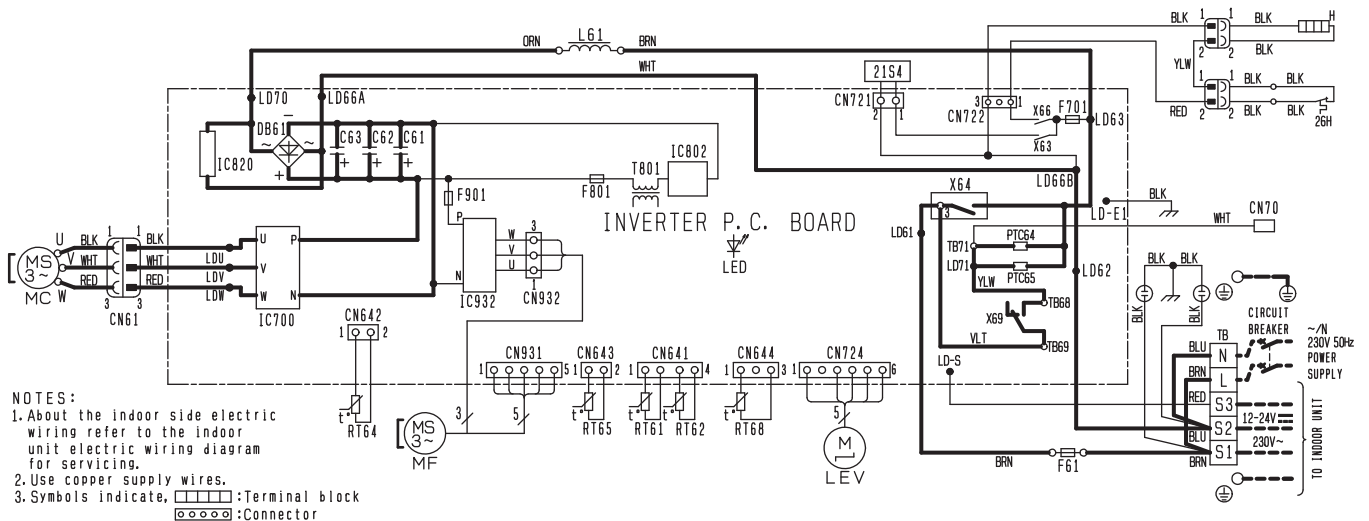


- NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires.
 3. Symbols indicate, □: Terminal block
○: Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LEV	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	TB	TERMINAL BLOCK
DB61	DIODE MODULE	MC	COMPRESSOR	T801	TRANSFORMER
F61	FUSE (T20AL250V)	MF	FAN MOTOR	XG3, XG4, XG6, XG9	RELAY
F701, F801, F901	FUSE (T3. 15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	21S4	REVERSING VALVE COIL
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR	26H	HEATER PROTECTOR
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		
		RT65	AMBIENT TEMP. THERMISTOR		

MUZ-GF60VE MUZ-GF71VE

OUTDOOR UNIT

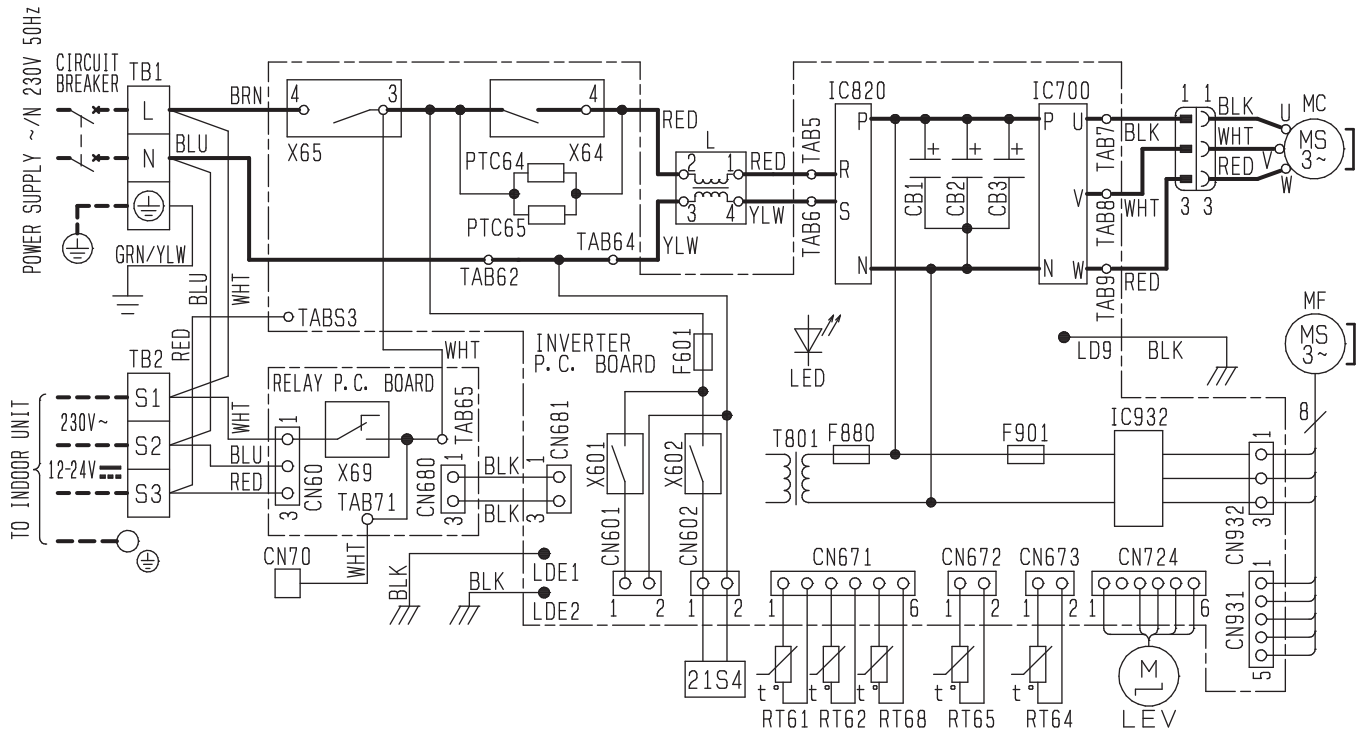


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1 ~ 3	SMOOTHING CAPACITOR	L	REACTOR	RT62	DISCHARGE TEMP. THERMISTOR	X602	RELAY
CN70	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR	X64	RELAY
F601	FUSE (T3. 15AL250V)	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR	X65	RELAY
F880	FUSE (T3. 15AL250V)	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR	X69	RELAY
F901	FUSE (T3. 15AL250V)	MF	FAN MOTOR			21S4	REVERSING VALVE SOLENOID COIL
IC700	IGBT Module	PTC64	CIRCUIT PROTECTION	TB1, TB2	TERMINAL BLOCK		
IC820	DIODE Module	PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER		
IC932	IGBT Module	RT61	DEFROST THERMISTOR	X601	RELAY		

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only (for field wiring). 3. Symbols indicate, : Terminal block

WIRING DIAGRAM WALL-MOUNTED


MUZ-WN25VA MUZ-WN35VA

OUTDOOR UNIT

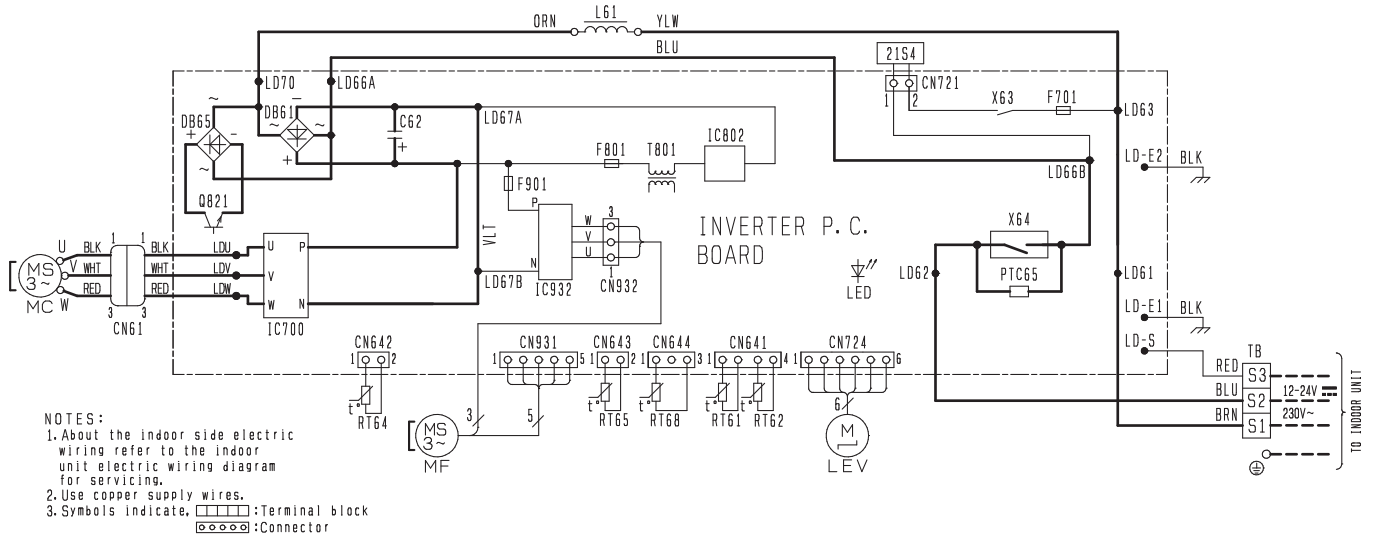


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
C62	SMOOTHING CAPACITOR	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MF	FAN MOTOR	TB	TERMINAL BLOCK
F701, F801, F901	FUSE (T3. 15A/250V)	PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER
IC700, IC932	POWER MODULE	Q821	SWITCHING POWER TRANSISTOR	X63, X64	RELAY
IC802	POWER DEVICE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
LED	LED	RT62	DISCHARGE TEMP. THERMISTOR		
LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR		

MUZ-DM25VA MUZ-DM35VA
OUTDOOR UNIT

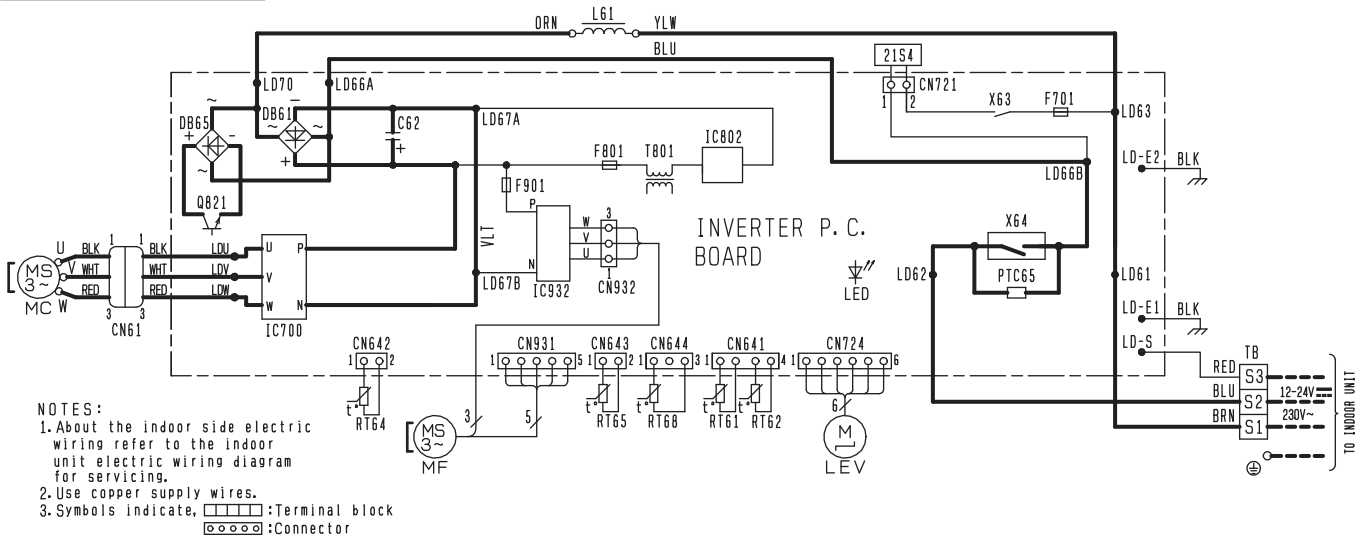

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	L61	REACTOR	RT65	AMBIENT TEMP. THERMISTOR
C62	SMOOTHING CAPACITOR	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	MF	FAN MOTOR	TB	TERMINAL BLOCK
F701, F801, F901	FUSE (T3. 15AL250V)	PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER
IC700, IC932	POWER MODULE	Q821	SWITCHING POWER TRANSISTOR	XG3, X64	RELAY
IC802	POWER DEVICE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
LED	LED	RT62	DISCHARGE TEMP. THERMISTOR		
LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR		

MUZ-HJ25VA
OUTDOOR UNIT

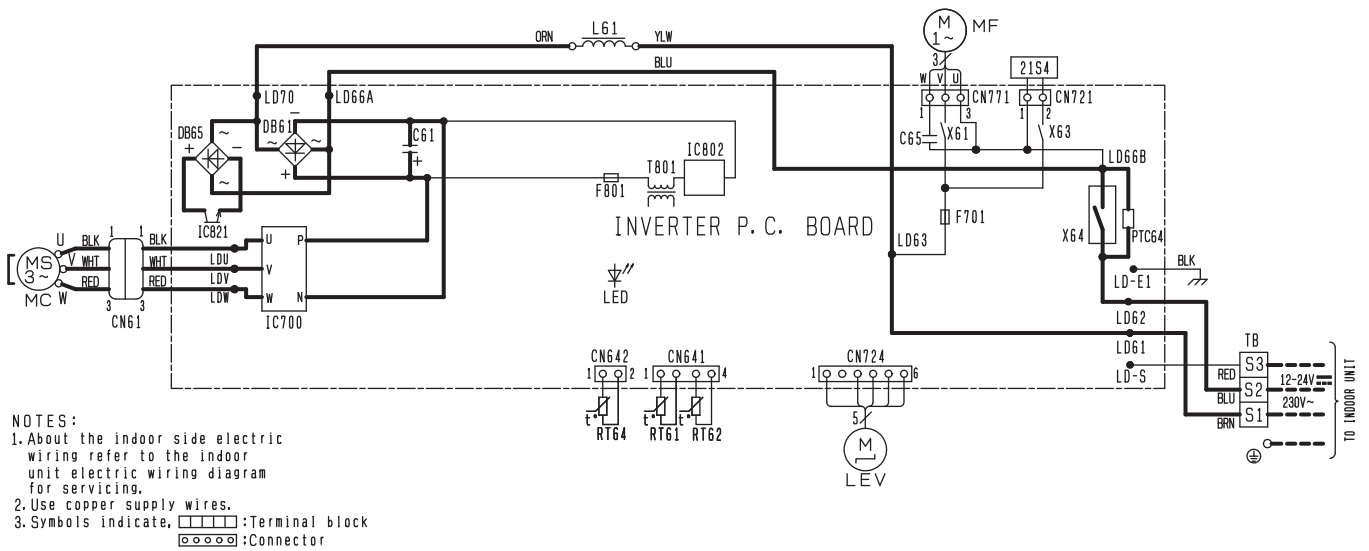


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	IC821	SWITCHING POWER TRANSISTOR	RT61	DEFROST THERMISTOR
C61	SMOOTHING CAPACITOR	LED	LED	RT62	DISCHARGE TEMP. THERMISTOR
C65	FAN MOTOR CAPACITOR	LEV	EXPANSION VALVE COIL	RT64	FIN TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	L61	REACTOR	TB	TERMINAL BLOCK
F701, F801	FUSE (T3. 15AL250V)	MC	COMPRESSOR	T801	TRANSFORMER
IC700	POWER MODULE	MF	FAN MOTOR (INNER FUSE)	X61, X63, X64	RELAY
IC802	POWER DEVICE	PTC64	CIRCUIT PROTECTION	21S4	REVERSING VALVE COIL

WIRING DIAGRAM WALL-MOUNTED

MUZ-HJ35VA

OUTDOOR UNIT

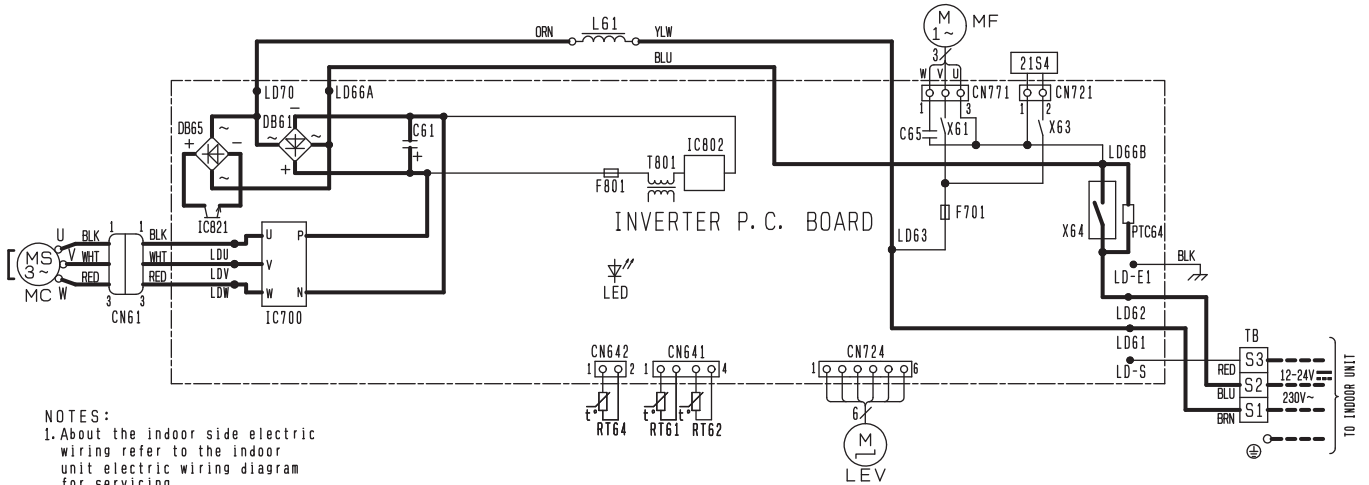


- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	IC821	SWITCHING POWER TRANSISTOR	SYMBOL	NAME
C61	SMOOTHING CAPACITOR	LED	LED	RT61	DEFROST THERMISTOR
C65	FAN MOTOR CAPACITOR	LEV	EXPANSION VALVE COIL	RT62	DISCHARGE TEMP. THERMISTOR
DB61, DB65	DIODE MODULE	L61	REACTOR	RT64	FIN TEMP. THERMISTOR
F701, F801	FUSE (T3. 15AL250V)	MC	COMPRESSOR	TB	TERMINAL BLOCK
IC700	POWER MODULE	MF	FAN MOTOR (INNER FUSE)	T801	TRANSFORMER
IC802	POWER DEVICE	PTC64	CIRCUIT PROTECTION	X61, X63, X64	RELAY

MUZ-HJ50VA MUZ-HJ60VA MUZ-HJ71VA

OUTDOOR UNIT

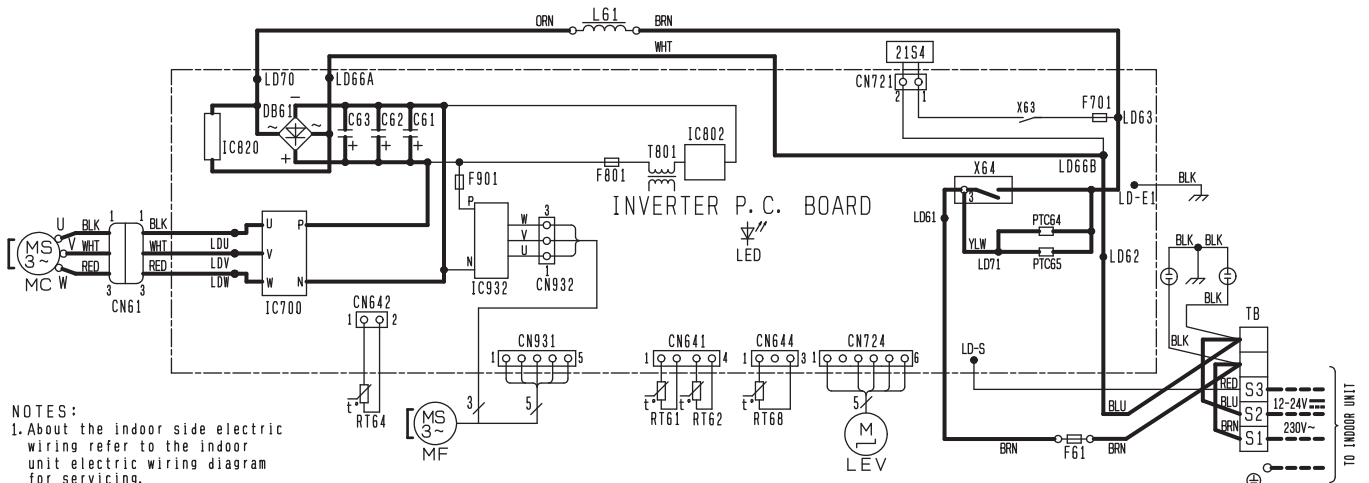

- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper supply wires.
 - Symbols indicate, :Terminal block
 :Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN61	CONNECTOR	LEV	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
C61, C62, C63	SMOOTHING CAPACITOR	L61	REACTOR	TB	TERMINAL BLOCK
DB61	DIODE MODULE	MC	COMPRESSOR	T801	TRANSFORMER
F61	FUSE (T20AL250V)	MF	FAN MOTOR	X63, X64	RELAY
F701, F801, F901	FUSE (T3. 15AL250V)	PTC64, PTC65	CIRCUIT PROTECTION	21S4	REVERSING VALVE COIL
IC700, IC820, IC932	POWER MODULE	RT61	DEFROST THERMISTOR		
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		
LED	LED	RT64	FIN TEMP. THERMISTOR		


WALL-MOUNTED WIRING DIAGRAM

C.1.4 REFRIGERANT SYSTEM DIAGRAM

C.1.4.1 Inverter


Unit: mm

MSZ-LN18VGW
MSZ-LN18VGV
MSZ-LN18VGB
MSZ-LN18VGR

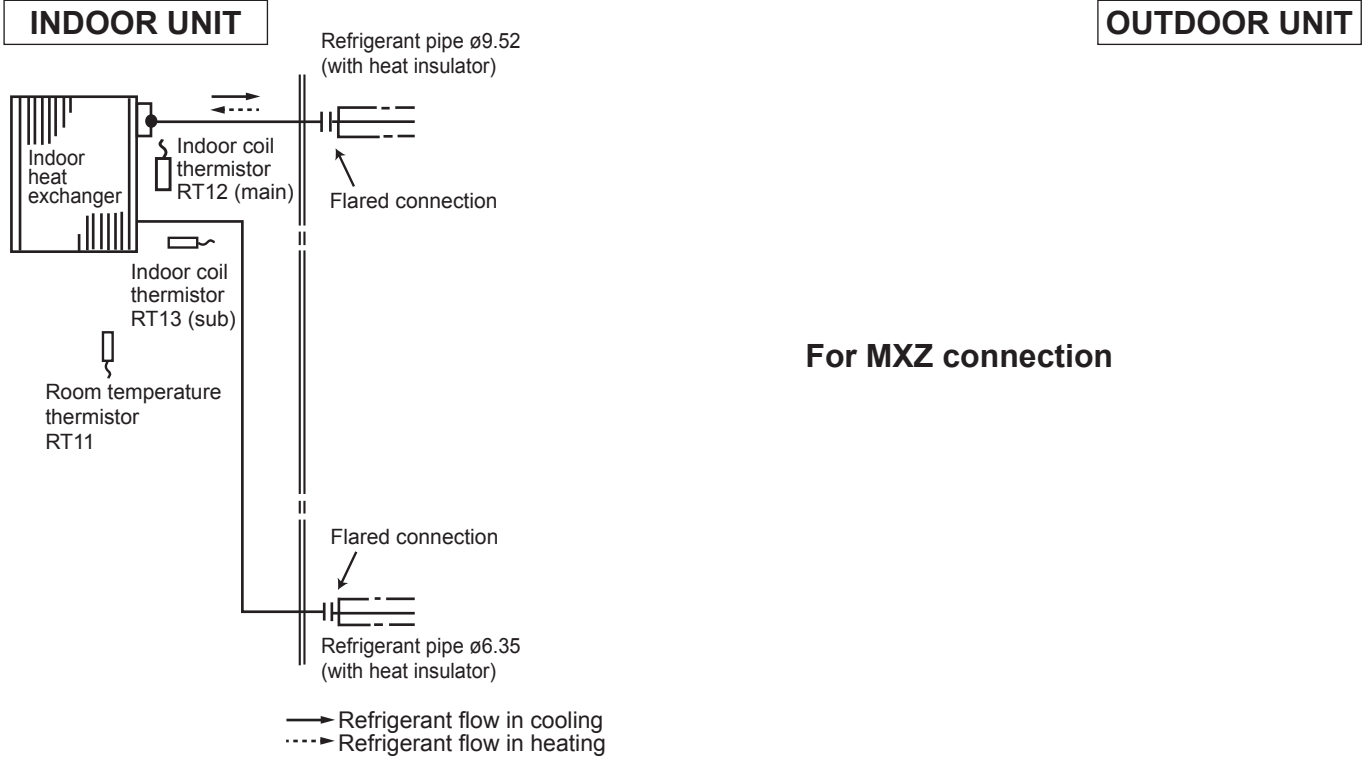

MSZ-LN25VGW **MSZ-LN35VGW**
MSZ-LN25VGV **MSZ-LN35VGV**
MSZ-LN25VGB **MSZ-LN35VGB**
MSZ-LN25VGR **MSZ-LN35VGR**

MUZ-LN25VG
MUZ-LN25VGHZ
MUZ-LN35VG
MUZ-LN35VGHZ

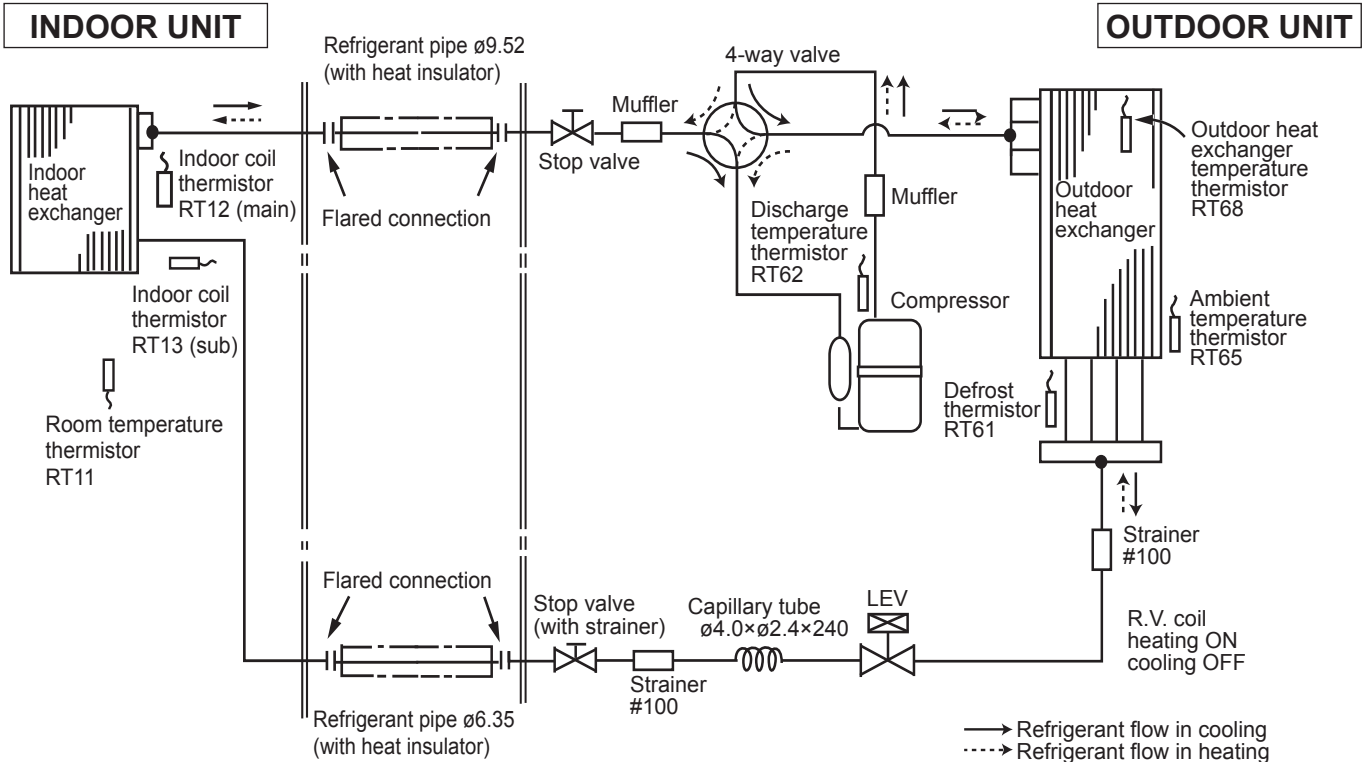

REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED


Unit: mm

MSZ-LN50VGW
MSZ-LN50VGV
MSZ-LN50VGB
MSZ-LN50VGR

MUZ-LN50VG

INDOOR UNIT

OUTDOOR UNIT

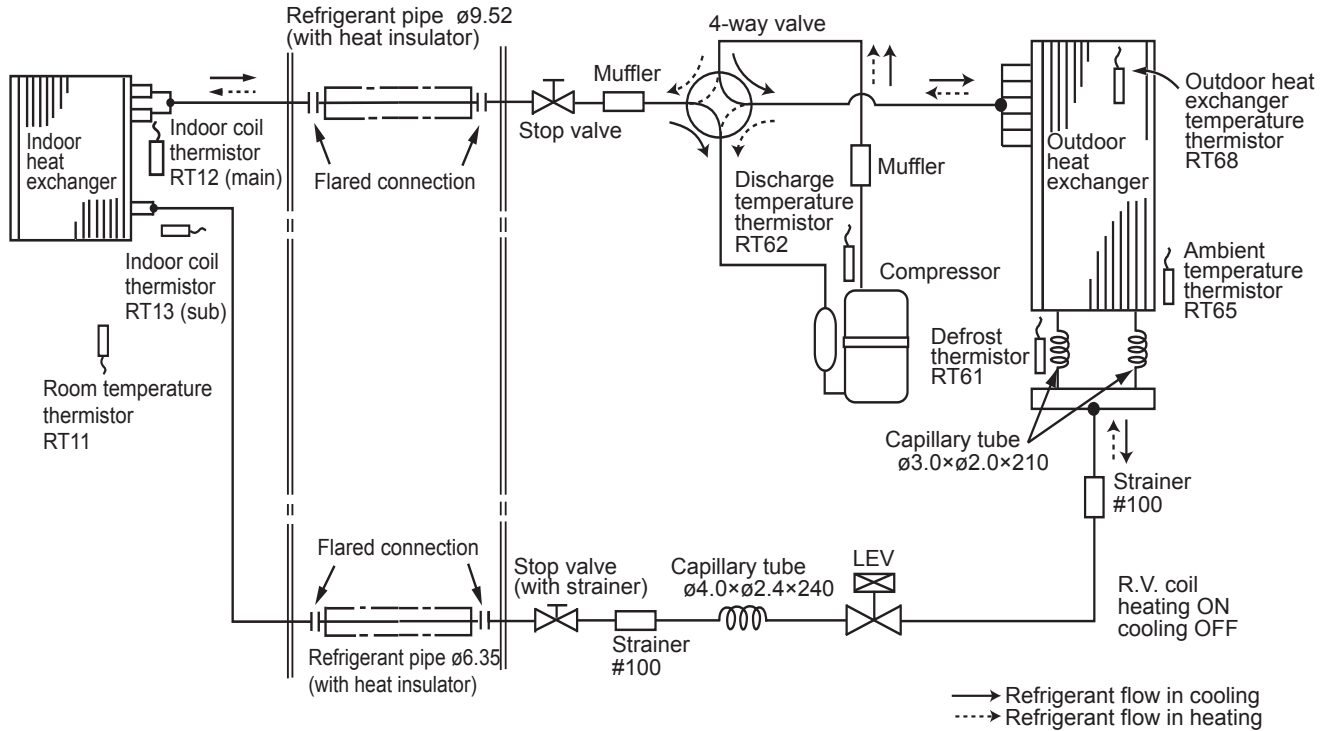


MSZ-LN50VGW
MSZ-LN50VGV
MSZ-LN50VGB
MSZ-LN50VGR

MUZ-LN50VGHZ

INDOOR UNIT

OUTDOOR UNIT

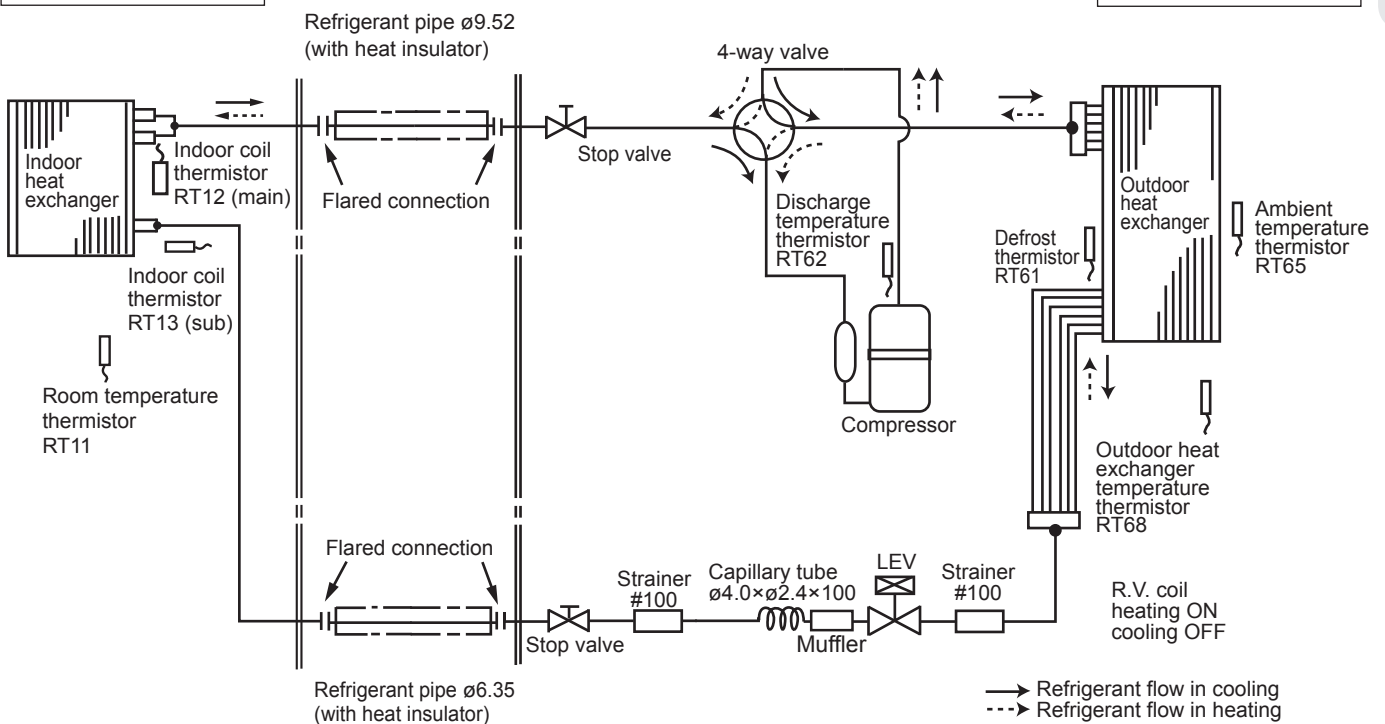


WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM

Unit: mm

MSZ-LN60VGW
MSZ-LN60VGV
MSZ-LN60VGB
MSZ-LN60VGR

MUZ-LN60VG
OUTDOOR UNIT

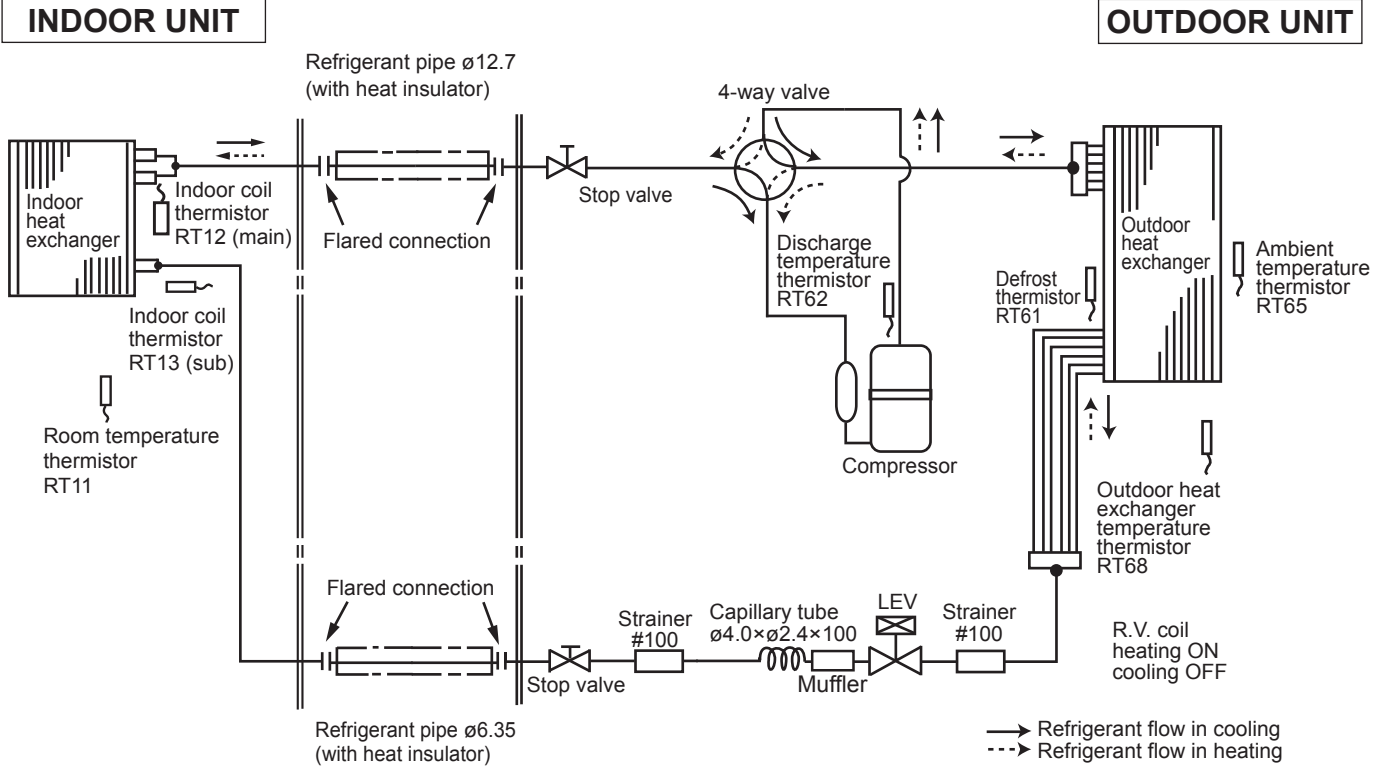


REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED

Unit: mm

MSZ-AP15VG

INDOOR UNIT

OUTDOOR UNIT

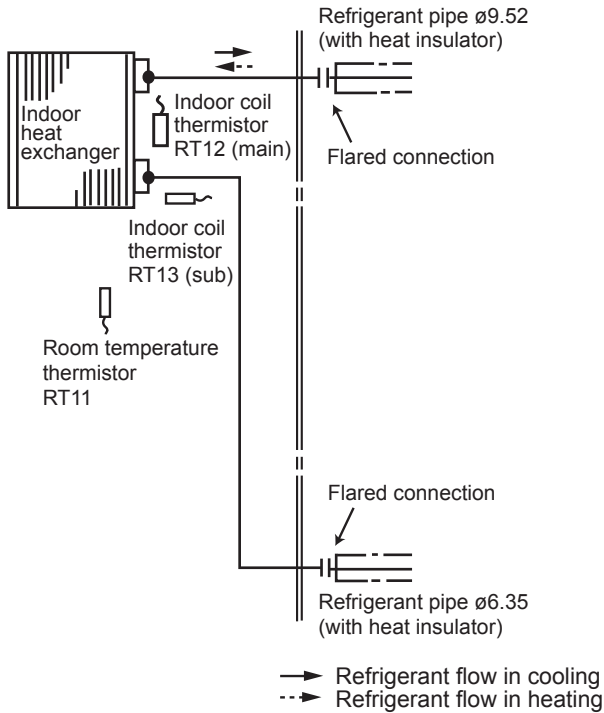


For MXZ connection

MSZ-AP20VG

INDOOR UNIT

MUZ-AP20VG

OUTDOOR UNIT

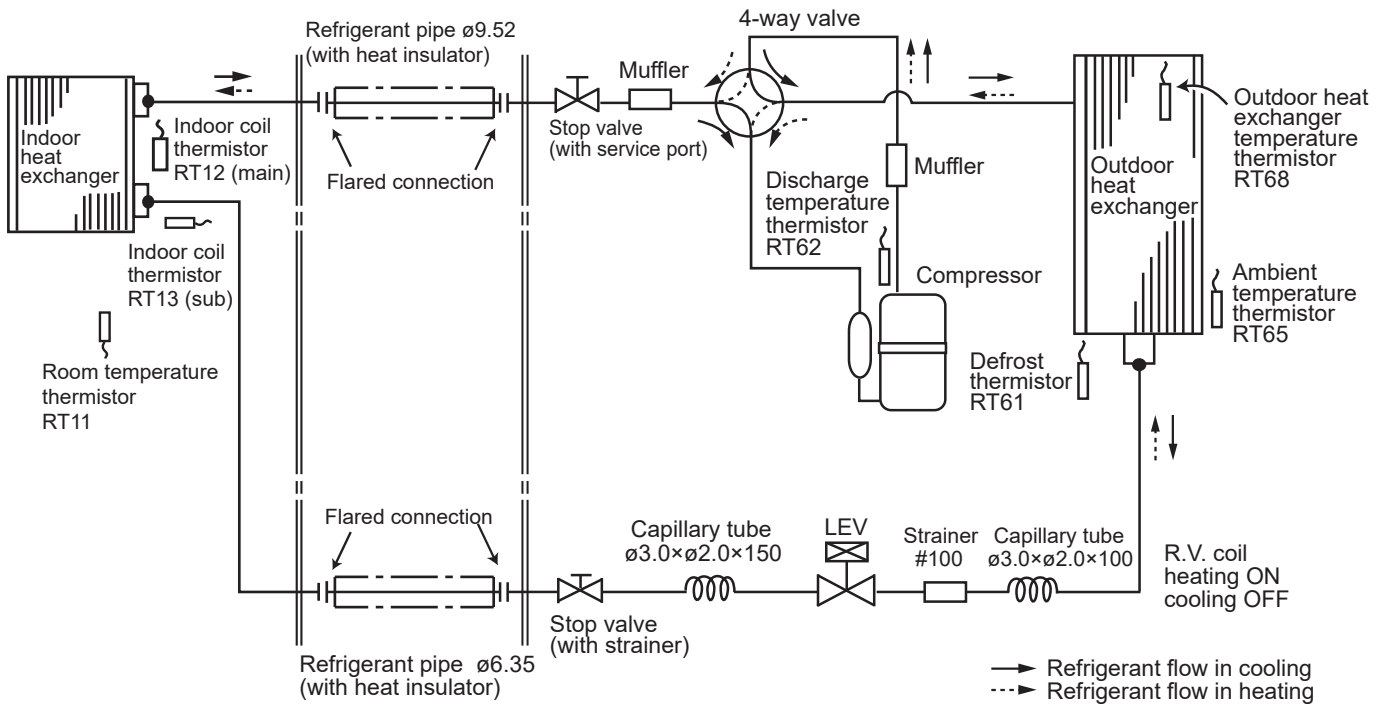

WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM


Unit: mm

MSZ-AP25VG
MSZ-AP35VG
MSZ-AP25VGK
MSZ-AP35VGK

MUZ-AP25VG
MUZ-AP35VG
MUZ-AP25VGH
MUZ-AP35VGH

INDOOR UNIT

OUTDOOR UNIT

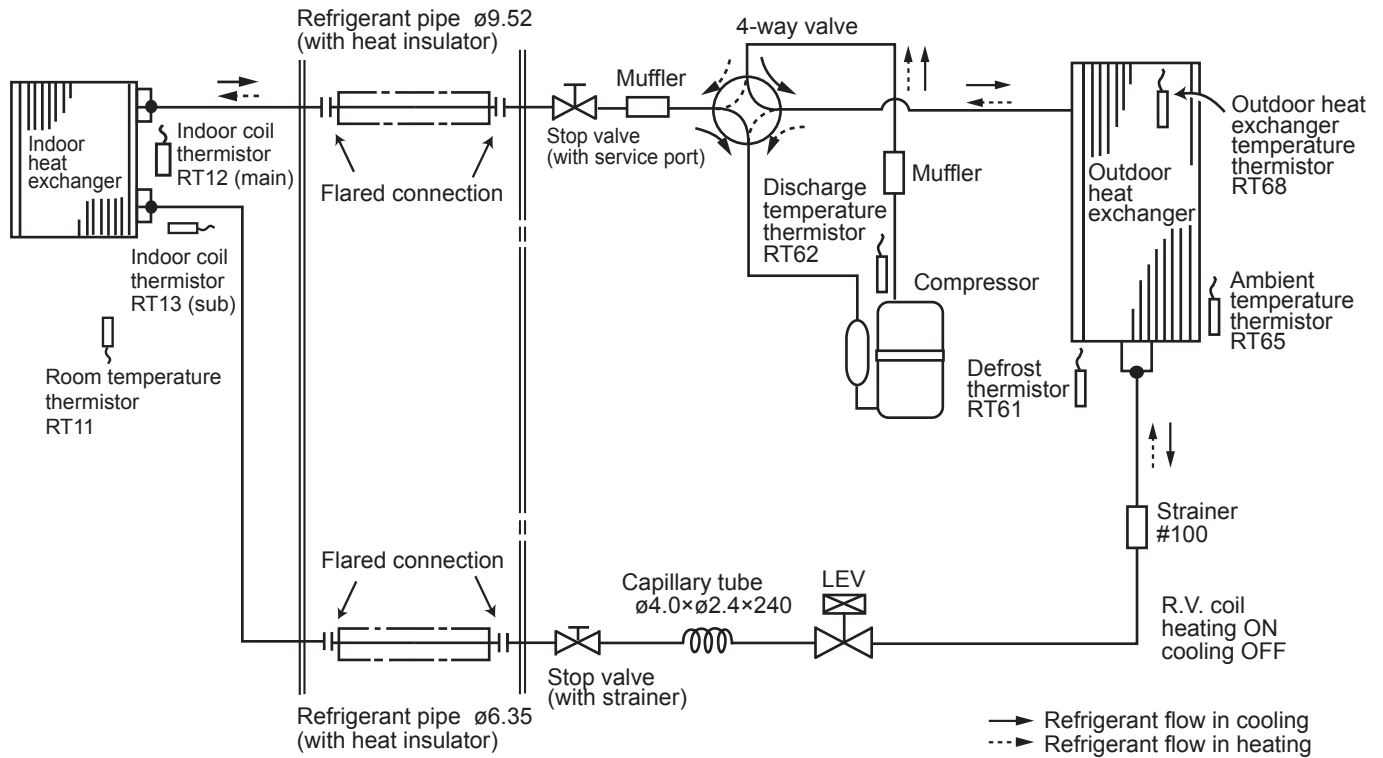


MSZ-AP42VG
MSZ-AP42VGK

MUZ-AP42VG
MUZ-AP42VGH

INDOOR UNIT

OUTDOOR UNIT

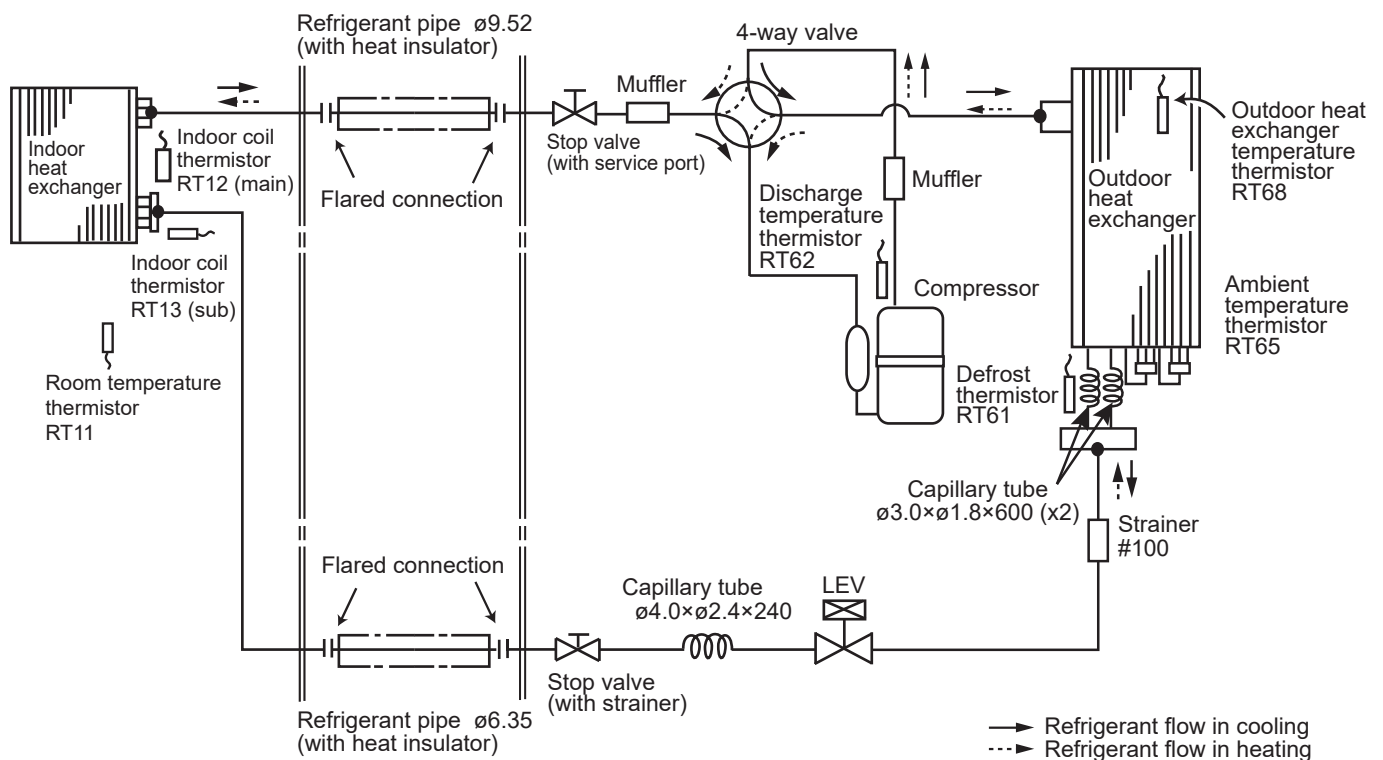

REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED


Unit: mm

**MSZ-AP50VG
MSZ-AP50VGK**

**MUZ-AP50VG
MUZ-AP50VGH**

INDOOR UNIT

OUTDOOR UNIT

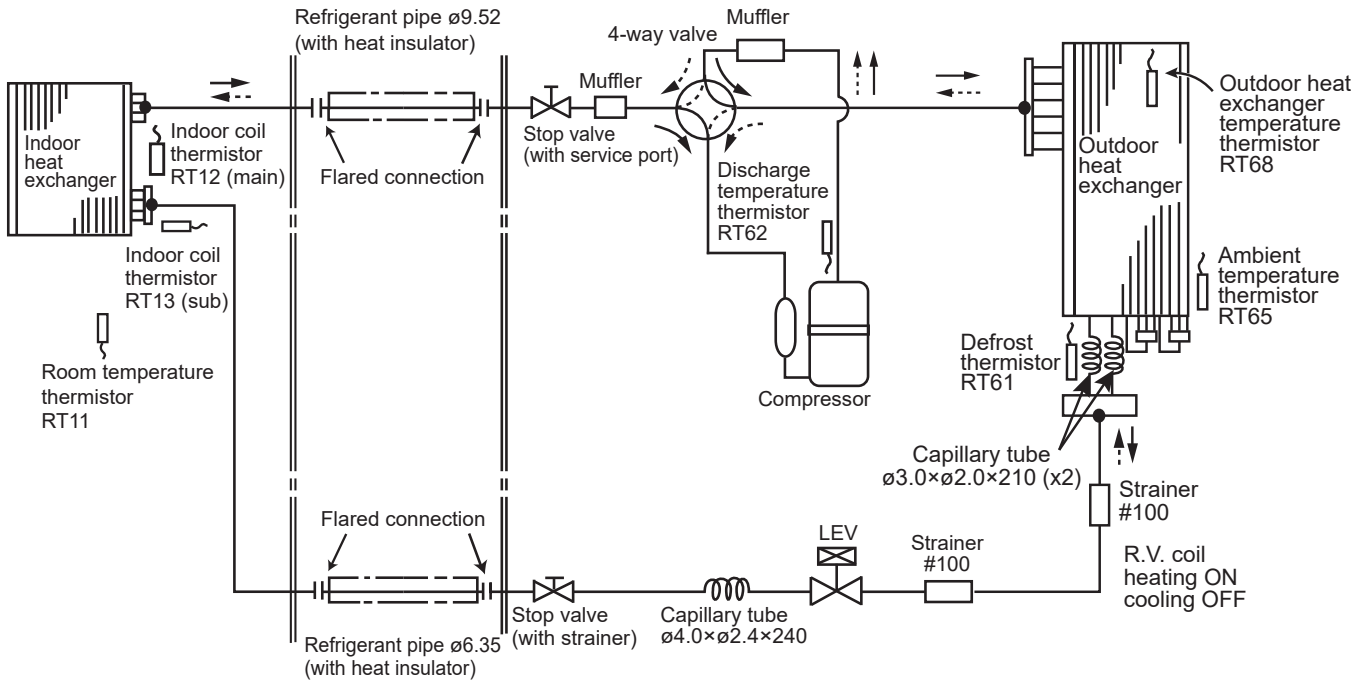


**MSZ-AP60VG
MSZ-AP60VGK**

MUZ-AP60VG

INDOOR UNIT

OUTDOOR UNIT

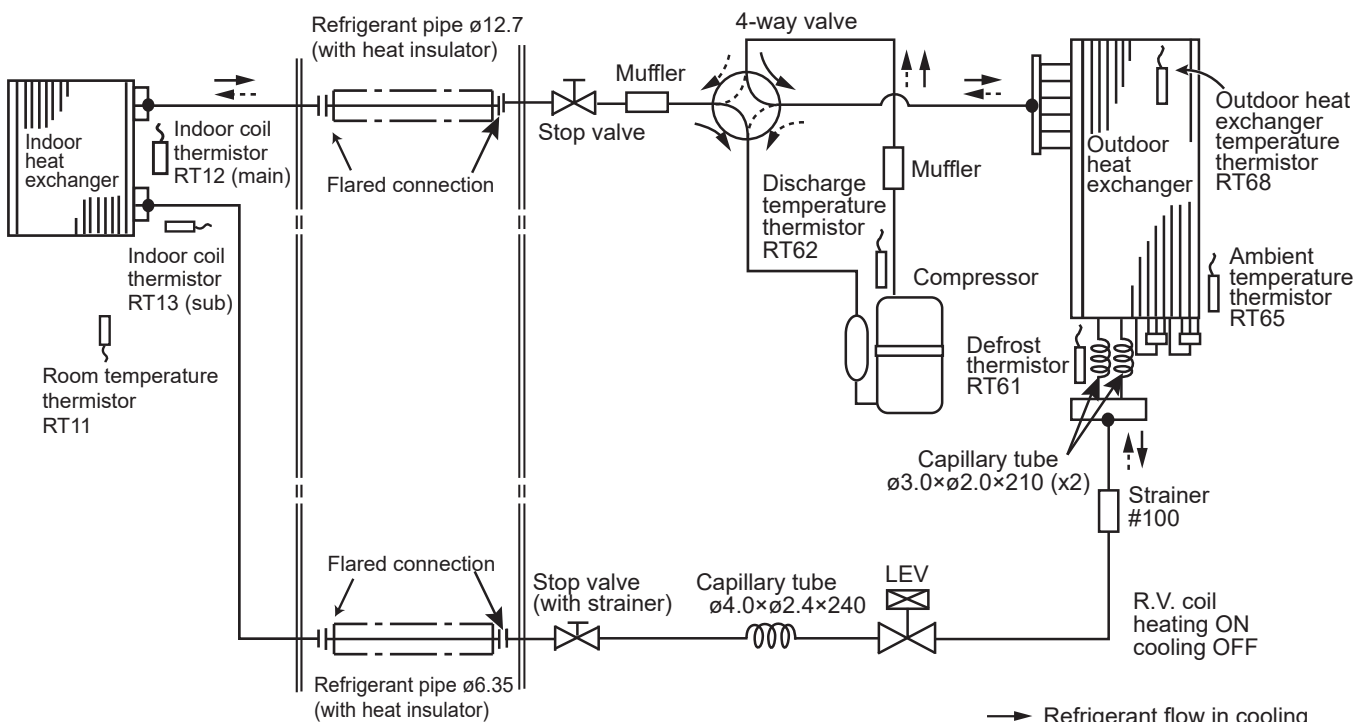

→ Refrigerant flow in cooling
 ··· Refrigerant flow in heating

WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM


Unit: mm

**MSZ-AP71VG
MSZ-AP71VGK**

MUZ-AP71VG

INDOOR UNIT

OUTDOOR UNIT

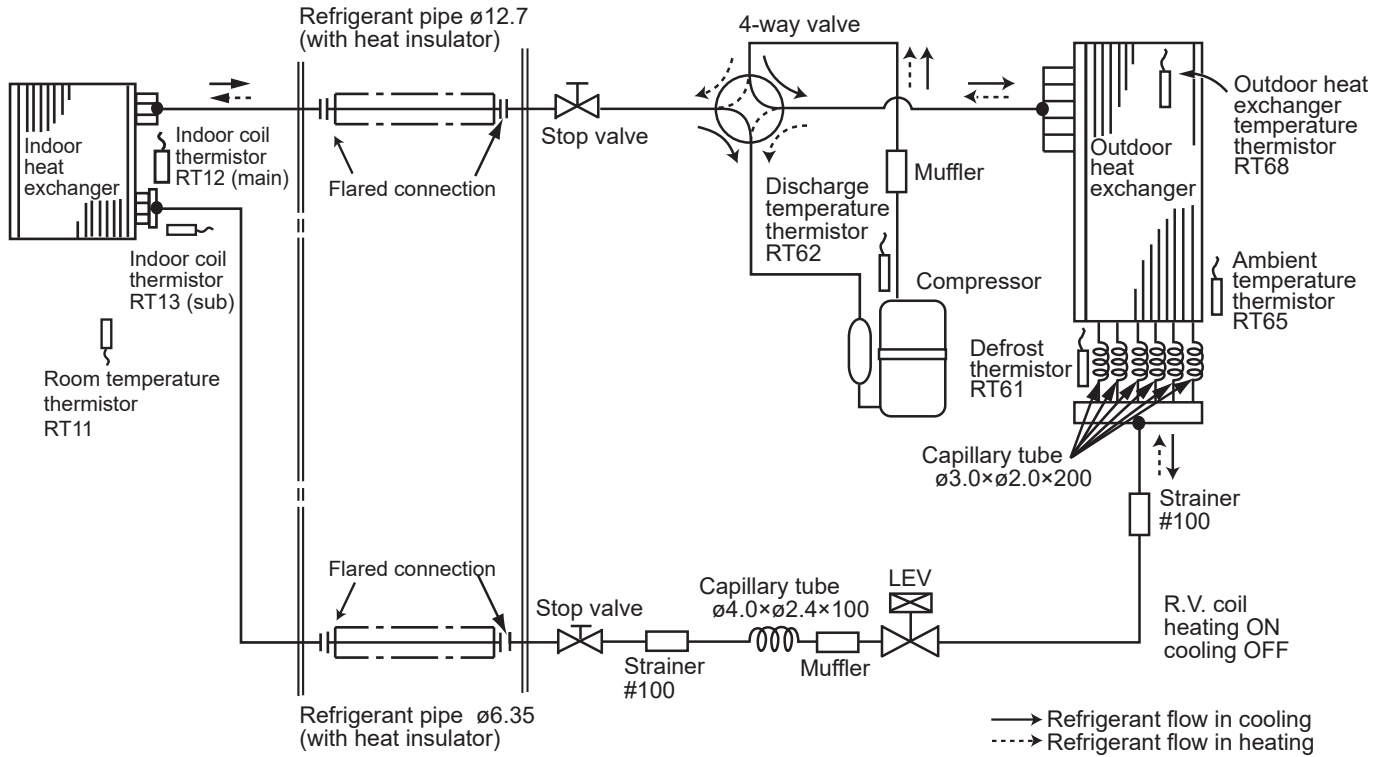


REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED

Unit: mm


MSZ-HR25VF
INDOOR UNIT

MUZ-HR25VF
OUTDOOR UNIT

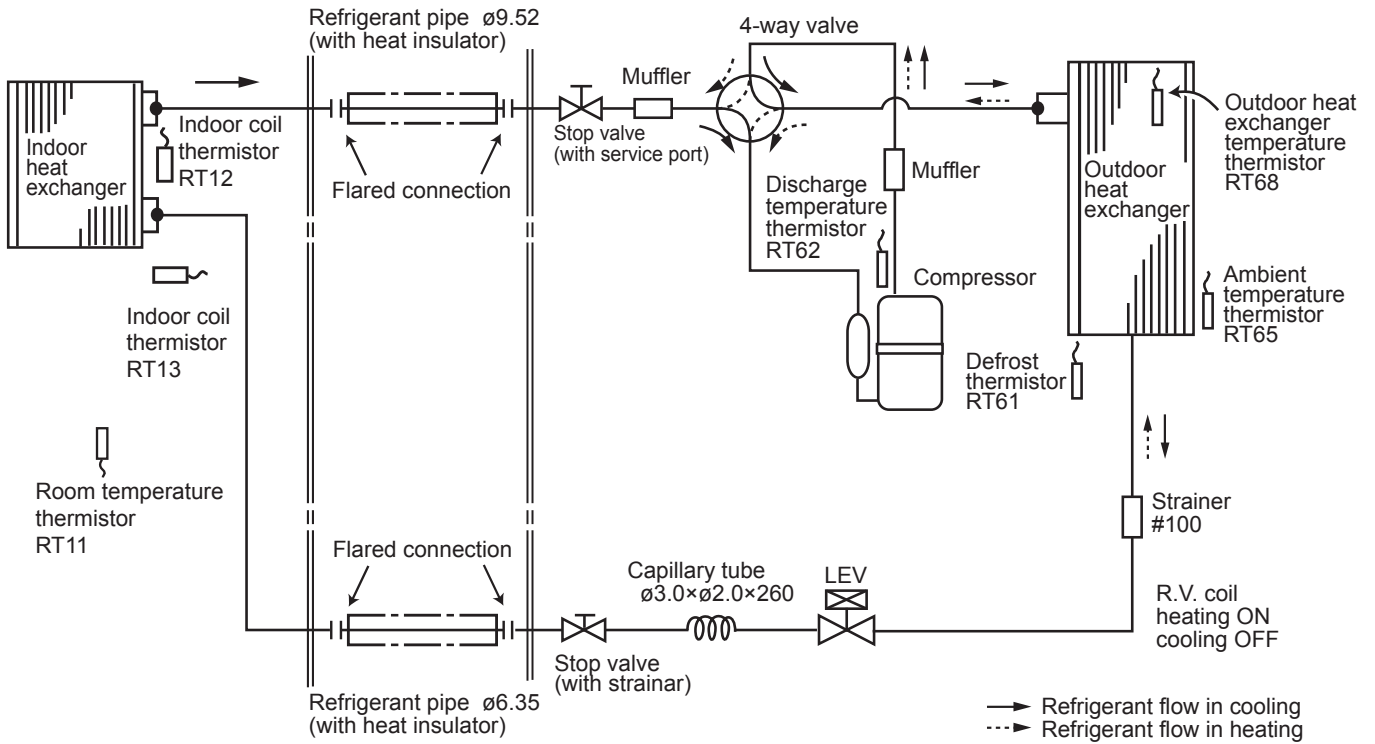

MSZ-HR35VF
INDOOR UNIT

MUZ-HR35VF
OUTDOOR UNIT

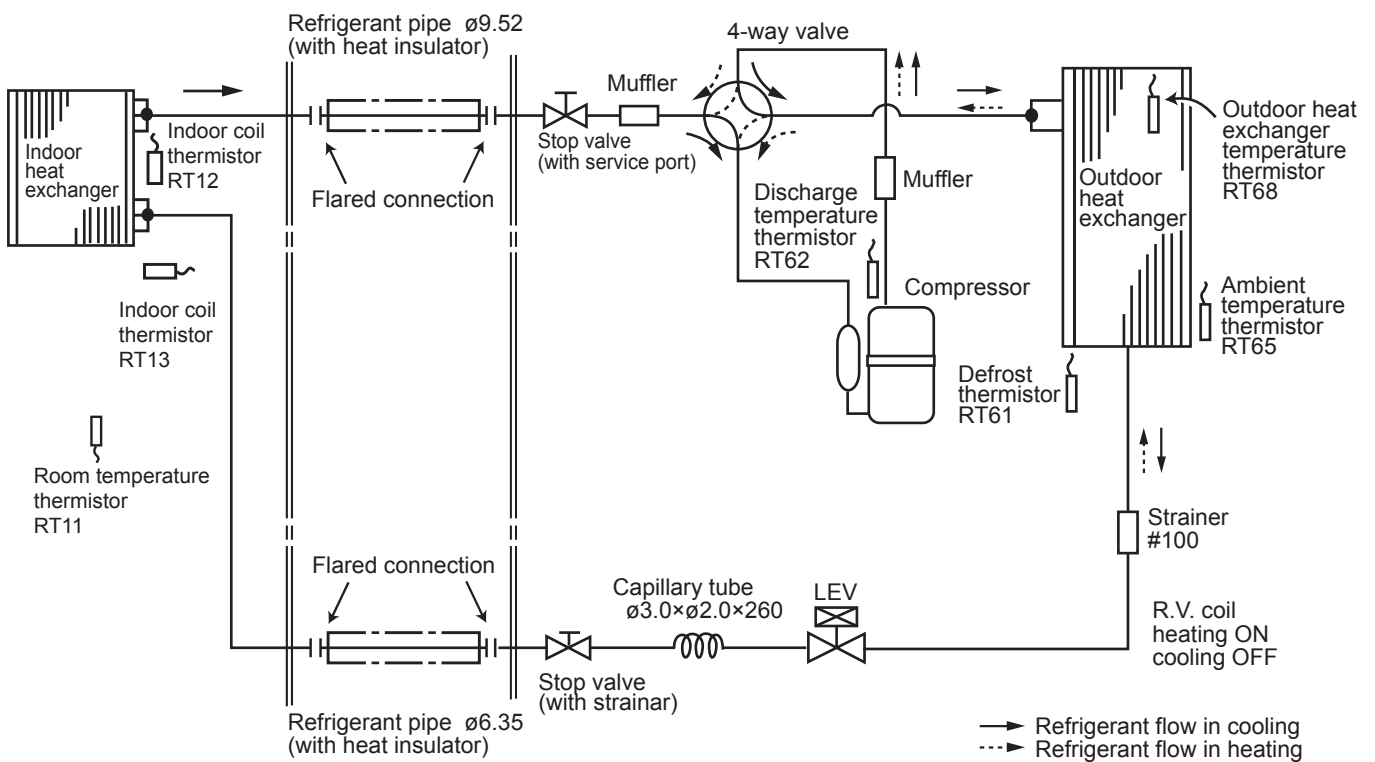

REFRIGERANT SYSTEM DIAGRAM

WALL-MOUNTED


Unit: mm

**MSZ-HR42VF
MSZ-HR50VF**

**MUZ-HR42VF
MUZ-HR50VF**

INDOOR UNIT

OUTDOOR UNIT

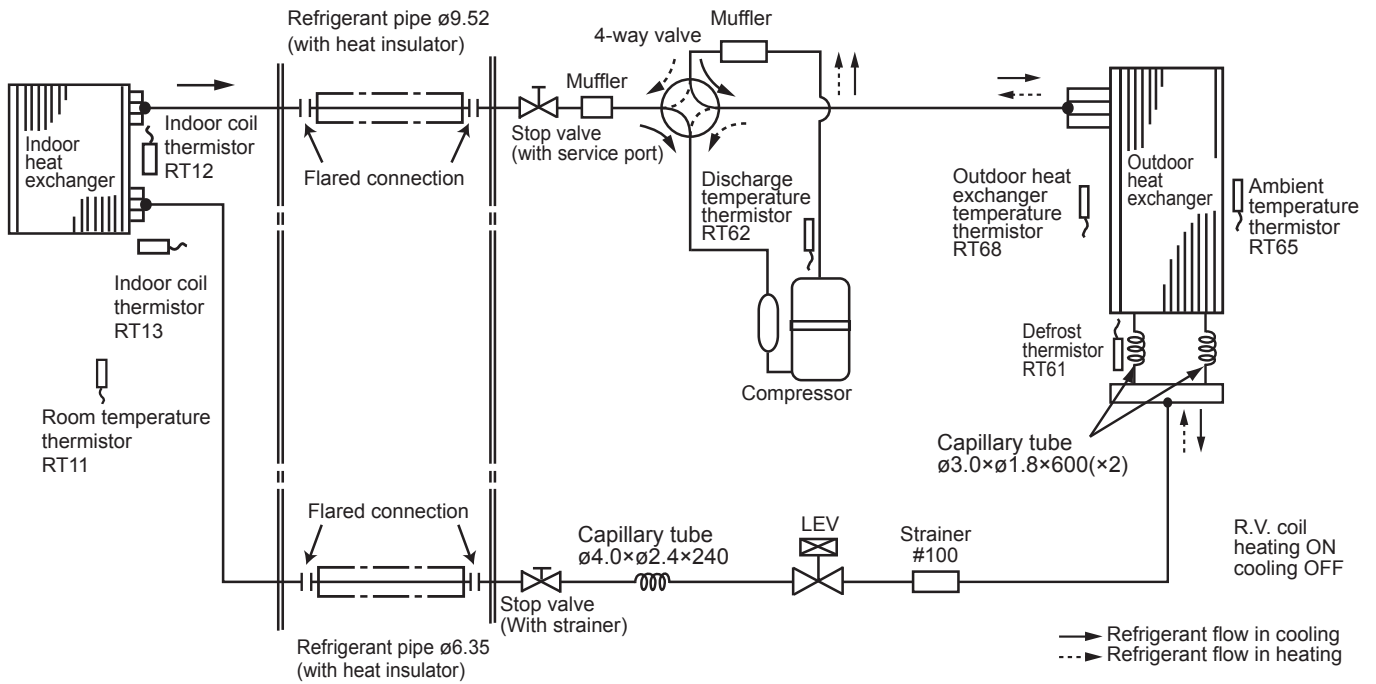


REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED

**MSY-TP35VF
MSY-TP50VF**

**MUY-TP35VF
MUY-TP50VF**

INDOOR UNIT


OUTDOOR UNIT

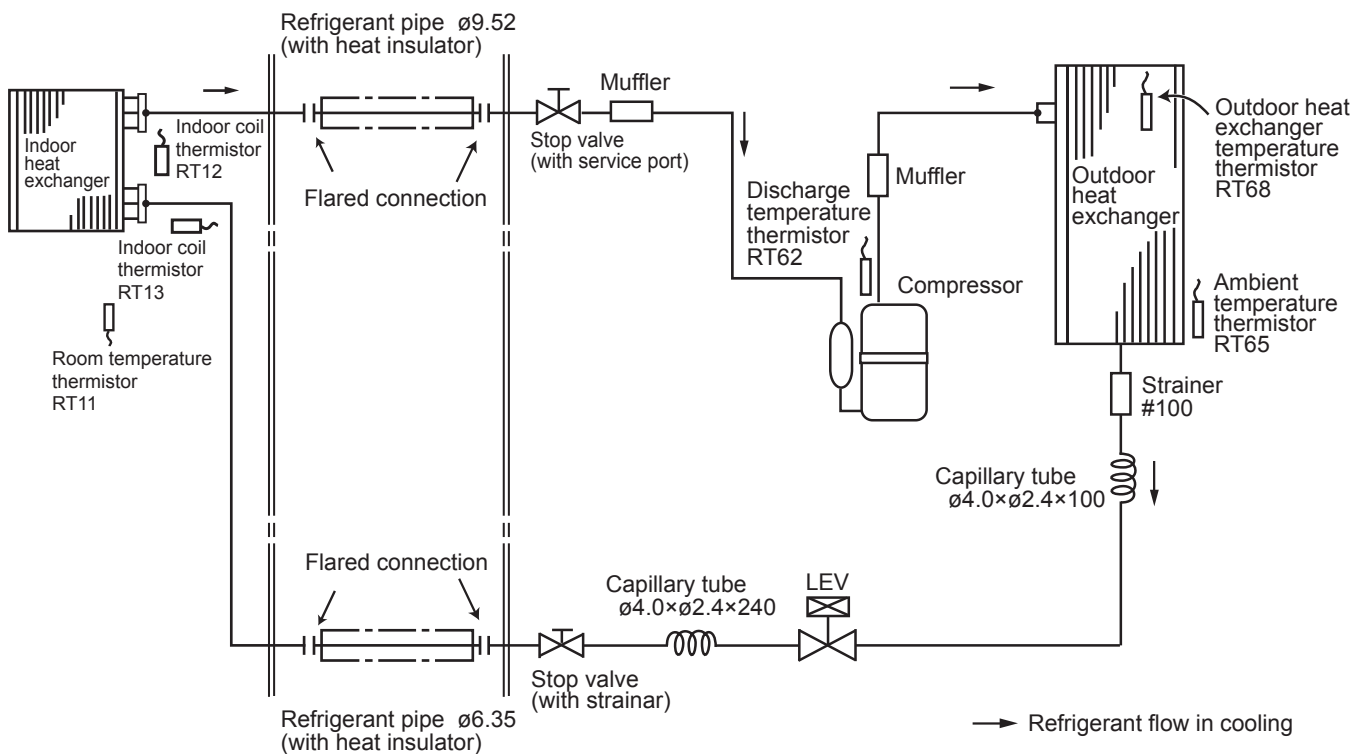

Unit: mm


MUZ-FH25VE
MUZ-FH25VEHZ
MUZ-FH35VE
MUZ-FH35VEHZ
OUTDOOR UNIT

MSZ-FH25VE2
MSZ-FH35VE2
INDOOR UNIT

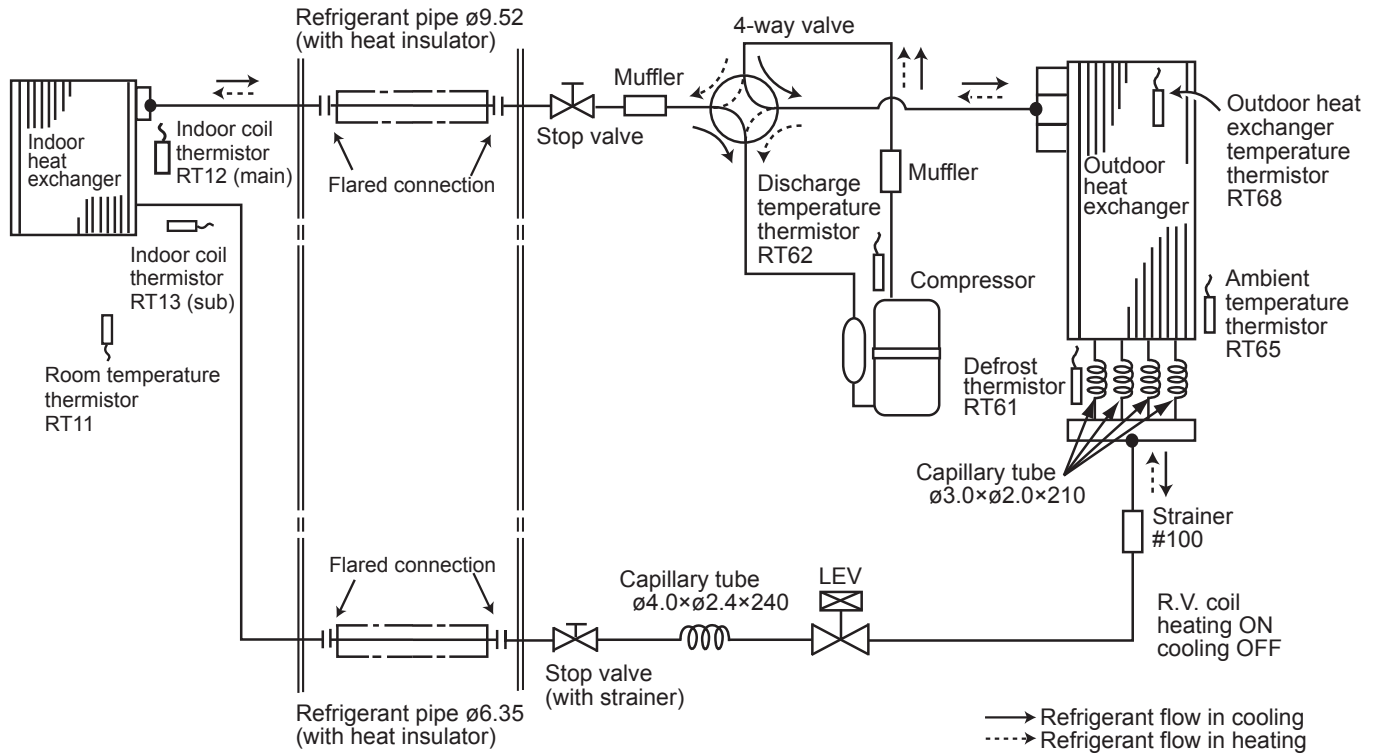

MSZ-FH50VE2
INDOOR UNIT

MUZ-FH50VE
MUZ-FH50VEHZ
OUTDOOR UNIT

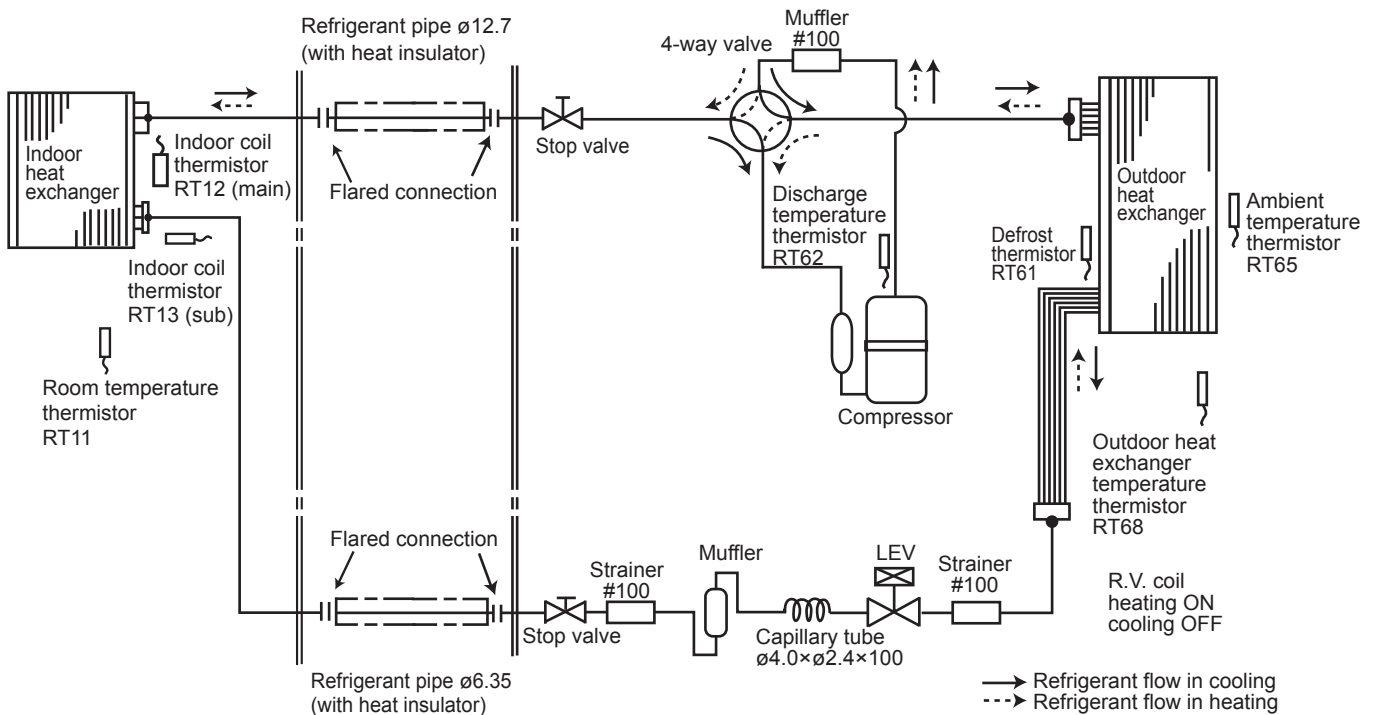


WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM

Unit: mm

MSZ-EF18VGW MSZ-EF22VGW
MSZ-EF18VGB MSZ-EF22VGB
MSZ-EF18VGS MSZ-EF22VGS

INDOOR UNIT

OUTDOOR UNIT

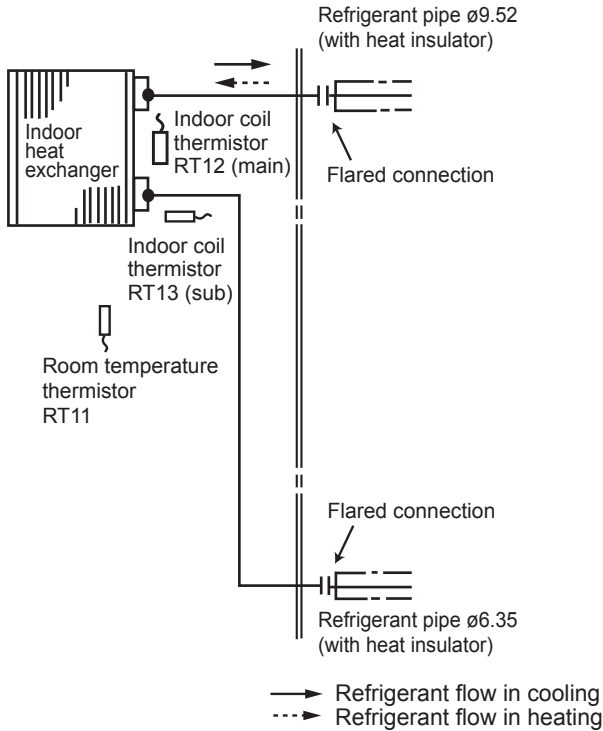


For MXZ connection

MSZ-EF25VGW MSZ-EF35VGW
MSZ-EF25VGB MSZ-EF35VGB
MSZ-EF25VGS MSZ-EF35VGS

MUZ-EF25VG MUZ-EF35VG
MUZ-EF25VGH MUZ-EF35VGH

INDOOR UNIT

OUTDOOR UNIT

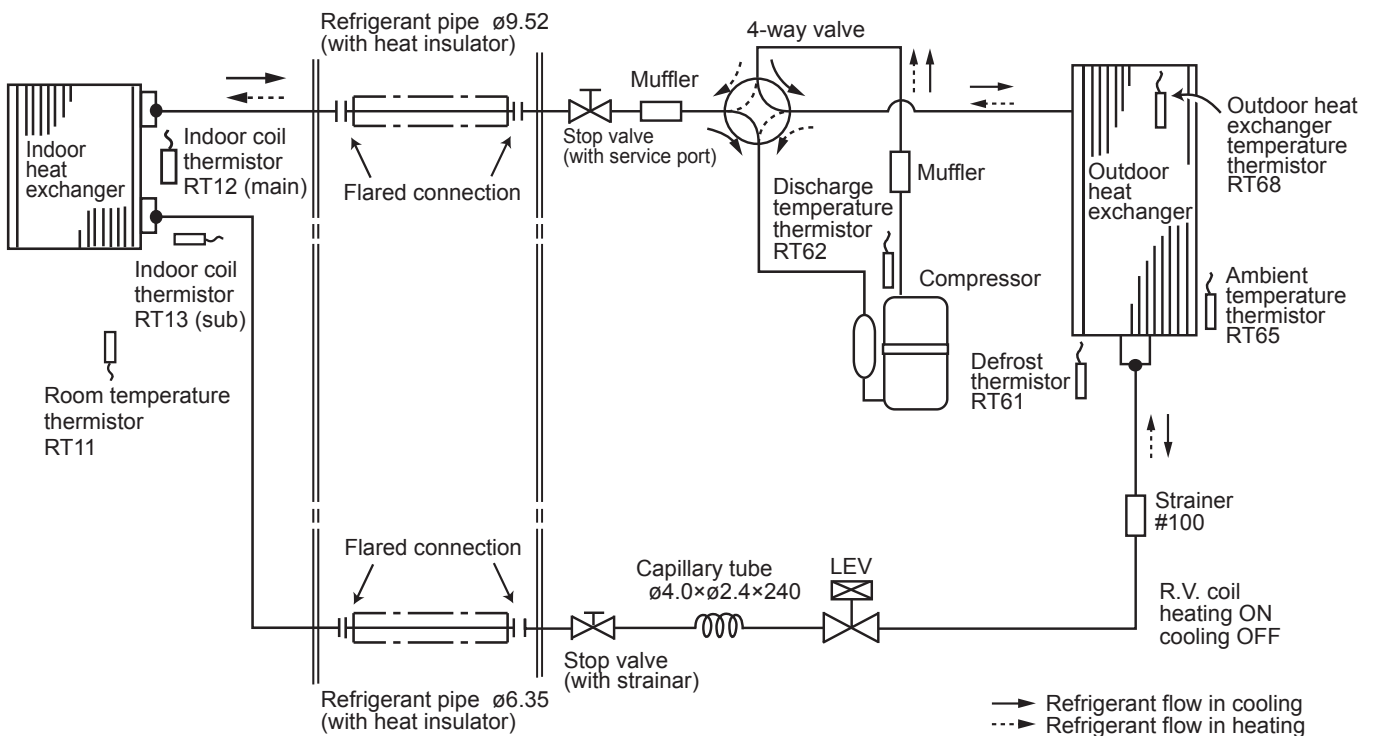

REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED


Unit: mm

MSZ-EF42VGW
MSZ-EF42VGB
MSZ-EF42VGS

MUZ-EF42VG

INDOOR UNIT

OUTDOOR UNIT

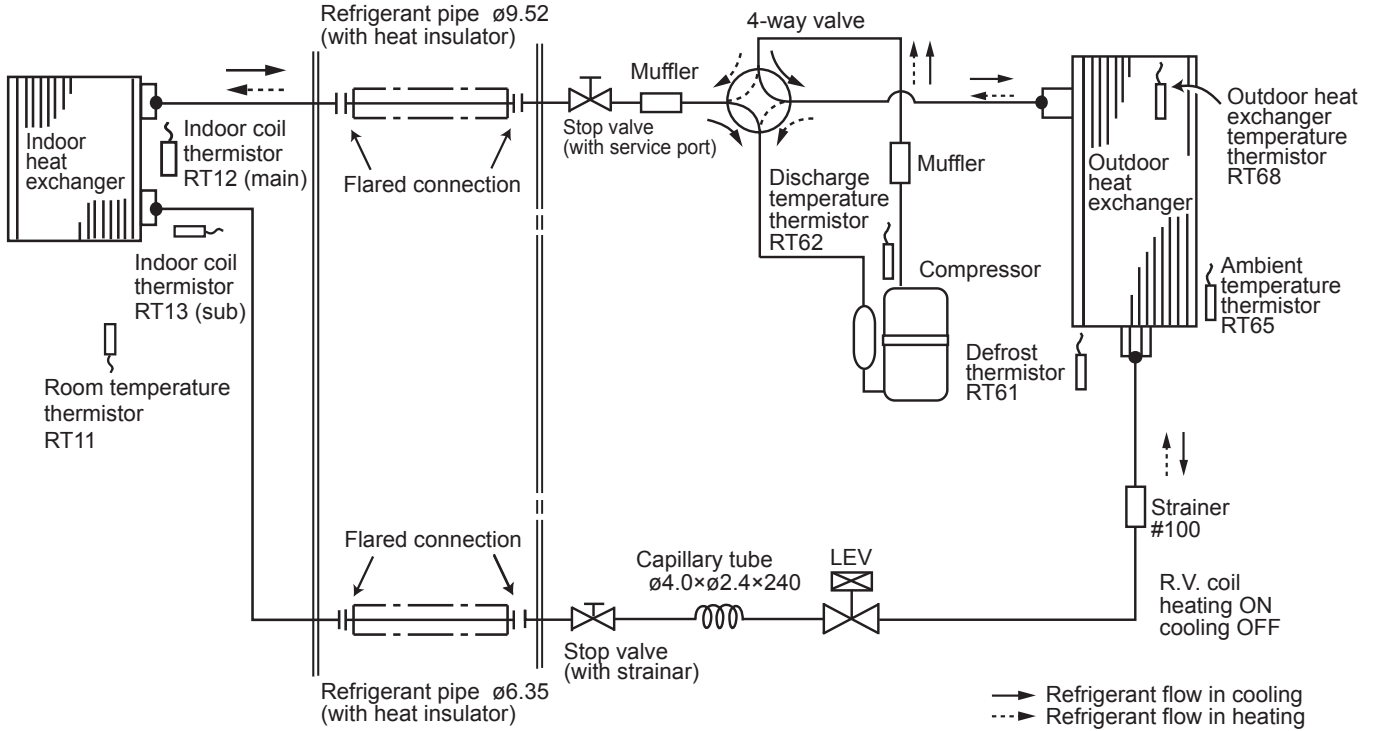


MSZ-EF50VGW
MSZ-EF50VGB
MSZ-EF50VGS

MUZ-EF50VG

INDOOR UNIT

OUTDOOR UNIT

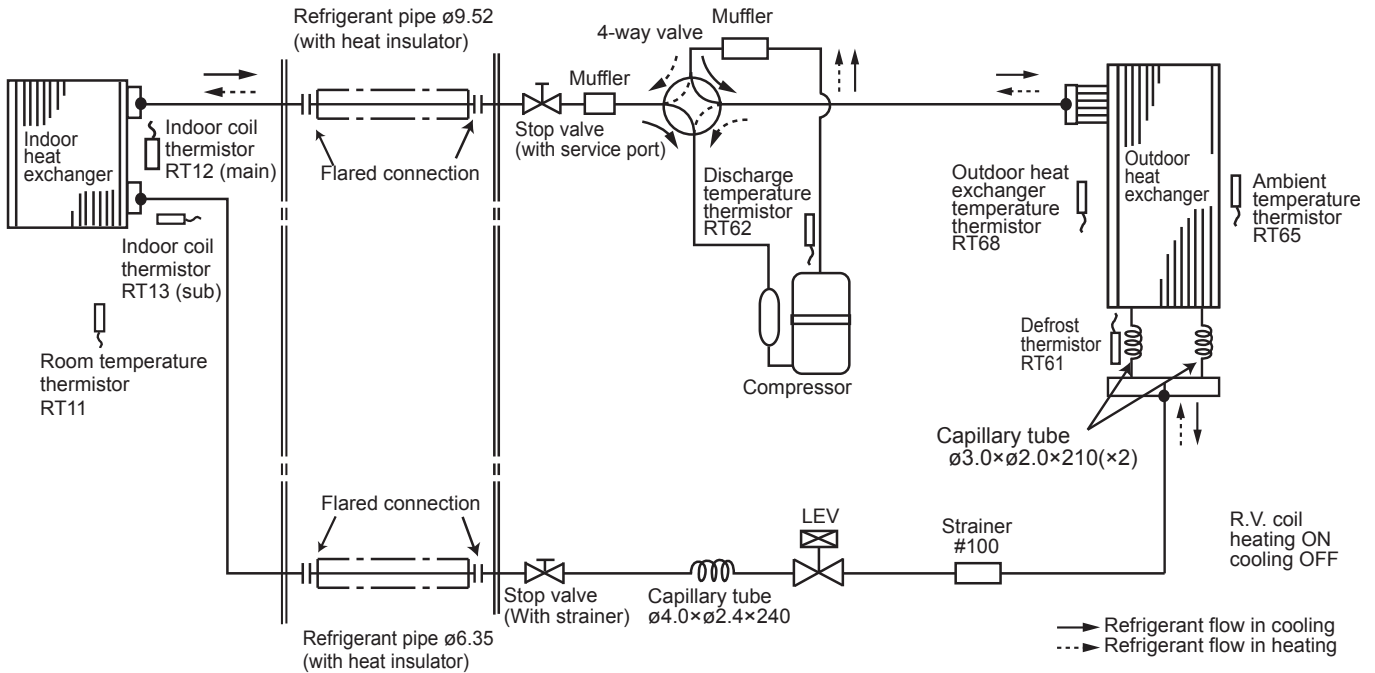


WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM

Unit: mm

MSZ-SF15VA
MSZ-SF20VA

INDOOR UNIT

OUTDOOR UNIT

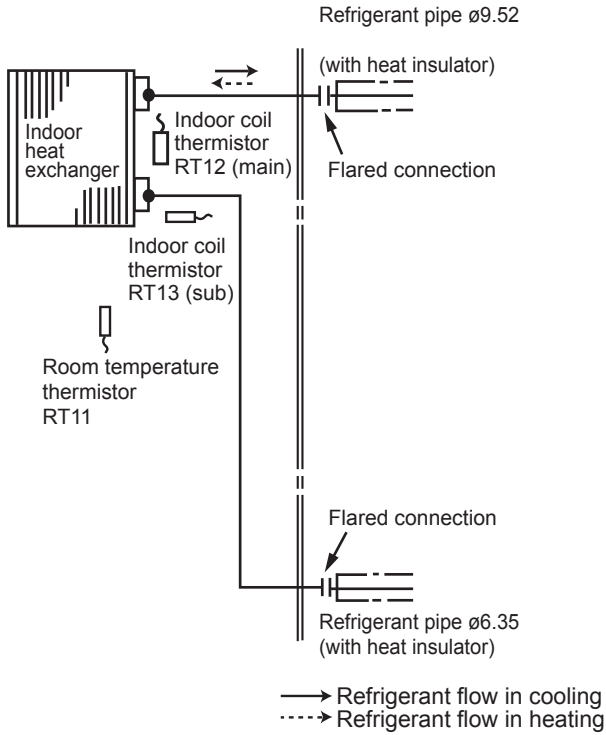


For MXZ connection

MSZ-SF25VE3
MSZ-SF35VE3

INDOOR UNIT

MUZ-SF25VE
MUZ-SF25VEH
MUZ-SF35VE
MUZ-SF35VEH

OUTDOOR UNIT

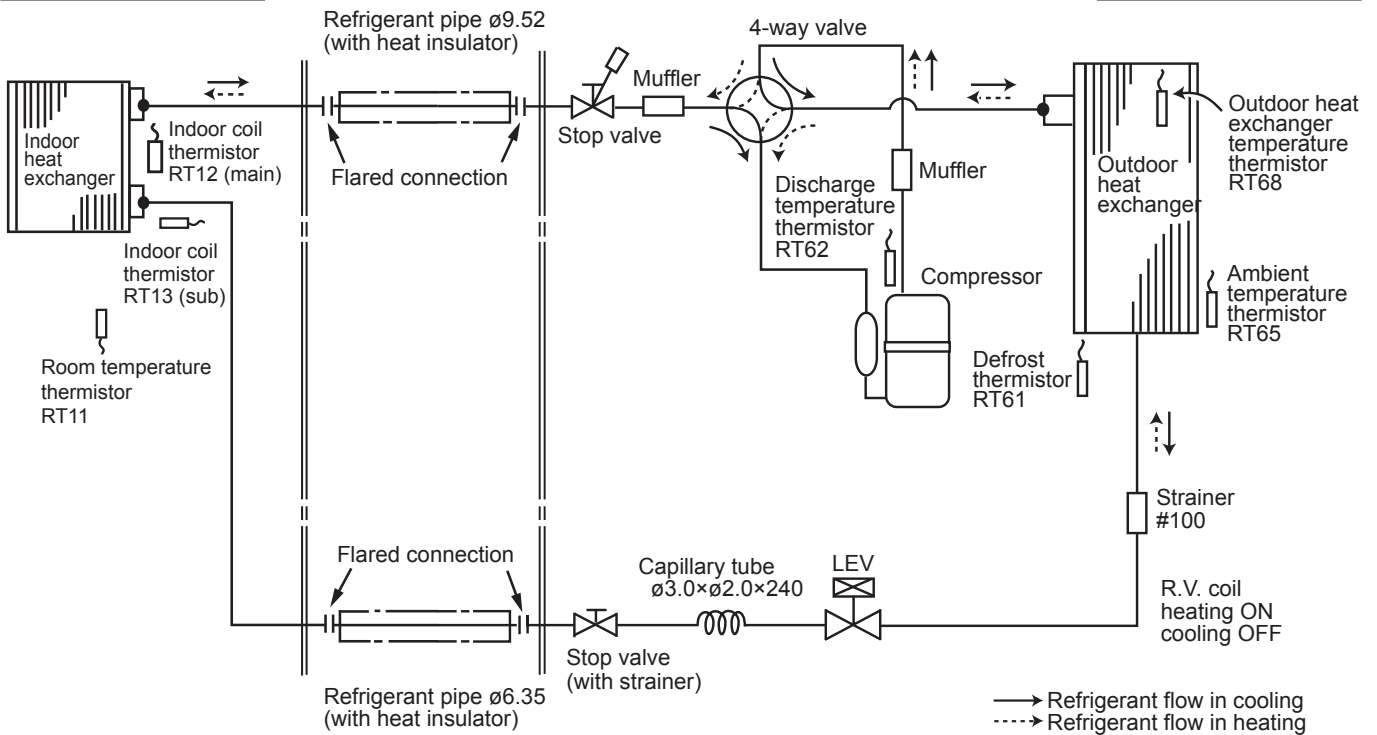

REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED

Unit: mm


MSZ-SF42VE3

INDOOR UNIT

MUZ-SF42VE

MUZ-SF42VEH

OUTDOOR UNIT

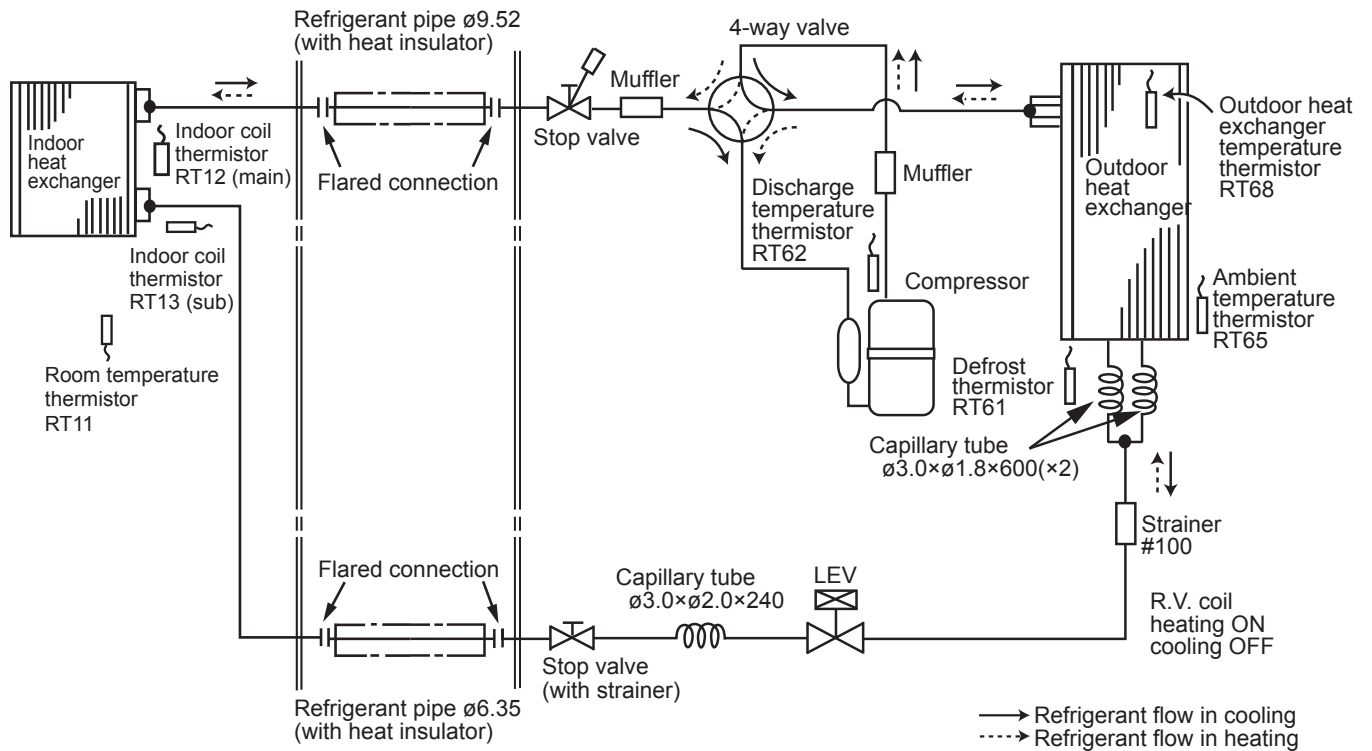


MSZ-SF50VE3

INDOOR UNIT

MUZ-SF50VE

MUZ-SF50VEH

OUTDOOR UNIT

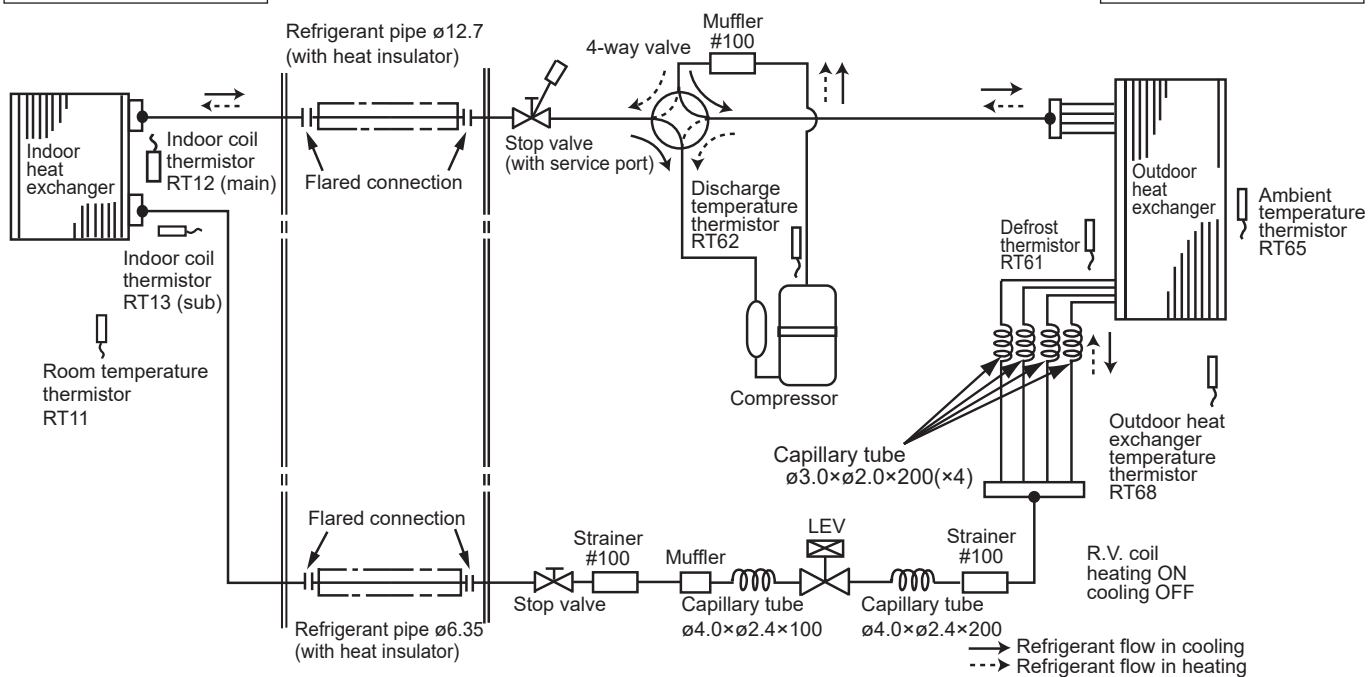

WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM


Unit: mm

MSZ-GF60VE2

INDOOR UNIT

MUZ-GF60VE

OUTDOOR UNIT

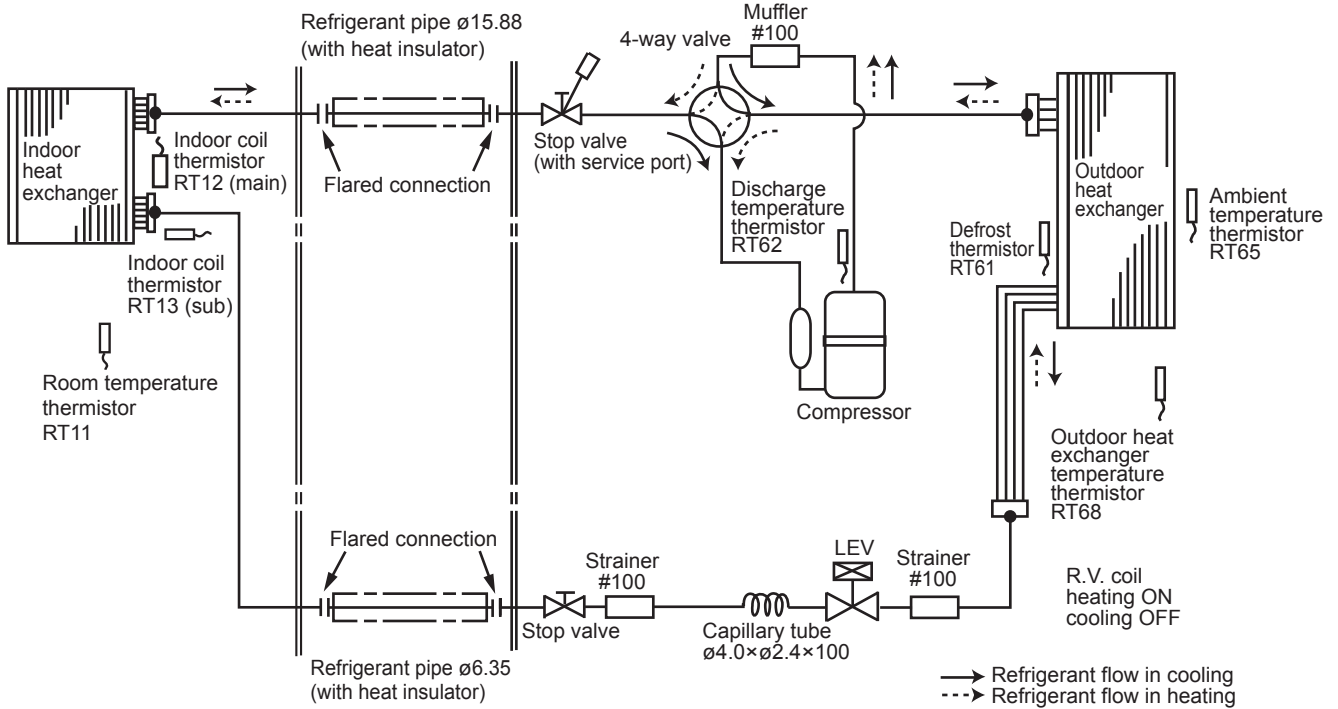


REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED

MSZ-GF71VE2

INDOOR UNIT

MUZ-GF71VE

OUTDOOR UNIT

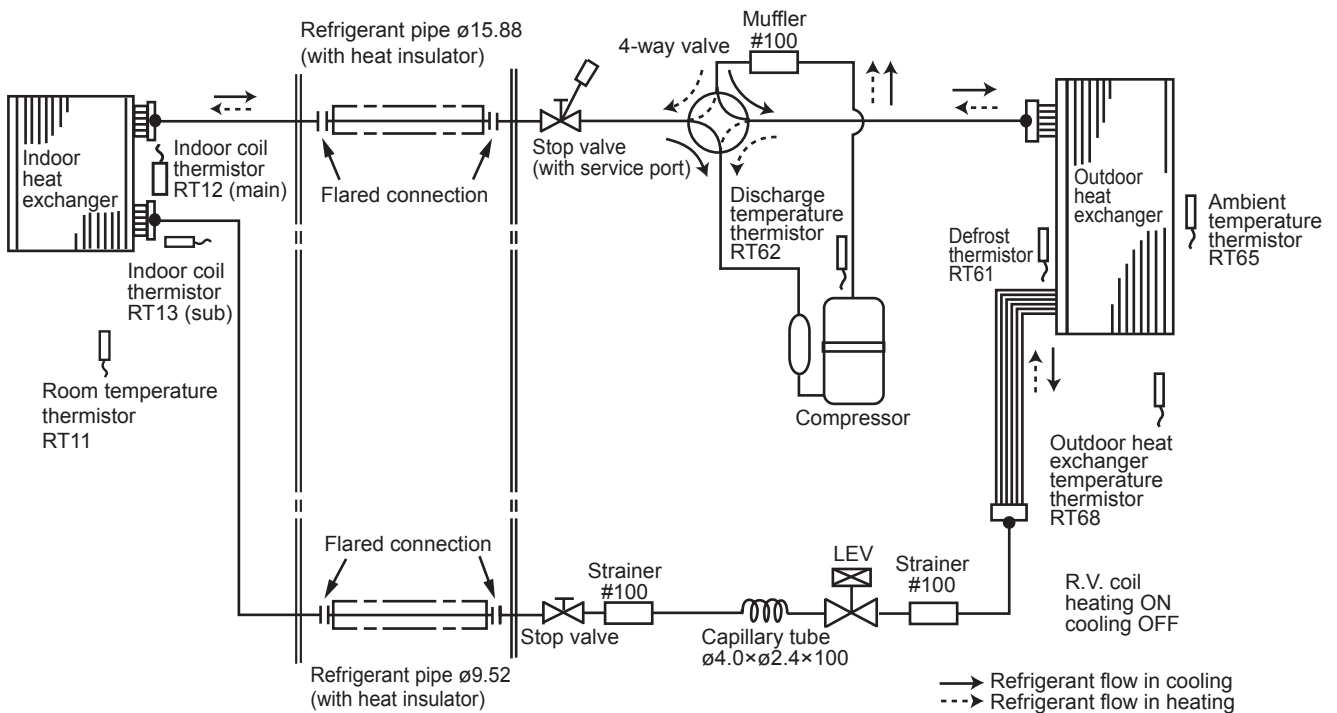


Unit: mm

MSZ-WN25VA
MSZ-WN35VA

MUZ-WN25VA
MUZ-WN35VA

INDOOR UNIT

OUTDOOR UNIT

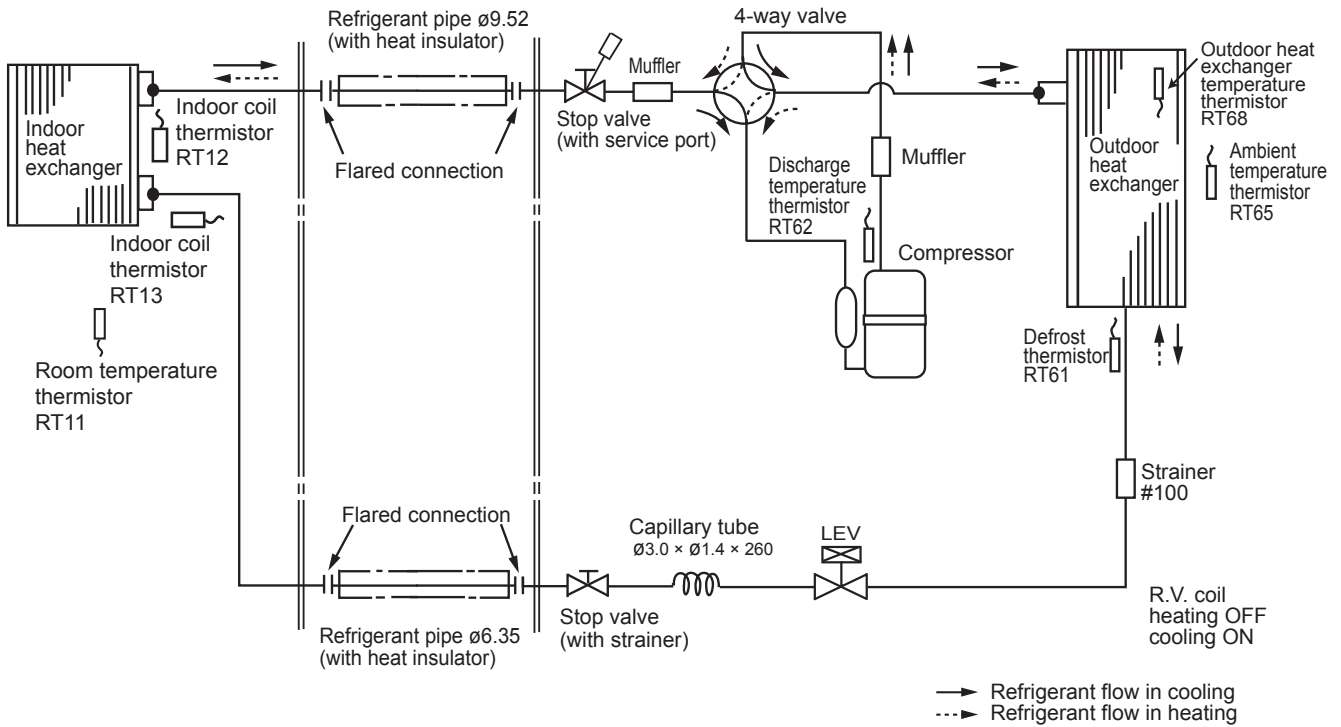


MSZ-DM25VA
MSZ-DM35VA
MSZ-HJ25VA
MSZ-HJ35VA

MUZ-DM25VA
MUZ-DM35VA
MUZ-HJ25VA
MUZ-HJ35VA

INDOOR UNIT

OUTDOOR UNIT

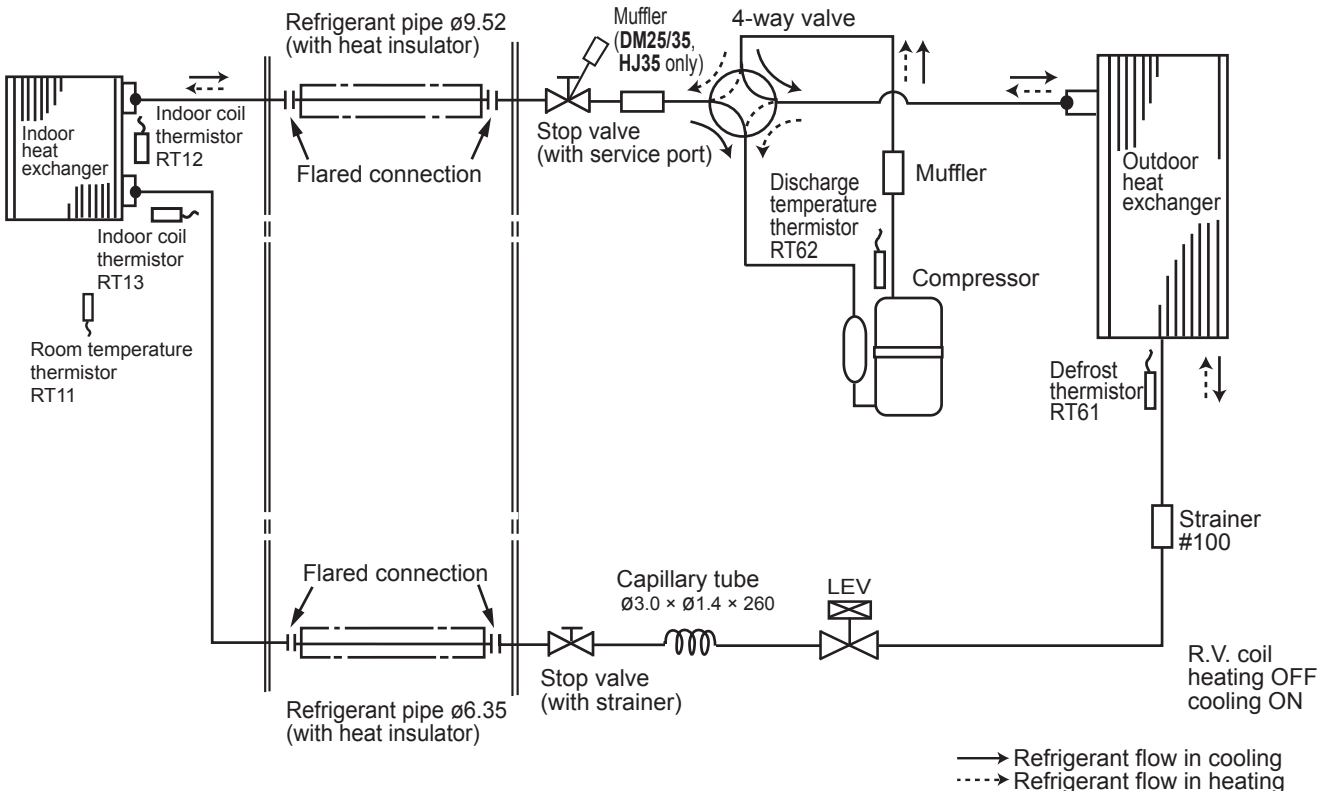

WALL-MOUNTED REFRIGERANT SYSTEM DIAGRAM


Unit: mm

MSZ-HJ50VA

MUZ-HJ50VA

INDOOR UNIT

OUTDOOR UNIT

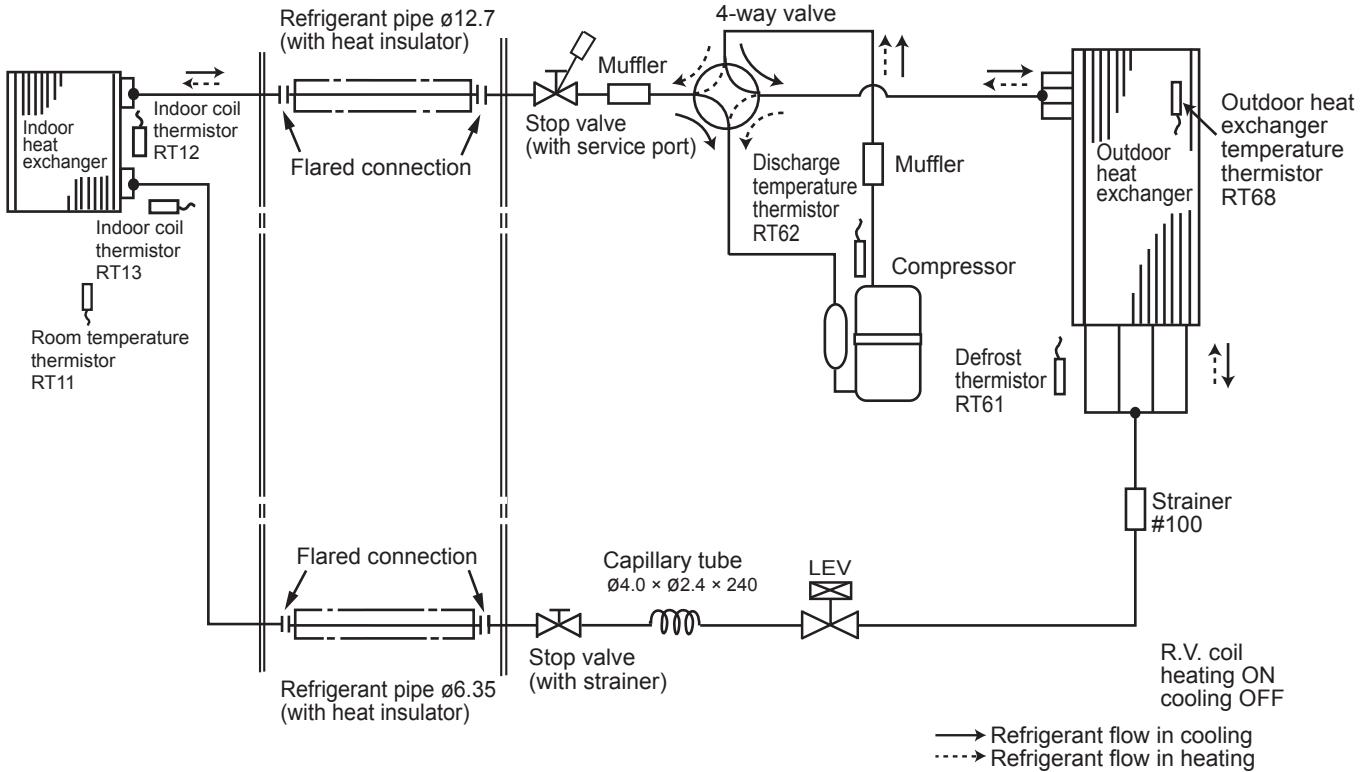


MSZ-HJ60VA

MUZ-HJ60VA

INDOOR UNIT

OUTDOOR UNIT

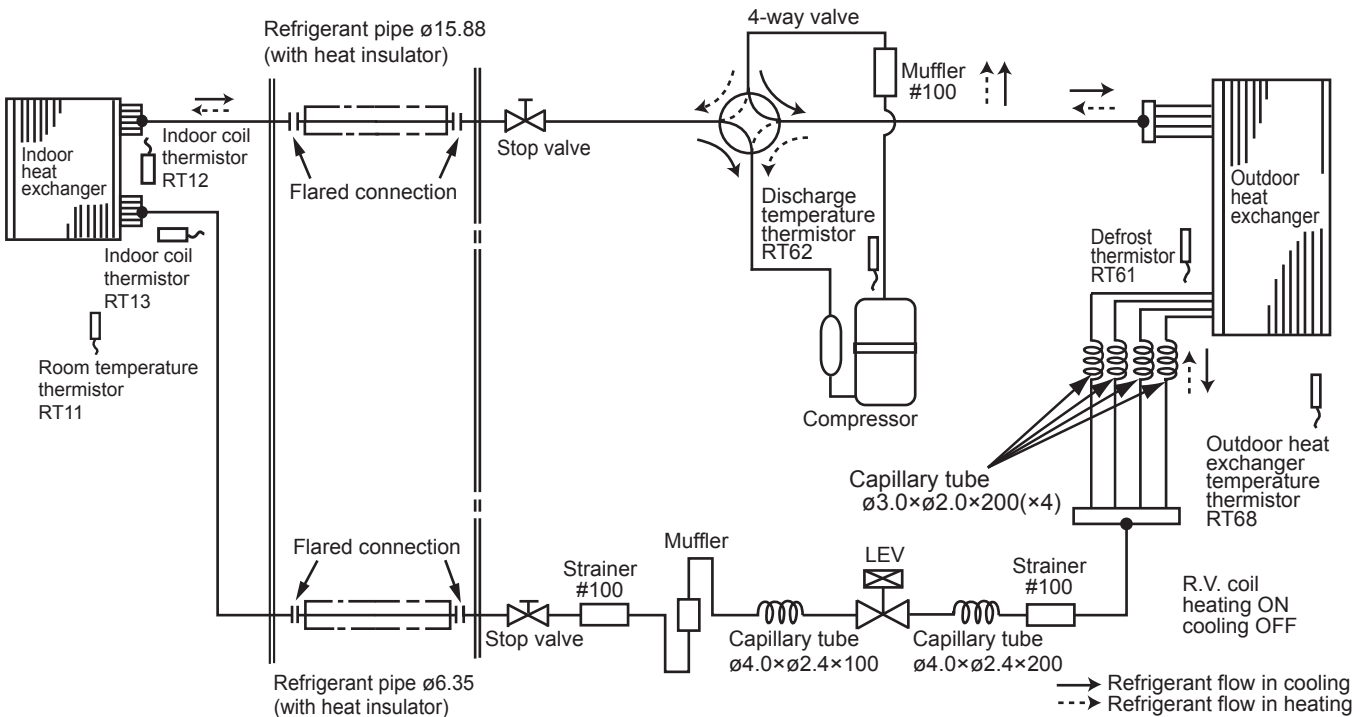

REFRIGERANT SYSTEM DIAGRAM WALL-MOUNTED


Unit: mm

MSZ-HJ71VA

MUZ-HJ71VA

INDOOR UNIT

OUTDOOR UNIT

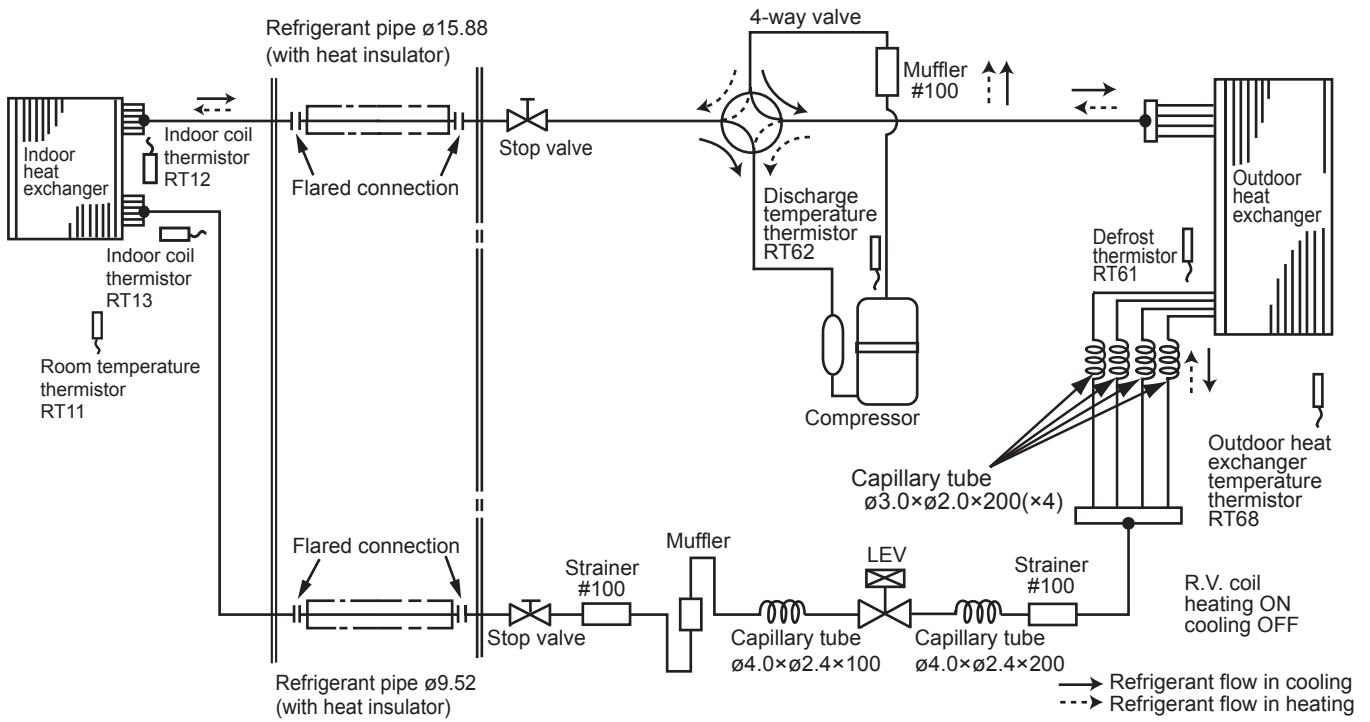

REFRIGERANT SYSTEM DIAGRAM

WALL-MOUNTED

C.1.5 PERFORMANCE CURVES

The standard specifications apply only to the operation of the air conditioner under normal conditions, since operating conditions vary according to the areas where these units are installed. The following information has been provided to clarify the operating characteristics of the air conditioner under the conditions indicated by the performance curve.

(1) GUARANTEED VOLTAGE

198~264 V, (50 Hz)

(2) AIR FLOW

Air flow should be set at MAX.


(3) MAIN READINGS

- | | | | |
|---|------|---|---------|
| (1) Indoor intake air wet-bulb temperature : | °CWB | } | Cooling |
| (2) Indoor outlet air wet-bulb temperature : | °CWB | | |
| (3) Outdoor intake air dry-bulb temperature : | °CDB | } | Heating |
| (4) Total input : | W | | |
| (5) Indoor intake air dry-bulb temperature : | °CDB | } | Heating |
| (6) Outdoor intake air wet-bulb temperature : | °CWB | | |
| (7) Total input : | W | | |

Indoor air wet and dry bulb temperature difference on the left side of the following chart shows the difference between the indoor intake air wet and dry bulb temperature and the indoor outlet air wet and dry bulb temperature for your reference at service.





How to measure the indoor air wet/dry bulb temperature difference

- Attach at least 2 sets of wet and dry bulb thermometers to the indoor air intake as shown in the figure, and at least 2 sets of wet and dry bulb thermometers to the indoor air outlet. The thermometers must be attached to the position where air speed is high.
- Attach at least 2 sets of wet and dry bulb thermometers to the outdoor air intake. Cover the thermometers to prevent direct rays of the sun.
- Check that the air filter is cleaned.
- Open windows and doors of room.
- Press the EMERGENCY OPERATION switch once (twice) to start the EMERGENCY COOL (HEAT) MODE.
- When system stabilizes after more than 15 minutes, measure temperature and take an average temperature.
- 10 minutes later, measure temperature again and check that the temperature does not change.




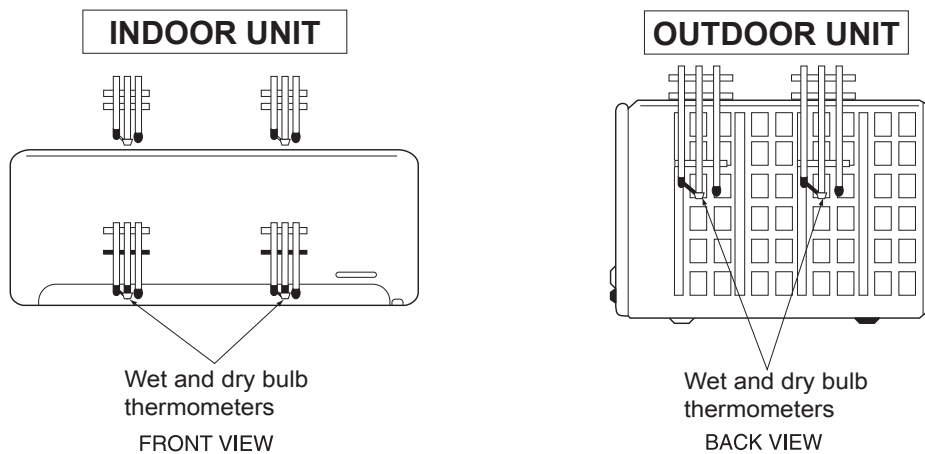


C.1.5.1 Inverter

CAPACITY AND THE INPUT CURVES

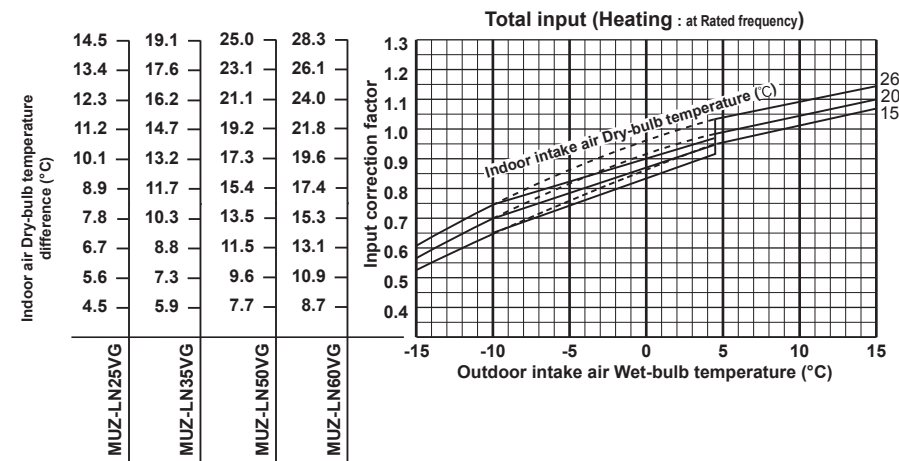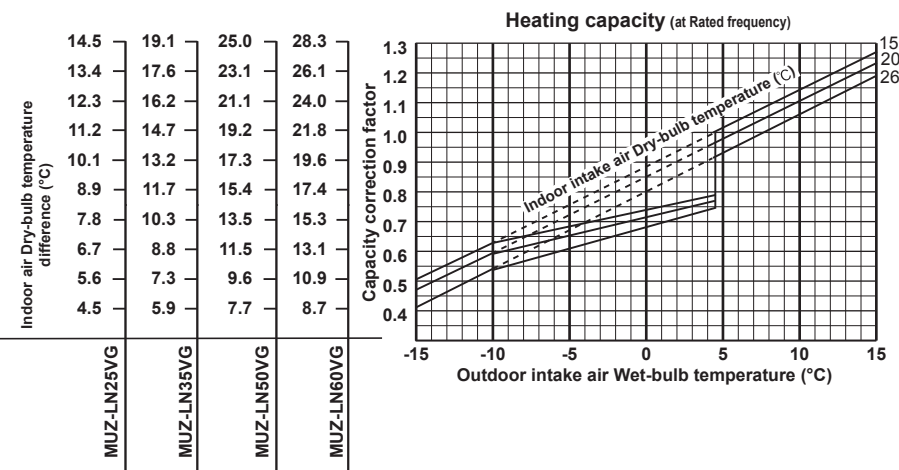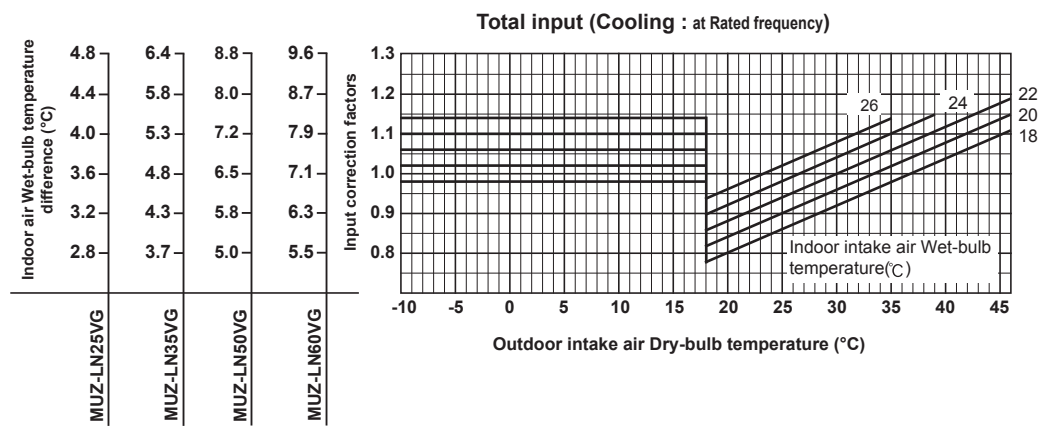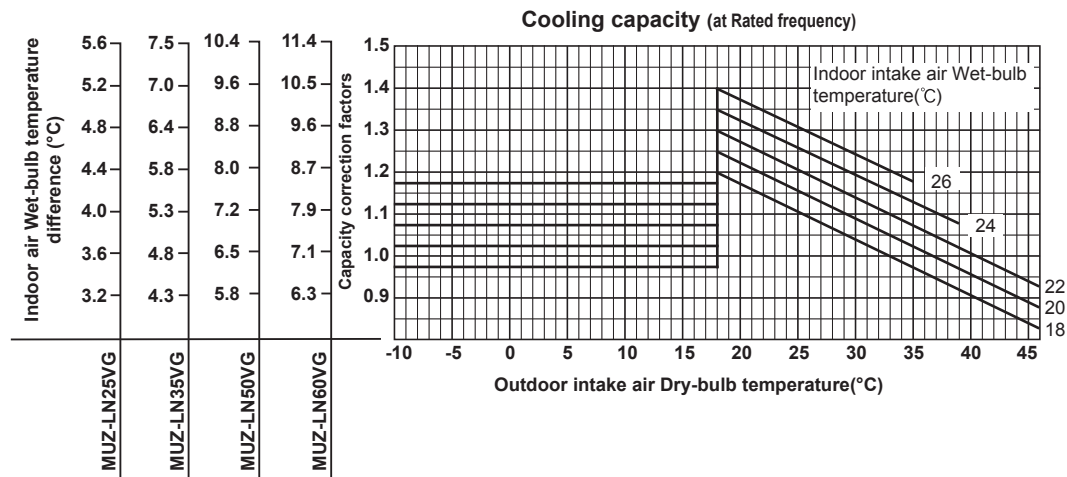


WALL-MOUNTED PERFORMANCE CURVES

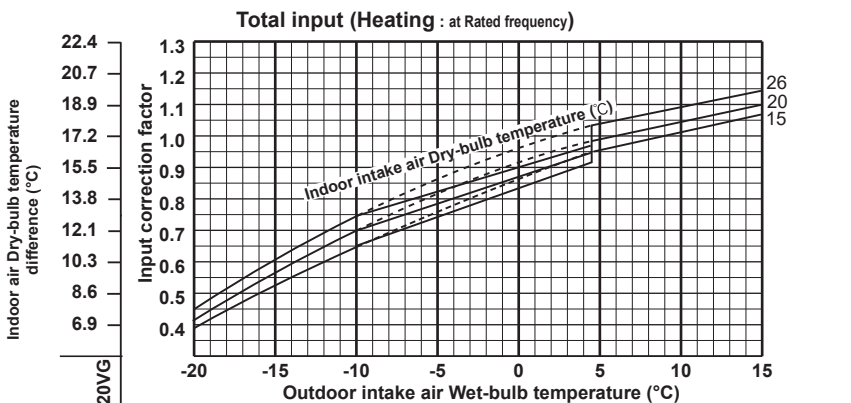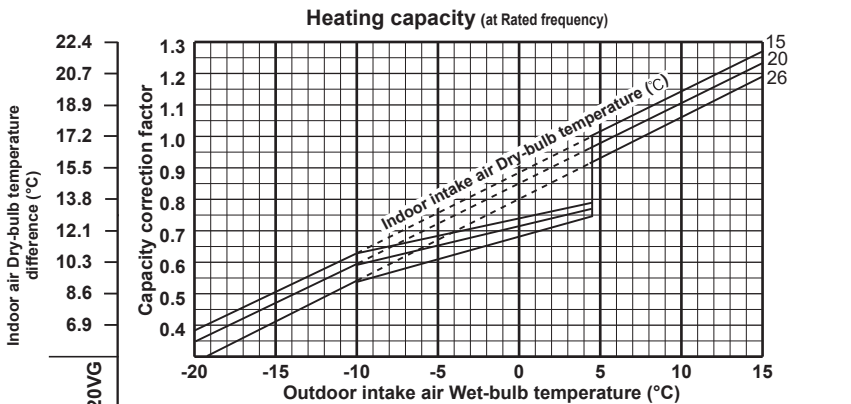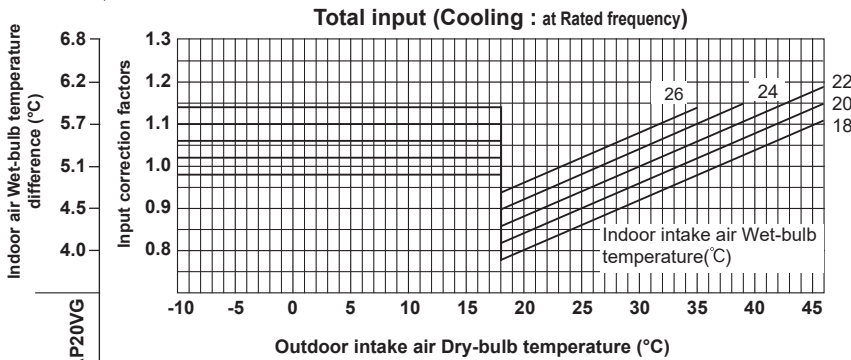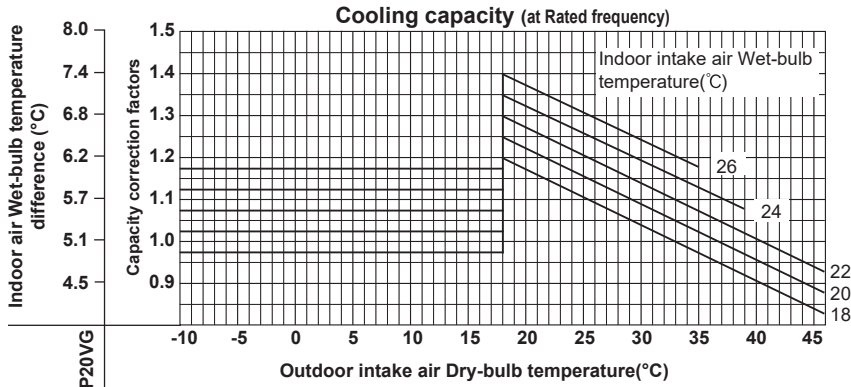


Lower limit of guaranteed operating range in heating
MUZ-AP20VG: -15°C

NOTE: The above broken lines are for the heating operation without any frost and defrost operation.


Indoor air Wet-bulb temperature difference (°C)	5.9	8.6	10.7	11.7	9.1	11.2
	5.4	7.9	9.9	10.8	8.4	10.3
	5.0	7.3	9.0	9.9	7.7	9.4
	4.6	6.7	8.2	9.0	7.0	8.6
	4.2	6.0	7.4	8.1	6.4	7.7
	3.8	5.4	6.7	7.2	5.7	6.9
	3.4	4.8	5.9	6.4	5.1	6.1
	MUZ-AP25VG MUZ-AP25VGH	MUZ-AP35VG MUZ-AP35VGH	MUZ-AP42VG MUZ-AP42VGH	MUZ-AP50VG MUZ-AP50VGH	MUZ-AP60VG	MUZ-AP71VG

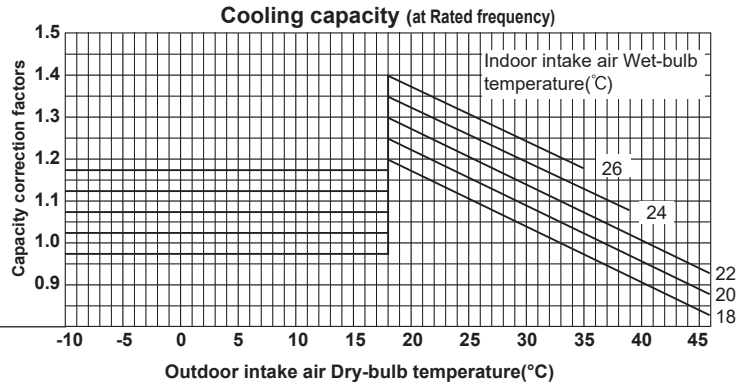


Indoor air Wet-bulb temperature difference (°C)	5.0	7.3	9.0	9.9	7.7	9.4
	4.6	6.7	8.2	9.0	7.0	8.6
	4.2	6.0	7.4	8.1	6.4	7.7
	3.8	5.4	6.7	7.2	5.7	6.9
	3.4	4.8	5.9	6.4	5.1	6.1
	3.0	4.2	5.2	5.6	4.5	5.4
	MUZ-AP25VG MUZ-AP25VGH	MUZ-AP35VG MUZ-AP35VGH	MUZ-AP42VG MUZ-AP42VGH	MUZ-AP50VG MUZ-AP50VGH	MUZ-AP60VG	MUZ-AP71VG

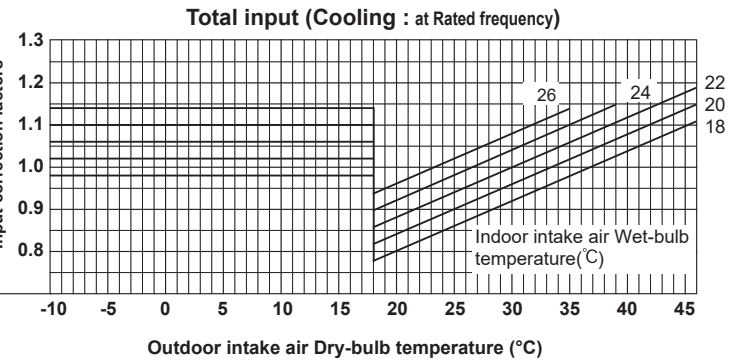

Indoor air Dry-bulb temperature difference (°C)	16.2	20.3	25.2	27.1	21.9	27.6
	15.0	18.7	23.3	25.0	20.2	25.5
	13.7	17.2	21.3	22.9	18.5	23.3
	12.5	15.6	19.4	20.8	16.8	21.2
	11.2	14.0	17.5	18.8	15.2	19.1
	10.0	12.5	15.5	16.7	13.5	17.0
	8.7	10.9	13.6	14.6	11.8	14.9
	7.5	9.4	11.6	12.5	10.1	12.7
	6.2	7.8	9.7	10.4	8.4	10.6
	5.0	6.2	7.8	8.3	6.7	8.5
	MUZ-AP25VG MUZ-AP25VGH	MUZ-AP35VG MUZ-AP35VGH	MUZ-AP42VG MUZ-AP42VGH	MUZ-AP50VG MUZ-AP50VGH	MUZ-AP60VG	MUZ-AP71VG




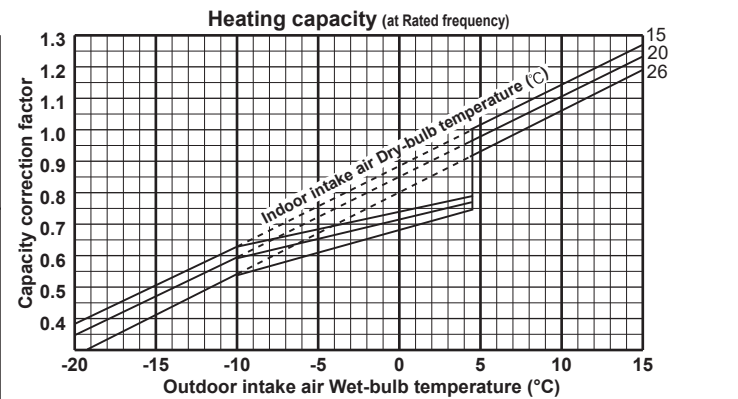


Indoor air Dry-bulb temperature difference (°C)	16.2	20.3	25.2	27.1	21.9	27.6
	15.0	18.7	23.3	25.0	20.2	25.5
	13.7	17.2	21.3	22.9	18.5	23.3
	12.5	15.6	19.4	20.8	16.8	21.2
	11.2	14.0	17.5	18.8	15.2	19.1
	10.0	12.5	15.5	16.7	13.5	17.0
	8.7	10.9	13.6	14.6	11.8	14.9
	7.5	9.4	11.6	12.5	10.1	12.7
	6.2	7.8	9.7	10.4	8.4	10.6
	5.0	6.2	7.8	8.3	6.7	8.5
	MUZ-AP25VG MUZ-AP25VGH	MUZ-AP35VG MUZ-AP35VGH	MUZ-AP42VG MUZ-AP42VGH	MUZ-AP50VG MUZ-AP50VGH	MUZ-AP60VG	MUZ-AP71VG

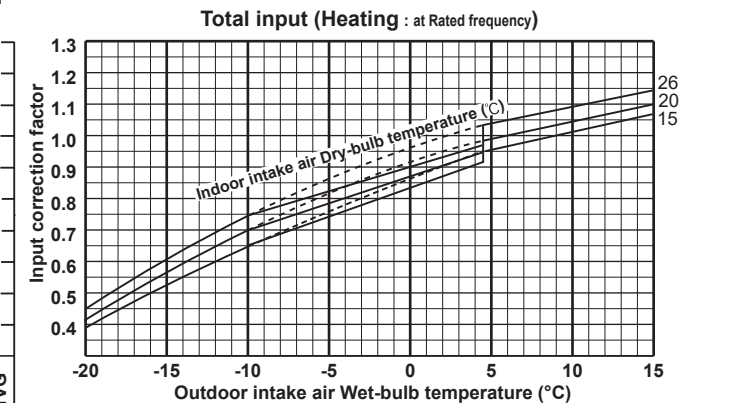



Lower limit of guaranteed operating range in heating
 MUZ-AP25/35/42/50/60/71VG: -15°C
 MUZ-AP25/35/42/50VGH: -20°C





NOTE: The above broken lines are for the heating operation without any frost and defrost operation.

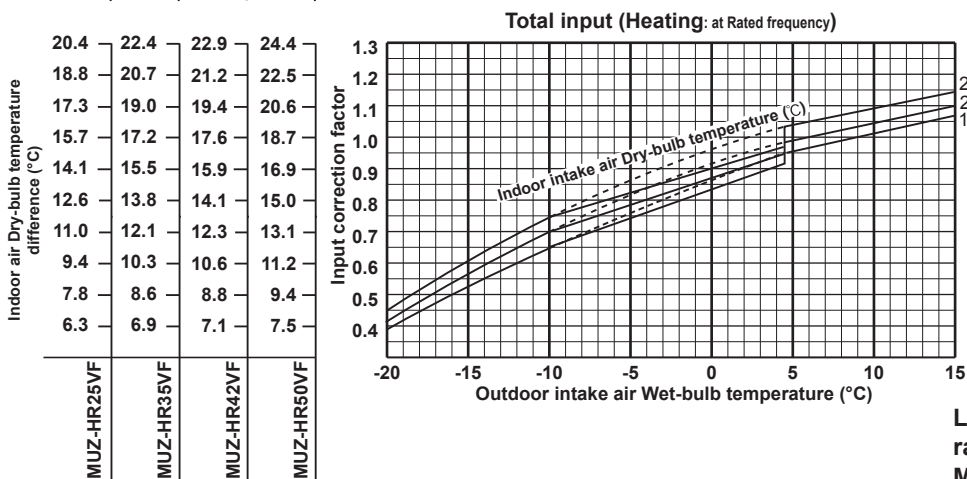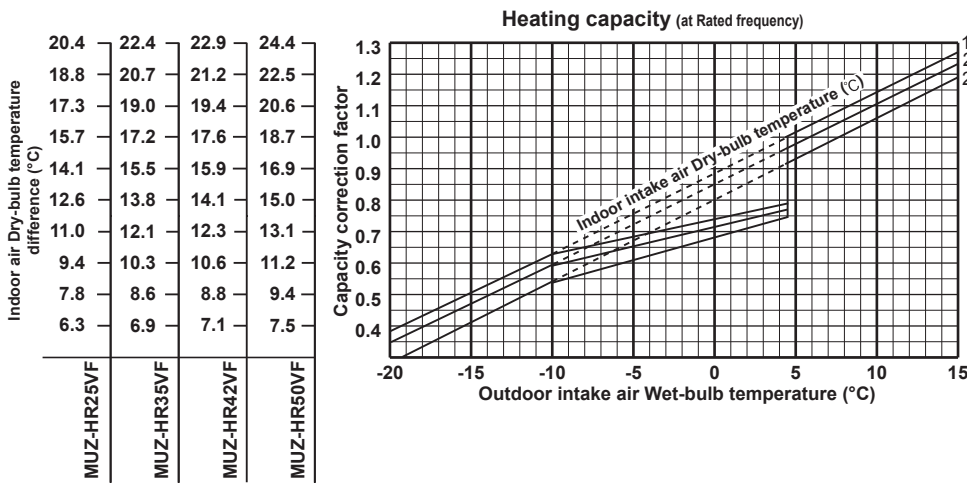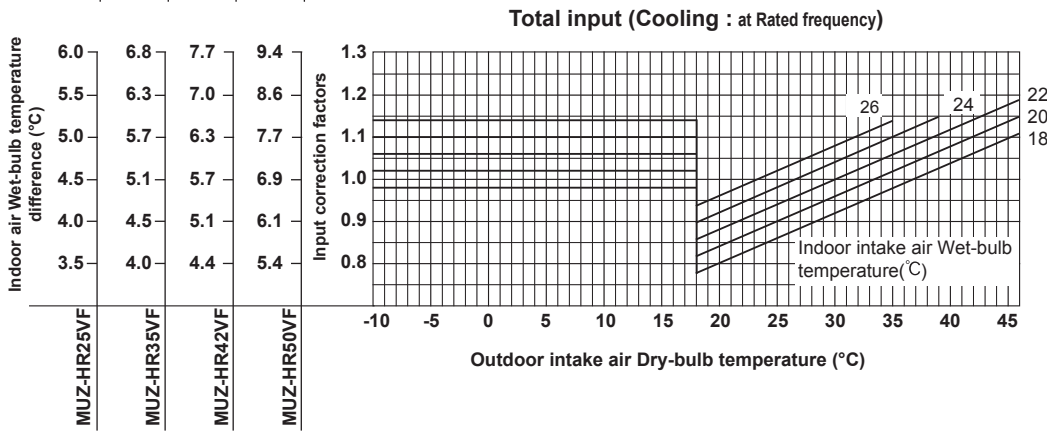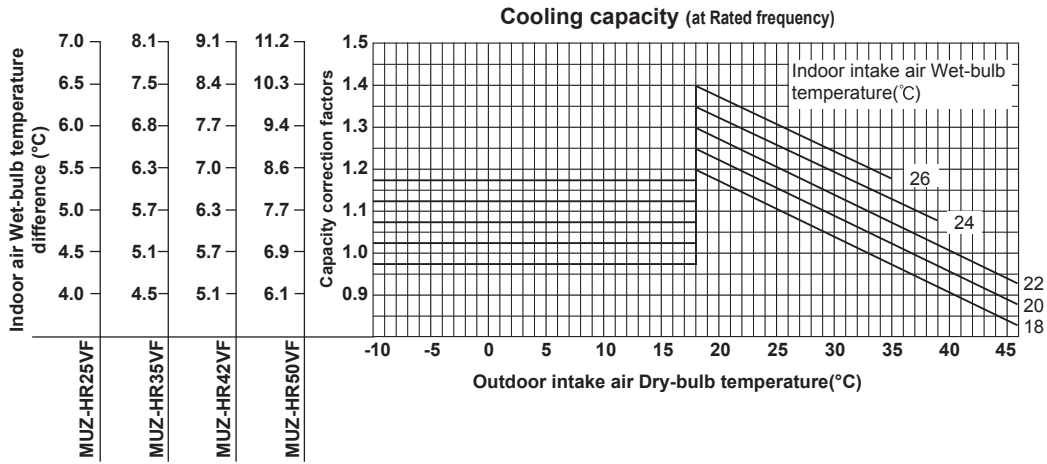





Lower limit of guaranteed operating range in heating
 MUZ-HR25/35/42/50VF: -10°C

NOTE: The above broken lines are for the heating operation without any frost and defrost operation.

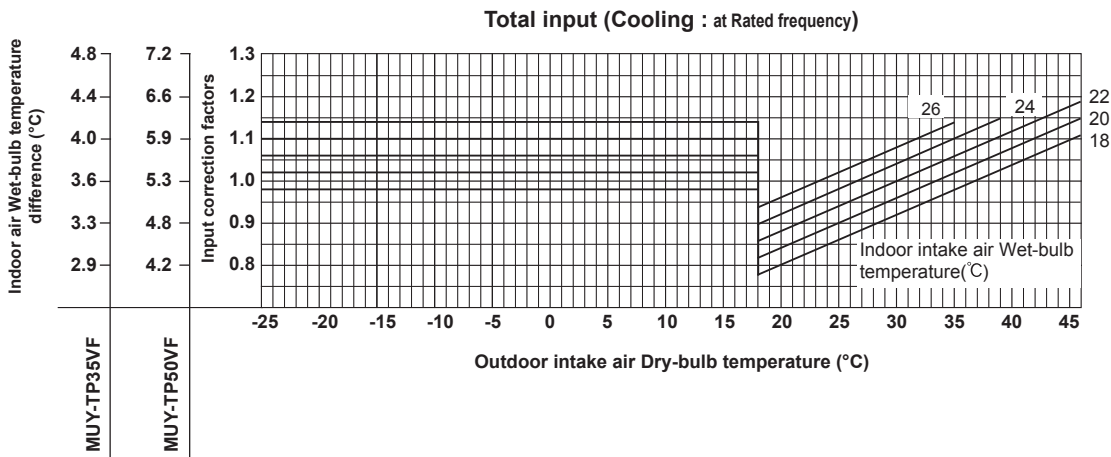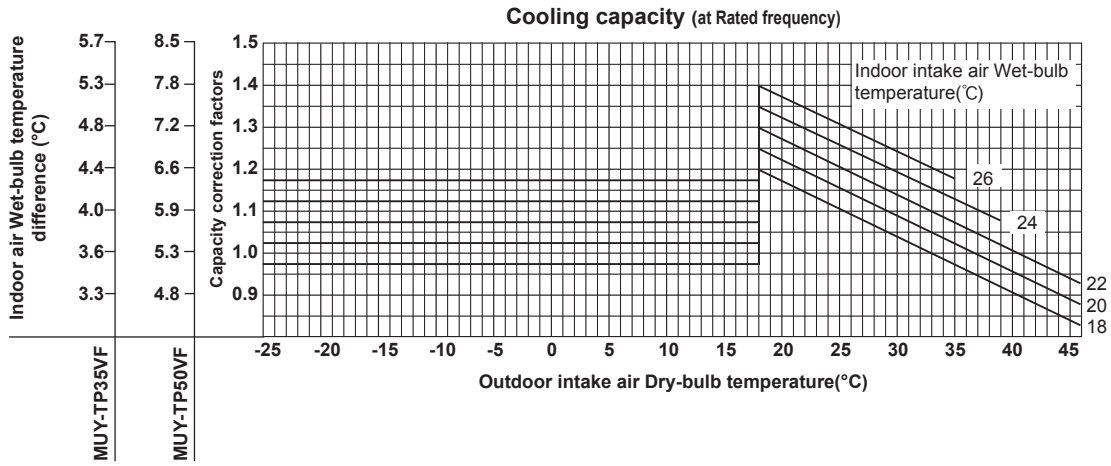

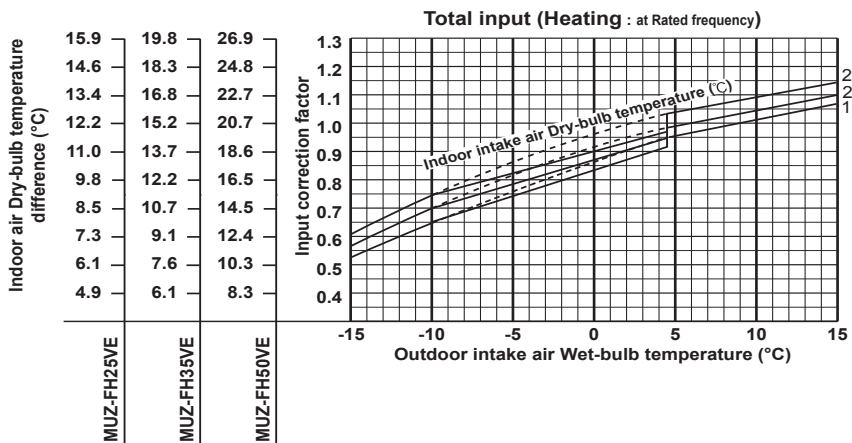
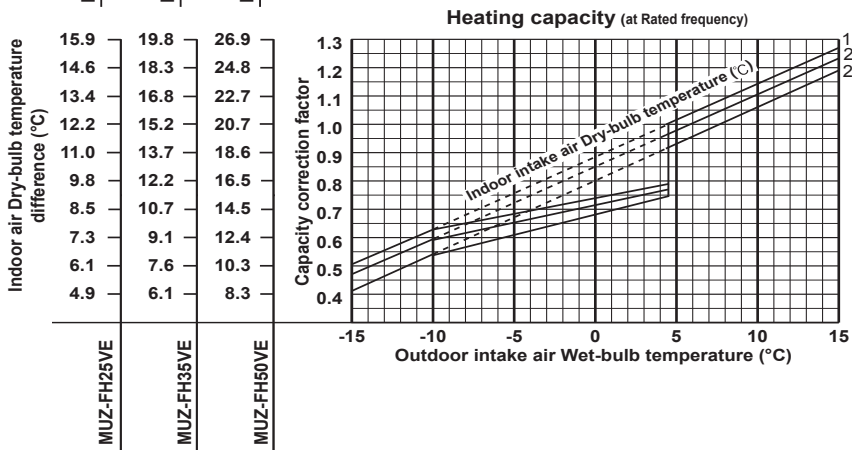
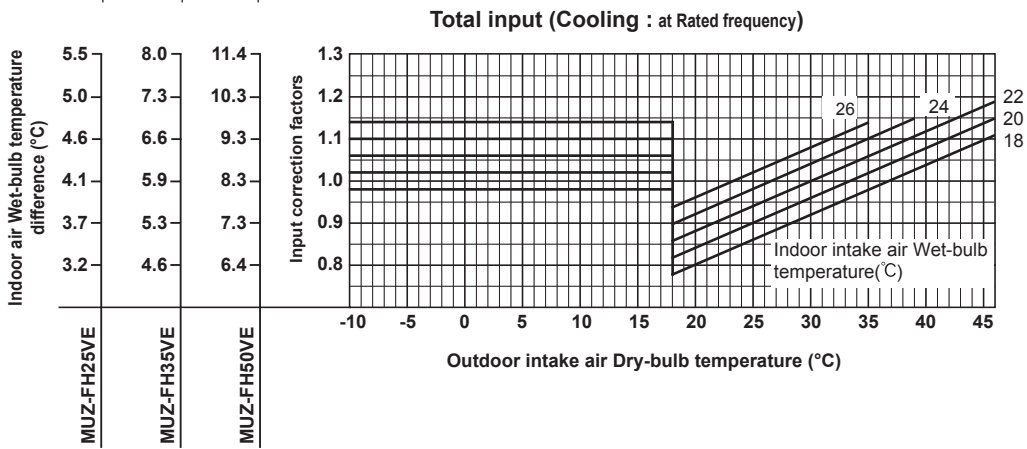
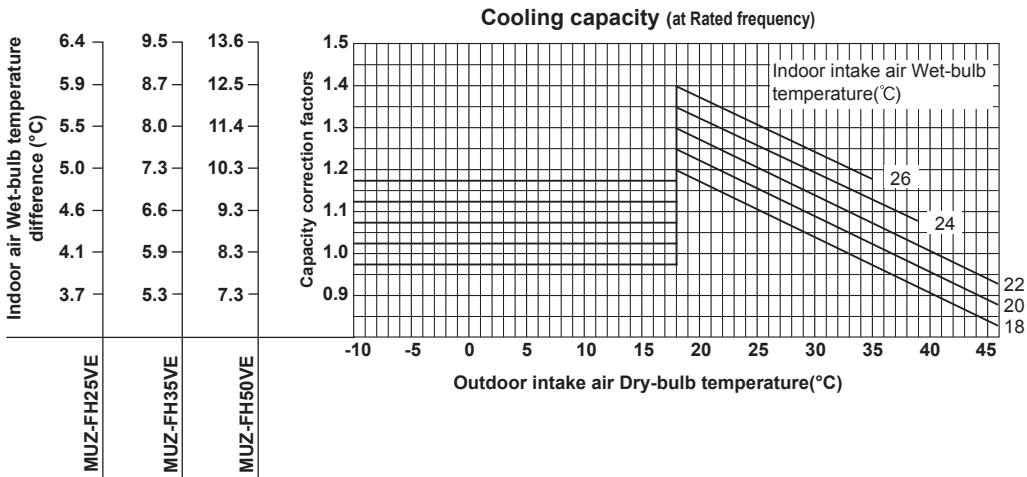


NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

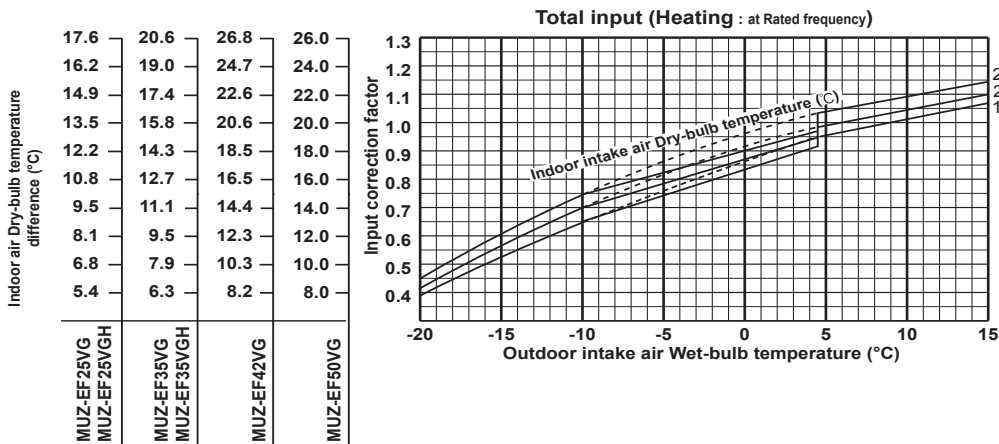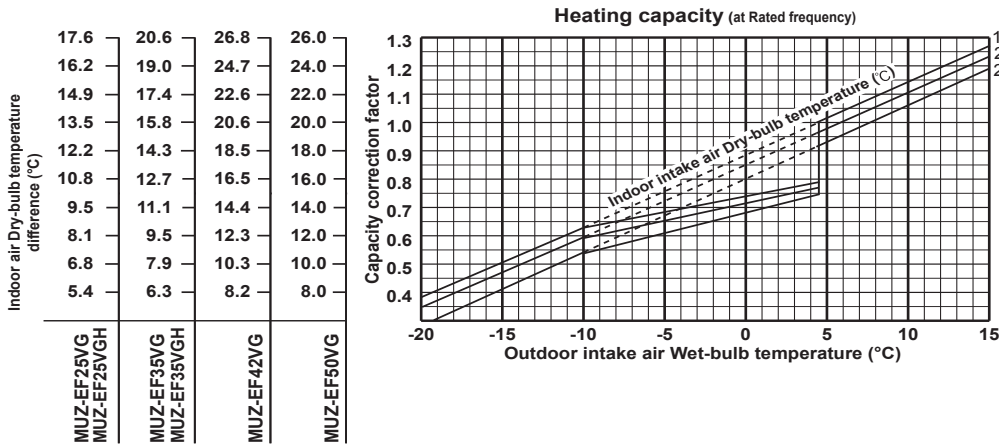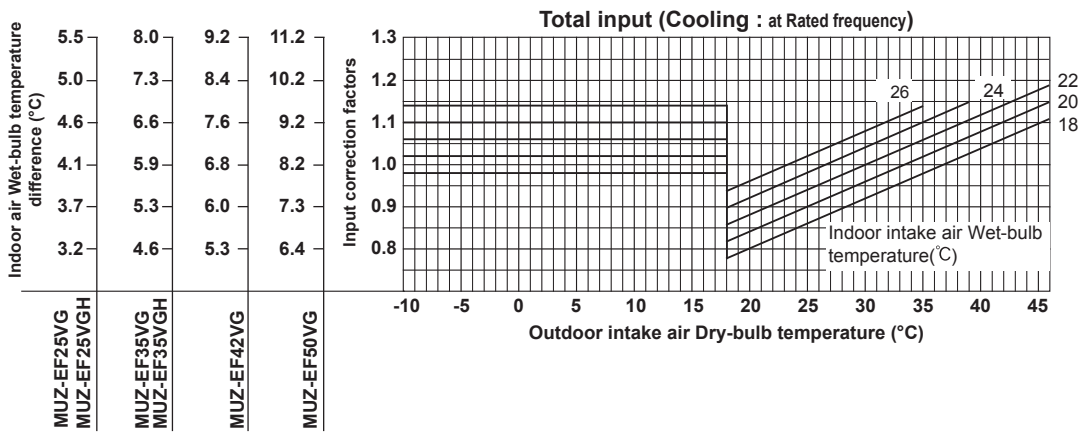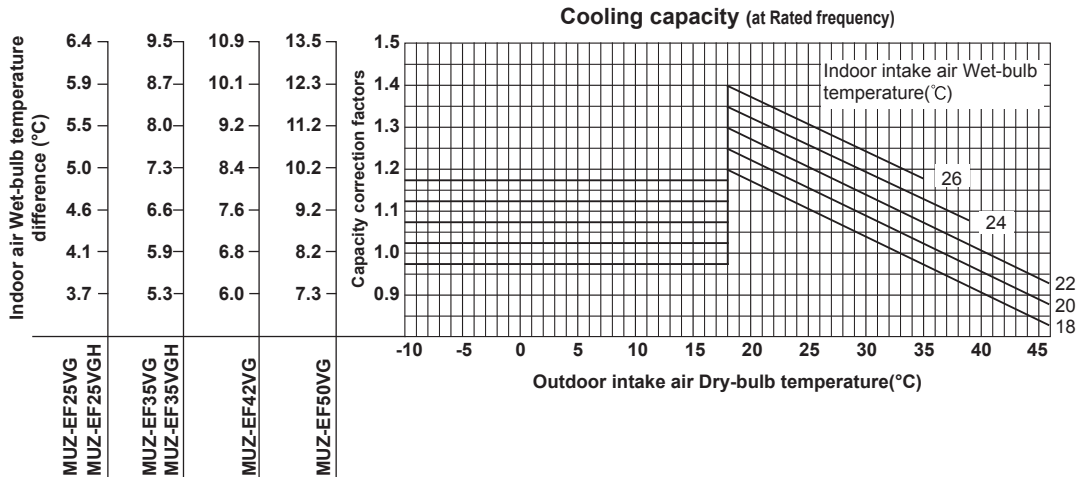





Lower limit of guaranteed operating range in heating
 MUZ-EF25/35/42/50VG : -15°C
 MUZ-EF25/35VGH : -20°C

NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

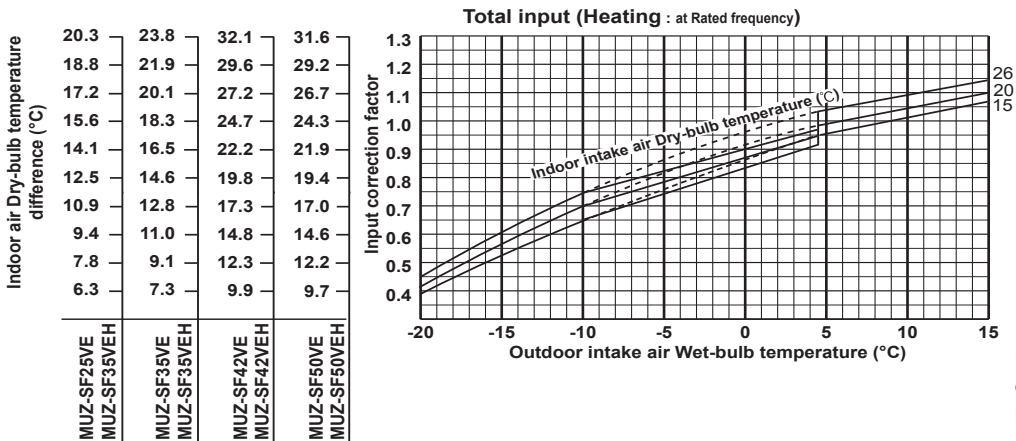
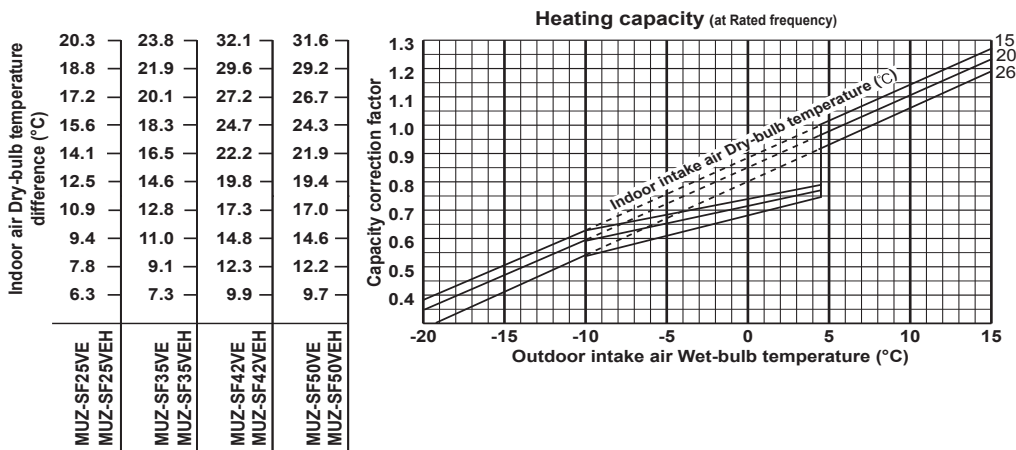
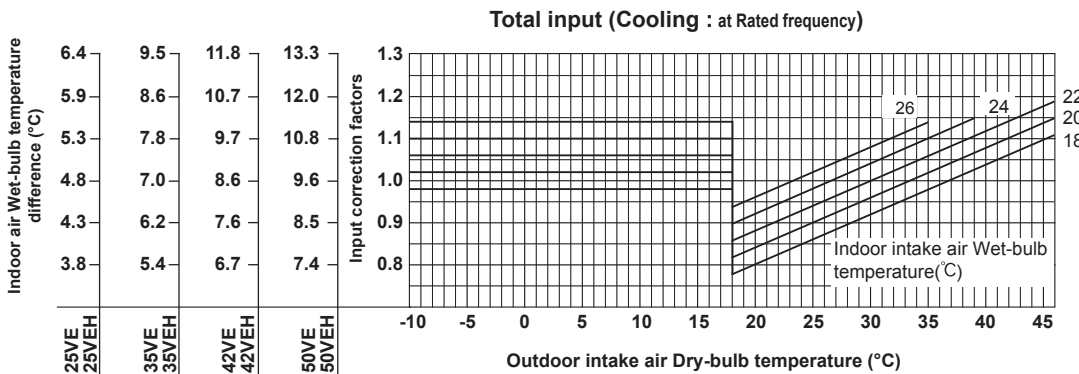
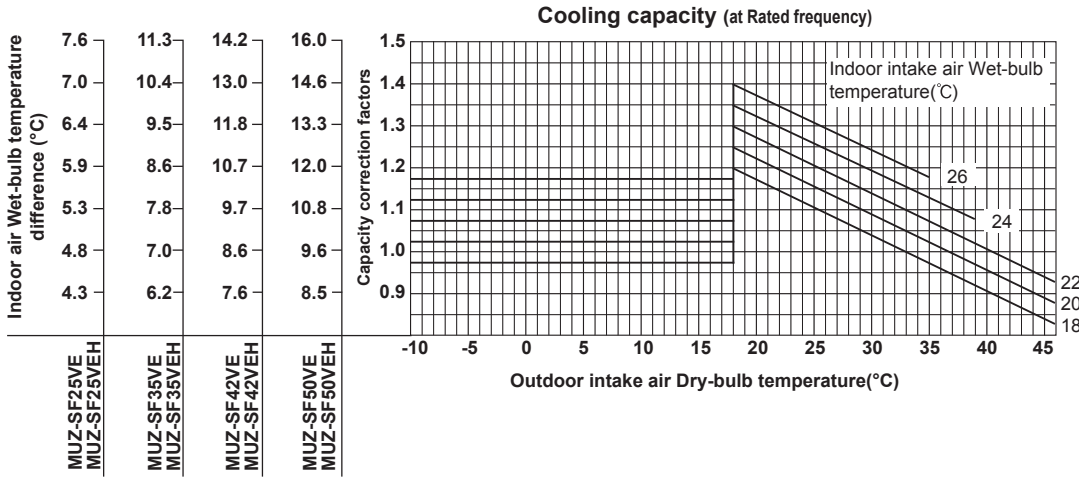


Lower limit of guaranteed operating range in heating
 MUZ-SF25/35/42/50VE: -15°C
 MUZ-SF25/35/42/50VEH: -20°C





NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

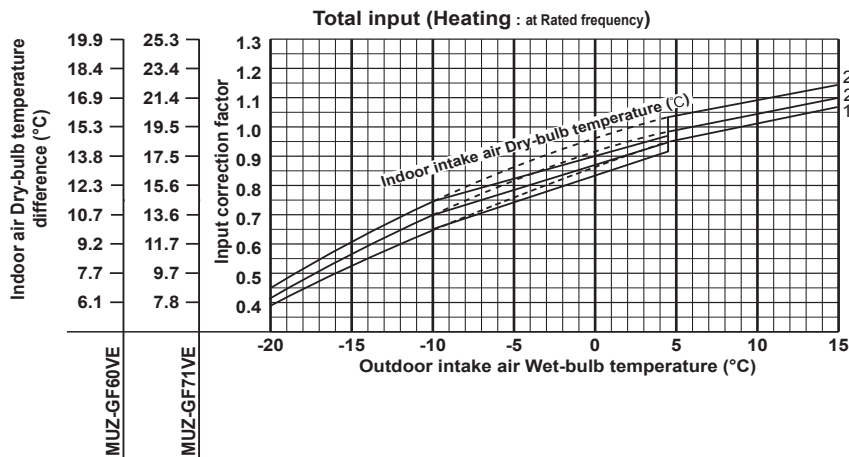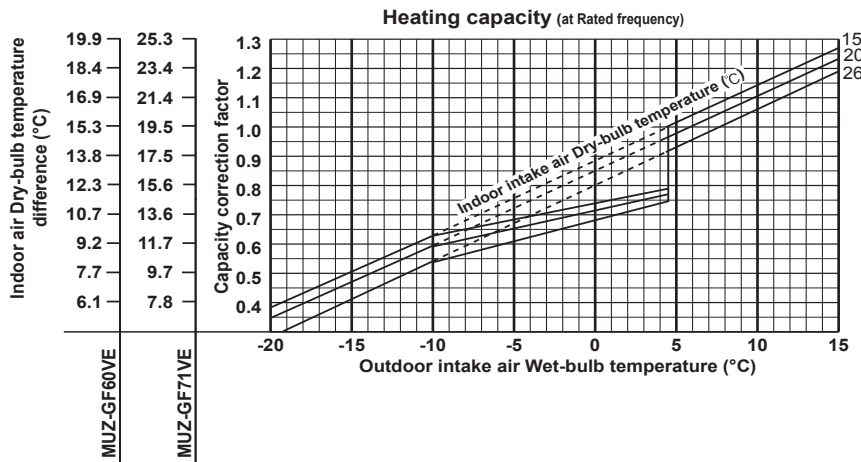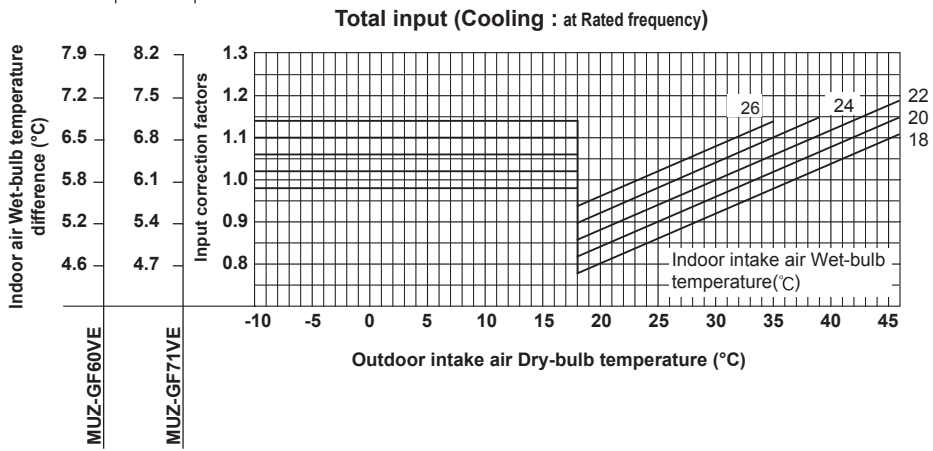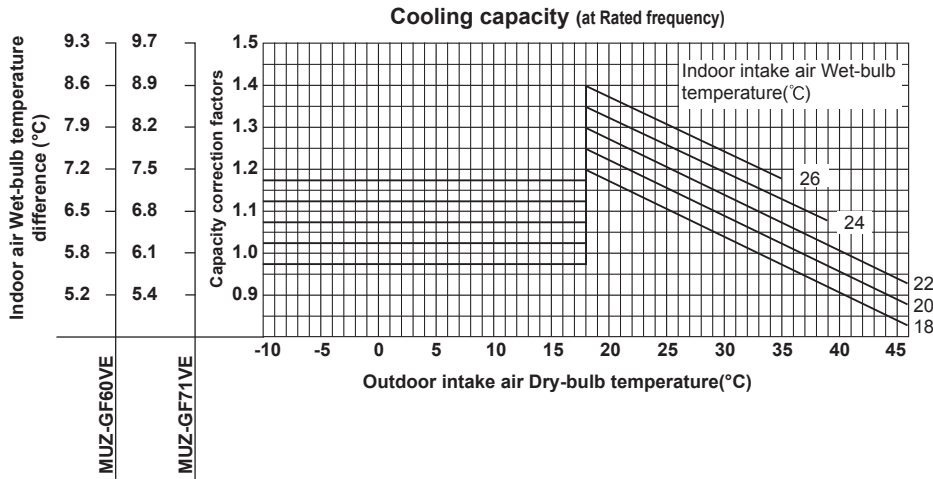





NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

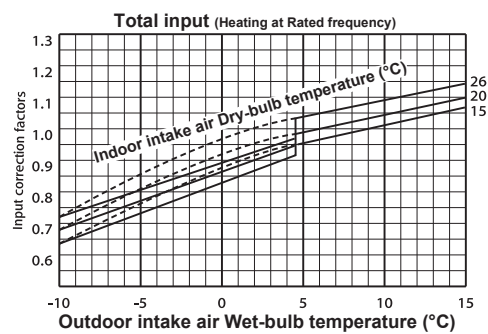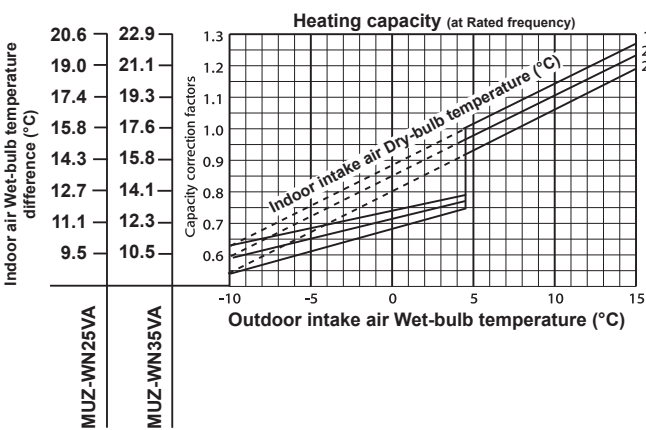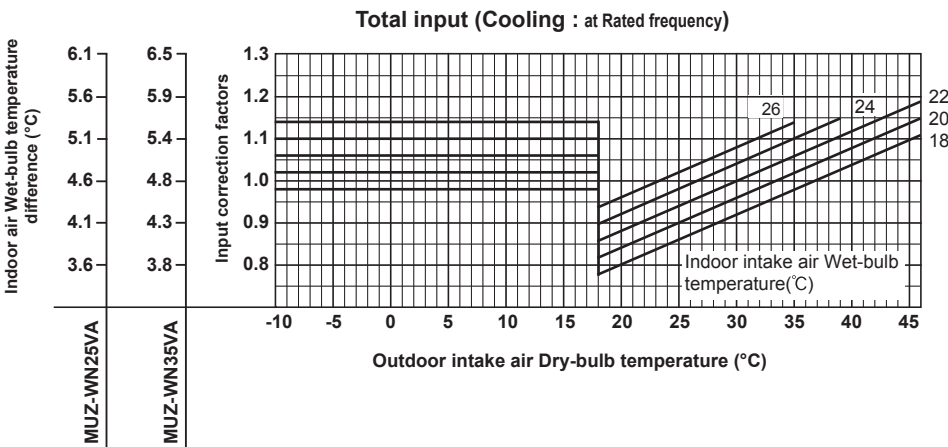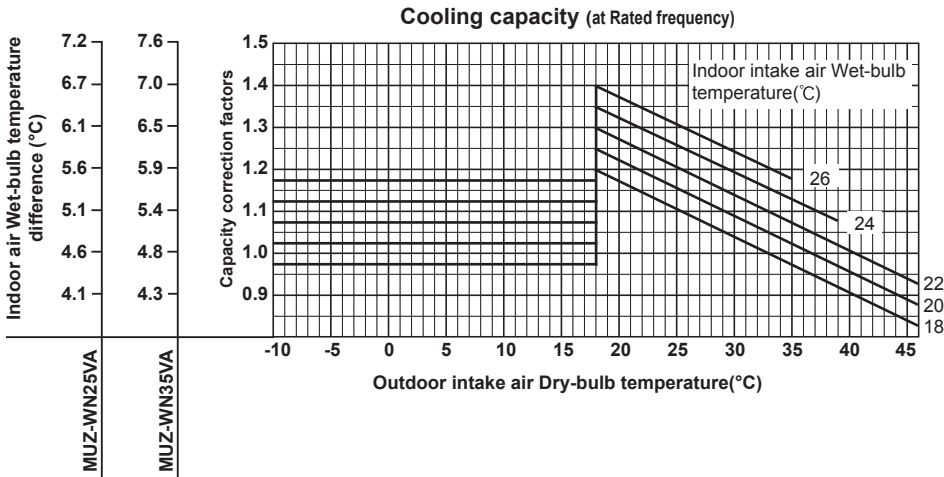

WALL-MOUNTED PERFORMANCE CURVES

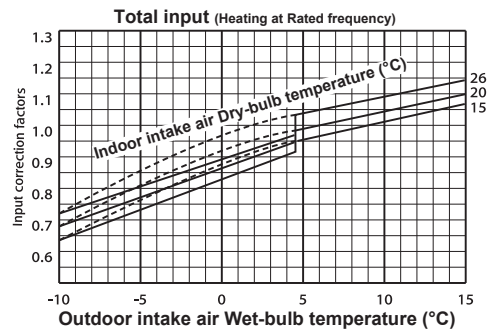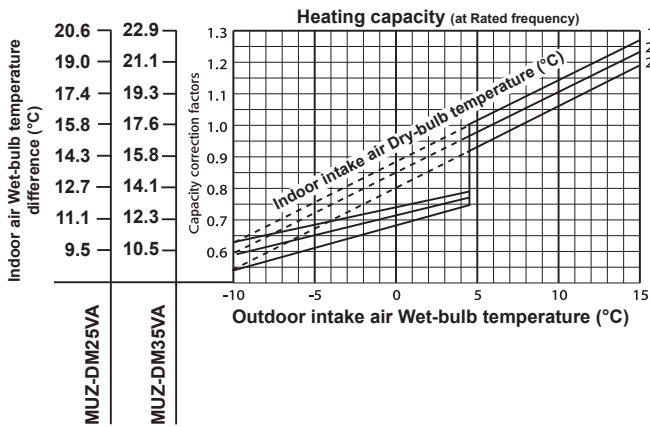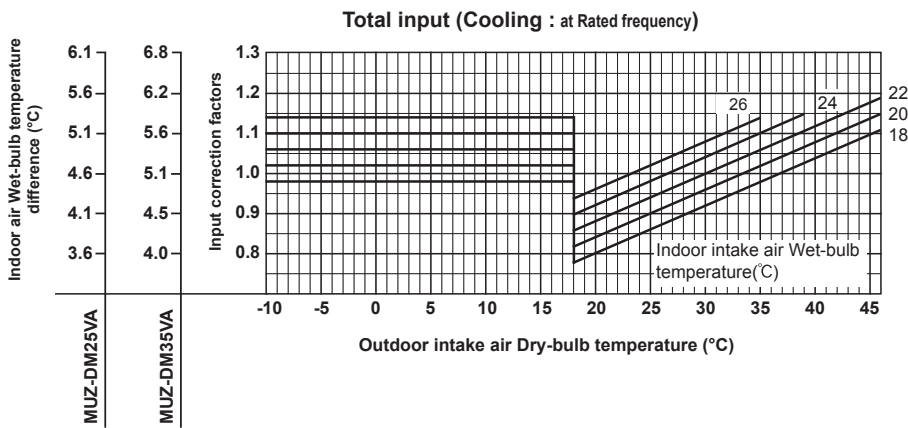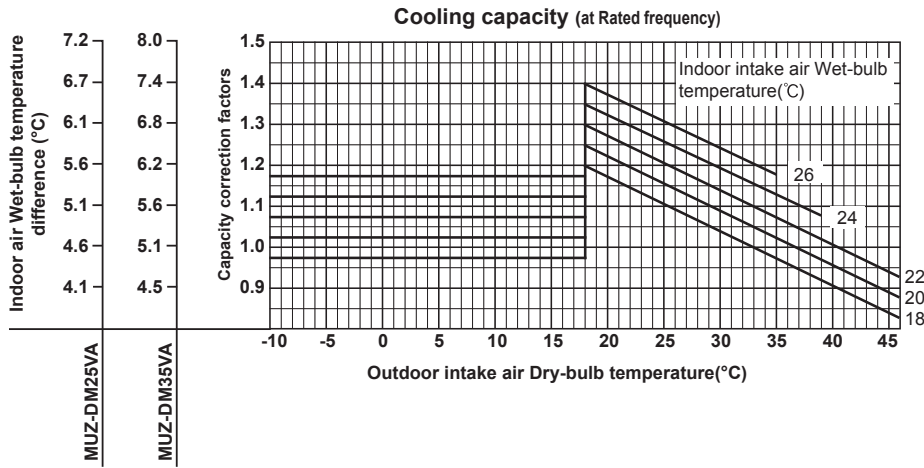


NOTE: The above broken lines are for the heating operation without any frost and defrost operation.

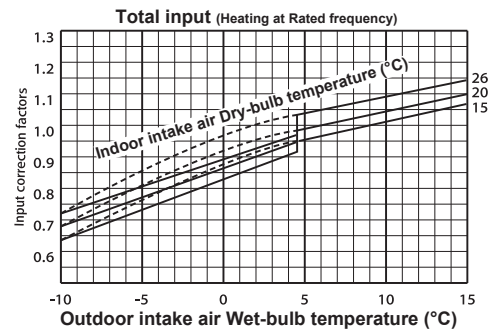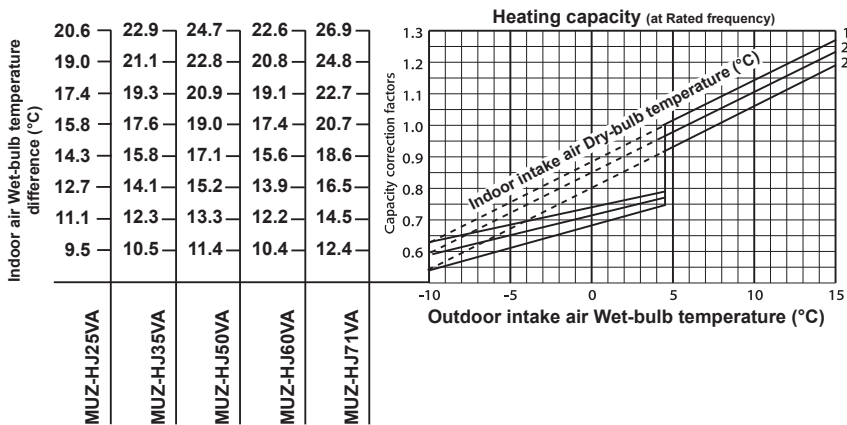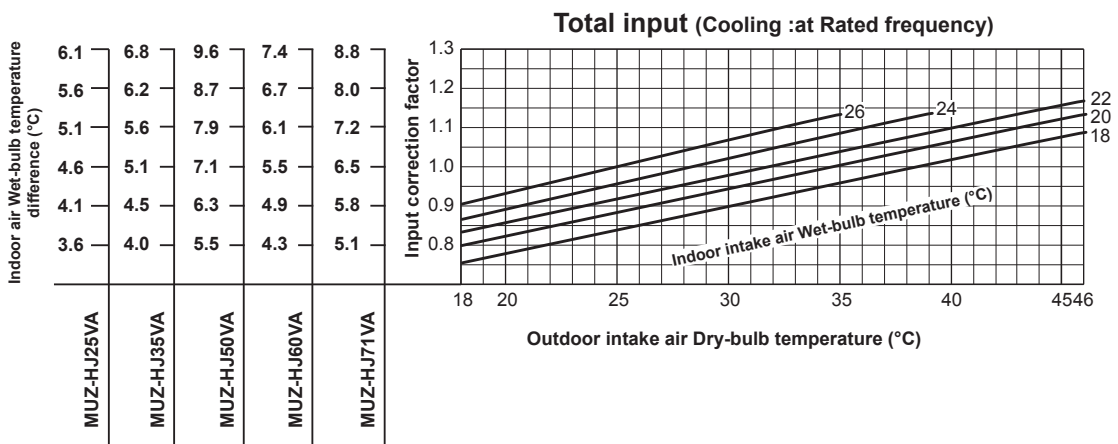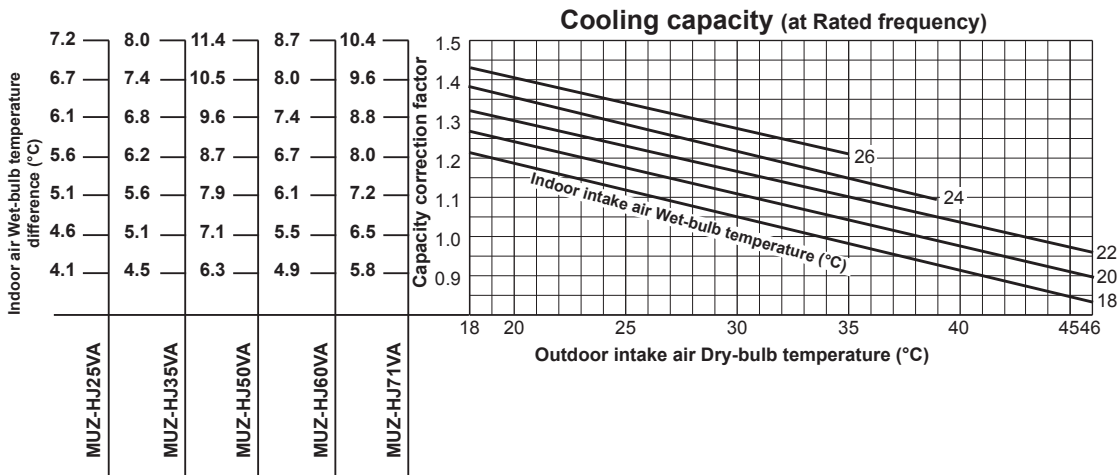


NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

CAPACITY AND INPUT CORRECTION BY OPERATIONAL FREQUENCY OF COMPRESSOR


MUZ-LN25VG

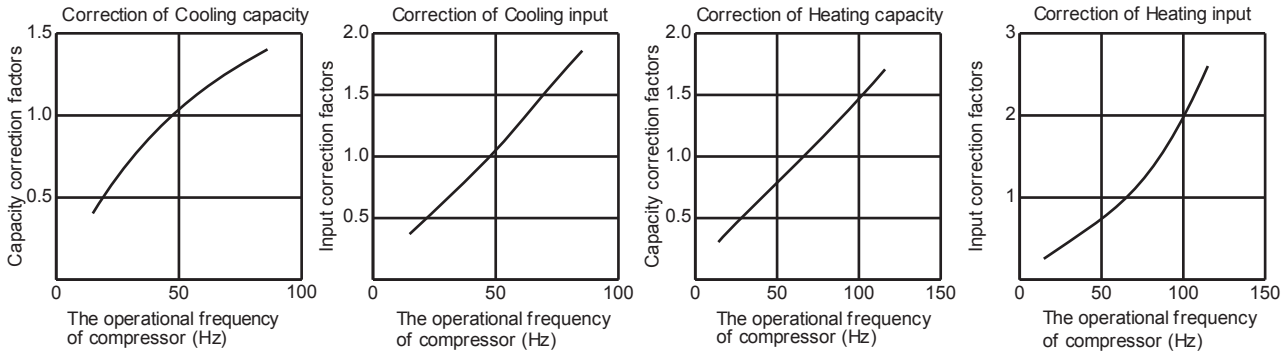


MUZ-LN35VG

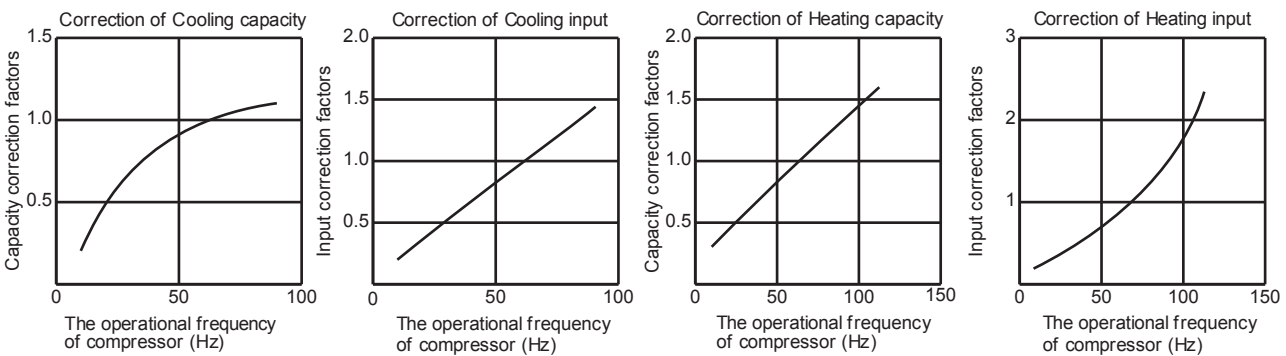

MUZ-LN50VG

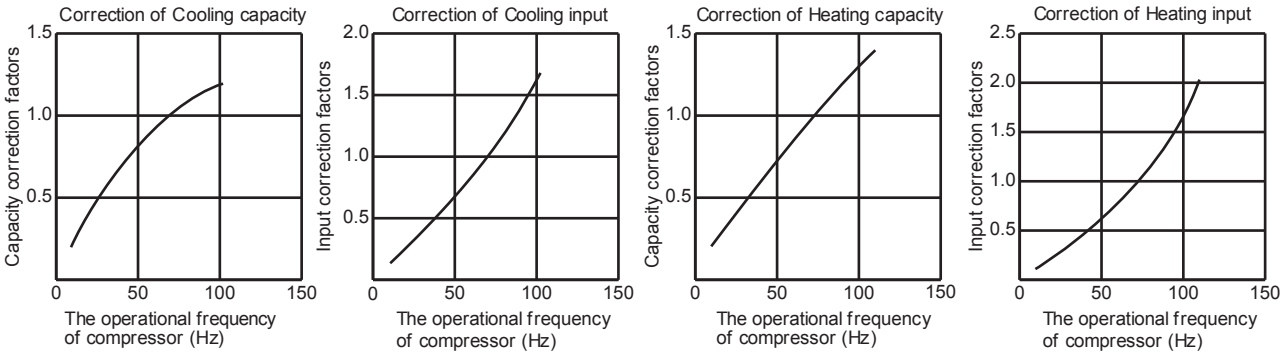


MUZ-LN60VG

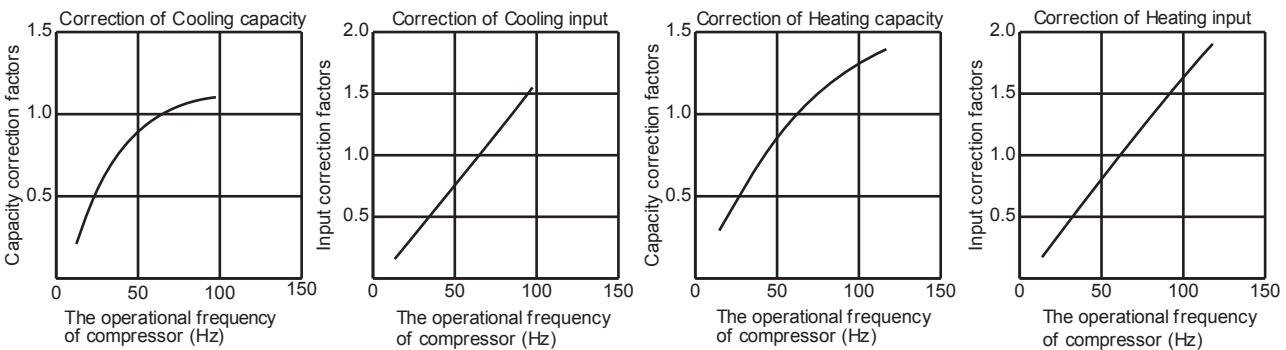


WALL-MOUNTED PERFORMANCE CURVES

MUZ-AP20VG

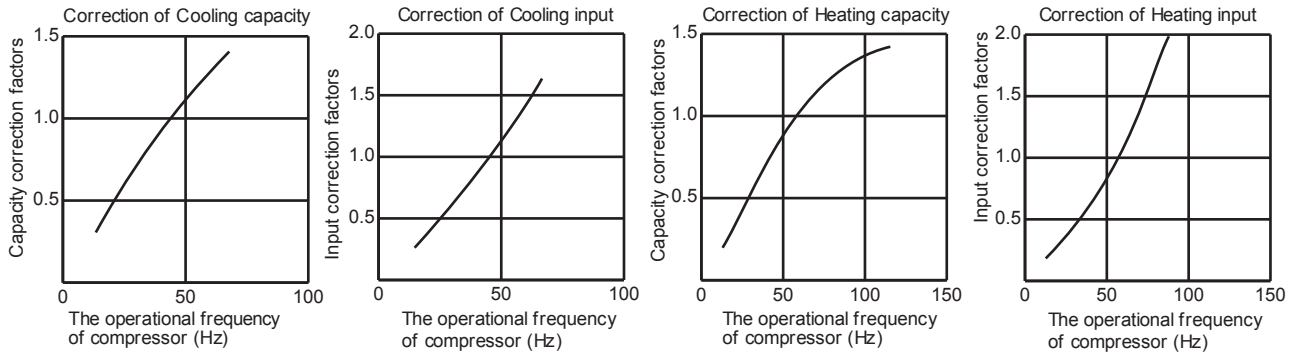


MUZ-AP25VG

MUZ-AP25VGH

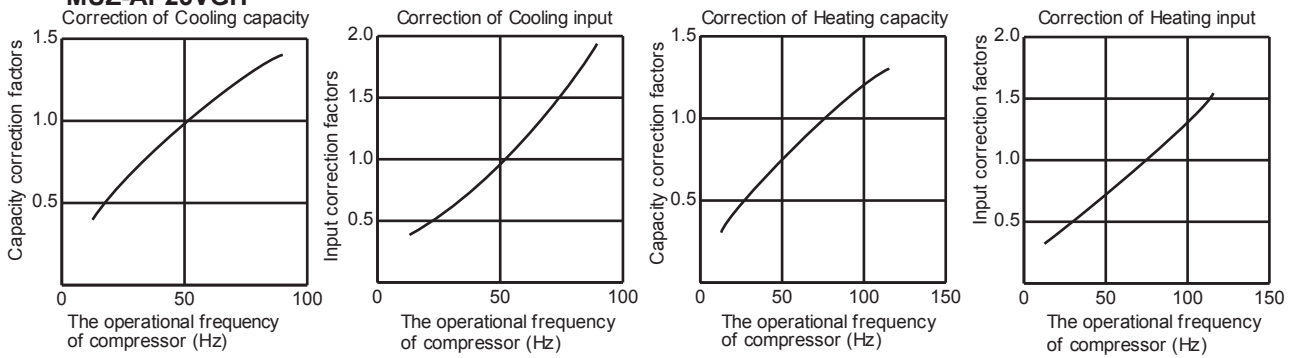


MUZ-AP35VG

MUZ-AP35VGH

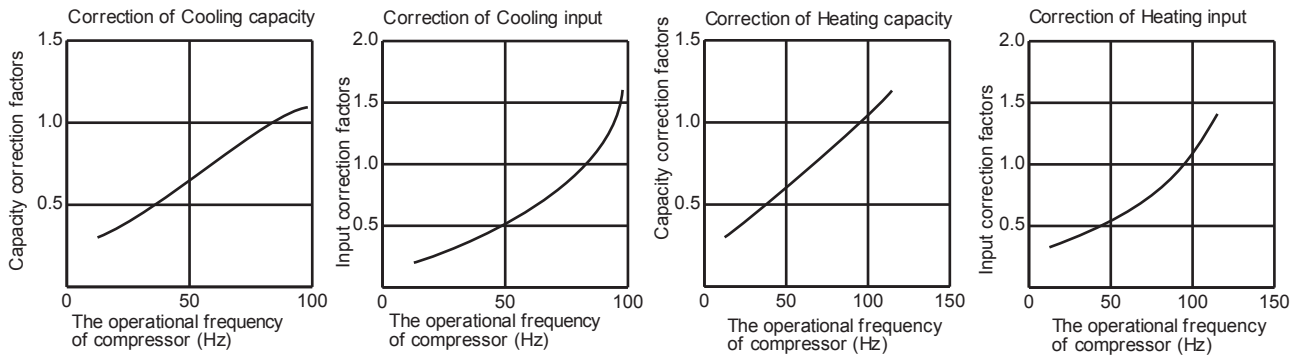


MUZ-AP42VG

MUZ-AP42VGH

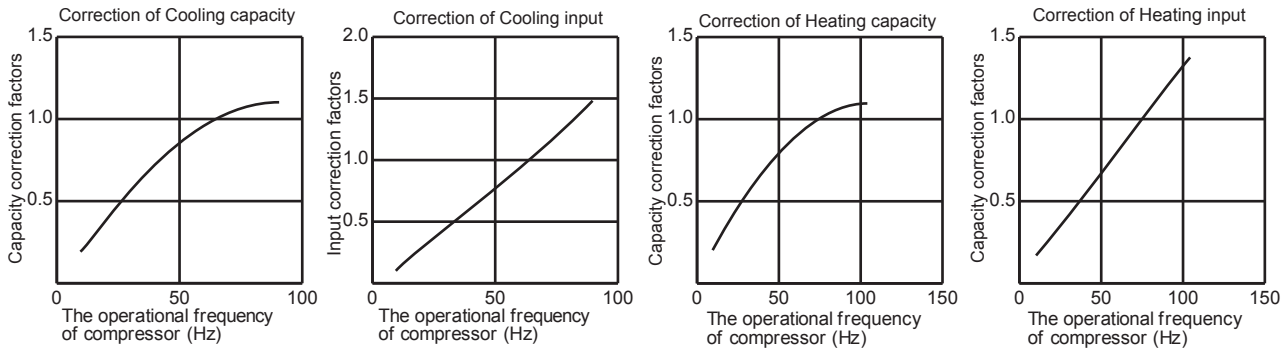


PERFORMANCE CURVES WALL-MOUNTED


MUZ-AP50VG
MUZ-AP50VGH

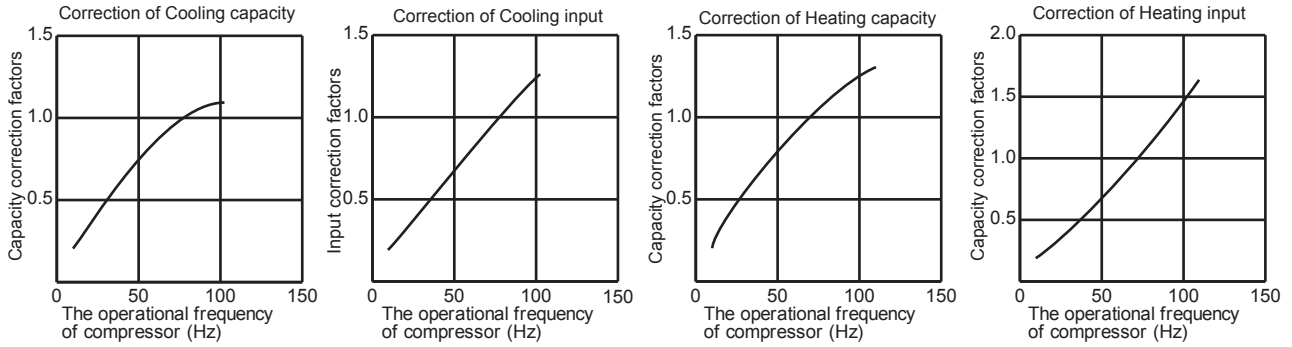


MUZ-AP60VG

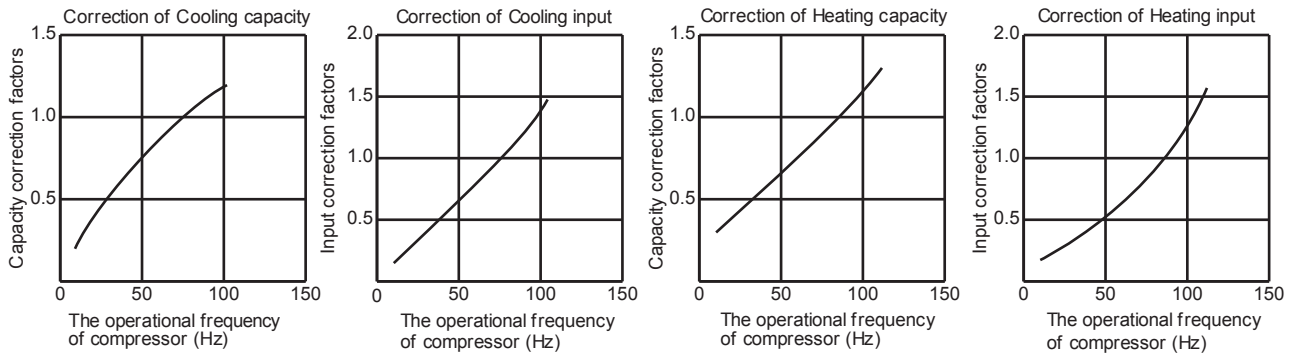


MUZ-AP71VG

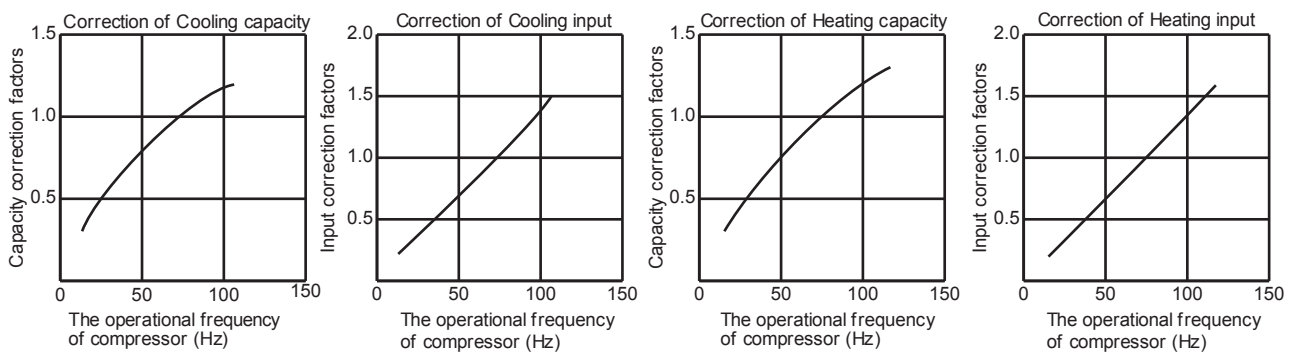


MUZ-HR25VF

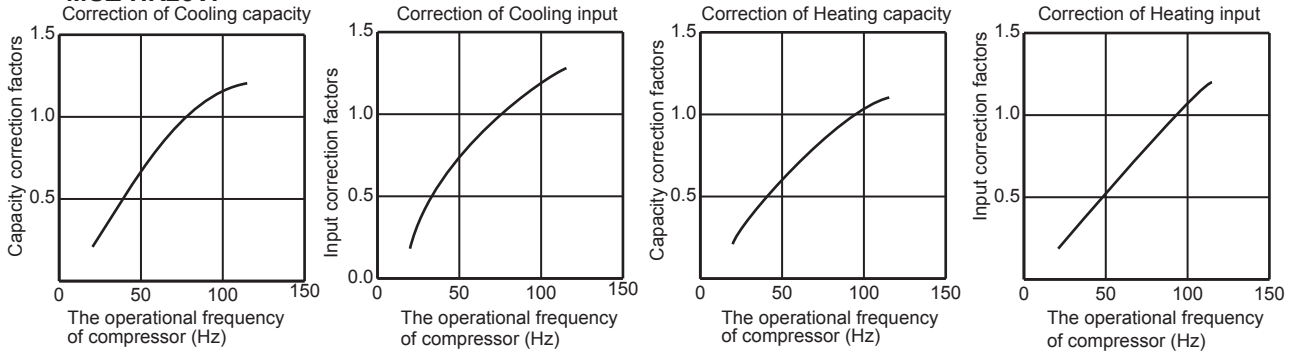


MUZ-HR35VF

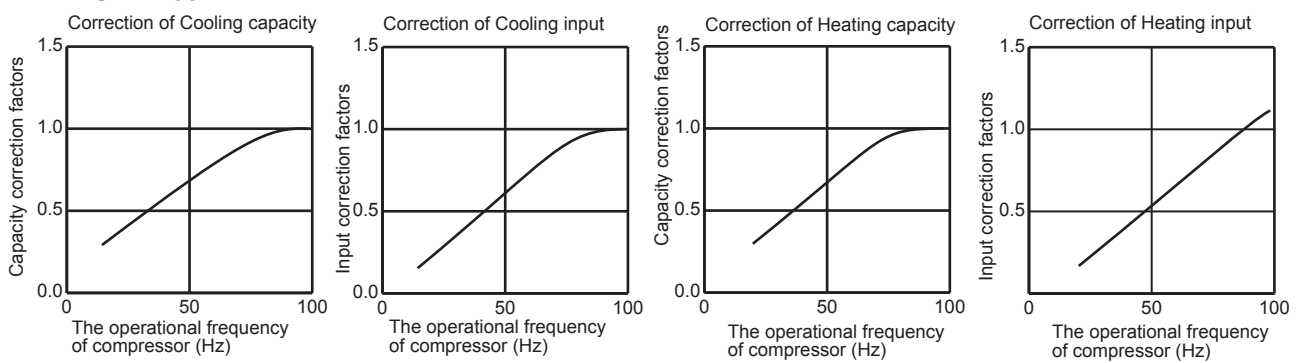

MUZ-HR42VF


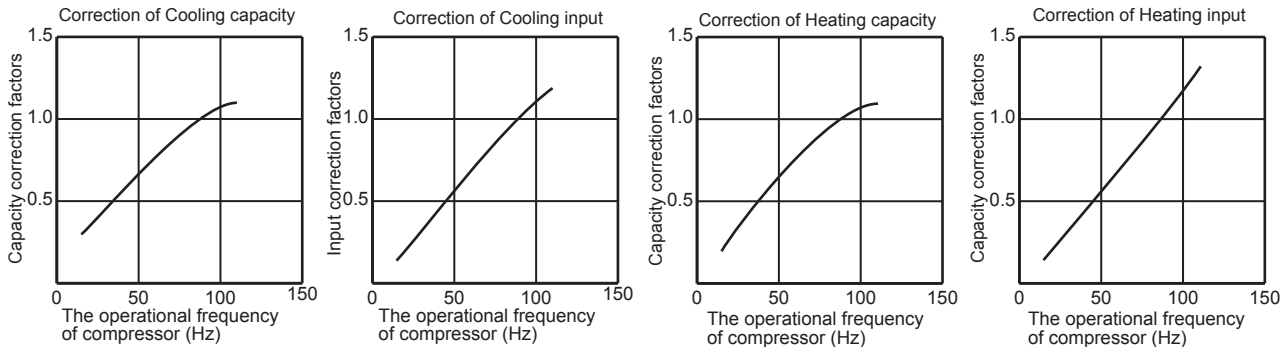


MUZ-HR50VF


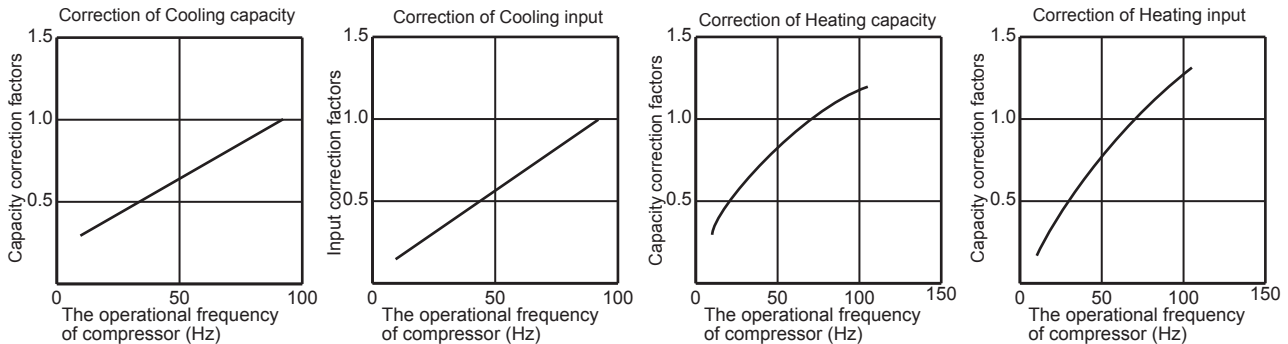


PERFORMANCE CURVES WALL-MOUNTED





MUY-TP35VF

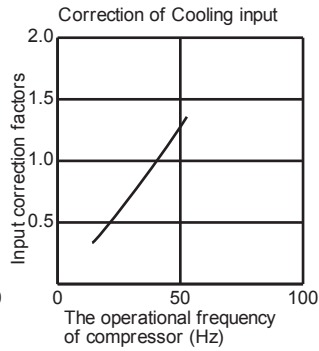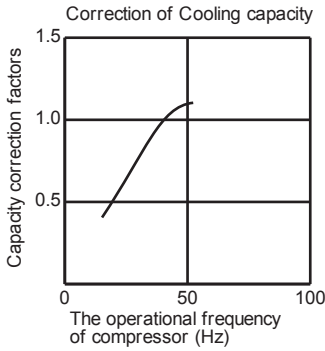





MUY-TP50VF

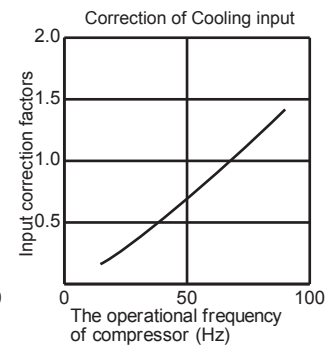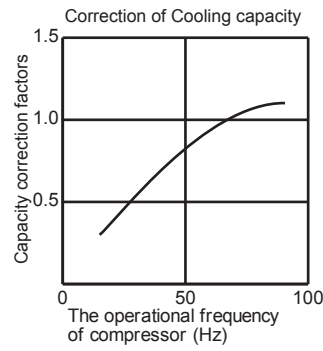





MUZ-FH25VE

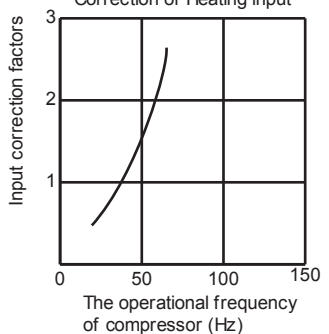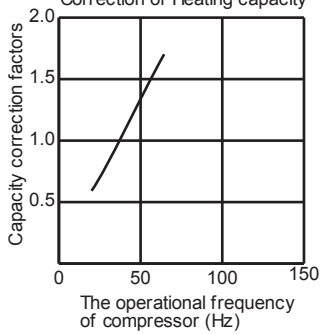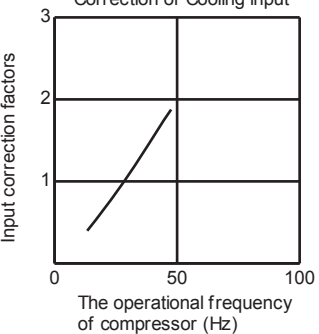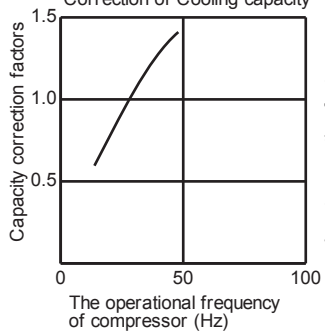


MUZ-FH35VE

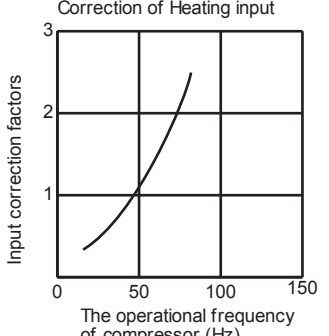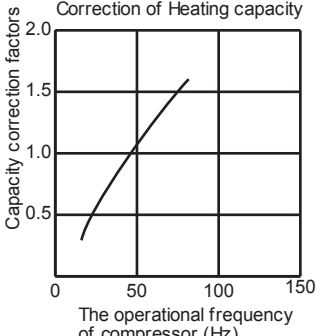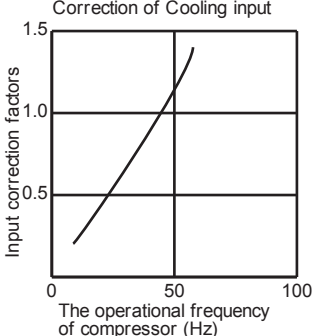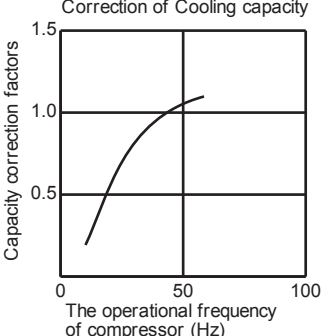


MUZ-FH50VE

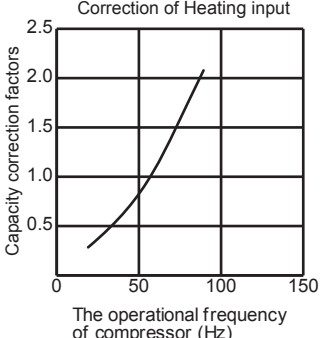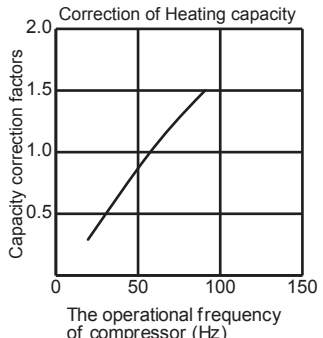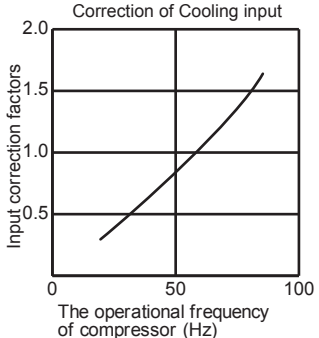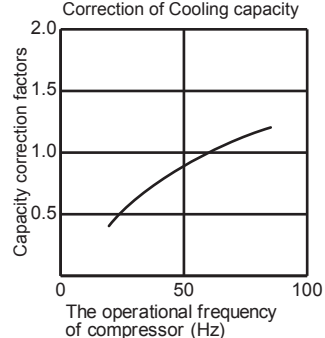


MUZ-EF25VG
MUZ-EF25VGH

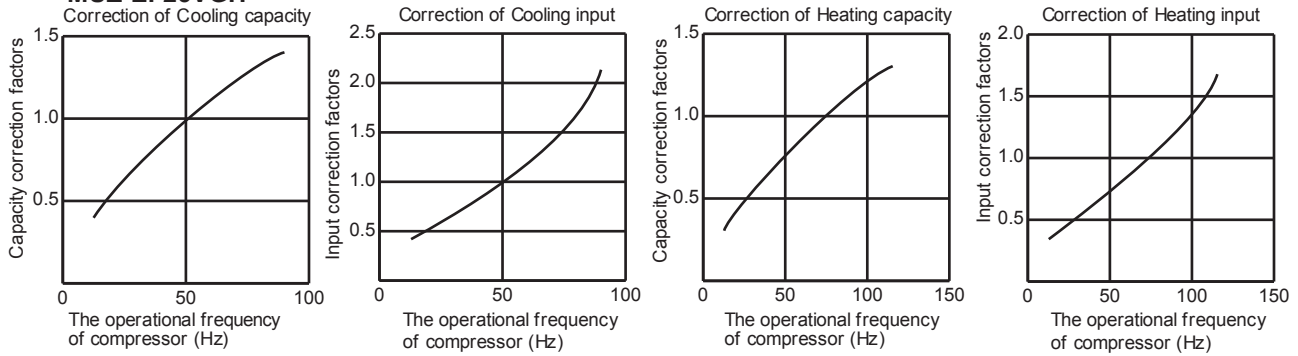


MUZ-EF35VG
MUZ-EF35VGH

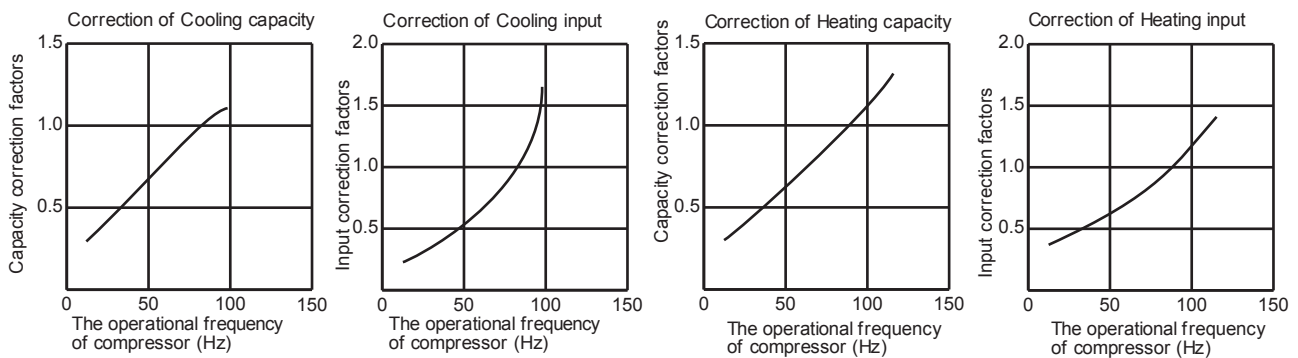

MUZ-EF42VG

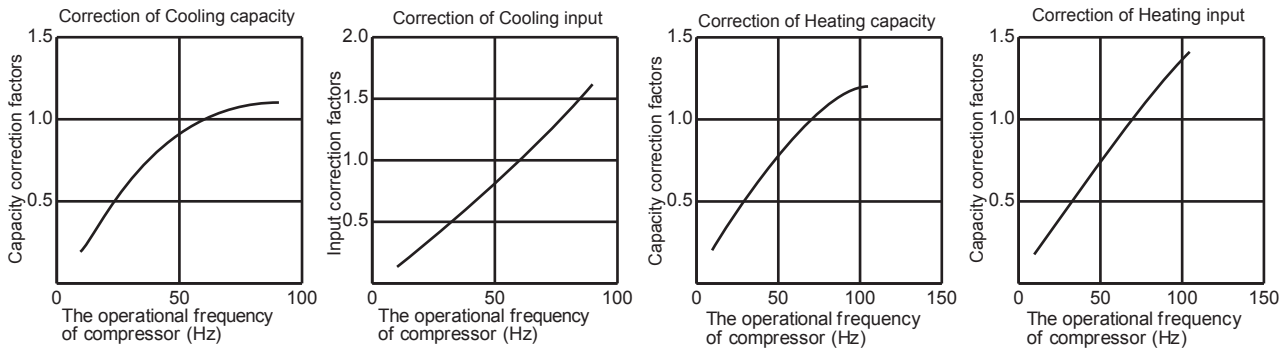


MUZ-EF50VG

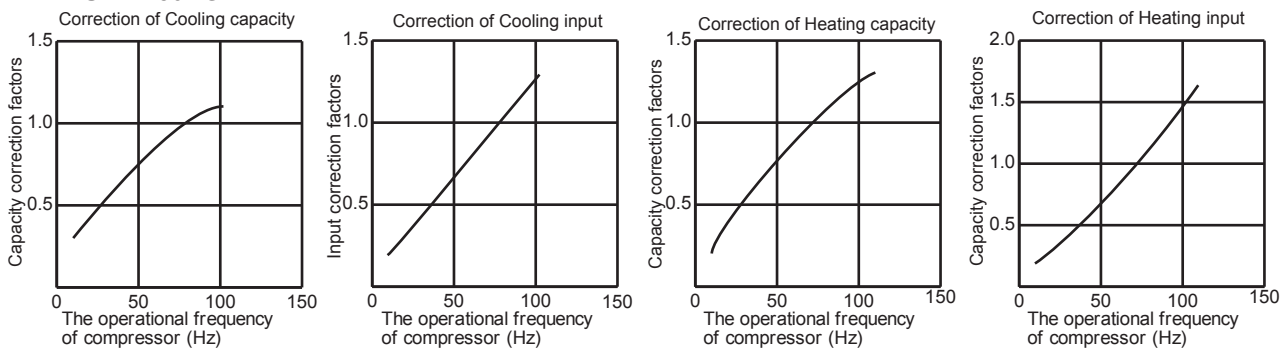


PERFORMANCE CURVES WALL-MOUNTED


MUZ-SF25VE
MUZ-SF25VEH

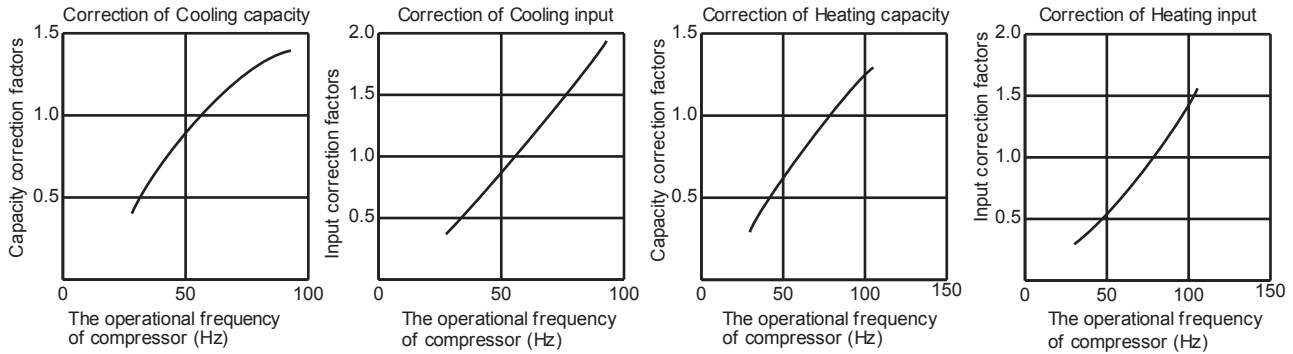


MUZ-SF35VE
MUZ-SF35VEH

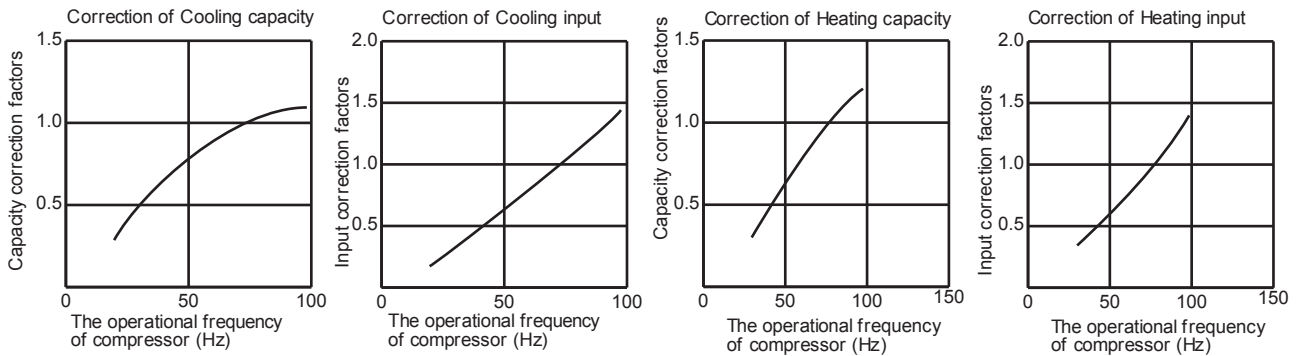


MUZ-SF42VE
MUZ-SF42VEH

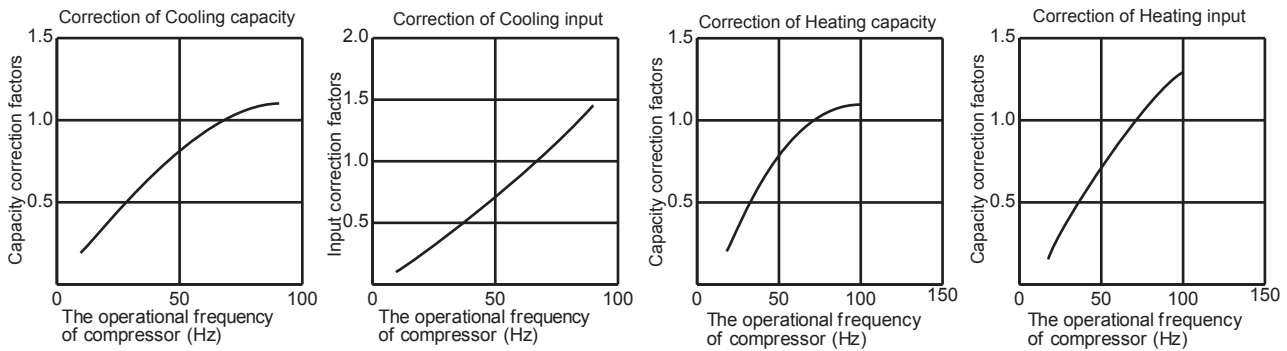


MUZ-SF50VE
MUZ-SF50VEH

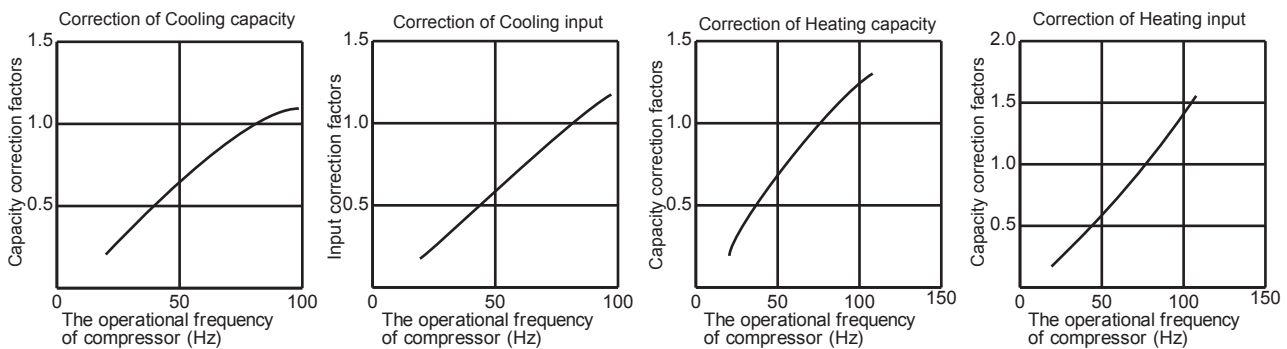


MUZ-GF60VE

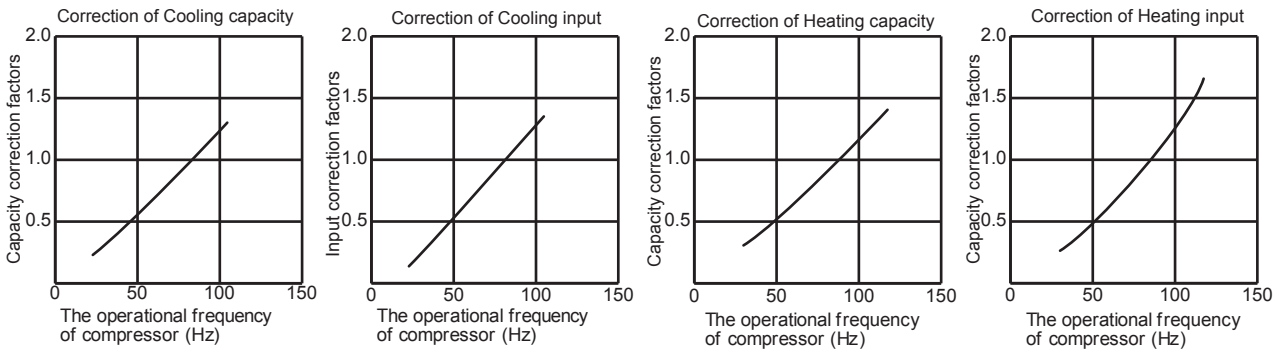


MUZ-GF71VE

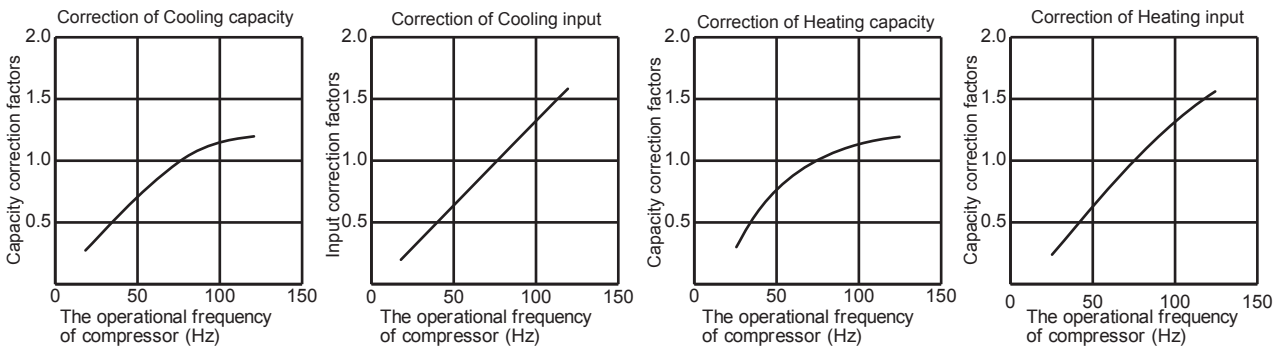

MUZ-WN25VA

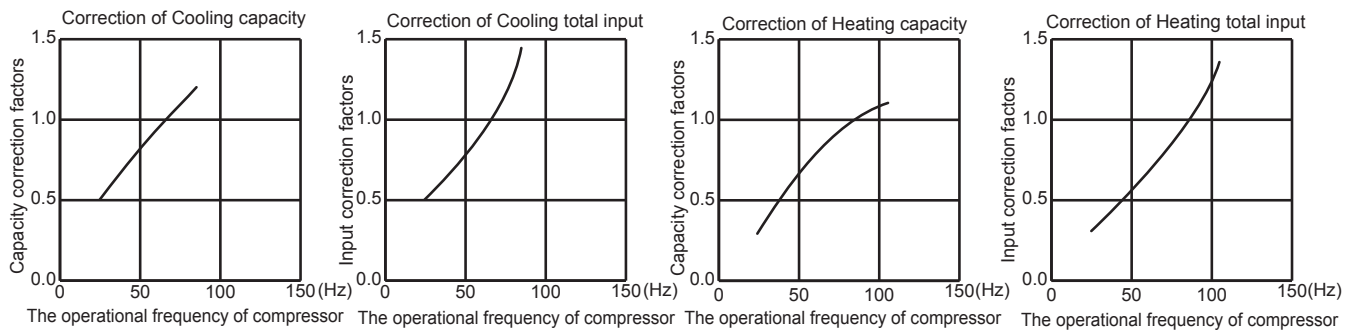


MUZ-WN35VA

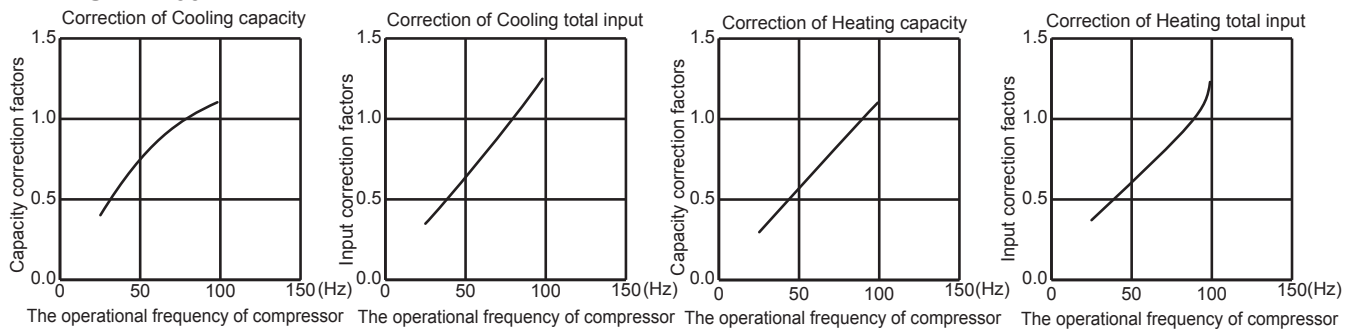


PERFORMANCE CURVES WALL-MOUNTED





MUZ-DM25VA

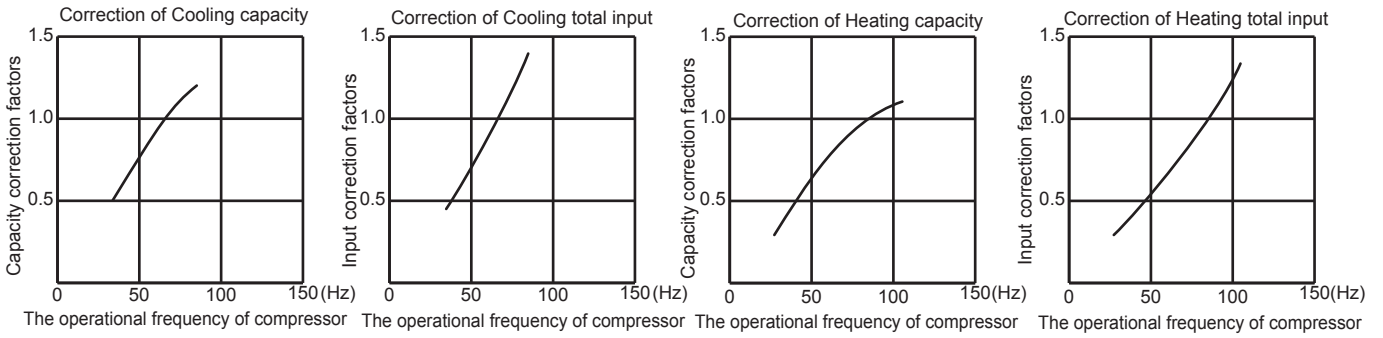





MUZ-DM35VA

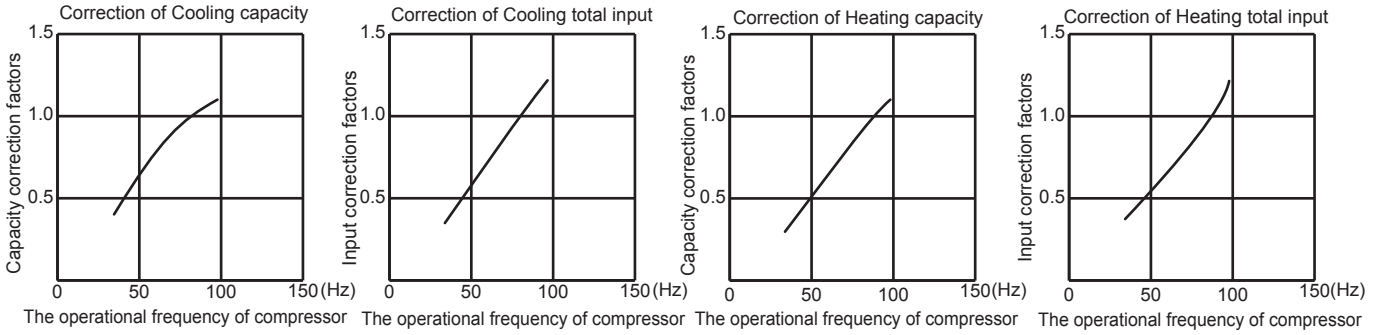





MUZ-HJ25VA

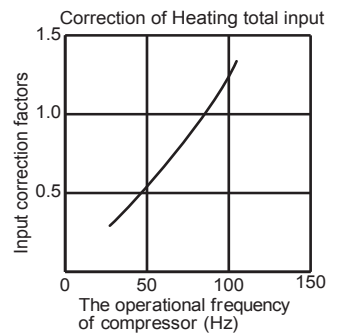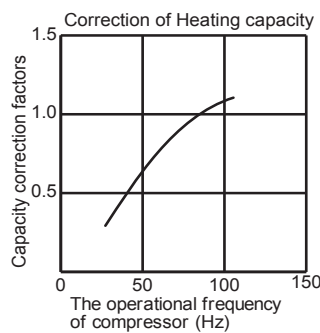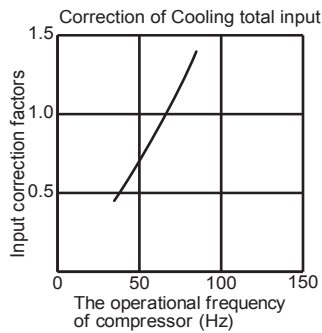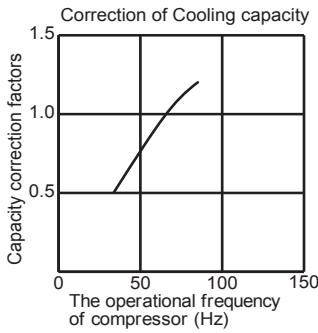





MUZ-HJ35VA

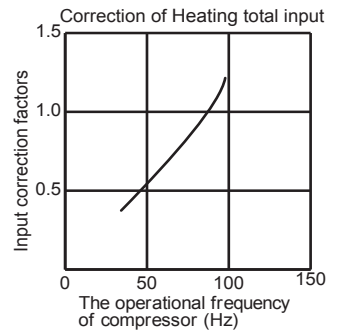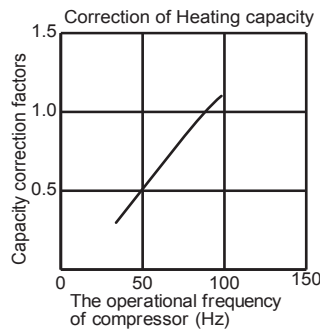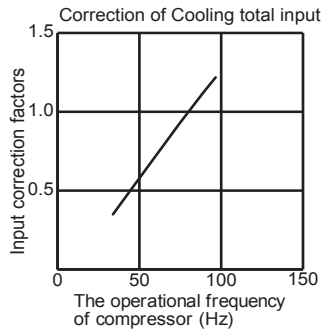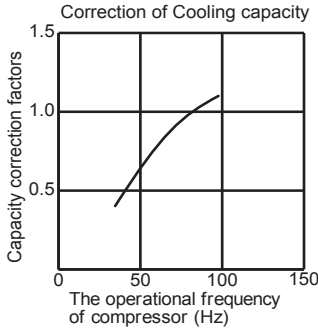





MUZ-HJ50VA

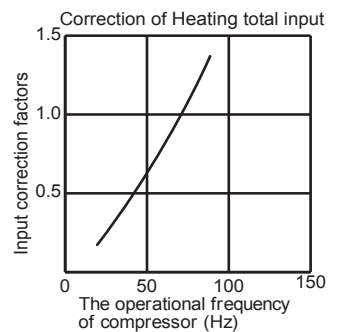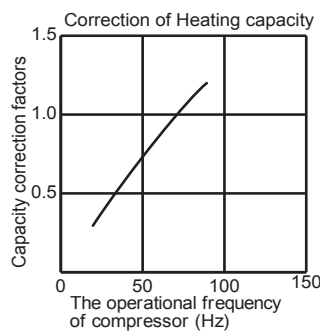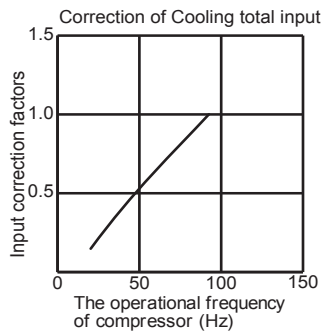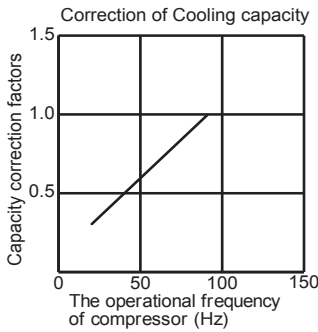

MUZ-HJ60VA

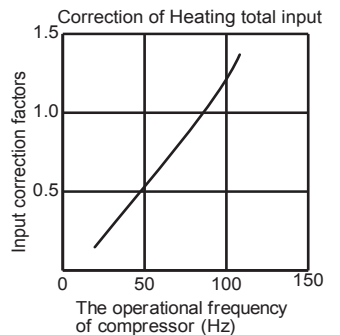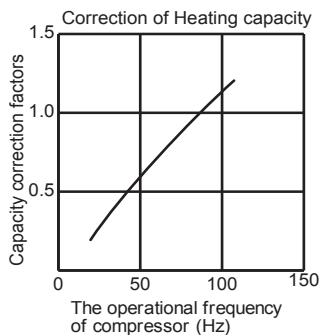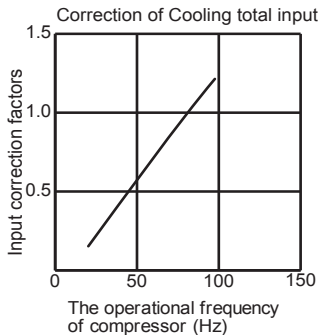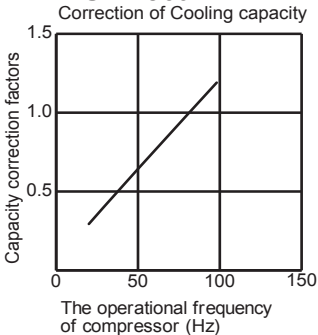


MUZ-HJ71VA

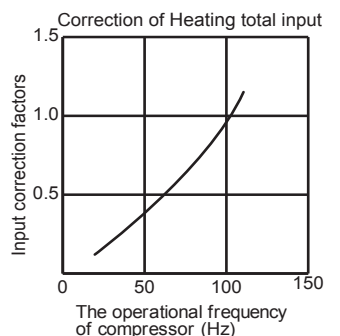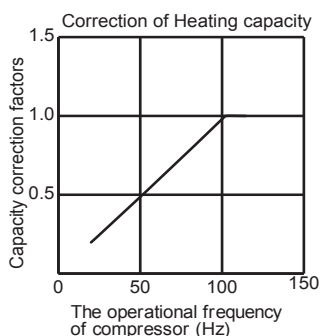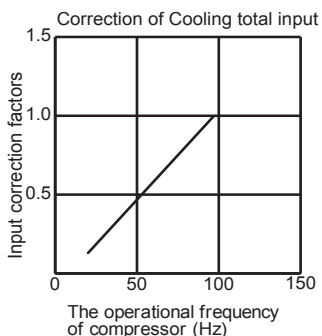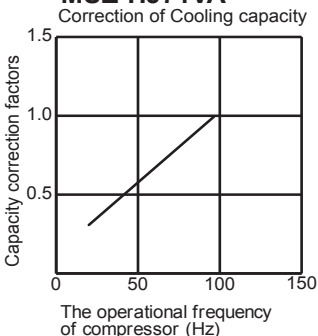

PERFORMANCE CURVES WALL-MOUNTED


C.1.5.2 Powerful Heating Heat Pump
CAPACITY AND THE INPUT CURVES

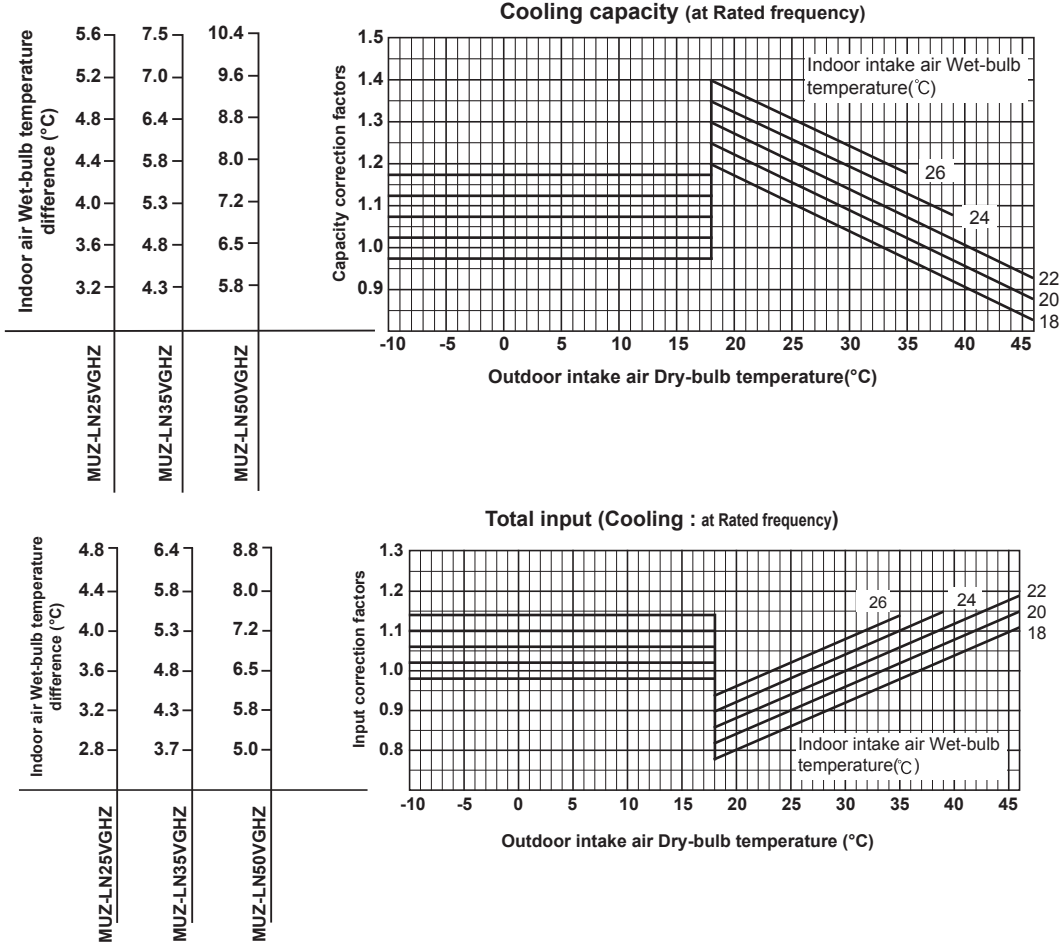

NOTE : The above broken lines are for the heating operation without any frost and defrost operation.


MUZ-LN25VGHZ

Heating capacity

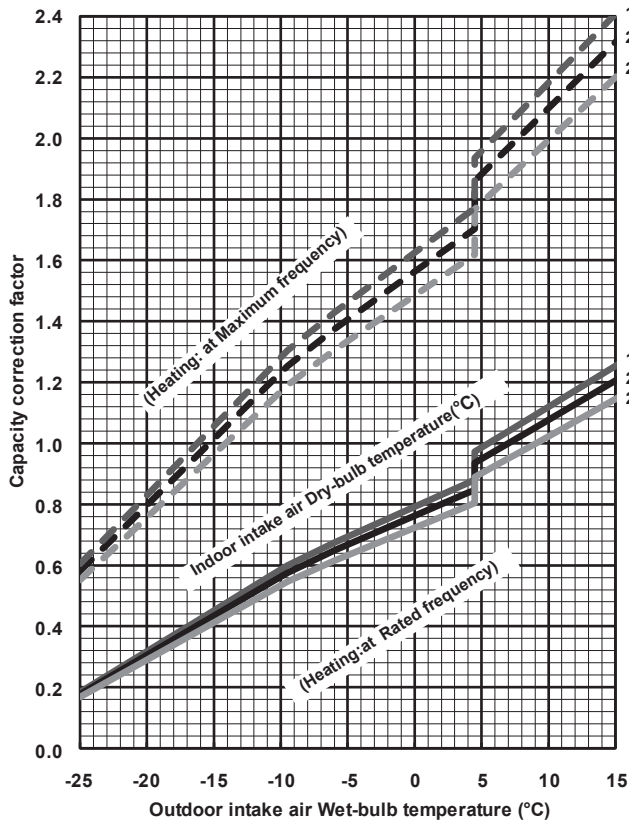


MUZ-LN35VGHZ

Heating capacity

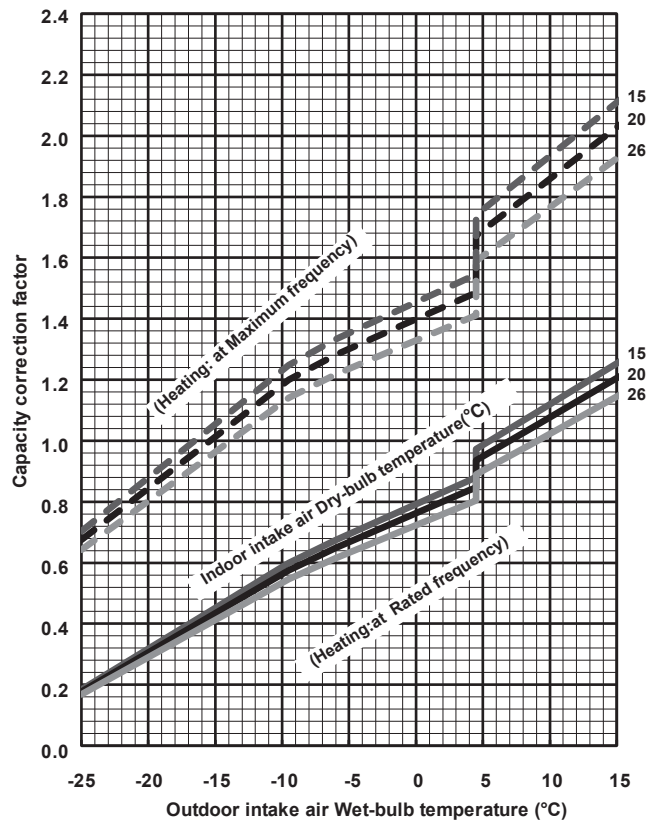

MUZ-LN50VGHZ

Heating capacity

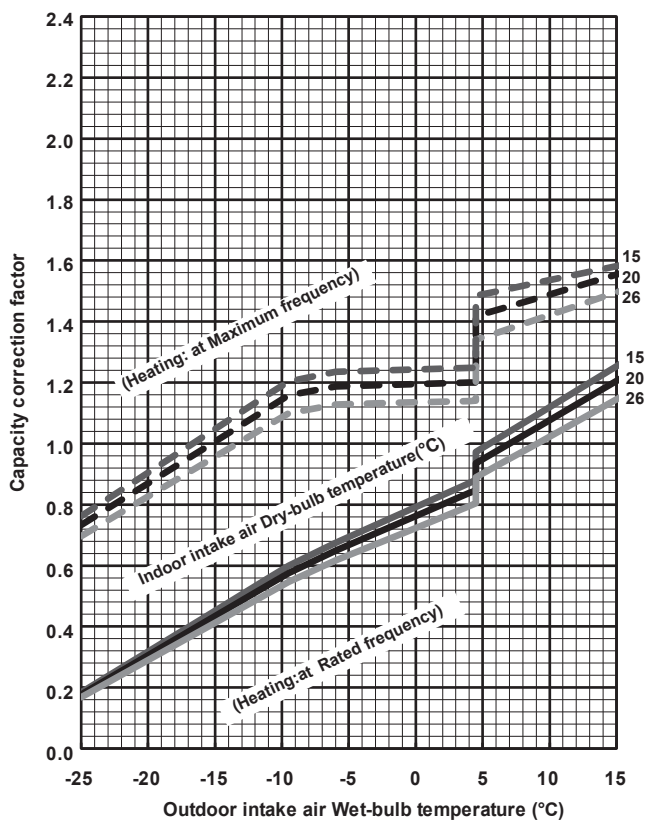


NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

PERFORMANCE CURVES WALL-MOUNTED


MUZ-LN25VGHZ

Total input (Heating)

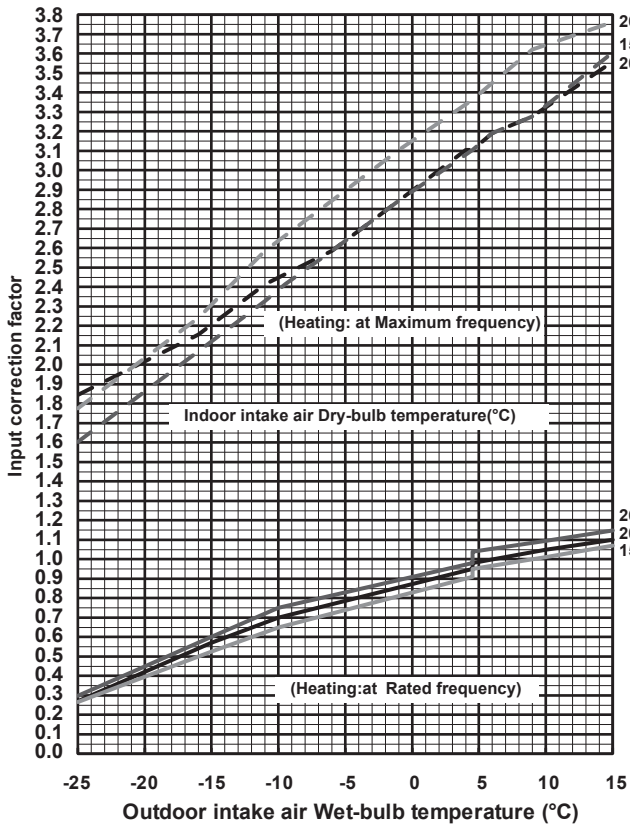


MUZ-LN35VGHZ

Total input (Heating)


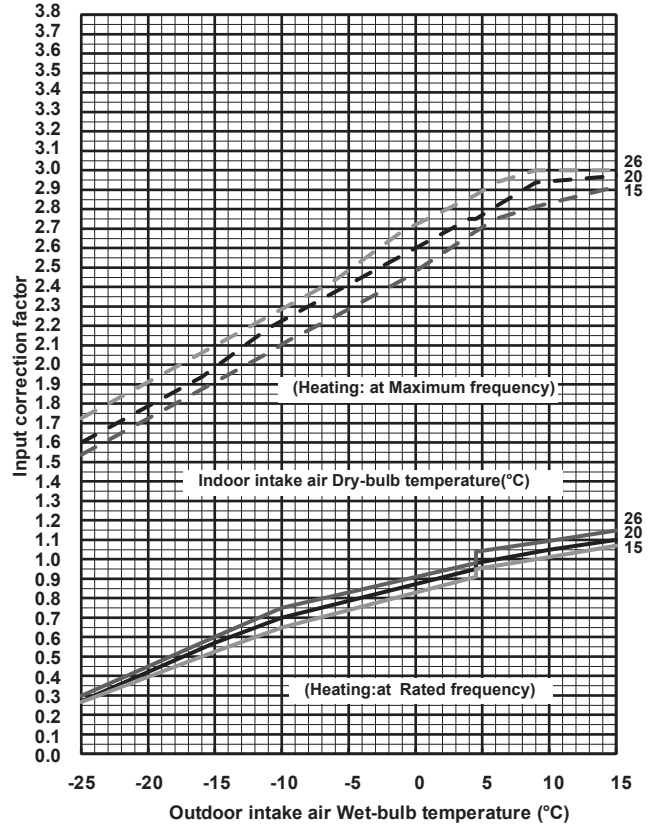


MUZ-LN50VGHZ

Total input (Heating)

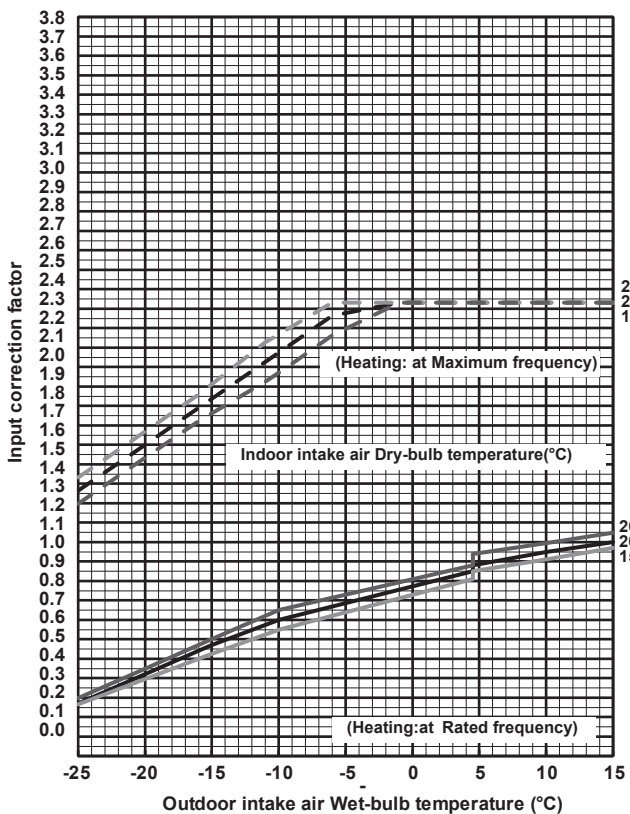

WALL-MOUNTED PERFORMANCE CURVES

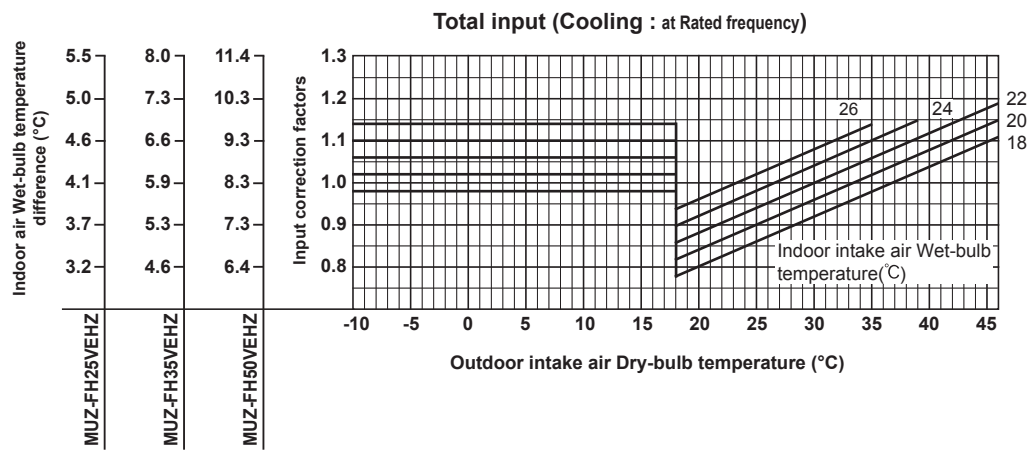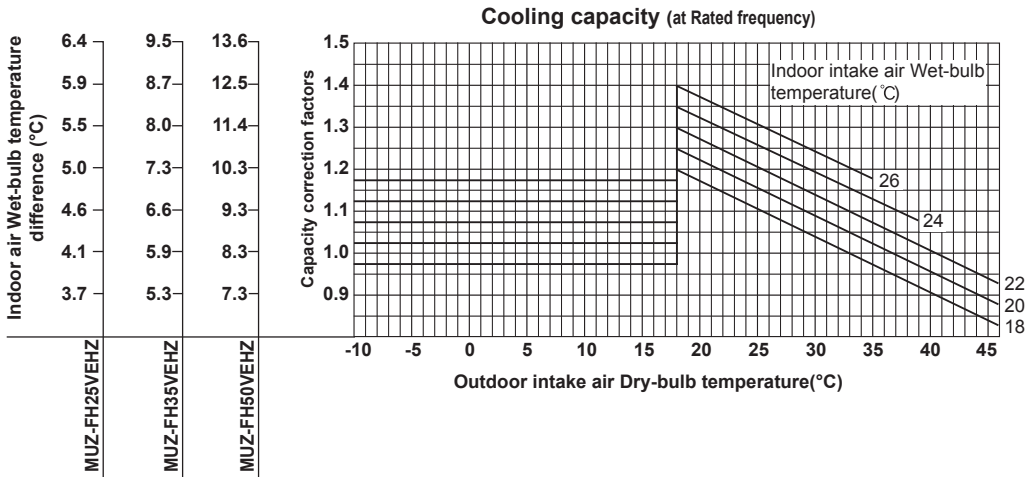


PERFORMANCE CURVES WALL-MOUNTED

NOTE : The above broken lines are for the heating operation without any frost and defrost operation.


MUZ-FH25VEHZ

Heating capacity

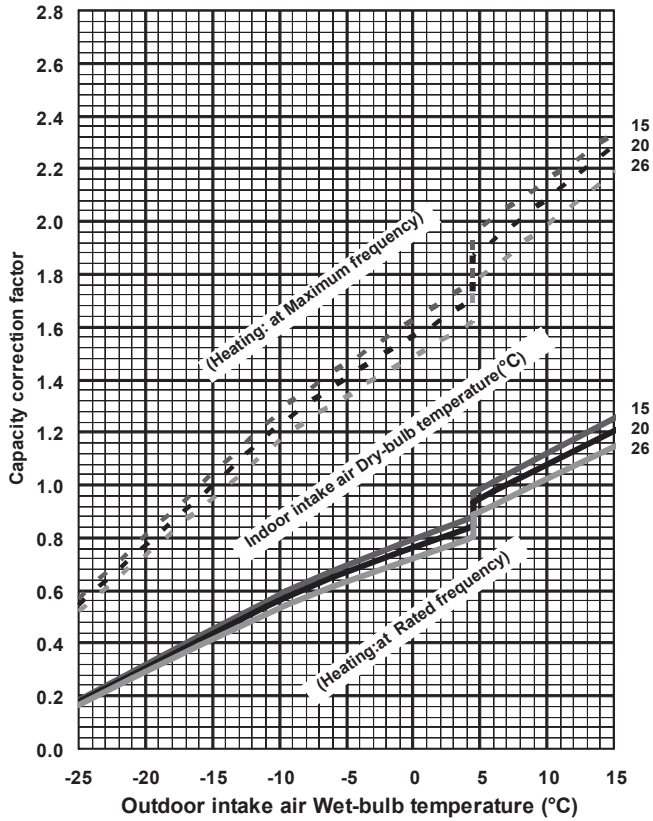


MUZ-FH35VEHZ

Heating capacity

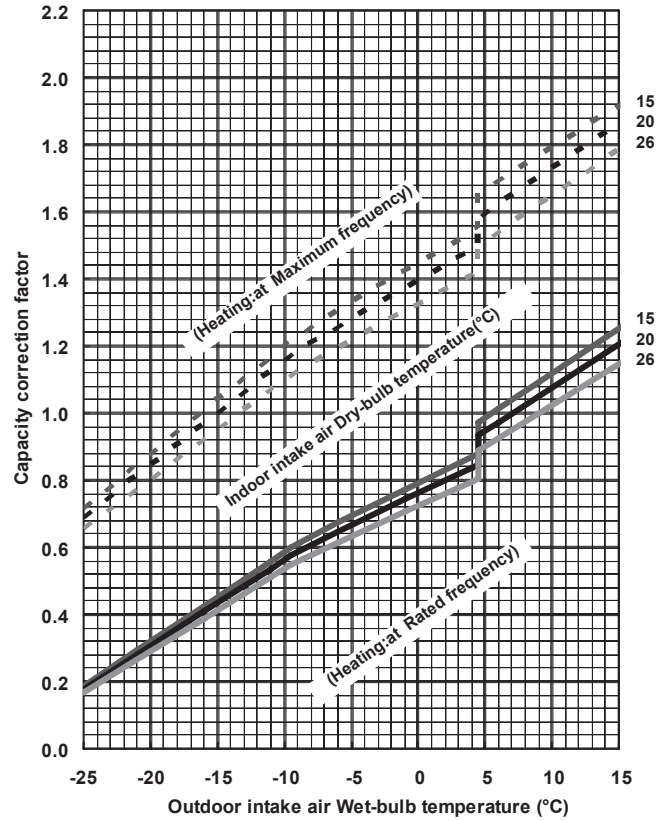

MUZ-FH50VEHZ


Heating capacity

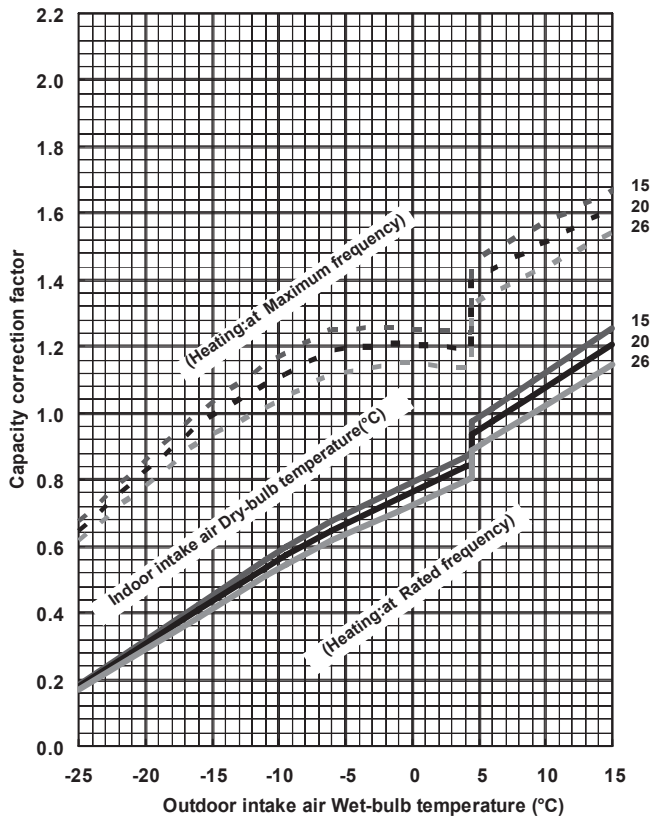

NOTE : The above broken lines are for the heating operation without any frost and defrost operation.


MUZ-FH25VEHZ

Total input (Heating)

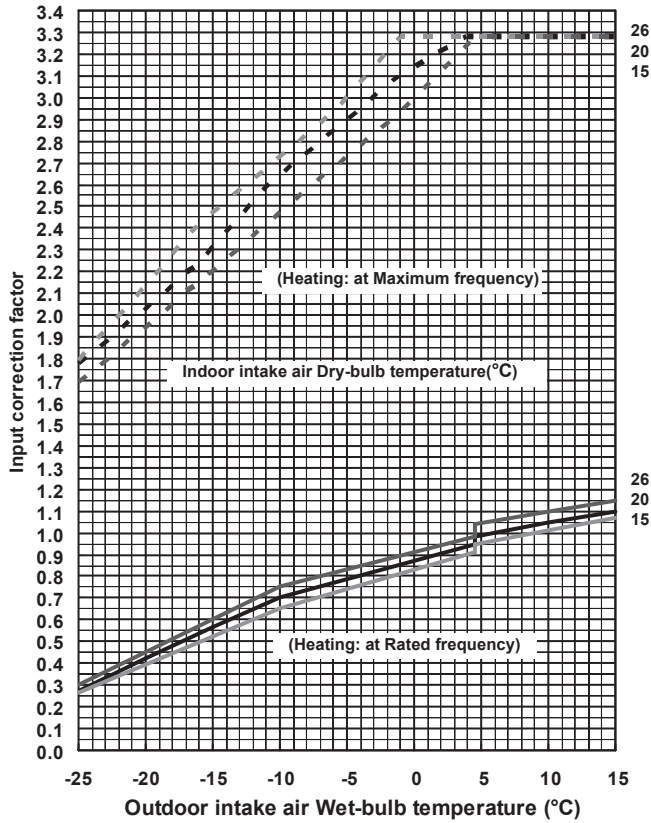


MUZ-FH35VEHZ

Total input (Heating)

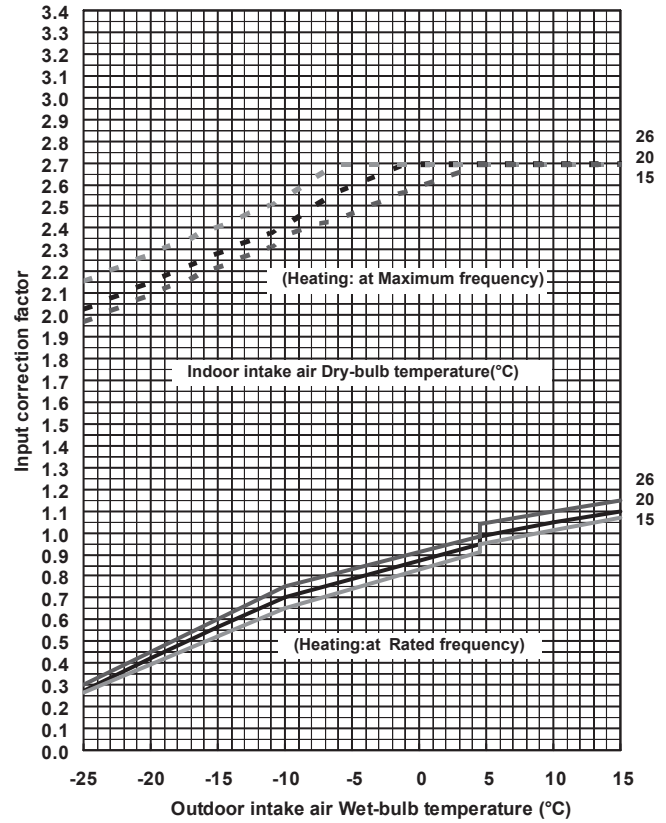

MUZ-FH50VEHZ


Total input (Heating)

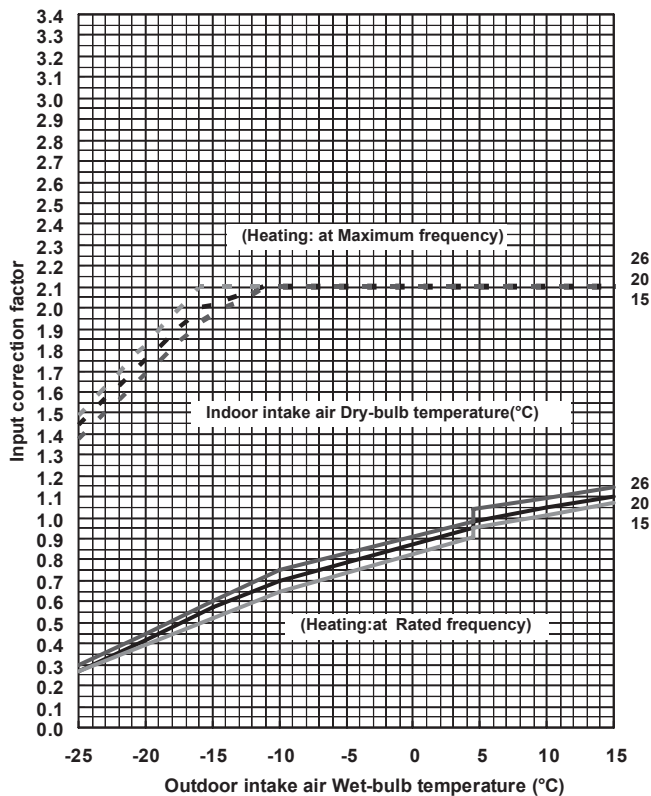


NOTE : The above broken lines are for the heating operation without any frost and defrost operation.

CAPACITY AND INPUT CORRECTION BY OPERATIONAL FREQUENCY OF COMPRESSOR


MUZ-LN25VGHZ

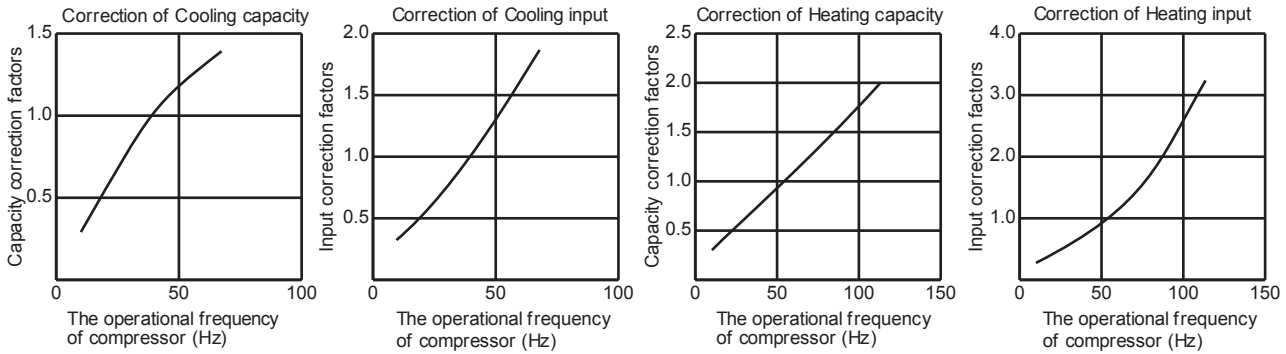

MUZ-LN35VGHZ




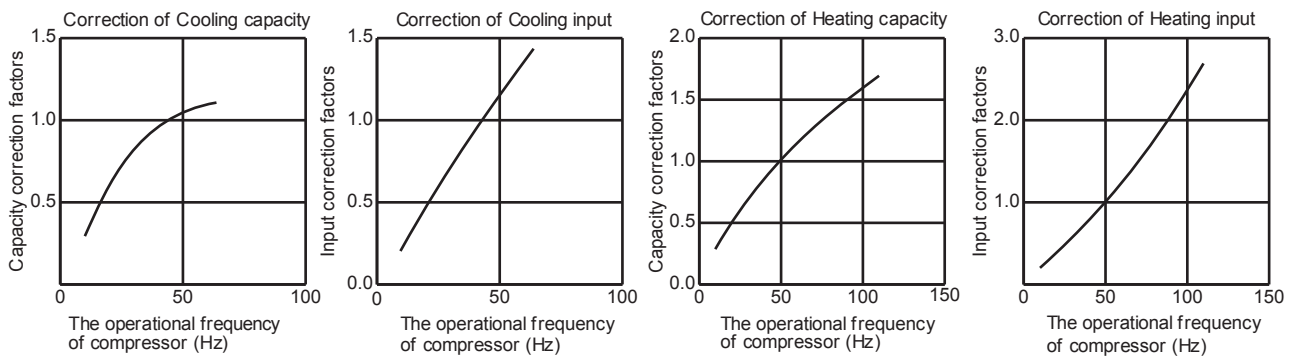


MUZ-LN50VGHZ




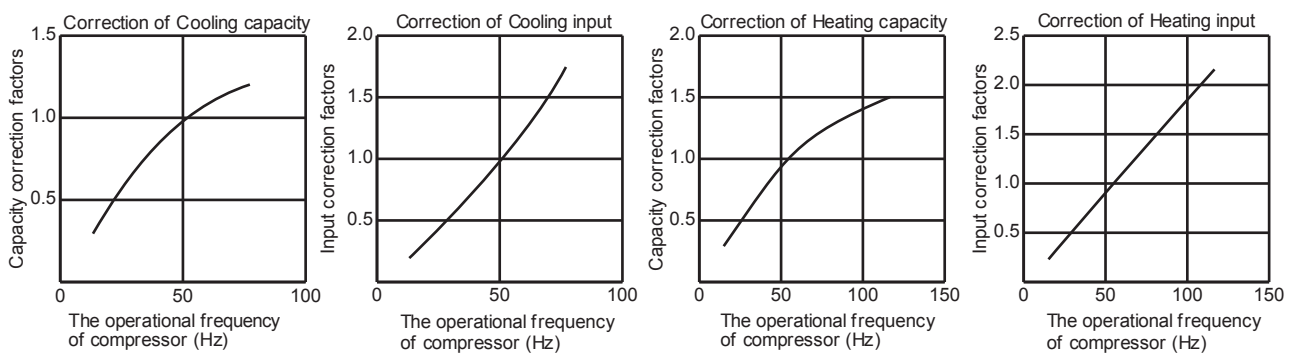


WALL-MOUNTED PERFORMANCE CURVES





MUZ-FH25VEHZ

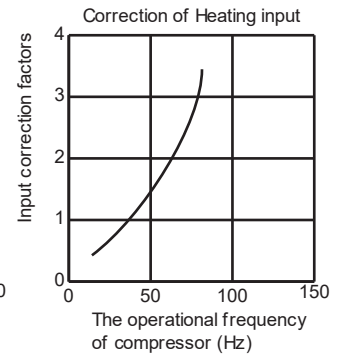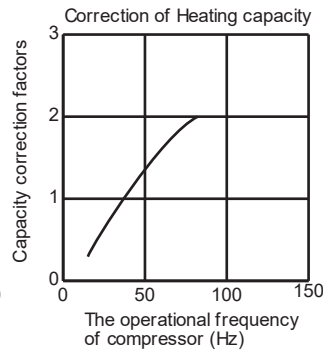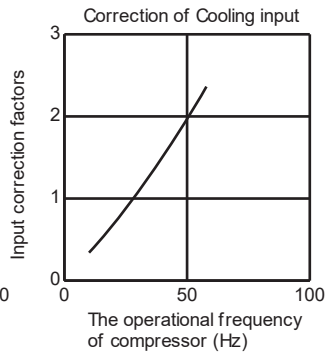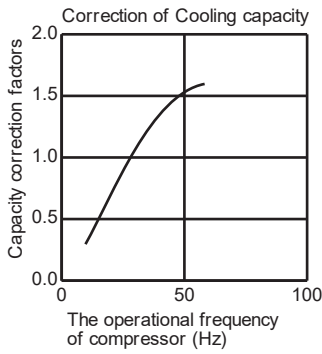

MUZ-FH35VEHZ

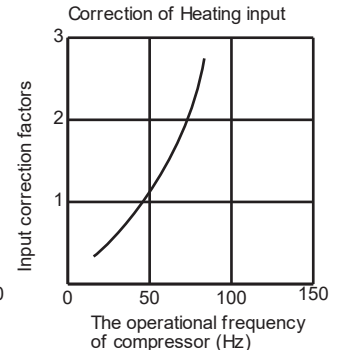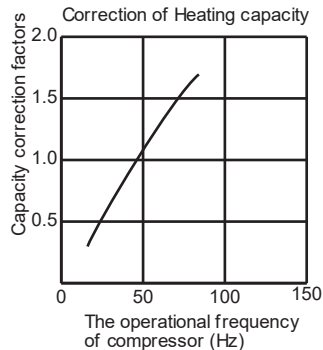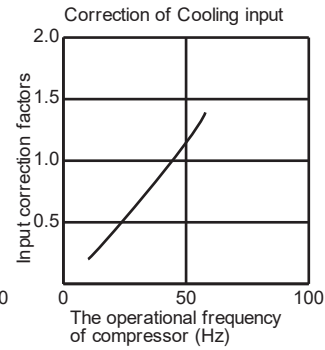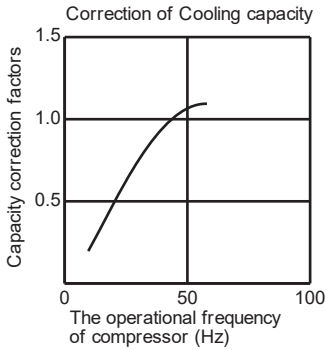

MUZ-FH50VEHZ

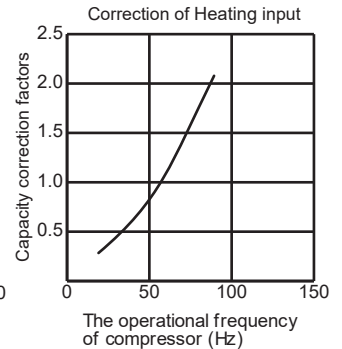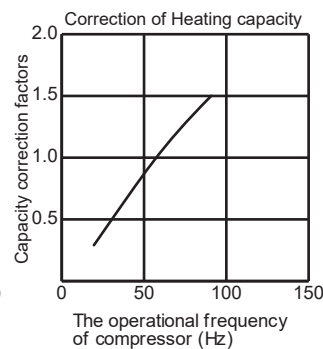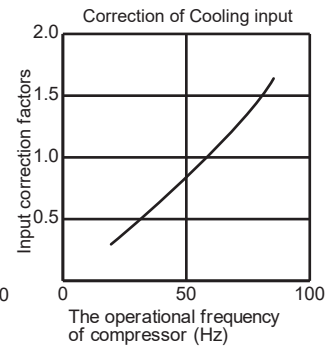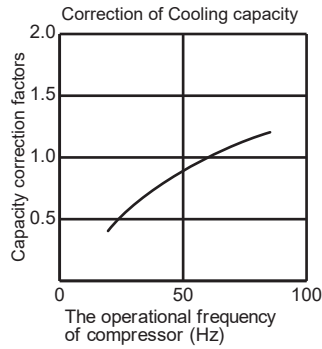

PERFORMANCE CURVES WALL-MOUNTED

C.1.5.3 Inverter/Powerful Heating Heat Pump HOW TO OPERATE FIXED-FREQUENCY OPERATION

<Test run operation>







1. Press EMERGENCY OPERATION switch to COOL or HEAT mode (COOL : Press once, HEAT : Press twice).
2. Test run operation starts and continues to operate for 30 minutes.
3. Compressor operates at rated frequency in COOL mode or 58Hz in HEAT mode.
4. Indoor fan operates at High speed.
5. After 30 minutes, test run operation finishes and EMERGENCY OPERATION starts (Operation frequency of compressor varies).
6. To cancel test run operation (EMERGENCY OPERATION), press EMERGENCY OPERATION switch or any button on remote controller.

OUTDOOR LOW PRESSURE AND OUTDOOR UNIT CURRENT

COOL operation


- ① Both indoor and outdoor unit are under the same temperature/humidity condition.
- ② Operation : TEST RUN OPERATION
- ③ The unit of pressure has been changed to MPa on the international system of units (SI unit system)
The conversion factor is: **1 (MPa [Gauge]) = 10.2 (kgf/cm² [Gauge])**

Dry-bulb temperature (°C)	Relative humidity (%)
20	50
25	60
30	70

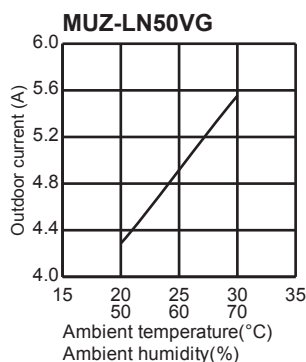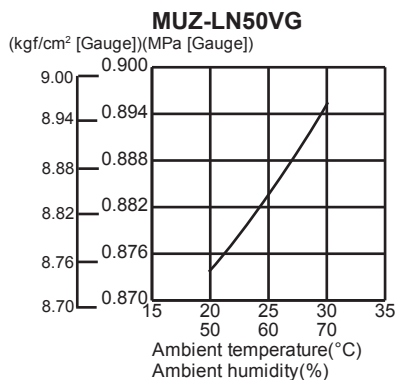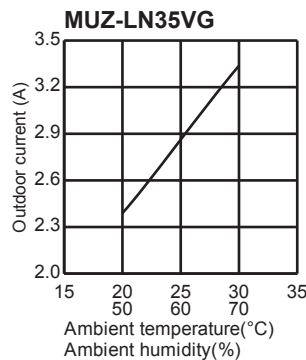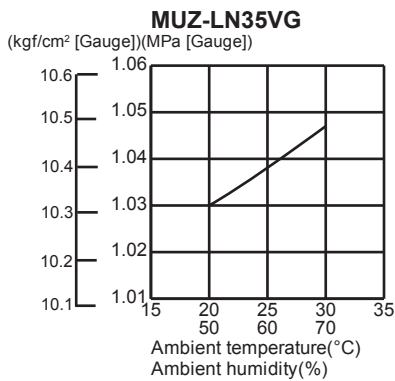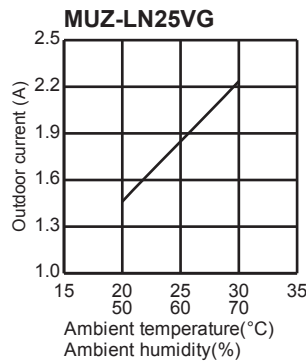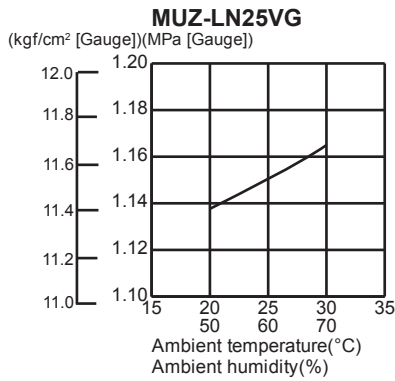


WALL-MOUNTED PERFORMANCE CURVES


MUZ-LN60VG

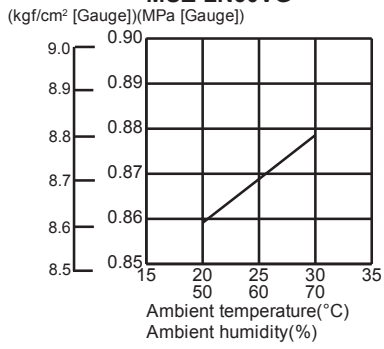


MUZ-LN60VG

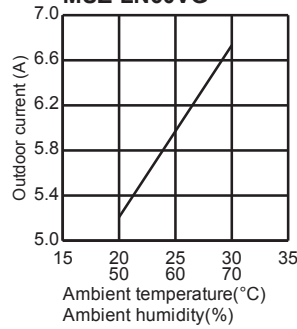


MUZ-LN25VGHZ

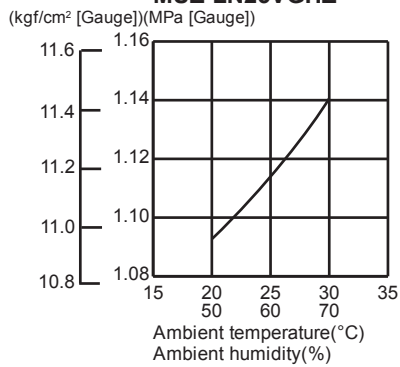


MUZ-LN25VGHZ

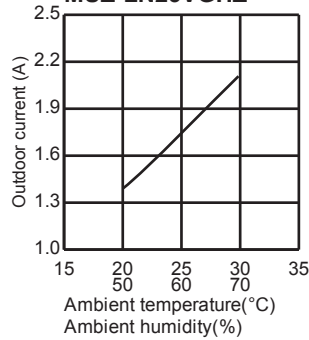


MUZ-LN35VGHZ

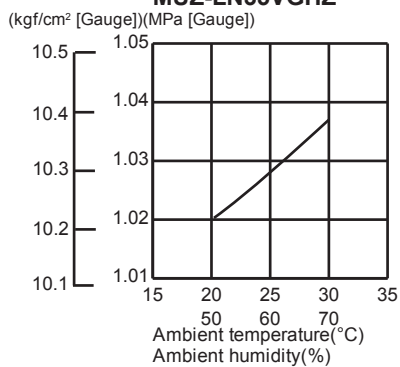


MUZ-LN35VGHZ

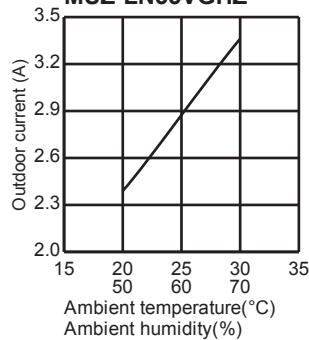

MUZ-LN50VGHZ

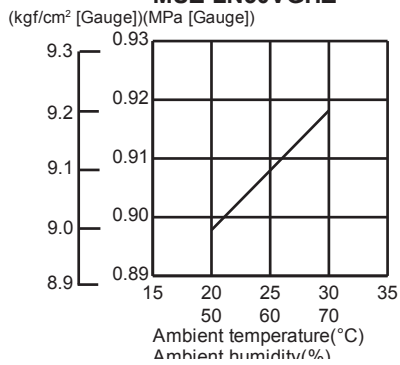


MUZ-LN50VGHZ

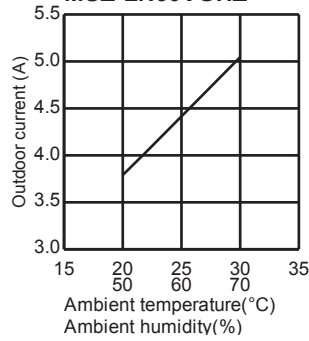


PERFORMANCE CURVES WALL-MOUNTED


MUZ-AP20VG

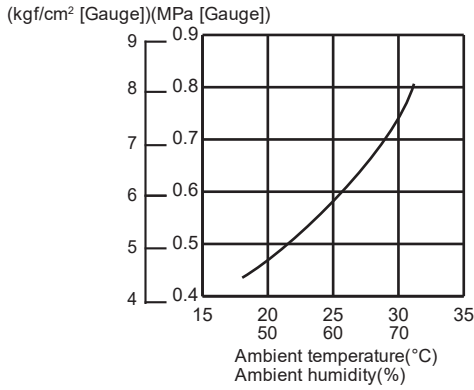


MUZ-AP20VG

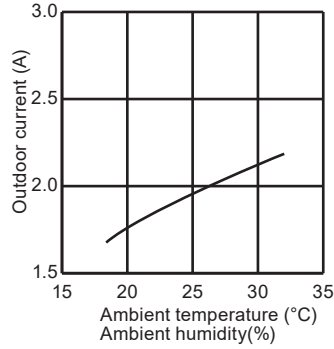


**MUZ-AP25VG
MUZ-AP25VGH**

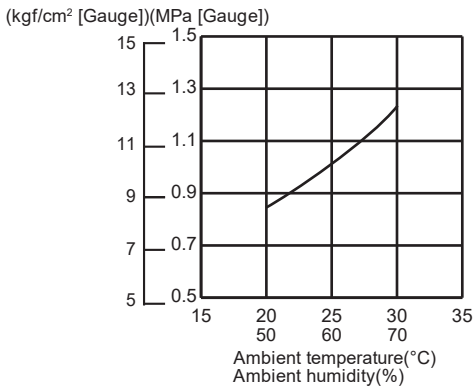


**MUZ-AP25VG
MUZ-AP25VGH**

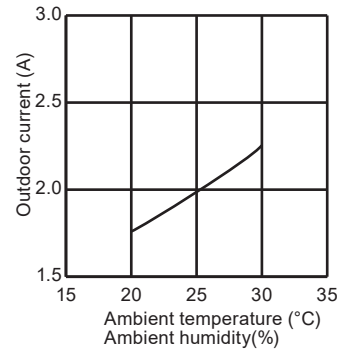


**MUZ-AP35VG
MUZ-AP35VGH**

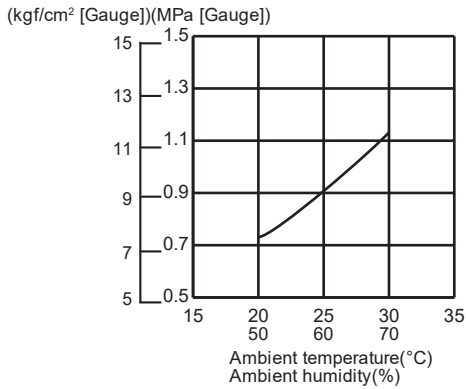


**MUZ-AP35VG
MUZ-AP35VGH**

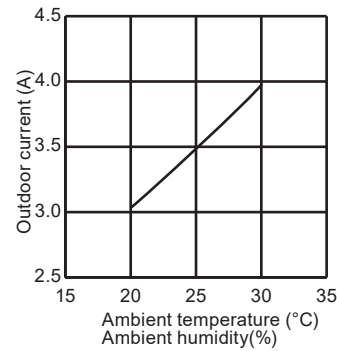


**MUZ-AP42VG
MUZ-AP42VGH**

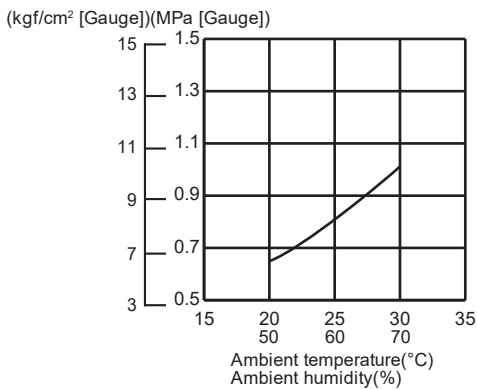


**MUZ-AP42VG
MUZ-AP42VGH**

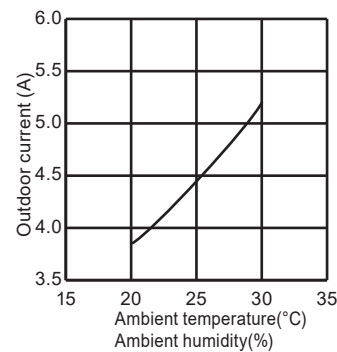


MUZ-AP50VG
MUZ-AP50VGH

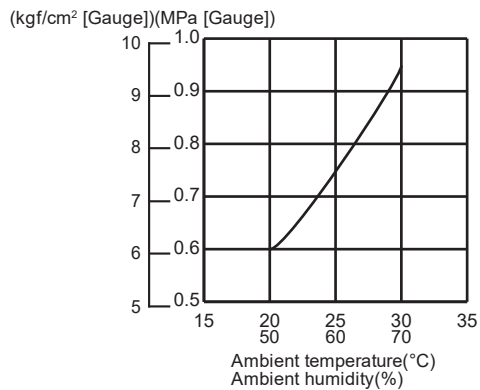


MUZ-AP50VG
MUZ-AP50VGH

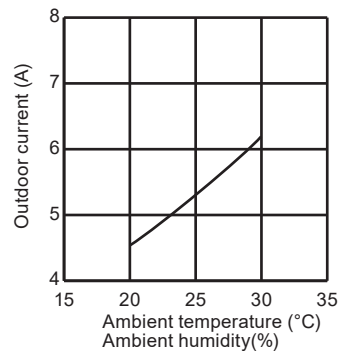


MUZ-AP60VG

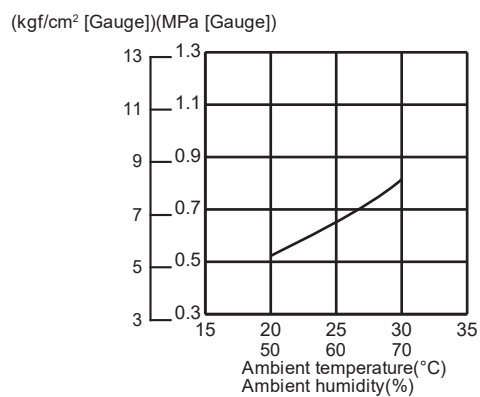


MUZ-AP60VG

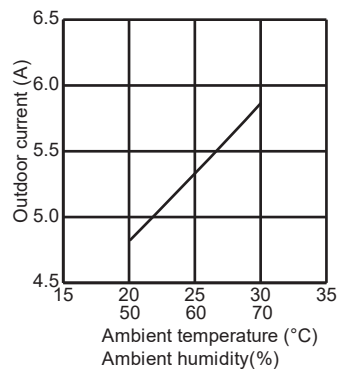

MUZ-AP71VG

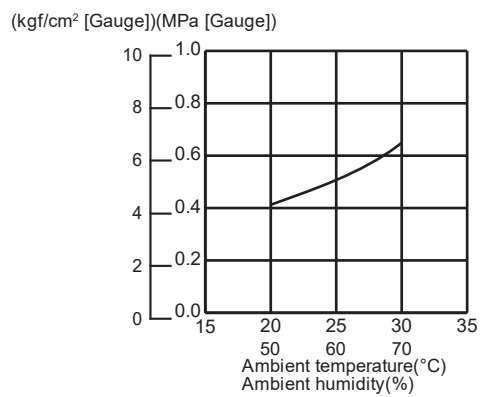


MUZ-AP71VG

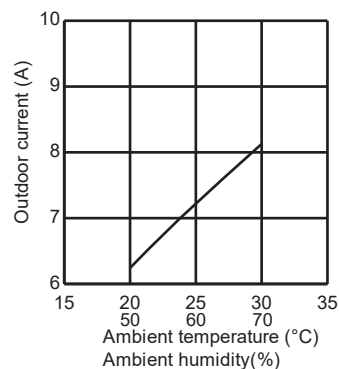


PERFORMANCE CURVES WALL-MOUNTED


MUZ-HR25VF

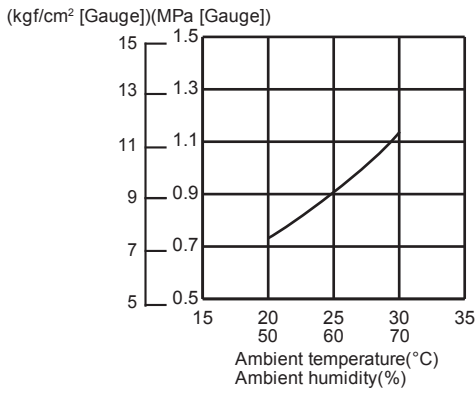


MUZ-HR25VF

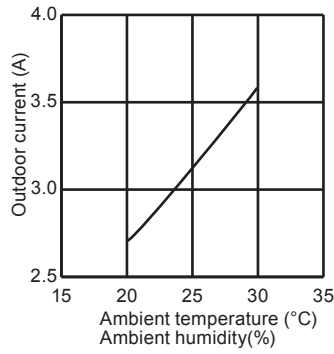


MUZ-HR35VF

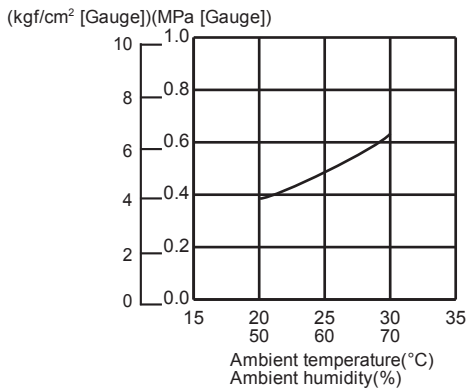


MUZ-HR35VF

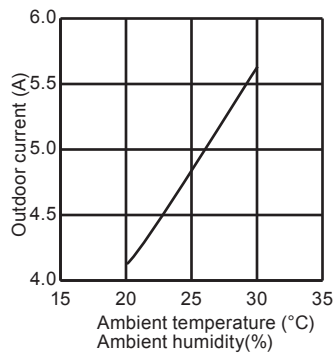


MUZ-HR42VF

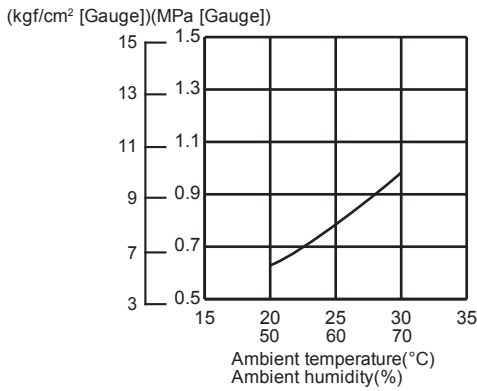


MUZ-HR42VF

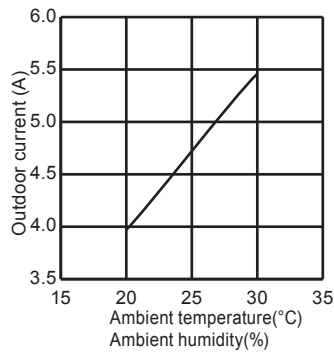


MUZ-HR50VF

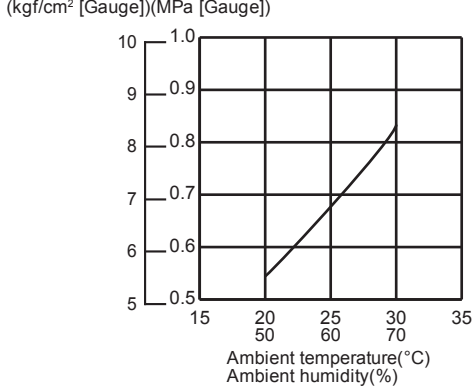


MUZ-HR50VF

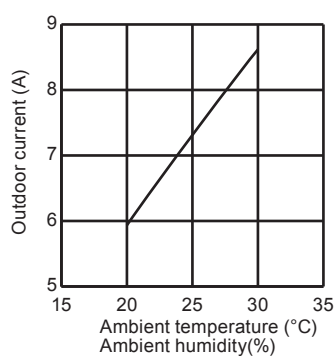


MUY-TP35VF

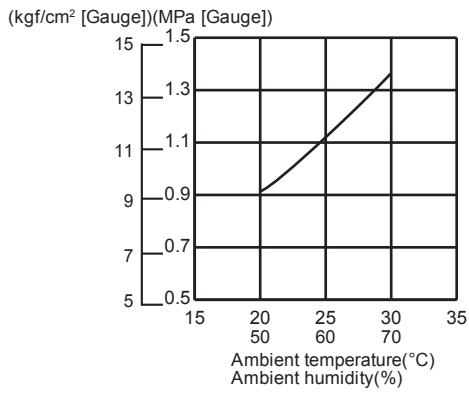


MUY-TP35VF

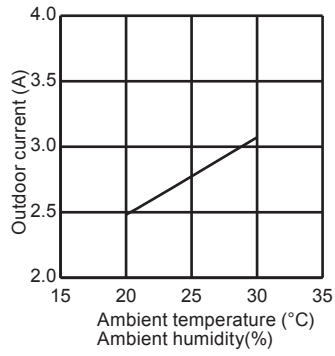

MUY-TP50VF

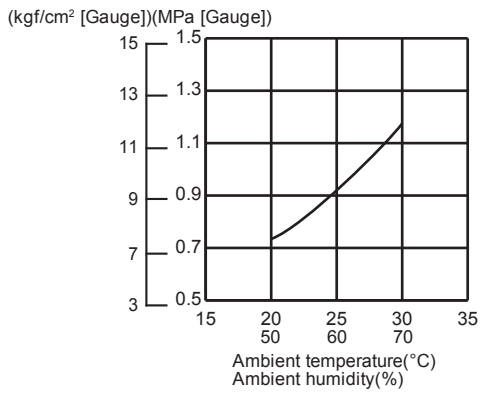


MUY-TP50VF

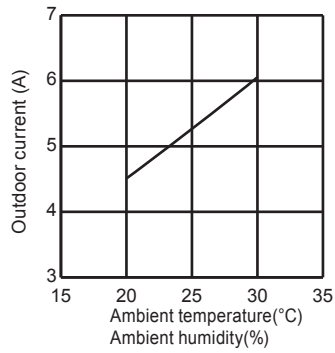


PERFORMANCE CURVES WALL-MOUNTED


MUZ-FH25VE

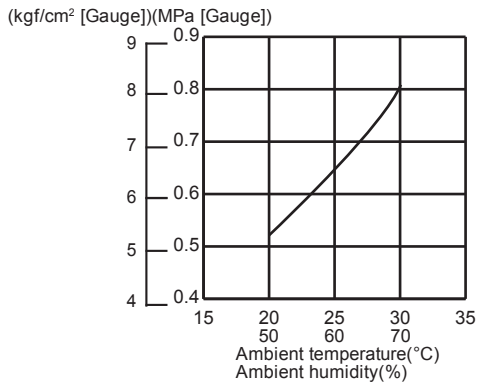


MUZ-FH25VE

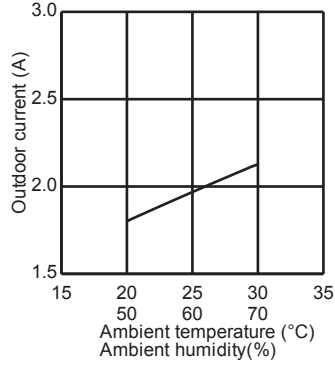


MUZ-FH35VE

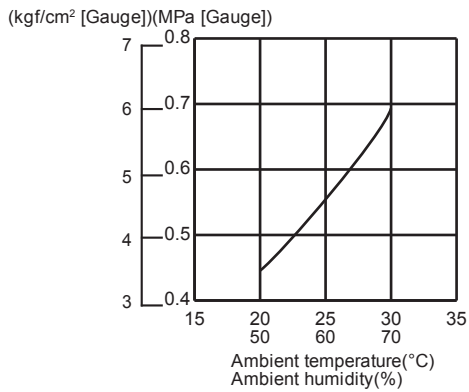


MUZ-FH35VE

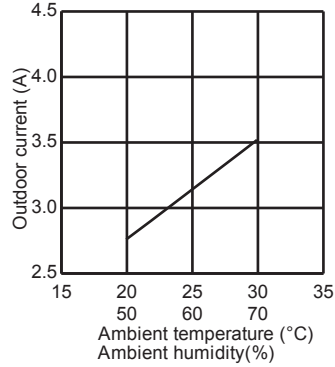


MUZ-FH50VE

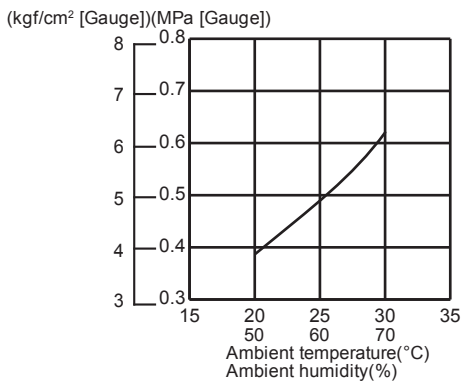


MUZ-FH50VE

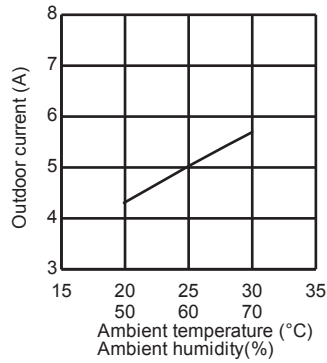


MUZ-FH25VEHZ

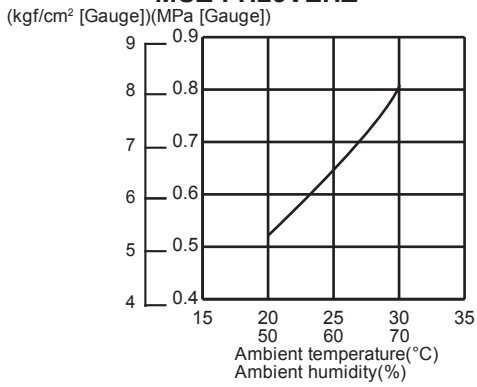


MUZ-FH25VEHZ

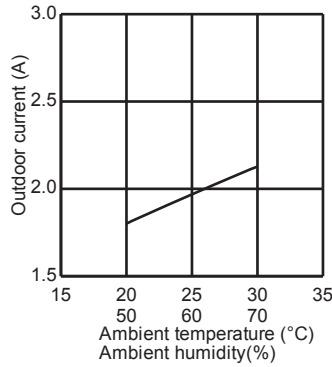


MUZ-FH35VEHZ

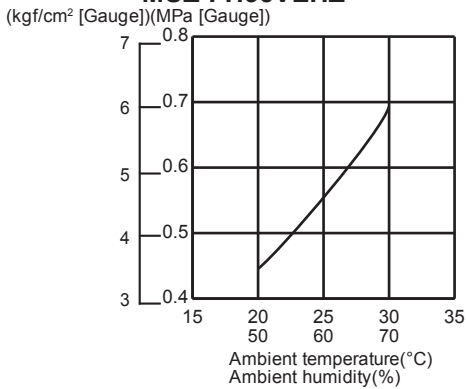


MUZ-FH35VEHZ

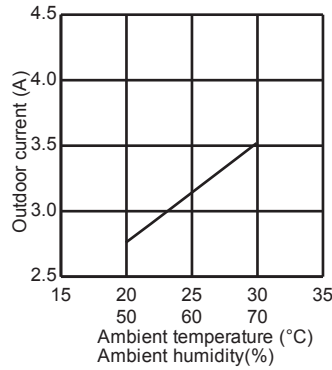


MUZ-FH50VEHZ

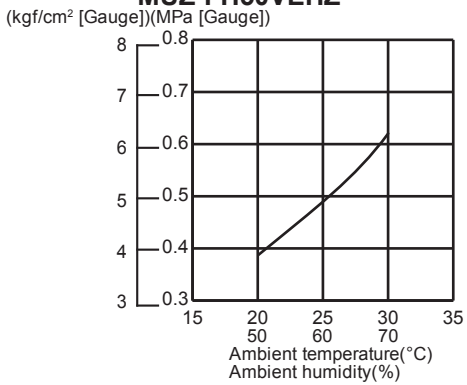


MUZ-FH50VEHZ

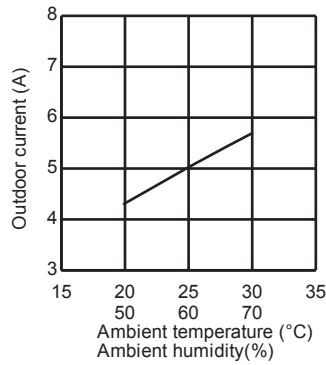

**MUZ-EF25VG
MUZ-EF25VGH**

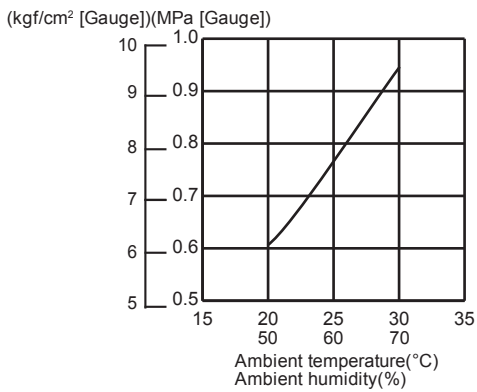


**MUZ-EF25VG
MUZ-EF25VGH**

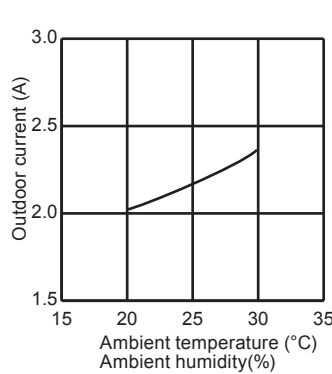


PERFORMANCE CURVES WALL-MOUNTED


MUZ-EF35VG
MUZ-EF35VGH

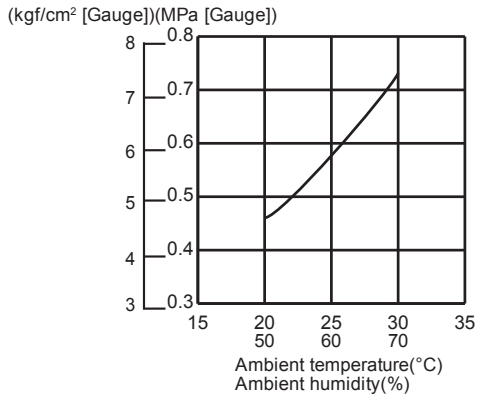


MUZ-EF35VG
MUZ-EF35VGH

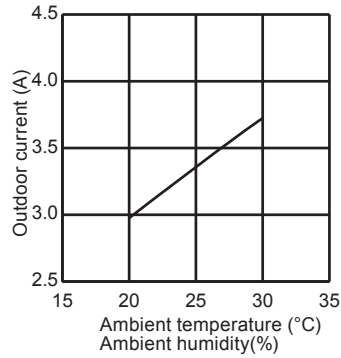


MUZ-EF42VG

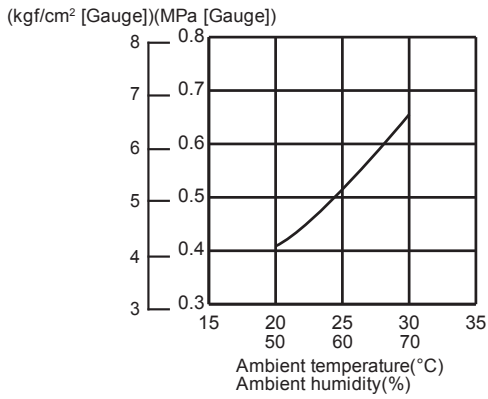


MUZ-EF42VG

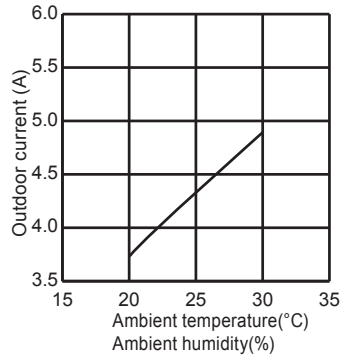


MUZ-EF50VG

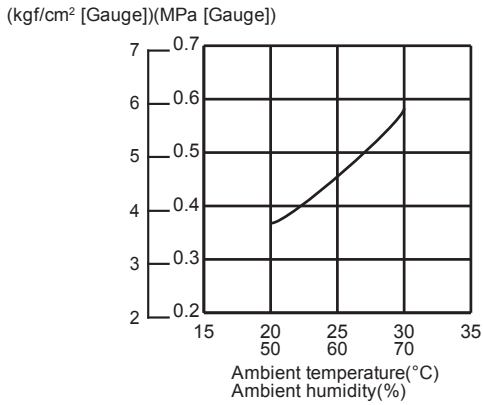


MUZ-EF50VG

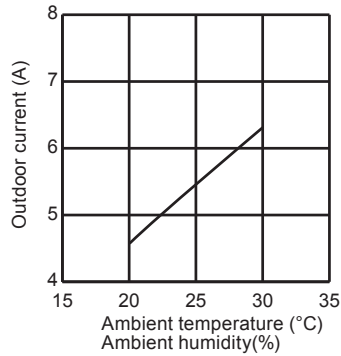


MUZ-SF25VE
MUZ-SF25VEH

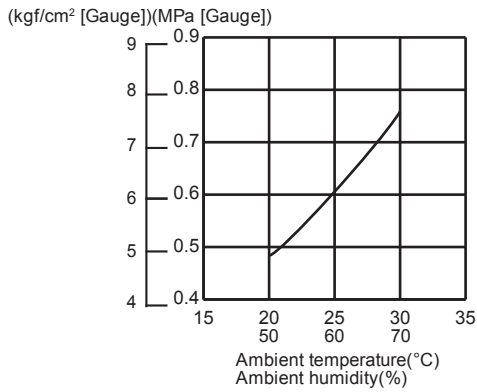


MUZ-SF25VE
MUZ-SF25VEH

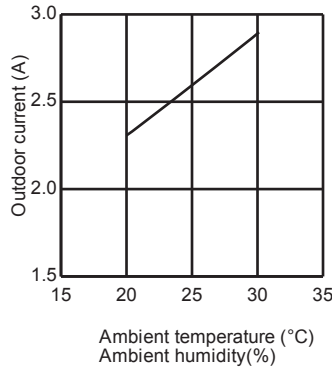


MUZ-SF35VE
MUZ-SF35VEH

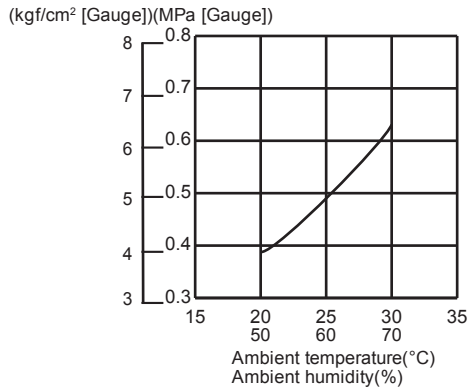


MUZ-SF35VE
MUZ-SF35VEH

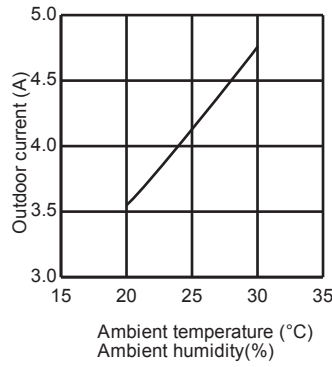


MUZ-SF42VE
MUZ-SF42VEH

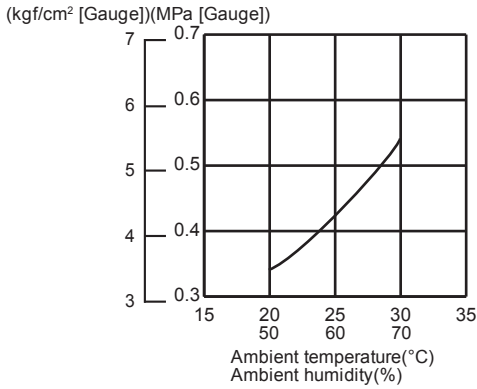


MUZ-SF42VE
MUZ-SF42VEH

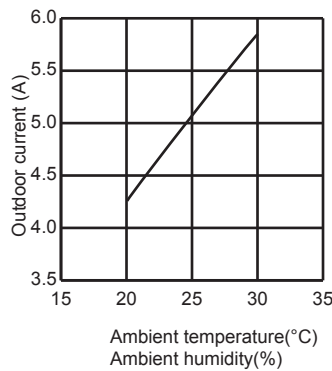

MUZ-SF50VE
MUZ-SF50VEH

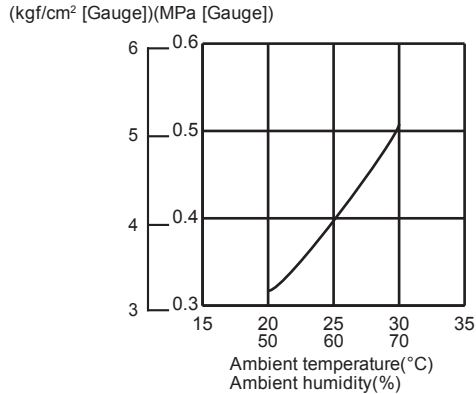


MUZ-SF50VE
MUZ-SF50VEH

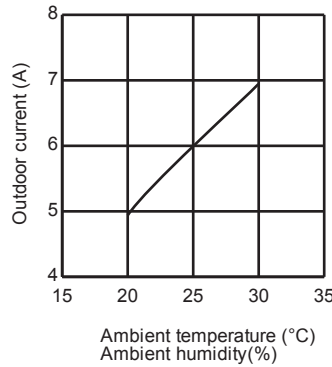


PERFORMANCE CURVES WALL-MOUNTED


MUZ-GF60VE

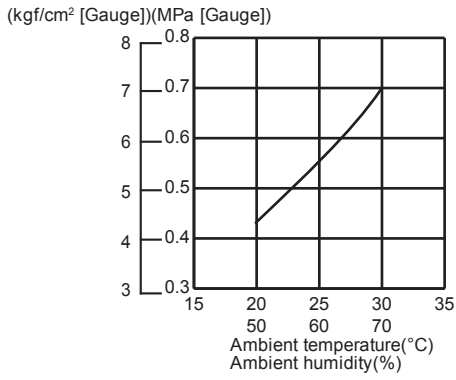


MUZ-GF60VE

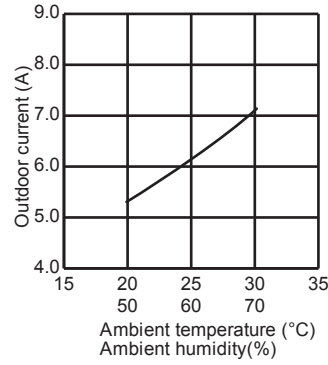


MUZ-GF71VE

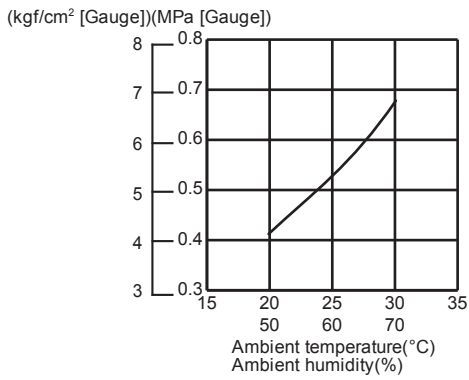


MUZ-GF71VE

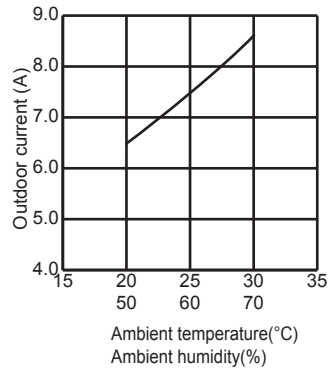


MUZ-WN25VA

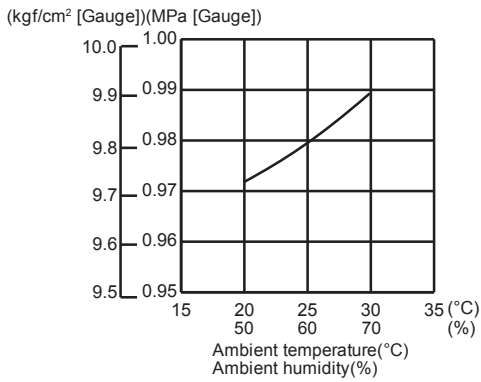


MUZ-WN25VA

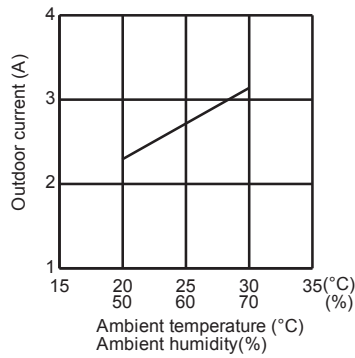


MUZ-WN35VA

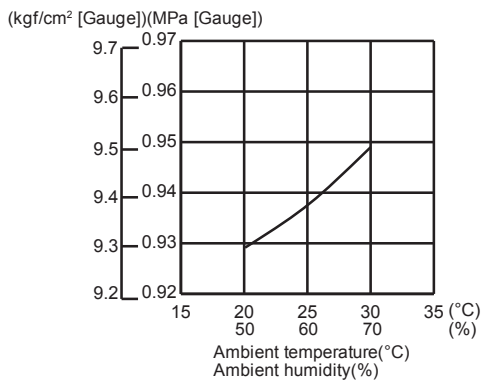


MUZ-WN35VA

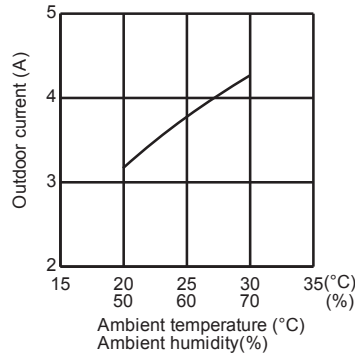


MUZ-DM25VA

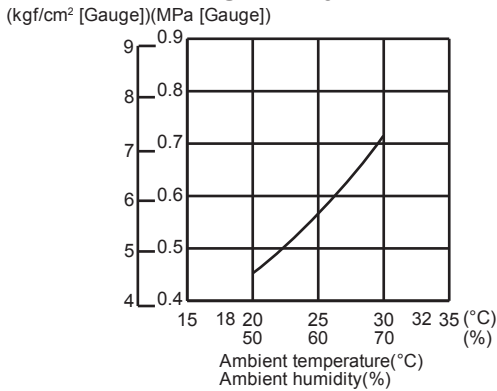


MUZ-DM25VA

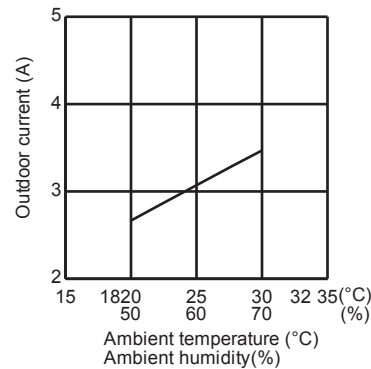


MUZ-DM35VA

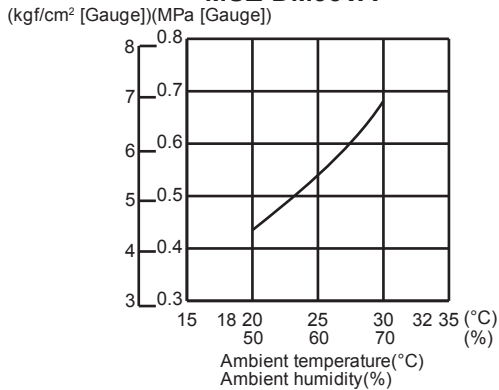


MUZ-DM35VA

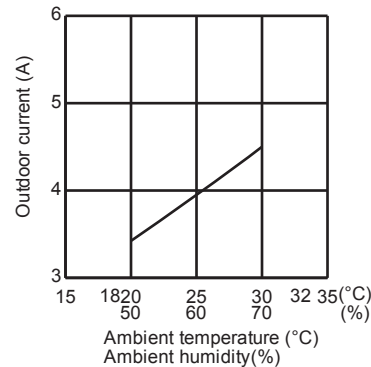


MUZ-HJ25VA

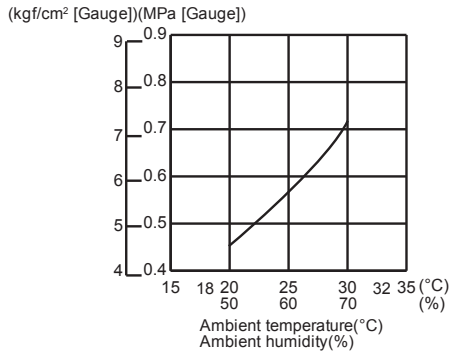


MUZ-HJ25VA

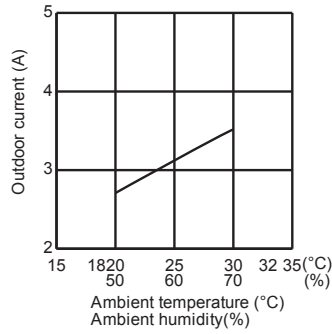


MUZ-HJ35VA

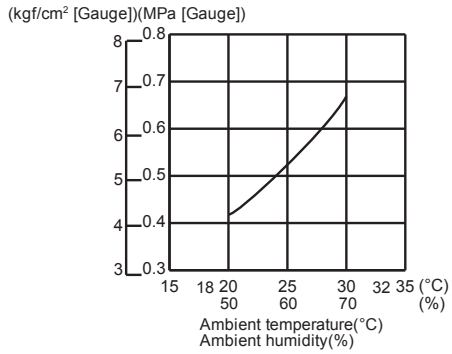


MUZ-HJ35VA

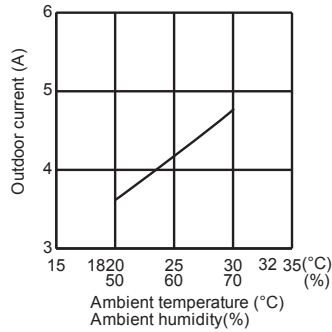


MUZ-HJ50VA

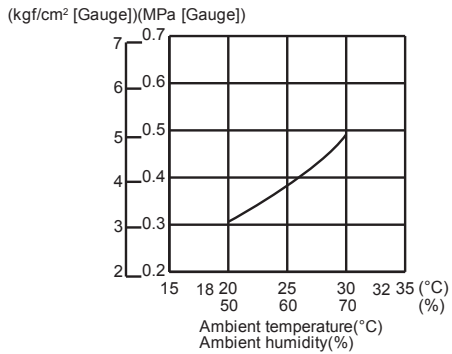


MUZ-HJ50VA

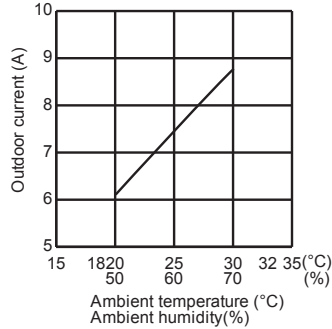


MUZ-HJ60VA

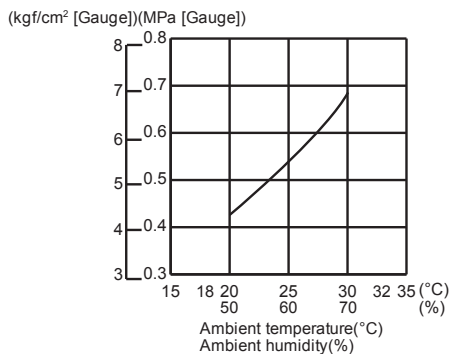


MUZ-HJ60VA

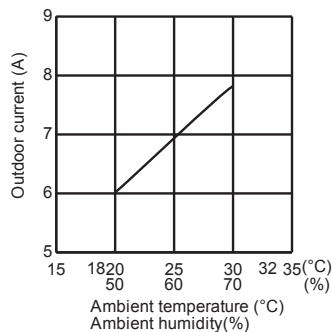

MUZ-HJ71VA

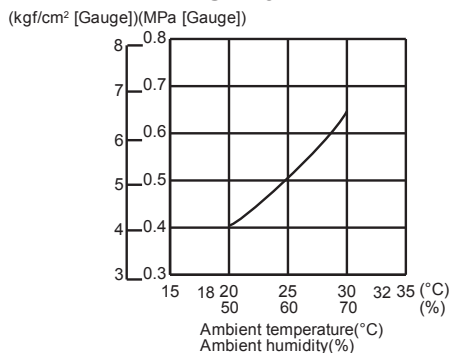

MUZ-HJ71VA

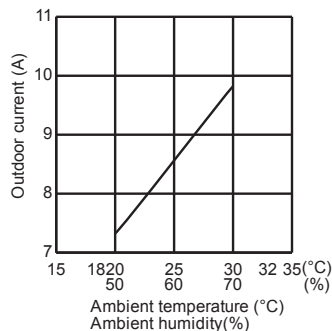











HEAT operation

① Condition :

	Indoor	Outdoor			
Dry bulb temperature (°C)	20.0	2	7	15	20.0
Wet bulb temperature (°C)	14.5	1	6	12	14.5


② Operation : TEST RUN OPERATION

Outdoor unit current

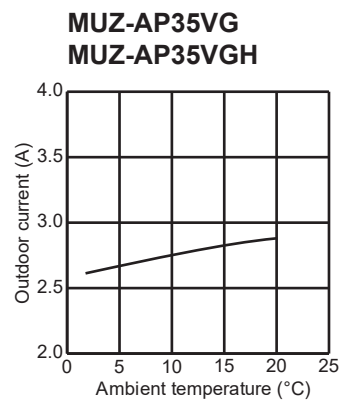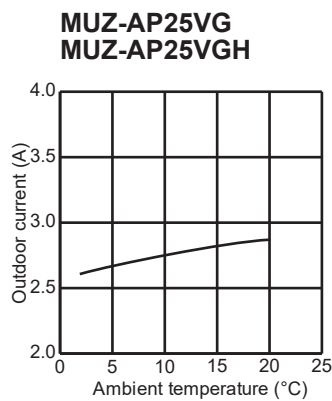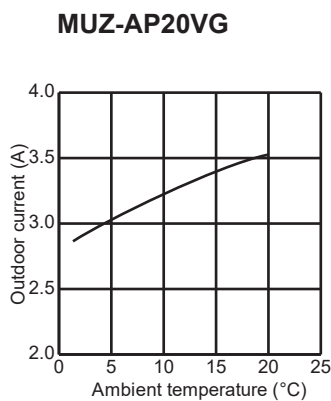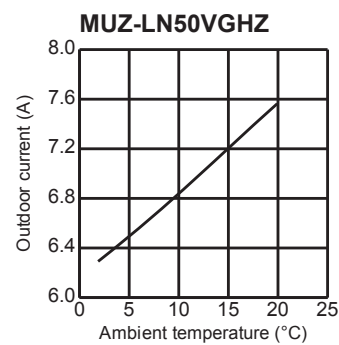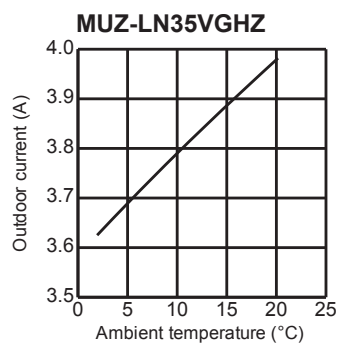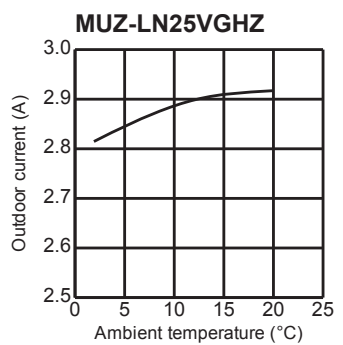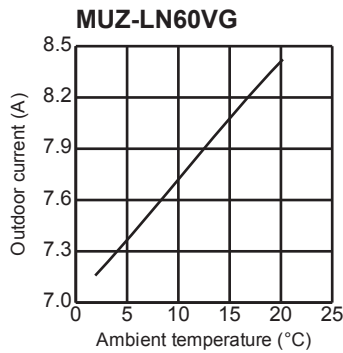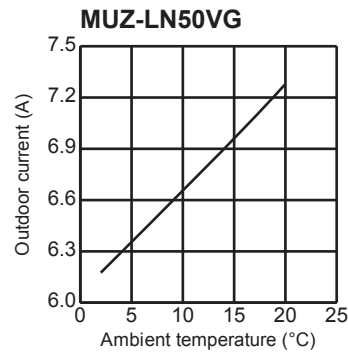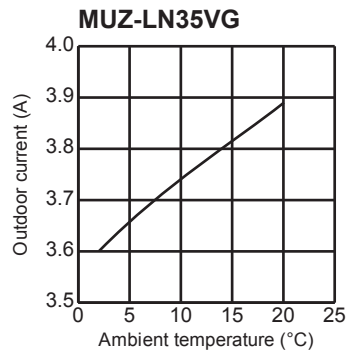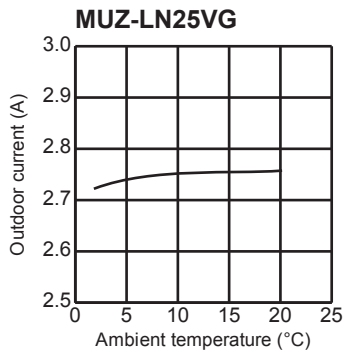


PERFORMANCE CURVES WALL-MOUNTED


**MUZ-AP42VG
MUZ-AP42VGH**

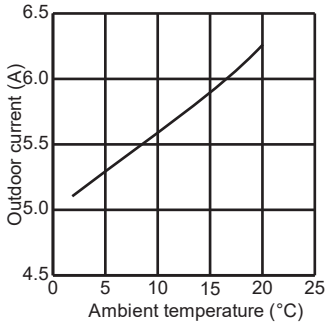


**MUZ-AP50VG
MUZ-AP50VGH**

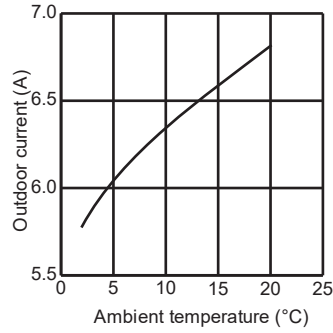


MUZ-AP60VG

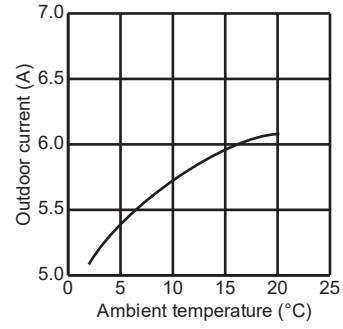


MUZ-AP71VG

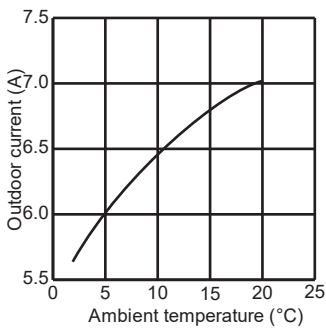


MUZ-HR25VF

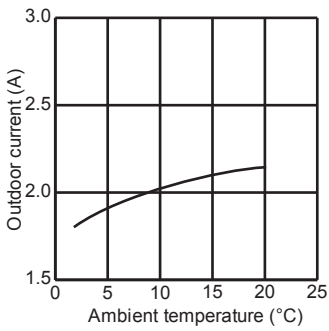


MUZ-HR35VF

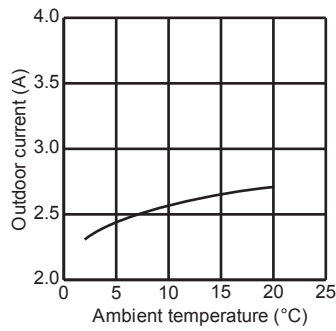


MUZ-HR42VF

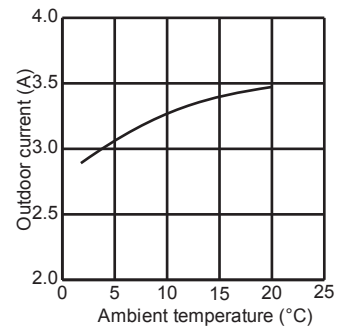


MUZ-HR50VF

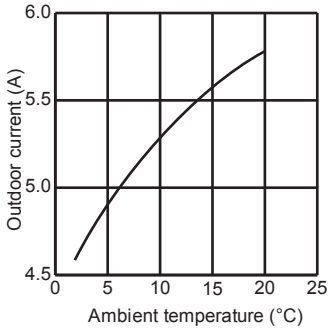


MUZ-FH25VE

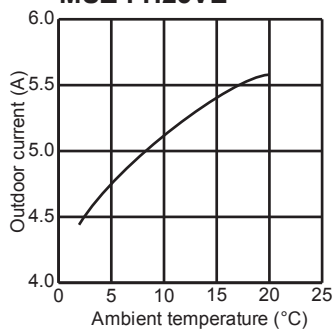


MUZ-FH35VE

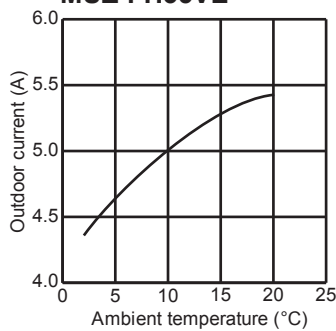


MUZ-FH50VE

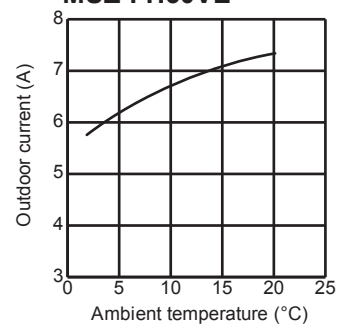


MUZ-FH25VEHZ

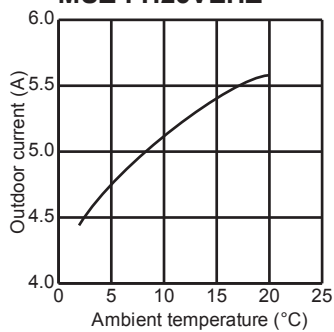


MUZ-FH35VEHZ

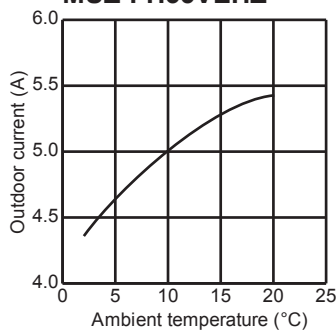


MUZ-FH50VEHZ

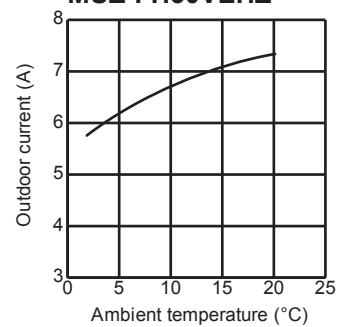


**MUZ-EF25VG
MUZ-EF25VGH**

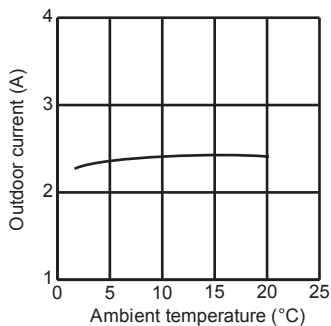


**MUZ-EF35VG
MUZ-EF35VGH**

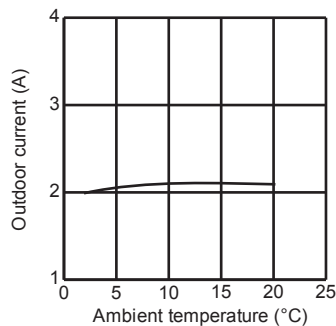

MUZ-EF42VG

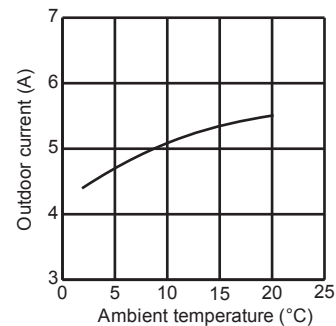


MUZ-EF50VG

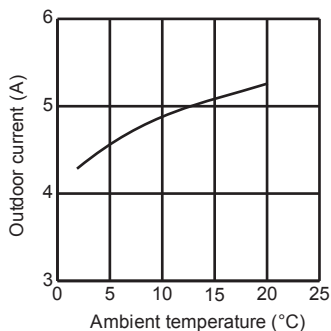


PERFORMANCE CURVES WALL-MOUNTED


MUZ-SF25VE
MUZ-SF25VEH

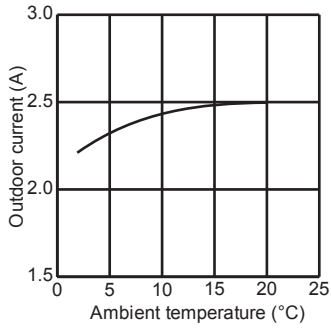


MUZ-SF35VE
MUZ-SF35VEH

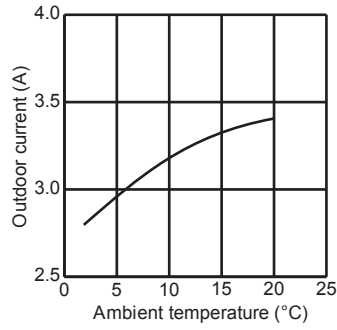


MUZ-SF42VE
MUZ-SF42VEH

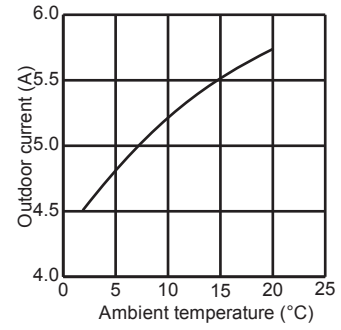


MUZ-SF50VE
MUZ-SF50VEH

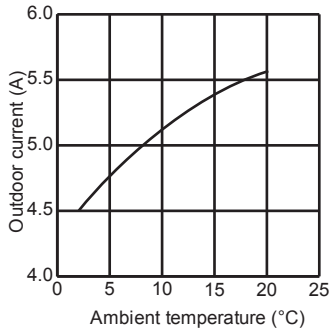


MUZ-GF60VE

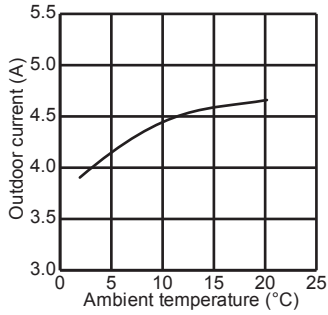


MUZ-GF71VE

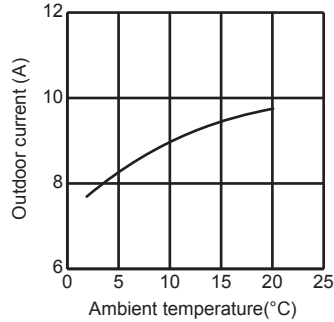


MUZ-WN25VA

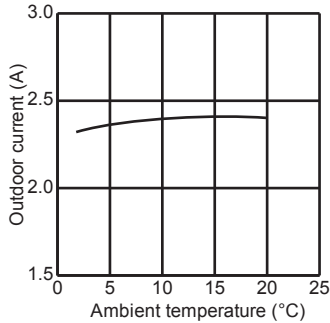


MUZ-WN35VA

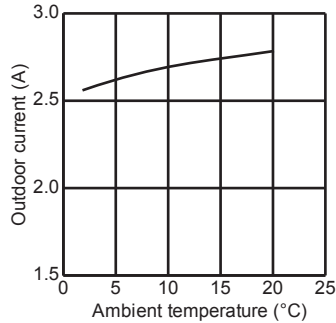


MUZ-DM25VA

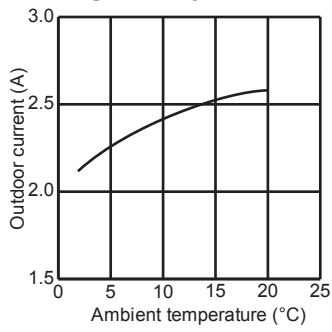


MUZ-DM35VA

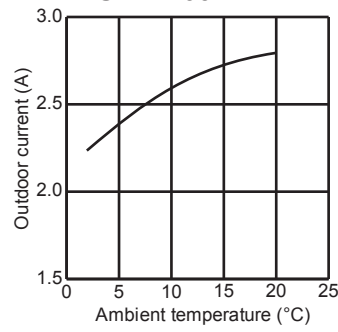


MUZ-HJ25VA

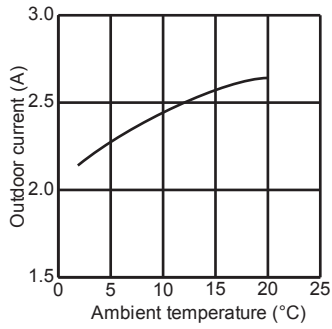


MUZ-HJ35VA

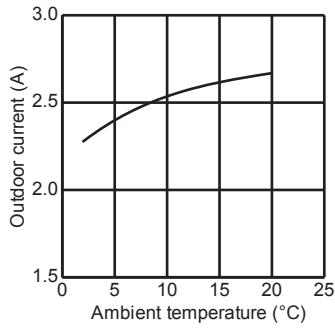


MUZ-HJ50VA

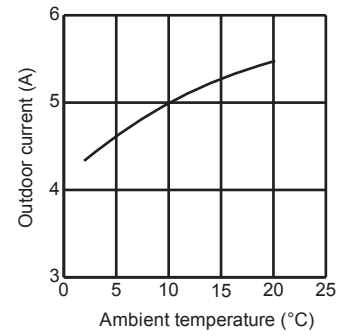

MUZ-HJ60VA

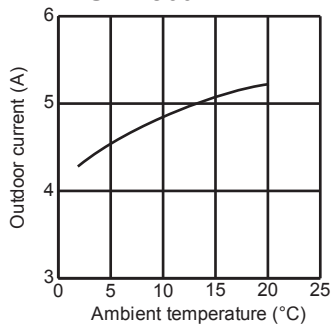

MUZ-HJ71VA

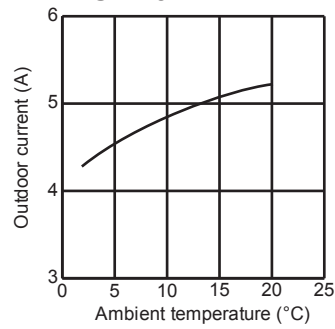

WALL-MOUNTED PERFORMANCE CURVES

C.1.6 PERFORMANCE DATA

C.1.6.1 Inverter

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-LN25VGW/V/B/R: MUZ-LN25VG, MUZ-LN25VGHZ

CAPACITY: 2.5 kW

SHF: 0.97

INPUT: 485 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.32	0.79	388	2.81	2.22	0.79	407	2.70	2.13	0.79	427	2.60	2.05	0.79	446
21	20	3.06	2.05	0.67	407	2.94	1.97	0.67	432	2.85	1.91	0.67	441	2.75	1.84	0.67	461
22	18	2.94	2.44	0.83	388	2.81	2.33	0.83	407	2.70	2.24	0.83	427	2.60	2.16	0.83	446
22	20	3.06	2.17	0.71	407	2.94	2.09	0.71	432	2.85	2.02	0.71	441	2.75	1.95	0.71	461
22	22	3.19	1.88	0.59	422	3.08	1.81	0.59	449	3.00	1.77	0.59	461	2.88	1.70	0.59	480
23	18	2.94	2.56	0.87	388	2.81	2.45	0.87	407	2.70	2.35	0.87	427	2.60	2.26	0.87	446
23	20	3.06	2.30	0.75	407	2.94	2.20	0.75	432	2.85	2.14	0.75	441	2.75	2.06	0.75	461
23	22	3.19	2.01	0.63	422	3.08	1.94	0.63	449	3.00	1.89	0.63	461	2.88	1.81	0.63	480
24	18	2.94	2.67	0.91	388	2.81	2.56	0.91	407	2.70	2.46	0.91	427	2.60	2.37	0.91	446
24	20	3.06	2.42	0.79	407	2.94	2.32	0.79	432	2.85	2.25	0.79	441	2.75	2.17	0.79	461
24	22	3.19	2.14	0.67	422	3.08	2.06	0.67	449	3.00	2.01	0.67	461	2.88	1.93	0.67	480
24	24	3.35	1.84	0.55	441	3.23	1.77	0.55	466	3.15	1.73	0.55	480	3.05	1.68	0.55	504
25	18	2.94	2.79	0.95	388	2.81	2.67	0.95	407	2.70	2.57	0.95	427	2.60	2.47	0.95	446
25	20	3.06	2.54	0.83	407	2.94	2.44	0.83	432	2.85	2.37	0.83	441	2.75	2.28	0.83	461
25	22	3.19	2.26	0.71	422	3.08	2.18	0.71	449	3.00	2.13	0.71	461	2.88	2.04	0.71	480
25	24	3.35	1.98	0.59	441	3.23	1.90	0.59	466	3.15	1.86	0.59	480	3.05	1.80	0.59	504
26	18	2.94	2.91	0.99	388	2.81	2.78	0.99	407	2.70	2.67	0.99	427	2.60	2.57	0.99	446
26	20	3.06	2.66	0.87	407	2.94	2.56	0.87	432	2.85	2.48	0.87	441	2.75	2.39	0.87	461
26	22	3.19	2.39	0.75	422	3.08	2.31	0.75	449	3.00	2.25	0.75	461	2.88	2.16	0.75	480
26	24	3.35	2.11	0.63	441	3.23	2.03	0.63	466	3.15	1.98	0.63	480	3.05	1.92	0.63	504
26	26	3.45	1.76	0.51	466	3.35	1.71	0.51	490	3.30	1.68	0.51	504	3.20	1.63	0.51	519
27	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
27	20	3.06	2.79	0.91	407	2.94	2.67	0.91	432	2.85	2.59	0.91	441	2.75	2.50	0.91	461
27	22	3.19	2.52	0.79	422	3.08	2.43	0.79	449	3.00	2.37	0.79	461	2.88	2.27	0.79	480
27	24	3.35	2.24	0.67	441	3.23	2.16	0.67	466	3.15	2.11	0.67	480	3.05	2.04	0.67	504
27	26	3.45	1.90	0.55	466	3.35	1.84	0.55	490	3.30	1.82	0.55	504	3.20	1.76	0.55	519
28	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
28	20	3.06	2.91	0.95	407	2.94	2.79	0.95	432	2.85	2.71	0.95	441	2.75	2.61	0.95	461
28	22	3.19	2.65	0.83	422	3.08	2.55	0.83	449	3.00	2.49	0.83	461	2.88	2.39	0.83	480
28	24	3.35	2.38	0.71	441	3.23	2.29	0.71	466	3.15	2.24	0.71	480	3.05	2.17	0.71	504
28	26	3.45	2.04	0.59	466	3.35	1.98	0.59	490	3.30	1.95	0.59	504	3.20	1.89	0.59	519
29	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
29	20	3.06	3.03	0.99	407	2.94	2.91	0.99	432	2.85	2.82	0.99	441	2.75	2.72	0.99	461
29	22	3.19	2.77	0.87	422	3.08	2.68	0.87	449	3.00	2.61	0.87	461	2.88	2.50	0.87	480
29	24	3.35	2.51	0.75	441	3.23	2.42	0.75	466	3.15	2.36	0.75	480	3.05	2.29	0.75	504
29	26	3.45	2.17	0.63	466	3.35	2.11	0.63	490	3.30	2.08	0.63	504	3.20	2.02	0.63	519
30	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
30	20	3.06	3.06	1.00	407	2.94	2.94	1.00	432	2.85	2.85	1.00	441	2.75	2.75	1.00	461
30	22	3.19	2.90	0.91	422	3.08	2.80	0.91	449	3.00	2.73	0.91	461	2.88	2.62	0.91	480
30	24	3.35	2.65	0.79	441	3.23	2.55	0.79	466	3.15	2.49	0.79	480	3.05	2.41	0.79	504
30	26	3.45	2.31	0.67	466	3.35	2.24	0.67	490	3.30	2.21	0.67	504	3.20	2.14	0.67	519
31	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
31	20	3.06	3.06	1.00	407	2.94	2.94	1.00	432	2.85	2.85	1.00	441	2.75	2.75	1.00	461
31	22	3.19	3.03	0.95	422	3.08	2.92	0.95	449	3.00	2.85	0.95	461	2.88	2.73	0.95	480
31	24	3.35	2.78	0.83	441	3.23	2.68	0.83	466	3.15	2.61	0.83	480	3.05	2.53	0.83	504
31	26	3.45	2.45	0.71	466	3.35	2.38	0.71	490	3.30	2.34	0.71	504	3.20	2.27	0.71	519
32	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
32	20	3.06	3.06	1.00	407	2.94	2.94	1.00	432	2.85	2.85	1.00	441	2.75	2.75	1.00	461
32	22	3.19	3.16	0.99	422	3.08	3.04	0.99	449	3.00	2.97	0.99	461	2.88	2.85	0.99	480
32	24	3.35	2.91	0.87	441	3.23	2.81	0.87	466	3.15	2.74	0.87	480	3.05	2.65	0.87	504
32	26	3.45	2.59	0.75	466	3.35	2.51	0.75	490	3.30	2.48	0.75	504	3.20	2.40	0.75	519

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-LN25VGW/V/B/R: MUZ-LN25VG, MUZ-LN25VGHZ
 CAPACITY: 2.5 kW SHF: 0.97 INPUT: 485 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.94	0.79	475	2.25	1.78	0.79	504	2.08	1.64	0.79	524
21	20	2.58	1.73	0.67	495	2.40	1.61	0.67	519	2.23	1.49	0.67	548
22	18	2.45	2.03	0.83	475	2.25	1.87	0.83	504	2.08	1.72	0.83	524
22	20	2.58	1.83	0.71	495	2.40	1.70	0.71	519	2.23	1.58	0.71	548
22	22	2.73	1.61	0.59	514	2.55	1.50	0.59	543	2.38	1.40	0.59	563
23	18	2.45	2.13	0.87	475	2.25	1.96	0.87	504	2.08	1.81	0.87	524
23	20	2.58	1.93	0.75	495	2.40	1.80	0.75	519	2.23	1.67	0.75	548
23	22	2.73	1.72	0.63	514	2.55	1.61	0.63	543	2.38	1.50	0.63	563
24	18	2.45	2.23	0.91	475	2.25	2.05	0.91	504	2.08	1.89	0.91	524
24	20	2.58	2.03	0.79	495	2.40	1.90	0.79	519	2.23	1.76	0.79	548
24	22	2.73	1.83	0.67	514	2.55	1.71	0.67	543	2.38	1.59	0.67	563
24	24	2.88	1.58	0.55	534	2.70	1.49	0.55	558	2.55	1.40	0.55	582
25	18	2.45	2.33	0.95	475	2.25	2.14	0.95	504	2.08	1.97	0.95	524
25	20	2.58	2.14	0.83	495	2.40	1.99	0.83	519	2.23	1.85	0.83	548
25	22	2.73	1.93	0.71	514	2.55	1.81	0.71	543	2.38	1.69	0.71	563
25	24	2.88	1.70	0.59	534	2.70	1.59	0.59	558	2.55	1.50	0.59	582
26	18	2.45	2.43	0.99	475	2.25	2.23	0.99	504	2.08	2.05	0.99	524
26	20	2.58	2.24	0.87	495	2.40	2.09	0.87	519	2.23	1.94	0.87	548
26	22	2.73	2.04	0.75	514	2.55	1.91	0.75	543	2.38	1.78	0.75	563
26	24	2.88	1.81	0.63	534	2.70	1.70	0.63	558	2.55	1.61	0.63	582
26	26	3.03	1.54	0.51	553	2.85	1.45	0.51	577	2.68	1.36	0.51	601
27	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
27	20	2.58	2.34	0.91	495	2.40	2.18	0.91	519	2.23	2.02	0.91	548
27	22	2.73	2.15	0.79	514	2.55	2.01	0.79	543	2.38	1.88	0.79	563
27	24	2.88	1.93	0.67	534	2.70	1.81	0.67	558	2.55	1.71	0.67	582
27	26	3.03	1.66	0.55	553	2.85	1.57	0.55	577	2.68	1.47	0.55	601
28	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
28	20	2.58	2.45	0.95	495	2.40	2.28	0.95	519	2.23	2.11	0.95	548
28	22	2.73	2.26	0.83	514	2.55	2.12	0.83	543	2.38	1.97	0.83	563
28	24	2.88	2.04	0.71	534	2.70	1.92	0.71	558	2.55	1.81	0.71	582
28	26	3.03	1.78	0.59	553	2.85	1.68	0.59	577	2.68	1.58	0.59	601
29	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
29	20	2.58	2.55	0.99	495	2.40	2.38	0.99	519	2.23	2.20	0.99	548
29	22	2.73	2.37	0.87	514	2.55	2.22	0.87	543	2.38	2.07	0.87	563
29	24	2.88	2.16	0.75	534	2.70	2.03	0.75	558	2.55	1.91	0.75	582
29	26	3.03	1.91	0.63	553	2.85	1.80	0.63	577	2.68	1.69	0.63	601
30	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
30	20	2.58	2.58	1.00	495	2.40	2.40	1.00	519	2.23	2.23	1.00	548
30	22	2.73	2.48	0.91	514	2.55	2.32	0.91	543	2.38	2.16	0.91	563
30	24	2.88	2.27	0.79	534	2.70	2.13	0.79	558	2.55	2.01	0.79	582
30	26	3.03	2.03	0.67	553	2.85	1.91	0.67	577	2.68	1.79	0.67	601
31	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
31	20	2.58	2.58	1.00	495	2.40	2.40	1.00	519	2.23	2.23	1.00	548
31	22	2.73	2.59	0.95	514	2.55	2.42	0.95	543	2.38	2.26	0.95	563
31	24	2.88	2.39	0.83	534	2.70	2.24	0.83	558	2.55	2.12	0.83	582
31	26	3.03	2.15	0.71	553	2.85	2.02	0.71	577	2.68	1.90	0.71	601
32	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
32	20	2.58	2.58	1.00	495	2.40	2.40	1.00	519	2.23	2.23	1.00	548
32	22	2.73	2.70	0.99	514	2.55	2.52	0.99	543	2.38	2.35	0.99	563
32	24	2.88	2.50	0.87	534	2.70	2.35	0.87	558	2.55	2.22	0.87	582
32	26	3.03	2.27	0.75	553	2.85	2.14	0.75	577	2.68	2.01	0.75	601

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-LN35VGW/V/B/R: MUZ-LN35VG, MUZ-LN35VGHZ
 CAPACITY: 3.5 kW SHF: 0.90 INPUT: 820 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.11	2.96	0.72	656	3.94	2.84	0.72	689	3.78	2.72	0.72	722	3.64	2.62	0.72	754
21	20	4.29	2.57	0.60	689	4.11	2.47	0.60	730	3.99	2.39	0.60	746	3.85	2.31	0.60	779
22	18	4.11	3.13	0.76	656	3.94	2.99	0.76	689	3.78	2.87	0.76	722	3.64	2.77	0.76	754
22	20	4.29	2.74	0.64	689	4.11	2.63	0.64	730	3.99	2.55	0.64	746	3.85	2.46	0.64	779
22	22	4.46	2.32	0.52	713	4.31	2.24	0.52	759	4.20	2.18	0.52	779	4.03	2.09	0.52	812
23	18	4.11	3.29	0.80	656	3.94	3.15	0.80	689	3.78	3.02	0.80	722	3.64	2.91	0.80	754
23	20	4.29	2.92	0.68	689	4.11	2.80	0.68	730	3.99	2.71	0.68	746	3.85	2.62	0.68	779
23	22	4.46	2.50	0.56	713	4.31	2.41	0.56	759	4.20	2.35	0.56	779	4.03	2.25	0.56	812
24	18	4.11	3.45	0.84	656	3.94	3.31	0.84	689	3.78	3.18	0.84	722	3.64	3.06	0.84	754
24	20	4.29	3.09	0.72	689	4.11	2.96	0.72	730	3.99	2.87	0.72	746	3.85	2.77	0.72	779
24	22	4.46	2.68	0.60	713	4.31	2.58	0.60	759	4.20	2.52	0.60	779	4.03	2.42	0.60	812
24	24	4.69	2.25	0.48	746	4.52	2.17	0.48	787	4.41	2.12	0.48	812	4.27	2.05	0.48	853
25	18	4.11	3.62	0.88	656	3.94	3.47	0.88	689	3.78	3.33	0.88	722	3.64	3.20	0.88	754
25	20	4.29	3.26	0.76	689	4.11	3.13	0.76	730	3.99	3.03	0.76	746	3.85	2.93	0.76	779
25	22	4.46	2.86	0.64	713	4.31	2.76	0.64	759	4.20	2.69	0.64	779	4.03	2.58	0.64	812
25	24	4.69	2.44	0.52	746	4.52	2.35	0.52	787	4.41	2.29	0.52	812	4.27	2.22	0.52	853
26	18	4.11	3.78	0.92	656	3.94	3.62	0.92	689	3.78	3.48	0.92	722	3.64	3.35	0.92	754
26	20	4.29	3.43	0.80	689	4.11	3.29	0.80	730	3.99	3.19	0.80	746	3.85	3.08	0.80	779
26	22	4.46	3.03	0.68	713	4.31	2.93	0.68	759	4.20	2.86	0.68	779	4.03	2.74	0.68	812
26	24	4.69	2.63	0.56	746	4.52	2.53	0.56	787	4.41	2.47	0.56	812	4.27	2.39	0.56	853
26	26	4.83	2.13	0.44	787	4.69	2.06	0.44	828	4.62	2.03	0.44	853	4.48	1.97	0.44	877
27	18	4.11	3.95	0.96	656	3.94	3.78	0.96	689	3.78	3.63	0.96	722	3.64	3.49	0.96	754
27	20	4.29	3.60	0.84	689	4.11	3.45	0.84	730	3.99	3.35	0.84	746	3.85	3.23	0.84	779
27	22	4.46	3.21	0.72	713	4.31	3.10	0.72	759	4.20	3.02	0.72	779	4.03	2.90	0.72	812
27	24	4.69	2.81	0.60	746	4.52	2.71	0.60	787	4.41	2.65	0.60	812	4.27	2.56	0.60	853
27	26	4.83	2.32	0.48	787	4.69	2.25	0.48	828	4.62	2.22	0.48	853	4.48	2.15	0.48	877
28	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
28	20	4.29	3.77	0.88	689	4.11	3.62	0.88	730	3.99	3.51	0.88	746	3.85	3.39	0.88	779
28	22	4.46	3.39	0.76	713	4.31	3.27	0.76	759	4.20	3.19	0.76	779	4.03	3.06	0.76	812
28	24	4.69	3.00	0.64	746	4.52	2.89	0.64	787	4.41	2.82	0.64	812	4.27	2.73	0.64	853
28	26	4.83	2.51	0.52	787	4.69	2.44	0.52	828	4.62	2.40	0.52	853	4.48	2.33	0.52	877
29	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
29	20	4.29	3.94	0.92	689	4.11	3.78	0.92	730	3.99	3.67	0.92	746	3.85	3.54	0.92	779
29	22	4.46	3.57	0.80	713	4.31	3.44	0.80	759	4.20	3.36	0.80	779	4.03	3.22	0.80	812
29	24	4.69	3.19	0.68	746	4.52	3.07	0.68	787	4.41	3.00	0.68	812	4.27	2.90	0.68	853
29	26	4.83	2.70	0.56	787	4.69	2.63	0.56	828	4.62	2.59	0.56	853	4.48	2.51	0.56	877
30	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
30	20	4.29	4.12	0.96	689	4.11	3.95	0.96	730	3.99	3.83	0.96	746	3.85	3.70	0.96	779
30	22	4.46	3.75	0.84	713	4.31	3.62	0.84	759	4.20	3.53	0.84	779	4.03	3.38	0.84	812
30	24	4.69	3.38	0.72	746	4.52	3.25	0.72	787	4.41	3.18	0.72	812	4.27	3.07	0.72	853
30	26	4.83	2.90	0.60	787	4.69	2.81	0.60	828	4.62	2.77	0.60	853	4.48	2.69	0.60	877
31	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
31	20	4.29	4.29	1.00	689	4.11	4.11	1.00	730	3.99	3.99	1.00	746	3.85	3.85	1.00	779
31	22	4.46	3.93	0.88	713	4.31	3.79	0.88	759	4.20	3.70	0.88	779	4.03	3.54	0.88	812
31	24	4.69	3.56	0.76	746	4.52	3.43	0.76	787	4.41	3.35	0.76	812	4.27	3.25	0.76	853
31	26	4.83	3.09	0.64	787	4.69	3.00	0.64	828	4.62	2.96	0.64	853	4.48	2.87	0.64	877
32	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
32	20	4.29	4.29	1.00	689	4.11	4.11	1.00	730	3.99	3.99	1.00	746	3.85	3.85	1.00	779
32	22	4.46	4.11	0.92	713	4.31	3.96	0.92	759	4.20	3.86	0.92	779	4.03	3.70	0.92	812
32	24	4.69	3.75	0.80	746	4.52	3.61	0.80	787	4.41	3.53	0.80	812	4.27	3.42	0.80	853
32	26	4.83	3.28	0.68	787	4.69	3.19	0.68	828	4.62	3.14	0.68	853	4.48	3.05	0.68	877

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-LN35VGW/V/B/R: MUZ-LN35VG, MUZ-LN35VGHZ
 CAPACITY: 3.5 kW SHF: 0.90 INPUT: 820 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.43	2.47	0.72	804	3.15	2.27	0.72	853	2.91	2.09	0.72	886
21	20	3.61	2.16	0.60	836	3.36	2.02	0.60	877	3.12	1.87	0.60	927
22	18	3.43	2.61	0.76	804	3.15	2.39	0.76	853	2.91	2.21	0.76	886
22	20	3.61	2.31	0.64	836	3.36	2.15	0.64	877	3.12	1.99	0.64	927
22	22	3.82	1.98	0.52	869	3.57	1.86	0.52	918	3.33	1.73	0.52	951
23	18	3.43	2.74	0.80	804	3.15	2.52	0.80	853	2.91	2.32	0.80	886
23	20	3.61	2.45	0.68	836	3.36	2.28	0.68	877	3.12	2.12	0.68	927
23	22	3.82	2.14	0.56	869	3.57	2.00	0.56	918	3.33	1.86	0.56	951
24	18	3.43	2.88	0.84	804	3.15	2.65	0.84	853	2.91	2.44	0.84	886
24	20	3.61	2.60	0.72	836	3.36	2.42	0.72	877	3.12	2.24	0.72	927
24	22	3.82	2.29	0.60	869	3.57	2.14	0.60	918	3.33	2.00	0.60	951
24	24	4.03	1.93	0.48	902	3.78	1.81	0.48	943	3.57	1.71	0.48	984
25	18	3.43	3.02	0.88	804	3.15	2.77	0.88	853	2.91	2.56	0.88	886
25	20	3.61	2.74	0.76	836	3.36	2.55	0.76	877	3.12	2.37	0.76	927
25	22	3.82	2.44	0.64	869	3.57	2.28	0.64	918	3.33	2.13	0.64	951
25	24	4.03	2.09	0.52	902	3.78	1.97	0.52	943	3.57	1.86	0.52	984
26	18	3.43	3.16	0.92	804	3.15	2.90	0.92	853	2.91	2.67	0.92	886
26	20	3.61	2.88	0.80	836	3.36	2.69	0.80	877	3.12	2.49	0.80	927
26	22	3.82	2.59	0.68	869	3.57	2.43	0.68	918	3.33	2.26	0.68	951
26	24	4.03	2.25	0.56	902	3.78	2.12	0.56	943	3.57	2.00	0.56	984
26	26	4.24	1.86	0.44	935	3.99	1.76	0.44	976	3.75	1.65	0.44	1017
27	18	3.43	3.29	0.96	804	3.15	3.02	0.96	853	2.91	2.79	0.96	886
27	20	3.61	3.03	0.84	836	3.36	2.82	0.84	877	3.12	2.62	0.84	927
27	22	3.82	2.75	0.72	869	3.57	2.57	0.72	918	3.33	2.39	0.72	951
27	24	4.03	2.42	0.60	902	3.78	2.27	0.60	943	3.57	2.14	0.60	984
27	26	4.24	2.03	0.48	935	3.99	1.92	0.48	976	3.75	1.80	0.48	1017
28	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
28	20	3.61	3.17	0.88	836	3.36	2.96	0.88	877	3.12	2.74	0.88	927
28	22	3.82	2.90	0.76	869	3.57	2.71	0.76	918	3.33	2.53	0.76	951
28	24	4.03	2.58	0.64	902	3.78	2.42	0.64	943	3.57	2.28	0.64	984
28	26	4.24	2.20	0.52	935	3.99	2.07	0.52	976	3.75	1.95	0.52	1017
29	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
29	20	3.61	3.32	0.92	836	3.36	3.09	0.92	877	3.12	2.87	0.92	927
29	22	3.82	3.05	0.80	869	3.57	2.86	0.80	918	3.33	2.66	0.80	951
29	24	4.03	2.74	0.68	902	3.78	2.57	0.68	943	3.57	2.43	0.68	984
29	26	4.24	2.37	0.56	935	3.99	2.23	0.56	976	3.75	2.10	0.56	1017
30	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
30	20	3.61	3.46	0.96	836	3.36	3.23	0.96	877	3.12	2.99	0.96	927
30	22	3.82	3.20	0.84	869	3.57	3.00	0.84	918	3.33	2.79	0.84	951
30	24	4.03	2.90	0.72	902	3.78	2.72	0.72	943	3.57	2.57	0.72	984
30	26	4.24	2.54	0.60	935	3.99	2.39	0.60	976	3.75	2.25	0.60	1017
31	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
31	20	3.61	3.61	1.00	836	3.36	3.36	1.00	877	3.12	3.12	1.00	927
31	22	3.82	3.36	0.88	869	3.57	3.14	0.88	918	3.33	2.93	0.88	951
31	24	4.03	3.06	0.76	902	3.78	2.87	0.76	943	3.57	2.71	0.76	984
31	26	4.24	2.71	0.64	935	3.99	2.55	0.64	976	3.75	2.40	0.64	1017
32	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
32	20	3.61	3.61	1.00	836	3.36	3.36	1.00	877	3.12	3.12	1.00	927
32	22	3.82	3.51	0.92	869	3.57	3.28	0.92	918	3.33	3.06	0.92	951
32	24	4.03	3.22	0.80	902	3.78	3.02	0.80	943	3.57	2.86	0.80	984
32	26	4.24	2.88	0.68	935	3.99	2.71	0.68	976	3.75	2.55	0.68	1017

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-LN50VGW/V/B/R: MUZ-LN50VG, MUZ-LN50VGHZ
 CAPACITY: 5.0 kW SHF: 0.77 INPUT: 1380 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.88	3.47	0.59	1104	5.63	3.32	0.59	1159	5.40	3.19	0.59	1214	5.20	3.07	0.59	1270
21	20	6.13	2.88	0.47	1159	5.88	2.76	0.47	1228	5.70	2.68	0.47	1256	5.50	2.59	0.47	1311
22	18	5.88	3.70	0.63	1104	5.63	3.54	0.63	1159	5.40	3.40	0.63	1214	5.20	3.28	0.63	1270
22	20	6.13	3.12	0.51	1159	5.88	3.00	0.51	1228	5.70	2.91	0.51	1256	5.50	2.81	0.51	1311
22	22	6.38	2.49	0.39	1201	6.15	2.40	0.39	1277	6.00	2.34	0.39	1311	5.75	2.24	0.39	1366
23	18	5.88	3.94	0.67	1104	5.63	3.77	0.67	1159	5.40	3.62	0.67	1214	5.20	3.48	0.67	1270
23	20	6.13	3.37	0.55	1159	5.88	3.23	0.55	1228	5.70	3.14	0.55	1256	5.50	3.03	0.55	1311
23	22	6.38	2.74	0.43	1201	6.15	2.64	0.43	1277	6.00	2.58	0.43	1311	5.75	2.47	0.43	1366
24	18	5.88	4.17	0.71	1104	5.63	3.99	0.71	1159	5.40	3.83	0.71	1214	5.20	3.69	0.71	1270
24	20	6.13	3.61	0.59	1159	5.88	3.47	0.59	1228	5.70	3.36	0.59	1256	5.50	3.25	0.59	1311
24	22	6.38	3.00	0.47	1201	6.15	2.89	0.47	1277	6.00	2.82	0.47	1311	5.75	2.70	0.47	1366
24	24	6.70	2.35	0.35	1256	6.45	2.26	0.35	1325	6.30	2.21	0.35	1366	6.10	2.14	0.35	1435
25	18	5.88	4.41	0.75	1104	5.63	4.22	0.75	1159	5.40	4.05	0.75	1214	5.20	3.90	0.75	1270
25	20	6.13	3.86	0.63	1159	5.88	3.70	0.63	1228	5.70	3.59	0.63	1256	5.50	3.47	0.63	1311
25	22	6.38	3.25	0.51	1201	6.15	3.14	0.51	1277	6.00	3.06	0.51	1311	5.75	2.93	0.51	1366
25	24	6.70	2.61	0.39	1256	6.45	2.52	0.39	1325	6.30	2.46	0.39	1366	6.10	2.38	0.39	1435
26	18	5.88	4.64	0.79	1104	5.63	4.44	0.79	1159	5.40	4.27	0.79	1214	5.20	4.11	0.79	1270
26	20	6.13	4.10	0.67	1159	5.88	3.94	0.67	1228	5.70	3.82	0.67	1256	5.50	3.69	0.67	1311
26	22	6.38	3.51	0.55	1201	6.15	3.38	0.55	1277	6.00	3.30	0.55	1311	5.75	3.16	0.55	1366
26	24	6.70	2.88	0.43	1256	6.45	2.77	0.43	1325	6.30	2.71	0.43	1366	6.10	2.62	0.43	1435
26	26	6.90	2.14	0.31	1325	6.70	2.08	0.31	1394	6.60	2.05	0.31	1435	6.40	1.98	0.31	1477
27	18	5.88	4.88	0.83	1104	5.63	4.67	0.83	1159	5.40	4.48	0.83	1214	5.20	4.32	0.83	1270
27	20	6.13	4.35	0.71	1159	5.88	4.17	0.71	1228	5.70	4.05	0.71	1256	5.50	3.91	0.71	1311
27	22	6.38	3.76	0.59	1201	6.15	3.63	0.59	1277	6.00	3.54	0.59	1311	5.75	3.39	0.59	1366
27	24	6.70	3.15	0.47	1256	6.45	3.03	0.47	1325	6.30	2.96	0.47	1366	6.10	2.87	0.47	1435
27	26	6.90	2.42	0.35	1325	6.70	2.35	0.35	1394	6.60	2.31	0.35	1435	6.40	2.24	0.35	1477
28	18	5.88	5.11	0.87	1104	5.63	4.89	0.87	1159	5.40	4.70	0.87	1214	5.20	4.52	0.87	1270
28	20	6.13	4.59	0.75	1159	5.88	4.41	0.75	1228	5.70	4.28	0.75	1256	5.50	4.13	0.75	1311
28	22	6.38	4.02	0.63	1201	6.15	3.87	0.63	1277	6.00	3.78	0.63	1311	5.75	3.62	0.63	1366
28	24	6.70	3.42	0.51	1256	6.45	3.29	0.51	1325	6.30	3.21	0.51	1366	6.10	3.11	0.51	1435
28	26	6.90	2.69	0.39	1325	6.70	2.61	0.39	1394	6.60	2.57	0.39	1435	6.40	2.50	0.39	1477
29	18	5.88	5.35	0.91	1104	5.63	5.12	0.91	1159	5.40	4.91	0.91	1214	5.20	4.73	0.91	1270
29	20	6.13	4.84	0.79	1159	5.88	4.64	0.79	1228	5.70	4.50	0.79	1256	5.50	4.35	0.79	1311
29	22	6.38	4.27	0.67	1201	6.15	4.12	0.67	1277	6.00	4.02	0.67	1311	5.75	3.85	0.67	1366
29	24	6.70	3.69	0.55	1256	6.45	3.55	0.55	1325	6.30	3.47	0.55	1366	6.10	3.36	0.55	1435
29	26	6.90	2.97	0.43	1325	6.70	2.88	0.43	1394	6.60	2.84	0.43	1435	6.40	2.75	0.43	1477
30	18	5.88	5.58	0.95	1104	5.63	5.34	0.95	1159	5.40	5.13	0.95	1214	5.20	4.94	0.95	1270
30	20	6.13	5.08	0.83	1159	5.88	4.88	0.83	1228	5.70	4.73	0.83	1256	5.50	4.57	0.83	1311
30	22	6.38	4.53	0.71	1201	6.15	4.37	0.71	1277	6.00	4.26	0.71	1311	5.75	4.08	0.71	1366
30	24	6.70	3.95	0.59	1256	6.45	3.81	0.59	1325	6.30	3.72	0.59	1366	6.10	3.60	0.59	1435
30	26	6.90	3.24	0.47	1325	6.70	3.15	0.47	1394	6.60	3.10	0.47	1435	6.40	3.01	0.47	1477
31	18	5.88	5.82	0.99	1104	5.63	5.57	0.99	1159	5.40	5.35	0.99	1214	5.20	5.15	0.99	1270
31	20	6.13	5.33	0.87	1159	5.88	5.11	0.87	1228	5.70	4.96	0.87	1256	5.50	4.79	0.87	1311
31	22	6.38	4.78	0.75	1201	6.15	4.61	0.75	1277	6.00	4.50	0.75	1311	5.75	4.31	0.75	1366
31	24	6.70	4.22	0.63	1256	6.45	4.06	0.63	1325	6.30	3.97	0.63	1366	6.10	3.84	0.63	1435
31	26	6.90	3.52	0.51	1325	6.70	3.42	0.51	1394	6.60	3.37	0.51	1435	6.40	3.26	0.51	1477
32	18	5.88	5.88	1.00	1104	5.63	5.63	1.00	1159	5.40	5.40	1.00	1214	5.20	5.20	1.00	1270
32	20	6.13	5.57	0.91	1159	5.88	5.35	0.91	1228	5.70	5.19	0.91	1256	5.50	5.01	0.91	1311
32	22	6.38	5.04	0.79	1201	6.15	4.86	0.79	1277	6.00	4.74	0.79	1311	5.75	4.54	0.79	1366
32	24	6.70	4.49	0.67	1256	6.45	4.32	0.67	1325	6.30	4.22	0.67	1366	6.10	4.09	0.67	1435
32	26	6.90	3.80	0.55	1325	6.70	3.69	0.55	1394	6.60	3.63	0.55	1435	6.40	3.52	0.55	1477

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-LN50VGW/V/B/R: MUZ-LN50VG, MUZ-LN50VGHZ
 CAPACITY: 5.0 kW SHF: 0.77 INPUT: 1380 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.89	0.59	1352	4.50	2.66	0.59	1435	4.15	2.45	0.59	1490
21	20	5.15	2.42	0.47	1408	4.80	2.26	0.47	1477	4.45	2.09	0.47	1559
22	18	4.90	3.09	0.63	1352	4.50	2.84	0.63	1435	4.15	2.61	0.63	1490
22	20	5.15	2.63	0.51	1408	4.80	2.45	0.51	1477	4.45	2.27	0.51	1559
22	22	5.45	2.13	0.39	1463	5.10	1.99	0.39	1546	4.75	1.85	0.39	1601
23	18	4.90	3.28	0.67	1352	4.50	3.02	0.67	1435	4.15	2.78	0.67	1490
23	20	5.15	2.83	0.55	1408	4.80	2.64	0.55	1477	4.45	2.45	0.55	1559
23	22	5.45	2.34	0.43	1463	5.10	2.19	0.43	1546	4.75	2.04	0.43	1601
24	18	4.90	3.48	0.71	1352	4.50	3.20	0.71	1435	4.15	2.95	0.71	1490
24	20	5.15	3.04	0.59	1408	4.80	2.83	0.59	1477	4.45	2.63	0.59	1559
24	22	5.45	2.56	0.47	1463	5.10	2.40	0.47	1546	4.75	2.23	0.47	1601
24	24	5.75	2.01	0.35	1518	5.40	1.89	0.35	1587	5.10	1.79	0.35	1656
25	18	4.90	3.68	0.75	1352	4.50	3.38	0.75	1435	4.15	3.11	0.75	1490
25	20	5.15	3.24	0.63	1408	4.80	3.02	0.63	1477	4.45	2.80	0.63	1559
25	22	5.45	2.78	0.51	1463	5.10	2.60	0.51	1546	4.75	2.42	0.51	1601
25	24	5.75	2.24	0.39	1518	5.40	2.11	0.39	1587	5.10	1.99	0.39	1656
26	18	4.90	3.87	0.79	1352	4.50	3.56	0.79	1435	4.15	3.28	0.79	1490
26	20	5.15	3.45	0.67	1408	4.80	3.22	0.67	1477	4.45	2.98	0.67	1559
26	22	5.45	3.00	0.55	1463	5.10	2.81	0.55	1546	4.75	2.61	0.55	1601
26	24	5.75	2.47	0.43	1518	5.40	2.32	0.43	1587	5.10	2.19	0.43	1656
26	26	6.05	1.88	0.31	1573	5.70	1.77	0.31	1642	5.35	1.66	0.31	1711
27	18	4.90	4.07	0.83	1352	4.50	3.74	0.83	1435	4.15	3.44	0.83	1490
27	20	5.15	3.66	0.71	1408	4.80	3.41	0.71	1477	4.45	3.16	0.71	1559
27	22	5.45	3.22	0.59	1463	5.10	3.01	0.59	1546	4.75	2.80	0.59	1601
27	24	5.75	2.70	0.47	1518	5.40	2.54	0.47	1587	5.10	2.40	0.47	1656
27	26	6.05	2.12	0.35	1573	5.70	2.00	0.35	1642	5.35	1.87	0.35	1711
28	18	4.90	4.26	0.87	1352	4.50	3.92	0.87	1435	4.15	3.61	0.87	1490
28	20	5.15	3.86	0.75	1408	4.80	3.60	0.75	1477	4.45	3.34	0.75	1559
28	22	5.45	3.43	0.63	1463	5.10	3.21	0.63	1546	4.75	2.99	0.63	1601
28	24	5.75	2.93	0.51	1518	5.40	2.75	0.51	1587	5.10	2.60	0.51	1656
28	26	6.05	2.36	0.39	1573	5.70	2.22	0.39	1642	5.35	2.09	0.39	1711
29	18	4.90	4.46	0.91	1352	4.50	4.10	0.91	1435	4.15	3.78	0.91	1490
29	20	5.15	4.07	0.79	1408	4.80	3.79	0.79	1477	4.45	3.52	0.79	1559
29	22	5.45	3.65	0.67	1463	5.10	3.42	0.67	1546	4.75	3.18	0.67	1601
29	24	5.75	3.16	0.55	1518	5.40	2.97	0.55	1587	5.10	2.81	0.55	1656
29	26	6.05	2.60	0.43	1573	5.70	2.45	0.43	1642	5.35	2.30	0.43	1711
30	18	4.90	4.66	0.95	1352	4.50	4.28	0.95	1435	4.15	3.94	0.95	1490
30	20	5.15	4.27	0.83	1408	4.80	3.98	0.83	1477	4.45	3.69	0.83	1559
30	22	5.45	3.87	0.71	1463	5.10	3.62	0.71	1546	4.75	3.37	0.71	1601
30	24	5.75	3.39	0.59	1518	5.40	3.19	0.59	1587	5.10	3.01	0.59	1656
30	26	6.05	2.84	0.47	1573	5.70	2.68	0.47	1642	5.35	2.51	0.47	1711
31	18	4.90	4.85	0.99	1352	4.50	4.46	0.99	1435	4.15	4.11	0.99	1490
31	20	5.15	4.48	0.87	1408	4.80	4.18	0.87	1477	4.45	3.87	0.87	1559
31	22	5.45	4.09	0.75	1463	5.10	3.83	0.75	1546	4.75	3.56	0.75	1601
31	24	5.75	3.62	0.63	1518	5.40	3.40	0.63	1587	5.10	3.21	0.63	1656
31	26	6.05	3.09	0.51	1573	5.70	2.91	0.51	1642	5.35	2.73	0.51	1711
32	18	4.90	4.90	1.00	1352	4.50	4.50	1.00	1435	4.15	4.15	1.00	1490
32	20	5.15	4.69	0.91	1408	4.80	4.37	0.91	1477	4.45	4.05	0.91	1559
32	22	5.45	4.31	0.79	1463	5.10	4.03	0.79	1546	4.75	3.75	0.79	1601
32	24	5.75	3.85	0.67	1518	5.40	3.62	0.67	1587	5.10	3.42	0.67	1656
32	26	6.05	3.33	0.55	1573	5.70	3.14	0.55	1642	5.35	2.94	0.55	1711

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-LN60VGW/V/B/R: MUZ-LN60VG

CAPACITY: 6.1 kW SHF: 0.75 INPUT: 1790 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	7.17	4.09	0.57	1432	6.86	3.91	0.57	1504	6.59	3.76	0.57	1575	6.34	3.62	0.57	1647
21	20	7.47	3.36	0.45	1504	7.17	3.23	0.45	1593	6.95	3.13	0.45	1629	6.71	3.02	0.45	1701
22	18	7.17	4.37	0.61	1432	6.86	4.19	0.61	1504	6.59	4.02	0.61	1575	6.34	3.87	0.61	1647
22	20	7.47	3.66	0.49	1504	7.17	3.51	0.49	1593	6.95	3.41	0.49	1629	6.71	3.29	0.49	1701
22	22	7.78	2.88	0.37	1557	7.50	2.78	0.37	1656	7.32	2.71	0.37	1701	7.01	2.60	0.37	1772
23	18	7.17	4.66	0.65	1432	6.86	4.46	0.65	1504	6.59	4.28	0.65	1575	6.34	4.12	0.65	1647
23	20	7.47	3.96	0.53	1504	7.17	3.80	0.53	1593	6.95	3.69	0.53	1629	6.71	3.56	0.53	1701
23	22	7.78	3.19	0.41	1557	7.50	3.08	0.41	1656	7.32	3.00	0.41	1701	7.01	2.88	0.41	1772
24	18	7.17	4.95	0.69	1432	6.86	4.74	0.69	1504	6.59	4.55	0.69	1575	6.34	4.38	0.69	1647
24	20	7.47	4.26	0.57	1504	7.17	4.09	0.57	1593	6.95	3.96	0.57	1629	6.71	3.82	0.57	1701
24	22	7.78	3.50	0.45	1557	7.50	3.38	0.45	1656	7.32	3.29	0.45	1701	7.01	3.16	0.45	1772
24	24	8.17	2.70	0.33	1629	7.87	2.60	0.33	1718	7.69	2.54	0.33	1772	7.44	2.46	0.33	1862
25	18	7.17	5.23	0.73	1432	6.86	5.01	0.73	1504	6.59	4.81	0.73	1575	6.34	4.63	0.73	1647
25	20	7.47	4.56	0.61	1504	7.17	4.37	0.61	1593	6.95	4.24	0.61	1629	6.71	4.09	0.61	1701
25	22	7.78	3.81	0.49	1557	7.50	3.68	0.49	1656	7.32	3.59	0.49	1701	7.01	3.44	0.49	1772
25	24	8.17	3.02	0.37	1629	7.87	2.91	0.37	1718	7.69	2.84	0.37	1772	7.44	2.75	0.37	1862
26	18	7.17	5.52	0.77	1432	6.86	5.28	0.77	1504	6.59	5.07	0.77	1575	6.34	4.88	0.77	1647
26	20	7.47	4.86	0.65	1504	7.17	4.66	0.65	1593	6.95	4.52	0.65	1629	6.71	4.36	0.65	1701
26	22	7.78	4.12	0.53	1557	7.50	3.98	0.53	1656	7.32	3.88	0.53	1701	7.01	3.72	0.53	1772
26	24	8.17	3.35	0.41	1629	7.87	3.23	0.41	1718	7.69	3.15	0.41	1772	7.44	3.05	0.41	1862
26	26	8.42	2.44	0.29	1718	8.17	2.37	0.29	1808	8.05	2.34	0.29	1862	7.81	2.26	0.29	1915
27	18	7.17	5.81	0.81	1432	6.86	5.56	0.81	1504	6.59	5.34	0.81	1575	6.34	5.14	0.81	1647
27	20	7.47	5.16	0.69	1504	7.17	4.95	0.69	1593	6.95	4.80	0.69	1629	6.71	4.63	0.69	1701
27	22	7.78	4.43	0.57	1557	7.50	4.28	0.57	1656	7.32	4.17	0.57	1701	7.01	4.00	0.57	1772
27	24	8.17	3.68	0.45	1629	7.87	3.54	0.45	1718	7.69	3.46	0.45	1772	7.44	3.35	0.45	1862
27	26	8.42	2.78	0.33	1718	8.17	2.70	0.33	1808	8.05	2.66	0.33	1862	7.81	2.58	0.33	1915
28	18	7.17	6.09	0.85	1432	6.86	5.83	0.85	1504	6.59	5.60	0.85	1575	6.34	5.39	0.85	1647
28	20	7.47	5.45	0.73	1504	7.17	5.23	0.73	1593	6.95	5.08	0.73	1629	6.71	4.90	0.73	1701
28	22	7.78	4.74	0.61	1557	7.50	4.58	0.61	1656	7.32	4.47	0.61	1701	7.01	4.28	0.61	1772
28	24	8.17	4.01	0.49	1629	7.87	3.86	0.49	1718	7.69	3.77	0.49	1772	7.44	3.65	0.49	1862
28	26	8.42	3.11	0.37	1718	8.17	3.02	0.37	1808	8.05	2.98	0.37	1862	7.81	2.89	0.37	1915
29	18	7.17	6.38	0.89	1432	6.86	6.11	0.89	1504	6.59	5.86	0.89	1575	6.34	5.65	0.89	1647
29	20	7.47	5.75	0.77	1504	7.17	5.52	0.77	1593	6.95	5.35	0.77	1629	6.71	5.17	0.77	1701
29	22	7.78	5.06	0.65	1557	7.50	4.88	0.65	1656	7.32	4.76	0.65	1701	7.01	4.56	0.65	1772
29	24	8.17	4.33	0.53	1629	7.87	4.17	0.53	1718	7.69	4.07	0.53	1772	7.44	3.94	0.53	1862
29	26	8.42	3.45	0.41	1718	8.17	3.35	0.41	1808	8.05	3.30	0.41	1862	7.81	3.20	0.41	1915
30	18	7.17	6.67	0.93	1432	6.86	6.38	0.93	1504	6.59	6.13	0.93	1575	6.34	5.90	0.93	1647
30	20	7.47	6.05	0.81	1504	7.17	5.81	0.81	1593	6.95	5.63	0.81	1629	6.71	5.44	0.81	1701
30	22	7.78	5.37	0.69	1557	7.50	5.18	0.69	1656	7.32	5.05	0.69	1701	7.01	4.84	0.69	1772
30	24	8.17	4.66	0.57	1629	7.87	4.49	0.57	1718	7.69	4.38	0.57	1772	7.44	4.24	0.57	1862
30	26	8.42	3.79	0.45	1718	8.17	3.68	0.45	1808	8.05	3.62	0.45	1862	7.81	3.51	0.45	1915
31	18	7.17	6.95	0.97	1432	6.86	6.66	0.97	1504	6.59	6.39	0.97	1575	6.34	6.15	0.97	1647
31	20	7.47	6.35	0.85	1504	7.17	6.09	0.85	1593	6.95	5.91	0.85	1629	6.71	5.70	0.85	1701
31	22	7.78	5.68	0.73	1557	7.50	5.48	0.73	1656	7.32	5.34	0.73	1701	7.01	5.12	0.73	1772
31	24	8.17	4.99	0.61	1629	7.87	4.80	0.61	1718	7.69	4.69	0.61	1772	7.44	4.54	0.61	1862
31	26	8.42	4.12	0.49	1718	8.17	4.01	0.49	1808	8.05	3.95	0.49	1862	7.81	3.83	0.49	1915
32	18	7.17	7.17	1.00	1432	6.86	6.86	1.00	1504	6.59	6.59	1.00	1575	6.34	6.34	1.00	1647
32	20	7.47	6.65	0.89	1504	7.17	6.38	0.89	1593	6.95	6.19	0.89	1629	6.71	5.97	0.89	1701
32	22	7.78	5.99	0.77	1557	7.50	5.78	0.77	1656	7.32	5.64	0.77	1701	7.01	5.40	0.77	1772
32	24	8.17	5.31	0.65	1629	7.87	5.11	0.65	1718	7.69	5.00	0.65	1772	7.44	4.84	0.65	1862
32	26	8.42	4.46	0.53	1718	8.17	4.33	0.53	1808	8.05	4.27	0.53	1862	7.81	4.14	0.53	1915

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-LN60VGW/V/B/R: MUZ-LN60VG

CAPACITY: 6.1 kW SHF: 0.75 INPUT: 1790 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.98	3.41	0.57	1754	5.49	3.13	0.57	1862	5.06	2.89	0.57	1933
21	20	6.28	2.83	0.45	1826	5.86	2.64	0.45	1915	5.43	2.44	0.45	2023
22	18	5.98	3.65	0.61	1754	5.49	3.35	0.61	1862	5.06	3.09	0.61	1933
22	20	6.28	3.08	0.49	1826	5.86	2.87	0.49	1915	5.43	2.66	0.49	2023
22	22	6.65	2.46	0.37	1897	6.22	2.30	0.37	2005	5.79	2.14	0.37	2076
23	18	5.98	3.89	0.65	1754	5.49	3.57	0.65	1862	5.06	3.29	0.65	1933
23	20	6.28	3.33	0.53	1826	5.86	3.10	0.53	1915	5.43	2.88	0.53	2023
23	22	6.65	2.73	0.41	1897	6.22	2.55	0.41	2005	5.79	2.38	0.41	2076
24	18	5.98	4.12	0.69	1754	5.49	3.79	0.69	1862	5.06	3.49	0.69	1933
24	20	6.28	3.58	0.57	1826	5.86	3.34	0.57	1915	5.43	3.09	0.57	2023
24	22	6.65	2.99	0.45	1897	6.22	2.80	0.45	2005	5.79	2.61	0.45	2076
24	24	7.01	2.31	0.33	1969	6.59	2.17	0.33	2059	6.22	2.05	0.33	2148
25	18	5.98	4.36	0.73	1754	5.49	4.01	0.73	1862	5.06	3.70	0.73	1933
25	20	6.28	3.83	0.61	1826	5.86	3.57	0.61	1915	5.43	3.31	0.61	2023
25	22	6.65	3.26	0.49	1897	6.22	3.05	0.49	2005	5.79	2.84	0.49	2076
25	24	7.01	2.60	0.37	1969	6.59	2.44	0.37	2059	6.22	2.30	0.37	2148
26	18	5.98	4.60	0.77	1754	5.49	4.23	0.77	1862	5.06	3.90	0.77	1933
26	20	6.28	4.08	0.65	1826	5.86	3.81	0.65	1915	5.43	3.53	0.65	2023
26	22	6.65	3.52	0.53	1897	6.22	3.30	0.53	2005	5.79	3.07	0.53	2076
26	24	7.01	2.88	0.41	1969	6.59	2.70	0.41	2059	6.22	2.55	0.41	2148
26	26	7.38	2.14	0.29	2041	6.95	2.02	0.29	2130	6.53	1.89	0.29	2220
27	18	5.98	4.84	0.81	1754	5.49	4.45	0.81	1862	5.06	4.10	0.81	1933
27	20	6.28	4.34	0.69	1826	5.86	4.04	0.69	1915	5.43	3.75	0.69	2023
27	22	6.65	3.79	0.57	1897	6.22	3.55	0.57	2005	5.79	3.30	0.57	2076
27	24	7.01	3.16	0.45	1969	6.59	2.96	0.45	2059	6.22	2.80	0.45	2148
27	26	7.38	2.44	0.33	2041	6.95	2.29	0.33	2130	6.53	2.15	0.33	2220
28	18	5.98	5.08	0.85	1754	5.49	4.67	0.85	1862	5.06	4.30	0.85	1933
28	20	6.28	4.59	0.73	1826	5.86	4.27	0.73	1915	5.43	3.96	0.73	2023
28	22	6.65	4.06	0.61	1897	6.22	3.80	0.61	2005	5.79	3.53	0.61	2076
28	24	7.01	3.44	0.49	1969	6.59	3.23	0.49	2059	6.22	3.05	0.49	2148
28	26	7.38	2.73	0.37	2041	6.95	2.57	0.37	2130	6.53	2.41	0.37	2220
29	18	5.98	5.32	0.89	1754	5.49	4.89	0.89	1862	5.06	4.51	0.89	1933
29	20	6.28	4.84	0.77	1826	5.86	4.51	0.77	1915	5.43	4.18	0.77	2023
29	22	6.65	4.32	0.65	1897	6.22	4.04	0.65	2005	5.79	3.77	0.65	2076
29	24	7.01	3.72	0.53	1969	6.59	3.49	0.53	2059	6.22	3.30	0.53	2148
29	26	7.38	3.03	0.41	2041	6.95	2.85	0.41	2130	6.53	2.68	0.41	2220
30	18	5.98	5.56	0.93	1754	5.49	5.11	0.93	1862	5.06	4.71	0.93	1933
30	20	6.28	5.09	0.81	1826	5.86	4.74	0.81	1915	5.43	4.40	0.81	2023
30	22	6.65	4.59	0.69	1897	6.22	4.29	0.69	2005	5.79	4.00	0.69	2076
30	24	7.01	4.00	0.57	1969	6.59	3.76	0.57	2059	6.22	3.55	0.57	2148
30	26	7.38	3.32	0.45	2041	6.95	3.13	0.45	2130	6.53	2.94	0.45	2220
31	18	5.98	5.80	0.97	1754	5.49	5.33	0.97	1862	5.06	4.91	0.97	1933
31	20	6.28	5.34	0.85	1826	5.86	4.98	0.85	1915	5.43	4.61	0.85	2023
31	22	6.65	4.85	0.73	1897	6.22	4.54	0.73	2005	5.79	4.23	0.73	2076
31	24	7.01	4.28	0.61	1969	6.59	4.02	0.61	2059	6.22	3.80	0.61	2148
31	26	7.38	3.62	0.49	2041	6.95	3.41	0.49	2130	6.53	3.20	0.49	2220
32	18	5.98	5.98	1.00	1754	5.49	5.49	1.00	1862	5.06	5.06	1.00	1933
32	20	6.28	5.59	0.89	1826	5.86	5.21	0.89	1915	5.43	4.83	0.89	2023
32	22	6.65	5.12	0.77	1897	6.22	4.79	0.77	2005	5.79	4.46	0.77	2076
32	24	7.01	4.56	0.65	1969	6.59	4.28	0.65	2059	6.22	4.04	0.65	2148
32	26	7.38	3.91	0.53	2041	6.95	3.69	0.53	2130	6.53	3.46	0.53	2220

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-AP20VG: MUZ-AP20VG

CAPACITY: 2.0 kW

SHF: 0.8

INPUT: 460 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.35	1.46	0.62	368	2.25	1.40	0.62	386	2.16	1.34	0.62	405	2.08	1.29	0.62	423
21	20	2.45	1.23	0.50	386	2.35	1.18	0.50	409	2.28	1.14	0.50	419	2.20	1.10	0.50	437
22	18	2.35	1.55	0.66	368	2.25	1.49	0.66	386	2.16	1.43	0.66	405	2.08	1.37	0.66	423
22	20	2.45	1.32	0.54	386	2.35	1.27	0.54	409	2.28	1.23	0.54	419	2.20	1.19	0.54	437
22	22	2.55	1.07	0.42	400	2.46	1.03	0.42	426	2.40	1.01	0.42	437	2.30	0.97	0.42	455
23	18	2.35	1.65	0.70	368	2.25	1.58	0.70	386	2.16	1.51	0.70	405	2.08	1.46	0.70	423
23	20	2.45	1.42	0.58	386	2.35	1.36	0.58	409	2.28	1.32	0.58	419	2.20	1.28	0.58	437
23	22	2.55	1.17	0.46	400	2.46	1.13	0.46	426	2.40	1.10	0.46	437	2.30	1.06	0.46	455
24	18	2.35	1.74	0.74	368	2.25	1.67	0.74	386	2.16	1.60	0.74	405	2.08	1.54	0.74	423
24	20	2.45	1.52	0.62	386	2.35	1.46	0.62	409	2.28	1.41	0.62	419	2.20	1.36	0.62	437
24	22	2.55	1.28	0.50	400	2.46	1.23	0.50	426	2.40	1.20	0.50	437	2.30	1.15	0.50	455
24	24	2.68	1.02	0.38	419	2.58	0.98	0.38	442	2.52	0.96	0.38	455	2.44	0.93	0.38	478
25	18	2.35	1.83	0.78	368	2.25	1.76	0.78	386	2.16	1.68	0.78	405	2.08	1.62	0.78	423
25	20	2.45	1.62	0.66	386	2.35	1.55	0.66	409	2.28	1.50	0.66	419	2.20	1.45	0.66	437
25	22	2.55	1.38	0.54	400	2.46	1.33	0.54	426	2.40	1.30	0.54	437	2.30	1.24	0.54	455
25	24	2.68	1.13	0.42	419	2.58	1.08	0.42	442	2.52	1.06	0.42	455	2.44	1.02	0.42	478
26	18	2.35	1.93	0.82	368	2.25	1.85	0.82	386	2.16	1.77	0.82	405	2.08	1.71	0.82	423
26	20	2.45	1.72	0.70	386	2.35	1.65	0.70	409	2.28	1.60	0.70	419	2.20	1.54	0.70	437
26	22	2.55	1.48	0.58	400	2.46	1.43	0.58	426	2.40	1.39	0.58	437	2.30	1.33	0.58	455
26	24	2.68	1.23	0.46	419	2.58	1.19	0.46	442	2.52	1.16	0.46	455	2.44	1.12	0.46	478
26	26	2.76	0.94	0.34	442	2.68	0.91	0.34	465	2.64	0.90	0.34	478	2.56	0.87	0.34	492
27	18	2.35	2.02	0.86	368	2.25	1.94	0.86	386	2.16	1.86	0.86	405	2.08	1.79	0.86	423
27	20	2.45	1.81	0.74	386	2.35	1.74	0.74	409	2.28	1.69	0.74	419	2.20	1.63	0.74	437
27	22	2.55	1.58	0.62	400	2.46	1.53	0.62	426	2.40	1.49	0.62	437	2.30	1.43	0.62	455
27	24	2.68	1.34	0.50	419	2.58	1.29	0.50	442	2.52	1.26	0.50	455	2.44	1.22	0.50	478
27	26	2.76	1.05	0.38	442	2.68	1.02	0.38	465	2.64	1.00	0.38	478	2.56	0.97	0.38	492
28	18	2.35	2.12	0.90	368	2.25	2.03	0.90	386	2.16	1.94	0.90	405	2.08	1.87	0.90	423
28	20	2.45	1.91	0.78	386	2.35	1.83	0.78	409	2.28	1.78	0.78	419	2.20	1.72	0.78	437
28	22	2.55	1.68	0.66	400	2.46	1.62	0.66	426	2.40	1.58	0.66	437	2.30	1.52	0.66	455
28	24	2.68	1.45	0.54	419	2.58	1.39	0.54	442	2.52	1.36	0.54	455	2.44	1.32	0.54	478
28	26	2.76	1.16	0.42	442	2.68	1.13	0.42	465	2.64	1.11	0.42	478	2.56	1.08	0.42	492
29	18	2.35	2.21	0.94	368	2.25	2.12	0.94	386	2.16	2.03	0.94	405	2.08	1.96	0.94	423
29	20	2.45	2.01	0.82	386	2.35	1.93	0.82	409	2.28	1.87	0.82	419	2.20	1.80	0.82	437
29	22	2.55	1.79	0.70	400	2.46	1.72	0.70	426	2.40	1.68	0.70	437	2.30	1.61	0.70	455
29	24	2.68	1.55	0.58	419	2.58	1.50	0.58	442	2.52	1.46	0.58	455	2.44	1.42	0.58	478
29	26	2.76	1.27	0.46	442	2.68	1.23	0.46	465	2.64	1.21	0.46	478	2.56	1.18	0.46	492
30	18	2.35	2.30	0.98	368	2.25	2.21	0.98	386	2.16	2.12	0.98	405	2.08	2.04	0.98	423
30	20	2.45	2.11	0.86	386	2.35	2.02	0.86	409	2.28	1.96	0.86	419	2.20	1.89	0.86	437
30	22	2.55	1.89	0.74	400	2.46	1.82	0.74	426	2.40	1.78	0.74	437	2.30	1.70	0.74	455
30	24	2.68	1.66	0.62	419	2.58	1.60	0.62	442	2.52	1.56	0.62	455	2.44	1.51	0.62	478
30	26	2.76	1.38	0.50	442	2.68	1.34	0.50	465	2.64	1.32	0.50	478	2.56	1.28	0.50	492
31	18	2.35	2.35	1.00	368	2.25	2.25	1.00	386	2.16	2.16	1.00	405	2.08	2.08	1.00	423
31	20	2.45	2.21	0.90	386	2.35	2.12	0.90	409	2.28	2.05	0.90	419	2.20	1.98	0.90	437
31	22	2.55	1.99	0.78	400	2.46	1.92	0.78	426	2.40	1.87	0.78	437	2.30	1.79	0.78	455
31	24	2.68	1.77	0.66	419	2.58	1.70	0.66	442	2.52	1.66	0.66	455	2.44	1.61	0.66	478
31	26	2.76	1.49	0.54	442	2.68	1.45	0.54	465	2.64	1.43	0.54	478	2.56	1.38	0.54	492
32	18	2.35	2.35	1.00	368	2.25	2.25	1.00	386	2.16	2.16	1.00	405	2.08	2.08	1.00	423
32	20	2.45	2.30	0.94	386	2.35	2.21	0.94	409	2.28	2.14	0.94	419	2.20	2.07	0.94	437
32	22	2.55	2.09	0.82	400	2.46	2.02	0.82	426	2.40	1.97	0.82	437	2.30	1.89	0.82	455
32	24	2.68	1.88	0.70	419	2.58	1.81	0.70	442	2.52	1.76	0.70	455	2.44	1.71	0.70	478
32	26	2.76	1.60	0.58	442	2.68	1.55	0.58	465	2.64	1.53	0.58	478	2.56	1.48	0.58	492

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-AP20VG: MUZ-AP20VG

CAPACITY: 2.0 kW

SHF: 0.8

INPUT: 460 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	1.96	1.22	0.62	451	1.80	1.12	0.62	478	1.66	1.03	0.62	497
21	20	2.06	1.03	0.50	469	1.92	0.96	0.50	492	1.78	0.89	0.50	520
22	18	1.96	1.29	0.66	451	1.80	1.19	0.66	478	1.66	1.10	0.66	497
22	20	2.06	1.11	0.54	469	1.92	1.04	0.54	492	1.78	0.96	0.54	520
22	22	2.18	0.92	0.42	488	2.04	0.86	0.42	515	1.90	0.80	0.42	534
23	18	1.96	1.37	0.70	451	1.80	1.26	0.70	478	1.66	1.16	0.70	497
23	20	2.06	1.19	0.58	469	1.92	1.11	0.58	492	1.78	1.03	0.58	520
23	22	2.18	1.00	0.46	488	2.04	0.94	0.46	515	1.90	0.87	0.46	534
24	18	1.96	1.45	0.74	451	1.80	1.33	0.74	478	1.66	1.23	0.74	497
24	20	2.06	1.28	0.62	469	1.92	1.19	0.62	492	1.78	1.10	0.62	520
24	22	2.18	1.09	0.50	488	2.04	1.02	0.50	515	1.90	0.95	0.50	534
24	24	2.30	0.87	0.38	506	2.16	0.82	0.38	529	2.04	0.78	0.38	552
25	18	1.96	1.53	0.78	451	1.80	1.40	0.78	478	1.66	1.29	0.78	497
25	20	2.06	1.36	0.66	469	1.92	1.27	0.66	492	1.78	1.17	0.66	520
25	22	2.18	1.18	0.54	488	2.04	1.10	0.54	515	1.90	1.03	0.54	534
25	24	2.30	0.97	0.42	506	2.16	0.91	0.42	529	2.04	0.86	0.42	552
26	18	1.96	1.61	0.82	451	1.80	1.48	0.82	478	1.66	1.36	0.82	497
26	20	2.06	1.44	0.70	469	1.92	1.34	0.70	492	1.78	1.25	0.70	520
26	22	2.18	1.26	0.58	488	2.04	1.18	0.58	515	1.90	1.10	0.58	534
26	24	2.30	1.06	0.46	506	2.16	0.99	0.46	529	2.04	0.94	0.46	552
26	26	2.42	0.82	0.34	524	2.28	0.78	0.34	547	2.14	0.73	0.34	570
27	18	1.96	1.69	0.86	451	1.80	1.55	0.86	478	1.66	1.43	0.86	497
27	20	2.06	1.52	0.74	469	1.92	1.42	0.74	492	1.78	1.32	0.74	520
27	22	2.18	1.35	0.62	488	2.04	1.26	0.62	515	1.90	1.18	0.62	534
27	24	2.30	1.15	0.50	506	2.16	1.08	0.50	529	2.04	1.02	0.50	552
27	26	2.42	0.92	0.38	524	2.28	0.87	0.38	547	2.14	0.81	0.38	570
28	18	1.96	1.76	0.90	451	1.80	1.62	0.90	478	1.66	1.49	0.90	497
28	20	2.06	1.61	0.78	469	1.92	1.50	0.78	492	1.78	1.39	0.78	520
28	22	2.18	1.44	0.66	488	2.04	1.35	0.66	515	1.90	1.25	0.66	534
28	24	2.30	1.24	0.54	506	2.16	1.17	0.54	529	2.04	1.10	0.54	552
28	26	2.42	1.02	0.42	524	2.28	0.96	0.42	547	2.14	0.90	0.42	570
29	18	1.96	1.84	0.94	451	1.80	1.69	0.94	478	1.66	1.56	0.94	497
29	20	2.06	1.69	0.82	469	1.92	1.57	0.82	492	1.78	1.46	0.82	520
29	22	2.18	1.53	0.70	488	2.04	1.43	0.70	515	1.90	1.33	0.70	534
29	24	2.30	1.33	0.58	506	2.16	1.25	0.58	529	2.04	1.18	0.58	552
29	26	2.42	1.11	0.46	524	2.28	1.05	0.46	547	2.14	0.98	0.46	570
30	18	1.96	1.92	0.98	451	1.80	1.76	0.98	478	1.66	1.63	0.98	497
30	20	2.06	1.77	0.86	469	1.92	1.65	0.86	492	1.78	1.53	0.86	520
30	22	2.18	1.61	0.74	488	2.04	1.51	0.74	515	1.90	1.41	0.74	534
30	24	2.30	1.43	0.62	506	2.16	1.34	0.62	529	2.04	1.26	0.62	552
30	26	2.42	1.21	0.50	524	2.28	1.14	0.50	547	2.14	1.07	0.50	570
31	18	1.96	1.96	1.00	451	1.80	1.80	1.00	478	1.66	1.66	1.00	497
31	20	2.06	1.85	0.90	469	1.92	1.73	0.90	492	1.78	1.60	0.90	520
31	22	2.18	1.70	0.78	488	2.04	1.59	0.78	515	1.90	1.48	0.78	534
31	24	2.30	1.52	0.66	506	2.16	1.43	0.66	529	2.04	1.35	0.66	552
31	26	2.42	1.31	0.54	524	2.28	1.23	0.54	547	2.14	1.16	0.54	570
32	18	1.96	1.96	1.00	451	1.80	1.80	1.00	478	1.66	1.66	1.00	497
32	20	2.06	1.94	0.94	469	1.92	1.80	0.94	492	1.78	1.67	0.94	520
32	22	2.18	1.79	0.82	488	2.04	1.67	0.82	515	1.90	1.56	0.82	534
32	24	2.30	1.61	0.70	506	2.16	1.51	0.70	529	2.04	1.43	0.70	552
32	26	2.42	1.40	0.58	524	2.28	1.32	0.58	547	2.14	1.24	0.58	570

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP25VG, MSZ-AP25VGK: MUZ-AP25VG, MUZ-AP25VGH
 CAPACITY: 2.5 kW SHF: 0.92 INPUT: 600 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.17	0.74	480	2.81	2.08	0.74	504	2.70	2.00	0.74	528	2.60	1.92	0.74	552
21	20	3.06	1.90	0.62	504	2.94	1.82	0.62	534	2.85	1.77	0.62	546	2.75	1.71	0.62	570
22	18	2.94	2.29	0.78	480	2.81	2.19	0.78	504	2.70	2.11	0.78	528	2.60	2.03	0.78	552
22	20	3.06	2.02	0.66	504	2.94	1.94	0.66	534	2.85	1.88	0.66	546	2.75	1.82	0.66	570
22	22	3.19	1.72	0.54	522	3.08	1.66	0.54	555	3.00	1.62	0.54	570	2.88	1.55	0.54	594
23	18	2.94	2.41	0.82	480	2.81	2.31	0.82	504	2.70	2.21	0.82	528	2.60	2.13	0.82	552
23	20	3.06	2.14	0.70	504	2.94	2.06	0.70	534	2.85	2.00	0.70	546	2.75	1.93	0.70	570
23	22	3.19	1.85	0.58	522	3.08	1.78	0.58	555	3.00	1.74	0.58	570	2.88	1.67	0.58	594
24	18	2.94	2.53	0.86	480	2.81	2.42	0.86	504	2.70	2.32	0.86	528	2.60	2.24	0.86	552
24	20	3.06	2.27	0.74	504	2.94	2.17	0.74	534	2.85	2.11	0.74	546	2.75	2.04	0.74	570
24	22	3.19	1.98	0.62	522	3.08	1.91	0.62	555	3.00	1.86	0.62	570	2.88	1.78	0.62	594
24	24	3.35	1.68	0.50	546	3.23	1.61	0.50	576	3.15	1.58	0.50	594	3.05	1.53	0.50	624
25	18	2.94	2.64	0.90	480	2.81	2.53	0.90	504	2.70	2.43	0.90	528	2.60	2.34	0.90	552
25	20	3.06	2.39	0.78	504	2.94	2.29	0.78	534	2.85	2.22	0.78	546	2.75	2.15	0.78	570
25	22	3.19	2.10	0.66	522	3.08	2.03	0.66	555	3.00	1.98	0.66	570	2.88	1.90	0.66	594
25	24	3.35	1.81	0.54	546	3.23	1.74	0.54	576	3.15	1.70	0.54	594	3.05	1.65	0.54	624
26	18	2.94	2.76	0.94	480	2.81	2.64	0.94	504	2.70	2.54	0.94	528	2.60	2.44	0.94	552
26	20	3.06	2.51	0.82	504	2.94	2.41	0.82	534	2.85	2.34	0.82	546	2.75	2.26	0.82	570
26	22	3.19	2.23	0.70	522	3.08	2.15	0.70	555	3.00	2.10	0.70	570	2.88	2.01	0.70	594
26	24	3.35	1.94	0.58	546	3.23	1.87	0.58	576	3.15	1.83	0.58	594	3.05	1.77	0.58	624
26	26	3.45	1.59	0.46	576	3.35	1.54	0.46	606	3.30	1.52	0.46	624	3.20	1.47	0.46	642
27	18	2.94	2.88	0.98	480	2.81	2.76	0.98	504	2.70	2.65	0.98	528	2.60	2.55	0.98	552
27	20	3.06	2.63	0.86	504	2.94	2.53	0.86	534	2.85	2.45	0.86	546	2.75	2.37	0.86	570
27	22	3.19	2.36	0.74	522	3.08	2.28	0.74	555	3.00	2.22	0.74	570	2.88	2.13	0.74	594
27	24	3.35	2.08	0.62	546	3.23	2.00	0.62	576	3.15	1.95	0.62	594	3.05	1.89	0.62	624
27	26	3.45	1.73	0.50	576	3.35	1.68	0.50	606	3.30	1.65	0.50	624	3.20	1.60	0.50	642
28	18	2.94	2.94	1.00	480	2.81	2.81	1.00	504	2.70	2.70	1.00	528	2.60	2.60	1.00	552
28	20	3.06	2.76	0.90	504	2.94	2.64	0.90	534	2.85	2.57	0.90	546	2.75	2.48	0.90	570
28	22	3.19	2.49	0.78	522	3.08	2.40	0.78	555	3.00	2.34	0.78	570	2.88	2.24	0.78	594
28	24	3.35	2.21	0.66	546	3.23	2.13	0.66	576	3.15	2.08	0.66	594	3.05	2.01	0.66	624
28	26	3.45	1.86	0.54	576	3.35	1.81	0.54	606	3.30	1.78	0.54	624	3.20	1.73	0.54	642
29	18	2.94	2.94	1.00	480	2.81	2.81	1.00	504	2.70	2.70	1.00	528	2.60	2.60	1.00	552
29	20	3.06	2.88	0.94	504	2.94	2.76	0.94	534	2.85	2.68	0.94	546	2.75	2.59	0.94	570
29	22	3.19	2.61	0.82	522	3.08	2.52	0.82	555	3.00	2.46	0.82	570	2.88	2.36	0.82	594
29	24	3.35	2.35	0.70	546	3.23	2.26	0.70	576	3.15	2.21	0.70	594	3.05	2.14	0.70	624
29	26	3.45	2.00	0.58	576	3.35	1.94	0.58	606	3.30	1.91	0.58	624	3.20	1.86	0.58	642
30	18	2.94	2.94	1.00	480	2.81	2.81	1.00	504	2.70	2.70	1.00	528	2.60	2.60	1.00	552
30	20	3.06	3.00	0.98	504	2.94	2.88	0.98	534	2.85	2.79	0.98	546	2.75	2.70	0.98	570
30	22	3.19	2.74	0.86	522	3.08	2.64	0.86	555	3.00	2.58	0.86	570	2.88	2.47	0.86	594
30	24	3.35	2.48	0.74	546	3.23	2.39	0.74	576	3.15	2.33	0.74	594	3.05	2.26	0.74	624
30	26	3.45	2.14	0.62	576	3.35	2.08	0.62	606	3.30	2.05	0.62	624	3.20	1.98	0.62	642
31	18	2.94	2.94	1.00	480	2.81	2.81	1.00	504	2.70	2.70	1.00	528	2.60	2.60	1.00	552
31	20	3.06	3.06	1.00	504	2.94	2.94	1.00	534	2.85	2.85	1.00	546	2.75	2.75	1.00	570
31	22	3.19	2.87	0.90	522	3.08	2.77	0.90	555	3.00	2.70	0.90	570	2.88	2.59	0.90	594
31	24	3.35	2.61	0.78	546	3.23	2.52	0.78	576	3.15	2.46	0.78	594	3.05	2.38	0.78	624
31	26	3.45	2.28	0.66	576	3.35	2.21	0.66	606	3.30	2.18	0.66	624	3.20	2.11	0.66	642
32	18	2.94	2.94	1.00	480	2.81	2.81	1.00	504	2.70	2.70	1.00	528	2.60	2.60	1.00	552
32	20	3.06	3.06	1.00	504	2.94	2.94	1.00	534	2.85	2.85	1.00	546	2.75	2.75	1.00	570
32	22	3.19	3.00	0.94	522	3.08	2.89	0.94	555	3.00	2.82	0.94	570	2.88	2.70	0.94	594
32	24	3.35	2.75	0.82	546	3.23	2.64	0.82	576	3.15	2.58	0.82	594	3.05	2.50	0.82	624
32	26	3.45	2.42	0.70	576	3.35	2.35	0.70	606	3.30	2.31	0.70	624	3.20	2.24	0.70	642

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP25VG, MSZ-AP25VGK: MUZ-AP25VG, MUZ-AP25VGH
 CAPACITY: 2.5 kW SHF: 0.92 INPUT: 600 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.81	0.74	588	2.25	1.67	0.74	624	2.08	1.54	0.74	648
21	20	2.58	1.60	0.62	612	2.40	1.49	0.62	642	2.23	1.38	0.62	678
22	18	2.45	1.91	0.78	588	2.25	1.76	0.78	624	2.08	1.62	0.78	648
22	20	2.58	1.70	0.66	612	2.40	1.58	0.66	642	2.23	1.47	0.66	678
22	22	2.73	1.47	0.54	636	2.55	1.38	0.54	672	2.38	1.28	0.54	696
23	18	2.45	2.01	0.82	588	2.25	1.85	0.82	624	2.08	1.70	0.82	648
23	20	2.58	1.80	0.70	612	2.40	1.68	0.70	642	2.23	1.56	0.70	678
23	22	2.73	1.58	0.58	636	2.55	1.48	0.58	672	2.38	1.38	0.58	696
24	18	2.45	2.11	0.86	588	2.25	1.94	0.86	624	2.08	1.78	0.86	648
24	20	2.58	1.91	0.74	612	2.40	1.78	0.74	642	2.23	1.65	0.74	678
24	22	2.73	1.69	0.62	636	2.55	1.58	0.62	672	2.38	1.47	0.62	696
24	24	2.88	1.44	0.50	660	2.70	1.35	0.50	690	2.55	1.28	0.50	720
25	18	2.45	2.21	0.90	588	2.25	2.03	0.90	624	2.08	1.87	0.9	648
25	20	2.58	2.01	0.78	612	2.40	1.87	0.78	642	2.23	1.74	0.78	678
25	22	2.73	1.80	0.66	636	2.55	1.68	0.66	672	2.38	1.57	0.66	696
25	24	2.88	1.55	0.54	660	2.70	1.46	0.54	690	2.55	1.38	0.54	720
26	18	2.45	2.30	0.94	588	2.25	2.12	0.94	624	2.08	1.95	0.94	648
26	20	2.58	2.11	0.82	612	2.40	1.97	0.82	642	2.23	1.82	0.82	678
26	22	2.73	1.91	0.70	636	2.55	1.79	0.70	672	2.38	1.66	0.70	696
26	24	2.88	1.67	0.58	660	2.70	1.57	0.58	690	2.55	1.48	0.58	720
26	26	3.03	1.39	0.46	684	2.85	1.31	0.46	714	2.68	1.23	0.46	744
27	18	2.45	2.40	0.98	588	2.25	2.21	0.98	624	2.08	2.03	0.98	648
27	20	2.58	2.21	0.86	612	2.40	2.06	0.86	642	2.23	1.91	0.86	678
27	22	2.73	2.02	0.74	636	2.55	1.89	0.74	672	2.38	1.76	0.74	696
27	24	2.88	1.78	0.62	660	2.70	1.67	0.62	690	2.55	1.58	0.62	720
27	26	3.03	1.51	0.50	684	2.85	1.43	0.50	714	2.68	1.34	0.50	744
28	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
28	20	2.58	2.32	0.90	612	2.40	2.16	0.90	642	2.23	2.00	0.90	678
28	22	2.73	2.13	0.78	636	2.55	1.99	0.78	672	2.38	1.85	0.78	696
28	24	2.88	1.90	0.66	660	2.70	1.78	0.66	690	2.55	1.68	0.66	720
28	26	3.03	1.63	0.54	684	2.85	1.54	0.54	714	2.68	1.44	0.54	744
29	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
29	20	2.58	2.42	0.94	612	2.40	2.26	0.94	642	2.23	2.09	0.94	678
29	22	2.73	2.23	0.82	636	2.55	2.09	0.82	672	2.38	1.95	0.82	696
29	24	2.88	2.01	0.70	660	2.70	1.89	0.70	690	2.55	1.79	0.70	720
29	26	3.03	1.75	0.58	684	2.85	1.65	0.58	714	2.68	1.55	0.58	744
30	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
30	20	2.58	2.52	0.98	612	2.40	2.35	0.98	642	2.23	2.18	0.98	678
30	22	2.73	2.34	0.86	636	2.55	2.19	0.86	672	2.38	2.04	0.86	696
30	24	2.88	2.13	0.74	660	2.70	2.00	0.74	690	2.55	1.89	0.74	720
30	26	3.03	1.88	0.62	684	2.85	1.77	0.62	714	2.68	1.66	0.62	744
31	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
31	20	2.58	2.58	1.00	612	2.40	2.40	1.00	642	2.23	2.23	1.00	678
31	22	2.73	2.45	0.90	636	2.55	2.30	0.90	672	2.38	2.14	0.90	696
31	24	2.88	2.24	0.78	660	2.70	2.11	0.78	690	2.55	1.99	0.78	720
31	26	3.03	2.00	0.66	684	2.85	1.88	0.66	714	2.68	1.77	0.66	744
32	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
32	20	2.58	2.58	1.00	612	2.40	2.40	1.00	642	2.23	2.23	1.00	678
32	22	2.73	2.56	0.94	636	2.55	2.40	0.94	672	2.38	2.23	0.94	696
32	24	2.88	2.36	0.82	660	2.70	2.21	0.82	690	2.55	2.09	0.82	720
32	26	3.03	2.12	0.70	684	2.85	2.00	0.70	714	2.68	1.87	0.70	744

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP35VG, MSZ-AP35VGK: MUZ-AP35VG, MUZ-AP35VGH
 CAPACITY: 3.5 kW SHF: 0.88 INPUT: 990 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.11	2.88	0.70	792	3.94	2.76	0.70	832	3.78	2.65	0.70	871	3.64	2.55	0.70	911
21	20	4.29	2.49	0.58	832	4.11	2.39	0.58	881	3.99	2.31	0.58	901	3.85	2.23	0.58	941
22	18	4.11	3.04	0.74	792	3.94	2.91	0.74	832	3.78	2.80	0.74	871	3.64	2.69	0.74	911
22	20	4.29	2.66	0.62	832	4.11	2.55	0.62	881	3.99	2.47	0.62	901	3.85	2.39	0.62	941
22	22	4.46	2.23	0.50	861	4.31	2.15	0.50	916	4.20	2.10	0.50	941	4.03	2.01	0.50	980
23	18	4.11	3.21	0.78	792	3.94	3.07	0.78	832	3.78	2.95	0.78	871	3.64	2.84	0.78	911
23	20	4.29	2.83	0.66	832	4.11	2.71	0.66	881	3.99	2.63	0.66	901	3.85	2.54	0.66	941
23	22	4.46	2.41	0.54	861	4.31	2.32	0.54	916	4.20	2.27	0.54	941	4.03	2.17	0.54	980
24	18	4.11	3.37	0.82	792	3.94	3.23	0.82	832	3.78	3.10	0.82	871	3.64	2.98	0.82	911
24	20	4.29	3.00	0.70	832	4.11	2.88	0.70	881	3.99	2.79	0.70	901	3.85	2.70	0.70	941
24	22	4.46	2.59	0.58	861	4.31	2.50	0.58	916	4.20	2.44	0.58	941	4.03	2.33	0.58	980
24	24	4.69	2.16	0.46	901	4.52	2.08	0.46	950	4.41	2.03	0.46	980	4.27	1.96	0.46	1030
25	18	4.11	3.54	0.86	792	3.94	3.39	0.86	832	3.78	3.25	0.86	871	3.64	3.13	0.86	911
25	20	4.29	3.17	0.74	832	4.11	3.04	0.74	881	3.99	2.95	0.74	901	3.85	2.85	0.74	941
25	22	4.46	2.77	0.62	861	4.31	2.67	0.62	916	4.20	2.60	0.62	941	4.03	2.50	0.62	980
25	24	4.69	2.35	0.50	901	4.52	2.26	0.50	950	4.41	2.21	0.50	980	4.27	2.14	0.50	1030
26	18	4.11	3.70	0.90	792	3.94	3.54	0.90	832	3.78	3.40	0.90	871	3.64	3.28	0.90	911
26	20	4.29	3.34	0.78	832	4.11	3.21	0.78	881	3.99	3.11	0.78	901	3.85	3.00	0.78	941
26	22	4.46	2.95	0.66	861	4.31	2.84	0.66	916	4.20	2.77	0.66	941	4.03	2.66	0.66	980
26	24	4.69	2.53	0.54	901	4.52	2.44	0.54	950	4.41	2.38	0.54	980	4.27	2.31	0.54	1030
26	26	4.83	2.03	0.42	950	4.69	1.97	0.42	1000	4.62	1.94	0.42	1030	4.48	1.88	0.42	1059
27	18	4.11	3.87	0.94	792	3.94	3.70	0.94	832	3.78	3.55	0.94	871	3.64	3.42	0.94	911
27	20	4.29	3.52	0.82	832	4.11	3.37	0.82	881	3.99	3.27	0.82	901	3.85	3.16	0.82	941
27	22	4.46	3.12	0.70	861	4.31	3.01	0.70	916	4.20	2.94	0.70	941	4.03	2.82	0.70	980
27	24	4.69	2.72	0.58	901	4.52	2.62	0.58	950	4.41	2.56	0.58	980	4.27	2.48	0.58	1030
27	26	4.83	2.22	0.46	950	4.69	2.16	0.46	1000	4.62	2.13	0.46	1030	4.48	2.06	0.46	1059
28	18	4.11	4.03	0.98	792	3.94	3.86	0.98	832	3.78	3.70	0.98	871	3.64	3.57	0.98	911
28	20	4.29	3.69	0.86	832	4.11	3.54	0.86	881	3.99	3.43	0.86	901	3.85	3.31	0.86	941
28	22	4.46	3.30	0.74	861	4.31	3.19	0.74	916	4.20	3.11	0.74	941	4.03	2.98	0.74	980
28	24	4.69	2.91	0.62	901	4.52	2.80	0.62	950	4.41	2.73	0.62	980	4.27	2.65	0.62	1030
28	26	4.83	2.42	0.50	950	4.69	2.35	0.50	1000	4.62	2.31	0.50	1030	4.48	2.24	0.50	1059
29	18	4.11	4.11	1.00	792	3.94	3.94	1.00	832	3.78	3.78	1.00	871	3.64	3.64	1.00	911
29	20	4.29	3.86	0.90	832	4.11	3.70	0.90	881	3.99	3.59	0.90	901	3.85	3.47	0.90	941
29	22	4.46	3.48	0.78	861	4.31	3.36	0.78	916	4.20	3.28	0.78	941	4.03	3.14	0.78	980
29	24	4.69	3.10	0.66	901	4.52	2.98	0.66	950	4.41	2.91	0.66	980	4.27	2.82	0.66	1030
29	26	4.83	2.61	0.54	950	4.69	2.53	0.54	1000	4.62	2.49	0.54	1030	4.48	2.42	0.54	1059
30	18	4.11	4.11	1.00	792	3.94	3.94	1.00	832	3.78	3.78	1.00	871	3.64	3.64	1.00	911
30	20	4.29	4.03	0.94	832	4.11	3.87	0.94	881	3.99	3.75	0.94	901	3.85	3.62	0.94	941
30	22	4.46	3.66	0.82	861	4.31	3.53	0.82	916	4.20	3.44	0.82	941	4.03	3.30	0.82	980
30	24	4.69	3.28	0.70	901	4.52	3.16	0.70	950	4.41	3.09	0.70	980	4.27	2.99	0.70	1030
30	26	4.83	2.80	0.58	950	4.69	2.72	0.58	1000	4.62	2.68	0.58	1030	4.48	2.60	0.58	1059
31	18	4.11	4.11	1.00	792	3.94	3.94	1.00	832	3.78	3.78	1.00	871	3.64	3.64	1.00	911
31	20	4.29	4.20	0.98	832	4.11	4.03	0.98	881	3.99	3.91	0.98	901	3.85	3.77	0.98	941
31	22	4.46	3.84	0.86	861	4.31	3.70	0.86	916	4.20	3.61	0.86	941	4.03	3.46	0.86	980
31	24	4.69	3.47	0.74	901	4.52	3.34	0.74	950	4.41	3.26	0.74	980	4.27	3.16	0.74	1030
31	26	4.83	2.99	0.62	950	4.69	2.91	0.62	1000	4.62	2.86	0.62	1030	4.48	2.78	0.62	1059
32	18	4.11	4.11	1.00	792	3.94	3.94	1.00	832	3.78	3.78	1.00	871	3.64	3.64	1.00	911
32	20	4.29	4.29	1.00	832	4.11	4.11	1.00	881	3.99	3.99	1.00	901	3.85	3.85	1.00	941
32	22	4.46	4.02	0.90	861	4.31	3.87	0.90	916	4.20	3.78	0.90	941	4.03	3.62	0.90	980
32	24	4.69	3.66	0.78	901	4.52	3.52	0.78	950	4.41	3.44	0.78	980	4.27	3.33	0.78	1030
32	26	4.83	3.19	0.66	950	4.69	3.10	0.66	1000	4.62	3.05	0.66	1030	4.48	2.96	0.66	1059

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP35VG, MSZ-AP35VGK: MUZ-AP35VG, MUZ-AP35VGH

CAPACITY: 3.5 kW SHF: 0.88 INPUT: 990 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.43	2.40	0.70	970	3.15	2.21	0.70	1030	2.91	2.03	0.70	1069
21	20	3.61	2.09	0.58	1010	3.36	1.95	0.58	1059	3.12	1.81	0.58	1119
22	18	3.43	2.54	0.74	970	3.15	2.33	0.74	1030	2.91	2.15	0.74	1069
22	20	3.61	2.24	0.62	1010	3.36	2.08	0.62	1059	3.12	1.93	0.62	1119
22	22	3.82	1.91	0.50	1049	3.57	1.79	0.50	1109	3.33	1.66	0.50	1148
23	18	3.43	2.68	0.78	970	3.15	2.46	0.78	1030	2.91	2.27	0.78	1069
23	20	3.61	2.38	0.66	1010	3.36	2.22	0.66	1059	3.12	2.06	0.66	1119
23	22	3.82	2.06	0.54	1049	3.57	1.93	0.54	1109	3.33	1.80	0.54	1148
24	18	3.43	2.81	0.82	970	3.15	2.58	0.82	1030	2.91	2.38	0.82	1069
24	20	3.61	2.52	0.70	1010	3.36	2.35	0.70	1059	3.12	2.18	0.70	1119
24	22	3.82	2.21	0.58	1049	3.57	2.07	0.58	1109	3.33	1.93	0.58	1148
24	24	4.03	1.85	0.46	1089	3.78	1.74	0.46	1139	3.57	1.64	0.46	1188
25	18	3.43	2.95	0.86	970	3.15	2.71	0.86	1030	2.91	2.50	0.86	1069
25	20	3.61	2.67	0.74	1010	3.36	2.49	0.74	1059	3.12	2.31	0.74	1119
25	22	3.82	2.37	0.62	1049	3.57	2.21	0.62	1109	3.33	2.06	0.62	1148
25	24	4.03	2.01	0.50	1089	3.78	1.89	0.50	1139	3.57	1.79	0.50	1188
26	18	3.43	3.09	0.90	970	3.15	2.84	0.90	1030	2.91	2.61	0.90	1069
26	20	3.61	2.81	0.78	1010	3.36	2.62	0.78	1059	3.12	2.43	0.78	1119
26	22	3.82	2.52	0.66	1049	3.57	2.36	0.66	1109	3.33	2.19	0.66	1148
26	24	4.03	2.17	0.54	1089	3.78	2.04	0.54	1139	3.57	1.93	0.54	1188
26	26	4.24	1.78	0.42	1129	3.99	1.68	0.42	1178	3.75	1.57	0.42	1228
27	18	3.43	3.22	0.94	970	3.15	2.96	0.94	1030	2.91	2.73	0.94	1069
27	20	3.61	2.96	0.82	1010	3.36	2.76	0.82	1059	3.12	2.55	0.82	1119
27	22	3.82	2.67	0.70	1049	3.57	2.50	0.70	1109	3.33	2.33	0.70	1148
27	24	4.03	2.33	0.58	1089	3.78	2.19	0.58	1139	3.57	2.07	0.58	1188
27	26	4.24	1.95	0.46	1129	3.99	1.84	0.46	1178	3.75	1.72	0.46	1228
28	18	3.43	3.36	0.98	970	3.15	3.09	0.98	1030	2.91	2.85	0.98	1069
28	20	3.61	3.10	0.86	1010	3.36	2.89	0.86	1059	3.12	2.68	0.86	1119
28	22	3.82	2.82	0.74	1049	3.57	2.64	0.74	1109	3.33	2.46	0.74	1148
28	24	4.03	2.50	0.62	1089	3.78	2.34	0.62	1139	3.57	2.21	0.62	1188
28	26	4.24	2.12	0.50	1129	3.99	2.00	0.50	1178	3.75	1.87	0.50	1228
29	18	3.43	3.43	1.00	970	3.15	3.15	1.00	1030	2.91	2.91	1.00	1069
29	20	3.61	3.24	0.90	1010	3.36	3.02	0.90	1059	3.12	2.80	0.90	1119
29	22	3.82	2.98	0.78	1049	3.57	2.78	0.78	1109	3.33	2.59	0.78	1148
29	24	4.03	2.66	0.66	1089	3.78	2.49	0.66	1139	3.57	2.36	0.66	1188
29	26	4.24	2.29	0.54	1129	3.99	2.15	0.54	1178	3.75	2.02	0.54	1228
30	18	3.43	3.43	1.00	970	3.15	3.15	1.00	1030	2.91	2.91	1.00	1069
30	20	3.61	3.39	0.94	1010	3.36	3.16	0.94	1059	3.12	2.93	0.94	1119
30	22	3.82	3.13	0.82	1049	3.57	2.93	0.82	1109	3.33	2.73	0.82	1148
30	24	4.03	2.82	0.70	1089	3.78	2.65	0.70	1139	3.57	2.50	0.70	1188
30	26	4.24	2.46	0.58	1129	3.99	2.31	0.58	1178	3.75	2.17	0.58	1228
31	18	3.43	3.43	1.00	970	3.15	3.15	1.00	1030	2.91	2.91	1.00	1069
31	20	3.61	3.53	0.98	1010	3.36	3.29	0.98	1059	3.12	3.05	0.98	1119
31	22	3.82	3.28	0.86	1049	3.57	3.07	0.86	1109	3.33	2.86	0.86	1148
31	24	4.03	2.98	0.74	1089	3.78	2.80	0.74	1139	3.57	2.64	0.74	1188
31	26	4.24	2.63	0.62	1129	3.99	2.47	0.62	1178	3.75	2.32	0.62	1228
32	18	3.43	3.43	1.00	970	3.15	3.15	1.00	1030	2.91	2.91	1.00	1069
32	20	3.61	3.61	1.00	1010	3.36	3.36	1.00	1059	3.12	3.12	1.00	1119
32	22	3.82	3.43	0.90	1049	3.57	3.21	0.90	1109	3.33	2.99	0.90	1148
32	24	4.03	3.14	0.78	1089	3.78	2.95	0.78	1139	3.57	2.78	0.78	1188
32	26	4.24	2.80	0.66	1129	3.99	2.63	0.66	1178	3.75	2.47	0.66	1228

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP42VG, MSZ-AP42VGK: MUZ-AP42VG, MUZ-AP42VGH
 CAPACITY: 4.2 kW SHF: 0.77 INPUT: 1300 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.94	2.91	0.59	1040	4.73	2.79	0.59	1092	4.54	2.68	0.59	1144	4.37	2.58	0.59	1196
21	20	5.15	2.42	0.47	1092	4.94	2.32	0.47	1157	4.79	2.25	0.47	1183	4.62	2.17	0.47	1235
22	18	4.94	3.11	0.63	1040	4.73	2.98	0.63	1092	4.54	2.86	0.63	1144	4.37	2.75	0.63	1196
22	20	5.15	2.62	0.51	1092	4.94	2.52	0.51	1157	4.79	2.44	0.51	1183	4.62	2.36	0.51	1235
22	22	5.36	2.09	0.39	1131	5.17	2.01	0.39	1203	5.04	1.97	0.39	1235	4.83	1.88	0.39	1287
23	18	4.94	3.31	0.67	1040	4.73	3.17	0.67	1092	4.54	3.04	0.67	1144	4.37	2.93	0.67	1196
23	20	5.15	2.83	0.55	1092	4.94	2.71	0.55	1157	4.79	2.63	0.55	1183	4.62	2.54	0.55	1235
23	22	5.36	2.30	0.43	1131	5.17	2.22	0.43	1203	5.04	2.17	0.43	1235	4.83	2.08	0.43	1287
24	18	4.94	3.50	0.71	1040	4.73	3.35	0.71	1092	4.54	3.22	0.71	1144	4.37	3.10	0.71	1196
24	20	5.15	3.04	0.59	1092	4.94	2.91	0.59	1157	4.79	2.82	0.59	1183	4.62	2.73	0.59	1235
24	22	5.36	2.52	0.47	1131	5.17	2.43	0.47	1203	5.04	2.37	0.47	1235	4.83	2.27	0.47	1287
24	24	5.63	1.97	0.35	1183	5.42	1.90	0.35	1248	5.29	1.85	0.35	1287	5.12	1.79	0.35	1352
25	18	4.94	3.70	0.75	1040	4.73	3.54	0.75	1092	4.54	3.40	0.75	1144	4.37	3.28	0.75	1196
25	20	5.15	3.24	0.63	1092	4.94	3.11	0.63	1157	4.79	3.02	0.63	1183	4.62	2.91	0.63	1235
25	22	5.36	2.73	0.51	1131	5.17	2.63	0.51	1203	5.04	2.57	0.51	1235	4.83	2.46	0.51	1287
25	24	5.63	2.19	0.39	1183	5.42	2.11	0.39	1248	5.29	2.06	0.39	1287	5.12	2.00	0.39	1352
26	18	4.94	3.90	0.79	1040	4.73	3.73	0.79	1092	4.54	3.58	0.79	1144	4.37	3.45	0.79	1196
26	20	5.15	3.45	0.67	1092	4.94	3.31	0.67	1157	4.79	3.21	0.67	1183	4.62	3.10	0.67	1235
26	22	5.36	2.95	0.55	1131	5.17	2.84	0.55	1203	5.04	2.77	0.55	1235	4.83	2.66	0.55	1287
26	24	5.63	2.42	0.43	1183	5.42	2.33	0.43	1248	5.29	2.28	0.43	1287	5.12	2.20	0.43	1352
26	26	5.80	1.80	0.31	1248	5.63	1.74	0.31	1313	5.54	1.72	0.31	1352	5.38	1.67	0.31	1391
27	18	4.94	4.10	0.83	1040	4.73	3.92	0.83	1092	4.54	3.76	0.83	1144	4.37	3.63	0.83	1196
27	20	5.15	3.65	0.71	1092	4.94	3.50	0.71	1157	4.79	3.40	0.71	1183	4.62	3.28	0.71	1235
27	22	5.36	3.16	0.59	1131	5.17	3.05	0.59	1203	5.04	2.97	0.59	1235	4.83	2.85	0.59	1287
27	24	5.63	2.65	0.47	1183	5.42	2.55	0.47	1248	5.29	2.49	0.47	1287	5.12	2.41	0.47	1352
27	26	5.80	2.03	0.35	1248	5.63	1.97	0.35	1313	5.54	1.94	0.35	1352	5.38	1.88	0.35	1391
28	18	4.94	4.29	0.87	1040	4.73	4.11	0.87	1092	4.54	3.95	0.87	1144	4.37	3.80	0.87	1196
28	20	5.15	3.86	0.75	1092	4.94	3.70	0.75	1157	4.79	3.59	0.75	1183	4.62	3.47	0.75	1235
28	22	5.36	3.37	0.63	1131	5.17	3.25	0.63	1203	5.04	3.18	0.63	1235	4.83	3.04	0.63	1287
28	24	5.63	2.87	0.51	1183	5.42	2.76	0.51	1248	5.29	2.70	0.51	1287	5.12	2.61	0.51	1352
28	26	5.80	2.26	0.39	1248	5.63	2.19	0.39	1313	5.54	2.16	0.39	1352	5.38	2.10	0.39	1391
29	18	4.94	4.49	0.91	1040	4.73	4.30	0.91	1092	4.54	4.13	0.91	1144	4.37	3.97	0.91	1196
29	20	5.15	4.06	0.79	1092	4.94	3.90	0.79	1157	4.79	3.78	0.79	1183	4.62	3.65	0.79	1235
29	22	5.36	3.59	0.67	1131	5.17	3.46	0.67	1203	5.04	3.38	0.67	1235	4.83	3.24	0.67	1287
29	24	5.63	3.10	0.55	1183	5.42	2.98	0.55	1248	5.29	2.91	0.55	1287	5.12	2.82	0.55	1352
29	26	5.80	2.49	0.43	1248	5.63	2.42	0.43	1313	5.54	2.38	0.43	1352	5.38	2.31	0.43	1391
30	18	4.94	4.69	0.95	1040	4.73	4.49	0.95	1092	4.54	4.31	0.95	1144	4.37	4.15	0.95	1196
30	20	5.15	4.27	0.83	1092	4.94	4.10	0.83	1157	4.79	3.97	0.83	1183	4.62	3.83	0.83	1235
30	22	5.36	3.80	0.71	1131	5.17	3.67	0.71	1203	5.04	3.58	0.71	1235	4.83	3.43	0.71	1287
30	24	5.63	3.32	0.59	1183	5.42	3.20	0.59	1248	5.29	3.12	0.59	1287	5.12	3.02	0.59	1352
30	26	5.80	2.72	0.47	1248	5.63	2.65	0.47	1313	5.54	2.61	0.47	1352	5.38	2.53	0.47	1391
31	18	4.94	4.89	0.99	1040	4.73	4.68	0.99	1092	4.54	4.49	0.99	1144	4.37	4.32	0.99	1196
31	20	5.15	4.48	0.87	1092	4.94	4.29	0.87	1157	4.79	4.17	0.87	1183	4.62	4.02	0.87	1235
31	22	5.36	4.02	0.75	1131	5.17	3.87	0.75	1203	5.04	3.78	0.75	1235	4.83	3.62	0.75	1287
31	24	5.63	3.55	0.63	1183	5.42	3.41	0.63	1248	5.29	3.33	0.63	1287	5.12	3.23	0.63	1352
31	26	5.80	2.96	0.51	1248	5.63	2.87	0.51	1313	5.54	2.83	0.51	1352	5.38	2.74	0.51	1391
32	18	4.94	4.94	1.00	1040	4.73	4.73	1.00	1092	4.54	4.54	1.00	1144	4.37	4.37	1.00	1196
32	20	5.15	4.68	0.91	1092	4.94	4.49	0.91	1157	4.79	4.36	0.91	1183	4.62	4.20	0.91	1235
32	22	5.36	4.23	0.79	1131	5.17	4.08	0.79	1203	5.04	3.98	0.79	1235	4.83	3.82	0.79	1287
32	24	5.63	3.77	0.67	1183	5.42	3.63	0.67	1248	5.29	3.55	0.67	1287	5.12	3.43	0.67	1352
32	26	5.80	3.19	0.55	1248	5.63	3.10	0.55	1313	5.54	3.05	0.55	1352	5.38	2.96	0.55	1391

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP42VG, MSZ-AP42VGK: MUZ-AP42VG, MUZ-AP42VGH

CAPACITY: 4.2 kW SHF: 0.77 INPUT: 1300 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.12	2.43	0.59	1274	3.78	2.23	0.59	1352	3.49	2.06	0.59	1404
21	20	4.33	2.03	0.47	1326	4.03	1.90	0.47	1391	3.74	1.76	0.47	1469
22	18	4.12	2.59	0.63	1274	3.78	2.38	0.63	1352	3.49	2.20	0.63	1404
22	20	4.33	2.21	0.51	1326	4.03	2.06	0.51	1391	3.74	1.91	0.51	1469
22	22	4.58	1.79	0.39	1378	4.28	1.67	0.39	1456	3.99	1.56	0.39	1508
23	18	4.12	2.76	0.67	1274	3.78	2.53	0.67	1352	3.49	2.34	0.67	1404
23	20	4.33	2.38	0.55	1326	4.03	2.22	0.55	1391	3.74	2.06	0.55	1469
23	22	4.58	1.97	0.43	1378	4.28	1.84	0.43	1456	3.99	1.72	0.43	1508
24	18	4.12	2.92	0.71	1274	3.78	2.68	0.71	1352	3.49	2.48	0.71	1404
24	20	4.33	2.55	0.59	1326	4.03	2.38	0.59	1391	3.74	2.21	0.59	1469
24	22	4.58	2.15	0.47	1378	4.28	2.01	0.47	1456	3.99	1.88	0.47	1508
24	24	4.83	1.69	0.35	1430	4.54	1.59	0.35	1495	4.28	1.50	0.35	1560
25	18	4.12	3.09	0.75	1274	3.78	2.84	0.75	1352	3.49	2.61	0.75	1404
25	20	4.33	2.73	0.63	1326	4.03	2.54	0.63	1391	3.74	2.35	0.63	1469
25	22	4.58	2.33	0.51	1378	4.28	2.18	0.51	1456	3.99	2.03	0.51	1508
25	24	4.83	1.88	0.39	1430	4.54	1.77	0.39	1495	4.28	1.67	0.39	1560
26	18	4.12	3.25	0.79	1274	3.78	2.99	0.79	1352	3.49	2.75	0.79	1404
26	20	4.33	2.90	0.67	1326	4.03	2.70	0.67	1391	3.74	2.50	0.67	1469
26	22	4.58	2.52	0.55	1378	4.28	2.36	0.55	1456	3.99	2.19	0.55	1508
26	24	4.83	2.08	0.43	1430	4.54	1.95	0.43	1495	4.28	1.84	0.43	1560
26	26	5.08	1.58	0.31	1482	4.79	1.48	0.31	1547	4.49	1.39	0.31	1612
27	18	4.12	3.42	0.83	1274	3.78	3.14	0.83	1352	3.49	2.89	0.83	1404
27	20	4.33	3.07	0.71	1326	4.03	2.86	0.71	1391	3.74	2.65	0.71	1469
27	22	4.58	2.70	0.59	1378	4.28	2.53	0.59	1456	3.99	2.35	0.59	1508
27	24	4.83	2.27	0.47	1430	4.54	2.13	0.47	1495	4.28	2.01	0.47	1560
27	26	5.08	1.78	0.35	1482	4.79	1.68	0.35	1547	4.49	1.57	0.35	1612
28	18	4.12	3.58	0.87	1274	3.78	3.29	0.87	1352	3.49	3.03	0.87	1404
28	20	4.33	3.24	0.75	1326	4.03	3.02	0.75	1391	3.74	2.80	0.75	1469
28	22	4.58	2.88	0.63	1378	4.28	2.70	0.63	1456	3.99	2.51	0.63	1508
28	24	4.83	2.46	0.51	1430	4.54	2.31	0.51	1495	4.28	2.18	0.51	1560
28	26	5.08	1.98	0.39	1482	4.79	1.87	0.39	1547	4.49	1.75	0.39	1612
29	18	4.12	3.75	0.91	1274	3.78	3.44	0.91	1352	3.49	3.17	0.91	1404
29	20	4.33	3.42	0.79	1326	4.03	3.19	0.79	1391	3.74	2.95	0.79	1469
29	22	4.58	3.07	0.67	1378	4.28	2.87	0.67	1456	3.99	2.67	0.67	1508
29	24	4.83	2.66	0.55	1430	4.54	2.49	0.55	1495	4.28	2.36	0.55	1560
29	26	5.08	2.19	0.43	1482	4.79	2.06	0.43	1547	4.49	1.93	0.43	1612
30	18	4.12	3.91	0.95	1274	3.78	3.59	0.95	1352	3.49	3.31	0.95	1404
30	20	4.33	3.59	0.83	1326	4.03	3.35	0.83	1391	3.74	3.10	0.83	1469
30	22	4.58	3.25	0.71	1378	4.28	3.04	0.71	1456	3.99	2.83	0.71	1508
30	24	4.83	2.85	0.59	1430	4.54	2.68	0.59	1495	4.28	2.53	0.59	1560
30	26	5.08	2.39	0.47	1482	4.79	2.25	0.47	1547	4.49	2.11	0.47	1612
31	18	4.12	4.07	0.99	1274	3.78	3.74	0.99	1352	3.49	3.45	0.99	1404
31	20	4.33	3.76	0.87	1326	4.03	3.51	0.87	1391	3.74	3.25	0.87	1469
31	22	4.58	3.43	0.75	1378	4.28	3.21	0.75	1456	3.99	2.99	0.75	1508
31	24	4.83	3.04	0.63	1430	4.54	2.86	0.63	1495	4.28	2.70	0.63	1560
31	26	5.08	2.59	0.51	1482	4.79	2.44	0.51	1547	4.49	2.29	0.51	1612
32	18	4.12	4.12	1.00	1274	3.78	3.78	1.00	1352	3.49	3.49	1.00	1404
32	20	4.33	3.94	0.91	1326	4.03	3.67	0.91	1391	3.74	3.40	0.91	1469
32	22	4.58	3.62	0.79	1378	4.28	3.38	0.79	1456	3.99	3.15	0.79	1508
32	24	4.83	3.24	0.67	1430	4.54	3.04	0.67	1495	4.28	2.87	0.67	1560
32	26	5.08	2.80	0.55	1482	4.79	2.63	0.55	1547	4.49	2.47	0.55	1612

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP50VG, MSZ-AP50VGK: MUZ-AP50VG, MUZ-AP50VGH
 CAPACITY: 5.0 kW SHF: 0.74 INPUT: 1550 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.88	3.29	0.56	1240	5.63	3.15	0.56	1302	5.40	3.02	0.56	1364	5.20	2.91	0.56	1426
21	20	6.13	2.70	0.44	1302	5.88	2.59	0.44	1380	5.70	2.51	0.44	1411	5.50	2.42	0.44	1473
22	18	5.88	3.53	0.60	1240	5.63	3.38	0.60	1302	5.40	3.24	0.60	1364	5.20	3.12	0.60	1426
22	20	6.13	2.94	0.48	1302	5.88	2.82	0.48	1380	5.70	2.74	0.48	1411	5.50	2.64	0.48	1473
22	22	6.38	2.30	0.36	1349	6.15	2.21	0.36	1434	6.00	2.16	0.36	1473	5.75	2.07	0.36	1535
23	18	5.88	3.76	0.64	1240	5.63	3.60	0.64	1302	5.40	3.46	0.64	1364	5.20	3.33	0.64	1426
23	20	6.13	3.19	0.52	1302	5.88	3.06	0.52	1380	5.70	2.96	0.52	1411	5.50	2.86	0.52	1473
23	22	6.38	2.55	0.40	1349	6.15	2.46	0.40	1434	6.00	2.40	0.40	1473	5.75	2.30	0.40	1535
24	18	5.88	4.00	0.68	1240	5.63	3.83	0.68	1302	5.40	3.67	0.68	1364	5.20	3.54	0.68	1426
24	20	6.13	3.43	0.56	1302	5.88	3.29	0.56	1380	5.70	3.19	0.56	1411	5.50	3.08	0.56	1473
24	22	6.38	2.81	0.44	1349	6.15	2.71	0.44	1434	6.00	2.64	0.44	1473	5.75	2.53	0.44	1535
24	24	6.70	2.14	0.32	1411	6.45	2.06	0.32	1488	6.30	2.02	0.32	1535	6.10	1.95	0.32	1612
25	18	5.88	4.23	0.72	1240	5.63	4.05	0.72	1302	5.40	3.89	0.72	1364	5.20	3.74	0.72	1426
25	20	6.13	3.68	0.60	1302	5.88	3.53	0.60	1380	5.70	3.42	0.60	1411	5.50	3.30	0.60	1473
25	22	6.38	3.06	0.48	1349	6.15	2.95	0.48	1434	6.00	2.88	0.48	1473	5.75	2.76	0.48	1535
25	24	6.70	2.41	0.36	1411	6.45	2.32	0.36	1488	6.30	2.27	0.36	1535	6.10	2.20	0.36	1612
26	18	5.88	4.47	0.76	1240	5.63	4.28	0.76	1302	5.40	4.10	0.76	1364	5.20	3.95	0.76	1426
26	20	6.13	3.92	0.64	1302	5.88	3.76	0.64	1380	5.70	3.65	0.64	1411	5.50	3.52	0.64	1473
26	22	6.38	3.32	0.52	1349	6.15	3.20	0.52	1434	6.00	3.12	0.52	1473	5.75	2.99	0.52	1535
26	24	6.70	2.68	0.40	1411	6.45	2.58	0.40	1488	6.30	2.52	0.40	1535	6.10	2.44	0.40	1612
26	26	6.90	1.93	0.28	1488	6.70	1.88	0.28	1566	6.60	1.85	0.28	1612	6.40	1.79	0.28	1659
27	18	5.88	4.70	0.80	1240	5.63	4.50	0.80	1302	5.40	4.32	0.80	1364	5.20	4.16	0.80	1426
27	20	6.13	4.17	0.68	1302	5.88	4.00	0.68	1380	5.70	3.88	0.68	1411	5.50	3.74	0.68	1473
27	22	6.38	3.57	0.56	1349	6.15	3.44	0.56	1434	6.00	3.36	0.56	1473	5.75	3.22	0.56	1535
27	24	6.70	2.95	0.44	1411	6.45	2.84	0.44	1488	6.30	2.77	0.44	1535	6.10	2.68	0.44	1612
27	26	6.90	2.21	0.32	1488	6.70	2.14	0.32	1566	6.60	2.11	0.32	1612	6.40	2.05	0.32	1659
28	18	5.88	4.94	0.84	1240	5.63	4.73	0.84	1302	5.40	4.54	0.84	1364	5.20	4.37	0.84	1426
28	20	6.13	4.41	0.72	1302	5.88	4.23	0.72	1380	5.70	4.10	0.72	1411	5.50	3.96	0.72	1473
28	22	6.38	3.83	0.60	1349	6.15	3.69	0.60	1434	6.00	3.60	0.60	1473	5.75	3.45	0.60	1535
28	24	6.70	3.22	0.48	1411	6.45	3.10	0.48	1488	6.30	3.02	0.48	1535	6.10	2.93	0.48	1612
28	26	6.90	2.48	0.36	1488	6.70	2.41	0.36	1566	6.60	2.38	0.36	1612	6.40	2.30	0.36	1659
29	18	5.88	5.17	0.88	1240	5.63	4.95	0.88	1302	5.40	4.75	0.88	1364	5.20	4.58	0.88	1426
29	20	6.13	4.66	0.76	1302	5.88	4.47	0.76	1380	5.70	4.33	0.76	1411	5.50	4.18	0.76	1473
29	22	6.38	4.08	0.64	1349	6.15	3.94	0.64	1434	6.00	3.84	0.64	1473	5.75	3.68	0.64	1535
29	24	6.70	3.48	0.52	1411	6.45	3.35	0.52	1488	6.30	3.28	0.52	1535	6.10	3.17	0.52	1612
29	26	6.90	2.76	0.40	1488	6.70	2.68	0.40	1566	6.60	2.64	0.40	1612	6.40	2.56	0.40	1659
30	18	5.88	5.41	0.92	1240	5.63	5.18	0.92	1302	5.40	4.97	0.92	1364	5.20	4.78	0.92	1426
30	20	6.13	4.90	0.80	1302	5.88	4.70	0.80	1380	5.70	4.56	0.80	1411	5.50	4.40	0.80	1473
30	22	6.38	4.34	0.68	1349	6.15	4.18	0.68	1434	6.00	4.08	0.68	1473	5.75	3.91	0.68	1535
30	24	6.70	3.75	0.56	1411	6.45	3.61	0.56	1488	6.30	3.53	0.56	1535	6.10	3.42	0.56	1612
30	26	6.90	3.04	0.44	1488	6.70	2.95	0.44	1566	6.60	2.90	0.44	1612	6.40	2.82	0.44	1659
31	18	5.88	5.64	0.96	1240	5.63	5.40	0.96	1302	5.40	5.18	0.96	1364	5.20	4.99	0.96	1426
31	20	6.13	5.15	0.84	1302	5.88	4.94	0.84	1380	5.70	4.79	0.84	1411	5.50	4.62	0.84	1473
31	22	6.38	4.59	0.72	1349	6.15	4.43	0.72	1434	6.00	4.32	0.72	1473	5.75	4.14	0.72	1535
31	24	6.70	4.02	0.60	1411	6.45	3.87	0.60	1488	6.30	3.78	0.60	1535	6.10	3.66	0.60	1612
31	26	6.90	3.31	0.48	1488	6.70	3.22	0.48	1566	6.60	3.17	0.48	1612	6.40	3.07	0.48	1659
32	18	5.88	5.88	1.00	1240	5.63	5.63	1.00	1302	5.40	5.40	1.00	1364	5.20	5.20	1.00	1426
32	20	6.13	5.39	0.88	1302	5.88	5.17	0.88	1380	5.70	5.02	0.88	1411	5.50	4.84	0.88	1473
32	22	6.38	4.85	0.76	1349	6.15	4.67	0.76	1434	6.00	4.56	0.76	1473	5.75	4.37	0.76	1535
32	24	6.70	4.29	0.64	1411	6.45	4.13	0.64	1488	6.30	4.03	0.64	1535	6.10	3.90	0.64	1612
32	26	6.90	3.59	0.52	1488	6.70	3.48	0.52	1566	6.60	3.43	0.52	1612	6.40	3.33	0.52	1659

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP50VG, MSZ-AP50VGK: MUZ-AP50VG, MUZ-AP50VGH
 CAPACITY: 5.0 kW SHF: 0.74 INPUT: 1550 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.74	0.56	1519	4.50	2.52	0.56	1612	4.15	2.32	0.56	1674
21	20	5.15	2.27	0.44	1581	4.80	2.11	0.44	1659	4.45	1.96	0.44	1752
22	18	4.90	2.94	0.60	1519	4.50	2.70	0.60	1612	4.15	2.49	0.60	1674
22	20	5.15	2.47	0.48	1581	4.80	2.30	0.48	1659	4.45	2.14	0.48	1752
22	22	5.45	1.96	0.36	1643	5.10	1.84	0.36	1736	4.75	1.71	0.36	1798
23	18	4.90	3.14	0.64	1519	4.50	2.88	0.64	1612	4.15	2.66	0.64	1674
23	20	5.15	2.68	0.52	1581	4.80	2.50	0.52	1659	4.45	2.31	0.52	1752
23	22	5.45	2.18	0.40	1643	5.10	2.04	0.40	1736	4.75	1.90	0.40	1798
24	18	4.90	3.33	0.68	1519	4.50	3.06	0.68	1612	4.15	2.82	0.68	1674
24	20	5.15	2.88	0.56	1581	4.80	2.69	0.56	1659	4.45	2.49	0.56	1752
24	22	5.45	2.40	0.44	1643	5.10	2.24	0.44	1736	4.75	2.09	0.44	1798
24	24	5.75	1.84	0.32	1705	5.40	1.73	0.32	1783	5.10	1.63	0.32	1860
25	18	4.90	3.53	0.72	1519	4.50	3.24	0.72	1612	4.15	2.99	0.72	1674
25	20	5.15	3.09	0.60	1581	4.80	2.88	0.60	1659	4.45	2.67	0.60	1752
25	22	5.45	2.62	0.48	1643	5.10	2.45	0.48	1736	4.75	2.28	0.48	1798
25	24	5.75	2.07	0.36	1705	5.40	1.94	0.36	1783	5.10	1.84	0.36	1860
26	18	4.90	3.72	0.76	1519	4.50	3.42	0.76	1612	4.15	3.15	0.76	1674
26	20	5.15	3.30	0.64	1581	4.80	3.07	0.64	1659	4.45	2.85	0.64	1752
26	22	5.45	2.83	0.52	1643	5.10	2.65	0.52	1736	4.75	2.47	0.52	1798
26	24	5.75	2.30	0.40	1705	5.40	2.16	0.40	1783	5.10	2.04	0.40	1860
26	26	6.05	1.69	0.28	1767	5.70	1.60	0.28	1845	5.35	1.50	0.28	1922
27	18	4.90	3.92	0.80	1519	4.50	3.60	0.80	1612	4.15	3.32	0.80	1674
27	20	5.15	3.50	0.68	1581	4.80	3.26	0.68	1659	4.45	3.03	0.68	1752
27	22	5.45	3.05	0.56	1643	5.10	2.86	0.56	1736	4.75	2.66	0.56	1798
27	24	5.75	2.53	0.44	1705	5.40	2.38	0.44	1783	5.10	2.24	0.44	1860
27	26	6.05	1.94	0.32	1767	5.70	1.82	0.32	1845	5.35	1.71	0.32	1922
28	18	4.90	4.12	0.84	1519	4.50	3.78	0.84	1612	4.15	3.49	0.84	1674
28	20	5.15	3.71	0.72	1581	4.80	3.46	0.72	1659	4.45	3.20	0.72	1752
28	22	5.45	3.27	0.60	1643	5.10	3.06	0.60	1736	4.75	2.85	0.60	1798
28	24	5.75	2.76	0.48	1705	5.40	2.59	0.48	1783	5.10	2.45	0.48	1860
28	26	6.05	2.18	0.36	1767	5.70	2.05	0.36	1845	5.35	1.93	0.36	1922
29	18	4.90	4.31	0.88	1519	4.50	3.96	0.88	1612	4.15	3.65	0.88	1674
29	20	5.15	3.91	0.76	1581	4.80	3.65	0.76	1659	4.45	3.38	0.76	1752
29	22	5.45	3.49	0.64	1643	5.10	3.26	0.64	1736	4.75	3.04	0.64	1798
29	24	5.75	2.99	0.52	1705	5.40	2.81	0.52	1783	5.10	2.65	0.52	1860
29	26	6.05	2.42	0.40	1767	5.70	2.28	0.40	1845	5.35	2.14	0.40	1922
30	18	4.90	4.51	0.92	1519	4.50	4.14	0.92	1612	4.15	3.82	0.92	1674
30	20	5.15	4.12	0.80	1581	4.80	3.84	0.80	1659	4.45	3.56	0.80	1752
30	22	5.45	3.71	0.68	1643	5.10	3.47	0.68	1736	4.75	3.23	0.68	1798
30	24	5.75	3.22	0.56	1705	5.40	3.02	0.56	1783	5.10	2.86	0.56	1860
30	26	6.05	2.66	0.44	1767	5.70	2.51	0.44	1845	5.35	2.35	0.44	1922
31	18	4.90	4.70	0.96	1519	4.50	4.32	0.96	1612	4.15	3.98	0.96	1674
31	20	5.15	4.33	0.84	1581	4.80	4.03	0.84	1659	4.45	3.74	0.84	1752
31	22	5.45	3.92	0.72	1643	5.10	3.67	0.72	1736	4.75	3.42	0.72	1798
31	24	5.75	3.45	0.60	1705	5.40	3.24	0.60	1783	5.10	3.06	0.60	1860
31	26	6.05	2.90	0.48	1767	5.70	2.74	0.48	1845	5.35	2.57	0.48	1922
32	18	4.90	4.90	1.00	1519	4.50	4.50	1.00	1612	4.15	4.15	1.00	1674
32	20	5.15	4.53	0.88	1581	4.80	4.22	0.88	1659	4.45	3.92	0.88	1752
32	22	5.45	4.14	0.76	1643	5.10	3.88	0.76	1736	4.75	3.61	0.76	1798
32	24	5.75	3.68	0.64	1705	5.40	3.46	0.64	1783	5.10	3.26	0.64	1860
32	26	6.05	3.15	0.52	1767	5.70	2.96	0.52	1845	5.35	2.78	0.52	1922

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-AP60VG, MSZ-AP60VGK: MUZ-AP60VG

CAPACITY: 6.1 kW SHF: 0.83 INPUT: 1590 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	7.17	4.66	0.65	1272	6.86	4.46	0.65	1336	6.59	4.28	0.65	1399	6.34	4.12	0.65	1463
21	20	7.47	3.96	0.53	1336	7.17	3.80	0.53	1415	6.95	3.69	0.53	1447	6.71	3.56	0.53	1511
22	18	7.17	4.95	0.69	1272	6.86	4.74	0.69	1336	6.59	4.55	0.69	1399	6.34	4.38	0.69	1463
22	20	7.47	4.26	0.57	1336	7.17	4.09	0.57	1415	6.95	3.96	0.57	1447	6.71	3.82	0.57	1511
22	22	7.78	3.50	0.45	1383	7.50	3.38	0.45	1471	7.32	3.29	0.45	1511	7.02	3.16	0.45	1574
23	18	7.17	5.23	0.73	1272	6.86	5.01	0.73	1336	6.59	4.81	0.73	1399	6.34	4.63	0.73	1463
23	20	7.47	4.56	0.61	1336	7.17	4.37	0.61	1415	6.95	4.24	0.61	1447	6.71	4.09	0.61	1511
23	22	7.78	3.81	0.49	1383	7.50	3.68	0.49	1471	7.32	3.59	0.49	1511	7.02	3.44	0.49	1574
24	18	7.17	5.52	0.77	1272	6.86	5.28	0.77	1336	6.59	5.07	0.77	1399	6.34	4.88	0.77	1463
24	20	7.47	4.86	0.65	1336	7.17	4.66	0.65	1415	6.95	4.52	0.65	1447	6.71	4.36	0.65	1511
24	22	7.78	4.12	0.53	1383	7.50	3.98	0.53	1471	7.32	3.88	0.53	1511	7.02	3.72	0.53	1574
24	24	8.17	3.35	0.41	1447	7.87	3.23	0.41	1526	7.69	3.15	0.41	1574	7.44	3.05	0.41	1654
25	18	7.17	5.81	0.81	1272	6.86	5.56	0.81	1336	6.59	5.34	0.81	1399	6.34	5.14	0.81	1463
25	20	7.47	5.16	0.69	1336	7.17	4.95	0.69	1415	6.95	4.80	0.69	1447	6.71	4.63	0.69	1511
25	22	7.78	4.43	0.57	1383	7.50	4.28	0.57	1471	7.32	4.17	0.57	1511	7.02	4.00	0.57	1574
25	24	8.17	3.68	0.45	1447	7.87	3.54	0.45	1526	7.69	3.46	0.45	1574	7.44	3.35	0.45	1654
26	18	7.17	6.09	0.85	1272	6.86	5.83	0.85	1336	6.59	5.60	0.85	1399	6.34	5.39	0.85	1463
26	20	7.47	5.45	0.73	1336	7.17	5.23	0.73	1415	6.95	5.08	0.73	1447	6.71	4.90	0.73	1511
26	22	7.78	4.74	0.61	1383	7.50	4.58	0.61	1471	7.32	4.47	0.61	1511	7.02	4.28	0.61	1574
26	24	8.17	4.01	0.49	1447	7.87	3.86	0.49	1526	7.69	3.77	0.49	1574	7.44	3.65	0.49	1654
26	26	8.42	3.11	0.37	1526	8.17	3.02	0.37	1606	8.05	2.98	0.37	1654	7.81	2.89	0.37	1701
27	18	7.17	6.38	0.89	1272	6.86	6.11	0.89	1336	6.59	5.86	0.89	1399	6.34	5.65	0.89	1463
27	20	7.47	5.75	0.77	1336	7.17	5.52	0.77	1415	6.95	5.35	0.77	1447	6.71	5.17	0.77	1511
27	22	7.78	5.06	0.65	1383	7.50	4.88	0.65	1471	7.32	4.76	0.65	1511	7.02	4.56	0.65	1574
27	24	8.17	4.33	0.53	1447	7.87	4.17	0.53	1526	7.69	4.07	0.53	1574	7.44	3.94	0.53	1654
27	26	8.42	3.45	0.41	1526	8.17	3.35	0.41	1606	8.05	3.30	0.41	1654	7.81	3.20	0.41	1701
28	18	7.17	6.67	0.93	1272	6.86	6.38	0.93	1336	6.59	6.13	0.93	1399	6.34	5.90	0.93	1463
28	20	7.47	6.05	0.81	1336	7.17	5.81	0.81	1415	6.95	5.63	0.81	1447	6.71	5.44	0.81	1511
28	22	7.78	5.37	0.69	1383	7.50	5.18	0.69	1471	7.32	5.05	0.69	1511	7.02	4.84	0.69	1574
28	24	8.17	4.66	0.57	1447	7.87	4.49	0.57	1526	7.69	4.38	0.57	1574	7.44	4.24	0.57	1654
28	26	8.42	3.79	0.45	1526	8.17	3.68	0.45	1606	8.05	3.62	0.45	1654	7.81	3.51	0.45	1701
29	18	7.17	6.95	0.97	1272	6.86	6.66	0.97	1336	6.59	6.39	0.97	1399	6.34	6.15	0.97	1463
29	20	7.47	6.35	0.85	1336	7.17	6.09	0.85	1415	6.95	5.91	0.85	1447	6.71	5.70	0.85	1511
29	22	7.78	5.68	0.73	1383	7.50	5.48	0.73	1471	7.32	5.34	0.73	1511	7.02	5.12	0.73	1574
29	24	8.17	4.99	0.61	1447	7.87	4.80	0.61	1526	7.69	4.69	0.61	1574	7.44	4.54	0.61	1654
29	26	8.42	4.12	0.49	1526	8.17	4.01	0.49	1606	8.05	3.95	0.49	1654	7.81	3.83	0.49	1701
30	18	7.17	7.17	1.00	1272	6.86	6.86	1.00	1336	6.59	6.59	1.00	1399	6.34	6.34	1.00	1463
30	20	7.47	6.65	0.89	1336	7.17	6.38	0.89	1415	6.95	6.19	0.89	1447	6.71	5.97	0.89	1511
30	22	7.78	5.99	0.77	1383	7.50	5.78	0.77	1471	7.32	5.64	0.77	1511	7.02	5.40	0.77	1574
30	24	8.17	5.31	0.65	1447	7.87	5.11	0.65	1526	7.69	5.00	0.65	1574	7.44	4.84	0.65	1654
30	26	8.42	4.46	0.53	1526	8.17	4.33	0.53	1606	8.05	4.27	0.53	1654	7.81	4.14	0.53	1701
31	18	7.17	7.17	1.00	1272	6.86	6.86	1.00	1336	6.59	6.59	1.00	1399	6.34	6.34	1.00	1463
31	20	7.47	6.95	0.93	1336	7.17	6.67	0.93	1415	6.95	6.47	0.93	1447	6.71	6.24	0.93	1511
31	22	7.78	6.30	0.81	1383	7.50	6.08	0.81	1471	7.32	5.93	0.81	1511	7.02	5.68	0.81	1574
31	24	8.17	5.64	0.69	1447	7.87	5.43	0.69	1526	7.69	5.30	0.69	1574	7.44	5.13	0.69	1654
31	26	8.42	4.80	0.57	1526	8.17	4.66	0.57	1606	8.05	4.59	0.57	1654	7.81	4.45	0.57	1701
32	18	7.17	7.17	1.00	1272	6.86	6.86	1.00	1336	6.59	6.59	1.00	1399	6.34	6.34	1.00	1463
32	20	7.47	7.25	0.97	1336	7.17	6.95	0.97	1415	6.95	6.75	0.97	1447	6.71	6.51	0.97	1511
32	22	7.78	6.61	0.85	1383	7.50	6.38	0.85	1471	7.32	6.22	0.85	1511	7.02	5.96	0.85	1574
32	24	8.17	5.97	0.73	1447	7.87	5.74	0.73	1526	7.69	5.61	0.73	1574	7.44	5.43	0.73	1654
32	26	8.42	5.13	0.61	1526	8.17	4.99	0.61	1606	8.05	4.91	0.61	1654	7.81	4.76	0.61	1701

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-AP60VG, MSZ-AP60VGK: MUZ-AP60VG

CAPACITY: 6.1 kW SHF: 0.83 INPUT: 1590 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.98	3.89	0.65	1558	5.49	3.57	0.65	1654	5.06	3.29	0.65	1717
21	20	6.28	3.33	0.53	1622	5.86	3.10	0.53	1701	5.43	2.88	0.53	1797
22	18	5.98	4.12	0.69	1558	5.49	3.79	0.69	1654	5.06	3.49	0.69	1717
22	20	6.28	3.58	0.57	1622	5.86	3.34	0.57	1701	5.43	3.09	0.57	1797
22	22	6.65	2.99	0.45	1685	6.22	2.80	0.45	1781	5.80	2.61	0.45	1844
23	18	5.98	4.36	0.73	1558	5.49	4.01	0.73	1654	5.06	3.70	0.73	1717
23	20	6.28	3.83	0.61	1622	5.86	3.57	0.61	1701	5.43	3.31	0.61	1797
23	22	6.65	3.26	0.49	1685	6.22	3.05	0.49	1781	5.80	2.84	0.49	1844
24	18	5.98	4.60	0.77	1558	5.49	4.23	0.77	1654	5.06	3.90	0.77	1717
24	20	6.28	4.08	0.65	1622	5.86	3.81	0.65	1701	5.43	3.53	0.65	1797
24	22	6.65	3.52	0.53	1685	6.22	3.30	0.53	1781	5.80	3.07	0.53	1844
24	24	7.02	2.88	0.41	1749	6.59	2.70	0.41	1829	6.22	2.55	0.41	1908
25	18	5.98	4.84	0.81	1558	5.49	4.45	0.81	1654	5.06	4.10	0.81	1717
25	20	6.28	4.34	0.69	1622	5.86	4.04	0.69	1701	5.43	3.75	0.69	1797
25	22	6.65	3.79	0.57	1685	6.22	3.55	0.57	1781	5.80	3.30	0.57	1844
25	24	7.02	3.16	0.45	1749	6.59	2.96	0.45	1829	6.22	2.80	0.45	1908
26	18	5.98	5.08	0.85	1558	5.49	4.67	0.85	1654	5.06	4.30	0.85	1717
26	20	6.28	4.59	0.73	1622	5.86	4.27	0.73	1701	5.43	3.96	0.73	1797
26	22	6.65	4.06	0.61	1685	6.22	3.80	0.61	1781	5.80	3.53	0.61	1844
26	24	7.02	3.44	0.49	1749	6.59	3.23	0.49	1829	6.22	3.05	0.49	1908
26	26	7.38	2.73	0.37	1813	6.95	2.57	0.37	1892	6.53	2.41	0.37	1972
27	18	5.98	5.32	0.89	1558	5.49	4.89	0.89	1654	5.06	4.51	0.89	1717
27	20	6.28	4.84	0.77	1622	5.86	4.51	0.77	1701	5.43	4.18	0.77	1797
27	22	6.65	4.32	0.65	1685	6.22	4.04	0.65	1781	5.80	3.77	0.65	1844
27	24	7.02	3.72	0.53	1749	6.59	3.49	0.53	1829	6.22	3.30	0.53	1908
27	26	7.38	3.03	0.41	1813	6.95	2.85	0.41	1892	6.53	2.68	0.41	1972
28	18	5.98	5.56	0.93	1558	5.49	5.11	0.93	1654	5.06	4.71	0.93	1717
28	20	6.28	5.09	0.81	1622	5.86	4.74	0.81	1701	5.43	4.40	0.81	1797
28	22	6.65	4.59	0.69	1685	6.22	4.29	0.69	1781	5.80	4.00	0.69	1844
28	24	7.02	4.00	0.57	1749	6.59	3.76	0.57	1829	6.22	3.55	0.57	1908
28	26	7.38	3.32	0.45	1813	6.95	3.13	0.45	1892	6.53	2.94	0.45	1972
29	18	5.98	5.80	0.97	1558	5.49	5.33	0.97	1654	5.06	4.91	0.97	1717
29	20	6.28	5.34	0.85	1622	5.86	4.98	0.85	1701	5.43	4.61	0.85	1797
29	22	6.65	4.85	0.73	1685	6.22	4.54	0.73	1781	5.80	4.23	0.73	1844
29	24	7.02	4.28	0.61	1749	6.59	4.02	0.61	1829	6.22	3.80	0.61	1908
29	26	7.38	3.62	0.49	1813	6.95	3.41	0.49	1892	6.53	3.20	0.49	1972
30	18	5.98	5.98	1.00	1558	5.49	5.49	1.00	1654	5.06	5.06	1.00	1717
30	20	6.28	5.59	0.89	1622	5.86	5.21	0.89	1701	5.43	4.83	0.89	1797
30	22	6.65	5.12	0.77	1685	6.22	4.79	0.77	1781	5.80	4.46	0.77	1844
30	24	7.02	4.56	0.65	1749	6.59	4.28	0.65	1829	6.22	4.04	0.65	1908
30	26	7.38	3.91	0.53	1813	6.95	3.69	0.53	1892	6.53	3.46	0.53	1972
31	18	5.98	5.98	1.00	1558	5.49	5.49	1.00	1654	5.06	5.06	1.00	1717
31	20	6.28	5.84	0.93	1622	5.86	5.45	0.93	1701	5.43	5.05	0.93	1797
31	22	6.65	5.39	0.81	1685	6.22	5.04	0.81	1781	5.80	4.69	0.81	1844
31	24	7.02	4.84	0.69	1749	6.59	4.55	0.69	1829	6.22	4.29	0.69	1908
31	26	7.38	4.21	0.57	1813	6.95	3.96	0.57	1892	6.53	3.72	0.57	1972
32	18	5.98	5.98	1.00	1558	5.49	5.49	1.00	1654	5.06	5.06	1.00	1717
32	20	6.28	6.09	0.97	1622	5.86	5.68	0.97	1701	5.43	5.27	0.97	1797
32	22	6.65	5.65	0.85	1685	6.22	5.29	0.85	1781	5.80	4.93	0.85	1844
32	24	7.02	5.12	0.73	1749	6.59	4.81	0.73	1829	6.22	4.54	0.73	1908
32	26	7.38	4.50	0.61	1813	6.95	4.24	0.61	1892	6.53	3.98	0.61	1972

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA WALL-MOUNTED

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP71VG, MSZ-AP71VGK: MUZ-AP71VG

CAPACITY: 7.1 kW SHF: 0.77 INPUT: 2010 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	8.34	4.92	0.59	1608	7.99	4.71	0.59	1688	7.67	4.52	0.59	1769	7.38	4.36	0.59	1849
21	20	8.70	4.09	0.47	1688	8.34	3.92	0.47	1789	8.09	3.80	0.47	1829	7.81	3.67	0.47	1910
22	18	8.34	5.26	0.63	1608	7.99	5.03	0.63	1688	7.67	4.83	0.63	1769	7.38	4.65	0.63	1849
22	20	8.70	4.44	0.51	1688	8.34	4.25	0.51	1789	8.09	4.13	0.51	1829	7.81	3.98	0.51	1910
22	22	9.05	3.53	0.39	1749	8.73	3.41	0.39	1859	8.52	3.32	0.39	1910	8.17	3.18	0.39	1990
23	18	8.34	5.59	0.67	1608	7.99	5.35	0.67	1688	7.67	5.14	0.67	1769	7.38	4.95	0.67	1849
23	20	8.70	4.78	0.55	1688	8.34	4.59	0.55	1789	8.09	4.45	0.55	1829	7.81	4.30	0.55	1910
23	22	9.05	3.89	0.43	1749	8.73	3.76	0.43	1859	8.52	3.66	0.43	1910	8.17	3.51	0.43	1990
24	18	8.34	5.92	0.71	1608	7.99	5.67	0.71	1688	7.67	5.44	0.71	1769	7.38	5.24	0.71	1849
24	20	8.70	5.13	0.59	1688	8.34	4.92	0.59	1789	8.09	4.78	0.59	1829	7.81	4.61	0.59	1910
24	22	9.05	4.25	0.47	1749	8.73	4.10	0.47	1859	8.52	4.00	0.47	1910	8.17	3.84	0.47	1990
24	24	9.51	3.33	0.35	1829	9.16	3.21	0.35	1930	8.95	3.13	0.35	1990	8.66	3.03	0.35	2090
25	18	8.34	6.26	0.75	1608	7.99	5.99	0.75	1688	7.67	5.75	0.75	1769	7.38	5.54	0.75	1849
25	20	8.70	5.48	0.63	1688	8.34	5.26	0.63	1789	8.09	5.10	0.63	1829	7.81	4.92	0.63	1910
25	22	9.05	4.62	0.51	1749	8.73	4.45	0.51	1859	8.52	4.35	0.51	1910	8.17	4.16	0.51	1990
25	24	9.51	3.71	0.39	1829	9.16	3.57	0.39	1930	8.95	3.49	0.39	1990	8.66	3.38	0.39	2090
26	18	8.34	6.59	0.79	1608	7.99	6.31	0.79	1688	7.67	6.06	0.79	1769	7.38	5.83	0.79	1849
26	20	8.70	5.83	0.67	1688	8.34	5.59	0.67	1789	8.09	5.42	0.67	1829	7.81	5.23	0.67	1910
26	22	9.05	4.98	0.55	1749	8.73	4.80	0.55	1859	8.52	4.69	0.55	1910	8.17	4.49	0.55	1990
26	24	9.51	4.09	0.43	1829	9.16	3.94	0.43	1930	8.95	3.85	0.43	1990	8.66	3.72	0.43	2090
26	26	9.80	3.04	0.31	1930	9.51	2.95	0.31	2030	9.37	2.91	0.31	2090	9.09	2.82	0.31	2151
27	18	8.34	6.92	0.83	1608	7.99	6.63	0.83	1688	7.67	6.36	0.83	1769	7.38	6.13	0.83	1849
27	20	8.70	6.18	0.71	1688	8.34	5.92	0.71	1789	8.09	5.75	0.71	1829	7.81	5.55	0.71	1910
27	22	9.05	5.34	0.59	1749	8.73	5.15	0.59	1859	8.52	5.03	0.59	1910	8.17	4.82	0.59	1990
27	24	9.51	4.47	0.47	1829	9.16	4.30	0.47	1930	8.95	4.20	0.47	1990	8.66	4.07	0.47	2090
27	26	9.80	3.43	0.35	1930	9.51	3.33	0.35	2030	9.37	3.28	0.35	2090	9.09	3.18	0.35	2151
28	18	8.34	7.26	0.87	1608	7.99	6.95	0.87	1688	7.67	6.67	0.87	1769	7.38	6.42	0.87	1849
28	20	8.70	6.52	0.75	1688	8.34	6.26	0.75	1789	8.09	6.07	0.75	1829	7.81	5.86	0.75	1910
28	22	9.05	5.70	0.63	1749	8.73	5.50	0.63	1859	8.52	5.37	0.63	1910	8.17	5.14	0.63	1990
28	24	9.51	4.85	0.51	1829	9.16	4.67	0.51	1930	8.95	4.56	0.51	1990	8.66	4.42	0.51	2090
28	26	9.80	3.82	0.39	1930	9.51	3.71	0.39	2030	9.37	3.66	0.39	2090	9.09	3.54	0.39	2151
29	18	8.34	7.59	0.91	1608	7.99	7.27	0.91	1688	7.67	6.98	0.91	1769	7.38	6.72	0.91	1849
29	20	8.70	6.87	0.79	1688	8.34	6.59	0.79	1789	8.09	6.39	0.79	1829	7.81	6.17	0.79	1910
29	22	9.05	6.07	0.67	1749	8.73	5.85	0.67	1859	8.52	5.71	0.67	1910	8.17	5.47	0.67	1990
29	24	9.51	5.23	0.55	1829	9.16	5.04	0.55	1930	8.95	4.92	0.55	1990	8.66	4.76	0.55	2090
29	26	9.80	4.21	0.43	1930	9.51	4.09	0.43	2030	9.37	4.03	0.43	2090	9.09	3.91	0.43	2151
30	18	8.34	7.93	0.95	1608	7.99	7.59	0.95	1688	7.67	7.28	0.95	1769	7.38	7.01	0.95	1849
30	20	8.70	7.22	0.83	1688	8.34	6.92	0.83	1789	8.09	6.72	0.83	1829	7.81	6.48	0.83	1910
30	22	9.05	6.43	0.71	1749	8.73	6.20	0.71	1859	8.52	6.05	0.71	1910	8.17	5.80	0.71	1990
30	24	9.51	5.61	0.59	1829	9.16	5.40	0.59	1930	8.95	5.28	0.59	1990	8.66	5.11	0.59	2090
30	26	9.80	4.61	0.47	1930	9.51	4.47	0.47	2030	9.37	4.40	0.47	2090	9.09	4.27	0.47	2151
31	18	8.34	8.26	0.99	1608	7.99	7.91	0.99	1688	7.67	7.59	0.99	1769	7.38	7.31	0.99	1849
31	20	8.70	7.57	0.87	1688	8.34	7.26	0.87	1789	8.09	7.04	0.87	1829	7.81	6.79	0.87	1910
31	22	9.05	6.79	0.75	1749	8.73	6.55	0.75	1859	8.52	6.39	0.75	1910	8.17	6.12	0.75	1990
31	24	9.51	5.99	0.63	1829	9.16	5.77	0.63	1930	8.95	5.64	0.63	1990	8.66	5.46	0.63	2090
31	26	9.80	5.00	0.51	1930	9.51	4.85	0.51	2030	9.37	4.78	0.51	2090	9.09	4.63	0.51	2151
32	18	8.34	8.34	1.00	1608	7.99	7.99	1.00	1688	7.67	7.67	1.00	1769	7.38	7.38	1.00	1849
32	20	8.70	7.91	0.91	1688	8.34	7.59	0.91	1789	8.09	7.37	0.91	1829	7.81	7.11	0.91	1910
32	22	9.05	7.15	0.79	1749	8.73	6.90	0.79	1859	8.52	6.73	0.79	1910	8.17	6.45	0.79	1990
32	24	9.51	6.37	0.67	1829	9.16	6.14	0.67	1930	8.95	5.99	0.67	1990	8.66	5.80	0.67	2090
32	26	9.80	5.39	0.55	1930	9.51	5.23	0.55	2030	9.37	5.15	0.55	2090	9.09	5.00	0.55	2151

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSZ-AP71VG, MSZ-AP71VGK: MUZ-AP71VG

CAPACITY: 7.1 kW SHF: 0.77 INPUT: 2010 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	6.96	4.11	0.59	1970	6.39	3.77	0.59	2090	5.89	3.48	0.59	2171
21	20	7.31	3.44	0.47	2050	6.82	3.20	0.47	2151	6.32	2.97	0.47	2271
22	18	6.96	4.38	0.63	1970	6.39	4.03	0.63	2090	5.89	3.71	0.63	2171
22	20	7.31	3.73	0.51	2050	6.82	3.48	0.51	2151	6.32	3.22	0.51	2271
22	22	7.74	3.02	0.39	2131	7.24	2.82	0.39	2251	6.75	2.63	0.39	2332
23	18	6.96	4.66	0.67	1970	6.39	4.28	0.67	2090	5.89	3.95	0.67	2171
23	20	7.31	4.02	0.55	2050	6.82	3.75	0.55	2151	6.32	3.48	0.55	2271
23	22	7.74	3.33	0.43	2131	7.24	3.11	0.43	2251	6.75	2.90	0.43	2332
24	18	6.96	4.94	0.71	1970	6.39	4.54	0.71	2090	5.89	4.18	0.71	2171
24	20	7.31	4.31	0.59	2050	6.82	4.02	0.59	2151	6.32	3.73	0.59	2271
24	22	7.74	3.64	0.47	2131	7.24	3.40	0.47	2251	6.75	3.17	0.47	2332
24	24	8.17	2.86	0.35	2211	7.67	2.68	0.35	2312	7.24	2.53	0.35	2412
25	18	6.96	5.22	0.75	1970	6.39	4.79	0.75	2090	5.89	4.42	0.75	2171
25	20	7.31	4.61	0.63	2050	6.82	4.29	0.63	2151	6.32	3.98	0.63	2271
25	22	7.74	3.95	0.51	2131	7.24	3.69	0.51	2251	6.75	3.44	0.51	2332
25	24	8.17	3.18	0.39	2211	7.67	2.99	0.39	2312	7.24	2.82	0.39	2412
26	18	6.96	5.50	0.79	1970	6.39	5.05	0.79	2090	5.89	4.66	0.79	2171
26	20	7.31	4.90	0.67	2050	6.82	4.57	0.67	2151	6.32	4.23	0.67	2271
26	22	7.74	4.26	0.55	2131	7.24	3.98	0.55	2251	6.75	3.71	0.55	2332
26	24	8.17	3.51	0.43	2211	7.67	3.30	0.43	2312	7.24	3.11	0.43	2412
26	26	8.59	2.66	0.31	2291	8.09	2.51	0.31	2392	7.60	2.36	0.31	2492
27	18	6.96	5.78	0.83	1970	6.39	5.30	0.83	2090	5.89	4.89	0.83	2171
27	20	7.31	5.19	0.71	2050	6.82	4.84	0.71	2151	6.32	4.49	0.71	2271
27	22	7.74	4.57	0.59	2131	7.24	4.27	0.59	2251	6.75	3.98	0.59	2332
27	24	8.17	3.84	0.47	2211	7.67	3.60	0.47	2312	7.24	3.40	0.47	2412
27	26	8.59	3.01	0.35	2291	8.09	2.83	0.35	2392	7.60	2.66	0.35	2492
28	18	6.96	6.05	0.87	1970	6.39	5.56	0.87	2090	5.89	5.13	0.87	2171
28	20	7.31	5.48	0.75	2050	6.82	5.11	0.75	2151	6.32	4.74	0.75	2271
28	22	7.74	4.88	0.63	2131	7.24	4.56	0.63	2251	6.75	4.25	0.63	2332
28	24	8.17	4.16	0.51	2211	7.67	3.91	0.51	2312	7.24	3.69	0.51	2412
28	26	8.59	3.35	0.39	2291	8.09	3.16	0.39	2392	7.60	2.96	0.39	2492
29	18	6.96	6.33	0.91	1970	6.39	5.81	0.91	2090	5.89	5.36	0.91	2171
29	20	7.31	5.78	0.79	2050	6.82	5.38	0.79	2151	6.32	4.99	0.79	2271
29	22	7.74	5.19	0.67	2131	7.24	4.85	0.67	2251	6.75	4.52	0.67	2332
29	24	8.17	4.49	0.55	2211	7.67	4.22	0.55	2312	7.24	3.98	0.55	2412
29	26	8.59	3.69	0.43	2291	8.09	3.48	0.43	2392	7.60	3.27	0.43	2492
30	18	6.96	6.61	0.95	1970	6.39	6.07	0.95	2090	5.89	5.60	0.95	2171
30	20	7.31	6.07	0.83	2050	6.82	5.66	0.83	2151	6.32	5.24	0.83	2271
30	22	7.74	5.49	0.71	2131	7.24	5.14	0.71	2251	6.75	4.79	0.71	2332
30	24	8.17	4.82	0.59	2211	7.67	4.52	0.59	2312	7.24	4.27	0.59	2412
30	26	8.59	4.04	0.47	2291	8.09	3.80	0.47	2392	7.60	3.57	0.47	2492
31	18	6.96	6.89	0.99	1970	6.39	6.33	0.99	2090	5.89	5.83	0.99	2171
31	20	7.31	6.36	0.87	2050	6.82	5.93	0.87	2151	6.32	5.50	0.87	2271
31	22	7.74	5.80	0.75	2131	7.24	5.43	0.75	2251	6.75	5.06	0.75	2332
31	24	8.17	5.14	0.63	2211	7.67	4.83	0.63	2312	7.24	4.56	0.63	2412
31	26	8.59	4.38	0.51	2291	8.09	4.13	0.51	2392	7.60	3.87	0.51	2492
32	18	6.96	6.96	1.00	1970	6.39	6.39	1.00	2090	5.89	5.89	1.00	2171
32	20	7.31	6.65	0.91	2050	6.82	6.20	0.91	2151	6.32	5.75	0.91	2271
32	22	7.74	6.11	0.79	2131	7.24	5.72	0.79	2251	6.75	5.33	0.79	2332
32	24	8.17	5.47	0.67	2211	7.67	5.14	0.67	2312	7.24	4.85	0.67	2412
32	26	8.59	4.73	0.55	2291	8.09	4.45	0.55	2392	7.60	4.18	0.55	2492

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR25VF: MUZ-HR25VF

CAPACITY: 2.5 kW

SHF: 0.78

INPUT: 800 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	1.76	0.60	640	2.81	1.69	0.60	672	2.70	1.62	0.60	704	2.60	1.56	0.60	736
21	20	3.06	1.47	0.48	672	2.94	1.41	0.48	712	2.85	1.37	0.48	728	2.75	1.32	0.48	760
22	18	2.94	1.88	0.64	640	2.81	1.80	0.64	672	2.70	1.73	0.64	704	2.60	1.66	0.64	736
22	20	3.06	1.59	0.52	672	2.94	1.53	0.52	712	2.85	1.48	0.52	728	2.75	1.43	0.52	760
22	22	3.19	1.28	0.40	696	3.08	1.23	0.40	740	3.00	1.20	0.40	760	2.88	1.15	0.40	792
23	18	2.94	2.00	0.68	640	2.81	1.91	0.68	672	2.70	1.84	0.68	704	2.60	1.77	0.68	736
23	20	3.06	1.72	0.56	672	2.94	1.65	0.56	712	2.85	1.60	0.56	728	2.75	1.54	0.56	760
23	22	3.19	1.40	0.44	696	3.08	1.35	0.44	740	3.00	1.32	0.44	760	2.88	1.27	0.44	792
24	18	2.94	2.12	0.72	640	2.81	2.03	0.72	672	2.70	1.94	0.72	704	2.60	1.87	0.72	736
24	20	3.06	1.84	0.60	672	2.94	1.76	0.60	712	2.85	1.71	0.60	728	2.75	1.65	0.60	760
24	22	3.19	1.53	0.48	696	3.08	1.48	0.48	740	3.00	1.44	0.48	760	2.88	1.38	0.48	792
24	24	3.35	1.21	0.36	728	3.23	1.16	0.36	768	3.15	1.13	0.36	792	3.05	1.10	0.36	832
25	18	2.94	2.23	0.76	640	2.81	2.14	0.76	672	2.70	2.05	0.76	704	2.60	1.98	0.76	736
25	20	3.06	1.96	0.64	672	2.94	1.88	0.64	712	2.85	1.82	0.64	728	2.75	1.76	0.64	760
25	22	3.19	1.66	0.52	696	3.08	1.60	0.52	740	3.00	1.56	0.52	760	2.88	1.50	0.52	792
25	24	3.35	1.34	0.40	728	3.23	1.29	0.40	768	3.15	1.26	0.40	792	3.05	1.22	0.40	832
26	18	2.94	2.35	0.80	640	2.81	2.25	0.80	672	2.70	2.16	0.80	704	2.60	2.08	0.80	736
26	20	3.06	2.08	0.68	672	2.94	2.00	0.68	712	2.85	1.94	0.68	728	2.75	1.87	0.68	760
26	22	3.19	1.79	0.56	696	3.08	1.72	0.56	740	3.00	1.68	0.56	760	2.88	1.61	0.56	792
26	24	3.35	1.47	0.44	728	3.23	1.42	0.44	768	3.15	1.39	0.44	792	3.05	1.34	0.44	832
26	26	3.45	1.10	0.32	768	3.35	1.07	0.32	808	3.30	1.06	0.32	832	3.20	1.02	0.32	856
27	18	2.94	2.47	0.84	640	2.81	2.36	0.84	672	2.70	2.27	0.84	704	2.60	2.18	0.84	736
27	20	3.06	2.21	0.72	672	2.94	2.12	0.72	712	2.85	2.05	0.72	728	2.75	1.98	0.72	760
27	22	3.19	1.91	0.60	696	3.08	1.85	0.60	740	3.00	1.80	0.60	760	2.88	1.73	0.60	792
27	24	3.35	1.61	0.48	728	3.23	1.55	0.48	768	3.15	1.51	0.48	792	3.05	1.46	0.48	832
27	26	3.45	1.24	0.36	768	3.35	1.21	0.36	808	3.30	1.19	0.36	832	3.20	1.15	0.36	856
28	18	2.94	2.59	0.88	640	2.81	2.48	0.88	672	2.70	2.38	0.88	704	2.60	2.29	0.88	736
28	20	3.06	2.33	0.76	672	2.94	2.23	0.76	712	2.85	2.17	0.76	728	2.75	2.09	0.76	760
28	22	3.19	2.04	0.64	696	3.08	1.97	0.64	740	3.00	1.92	0.64	760	2.88	1.84	0.64	792
28	24	3.35	1.74	0.52	728	3.23	1.68	0.52	768	3.15	1.64	0.52	792	3.05	1.59	0.52	832
28	26	3.45	1.38	0.40	768	3.35	1.34	0.40	808	3.30	1.32	0.40	832	3.20	1.28	0.40	856
29	18	2.94	2.70	0.92	640	2.81	2.59	0.92	672	2.70	2.48	0.92	704	2.60	2.39	0.92	736
29	20	3.06	2.45	0.80	672	2.94	2.35	0.80	712	2.85	2.28	0.80	728	2.75	2.20	0.80	760
29	22	3.19	2.17	0.68	696	3.08	2.09	0.68	740	3.00	2.04	0.68	760	2.88	1.96	0.68	792
29	24	3.35	1.88	0.56	728	3.23	1.81	0.56	768	3.15	1.76	0.56	792	3.05	1.71	0.56	832
29	26	3.45	1.52	0.44	768	3.35	1.47	0.44	808	3.30	1.45	0.44	832	3.20	1.41	0.44	856
30	18	2.94	2.82	0.96	640	2.81	2.70	0.96	672	2.70	2.59	0.96	704	2.60	2.50	0.96	736
30	20	3.06	2.57	0.84	672	2.94	2.47	0.84	712	2.85	2.39	0.84	728	2.75	2.31	0.84	760
30	22	3.19	2.30	0.72	696	3.08	2.21	0.72	740	3.00	2.16	0.72	760	2.88	2.07	0.72	792
30	24	3.35	2.01	0.60	728	3.23	1.94	0.60	768	3.15	1.89	0.60	792	3.05	1.83	0.60	832
30	26	3.45	1.66	0.48	768	3.35	1.61	0.48	808	3.30	1.58	0.48	832	3.20	1.54	0.48	856
31	18	2.94	2.94	1.00	640	2.81	2.81	1.00	672	2.70	2.70	1.00	704	2.60	2.60	1.00	736
31	20	3.06	2.70	0.88	672	2.94	2.59	0.88	712	2.85	2.51	0.88	728	2.75	2.42	0.88	760
31	22	3.19	2.42	0.76	696	3.08	2.34	0.76	740	3.00	2.28	0.76	760	2.88	2.19	0.76	792
31	24	3.35	2.14	0.64	728	3.23	2.06	0.64	768	3.15	2.02	0.64	792	3.05	1.95	0.64	832
31	26	3.45	1.79	0.52	768	3.35	1.74	0.52	808	3.30	1.72	0.52	832	3.20	1.66	0.52	856
32	18	2.94	2.94	1.00	640	2.81	2.81	1.00	672	2.70	2.70	1.00	704	2.60	2.60	1.00	736
32	20	3.06	2.82	0.92	672	2.94	2.70	0.92	712	2.85	2.62	0.92	728	2.75	2.53	0.92	760
32	22	3.19	2.55	0.80	696	3.08	2.46	0.80	740	3.00	2.40	0.80	760	2.88	2.30	0.80	792
32	24	3.35	2.28	0.68	728	3.23	2.19	0.68	768	3.15	2.14	0.68	792	3.05	2.07	0.68	832
32	26	3.45	1.93	0.56	768	3.35	1.88	0.56	808	3.30	1.85	0.56	832	3.20	1.79	0.56	856

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR25VF: MUZ-HR25VF

CAPACITY: 2.5 kW SHF: 0.78 INPUT: 800 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.47	0.60	784	2.25	1.35	0.60	832	2.08	1.25	0.60	864
21	20	2.58	1.24	0.48	816	2.40	1.15	0.48	856	2.23	1.07	0.48	904
22	18	2.45	1.57	0.64	784	2.25	1.44	0.64	832	2.08	1.33	0.64	864
22	20	2.58	1.34	0.52	816	2.40	1.25	0.52	856	2.23	1.16	0.52	904
22	22	2.73	1.09	0.40	848	2.55	1.02	0.40	896	2.38	0.95	0.40	928
23	18	2.45	1.67	0.68	784	2.25	1.53	0.68	832	2.08	1.41	0.68	864
23	20	2.58	1.44	0.56	816	2.40	1.34	0.56	856	2.23	1.25	0.56	904
23	22	2.73	1.20	0.44	848	2.55	1.12	0.44	896	2.38	1.05	0.44	928
24	18	2.45	1.76	0.72	784	2.25	1.62	0.72	832	2.08	1.49	0.72	864
24	20	2.58	1.55	0.60	816	2.40	1.44	0.60	856	2.23	1.34	0.60	904
24	22	2.73	1.31	0.48	848	2.55	1.22	0.48	896	2.38	1.14	0.48	928
24	24	2.88	1.04	0.36	880	2.70	0.97	0.36	920	2.55	0.92	0.36	960
25	18	2.45	1.86	0.76	784	2.25	1.71	0.76	832	2.08	1.58	0.76	864
25	20	2.58	1.65	0.64	816	2.40	1.54	0.64	856	2.23	1.42	0.64	904
25	22	2.73	1.42	0.52	848	2.55	1.33	0.52	896	2.38	1.24	0.52	928
25	24	2.88	1.15	0.40	880	2.70	1.08	0.40	920	2.55	1.02	0.40	960
26	18	2.45	1.96	0.80	784	2.25	1.80	0.80	832	2.08	1.66	0.80	864
26	20	2.58	1.75	0.68	816	2.40	1.63	0.68	856	2.23	1.51	0.68	904
26	22	2.73	1.53	0.56	848	2.55	1.43	0.56	896	2.38	1.33	0.56	928
26	24	2.88	1.27	0.44	880	2.70	1.19	0.44	920	2.55	1.12	0.44	960
26	26	3.03	0.97	0.32	912	2.85	0.91	0.32	952	2.68	0.86	0.32	992
27	18	2.45	2.06	0.84	784	2.25	1.89	0.84	832	2.08	1.74	0.84	864
27	20	2.58	1.85	0.72	816	2.40	1.73	0.72	856	2.23	1.60	0.72	904
27	22	2.73	1.64	0.60	848	2.55	1.53	0.60	896	2.38	1.43	0.60	928
27	24	2.88	1.38	0.48	880	2.70	1.30	0.48	920	2.55	1.22	0.48	960
27	26	3.03	1.09	0.36	912	2.85	1.03	0.36	952	2.68	0.96	0.36	992
28	18	2.45	2.16	0.88	784	2.25	1.98	0.88	832	2.08	1.83	0.88	864
28	20	2.58	1.96	0.76	816	2.40	1.82	0.76	856	2.23	1.69	0.76	904
28	22	2.73	1.74	0.64	848	2.55	1.63	0.64	896	2.38	1.52	0.64	928
28	24	2.88	1.50	0.52	880	2.70	1.40	0.52	920	2.55	1.33	0.52	960
28	26	3.03	1.21	0.40	912	2.85	1.14	0.40	952	2.68	1.07	0.40	992
29	18	2.45	2.25	0.92	784	2.25	2.07	0.92	832	2.08	1.91	0.92	864
29	20	2.58	2.06	0.80	816	2.40	1.92	0.80	856	2.23	1.78	0.80	904
29	22	2.73	1.85	0.68	848	2.55	1.73	0.68	896	2.38	1.62	0.68	928
29	24	2.88	1.61	0.56	880	2.70	1.51	0.56	920	2.55	1.43	0.56	960
29	26	3.03	1.33	0.44	912	2.85	1.25	0.44	952	2.68	1.18	0.44	992
30	18	2.45	2.35	0.96	784	2.25	2.16	0.96	832	2.08	1.99	0.96	864
30	20	2.58	2.16	0.84	816	2.40	2.02	0.84	856	2.23	1.87	0.84	904
30	22	2.73	1.96	0.72	848	2.55	1.84	0.72	896	2.38	1.71	0.72	928
30	24	2.88	1.73	0.60	880	2.70	1.62	0.60	920	2.55	1.53	0.60	960
30	26	3.03	1.45	0.48	912	2.85	1.37	0.48	952	2.68	1.28	0.48	992
31	18	2.45	2.45	1.00	784	2.25	2.25	1.00	832	2.08	2.08	1.00	864
31	20	2.58	2.27	0.88	816	2.40	2.11	0.88	856	2.23	1.96	0.88	904
31	22	2.73	2.07	0.76	848	2.55	1.94	0.76	896	2.38	1.81	0.76	928
31	24	2.88	1.84	0.64	880	2.70	1.73	0.64	920	2.55	1.63	0.64	960
31	26	3.03	1.57	0.52	912	2.85	1.48	0.52	952	2.68	1.39	0.52	992
32	18	2.45	2.45	1.00	784	2.25	2.25	1.00	832	2.08	2.08	1.00	864
32	20	2.58	2.37	0.92	816	2.40	2.21	0.92	856	2.23	2.05	0.92	904
32	22	2.73	2.18	0.80	848	2.55	2.04	0.80	896	2.38	1.90	0.80	928
32	24	2.88	1.96	0.68	880	2.70	1.84	0.68	920	2.55	1.73	0.68	960
32	26	3.03	1.69	0.56	912	2.85	1.60	0.56	952	2.68	1.50	0.56	992

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR35VF: MUZ-HR35VF

CAPACITY: 3.4 kW

SHF: 0.78

INPUT: 1210 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.00	2.40	0.60	968	3.83	2.30	0.60	1016	3.67	2.20	0.60	1065	3.54	2.12	0.60	1113
21	20	4.17	2.00	0.48	1016	4.00	1.92	0.48	1077	3.88	1.86	0.48	1101	3.74	1.80	0.48	1150
22	18	4.00	2.56	0.64	968	3.83	2.45	0.64	1016	3.67	2.35	0.64	1065	3.54	2.26	0.64	1113
22	20	4.17	2.17	0.52	1016	4.00	2.08	0.52	1077	3.88	2.02	0.52	1101	3.74	1.94	0.52	1150
22	22	4.34	1.73	0.40	1053	4.18	1.67	0.40	1119	4.08	1.63	0.40	1150	3.91	1.56	0.40	1198
23	18	4.00	2.72	0.68	968	3.83	2.60	0.68	1016	3.67	2.50	0.68	1065	3.54	2.40	0.68	1113
23	20	4.17	2.33	0.56	1016	4.00	2.24	0.56	1077	3.88	2.17	0.56	1101	3.74	2.09	0.56	1150
23	22	4.34	1.91	0.44	1053	4.18	1.84	0.44	1119	4.08	1.80	0.44	1150	3.91	1.72	0.44	1198
24	18	4.00	2.88	0.72	968	3.83	2.75	0.72	1016	3.67	2.64	0.72	1065	3.54	2.55	0.72	1113
24	20	4.17	2.50	0.60	1016	4.00	2.40	0.60	1077	3.88	2.33	0.60	1101	3.74	2.24	0.60	1150
24	22	4.34	2.08	0.48	1053	4.18	2.01	0.48	1119	4.08	1.96	0.48	1150	3.91	1.88	0.48	1198
24	24	4.56	1.64	0.36	1101	4.39	1.58	0.36	1162	4.28	1.54	0.36	1198	4.15	1.49	0.36	1258
25	18	4.00	3.04	0.76	968	3.83	2.91	0.76	1016	3.67	2.79	0.76	1065	3.54	2.69	0.76	1113
25	20	4.17	2.67	0.64	1016	4.00	2.56	0.64	1077	3.88	2.48	0.64	1101	3.74	2.39	0.64	1150
25	22	4.34	2.25	0.52	1053	4.18	2.17	0.52	1119	4.08	2.12	0.52	1150	3.91	2.03	0.52	1198
25	24	4.56	1.82	0.40	1101	4.39	1.75	0.40	1162	4.28	1.71	0.40	1198	4.15	1.66	0.40	1258
26	18	4.00	3.20	0.80	968	3.83	3.06	0.80	1016	3.67	2.94	0.80	1065	3.54	2.83	0.80	1113
26	20	4.17	2.83	0.68	1016	4.00	2.72	0.68	1077	3.88	2.64	0.68	1101	3.74	2.54	0.68	1150
26	22	4.34	2.43	0.56	1053	4.18	2.34	0.56	1119	4.08	2.28	0.56	1150	3.91	2.19	0.56	1198
26	24	4.56	2.00	0.44	1101	4.39	1.93	0.44	1162	4.28	1.88	0.44	1198	4.15	1.83	0.44	1258
26	26	4.69	1.50	0.32	1162	4.56	1.46	0.32	1222	4.49	1.44	0.32	1258	4.35	1.39	0.32	1295
27	18	4.00	3.36	0.84	968	3.83	3.21	0.84	1016	3.67	3.08	0.84	1065	3.54	2.97	0.84	1113
27	20	4.17	3.00	0.72	1016	4.00	2.88	0.72	1077	3.88	2.79	0.72	1101	3.74	2.69	0.72	1150
27	22	4.34	2.60	0.60	1053	4.18	2.51	0.60	1119	4.08	2.45	0.60	1150	3.91	2.35	0.60	1198
27	24	4.56	2.19	0.48	1101	4.39	2.11	0.48	1162	4.28	2.06	0.48	1198	4.15	1.99	0.48	1258
27	26	4.69	1.69	0.36	1162	4.56	1.64	0.36	1222	4.49	1.62	0.36	1258	4.35	1.57	0.36	1295
28	18	4.00	3.52	0.88	968	3.83	3.37	0.88	1016	3.67	3.23	0.88	1065	3.54	3.11	0.88	1113
28	20	4.17	3.17	0.76	1016	4.00	3.04	0.76	1077	3.88	2.95	0.76	1101	3.74	2.84	0.76	1150
28	22	4.34	2.77	0.64	1053	4.18	2.68	0.64	1119	4.08	2.61	0.64	1150	3.91	2.50	0.64	1198
28	24	4.56	2.37	0.52	1101	4.39	2.28	0.52	1162	4.28	2.23	0.52	1198	4.15	2.16	0.52	1258
28	26	4.69	1.88	0.40	1162	4.56	1.82	0.40	1222	4.49	1.80	0.40	1258	4.35	1.74	0.40	1295
29	18	4.00	3.68	0.92	968	3.83	3.52	0.92	1016	3.67	3.38	0.92	1065	3.54	3.25	0.92	1113
29	20	4.17	3.33	0.80	1016	4.00	3.20	0.80	1077	3.88	3.10	0.80	1101	3.74	2.99	0.80	1150
29	22	4.34	2.95	0.68	1053	4.18	2.84	0.68	1119	4.08	2.77	0.68	1150	3.91	2.66	0.68	1198
29	24	4.56	2.55	0.56	1101	4.39	2.46	0.56	1162	4.28	2.40	0.56	1198	4.15	2.32	0.56	1258
29	26	4.69	2.06	0.44	1162	4.56	2.00	0.44	1222	4.49	1.97	0.44	1258	4.35	1.91	0.44	1295
30	18	4.00	3.84	0.96	968	3.83	3.67	0.96	1016	3.67	3.53	0.96	1065	3.54	3.39	0.96	1113
30	20	4.17	3.50	0.84	1016	4.00	3.36	0.84	1077	3.88	3.26	0.84	1101	3.74	3.14	0.84	1150
30	22	4.34	3.12	0.72	1053	4.18	3.01	0.72	1119	4.08	2.94	0.72	1150	3.91	2.82	0.72	1198
30	24	4.56	2.73	0.60	1101	4.39	2.63	0.60	1162	4.28	2.57	0.60	1198	4.15	2.49	0.60	1258
30	26	4.69	2.25	0.48	1162	4.56	2.19	0.48	1222	4.49	2.15	0.48	1258	4.35	2.09	0.48	1295
31	18	4.00	4.00	1.00	968	3.83	3.83	1.00	1016	3.67	3.67	1.00	1065	3.54	3.54	1.00	1113
31	20	4.17	3.67	0.88	1016	4.00	3.52	0.88	1077	3.88	3.41	0.88	1101	3.74	3.29	0.88	1150
31	22	4.34	3.29	0.76	1053	4.18	3.18	0.76	1119	4.08	3.10	0.76	1150	3.91	2.97	0.76	1198
31	24	4.56	2.92	0.64	1101	4.39	2.81	0.64	1162	4.28	2.74	0.64	1198	4.15	2.65	0.64	1258
31	26	4.69	2.44	0.52	1162	4.56	2.37	0.52	1222	4.49	2.33	0.52	1258	4.35	2.26	0.52	1295
32	18	4.00	4.00	1.00	968	3.83	3.83	1.00	1016	3.67	3.67	1.00	1065	3.54	3.54	1.00	1113
32	20	4.17	3.83	0.92	1016	4.00	3.68	0.92	1077	3.88	3.57	0.92	1101	3.74	3.44	0.92	1150
32	22	4.34	3.47	0.80	1053	4.18	3.35	0.80	1119	4.08	3.26	0.80	1150	3.91	3.13	0.80	1198
32	24	4.56	3.10	0.68	1101	4.39	2.98	0.68	1162	4.28	2.91	0.68	1198	4.15	2.82	0.68	1258
32	26	4.69	2.63	0.56	1162	4.56	2.55	0.56	1222	4.49	2.51	0.56	1258	4.35	2.44	0.56	1295

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR35VF: MUZ-HR35VF

CAPACITY: 3.4 kW SHF: 0.78 INPUT: 1210 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.33	2.00	0.60	1186	3.06	1.84	0.60	1258	2.82	1.69	0.60	1307
21	20	3.50	1.68	0.48	1234	3.26	1.57	0.48	1295	3.03	1.45	0.48	1367
22	18	3.33	2.13	0.64	1186	3.06	1.96	0.64	1258	2.82	1.81	0.64	1307
22	20	3.50	1.82	0.52	1234	3.26	1.70	0.52	1295	3.03	1.57	0.52	1367
22	22	3.71	1.48	0.40	1283	3.47	1.39	0.40	1355	3.23	1.29	0.40	1404
23	18	3.33	2.27	0.68	1186	3.06	2.08	0.68	1258	2.82	1.92	0.68	1307
23	20	3.50	1.96	0.56	1234	3.26	1.83	0.56	1295	3.03	1.69	0.56	1367
23	22	3.71	1.63	0.44	1283	3.47	1.53	0.44	1355	3.23	1.42	0.44	1404
24	18	3.33	2.40	0.72	1186	3.06	2.20	0.72	1258	2.82	2.03	0.72	1307
24	20	3.50	2.10	0.60	1234	3.26	1.96	0.60	1295	3.03	1.82	0.60	1367
24	22	3.71	1.78	0.48	1283	3.47	1.66	0.48	1355	3.23	1.55	0.48	1404
24	24	3.91	1.41	0.36	1331	3.67	1.32	0.36	1392	3.47	1.25	0.36	1452
25	18	3.33	2.53	0.76	1186	3.06	2.33	0.76	1258	2.82	2.14	0.76	1307
25	20	3.50	2.24	0.64	1234	3.26	2.09	0.64	1295	3.03	1.94	0.64	1367
25	22	3.71	1.93	0.52	1283	3.47	1.80	0.52	1355	3.23	1.68	0.52	1404
25	24	3.91	1.56	0.40	1331	3.67	1.47	0.40	1392	3.47	1.39	0.40	1452
26	18	3.33	2.67	0.80	1186	3.06	2.45	0.80	1258	2.82	2.26	0.80	1307
26	20	3.50	2.38	0.68	1234	3.26	2.22	0.68	1295	3.03	2.06	0.68	1367
26	22	3.71	2.08	0.56	1283	3.47	1.94	0.56	1355	3.23	1.81	0.56	1404
26	24	3.91	1.72	0.44	1331	3.67	1.62	0.44	1392	3.47	1.53	0.44	1452
26	26	4.11	1.32	0.32	1379	3.88	1.24	0.32	1440	3.64	1.16	0.32	1500
27	18	3.33	2.80	0.84	1186	3.06	2.57	0.84	1258	2.82	2.37	0.84	1307
27	20	3.50	2.52	0.72	1234	3.26	2.35	0.72	1295	3.03	2.18	0.72	1367
27	22	3.71	2.22	0.60	1283	3.47	2.08	0.60	1355	3.23	1.94	0.60	1404
27	24	3.91	1.88	0.48	1331	3.67	1.76	0.48	1392	3.47	1.66	0.48	1452
27	26	4.11	1.48	0.36	1379	3.88	1.40	0.36	1440	3.64	1.31	0.36	1500
28	18	3.33	2.93	0.88	1186	3.06	2.69	0.88	1258	2.82	2.48	0.88	1307
28	20	3.50	2.66	0.76	1234	3.26	2.48	0.76	1295	3.03	2.30	0.76	1367
28	22	3.71	2.37	0.64	1283	3.47	2.22	0.64	1355	3.23	2.07	0.64	1404
28	24	3.91	2.03	0.52	1331	3.67	1.91	0.52	1392	3.47	1.80	0.52	1452
28	26	4.11	1.65	0.40	1379	3.88	1.55	0.40	1440	3.64	1.46	0.40	1500
29	18	3.33	3.07	0.92	1186	3.06	2.82	0.92	1258	2.82	2.60	0.92	1307
29	20	3.50	2.80	0.80	1234	3.26	2.61	0.80	1295	3.03	2.42	0.80	1367
29	22	3.71	2.52	0.68	1283	3.47	2.36	0.68	1355	3.23	2.20	0.68	1404
29	24	3.91	2.19	0.56	1331	3.67	2.06	0.56	1392	3.47	1.94	0.56	1452
29	26	4.11	1.81	0.44	1379	3.88	1.71	0.44	1440	3.64	1.60	0.44	1500
30	18	3.33	3.20	0.96	1186	3.06	2.94	0.96	1258	2.82	2.71	0.96	1307
30	20	3.50	2.94	0.84	1234	3.26	2.74	0.84	1295	3.03	2.54	0.84	1367
30	22	3.71	2.67	0.72	1283	3.47	2.50	0.72	1355	3.23	2.33	0.72	1404
30	24	3.91	2.35	0.60	1331	3.67	2.20	0.60	1392	3.47	2.08	0.60	1452
30	26	4.11	1.97	0.48	1379	3.88	1.86	0.48	1440	3.64	1.75	0.48	1500
31	18	3.33	3.33	1.00	1186	3.06	3.06	1.00	1258	2.82	2.82	1.00	1307
31	20	3.50	3.08	0.88	1234	3.26	2.87	0.88	1295	3.03	2.66	0.88	1367
31	22	3.71	2.82	0.76	1283	3.47	2.64	0.76	1355	3.23	2.45	0.76	1404
31	24	3.91	2.50	0.64	1331	3.67	2.35	0.64	1392	3.47	2.22	0.64	1452
31	26	4.11	2.14	0.52	1379	3.88	2.02	0.52	1440	3.64	1.89	0.52	1500
32	18	3.33	3.33	1.00	1186	3.06	3.06	1.00	1258	2.82	2.82	1.00	1307
32	20	3.50	3.22	0.92	1234	3.26	3.00	0.92	1295	3.03	2.78	0.92	1367
32	22	3.71	2.96	0.80	1283	3.47	2.77	0.80	1355	3.23	2.58	0.80	1404
32	24	3.91	2.66	0.68	1331	3.67	2.50	0.68	1392	3.47	2.36	0.68	1452
32	26	4.11	2.30	0.56	1379	3.88	2.17	0.56	1440	3.64	2.04	0.56	1500

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR42VF: MUZ-HR42VF

CAPACITY: 4.2 kW SHF: 0.74 INPUT: 1340 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.94	2.76	0.56	1072	4.73	2.65	0.56	1126	4.54	2.54	0.56	1179	4.37	2.45	0.56	1233
21	20	5.15	2.26	0.44	1126	4.94	2.17	0.44	1193	4.79	2.11	0.44	1219	4.62	2.03	0.44	1273
22	18	4.94	2.96	0.60	1072	4.73	2.84	0.60	1126	4.54	2.72	0.60	1179	4.37	2.62	0.60	1233
22	20	5.15	2.47	0.48	1126	4.94	2.37	0.48	1193	4.79	2.30	0.48	1219	4.62	2.22	0.48	1273
22	22	5.36	1.93	0.36	1166	5.17	1.86	0.36	1240	5.04	1.81	0.36	1273	4.83	1.74	0.36	1327
23	18	4.94	3.16	0.64	1072	4.73	3.02	0.64	1126	4.54	2.90	0.64	1179	4.37	2.80	0.64	1233
23	20	5.15	2.68	0.52	1126	4.94	2.57	0.52	1193	4.79	2.49	0.52	1219	4.62	2.40	0.52	1273
23	22	5.36	2.14	0.40	1166	5.17	2.07	0.40	1240	5.04	2.02	0.40	1273	4.83	1.93	0.40	1327
24	18	4.94	3.36	0.68	1072	4.73	3.21	0.68	1126	4.54	3.08	0.68	1179	4.37	2.97	0.68	1233
24	20	5.15	2.88	0.56	1126	4.94	2.76	0.56	1193	4.79	2.68	0.56	1219	4.62	2.59	0.56	1273
24	22	5.36	2.36	0.44	1166	5.17	2.27	0.44	1240	5.04	2.22	0.44	1273	4.83	2.13	0.44	1327
24	24	5.63	1.80	0.32	1219	5.42	1.73	0.32	1286	5.29	1.69	0.32	1327	5.12	1.64	0.32	1394
25	18	4.94	3.55	0.72	1072	4.73	3.40	0.72	1126	4.54	3.27	0.72	1179	4.37	3.14	0.72	1233
25	20	5.15	3.09	0.60	1126	4.94	2.96	0.60	1193	4.79	2.87	0.60	1219	4.62	2.77	0.60	1273
25	22	5.36	2.57	0.48	1166	5.17	2.48	0.48	1240	5.04	2.42	0.48	1273	4.83	2.32	0.48	1327
25	24	5.63	2.03	0.36	1219	5.42	1.95	0.36	1286	5.29	1.91	0.36	1327	5.12	1.84	0.36	1394
26	18	4.94	3.75	0.76	1072	4.73	3.59	0.76	1126	4.54	3.45	0.76	1179	4.37	3.32	0.76	1233
26	20	5.15	3.29	0.64	1126	4.94	3.16	0.64	1193	4.79	3.06	0.64	1219	4.62	2.96	0.64	1273
26	22	5.36	2.78	0.52	1166	5.17	2.69	0.52	1240	5.04	2.62	0.52	1273	4.83	2.51	0.52	1327
26	24	5.63	2.25	0.40	1219	5.42	2.17	0.40	1286	5.29	2.12	0.40	1327	5.12	2.05	0.40	1394
26	26	5.80	1.62	0.28	1286	5.63	1.58	0.28	1353	5.54	1.55	0.28	1394	5.38	1.51	0.28	1434
27	18	4.94	3.95	0.80	1072	4.73	3.78	0.80	1126	4.54	3.63	0.80	1179	4.37	3.49	0.80	1233
27	20	5.15	3.50	0.68	1126	4.94	3.36	0.68	1193	4.79	3.26	0.68	1219	4.62	3.14	0.68	1273
27	22	5.36	3.00	0.56	1166	5.17	2.89	0.56	1240	5.04	2.82	0.56	1273	4.83	2.70	0.56	1327
27	24	5.63	2.48	0.44	1219	5.42	2.38	0.44	1286	5.29	2.33	0.44	1327	5.12	2.25	0.44	1394
27	26	5.80	1.85	0.32	1286	5.63	1.80	0.32	1353	5.54	1.77	0.32	1394	5.38	1.72	0.32	1434
28	18	4.94	4.15	0.84	1072	4.73	3.97	0.84	1126	4.54	3.81	0.84	1179	4.37	3.67	0.84	1233
28	20	5.15	3.70	0.72	1126	4.94	3.55	0.72	1193	4.79	3.45	0.72	1219	4.62	3.33	0.72	1273
28	22	5.36	3.21	0.60	1166	5.17	3.10	0.60	1240	5.04	3.02	0.60	1273	4.83	2.90	0.60	1327
28	24	5.63	2.70	0.48	1219	5.42	2.60	0.48	1286	5.29	2.54	0.48	1327	5.12	2.46	0.48	1394
28	26	5.80	2.09	0.36	1286	5.63	2.03	0.36	1353	5.54	2.00	0.36	1394	5.38	1.94	0.36	1434
29	18	4.94	4.34	0.88	1072	4.73	4.16	0.88	1126	4.54	3.99	0.88	1179	4.37	3.84	0.88	1233
29	20	5.15	3.91	0.76	1126	4.94	3.75	0.76	1193	4.79	3.64	0.76	1219	4.62	3.51	0.76	1273
29	22	5.36	3.43	0.64	1166	5.17	3.31	0.64	1240	5.04	3.23	0.64	1273	4.83	3.09	0.64	1327
29	24	5.63	2.93	0.52	1219	5.42	2.82	0.52	1286	5.29	2.75	0.52	1327	5.12	2.66	0.52	1394
29	26	5.80	2.32	0.40	1286	5.63	2.25	0.40	1353	5.54	2.22	0.40	1394	5.38	2.15	0.40	1434
30	18	4.94	4.54	0.92	1072	4.73	4.35	0.92	1126	4.54	4.17	0.92	1179	4.37	4.02	0.92	1233
30	20	5.15	4.12	0.80	1126	4.94	3.95	0.80	1193	4.79	3.83	0.80	1219	4.62	3.70	0.80	1273
30	22	5.36	3.64	0.68	1166	5.17	3.51	0.68	1240	5.04	3.43	0.68	1273	4.83	3.28	0.68	1327
30	24	5.63	3.15	0.56	1219	5.42	3.03	0.56	1286	5.29	2.96	0.56	1327	5.12	2.87	0.56	1394
30	26	5.80	2.55	0.44	1286	5.63	2.48	0.44	1353	5.54	2.44	0.44	1394	5.38	2.37	0.44	1434
31	18	4.94	4.74	0.96	1072	4.73	4.54	0.96	1126	4.54	4.35	0.96	1179	4.37	4.19	0.96	1233
31	20	5.15	4.32	0.84	1126	4.94	4.15	0.84	1193	4.79	4.02	0.84	1219	4.62	3.88	0.84	1273
31	22	5.36	3.86	0.72	1166	5.17	3.72	0.72	1240	5.04	3.63	0.72	1273	4.83	3.48	0.72	1327
31	24	5.63	3.38	0.60	1219	5.42	3.25	0.60	1286	5.29	3.18	0.60	1327	5.12	3.07	0.60	1394
31	26	5.80	2.78	0.48	1286	5.63	2.70	0.48	1353	5.54	2.66	0.48	1394	5.38	2.58	0.48	1434
32	18	4.94	4.94	1.00	1072	4.73	4.73	1.00	1126	4.54	4.54	1.00	1179	4.37	4.37	1.00	1233
32	20	5.15	4.53	0.88	1126	4.94	4.34	0.88	1193	4.79	4.21	0.88	1219	4.62	4.07	0.88	1273
32	22	5.36	4.07	0.76	1166	5.17	3.93	0.76	1240	5.04	3.83	0.76	1273	4.83	3.67	0.76	1327
32	24	5.63	3.60	0.64	1219	5.42	3.47	0.64	1286	5.29	3.39	0.64	1327	5.12	3.28	0.64	1394
32	26	5.80	3.01	0.52	1286	5.63	2.93	0.52	1353	5.54	2.88	0.52	1394	5.38	2.80	0.52	1434

WALL-MOUNTED PERFORMANCE DATA

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR42VF: MUZ-HR42VF

CAPACITY: 4.2 kW SHF: 0.74 INPUT: 1340 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.12	2.30	0.56	1313	3.78	2.12	0.56	1394	3.49	1.95	0.56	1447
21	20	4.33	1.90	0.44	1367	4.03	1.77	0.44	1434	3.74	1.64	0.44	1514
22	18	4.12	2.47	0.60	1313	3.78	2.27	0.60	1394	3.49	2.09	0.60	1447
22	20	4.33	2.08	0.48	1367	4.03	1.94	0.48	1434	3.74	1.79	0.48	1514
22	22	4.58	1.65	0.36	1420	4.28	1.54	0.36	1501	3.99	1.44	0.36	1554
23	18	4.12	2.63	0.64	1313	3.78	2.42	0.64	1394	3.49	2.23	0.64	1447
23	20	4.33	2.25	0.52	1367	4.03	2.10	0.52	1434	3.74	1.94	0.52	1514
23	22	4.58	1.83	0.40	1420	4.28	1.71	0.40	1501	3.99	1.60	0.40	1554
24	18	4.12	2.80	0.68	1313	3.78	2.57	0.68	1394	3.49	2.37	0.68	1447
24	20	4.33	2.42	0.56	1367	4.03	2.26	0.56	1434	3.74	2.09	0.56	1514
24	22	4.58	2.01	0.44	1420	4.28	1.88	0.44	1501	3.99	1.76	0.44	1554
24	24	4.83	1.55	0.32	1474	4.54	1.45	0.32	1541	4.28	1.37	0.32	1608
25	18	4.12	2.96	0.72	1313	3.78	2.72	0.72	1394	3.49	2.51	0.72	1447
25	20	4.33	2.60	0.60	1367	4.03	2.42	0.60	1434	3.74	2.24	0.60	1514
25	22	4.58	2.20	0.48	1420	4.28	2.06	0.48	1501	3.99	1.92	0.48	1554
25	24	4.83	1.74	0.36	1474	4.54	1.63	0.36	1541	4.28	1.54	0.36	1608
26	18	4.12	3.13	0.76	1313	3.78	2.87	0.76	1394	3.49	2.65	0.76	1447
26	20	4.33	2.77	0.64	1367	4.03	2.58	0.64	1434	3.74	2.39	0.64	1514
26	22	4.58	2.38	0.52	1420	4.28	2.23	0.52	1501	3.99	2.07	0.52	1554
26	24	4.83	1.93	0.40	1474	4.54	1.81	0.40	1541	4.28	1.71	0.40	1608
26	26	5.08	1.42	0.28	1528	4.79	1.34	0.28	1595	4.49	1.26	0.28	1662
27	18	4.12	3.29	0.80	1313	3.78	3.02	0.80	1394	3.49	2.79	0.80	1447
27	20	4.33	2.94	0.68	1367	4.03	2.74	0.68	1434	3.74	2.54	0.68	1514
27	22	4.58	2.56	0.56	1420	4.28	2.40	0.56	1501	3.99	2.23	0.56	1554
27	24	4.83	2.13	0.44	1474	4.54	2.00	0.44	1541	4.28	1.88	0.44	1608
27	26	5.08	1.63	0.32	1528	4.79	1.53	0.32	1595	4.49	1.44	0.32	1662
28	18	4.12	3.46	0.84	1313	3.78	3.18	0.84	1394	3.49	2.93	0.84	1447
28	20	4.33	3.11	0.72	1367	4.03	2.90	0.72	1434	3.74	2.69	0.72	1514
28	22	4.58	2.75	0.60	1420	4.28	2.57	0.60	1501	3.99	2.39	0.60	1554
28	24	4.83	2.32	0.48	1474	4.54	2.18	0.48	1541	4.28	2.06	0.48	1608
28	26	5.08	1.83	0.36	1528	4.79	1.72	0.36	1595	4.49	1.62	0.36	1662
29	18	4.12	3.62	0.88	1313	3.78	3.33	0.88	1394	3.49	3.07	0.88	1447
29	20	4.33	3.29	0.76	1367	4.03	3.06	0.76	1434	3.74	2.84	0.76	1514
29	22	4.58	2.93	0.64	1420	4.28	2.74	0.64	1501	3.99	2.55	0.64	1554
29	24	4.83	2.51	0.52	1474	4.54	2.36	0.52	1541	4.28	2.23	0.52	1608
29	26	5.08	2.03	0.40	1528	4.79	1.92	0.40	1595	4.49	1.80	0.40	1662
30	18	4.12	3.79	0.92	1313	3.78	3.48	0.92	1394	3.49	3.21	0.92	1447
30	20	4.33	3.46	0.80	1367	4.03	3.23	0.80	1434	3.74	2.99	0.80	1514
30	22	4.58	3.11	0.68	1420	4.28	2.91	0.68	1501	3.99	2.71	0.68	1554
30	24	4.83	2.70	0.56	1474	4.54	2.54	0.56	1541	4.28	2.40	0.56	1608
30	26	5.08	2.24	0.44	1528	4.79	2.11	0.44	1595	4.49	1.98	0.44	1662
31	18	4.12	3.95	0.96	1313	3.78	3.63	0.96	1394	3.49	3.35	0.96	1447
31	20	4.33	3.63	0.84	1367	4.03	3.39	0.84	1434	3.74	3.14	0.84	1514
31	22	4.58	3.30	0.72	1420	4.28	3.08	0.72	1501	3.99	2.87	0.72	1554
31	24	4.83	2.90	0.60	1474	4.54	2.72	0.60	1541	4.28	2.57	0.60	1608
31	26	5.08	2.44	0.48	1528	4.79	2.30	0.48	1595	4.49	2.16	0.48	1662
32	18	4.12	4.12	1.00	1313	3.78	3.78	1.00	1394	3.49	3.49	1.00	1447
32	20	4.33	3.81	0.88	1367	4.03	3.55	0.88	1434	3.74	3.29	0.88	1514
32	22	4.58	3.48	0.76	1420	4.28	3.26	0.76	1501	3.99	3.03	0.76	1554
32	24	4.83	3.09	0.64	1474	4.54	2.90	0.64	1541	4.28	2.74	0.64	1608
32	26	5.08	2.64	0.52	1528	4.79	2.49	0.52	1595	4.49	2.34	0.52	1662

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR50VF: MUZ-HR50VF

CAPACITY: 5.0 kW

SHF: 0.73

INPUT: 2050 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.88	3.23	0.55	1640	5.63	3.09	0.55	1722	5.40	2.97	0.55	1804	5.20	2.86	0.55	1886
21	20	6.13	2.63	0.43	1722	5.88	2.53	0.43	1825	5.70	2.45	0.43	1866	5.50	2.37	0.43	1948
22	18	5.88	3.47	0.59	1640	5.63	3.32	0.59	1722	5.40	3.19	0.59	1804	5.20	3.07	0.59	1886
22	20	6.13	2.88	0.47	1722	5.88	2.76	0.47	1825	5.70	2.68	0.47	1866	5.50	2.59	0.47	1948
22	22	6.38	2.23	0.35	1784	6.15	2.15	0.35	1896	6.00	2.10	0.35	1948	5.75	2.01	0.35	2030
23	18	5.88	3.70	0.63	1640	5.63	3.54	0.63	1722	5.40	3.40	0.63	1804	5.20	3.28	0.63	1886
23	20	6.13	3.12	0.51	1722	5.88	3.00	0.51	1825	5.70	2.91	0.51	1866	5.50	2.81	0.51	1948
23	22	6.38	2.49	0.39	1784	6.15	2.40	0.39	1896	6.00	2.34	0.39	1948	5.75	2.24	0.39	2030
24	18	5.88	3.94	0.67	1640	5.63	3.77	0.67	1722	5.40	3.62	0.67	1804	5.20	3.48	0.67	1886
24	20	6.13	3.37	0.55	1722	5.88	3.23	0.55	1825	5.70	3.14	0.55	1866	5.50	3.03	0.55	1948
24	22	6.38	2.74	0.43	1784	6.15	2.64	0.43	1896	6.00	2.58	0.43	1948	5.75	2.47	0.43	2030
24	24	6.70	2.08	0.31	1866	6.45	2.00	0.31	1968	6.30	1.95	0.31	2030	6.10	1.89	0.31	2132
25	18	5.88	4.17	0.71	1640	5.63	3.99	0.71	1722	5.40	3.83	0.71	1804	5.20	3.69	0.71	1886
25	20	6.13	3.61	0.59	1722	5.88	3.47	0.59	1825	5.70	3.36	0.59	1866	5.50	3.25	0.59	1948
25	22	6.38	3.00	0.47	1784	6.15	2.89	0.47	1896	6.00	2.82	0.47	1948	5.75	2.70	0.47	2030
25	24	6.70	2.35	0.35	1866	6.45	2.26	0.35	1968	6.30	2.21	0.35	2030	6.10	2.14	0.35	2132
26	18	5.88	4.41	0.75	1640	5.63	4.22	0.75	1722	5.40	4.05	0.75	1804	5.20	3.90	0.75	1886
26	20	6.13	3.86	0.63	1722	5.88	3.70	0.63	1825	5.70	3.59	0.63	1866	5.50	3.47	0.63	1948
26	22	6.38	3.25	0.51	1784	6.15	3.14	0.51	1896	6.00	3.06	0.51	1948	5.75	2.93	0.51	2030
26	24	6.70	2.61	0.39	1866	6.45	2.52	0.39	1968	6.30	2.46	0.39	2030	6.10	2.38	0.39	2132
26	26	6.90	1.86	0.27	1968	6.70	1.81	0.27	2071	6.60	1.78	0.27	2132	6.40	1.73	0.27	2194
27	18	5.88	4.64	0.79	1640	5.63	4.44	0.79	1722	5.40	4.27	0.79	1804	5.20	4.11	0.79	1886
27	20	6.13	4.10	0.67	1722	5.88	3.94	0.67	1825	5.70	3.82	0.67	1866	5.50	3.69	0.67	1948
27	22	6.38	3.51	0.55	1784	6.15	3.38	0.55	1896	6.00	3.30	0.55	1948	5.75	3.16	0.55	2030
27	24	6.70	2.88	0.43	1866	6.45	2.77	0.43	1968	6.30	2.71	0.43	2030	6.10	2.62	0.43	2132
27	26	6.90	2.14	0.31	1968	6.70	2.08	0.31	2071	6.60	2.05	0.31	2132	6.40	1.98	0.31	2194
28	18	5.88	4.88	0.83	1640	5.63	4.67	0.83	1722	5.40	4.48	0.83	1804	5.20	4.32	0.83	1886
28	20	6.13	4.35	0.71	1722	5.88	4.17	0.71	1825	5.70	4.05	0.71	1866	5.50	3.91	0.71	1948
28	22	6.38	3.76	0.59	1784	6.15	3.63	0.59	1896	6.00	3.54	0.59	1948	5.75	3.39	0.59	2030
28	24	6.70	3.15	0.47	1866	6.45	3.03	0.47	1968	6.30	2.96	0.47	2030	6.10	2.87	0.47	2132
28	26	6.90	2.42	0.35	1968	6.70	2.35	0.35	2071	6.60	2.31	0.35	2132	6.40	2.24	0.35	2194
29	18	5.88	5.11	0.87	1640	5.63	4.89	0.87	1722	5.40	4.70	0.87	1804	5.20	4.52	0.87	1886
29	20	6.13	4.59	0.75	1722	5.88	4.41	0.75	1825	5.70	4.28	0.75	1866	5.50	4.13	0.75	1948
29	22	6.38	4.02	0.63	1784	6.15	3.87	0.63	1896	6.00	3.78	0.63	1948	5.75	3.62	0.63	2030
29	24	6.70	3.42	0.51	1866	6.45	3.29	0.51	1968	6.30	3.21	0.51	2030	6.10	3.11	0.51	2132
29	26	6.90	2.69	0.39	1968	6.70	2.61	0.39	2071	6.60	2.57	0.39	2132	6.40	2.50	0.39	2194
30	18	5.88	5.35	0.91	1640	5.63	5.12	0.91	1722	5.40	4.91	0.91	1804	5.20	4.73	0.91	1886
30	20	6.13	4.84	0.79	1722	5.88	4.64	0.79	1825	5.70	4.50	0.79	1866	5.50	4.35	0.79	1948
30	22	6.38	4.27	0.67	1784	6.15	4.12	0.67	1896	6.00	4.02	0.67	1948	5.75	3.85	0.67	2030
30	24	6.70	3.69	0.55	1866	6.45	3.55	0.55	1968	6.30	3.47	0.55	2030	6.10	3.36	0.55	2132
30	26	6.90	2.97	0.43	1968	6.70	2.88	0.43	2071	6.60	2.84	0.43	2132	6.40	2.75	0.43	2194
31	18	5.88	5.58	0.95	1640	5.63	5.34	0.95	1722	5.40	5.13	0.95	1804	5.20	4.94	0.95	1886
31	20	6.13	5.08	0.83	1722	5.88	4.88	0.83	1825	5.70	4.73	0.83	1866	5.50	4.57	0.83	1948
31	22	6.38	4.53	0.71	1784	6.15	4.37	0.71	1896	6.00	4.26	0.71	1948	5.75	4.08	0.71	2030
31	24	6.70	3.95	0.59	1866	6.45	3.81	0.59	1968	6.30	3.72	0.59	2030	6.10	3.60	0.59	2132
31	26	6.90	3.24	0.47	1968	6.70	3.15	0.47	2071	6.60	3.10	0.47	2132	6.40	3.01	0.47	2194
32	18	5.88	5.82	0.99	1640	5.63	5.57	0.99	1722	5.40	5.35	0.99	1804	5.20	5.15	0.99	1886
32	20	6.13	5.33	0.87	1722	5.88	5.11	0.87	1825	5.70	4.96	0.87	1866	5.50	4.79	0.87	1948
32	22	6.38	4.78	0.75	1784	6.15	4.61	0.75	1896	6.00	4.50	0.75	1948	5.75	4.31	0.75	2030
32	24	6.70	4.22	0.63	1866	6.45	4.06	0.63	1968	6.30	3.97	0.63	2030	6.10	3.84	0.63	2132
32	26	6.90	3.52	0.51	1968	6.70	3.42	0.51	2071	6.60	3.37	0.51	2132	6.40	3.26	0.51	2194

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-HR50VF: MUZ-HR50VF

CAPACITY: 5.0 kW SHF: 0.73 INPUT: 2050 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.70	0.55	2009	4.50	2.48	0.55	2132	4.15	2.28	0.55	2214
21	20	5.15	2.21	0.43	2091	4.80	2.06	0.43	2194	4.45	1.91	0.43	2317
22	18	4.90	2.89	0.59	2009	4.50	2.66	0.59	2132	4.15	2.45	0.59	2214
22	20	5.15	2.42	0.47	2091	4.80	2.26	0.47	2194	4.45	2.09	0.47	2317
22	22	5.45	1.91	0.35	2173	5.10	1.79	0.35	2296	4.75	1.66	0.35	2378
23	18	4.90	3.09	0.63	2009	4.50	2.84	0.63	2132	4.15	2.61	0.63	2214
23	20	5.15	2.63	0.51	2091	4.80	2.45	0.51	2194	4.45	2.27	0.51	2317
23	22	5.45	2.13	0.39	2173	5.10	1.99	0.39	2296	4.75	1.85	0.39	2378
24	18	4.90	3.28	0.67	2009	4.50	3.02	0.67	2132	4.15	2.78	0.67	2214
24	20	5.15	2.83	0.55	2091	4.80	2.64	0.55	2194	4.45	2.45	0.55	2317
24	22	5.45	2.34	0.43	2173	5.10	2.19	0.43	2296	4.75	2.04	0.43	2378
24	24	5.75	1.78	0.31	2255	5.40	1.67	0.31	2358	5.10	1.58	0.31	2460
25	18	4.90	3.48	0.71	2009	4.50	3.20	0.71	2132	4.15	2.95	0.71	2214
25	20	5.15	3.04	0.59	2091	4.80	2.83	0.59	2194	4.45	2.63	0.59	2317
25	22	5.45	2.56	0.47	2173	5.10	2.40	0.47	2296	4.75	2.23	0.47	2378
25	24	5.75	2.01	0.35	2255	5.40	1.89	0.35	2358	5.10	1.79	0.35	2460
26	18	4.90	3.68	0.75	2009	4.50	3.38	0.75	2132	4.15	3.11	0.75	2214
26	20	5.15	3.24	0.63	2091	4.80	3.02	0.63	2194	4.45	2.80	0.63	2317
26	22	5.45	2.78	0.51	2173	5.10	2.60	0.51	2296	4.75	2.42	0.51	2378
26	24	5.75	2.24	0.39	2255	5.40	2.11	0.39	2358	5.10	1.99	0.39	2460
26	26	6.05	1.63	0.27	2337	5.70	1.54	0.27	2440	5.35	1.44	0.27	2542
27	18	4.90	3.87	0.79	2009	4.50	3.56	0.79	2132	4.15	3.28	0.79	2214
27	20	5.15	3.45	0.67	2091	4.80	3.22	0.67	2194	4.45	2.98	0.67	2317
27	22	5.45	3.00	0.55	2173	5.10	2.81	0.55	2296	4.75	2.61	0.55	2378
27	24	5.75	2.47	0.43	2255	5.40	2.32	0.43	2358	5.10	2.19	0.43	2460
27	26	6.05	1.88	0.31	2337	5.70	1.77	0.31	2440	5.35	1.66	0.31	2542
28	18	4.90	4.07	0.83	2009	4.50	3.74	0.83	2132	4.15	3.44	0.83	2214
28	20	5.15	3.66	0.71	2091	4.80	3.41	0.71	2194	4.45	3.16	0.71	2317
28	22	5.45	3.22	0.59	2173	5.10	3.01	0.59	2296	4.75	2.80	0.59	2378
28	24	5.75	2.70	0.47	2255	5.40	2.54	0.47	2358	5.10	2.40	0.47	2460
28	26	6.05	2.12	0.35	2337	5.70	2.00	0.35	2440	5.35	1.87	0.35	2542
29	18	4.90	4.26	0.87	2009	4.50	3.92	0.87	2132	4.15	3.61	0.87	2214
29	20	5.15	3.86	0.75	2091	4.80	3.60	0.75	2194	4.45	3.34	0.75	2317
29	22	5.45	3.43	0.63	2173	5.10	3.21	0.63	2296	4.75	2.99	0.63	2378
29	24	5.75	2.93	0.51	2255	5.40	2.75	0.51	2358	5.10	2.60	0.51	2460
29	26	6.05	2.36	0.39	2337	5.70	2.22	0.39	2440	5.35	2.09	0.39	2542
30	18	4.90	4.46	0.91	2009	4.50	4.10	0.91	2132	4.15	3.78	0.91	2214
30	20	5.15	4.07	0.79	2091	4.80	3.79	0.79	2194	4.45	3.52	0.79	2317
30	22	5.45	3.65	0.67	2173	5.10	3.42	0.67	2296	4.75	3.18	0.67	2378
30	24	5.75	3.16	0.55	2255	5.40	2.97	0.55	2358	5.10	2.81	0.55	2460
30	26	6.05	2.60	0.43	2337	5.70	2.45	0.43	2440	5.35	2.30	0.43	2542
31	18	4.90	4.66	0.95	2009	4.50	4.28	0.95	2132	4.15	3.94	0.95	2214
31	20	5.15	4.27	0.83	2091	4.80	3.98	0.83	2194	4.45	3.69	0.83	2317
31	22	5.45	3.87	0.71	2173	5.10	3.62	0.71	2296	4.75	3.37	0.71	2378
31	24	5.75	3.39	0.59	2255	5.40	3.19	0.59	2358	5.10	3.01	0.59	2460
31	26	6.05	2.84	0.47	2337	5.70	2.68	0.47	2440	5.35	2.51	0.47	2542
32	18	4.90	4.85	0.99	2009	4.50	4.46	0.99	2132	4.15	4.11	0.99	2214
32	20	5.15	4.48	0.87	2091	4.80	4.18	0.87	2194	4.45	3.87	0.87	2317
32	22	5.45	4.09	0.75	2173	5.10	3.83	0.75	2296	4.75	3.56	0.75	2378
32	24	5.75	3.62	0.63	2255	5.40	3.40	0.63	2358	5.10	3.21	0.63	2460
32	26	6.05	3.09	0.51	2337	5.70	2.91	0.51	2440	5.35	2.73	0.51	2542

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSY-TP35VF: MUY-TP35VF

CAPACITY: 3.5 kW

SHF: 0.98

INPUT: 790 W

SHF: 0.9 (When Cooling capacity is 3.5 kW under our measurement condition)

Our measurement condition: Indoor temperature 24°C

Relative humidity 45%

Outdoor temperature 34°C

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	15	3.84	3.76	0.98	584	3.65	3.57	0.98	617	3.47	3.40	0.98	643	3.32	3.25	0.98	677
21	18	4.11	3.29	0.80	632	3.94	3.15	0.80	664	3.78	3.02	0.80	695	3.64	2.91	0.80	727
21	20	4.29	2.92	0.68	664	4.11	2.80	0.68	703	3.99	2.71	0.68	719	3.85	2.62	0.68	751
22	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
22	18	4.11	3.45	0.84	632	3.94	3.31	0.84	664	3.78	3.18	0.84	695	3.64	3.06	0.84	727
22	20	4.29	3.09	0.72	664	4.11	2.96	0.72	703	3.99	2.87	0.72	719	3.85	2.77	0.72	751
22	22	4.46	2.68	0.60	687	4.31	2.58	0.60	731	4.20	2.52	0.60	751	4.03	2.42	0.60	782
23	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
23	18	4.11	3.62	0.88	632	3.94	3.47	0.88	664	3.78	3.33	0.88	695	3.64	3.20	0.88	727
23	20	4.29	3.26	0.76	664	4.11	3.13	0.76	703	3.99	3.03	0.76	719	3.85	2.93	0.76	751
23	22	4.46	2.86	0.64	687	4.31	2.76	0.64	731	4.20	2.69	0.64	751	4.03	2.58	0.64	782
24	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
24	18	4.11	3.78	0.92	632	3.94	3.62	0.92	664	3.78	3.48	0.92	695	3.64	3.35	0.92	727
24	20	4.29	3.43	0.80	664	4.11	3.29	0.80	703	3.99	3.19	0.80	719	3.85	3.08	0.80	751
24	22	4.46	3.03	0.68	687	4.31	2.93	0.68	731	4.20	2.86	0.68	751	4.03	2.74	0.68	782
24	24	4.69	2.63	0.56	719	4.52	2.53	0.56	758	4.41	2.47	0.56	782	4.27	2.39	0.56	822
25	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
25	18	4.11	3.95	0.96	632	3.94	3.78	0.96	664	3.78	3.63	0.96	695	3.64	3.49	0.96	727
25	20	4.29	3.60	0.84	664	4.11	3.45	0.84	703	3.99	3.35	0.84	719	3.85	3.23	0.84	751
25	22	4.46	3.21	0.72	687	4.31	3.10	0.72	731	4.20	3.02	0.72	751	4.03	2.90	0.72	782
25	24	4.69	2.81	0.60	719	4.52	2.71	0.60	758	4.41	2.65	0.60	782	4.27	2.56	0.60	822
26	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
26	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
26	20	4.29	3.77	0.88	664	4.11	3.62	0.88	703	3.99	3.51	0.88	719	3.85	3.39	0.88	751
26	22	4.46	3.39	0.76	687	4.31	3.27	0.76	731	4.20	3.19	0.76	751	4.03	3.06	0.76	782
26	24	4.69	3.00	0.64	719	4.52	2.89	0.64	758	4.41	2.82	0.64	782	4.27	2.73	0.64	822
26	26	4.83	2.51	0.52	758	4.69	2.44	0.52	798	4.62	2.40	0.52	822	4.48	2.33	0.52	845
27	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
27	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
27	20	4.29	3.94	0.92	664	4.11	3.78	0.92	703	3.99	3.67	0.92	719	3.85	3.54	0.92	751
27	22	4.46	3.57	0.80	687	4.31	3.44	0.80	731	4.20	3.36	0.80	751	4.03	3.22	0.80	782
27	24	4.69	3.19	0.68	719	4.52	3.07	0.68	758	4.41	3.00	0.68	782	4.27	2.90	0.68	822
27	26	4.83	2.70	0.56	758	4.69	2.63	0.56	798	4.62	2.59	0.56	822	4.48	2.51	0.56	845
28	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
28	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
28	20	4.29	4.12	0.96	664	4.11	3.95	0.96	703	3.99	3.83	0.96	719	3.85	3.70	0.96	751
28	22	4.46	3.75	0.84	687	4.31	3.62	0.84	731	4.20	3.53	0.84	751	4.03	3.38	0.84	782
28	24	4.69	3.38	0.72	719	4.52	3.25	0.72	758	4.41	3.18	0.72	782	4.27	3.07	0.72	822
28	26	4.83	2.90	0.60	758	4.69	2.81	0.60	798	4.62	2.77	0.60	822	4.48	2.69	0.60	845
29	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
29	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
29	20	4.29	4.29	1.00	664	4.11	4.11	1.00	703	3.99	3.99	1.00	719	3.85	3.85	1.00	751
29	22	4.46	3.93	0.88	687	4.31	3.79	0.88	731	4.20	3.70	0.88	751	4.03	3.54	0.88	782
29	24	4.69	3.56	0.76	719	4.52	3.43	0.76	758	4.41	3.35	0.76	782	4.27	3.25	0.76	822
29	26	4.83	3.09	0.64	758	4.69	3.00	0.64	798	4.62	2.96	0.64	822	4.48	2.87	0.64	845
30	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
30	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
30	20	4.29	4.29	1.00	664	4.11	4.11	1.00	703	3.99	3.99	1.00	719	3.85	3.85	1.00	751
30	22	4.46	4.11	0.92	687	4.31	3.96	0.92	731	4.20	3.86	0.92	751	4.03	3.70	0.92	782
30	24	4.69	3.75	0.80	719	4.52	3.61	0.80	758	4.41	3.53	0.80	782	4.27	3.42	0.80	822
30	26	4.83	3.28	0.68	758	4.69	3.19	0.68	798	4.62	3.14	0.68	822	4.48	3.05	0.68	845
31	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
31	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
31	20	4.29	4.29	1.00	664	4.11	4.11	1.00	703	3.99	3.99	1.00	719	3.85	3.85	1.00	751
31	22	4.46	4.28	0.96	687	4.31	4.13	0.96	731	4.20	4.03	0.96	751	4.03	3.86	0.96	782
31	24	4.69	3.94	0.84	719	4.52	3.79	0.84	758	4.41	3.70	0.84	782	4.27	3.59	0.84	822
31	26	4.83	3.48	0.72	758	4.69	3.38	0.72	798	4.62	3.33	0.72	822	4.48	3.23	0.72	845
32	15	3.84	3.84	1.00	584	3.65	3.65	1.00	617	3.47	3.47	1.00	643	3.32	3.32	1.00	677
32	18	4.11	4.11	1.00	632	3.94	3.94	1.00	664	3.78	3.78	1.00	695	3.64	3.64	1.00	727
32	20	4.29	4.29	1.00	664	4.11	4.11	1.00	703	3.99	3.99	1.00	719	3.85	3.85	1.00	751
32	22	4.46	4.46	1.00	687	4.31	4.31	1.00	731	4.20	4.20	1.00	751	4.03	4.03	1.00	782
32	24	4.69	4.13	0.88	719	4.52	3.97	0.88	758	4.41	3.88	0.88	782	4.27	3.76	0.88	822
32	26	4.83	3.67	0.76	758	4.69	3.56	0.76	798	4.62	3.51	0.76	822	4.48	3.40	0.76	845

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MSY-TP35VF: MUY-TP35VF
 CAPACITY: 3.5 kW SHF: 0.98 INPUT: 790 W

SHF: 0.9 (When Cooling capacity is 3.5 kW under our measurement condition)
 Our measurement condition: Indoor temperature 24°C
 Relative humidity 45%
 Outdoor temperature 34°C

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	15	3.11	3.05	0.98	727	2.84	2.78	0.98	775	2.58	2.53	0.98	810
21	18	3.43	2.74	0.80	774	3.15	2.52	0.80	822	2.91	2.32	0.80	853
21	20	3.61	2.45	0.68	806	3.36	2.28	0.68	845	3.12	2.12	0.68	893
22	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
22	18	3.43	2.88	0.84	774	3.15	2.65	0.84	822	2.91	2.44	0.84	853
22	20	3.61	2.60	0.72	806	3.36	2.42	0.72	845	3.12	2.24	0.72	893
22	22	3.82	2.29	0.60	837	3.57	2.14	0.60	885	3.33	2.00	0.60	916
23	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
23	18	3.43	3.02	0.88	774	3.15	2.77	0.88	822	2.91	2.56	0.88	853
23	20	3.61	2.74	0.76	806	3.36	2.55	0.76	845	3.12	2.37	0.76	893
23	22	3.82	2.44	0.64	837	3.57	2.28	0.64	885	3.33	2.13	0.64	916
24	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
24	18	3.43	3.16	0.92	774	3.15	2.90	0.92	822	2.91	2.67	0.92	853
24	20	3.61	2.88	0.80	806	3.36	2.69	0.80	845	3.12	2.49	0.80	893
24	22	3.82	2.59	0.68	837	3.57	2.43	0.68	885	3.33	2.26	0.68	916
24	24	4.03	2.25	0.56	869	3.78	2.12	0.56	909	3.57	2.00	0.56	948
25	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
25	18	3.43	3.29	0.96	774	3.15	3.02	0.96	822	2.91	2.79	0.96	853
25	20	3.61	3.03	0.84	806	3.36	2.82	0.84	845	3.12	2.62	0.84	893
25	22	3.82	2.75	0.72	837	3.57	2.57	0.72	885	3.33	2.39	0.72	916
25	24	4.03	2.42	0.60	869	3.78	2.27	0.60	909	3.57	2.14	0.60	948
26	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
26	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
26	20	3.61	3.17	0.88	806	3.36	2.96	0.88	845	3.12	2.74	0.88	893
26	22	3.82	2.90	0.76	837	3.57	2.71	0.76	885	3.33	2.53	0.76	916
26	24	4.03	2.58	0.64	869	3.78	2.42	0.64	909	3.57	2.28	0.64	948
26	26	4.24	2.20	0.52	901	3.99	2.07	0.52	940	3.75	1.95	0.52	980
27	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
27	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
27	20	3.61	3.32	0.92	806	3.36	3.09	0.92	845	3.12	2.87	0.92	893
27	22	3.82	3.05	0.80	837	3.57	2.86	0.80	885	3.33	2.66	0.80	916
27	24	4.03	2.74	0.68	869	3.78	2.57	0.68	909	3.57	2.43	0.68	948
27	26	4.24	2.37	0.56	901	3.99	2.23	0.56	940	3.75	2.10	0.56	980
28	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
28	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
28	20	3.61	3.46	0.96	806	3.36	3.23	0.96	845	3.12	2.99	0.96	893
28	22	3.82	3.20	0.84	837	3.57	3.00	0.84	885	3.33	2.79	0.84	916
28	24	4.03	2.90	0.72	869	3.78	2.72	0.72	909	3.57	2.57	0.72	948
28	26	4.24	2.54	0.60	901	3.99	2.39	0.60	940	3.75	2.25	0.60	980
29	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
29	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
29	20	3.61	3.61	1.00	806	3.36	3.36	1.00	845	3.12	3.12	1.00	893
29	22	3.82	3.36	0.88	837	3.57	3.14	0.88	885	3.33	2.93	0.88	916
29	24	4.03	3.06	0.76	869	3.78	2.87	0.76	909	3.57	2.71	0.76	948
29	26	4.24	2.71	0.64	901	3.99	2.55	0.64	940	3.75	2.40	0.64	980
30	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
30	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
30	20	3.61	3.61	1.00	806	3.36	3.36	1.00	845	3.12	3.12	1.00	893
30	22	3.82	3.51	0.92	837	3.57	3.28	0.92	885	3.33	3.06	0.92	916
30	24	4.03	3.22	0.80	869	3.78	3.02	0.80	909	3.57	2.86	0.80	948
30	26	4.24	2.88	0.68	901	3.99	2.71	0.68	940	3.75	2.55	0.68	980
31	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
31	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
31	20	3.61	3.61	1.00	806	3.36	3.36	1.00	845	3.12	3.12	1.00	893
31	22	3.82	3.66	0.96	837	3.57	3.43	0.96	885	3.33	3.19	0.96	916
31	24	4.03	3.38	0.84	869	3.78	3.18	0.84	909	3.57	3.00	0.84	948
31	26	4.24	3.05	0.72	901	3.99	2.87	0.72	940	3.75	2.70	0.72	980
32	15	3.11	3.11	1.00	727	2.84	2.84	1.00	775	2.58	2.58	1.00	810
32	18	3.43	3.43	1.00	774	3.15	3.15	1.00	822	2.91	2.91	1.00	853
32	20	3.61	3.61	1.00	806	3.36	3.36	1.00	845	3.12	3.12	1.00	893
32	22	3.82	3.82	1.00	837	3.57	3.57	1.00	885	3.33	3.33	1.00	916
32	24	4.03	3.54	0.88	869	3.78	3.33	0.88	909	3.57	3.14	0.88	948
32	26	4.24	3.22	0.76	901	3.99	3.03	0.76	940	3.75	2.85	0.76	980

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MSY-TP50VF: MUY-TP50VF
 CAPACITY: 5.0 kW SHF: 0.82 INPUT: 1460 W
 SHF: 0.87 (When Cooling capacity is 5.0 kW under our measurement condition)
 Our measurement condition: Indoor temperature 24°C
 Relative humidity 45%
 Outdoor temperature 34°C

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	15	5.48	4.49	0.82	1080	5.21	4.27	0.82	1141	4.95	4.06	0.82	1188	4.74	3.89	0.82	1252
21	18	5.88	3.76	0.64	1168	5.63	3.60	0.64	1226	5.40	3.46	0.64	1285	5.20	3.33	0.64	1343
21	20	6.13	3.19	0.52	1226	5.88	3.06	0.52	1299	5.70	2.96	0.52	1329	5.50	2.86	0.52	1387
22	15	5.48	4.71	0.86	1080	5.21	4.48	0.86	1141	4.95	4.26	0.86	1188	4.74	4.08	0.86	1252
22	18	5.88	4.00	0.68	1168	5.63	3.83	0.68	1226	5.40	3.67	0.68	1285	5.20	3.54	0.68	1343
22	20	6.13	3.43	0.56	1226	5.88	3.29	0.56	1299	5.70	3.19	0.56	1329	5.50	3.08	0.56	1387
22	22	6.38	2.81	0.44	1270	6.15	2.71	0.44	1351	6.00	2.64	0.44	1387	5.75	2.53	0.44	1445
23	15	5.48	4.93	0.90	1080	5.21	4.69	0.90	1141	4.95	4.46	0.90	1188	4.74	4.27	0.90	1252
23	18	5.88	4.23	0.72	1168	5.63	4.05	0.72	1226	5.40	3.89	0.72	1285	5.20	3.74	0.72	1343
23	20	6.13	3.68	0.60	1226	5.88	3.53	0.60	1299	5.70	3.42	0.60	1329	5.50	3.30	0.60	1387
23	22	6.38	3.06	0.48	1270	6.15	2.95	0.48	1351	6.00	2.88	0.48	1387	5.75	2.76	0.48	1445
24	15	5.48	5.15	0.94	1080	5.21	4.90	0.94	1141	4.95	4.65	0.94	1188	4.74	4.46	0.94	1252
24	18	5.88	4.47	0.76	1168	5.63	4.28	0.76	1226	5.40	4.10	0.76	1285	5.20	3.95	0.76	1343
24	20	6.13	3.92	0.64	1226	5.88	3.76	0.64	1299	5.70	3.65	0.64	1329	5.50	3.52	0.64	1387
24	22	6.38	3.32	0.52	1270	6.15	3.20	0.52	1351	6.00	3.12	0.52	1387	5.75	2.99	0.52	1445
24	24	6.70	2.68	0.40	1329	6.45	2.58	0.40	1402	6.30	2.52	0.40	1445	6.10	2.44	0.40	1518
25	15	5.48	5.37	0.98	1080	5.21	5.11	0.98	1141	4.95	4.85	0.98	1188	4.74	4.65	0.98	1252
25	18	5.88	4.70	0.80	1168	5.63	4.50	0.80	1226	5.40	4.32	0.80	1285	5.20	4.16	0.80	1343
25	20	6.13	4.17	0.68	1226	5.88	4.00	0.68	1299	5.70	3.88	0.68	1329	5.50	3.74	0.68	1387
25	22	6.38	3.57	0.56	1270	6.15	3.44	0.56	1351	6.00	3.36	0.56	1387	5.75	3.22	0.56	1445
25	24	6.70	2.95	0.44	1329	6.45	2.84	0.44	1402	6.30	2.77	0.44	1445	6.10	2.68	0.44	1518
26	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
26	18	5.88	4.94	0.84	1168	5.63	4.73	0.84	1226	5.40	4.54	0.84	1285	5.20	4.37	0.84	1343
26	20	6.13	4.41	0.72	1226	5.88	4.23	0.72	1299	5.70	4.10	0.72	1329	5.50	3.96	0.72	1387
26	22	6.38	3.83	0.60	1270	6.15	3.69	0.60	1351	6.00	3.60	0.60	1387	5.75	3.45	0.60	1445
26	24	6.70	3.22	0.48	1329	6.45	3.10	0.48	1402	6.30	3.02	0.48	1445	6.10	2.93	0.48	1518
26	26	6.90	2.48	0.36	1402	6.70	2.41	0.36	1475	6.60	2.38	0.36	1518	6.40	2.30	0.36	1562
27	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
27	18	5.88	5.17	0.88	1168	5.63	4.95	0.88	1226	5.40	4.75	0.88	1285	5.20	4.58	0.88	1343
27	20	6.13	4.66	0.76	1226	5.88	4.47	0.76	1299	5.70	4.33	0.76	1329	5.50	4.18	0.76	1387
27	22	6.38	4.08	0.64	1270	6.15	3.94	0.64	1351	6.00	3.84	0.64	1387	5.75	3.68	0.64	1445
27	24	6.70	3.48	0.52	1329	6.45	3.35	0.52	1402	6.30	3.28	0.52	1445	6.10	3.17	0.52	1518
27	26	6.90	2.76	0.40	1402	6.70	2.68	0.40	1475	6.60	2.64	0.40	1518	6.40	2.56	0.40	1562
28	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
28	18	5.88	5.41	0.92	1168	5.63	5.18	0.92	1226	5.40	4.97	0.92	1285	5.20	4.78	0.92	1343
28	20	6.13	4.90	0.80	1226	5.88	4.70	0.80	1299	5.70	4.56	0.80	1329	5.50	4.40	0.80	1387
28	22	6.38	4.34	0.68	1270	6.15	4.18	0.68	1351	6.00	4.08	0.68	1387	5.75	3.91	0.68	1445
28	24	6.70	3.75	0.56	1329	6.45	3.61	0.56	1402	6.30	3.53	0.56	1445	6.10	3.42	0.56	1518
28	26	6.90	3.04	0.44	1402	6.70	2.95	0.44	1475	6.60	2.90	0.44	1518	6.40	2.82	0.44	1562
29	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
29	18	5.88	5.64	0.96	1168	5.63	5.40	0.96	1226	5.40	5.18	0.96	1285	5.20	4.99	0.96	1343
29	20	6.13	5.15	0.84	1226	5.88	4.94	0.84	1299	5.70	4.79	0.84	1329	5.50	4.62	0.84	1387
29	22	6.38	4.59	0.72	1270	6.15	4.43	0.72	1351	6.00	4.32	0.72	1387	5.75	4.14	0.72	1445
29	24	6.70	4.02	0.60	1329	6.45	3.87	0.60	1402	6.30	3.78	0.60	1445	6.10	3.66	0.60	1518
29	26	6.90	3.31	0.48	1402	6.70	3.22	0.48	1475	6.60	3.17	0.48	1518	6.40	3.07	0.48	1562
30	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
30	18	5.88	5.88	1.00	1168	5.63	5.63	1.00	1226	5.40	5.40	1.00	1285	5.20	5.20	1.00	1343
30	20	6.13	5.39	0.88	1226	5.88	5.17	0.88	1299	5.70	5.02	0.88	1329	5.50	4.84	0.88	1387
30	22	6.38	4.85	0.76	1270	6.15	4.67	0.76	1351	6.00	4.56	0.76	1387	5.75	4.37	0.76	1445
30	24	6.70	4.29	0.64	1329	6.45	4.13	0.64	1402	6.30	4.03	0.64	1445	6.10	3.90	0.64	1518
30	26	6.90	3.59	0.52	1402	6.70	3.48	0.52	1475	6.60	3.43	0.52	1518	6.40	3.33	0.52	1562
31	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
31	18	5.88	5.88	1.00	1168	5.63	5.63	1.00	1226	5.40	5.40	1.00	1285	5.20	5.20	1.00	1343
31	20	6.13	5.64	0.92	1226	5.88	5.41	0.92	1299	5.70	5.24	0.92	1329	5.50	5.06	0.92	1387
31	22	6.38	5.10	0.80	1270	6.15	4.92	0.80	1351	6.00	4.80	0.80	1387	5.75	4.60	0.80	1445
31	24	6.70	4.56	0.68	1329	6.45	4.39	0.68	1402	6.30	4.28	0.68	1445	6.10	4.15	0.68	1518
31	26	6.90	3.86	0.56	1402	6.70	3.75	0.56	1475	6.60	3.70	0.56	1518	6.40	3.58	0.56	1562
32	15	5.48	5.48	1.00	1080	5.21	5.21	1.00	1141	4.95	4.95	1.00	1188	4.74	4.74	1.00	1252
32	18	5.88	5.88	1.00	1168	5.63	5.63	1.00	1226	5.40	5.40	1.00	1285	5.20	5.20	1.00	1343
32	20	6.13	5.88	0.96	1226	5.88	5.64	0.96	1299	5.70	5.47	0.96	1329	5.50	5.28	0.96	1387
32	22	6.38	5.36	0.84	1270	6.15	5.17	0.84	1351	6.00	5.04	0.84	1387	5.75	4.83	0.84	1445
32	24	6.70	4.82	0.72	1329	6.45	4.64	0.72	1402	6.30	4.54	0.72	1445	6.10	4.39	0.72	1518
32	26	6.90	4.14	0.60	1402	6.70	4.02	0.60	1475	6.60	3.96	0.60	1518	6.40	3.84	0.60	1562

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency

MSY-TP50VF: MUY-TP50VF

CAPACITY: 5.0 kW

SHF: 0.82

INPUT: 1460 W

SHF: 0.87 (When Cooling capacity is 5.0 kW under our measurement condition)
 Our measurement condition: Indoor temperature 24°C
 Relative humidity 45%
 Outdoor temperature 34°C

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	15	4.45	3.64	0.82	1343	4.05	3.32	0.82	1432	3.69	3.03	0.82	1497
21	18	4.90	3.14	0.64	1431	4.50	2.88	0.64	1518	4.15	2.66	0.64	1577
21	20	5.15	2.68	0.52	1489	4.80	2.50	0.52	1562	4.45	2.31	0.52	1650
22	15	4.45	3.82	0.86	1343	4.05	3.48	0.86	1432	3.69	3.18	0.86	1497
22	18	4.90	3.33	0.68	1431	4.50	3.06	0.68	1518	4.15	2.82	0.68	1577
22	20	5.15	2.88	0.56	1489	4.80	2.69	0.56	1562	4.45	2.49	0.56	1650
22	22	5.45	2.40	0.44	1548	5.10	2.24	0.44	1635	4.75	2.09	0.44	1694
23	15	4.45	4.00	0.90	1343	4.05	3.65	0.90	1432	3.69	3.32	0.90	1497
23	18	4.90	3.53	0.72	1431	4.50	3.24	0.72	1518	4.15	2.99	0.72	1577
23	20	5.15	3.09	0.60	1489	4.80	2.88	0.60	1562	4.45	2.67	0.60	1650
23	22	5.45	2.62	0.48	1548	5.10	2.45	0.48	1635	4.75	2.28	0.48	1694
24	15	4.45	4.18	0.94	1343	4.05	3.81	0.94	1432	3.69	3.47	0.94	1497
24	18	4.90	3.72	0.76	1431	4.50	3.42	0.76	1518	4.15	3.15	0.76	1577
24	20	5.15	3.30	0.64	1489	4.80	3.07	0.64	1562	4.45	2.85	0.64	1650
24	22	5.45	2.83	0.52	1548	5.10	2.65	0.52	1635	4.75	2.47	0.52	1694
24	24	5.75	2.30	0.40	1606	5.40	2.16	0.40	1679	5.10	2.04	0.40	1752
25	15	4.45	4.36	0.98	1343	4.05	3.97	0.98	1432	3.69	3.62	0.98	1497
25	18	4.90	3.92	0.80	1431	4.50	3.60	0.80	1518	4.15	3.32	0.80	1577
25	20	5.15	3.50	0.68	1489	4.80	3.26	0.68	1562	4.45	3.03	0.68	1650
25	22	5.45	3.05	0.56	1548	5.10	2.86	0.56	1635	4.75	2.66	0.56	1694
25	24	5.75	2.53	0.44	1606	5.40	2.38	0.44	1679	5.10	2.24	0.44	1752
26	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
26	18	4.90	4.12	0.84	1431	4.50	3.78	0.84	1518	4.15	3.49	0.84	1577
26	20	5.15	3.71	0.72	1489	4.80	3.46	0.72	1562	4.45	3.20	0.72	1650
26	22	5.45	3.27	0.60	1548	5.10	3.06	0.60	1635	4.75	2.85	0.60	1694
26	24	5.75	2.76	0.48	1606	5.40	2.59	0.48	1679	5.10	2.45	0.48	1752
26	26	6.05	2.18	0.36	1664	5.70	2.05	0.36	1737	5.35	1.93	0.36	1810
27	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
27	18	4.90	4.31	0.88	1431	4.50	3.96	0.88	1518	4.15	3.65	0.88	1577
27	20	5.15	3.91	0.76	1489	4.80	3.65	0.76	1562	4.45	3.38	0.76	1650
27	22	5.45	3.49	0.64	1548	5.10	3.26	0.64	1635	4.75	3.04	0.64	1694
27	24	5.75	2.99	0.52	1606	5.40	2.81	0.52	1679	5.10	2.65	0.52	1752
27	26	6.05	2.42	0.40	1664	5.70	2.28	0.40	1737	5.35	2.14	0.40	1810
28	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
28	18	4.90	4.51	0.92	1431	4.50	4.14	0.92	1518	4.15	3.82	0.92	1577
28	20	5.15	4.12	0.80	1489	4.80	3.84	0.80	1562	4.45	3.56	0.80	1650
28	22	5.45	3.71	0.68	1548	5.10	3.47	0.68	1635	4.75	3.23	0.68	1694
28	24	5.75	3.22	0.56	1606	5.40	3.02	0.56	1679	5.10	2.86	0.56	1752
28	26	6.05	2.66	0.44	1664	5.70	2.51	0.44	1737	5.35	2.35	0.44	1810
29	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
29	18	4.90	4.70	0.96	1431	4.50	4.32	0.96	1518	4.15	3.98	0.96	1577
29	20	5.15	4.33	0.84	1489	4.80	4.03	0.84	1562	4.45	3.74	0.84	1650
29	22	5.45	3.92	0.72	1548	5.10	3.67	0.72	1635	4.75	3.42	0.72	1694
29	24	5.75	3.45	0.60	1606	5.40	3.24	0.60	1679	5.10	3.06	0.60	1752
29	26	6.05	2.90	0.48	1664	5.70	2.74	0.48	1737	5.35	2.57	0.48	1810
30	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
30	18	4.90	4.90	1.00	1431	4.50	4.50	1.00	1518	4.15	4.15	1.00	1577
30	20	5.15	4.53	0.88	1489	4.80	4.22	0.88	1562	4.45	3.92	0.88	1650
30	22	5.45	4.14	0.76	1548	5.10	3.88	0.76	1635	4.75	3.61	0.76	1694
30	24	5.75	3.68	0.64	1606	5.40	3.46	0.64	1679	5.10	3.26	0.64	1752
30	26	6.05	3.15	0.52	1664	5.70	2.96	0.52	1737	5.35	2.78	0.52	1810
31	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
31	18	4.90	4.90	1.00	1431	4.50	4.50	1.00	1518	4.15	4.15	1.00	1577
31	20	5.15	4.74	0.92	1489	4.80	4.42	0.92	1562	4.45	4.09	0.92	1650
31	22	5.45	4.36	0.80	1548	5.10	4.08	0.80	1635	4.75	3.80	0.80	1694
31	24	5.75	3.91	0.68	1606	5.40	3.67	0.68	1679	5.10	3.47	0.68	1752
31	26	6.05	3.39	0.56	1664	5.70	3.19	0.56	1737	5.35	3.00	0.56	1810
32	15	4.45	4.45	1.00	1343	4.05	4.05	1.00	1432	3.69	3.69	1.00	1497
32	18	4.90	4.90	1.00	1431	4.50	4.50	1.00	1518	4.15	4.15	1.00	1577
32	20	5.15	4.94	0.96	1489	4.80	4.61	0.96	1562	4.45	4.27	0.96	1650
32	22	5.45	4.58	0.84	1548	5.10	4.28	0.84	1635	4.75	3.99	0.84	1694
32	24	5.75	4.14	0.72	1606	5.40	3.89	0.72	1679	5.10	3.67	0.72	1752
32	26	6.05	3.63	0.60	1664	5.70	3.42	0.60	1737	5.35	3.21	0.60	1810

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-FH25VE2: MUZ-FH25VE, MUZ-FH25VEHZ

CAPACITY: 2.5 kW SHF: 0.95 INPUT: 485 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.26	0.77	388	2.81	2.17	0.77	407	2.70	2.08	0.77	427	2.60	2.00	0.77	446
21	20	3.06	1.99	0.65	407	2.94	1.91	0.65	432	2.85	1.85	0.65	441	2.75	1.79	0.65	461
22	18	2.94	2.38	0.81	388	2.81	2.28	0.81	407	2.70	2.19	0.81	427	2.60	2.11	0.81	446
22	20	3.06	2.11	0.69	407	2.94	2.03	0.69	432	2.85	1.97	0.69	441	2.75	1.90	0.69	461
22	22	3.19	1.82	0.57	422	3.08	1.75	0.57	449	3.00	1.71	0.57	461	2.88	1.64	0.57	480
23	18	2.94	2.50	0.85	388	2.81	2.39	0.85	407	2.70	2.30	0.85	427	2.60	2.21	0.85	446
23	20	3.06	2.24	0.73	407	2.94	2.14	0.73	432	2.85	2.08	0.73	441	2.75	2.01	0.73	461
23	22	3.19	1.94	0.61	422	3.08	1.88	0.61	449	3.00	1.83	0.61	461	2.88	1.75	0.61	480
24	18	2.94	2.61	0.89	388	2.81	2.50	0.89	407	2.70	2.40	0.89	427	2.60	2.31	0.89	446
24	20	3.06	2.36	0.77	407	2.94	2.26	0.77	432	2.85	2.19	0.77	441	2.75	2.12	0.77	461
24	22	3.19	2.07	0.65	422	3.08	2.00	0.65	449	3.00	1.95	0.65	461	2.88	1.87	0.65	480
24	24	3.35	1.78	0.53	441	3.23	1.71	0.53	466	3.15	1.67	0.53	480	3.05	1.62	0.53	504
25	18	2.94	2.73	0.93	388	2.81	2.62	0.93	407	2.70	2.51	0.93	427	2.60	2.42	0.93	446
25	20	3.06	2.48	0.81	407	2.94	2.38	0.81	432	2.85	2.31	0.81	441	2.75	2.23	0.81	461
25	22	3.19	2.20	0.69	422	3.08	2.12	0.69	449	3.00	2.07	0.69	461	2.88	1.98	0.69	480
25	24	3.35	1.91	0.57	441	3.23	1.84	0.57	466	3.15	1.80	0.57	480	3.05	1.74	0.57	504
26	18	2.94	2.85	0.97	388	2.81	2.73	0.97	407	2.70	2.62	0.97	427	2.60	2.52	0.97	446
26	20	3.06	2.60	0.85	407	2.94	2.50	0.85	432	2.85	2.42	0.85	441	2.75	2.34	0.85	461
26	22	3.19	2.33	0.73	422	3.08	2.24	0.73	449	3.00	2.19	0.73	461	2.88	2.10	0.73	480
26	24	3.35	2.04	0.61	441	3.23	1.97	0.61	466	3.15	1.92	0.61	480	3.05	1.86	0.61	504
26	26	3.45	1.69	0.49	466	3.35	1.64	0.49	490	3.30	1.62	0.49	504	3.20	1.57	0.49	519
27	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
27	20	3.06	2.73	0.89	407	2.94	2.61	0.89	432	2.85	2.54	0.89	441	2.75	2.45	0.89	461
27	22	3.19	2.45	0.77	422	3.08	2.37	0.77	449	3.00	2.31	0.77	461	2.88	2.21	0.77	480
27	24	3.35	2.18	0.65	441	3.23	2.10	0.65	466	3.15	2.05	0.65	480	3.05	1.98	0.65	504
27	26	3.45	1.83	0.53	466	3.35	1.78	0.53	490	3.30	1.75	0.53	504	3.20	1.70	0.53	519
28	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
28	20	3.06	2.85	0.93	407	2.94	2.73	0.93	432	2.85	2.65	0.93	441	2.75	2.56	0.93	461
28	22	3.19	2.58	0.81	422	3.08	2.49	0.81	449	3.00	2.43	0.81	461	2.88	2.33	0.81	480
28	24	3.35	2.31	0.69	441	3.23	2.23	0.69	466	3.15	2.17	0.69	480	3.05	2.10	0.69	504
28	26	3.45	1.97	0.57	466	3.35	1.91	0.57	490	3.30	1.88	0.57	504	3.20	1.82	0.57	519
29	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
29	20	3.06	2.97	0.97	407	2.94	2.85	0.97	432	2.85	2.76	0.97	441	2.75	2.67	0.97	461
29	22	3.19	2.71	0.85	422	3.08	2.61	0.85	449	3.00	2.55	0.85	461	2.88	2.44	0.85	480
29	24	3.35	2.45	0.73	441	3.23	2.35	0.73	466	3.15	2.30	0.73	480	3.05	2.23	0.73	504
29	26	3.45	2.10	0.61	466	3.35	2.04	0.61	490	3.30	2.01	0.61	504	3.20	1.95	0.61	519
30	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
30	20	3.06	3.06	1.00	407	2.94	2.94	1.00	432	2.85	2.85	1.00	441	2.75	2.75	1.00	461
30	22	3.19	2.84	0.89	422	3.08	2.74	0.89	449	3.00	2.67	0.89	461	2.88	2.56	0.89	480
30	24	3.35	2.58	0.77	441	3.23	2.48	0.77	466	3.15	2.43	0.77	480	3.05	2.35	0.77	504
30	26	3.45	2.24	0.65	466	3.35	2.18	0.65	490	3.30	2.15	0.65	504	3.20	2.08	0.65	519
31	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
31	20	3.06	3.06	1.00	407	2.94	2.94	1.00	432	2.85	2.85	1.00	441	2.75	2.75	1.00	461
31	22	3.19	2.96	0.93	422	3.08	2.86	0.93	449	3.00	2.79	0.93	461	2.88	2.67	0.93	480
31	24	3.35	2.71	0.81	441	3.23	2.61	0.81	466	3.15	2.55	0.81	480	3.05	2.47	0.81	504
31	26	3.45	2.38	0.69	466	3.35	2.31	0.69	490	3.30	2.28	0.69	504	3.20	2.21	0.69	519
32	18	2.94	2.94	1.00	388	2.81	2.81	1.00	407	2.70	2.70	1.00	427	2.60	2.60	1.00	446
32	20	3.06	3.06	1.00	407	2.94	2.94	1.00	432	2.85	2.85	1.00	441	2.75	2.75	1.00	461
32	22	3.19	3.09	0.97	422	3.08	2.98	0.97	449	3.00	2.91	0.97	461	2.88	2.79	0.97	480
32	24	3.35	2.85	0.85	441	3.23	2.74	0.85	466	3.15	2.68	0.85	480	3.05	2.59	0.85	504
32	26	3.45	2.52	0.73	466	3.35	2.45	0.73	490	3.30	2.41	0.73	504	3.20	2.34	0.73	519

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-FH25VE2: MUZ-FH25VE, MUZ-FH25VEHZ

CAPACITY: 2.5 kW SHF: 0.95 INPUT: 485 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.89	0.77	475	2.25	1.73	0.77	504	2.08	1.60	0.77	524
21	20	2.58	1.67	0.65	495	2.40	1.56	0.65	519	2.23	1.45	0.65	548
22	18	2.45	1.98	0.81	475	2.25	1.82	0.81	504	2.08	1.68	0.81	524
22	20	2.58	1.78	0.69	495	2.40	1.66	0.69	519	2.23	1.54	0.69	548
22	22	2.73	1.55	0.57	514	2.55	1.45	0.57	543	2.38	1.35	0.57	563
23	18	2.45	2.08	0.85	475	2.25	1.91	0.85	504	2.08	1.76	0.85	524
23	20	2.58	1.88	0.73	495	2.40	1.75	0.73	519	2.23	1.62	0.73	548
23	22	2.73	1.66	0.61	514	2.55	1.56	0.61	543	2.38	1.45	0.61	563
24	18	2.45	2.18	0.89	475	2.25	2.00	0.89	504	2.08	1.85	0.89	524
24	20	2.58	1.98	0.77	495	2.40	1.85	0.77	519	2.23	1.71	0.77	548
24	22	2.73	1.77	0.65	514	2.55	1.66	0.65	543	2.38	1.54	0.65	563
24	24	2.88	1.52	0.53	534	2.70	1.43	0.53	558	2.55	1.35	0.53	582
25	18	2.45	2.28	0.93	475	2.25	2.09	0.93	504	2.08	1.93	0.93	524
25	20	2.58	2.09	0.81	495	2.40	1.94	0.81	519	2.23	1.80	0.81	548
25	22	2.73	1.88	0.69	514	2.55	1.76	0.69	543	2.38	1.64	0.69	563
25	24	2.88	1.64	0.57	534	2.70	1.54	0.57	558	2.55	1.45	0.57	582
26	18	2.45	2.38	0.97	475	2.25	2.18	0.97	504	2.08	2.01	0.97	524
26	20	2.58	2.19	0.85	495	2.40	2.04	0.85	519	2.23	1.89	0.85	548
26	22	2.73	1.99	0.73	514	2.55	1.86	0.73	543	2.38	1.73	0.73	563
26	24	2.88	1.75	0.61	534	2.70	1.65	0.61	558	2.55	1.56	0.61	582
26	26	3.03	1.48	0.49	553	2.85	1.40	0.49	577	2.68	1.31	0.49	601
27	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
27	20	2.58	2.29	0.89	495	2.40	2.14	0.89	519	2.23	1.98	0.89	548
27	22	2.73	2.10	0.77	514	2.55	1.96	0.77	543	2.38	1.83	0.77	563
27	24	2.88	1.87	0.65	534	2.70	1.76	0.65	558	2.55	1.66	0.65	582
27	26	3.03	1.60	0.53	553	2.85	1.51	0.53	577	2.68	1.42	0.53	601
28	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
28	20	2.58	2.39	0.93	495	2.40	2.23	0.93	519	2.23	2.07	0.93	548
28	22	2.73	2.21	0.81	514	2.55	2.07	0.81	543	2.38	1.92	0.81	563
28	24	2.88	1.98	0.69	534	2.70	1.86	0.69	558	2.55	1.76	0.69	582
28	26	3.03	1.72	0.57	553	2.85	1.62	0.57	577	2.68	1.52	0.57	601
29	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
29	20	2.58	2.50	0.97	495	2.40	2.33	0.97	519	2.23	2.16	0.97	548
29	22	2.73	2.32	0.85	514	2.55	2.17	0.85	543	2.38	2.02	0.85	563
29	24	2.88	2.10	0.73	534	2.70	1.97	0.73	558	2.55	1.86	0.73	582
29	26	3.03	1.85	0.61	553	2.85	1.74	0.61	577	2.68	1.63	0.61	601
30	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
30	20	2.58	2.58	1.00	495	2.40	2.40	1.00	519	2.23	2.23	1.00	548
30	22	2.73	2.43	0.89	514	2.55	2.27	0.89	543	2.38	2.11	0.89	563
30	24	2.88	2.21	0.77	534	2.70	2.08	0.77	558	2.55	1.96	0.77	582
30	26	3.03	1.97	0.65	553	2.85	1.85	0.65	577	2.68	1.74	0.65	601
31	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
31	20	2.58	2.58	1.00	495	2.40	2.40	1.00	519	2.23	2.23	1.00	548
31	22	2.73	2.53	0.93	514	2.55	2.37	0.93	543	2.38	2.21	0.93	563
31	24	2.88	2.33	0.81	534	2.70	2.19	0.81	558	2.55	2.07	0.81	582
31	26	3.03	2.09	0.69	553	2.85	1.97	0.69	577	2.68	1.85	0.69	601
32	18	2.45	2.45	1.00	475	2.25	2.25	1.00	504	2.08	2.08	1.00	524
32	20	2.58	2.58	1.00	495	2.40	2.40	1.00	519	2.23	2.23	1.00	548
32	22	2.73	2.64	0.97	514	2.55	2.47	0.97	543	2.38	2.30	0.97	563
32	24	2.88	2.44	0.85	534	2.70	2.30	0.85	558	2.55	2.17	0.85	582
32	26	3.03	2.21	0.73	553	2.85	2.08	0.73	577	2.68	1.95	0.73	601

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-FH35VE2: MUZ-FH35VE, MUZ-FH35VEHZ

CAPACITY: 3.5 kW SHF: 0.84 INPUT: 820 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.11	2.71	0.66	656	3.94	2.60	0.66	689	3.78	2.49	0.66	722	3.64	2.40	0.66	754
21	20	4.29	2.32	0.54	689	4.11	2.22	0.54	730	3.99	2.15	0.54	746	3.85	2.08	0.54	779
22	18	4.11	2.88	0.70	656	3.94	2.76	0.70	689	3.78	2.65	0.70	722	3.64	2.55	0.70	754
22	20	4.29	2.49	0.58	689	4.11	2.39	0.58	730	3.99	2.31	0.58	746	3.85	2.23	0.58	779
22	22	4.46	2.05	0.46	713	4.31	1.98	0.46	759	4.20	1.93	0.46	779	4.03	1.85	0.46	812
23	18	4.11	3.04	0.74	656	3.94	2.91	0.74	689	3.78	2.80	0.74	722	3.64	2.69	0.74	754
23	20	4.29	2.66	0.62	689	4.11	2.55	0.62	730	3.99	2.47	0.62	746	3.85	2.39	0.62	779
23	22	4.46	2.23	0.50	713	4.31	2.15	0.50	759	4.20	2.10	0.50	779	4.03	2.01	0.50	812
24	18	4.11	3.21	0.78	656	3.94	3.07	0.78	689	3.78	2.95	0.78	722	3.64	2.84	0.78	754
24	20	4.29	2.83	0.66	689	4.11	2.71	0.66	730	3.99	2.63	0.66	746	3.85	2.54	0.66	779
24	22	4.46	2.41	0.54	713	4.31	2.32	0.54	759	4.20	2.27	0.54	779	4.03	2.17	0.54	812
24	24	4.69	1.97	0.42	746	4.52	1.90	0.42	787	4.41	1.85	0.42	812	4.27	1.79	0.42	853
25	18	4.11	3.37	0.82	656	3.94	3.23	0.82	689	3.78	3.10	0.82	722	3.64	2.98	0.82	754
25	20	4.29	3.00	0.70	689	4.11	2.88	0.70	730	3.99	2.79	0.70	746	3.85	2.70	0.70	779
25	22	4.46	2.59	0.58	713	4.31	2.50	0.58	759	4.20	2.44	0.58	779	4.03	2.33	0.58	812
25	24	4.69	2.16	0.46	746	4.52	2.08	0.46	787	4.41	2.03	0.46	812	4.27	1.96	0.46	853
26	18	4.11	3.54	0.86	656	3.94	3.39	0.86	689	3.78	3.25	0.86	722	3.64	3.13	0.86	754
26	20	4.29	3.17	0.74	689	4.11	3.04	0.74	730	3.99	2.95	0.74	746	3.85	2.85	0.74	779
26	22	4.46	2.77	0.62	713	4.31	2.67	0.62	759	4.20	2.60	0.62	779	4.03	2.50	0.62	812
26	24	4.69	2.35	0.50	746	4.52	2.26	0.50	787	4.41	2.21	0.50	812	4.27	2.14	0.50	853
26	26	4.83	1.84	0.38	787	4.69	1.78	0.38	828	4.62	1.76	0.38	853	4.48	1.70	0.38	877
27	18	4.11	3.70	0.90	656	3.94	3.54	0.90	689	3.78	3.40	0.90	722	3.64	3.28	0.90	754
27	20	4.29	3.34	0.78	689	4.11	3.21	0.78	730	3.99	3.11	0.78	746	3.85	3.00	0.78	779
27	22	4.46	2.95	0.66	713	4.31	2.84	0.66	759	4.20	2.77	0.66	779	4.03	2.66	0.66	812
27	24	4.69	2.53	0.54	746	4.52	2.44	0.54	787	4.41	2.38	0.54	812	4.27	2.31	0.54	853
27	26	4.83	2.03	0.42	787	4.69	1.97	0.42	828	4.62	1.94	0.42	853	4.48	1.88	0.42	877
28	18	4.11	3.87	0.94	656	3.94	3.70	0.94	689	3.78	3.55	0.94	722	3.64	3.42	0.94	754
28	20	4.29	3.52	0.82	689	4.11	3.37	0.82	730	3.99	3.27	0.82	746	3.85	3.16	0.82	779
28	22	4.46	3.12	0.70	713	4.31	3.01	0.70	759	4.20	2.94	0.70	779	4.03	2.82	0.70	812
28	24	4.69	2.72	0.58	746	4.52	2.62	0.58	787	4.41	2.56	0.58	812	4.27	2.48	0.58	853
28	26	4.83	2.22	0.46	787	4.69	2.16	0.46	828	4.62	2.13	0.46	853	4.48	2.06	0.46	877
29	18	4.11	4.03	0.98	656	3.94	3.86	0.98	689	3.78	3.70	0.98	722	3.64	3.57	0.98	754
29	20	4.29	3.69	0.86	689	4.11	3.54	0.86	730	3.99	3.43	0.86	746	3.85	3.31	0.86	779
29	22	4.46	3.30	0.74	713	4.31	3.19	0.74	759	4.20	3.11	0.74	779	4.03	2.98	0.74	812
29	24	4.69	2.91	0.62	746	4.52	2.80	0.62	787	4.41	2.73	0.62	812	4.27	2.65	0.62	853
29	26	4.83	2.42	0.50	787	4.69	2.35	0.50	828	4.62	2.31	0.50	853	4.48	2.24	0.50	877
30	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
30	20	4.29	3.86	0.90	689	4.11	3.70	0.90	730	3.99	3.59	0.90	746	3.85	3.47	0.90	779
30	22	4.46	3.48	0.78	713	4.31	3.36	0.78	759	4.20	3.28	0.78	779	4.03	3.14	0.78	812
30	24	4.69	3.10	0.66	746	4.52	2.98	0.66	787	4.41	2.91	0.66	812	4.27	2.82	0.66	853
30	26	4.83	2.61	0.54	787	4.69	2.53	0.54	828	4.62	2.49	0.54	853	4.48	2.42	0.54	877
31	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
31	20	4.29	4.03	0.94	689	4.11	3.87	0.94	730	3.99	3.75	0.94	746	3.85	3.62	0.94	779
31	22	4.46	3.66	0.82	713	4.31	3.53	0.82	759	4.20	3.44	0.82	779	4.03	3.30	0.82	812
31	24	4.69	3.28	0.70	746	4.52	3.16	0.70	787	4.41	3.09	0.70	812	4.27	2.99	0.70	853
31	26	4.83	2.80	0.58	787	4.69	2.72	0.58	828	4.62	2.68	0.58	853	4.48	2.60	0.58	877
32	18	4.11	4.11	1.00	656	3.94	3.94	1.00	689	3.78	3.78	1.00	722	3.64	3.64	1.00	754
32	20	4.29	4.20	0.98	689	4.11	4.03	0.98	730	3.99	3.91	0.98	746	3.85	3.77	0.98	779
32	22	4.46	3.84	0.86	713	4.31	3.70	0.86	759	4.20	3.61	0.86	779	4.03	3.46	0.86	812
32	24	4.69	3.47	0.74	746	4.52	3.34	0.74	787	4.41	3.26	0.74	812	4.27	3.16	0.74	853
32	26	4.83	2.99	0.62	787	4.69	2.91	0.62	828	4.62	2.86	0.62	853	4.48	2.78	0.62	877

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-FH35VE2: MUZ-FH35VE, MUZ-FH35VEHZ

CAPACITY: 3.5 kW SHF: 0.84 INPUT: 820 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.43	2.26	0.66	804	3.15	2.08	0.66	853	2.91	1.92	0.66	886
21	20	3.61	1.95	0.54	836	3.36	1.81	0.54	877	3.12	1.68	0.54	927
22	18	3.43	2.40	0.70	804	3.15	2.21	0.70	853	2.91	2.03	0.70	886
22	20	3.61	2.09	0.58	836	3.36	1.95	0.58	877	3.12	1.81	0.58	927
22	22	3.82	1.75	0.46	869	3.57	1.64	0.46	918	3.33	1.53	0.46	951
23	18	3.43	2.54	0.74	804	3.15	2.33	0.74	853	2.91	2.15	0.74	886
23	20	3.61	2.24	0.62	836	3.36	2.08	0.62	877	3.12	1.93	0.62	927
23	22	3.82	1.91	0.50	869	3.57	1.79	0.50	918	3.33	1.66	0.50	951
24	18	3.43	2.68	0.78	804	3.15	2.46	0.78	853	2.91	2.27	0.78	886
24	20	3.61	2.38	0.66	836	3.36	2.22	0.66	877	3.12	2.06	0.66	927
24	22	3.82	2.06	0.54	869	3.57	1.93	0.54	918	3.33	1.80	0.54	951
24	24	4.03	1.69	0.42	902	3.78	1.59	0.42	943	3.57	1.50	0.42	984
25	18	3.43	2.81	0.82	804	3.15	2.58	0.82	853	2.91	2.38	0.82	886
25	20	3.61	2.52	0.70	836	3.36	2.35	0.70	877	3.12	2.18	0.70	927
25	22	3.82	2.21	0.58	869	3.57	2.07	0.58	918	3.33	1.93	0.58	951
25	24	4.03	1.85	0.46	902	3.78	1.74	0.46	943	3.57	1.64	0.46	984
26	18	3.43	2.95	0.86	804	3.15	2.71	0.86	853	2.91	2.50	0.86	886
26	20	3.61	2.67	0.74	836	3.36	2.49	0.74	877	3.12	2.31	0.74	927
26	22	3.82	2.37	0.62	869	3.57	2.21	0.62	918	3.33	2.06	0.62	951
26	24	4.03	2.01	0.50	902	3.78	1.89	0.50	943	3.57	1.79	0.50	984
26	26	4.24	1.61	0.38	935	3.99	1.52	0.38	976	3.75	1.42	0.38	1017
27	18	3.43	3.09	0.90	804	3.15	2.84	0.90	853	2.91	2.61	0.90	886
27	20	3.61	2.81	0.78	836	3.36	2.62	0.78	877	3.12	2.43	0.78	927
27	22	3.82	2.52	0.66	869	3.57	2.36	0.66	918	3.33	2.19	0.66	951
27	24	4.03	2.17	0.54	902	3.78	2.04	0.54	943	3.57	1.93	0.54	984
27	26	4.24	1.78	0.42	935	3.99	1.68	0.42	976	3.75	1.57	0.42	1017
28	18	3.43	3.22	0.94	804	3.15	2.96	0.94	853	2.91	2.73	0.94	886
28	20	3.61	2.96	0.82	836	3.36	2.76	0.82	877	3.12	2.55	0.82	927
28	22	3.82	2.67	0.70	869	3.57	2.50	0.70	918	3.33	2.33	0.70	951
28	24	4.03	2.33	0.58	902	3.78	2.19	0.58	943	3.57	2.07	0.58	984
28	26	4.24	1.95	0.46	935	3.99	1.84	0.46	976	3.75	1.72	0.46	1017
29	18	3.43	3.36	0.98	804	3.15	3.09	0.98	853	2.91	2.85	0.98	886
29	20	3.61	3.10	0.86	836	3.36	2.89	0.86	877	3.12	2.68	0.86	927
29	22	3.82	2.82	0.74	869	3.57	2.64	0.74	918	3.33	2.46	0.74	951
29	24	4.03	2.50	0.62	902	3.78	2.34	0.62	943	3.57	2.21	0.62	984
29	26	4.24	2.12	0.50	935	3.99	2.00	0.50	976	3.75	1.87	0.50	1017
30	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
30	20	3.61	3.24	0.90	836	3.36	3.02	0.90	877	3.12	2.80	0.90	927
30	22	3.82	2.98	0.78	869	3.57	2.78	0.78	918	3.33	2.59	0.78	951
30	24	4.03	2.66	0.66	902	3.78	2.49	0.66	943	3.57	2.36	0.66	984
30	26	4.24	2.29	0.54	935	3.99	2.15	0.54	976	3.75	2.02	0.54	1017
31	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
31	20	3.61	3.39	0.94	836	3.36	3.16	0.94	877	3.12	2.93	0.94	927
31	22	3.82	3.13	0.82	869	3.57	2.93	0.82	918	3.33	2.73	0.82	951
31	24	4.03	2.82	0.70	902	3.78	2.65	0.70	943	3.57	2.50	0.70	984
31	26	4.24	2.46	0.58	935	3.99	2.31	0.58	976	3.75	2.17	0.58	1017
32	18	3.43	3.43	1.00	804	3.15	3.15	1.00	853	2.91	2.91	1.00	886
32	20	3.61	3.53	0.98	836	3.36	3.29	0.98	877	3.12	3.05	0.98	927
32	22	3.82	3.28	0.86	869	3.57	3.07	0.86	918	3.33	2.86	0.86	951
32	24	4.03	2.98	0.74	902	3.78	2.80	0.74	943	3.57	2.64	0.74	984
32	26	4.24	2.63	0.62	935	3.99	2.47	0.62	976	3.75	2.32	0.62	1017

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-FH50VE2: MUZ-FH50VE, MUZ-FH50VEHZ

CAPACITY: 5.0 kW SHF: 0.73 INPUT: 1380 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.88	3.23	0.55	1104	5.63	3.09	0.55	1159	5.40	2.97	0.55	1214	5.20	2.86	0.55	1270
21	20	6.13	2.63	0.43	1159	5.88	2.53	0.43	1228	5.70	2.45	0.43	1256	5.50	2.37	0.43	1311
22	18	5.88	3.47	0.59	1104	5.63	3.32	0.59	1159	5.40	3.19	0.59	1214	5.20	3.07	0.59	1270
22	20	6.13	2.88	0.47	1159	5.88	2.76	0.47	1228	5.70	2.68	0.47	1256	5.50	2.59	0.47	1311
22	22	6.38	2.23	0.35	1201	6.15	2.15	0.35	1277	6.00	2.10	0.35	1311	5.75	2.01	0.35	1366
23	18	5.88	3.70	0.63	1104	5.63	3.54	0.63	1159	5.40	3.40	0.63	1214	5.20	3.28	0.63	1270
23	20	6.13	3.12	0.51	1159	5.88	3.00	0.51	1228	5.70	2.91	0.51	1256	5.50	2.81	0.51	1311
23	22	6.38	2.49	0.39	1201	6.15	2.40	0.39	1277	6.00	2.34	0.39	1311	5.75	2.24	0.39	1366
24	18	5.88	3.94	0.67	1104	5.63	3.77	0.67	1159	5.40	3.62	0.67	1214	5.20	3.48	0.67	1270
24	20	6.13	3.37	0.55	1159	5.88	3.23	0.55	1228	5.70	3.14	0.55	1256	5.50	3.03	0.55	1311
24	22	6.38	2.74	0.43	1201	6.15	2.64	0.43	1277	6.00	2.58	0.43	1311	5.75	2.47	0.43	1366
24	24	6.70	2.08	0.31	1256	6.45	2.00	0.31	1325	6.30	1.95	0.31	1366	6.10	1.89	0.31	1435
25	18	5.88	4.17	0.71	1104	5.63	3.99	0.71	1159	5.40	3.83	0.71	1214	5.20	3.69	0.71	1270
25	20	6.13	3.61	0.59	1159	5.88	3.47	0.59	1228	5.70	3.36	0.59	1256	5.50	3.25	0.59	1311
25	22	6.38	3.00	0.47	1201	6.15	2.89	0.47	1277	6.00	2.82	0.47	1311	5.75	2.70	0.47	1366
25	24	6.70	2.35	0.35	1256	6.45	2.26	0.35	1325	6.30	2.21	0.35	1366	6.10	2.14	0.35	1435
26	18	5.88	4.41	0.75	1104	5.63	4.22	0.75	1159	5.40	4.05	0.75	1214	5.20	3.90	0.75	1270
26	20	6.13	3.86	0.63	1159	5.88	3.70	0.63	1228	5.70	3.59	0.63	1256	5.50	3.47	0.63	1311
26	22	6.38	3.25	0.51	1201	6.15	3.14	0.51	1277	6.00	3.06	0.51	1311	5.75	2.93	0.51	1366
26	24	6.70	2.61	0.39	1256	6.45	2.52	0.39	1325	6.30	2.46	0.39	1366	6.10	2.38	0.39	1435
26	26	6.90	1.86	0.27	1325	6.70	1.81	0.27	1394	6.60	1.78	0.27	1435	6.40	1.73	0.27	1477
27	18	5.88	4.64	0.79	1104	5.63	4.44	0.79	1159	5.40	4.27	0.79	1214	5.20	4.11	0.79	1270
27	20	6.13	4.10	0.67	1159	5.88	3.94	0.67	1228	5.70	3.82	0.67	1256	5.50	3.69	0.67	1311
27	22	6.38	3.51	0.55	1201	6.15	3.38	0.55	1277	6.00	3.30	0.55	1311	5.75	3.16	0.55	1366
27	24	6.70	2.88	0.43	1256	6.45	2.77	0.43	1325	6.30	2.71	0.43	1366	6.10	2.62	0.43	1435
27	26	6.90	2.14	0.31	1325	6.70	2.08	0.31	1394	6.60	2.05	0.31	1435	6.40	1.98	0.31	1477
28	18	5.88	4.88	0.83	1104	5.63	4.67	0.83	1159	5.40	4.48	0.83	1214	5.20	4.32	0.83	1270
28	20	6.13	4.35	0.71	1159	5.88	4.17	0.71	1228	5.70	4.05	0.71	1256	5.50	3.91	0.71	1311
28	22	6.38	3.76	0.59	1201	6.15	3.63	0.59	1277	6.00	3.54	0.59	1311	5.75	3.39	0.59	1366
28	24	6.70	3.15	0.47	1256	6.45	3.03	0.47	1325	6.30	2.96	0.47	1366	6.10	2.87	0.47	1435
28	26	6.90	2.42	0.35	1325	6.70	2.35	0.35	1394	6.60	2.31	0.35	1435	6.40	2.24	0.35	1477
29	18	5.88	5.11	0.87	1104	5.63	4.89	0.87	1159	5.40	4.70	0.87	1214	5.20	4.52	0.87	1270
29	20	6.13	4.59	0.75	1159	5.88	4.41	0.75	1228	5.70	4.28	0.75	1256	5.50	4.13	0.75	1311
29	22	6.38	4.02	0.63	1201	6.15	3.87	0.63	1277	6.00	3.78	0.63	1311	5.75	3.62	0.63	1366
29	24	6.70	3.42	0.51	1256	6.45	3.29	0.51	1325	6.30	3.21	0.51	1366	6.10	3.11	0.51	1435
29	26	6.90	2.69	0.39	1325	6.70	2.61	0.39	1394	6.60	2.57	0.39	1435	6.40	2.50	0.39	1477
30	18	5.88	5.35	0.91	1104	5.63	5.12	0.91	1159	5.40	4.91	0.91	1214	5.20	4.73	0.91	1270
30	20	6.13	4.84	0.79	1159	5.88	4.64	0.79	1228	5.70	4.50	0.79	1256	5.50	4.35	0.79	1311
30	22	6.38	4.27	0.67	1201	6.15	4.12	0.67	1277	6.00	4.02	0.67	1311	5.75	3.85	0.67	1366
30	24	6.70	3.69	0.55	1256	6.45	3.55	0.55	1325	6.30	3.47	0.55	1366	6.10	3.36	0.55	1435
30	26	6.90	2.97	0.43	1325	6.70	2.88	0.43	1394	6.60	2.84	0.43	1435	6.40	2.75	0.43	1477
31	18	5.88	5.58	0.95	1104	5.63	5.34	0.95	1159	5.40	5.13	0.95	1214	5.20	4.94	0.95	1270
31	20	6.13	5.08	0.83	1159	5.88	4.88	0.83	1228	5.70	4.73	0.83	1256	5.50	4.57	0.83	1311
31	22	6.38	4.53	0.71	1201	6.15	4.37	0.71	1277	6.00	4.26	0.71	1311	5.75	4.08	0.71	1366
31	24	6.70	3.95	0.59	1256	6.45	3.81	0.59	1325	6.30	3.72	0.59	1366	6.10	3.60	0.59	1435
31	26	6.90	3.24	0.47	1325	6.70	3.15	0.47	1394	6.60	3.10	0.47	1435	6.40	3.01	0.47	1477
32	18	5.88	5.82	0.99	1104	5.63	5.57	0.99	1159	5.40	5.35	0.99	1214	5.20	5.15	0.99	1270
32	20	6.13	5.33	0.87	1159	5.88	5.11	0.87	1228	5.70	4.96	0.87	1256	5.50	4.79	0.87	1311
32	22	6.38	4.78	0.75	1201	6.15	4.61	0.75	1277	6.00	4.50	0.75	1311	5.75	4.31	0.75	1366
32	24	6.70	4.22	0.63	1256	6.45	4.06	0.63	1325	6.30	3.97	0.63	1366	6.10	3.84	0.63	1435
32	26	6.90	3.52	0.51	1325	6.70	3.42	0.51	1394	6.60	3.37	0.51	1435	6.40	3.26	0.51	1477

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-FH50VE2: MUZ-FH50VE, MUZ-FH50VEHZ

CAPACITY: 5.0 kW SHF: 0.73 INPUT: 1380 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.70	0.55	1352	4.50	2.48	0.55	1435	4.15	2.28	0.55	1490
21	20	5.15	2.21	0.43	1408	4.80	2.06	0.43	1477	4.45	1.91	0.43	1559
22	18	4.90	2.89	0.59	1352	4.50	2.66	0.59	1435	4.15	2.45	0.59	1490
22	20	5.15	2.42	0.47	1408	4.80	2.26	0.47	1477	4.45	2.09	0.47	1559
22	22	5.45	1.91	0.35	1463	5.10	1.79	0.35	1546	4.75	1.66	0.35	1601
23	18	4.90	3.09	0.63	1352	4.50	2.84	0.63	1435	4.15	2.61	0.63	1490
23	20	5.15	2.63	0.51	1408	4.80	2.45	0.51	1477	4.45	2.27	0.51	1559
23	22	5.45	2.13	0.39	1463	5.10	1.99	0.39	1546	4.75	1.85	0.39	1601
24	18	4.90	3.28	0.67	1352	4.50	3.02	0.67	1435	4.15	2.78	0.67	1490
24	20	5.15	2.83	0.55	1408	4.80	2.64	0.55	1477	4.45	2.45	0.55	1559
24	22	5.45	2.34	0.43	1463	5.10	2.19	0.43	1546	4.75	2.04	0.43	1601
24	24	5.75	1.78	0.31	1518	5.40	1.67	0.31	1587	5.10	1.58	0.31	1656
25	18	4.90	3.48	0.71	1352	4.50	3.20	0.71	1435	4.15	2.95	0.71	1490
25	20	5.15	3.04	0.59	1408	4.80	2.83	0.59	1477	4.45	2.63	0.59	1559
25	22	5.45	2.56	0.47	1463	5.10	2.40	0.47	1546	4.75	2.23	0.47	1601
25	24	5.75	2.01	0.35	1518	5.40	1.89	0.35	1587	5.10	1.79	0.35	1656
26	18	4.90	3.68	0.75	1352	4.50	3.38	0.75	1435	4.15	3.11	0.75	1490
26	20	5.15	3.24	0.63	1408	4.80	3.02	0.63	1477	4.45	2.80	0.63	1559
26	22	5.45	2.78	0.51	1463	5.10	2.60	0.51	1546	4.75	2.42	0.51	1601
26	24	5.75	2.24	0.39	1518	5.40	2.11	0.39	1587	5.10	1.99	0.39	1656
26	26	6.05	1.63	0.27	1573	5.70	1.54	0.27	1642	5.35	1.44	0.27	1711
27	18	4.90	3.87	0.79	1352	4.50	3.56	0.79	1435	4.15	3.28	0.79	1490
27	20	5.15	3.45	0.67	1408	4.80	3.22	0.67	1477	4.45	2.98	0.67	1559
27	22	5.45	3.00	0.55	1463	5.10	2.81	0.55	1546	4.75	2.61	0.55	1601
27	24	5.75	2.47	0.43	1518	5.40	2.32	0.43	1587	5.10	2.19	0.43	1656
27	26	6.05	1.88	0.31	1573	5.70	1.77	0.31	1642	5.35	1.66	0.31	1711
28	18	4.90	4.07	0.83	1352	4.50	3.74	0.83	1435	4.15	3.44	0.83	1490
28	20	5.15	3.66	0.71	1408	4.80	3.41	0.71	1477	4.45	3.16	0.71	1559
28	22	5.45	3.22	0.59	1463	5.10	3.01	0.59	1546	4.75	2.80	0.59	1601
28	24	5.75	2.70	0.47	1518	5.40	2.54	0.47	1587	5.10	2.40	0.47	1656
28	26	6.05	2.12	0.35	1573	5.70	2.00	0.35	1642	5.35	1.87	0.35	1711
29	18	4.90	4.26	0.87	1352	4.50	3.92	0.87	1435	4.15	3.61	0.87	1490
29	20	5.15	3.86	0.75	1408	4.80	3.60	0.75	1477	4.45	3.34	0.75	1559
29	22	5.45	3.43	0.63	1463	5.10	3.21	0.63	1546	4.75	2.99	0.63	1601
29	24	5.75	2.93	0.51	1518	5.40	2.75	0.51	1587	5.10	2.60	0.51	1656
29	26	6.05	2.36	0.39	1573	5.70	2.22	0.39	1642	5.35	2.09	0.39	1711
30	18	4.90	4.46	0.91	1352	4.50	4.10	0.91	1435	4.15	3.78	0.91	1490
30	20	5.15	4.07	0.79	1408	4.80	3.79	0.79	1477	4.45	3.52	0.79	1559
30	22	5.45	3.65	0.67	1463	5.10	3.42	0.67	1546	4.75	3.18	0.67	1601
30	24	5.75	3.16	0.55	1518	5.40	2.97	0.55	1587	5.10	2.81	0.55	1656
30	26	6.05	2.60	0.43	1573	5.70	2.45	0.43	1642	5.35	2.30	0.43	1711
31	18	4.90	4.66	0.95	1352	4.50	4.28	0.95	1435	4.15	3.94	0.95	1490
31	20	5.15	4.27	0.83	1408	4.80	3.98	0.83	1477	4.45	3.69	0.83	1559
31	22	5.45	3.87	0.71	1463	5.10	3.62	0.71	1546	4.75	3.37	0.71	1601
31	24	5.75	3.39	0.59	1518	5.40	3.19	0.59	1587	5.10	3.01	0.59	1656
31	26	6.05	2.84	0.47	1573	5.70	2.68	0.47	1642	5.35	2.51	0.47	1711
32	18	4.90	4.85	0.99	1352	4.50	4.46	0.99	1435	4.15	4.11	0.99	1490
32	20	5.15	4.48	0.87	1408	4.80	4.18	0.87	1477	4.45	3.87	0.87	1559
32	22	5.45	4.09	0.75	1463	5.10	3.83	0.75	1546	4.75	3.56	0.75	1601
32	24	5.75	3.62	0.63	1518	5.40	3.40	0.63	1587	5.10	3.21	0.63	1656
32	26	6.05	3.09	0.51	1573	5.70	2.91	0.51	1642	5.35	2.73	0.51	1711

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-EF25VGW/B/S: MUZ-EF25VG, MUZ-EF25VGH

CAPACITY: 2.5 kW SHF: 0.97 INPUT: 540 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.32	0.79	432	2.81	2.22	0.79	454	2.70	2.13	0.79	475	2.60	2.05	0.79	497
21	20	3.06	2.05	0.67	454	2.94	1.97	0.67	481	2.85	1.91	0.67	491	2.75	1.84	0.67	513
22	18	2.94	2.44	0.83	432	2.81	2.33	0.83	454	2.70	2.24	0.83	475	2.60	2.16	0.83	497
22	20	3.06	2.17	0.71	454	2.94	2.09	0.71	481	2.85	2.02	0.71	491	2.75	1.95	0.71	513
22	22	3.19	1.88	0.59	470	3.08	1.81	0.59	500	3.00	1.77	0.59	513	2.88	1.70	0.59	535
23	18	2.94	2.56	0.87	432	2.81	2.45	0.87	454	2.70	2.35	0.87	475	2.60	2.26	0.87	497
23	20	3.06	2.30	0.75	454	2.94	2.20	0.75	481	2.85	2.14	0.75	491	2.75	2.06	0.75	513
23	22	3.19	2.01	0.63	470	3.08	1.94	0.63	500	3.00	1.89	0.63	513	2.88	1.81	0.63	535
24	18	2.94	2.67	0.91	432	2.81	2.56	0.91	454	2.70	2.46	0.91	475	2.60	2.37	0.91	497
24	20	3.06	2.42	0.79	454	2.94	2.32	0.79	481	2.85	2.25	0.79	491	2.75	2.17	0.79	513
24	22	3.19	2.14	0.67	470	3.08	2.06	0.67	500	3.00	2.01	0.67	513	2.88	1.93	0.67	535
24	24	3.35	1.84	0.55	491	3.23	1.77	0.55	518	3.15	1.73	0.55	535	3.05	1.68	0.55	562
25	18	2.94	2.79	0.95	432	2.81	2.67	0.95	454	2.70	2.57	0.95	475	2.60	2.47	0.95	497
25	20	3.06	2.54	0.83	454	2.94	2.44	0.83	481	2.85	2.37	0.83	491	2.75	2.28	0.83	513
25	22	3.19	2.26	0.71	470	3.08	2.18	0.71	500	3.00	2.13	0.71	513	2.88	2.04	0.71	535
25	24	3.35	1.98	0.59	491	3.23	1.90	0.59	518	3.15	1.86	0.59	535	3.05	1.80	0.59	562
26	18	2.94	2.91	0.99	432	2.81	2.78	0.99	454	2.70	2.67	0.99	475	2.60	2.57	0.99	497
26	20	3.06	2.66	0.87	454	2.94	2.56	0.87	481	2.85	2.48	0.87	491	2.75	2.39	0.87	513
26	22	3.19	2.39	0.75	470	3.08	2.31	0.75	500	3.00	2.25	0.75	513	2.88	2.16	0.75	535
26	24	3.35	2.11	0.63	491	3.23	2.03	0.63	518	3.15	1.98	0.63	535	3.05	1.92	0.63	562
26	26	3.45	1.76	0.51	518	3.35	1.71	0.51	545	3.30	1.68	0.51	562	3.20	1.63	0.51	578
27	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
27	20	3.06	2.79	0.91	454	2.94	2.67	0.91	481	2.85	2.59	0.91	491	2.75	2.50	0.91	513
27	22	3.19	2.52	0.79	470	3.08	2.43	0.79	500	3.00	2.37	0.79	513	2.88	2.27	0.79	535
27	24	3.35	2.24	0.67	491	3.23	2.16	0.67	518	3.15	2.11	0.67	535	3.05	2.04	0.67	562
27	26	3.45	1.90	0.55	518	3.35	1.84	0.55	545	3.30	1.82	0.55	562	3.20	1.76	0.55	578
28	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
28	20	3.06	2.91	0.95	454	2.94	2.79	0.95	481	2.85	2.71	0.95	491	2.75	2.61	0.95	513
28	22	3.19	2.65	0.83	470	3.08	2.55	0.83	500	3.00	2.49	0.83	513	2.88	2.39	0.83	535
28	24	3.35	2.38	0.71	491	3.23	2.29	0.71	518	3.15	2.24	0.71	535	3.05	2.17	0.71	562
28	26	3.45	2.04	0.59	518	3.35	1.98	0.59	545	3.30	1.95	0.59	562	3.20	1.89	0.59	578
29	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
29	20	3.06	3.03	0.99	454	2.94	2.91	0.99	481	2.85	2.82	0.99	491	2.75	2.72	0.99	513
29	22	3.19	2.77	0.87	470	3.08	2.68	0.87	500	3.00	2.61	0.87	513	2.88	2.50	0.87	535
29	24	3.35	2.51	0.75	491	3.23	2.42	0.75	518	3.15	2.36	0.75	535	3.05	2.29	0.75	562
29	26	3.45	2.17	0.63	518	3.35	2.11	0.63	545	3.30	2.08	0.63	562	3.20	2.02	0.63	578
30	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
30	20	3.06	3.06	1.00	454	2.94	2.94	1.00	481	2.85	2.85	1.00	491	2.75	2.75	1.00	513
30	22	3.19	2.90	0.91	470	3.08	2.80	0.91	500	3.00	2.73	0.91	513	2.88	2.62	0.91	535
30	24	3.35	2.65	0.79	491	3.23	2.55	0.79	518	3.15	2.49	0.79	535	3.05	2.41	0.79	562
30	26	3.45	2.31	0.67	518	3.35	2.24	0.67	545	3.30	2.21	0.67	562	3.20	2.14	0.67	578
31	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
31	20	3.06	3.06	1.00	454	2.94	2.94	1.00	481	2.85	2.85	1.00	491	2.75	2.75	1.00	513
31	22	3.19	3.03	0.95	470	3.08	2.92	0.95	500	3.00	2.85	0.95	513	2.88	2.73	0.95	535
31	24	3.35	2.78	0.83	491	3.23	2.68	0.83	518	3.15	2.61	0.83	535	3.05	2.53	0.83	562
31	26	3.45	2.45	0.71	518	3.35	2.38	0.71	545	3.30	2.34	0.71	562	3.20	2.27	0.71	578
32	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
32	20	3.06	3.06	1.00	454	2.94	2.94	1.00	481	2.85	2.85	1.00	491	2.75	2.75	1.00	513
32	22	3.19	3.16	0.99	470	3.08	3.04	0.99	500	3.00	2.97	0.99	513	2.88	2.85	0.99	535
32	24	3.35	2.91	0.87	491	3.23	2.81	0.87	518	3.15	2.74	0.87	535	3.05	2.65	0.87	562
32	26	3.45	2.59	0.75	518	3.35	2.51	0.75	545	3.30	2.48	0.75	562	3.20	2.40	0.75	578

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-EF25VGW/B/S: MUZ-EF25VG, MUZ-EF25VGH

CAPACITY: 2.5 kW SHF: 0.97 INPUT: 540 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.94	0.79	529	2.25	1.78	0.79	562	2.08	1.64	0.79	583
21	20	2.58	1.73	0.67	551	2.40	1.61	0.67	578	2.23	1.49	0.67	610
22	18	2.45	2.03	0.83	529	2.25	1.87	0.83	562	2.08	1.72	0.83	583
22	20	2.58	1.83	0.71	551	2.40	1.70	0.71	578	2.23	1.58	0.71	610
22	22	2.73	1.61	0.59	572	2.55	1.50	0.59	605	2.38	1.40	0.59	626
23	18	2.45	2.13	0.87	529	2.25	1.96	0.87	562	2.08	1.81	0.87	583
23	20	2.58	1.93	0.75	551	2.40	1.80	0.75	578	2.23	1.67	0.75	610
23	22	2.73	1.72	0.63	572	2.55	1.61	0.63	605	2.38	1.50	0.63	626
24	18	2.45	2.23	0.91	529	2.25	2.05	0.91	562	2.08	1.89	0.91	583
24	20	2.58	2.03	0.79	551	2.40	1.90	0.79	578	2.23	1.76	0.79	610
24	22	2.73	1.83	0.67	572	2.55	1.71	0.67	605	2.38	1.59	0.67	626
24	24	2.88	1.58	0.55	594	2.70	1.49	0.55	621	2.55	1.40	0.55	648
25	18	2.45	2.33	0.95	529	2.25	2.14	0.95	562	2.08	1.97	0.95	583
25	20	2.58	2.14	0.83	551	2.40	1.99	0.83	578	2.23	1.85	0.83	610
25	22	2.73	1.93	0.71	572	2.55	1.81	0.71	605	2.38	1.69	0.71	626
25	24	2.88	1.70	0.59	594	2.70	1.59	0.59	621	2.55	1.50	0.59	648
26	18	2.45	2.43	0.99	529	2.25	2.23	0.99	562	2.08	2.05	0.99	583
26	20	2.58	2.24	0.87	551	2.40	2.09	0.87	578	2.23	1.94	0.87	610
26	22	2.73	2.04	0.75	572	2.55	1.91	0.75	605	2.38	1.78	0.75	626
26	24	2.88	1.81	0.63	594	2.70	1.70	0.63	621	2.55	1.61	0.63	648
26	26	3.03	1.54	0.51	616	2.85	1.45	0.51	643	2.68	1.36	0.51	670
27	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
27	20	2.58	2.34	0.91	551	2.40	2.18	0.91	578	2.23	2.02	0.91	610
27	22	2.73	2.15	0.79	572	2.55	2.01	0.79	605	2.38	1.88	0.79	626
27	24	2.88	1.93	0.67	594	2.70	1.81	0.67	621	2.55	1.71	0.67	648
27	26	3.03	1.66	0.55	616	2.85	1.57	0.55	643	2.68	1.47	0.55	670
28	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
28	20	2.58	2.45	0.95	551	2.40	2.28	0.95	578	2.23	2.11	0.95	610
28	22	2.73	2.26	0.83	572	2.55	2.12	0.83	605	2.38	1.97	0.83	626
28	24	2.88	2.04	0.71	594	2.70	1.92	0.71	621	2.55	1.81	0.71	648
28	26	3.03	1.78	0.59	616	2.85	1.68	0.59	643	2.68	1.58	0.59	670
29	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
29	20	2.58	2.55	0.99	551	2.40	2.38	0.99	578	2.23	2.20	0.99	610
29	22	2.73	2.37	0.87	572	2.55	2.22	0.87	605	2.38	2.07	0.87	626
29	24	2.88	2.16	0.75	594	2.70	2.03	0.75	621	2.55	1.91	0.75	648
29	26	3.03	1.91	0.63	616	2.85	1.80	0.63	643	2.68	1.69	0.63	670
30	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
30	20	2.58	2.58	1.00	551	2.40	2.40	1.00	578	2.23	2.23	1.00	610
30	22	2.73	2.48	0.91	572	2.55	2.32	0.91	605	2.38	2.16	0.91	626
30	24	2.88	2.27	0.79	594	2.70	2.13	0.79	621	2.55	2.01	0.79	648
30	26	3.03	2.03	0.67	616	2.85	1.91	0.67	643	2.68	1.79	0.67	670
31	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
31	20	2.58	2.58	1.00	551	2.40	2.40	1.00	578	2.23	2.23	1.00	610
31	22	2.73	2.59	0.95	572	2.55	2.42	0.95	605	2.38	2.26	0.95	626
31	24	2.88	2.39	0.83	594	2.70	2.24	0.83	621	2.55	2.12	0.83	648
31	26	3.03	2.15	0.71	616	2.85	2.02	0.71	643	2.68	1.90	0.71	670
32	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
32	20	2.58	2.58	1.00	551	2.40	2.40	1.00	578	2.23	2.23	1.00	610
32	22	2.73	2.70	0.99	572	2.55	2.52	0.99	605	2.38	2.35	0.99	626
32	24	2.88	2.50	0.87	594	2.70	2.35	0.87	621	2.55	2.22	0.87	648
32	26	3.03	2.27	0.75	616	2.85	2.14	0.75	643	2.68	2.01	0.75	670

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-EF35VGW/B/S: MUZ-EF35VG, MUZ-EF35VGH

CAPACITY: 3.5 kW SHF: 0.8 INPUT: 910 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.11	2.55	0.62	728	3.94	2.44	0.62	764	3.78	2.34	0.62	801	3.64	2.26	0.62	837
21	20	4.29	2.14	0.50	764	4.11	2.06	0.50	810	3.99	2.00	0.50	828	3.85	1.93	0.50	865
22	18	4.11	2.71	0.66	728	3.94	2.60	0.66	764	3.78	2.49	0.66	801	3.64	2.40	0.66	837
22	20	4.29	2.32	0.54	764	4.11	2.22	0.54	810	3.99	2.15	0.54	828	3.85	2.08	0.54	865
22	22	4.46	1.87	0.42	792	4.31	1.81	0.42	842	4.20	1.76	0.42	865	4.03	1.69	0.42	901
23	18	4.11	2.88	0.70	728	3.94	2.76	0.70	764	3.78	2.65	0.70	801	3.64	2.55	0.70	837
23	20	4.29	2.49	0.58	764	4.11	2.39	0.58	810	3.99	2.31	0.58	828	3.85	2.23	0.58	865
23	22	4.46	2.05	0.46	792	4.31	1.98	0.46	842	4.20	1.93	0.46	865	4.03	1.85	0.46	901
24	18	4.11	3.04	0.74	728	3.94	2.91	0.74	764	3.78	2.80	0.74	801	3.64	2.69	0.74	837
24	20	4.29	2.66	0.62	764	4.11	2.55	0.62	810	3.99	2.47	0.62	828	3.85	2.39	0.62	865
24	22	4.46	2.23	0.50	792	4.31	2.15	0.50	842	4.20	2.10	0.50	865	4.03	2.01	0.50	901
24	24	4.69	1.78	0.38	828	4.52	1.72	0.38	874	4.41	1.68	0.38	901	4.27	1.62	0.38	946
25	18	4.11	3.21	0.78	728	3.94	3.07	0.78	764	3.78	2.95	0.78	801	3.64	2.84	0.78	837
25	20	4.29	2.83	0.66	764	4.11	2.71	0.66	810	3.99	2.63	0.66	828	3.85	2.54	0.66	865
25	22	4.46	2.41	0.54	792	4.31	2.32	0.54	842	4.20	2.27	0.54	865	4.03	2.17	0.54	901
25	24	4.69	1.97	0.42	828	4.52	1.90	0.42	874	4.41	1.85	0.42	901	4.27	1.79	0.42	946
26	18	4.11	3.37	0.82	728	3.94	3.23	0.82	764	3.78	3.10	0.82	801	3.64	2.98	0.82	837
26	20	4.29	3.00	0.70	764	4.11	2.88	0.70	810	3.99	2.79	0.70	828	3.85	2.70	0.70	865
26	22	4.46	2.59	0.58	792	4.31	2.50	0.58	842	4.20	2.44	0.58	865	4.03	2.33	0.58	901
26	24	4.69	2.16	0.46	828	4.52	2.08	0.46	874	4.41	2.03	0.46	901	4.27	1.96	0.46	946
26	26	4.83	1.64	0.34	874	4.69	1.59	0.34	919	4.62	1.57	0.34	946	4.48	1.52	0.34	974
27	18	4.11	3.54	0.86	728	3.94	3.39	0.86	764	3.78	3.25	0.86	801	3.64	3.13	0.86	837
27	20	4.29	3.17	0.74	764	4.11	3.04	0.74	810	3.99	2.95	0.74	828	3.85	2.85	0.74	865
27	22	4.46	2.77	0.62	792	4.31	2.67	0.62	842	4.20	2.60	0.62	865	4.03	2.50	0.62	901
27	24	4.69	2.35	0.50	828	4.52	2.26	0.50	874	4.41	2.21	0.50	901	4.27	2.14	0.50	946
27	26	4.83	1.84	0.38	874	4.69	1.78	0.38	919	4.62	1.76	0.38	946	4.48	1.70	0.38	974
28	18	4.11	3.70	0.90	728	3.94	3.54	0.90	764	3.78	3.40	0.90	801	3.64	3.28	0.90	837
28	20	4.29	3.34	0.78	764	4.11	3.21	0.78	810	3.99	3.11	0.78	828	3.85	3.00	0.78	865
28	22	4.46	2.95	0.66	792	4.31	2.84	0.66	842	4.20	2.77	0.66	865	4.03	2.66	0.66	901
28	24	4.69	2.53	0.54	828	4.52	2.44	0.54	874	4.41	2.38	0.54	901	4.27	2.31	0.54	946
28	26	4.83	2.03	0.42	874	4.69	1.97	0.42	919	4.62	1.94	0.42	946	4.48	1.88	0.42	974
29	18	4.11	3.87	0.94	728	3.94	3.70	0.94	764	3.78	3.55	0.94	801	3.64	3.42	0.94	837
29	20	4.29	3.52	0.82	764	4.11	3.37	0.82	810	3.99	3.27	0.82	828	3.85	3.16	0.82	865
29	22	4.46	3.12	0.70	792	4.31	3.01	0.70	842	4.20	2.94	0.70	865	4.03	2.82	0.70	901
29	24	4.69	2.72	0.58	828	4.52	2.62	0.58	874	4.41	2.56	0.58	901	4.27	2.48	0.58	946
29	26	4.83	2.22	0.46	874	4.69	2.16	0.46	919	4.62	2.13	0.46	946	4.48	2.06	0.46	974
30	18	4.11	4.03	0.98	728	3.94	3.86	0.98	764	3.78	3.70	0.98	801	3.64	3.57	0.98	837
30	20	4.29	3.69	0.86	764	4.11	3.54	0.86	810	3.99	3.43	0.86	828	3.85	3.31	0.86	865
30	22	4.46	3.30	0.74	792	4.31	3.19	0.74	842	4.20	3.11	0.74	865	4.03	2.98	0.74	901
30	24	4.69	2.91	0.62	828	4.52	2.80	0.62	874	4.41	2.73	0.62	901	4.27	2.65	0.62	946
30	26	4.83	2.42	0.50	874	4.69	2.35	0.50	919	4.62	2.31	0.50	946	4.48	2.24	0.50	974
31	18	4.11	4.11	1.00	728	3.94	3.94	1.00	764	3.78	3.78	1.00	801	3.64	3.64	1.00	837
31	20	4.29	3.86	0.90	764	4.11	3.70	0.90	810	3.99	3.59	0.90	828	3.85	3.47	0.90	865
31	22	4.46	3.48	0.78	792	4.31	3.36	0.78	842	4.20	3.28	0.78	865	4.03	3.14	0.78	901
31	24	4.69	3.10	0.66	828	4.52	2.98	0.66	874	4.41	2.91	0.66	901	4.27	2.82	0.66	946
31	26	4.83	2.61	0.54	874	4.69	2.53	0.54	919	4.62	2.49	0.54	946	4.48	2.42	0.54	974
32	18	4.11	4.11	1.00	728	3.94	3.94	1.00	764	3.78	3.78	1.00	801	3.64	3.64	1.00	837
32	20	4.29	4.03	0.94	764	4.11	3.87	0.94	810	3.99	3.75	0.94	828	3.85	3.62	0.94	865
32	22	4.46	3.66	0.82	792	4.31	3.53	0.82	842	4.20	3.44	0.82	865	4.03	3.30	0.82	901
32	24	4.69	3.28	0.70	828	4.52	3.16	0.70	874	4.41	3.09	0.70	901	4.27	2.99	0.70	946
32	26	4.83	2.80	0.58	874	4.69	2.72	0.58	919	4.62	2.68	0.58	946	4.48	2.60	0.58	974

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-EF35VGW/B/S: MUZ-EF35VG, MUZ-EF35VGH

CAPACITY: 3.5 kW SHF: 0.8 INPUT: 910 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.43	2.13	0.62	892	3.15	1.95	0.62	946	2.91	1.80	0.62	983
21	20	3.61	1.80	0.50	928	3.36	1.68	0.50	974	3.12	1.56	0.50	1028
22	18	3.43	2.26	0.66	892	3.15	2.08	0.66	946	2.91	1.92	0.66	983
22	20	3.61	1.95	0.54	928	3.36	1.81	0.54	974	3.12	1.68	0.54	1028
22	22	3.82	1.60	0.42	965	3.57	1.50	0.42	1019	3.33	1.40	0.42	1056
23	18	3.43	2.40	0.70	892	3.15	2.21	0.70	946	2.91	2.03	0.70	983
23	20	3.61	2.09	0.58	928	3.36	1.95	0.58	974	3.12	1.81	0.58	1028
23	22	3.82	1.75	0.46	965	3.57	1.64	0.46	1019	3.33	1.53	0.46	1056
24	18	3.43	2.54	0.74	892	3.15	2.33	0.74	946	2.91	2.15	0.74	983
24	20	3.61	2.24	0.62	928	3.36	2.08	0.62	974	3.12	1.93	0.62	1028
24	22	3.82	1.91	0.50	965	3.57	1.79	0.50	1019	3.33	1.66	0.50	1056
24	24	4.03	1.53	0.38	1001	3.78	1.44	0.38	1047	3.57	1.36	0.38	1092
25	18	3.43	2.68	0.78	892	3.15	2.46	0.78	946	2.91	2.27	0.78	983
25	20	3.61	2.38	0.66	928	3.36	2.22	0.66	974	3.12	2.06	0.66	1028
25	22	3.82	2.06	0.54	965	3.57	1.93	0.54	1019	3.33	1.80	0.54	1056
25	24	4.03	1.69	0.42	1001	3.78	1.59	0.42	1047	3.57	1.50	0.42	1092
26	18	3.43	2.81	0.82	892	3.15	2.58	0.82	946	2.91	2.38	0.82	983
26	20	3.61	2.52	0.70	928	3.36	2.35	0.70	974	3.12	2.18	0.70	1028
26	22	3.82	2.21	0.58	965	3.57	2.07	0.58	1019	3.33	1.93	0.58	1056
26	24	4.03	1.85	0.46	1001	3.78	1.74	0.46	1047	3.57	1.64	0.46	1092
26	26	4.24	1.44	0.34	1037	3.99	1.36	0.34	1083	3.75	1.27	0.34	1128
27	18	3.43	2.95	0.86	892	3.15	2.71	0.86	946	2.91	2.50	0.86	983
27	20	3.61	2.67	0.74	928	3.36	2.49	0.74	974	3.12	2.31	0.74	1028
27	22	3.82	2.37	0.62	965	3.57	2.21	0.62	1019	3.33	2.06	0.62	1056
27	24	4.03	2.01	0.50	1001	3.78	1.89	0.50	1047	3.57	1.79	0.50	1092
27	26	4.24	1.61	0.38	1037	3.99	1.52	0.38	1083	3.75	1.42	0.38	1128
28	18	3.43	3.09	0.90	892	3.15	2.84	0.90	946	2.91	2.61	0.90	983
28	20	3.61	2.81	0.78	928	3.36	2.62	0.78	974	3.12	2.43	0.78	1028
28	22	3.82	2.52	0.66	965	3.57	2.36	0.66	1019	3.33	2.19	0.66	1056
28	24	4.03	2.17	0.54	1001	3.78	2.04	0.54	1047	3.57	1.93	0.54	1092
28	26	4.24	1.78	0.42	1037	3.99	1.68	0.42	1083	3.75	1.57	0.42	1128
29	18	3.43	3.22	0.94	892	3.15	2.96	0.94	946	2.91	2.73	0.94	983
29	20	3.61	2.96	0.82	928	3.36	2.76	0.82	974	3.12	2.55	0.82	1028
29	22	3.82	2.67	0.70	965	3.57	2.50	0.70	1019	3.33	2.33	0.70	1056
29	24	4.03	2.33	0.58	1001	3.78	2.19	0.58	1047	3.57	2.07	0.58	1092
29	26	4.24	1.95	0.46	1037	3.99	1.84	0.46	1083	3.75	1.72	0.46	1128
30	18	3.43	3.36	0.98	892	3.15	3.09	0.98	946	2.91	2.85	0.98	983
30	20	3.61	3.10	0.86	928	3.36	2.89	0.86	974	3.12	2.68	0.86	1028
30	22	3.82	2.82	0.74	965	3.57	2.64	0.74	1019	3.33	2.46	0.74	1056
30	24	4.03	2.50	0.62	1001	3.78	2.34	0.62	1047	3.57	2.21	0.62	1092
30	26	4.24	2.12	0.50	1037	3.99	2.00	0.50	1083	3.75	1.87	0.50	1128
31	18	3.43	3.43	1.00	892	3.15	3.15	1.00	946	2.91	2.91	1.00	983
31	20	3.61	3.24	0.90	928	3.36	3.02	0.90	974	3.12	2.80	0.90	1028
31	22	3.82	2.98	0.78	965	3.57	2.78	0.78	1019	3.33	2.59	0.78	1056
31	24	4.03	2.66	0.66	1001	3.78	2.49	0.66	1047	3.57	2.36	0.66	1092
31	26	4.24	2.29	0.54	1037	3.99	2.15	0.54	1083	3.75	2.02	0.54	1128
32	18	3.43	3.43	1.00	892	3.15	3.15	1.00	946	2.91	2.91	1.00	983
32	20	3.61	3.39	0.94	928	3.36	3.16	0.94	974	3.12	2.93	0.94	1028
32	22	3.82	3.13	0.82	965	3.57	2.93	0.82	1019	3.33	2.73	0.82	1056
32	24	4.03	2.82	0.70	1001	3.78	2.65	0.70	1047	3.57	2.50	0.70	1092
32	26	4.24	2.46	0.58	1037	3.99	2.31	0.58	1083	3.75	2.17	0.58	1128

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-EF42VGW/B/S: MUZ-EF42VG

CAPACITY: 4.2 kW SHF: 0.74 INPUT: 1200 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.12	2.30	0.56	1176	3.78	2.12	0.56	1248	3.49	1.95	0.56	1296
21	20	4.33	1.90	0.44	1224	4.03	1.77	0.44	1284	3.74	1.64	0.44	1356
22	18	4.12	2.47	0.60	1176	3.78	2.27	0.60	1248	3.49	2.09	0.60	1296
22	20	4.33	2.08	0.48	1224	4.03	1.94	0.48	1284	3.74	1.79	0.48	1356
22	22	4.58	1.65	0.36	1272	4.28	1.54	0.36	1344	3.99	1.44	0.36	1392
23	18	4.12	2.63	0.64	1176	3.78	2.42	0.64	1248	3.49	2.23	0.64	1296
23	20	4.33	2.25	0.52	1224	4.03	2.10	0.52	1284	3.74	1.94	0.52	1356
23	22	4.58	1.83	0.40	1272	4.28	1.71	0.40	1344	3.99	1.60	0.40	1392
24	18	4.12	2.80	0.68	1176	3.78	2.57	0.68	1248	3.49	2.37	0.68	1296
24	20	4.33	2.42	0.56	1224	4.03	2.26	0.56	1284	3.74	2.09	0.56	1356
24	22	4.58	2.01	0.44	1272	4.28	1.88	0.44	1344	3.99	1.76	0.44	1392
24	24	4.83	1.55	0.32	1320	4.54	1.45	0.32	1380	4.28	1.37	0.32	1440
25	18	4.12	2.96	0.72	1176	3.78	2.72	0.72	1248	3.49	2.51	0.72	1296
25	20	4.33	2.60	0.60	1224	4.03	2.42	0.60	1284	3.74	2.24	0.60	1356
25	22	4.58	2.20	0.48	1272	4.28	2.06	0.48	1344	3.99	1.92	0.48	1392
25	24	4.83	1.74	0.36	1320	4.54	1.63	0.36	1380	4.28	1.54	0.36	1440
26	18	4.12	3.13	0.76	1176	3.78	2.87	0.76	1248	3.49	2.65	0.76	1296
26	20	4.33	2.77	0.64	1224	4.03	2.58	0.64	1284	3.74	2.39	0.64	1356
26	22	4.58	2.38	0.52	1272	4.28	2.23	0.52	1344	3.99	2.07	0.52	1392
26	24	4.83	1.93	0.40	1320	4.54	1.81	0.40	1380	4.28	1.71	0.40	1440
26	26	5.08	1.42	0.28	1368	4.79	1.34	0.28	1428	4.49	1.26	0.28	1488
27	18	4.12	3.29	0.80	1176	3.78	3.02	0.80	1248	3.49	2.79	0.80	1296
27	20	4.33	2.94	0.68	1224	4.03	2.74	0.68	1284	3.74	2.54	0.68	1356
27	22	4.58	2.56	0.56	1272	4.28	2.40	0.56	1344	3.99	2.23	0.56	1392
27	24	4.83	2.13	0.44	1320	4.54	2.00	0.44	1380	4.28	1.88	0.44	1440
27	26	5.08	1.63	0.32	1368	4.79	1.53	0.32	1428	4.49	1.44	0.32	1488
28	18	4.12	3.46	0.84	1176	3.78	3.18	0.84	1248	3.49	2.93	0.84	1296
28	20	4.33	3.11	0.72	1224	4.03	2.90	0.72	1284	3.74	2.69	0.72	1356
28	22	4.58	2.75	0.60	1272	4.28	2.57	0.60	1344	3.99	2.39	0.60	1392
28	24	4.83	2.32	0.48	1320	4.54	2.18	0.48	1380	4.28	2.06	0.48	1440
28	26	5.08	1.83	0.36	1368	4.79	1.72	0.36	1428	4.49	1.62	0.36	1488
29	18	4.12	3.62	0.88	1176	3.78	3.33	0.88	1248	3.49	3.07	0.88	1296
29	20	4.33	3.29	0.76	1224	4.03	3.06	0.76	1284	3.74	2.84	0.76	1356
29	22	4.58	2.93	0.64	1272	4.28	2.74	0.64	1344	3.99	2.55	0.64	1392
29	24	4.83	2.51	0.52	1320	4.54	2.36	0.52	1380	4.28	2.23	0.52	1440
29	26	5.08	2.03	0.40	1368	4.79	1.92	0.40	1428	4.49	1.80	0.40	1488
30	18	4.12	3.79	0.92	1176	3.78	3.48	0.92	1248	3.49	3.21	0.92	1296
30	20	4.33	3.46	0.80	1224	4.03	3.23	0.80	1284	3.74	2.99	0.80	1356
30	22	4.58	3.11	0.68	1272	4.28	2.91	0.68	1344	3.99	2.71	0.68	1392
30	24	4.83	2.70	0.56	1320	4.54	2.54	0.56	1380	4.28	2.40	0.56	1440
30	26	5.08	2.24	0.44	1368	4.79	2.11	0.44	1428	4.49	1.98	0.44	1488
31	18	4.12	3.95	0.96	1176	3.78	3.63	0.96	1248	3.49	3.35	0.96	1296
31	20	4.33	3.63	0.84	1224	4.03	3.39	0.84	1284	3.74	3.14	0.84	1356
31	22	4.58	3.30	0.72	1272	4.28	3.08	0.72	1344	3.99	2.87	0.72	1392
31	24	4.83	2.90	0.60	1320	4.54	2.72	0.60	1380	4.28	2.57	0.60	1440
31	26	5.08	2.44	0.48	1368	4.79	2.30	0.48	1428	4.49	2.16	0.48	1488
32	18	4.12	4.12	1.00	1176	3.78	3.78	1.00	1248	3.49	3.49	1.00	1296
32	20	4.33	3.81	0.88	1224	4.03	3.55	0.88	1284	3.74	3.29	0.88	1356
32	22	4.58	3.48	0.76	1272	4.28	3.26	0.76	1344	3.99	3.03	0.76	1392
32	24	4.83	3.09	0.64	1320	4.54	2.90	0.64	1380	4.28	2.74	0.64	1440
32	26	5.08	2.64	0.52	1368	4.79	2.49	0.52	1428	4.49	2.34	0.52	1488

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-EF50VGW/B/S: MUZ-EF50VG

CAPACITY: 5.0 kW SHF: 0.7 INPUT: 1540 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.55	0.52	1509	4.50	2.34	0.52	1602	4.15	2.16	0.52	1663
21	20	5.15	2.06	0.40	1571	4.80	1.92	0.40	1648	4.45	1.78	0.40	1740
22	18	4.90	2.74	0.56	1509	4.50	2.52	0.56	1602	4.15	2.32	0.56	1663
22	20	5.15	2.27	0.44	1571	4.80	2.11	0.44	1648	4.45	1.96	0.44	1740
22	22	5.45	1.74	0.32	1632	5.10	1.63	0.32	1725	4.75	1.52	0.32	1786
23	18	4.90	2.94	0.60	1509	4.50	2.70	0.60	1602	4.15	2.49	0.60	1663
23	20	5.15	2.47	0.48	1571	4.80	2.30	0.48	1648	4.45	2.14	0.48	1740
23	22	5.45	1.96	0.36	1632	5.10	1.84	0.36	1725	4.75	1.71	0.36	1786
24	18	4.90	3.14	0.64	1509	4.50	2.88	0.64	1602	4.15	2.66	0.64	1663
24	20	5.15	2.68	0.52	1571	4.80	2.50	0.52	1648	4.45	2.31	0.52	1740
24	22	5.45	2.18	0.40	1632	5.10	2.04	0.40	1725	4.75	1.90	0.40	1786
24	24	5.75	1.61	0.28	1694	5.40	1.51	0.28	1771	5.10	1.43	0.28	1848
25	18	4.90	3.33	0.68	1509	4.50	3.06	0.68	1602	4.15	2.82	0.68	1663
25	20	5.15	2.88	0.56	1571	4.80	2.69	0.56	1648	4.45	2.49	0.56	1740
25	22	5.45	2.40	0.44	1632	5.10	2.24	0.44	1725	4.75	2.09	0.44	1786
25	24	5.75	1.84	0.32	1694	5.40	1.73	0.32	1771	5.10	1.63	0.32	1848
26	18	4.90	3.53	0.72	1509	4.50	3.24	0.72	1602	4.15	2.99	0.72	1663
26	20	5.15	3.09	0.60	1571	4.80	2.88	0.60	1648	4.45	2.67	0.60	1740
26	22	5.45	2.62	0.48	1632	5.10	2.45	0.48	1725	4.75	2.28	0.48	1786
26	24	5.75	2.07	0.36	1694	5.40	1.94	0.36	1771	5.10	1.84	0.36	1848
26	26	6.05	1.45	0.24	1756	5.70	1.37	0.24	1833	5.35	1.28	0.24	1910
27	18	4.90	3.72	0.76	1509	4.50	3.42	0.76	1602	4.15	3.15	0.76	1663
27	20	5.15	3.30	0.64	1571	4.80	3.07	0.64	1648	4.45	2.85	0.64	1740
27	22	5.45	2.83	0.52	1632	5.10	2.65	0.52	1725	4.75	2.47	0.52	1786
27	24	5.75	2.30	0.40	1694	5.40	2.16	0.40	1771	5.10	2.04	0.40	1848
27	26	6.05	1.69	0.28	1756	5.70	1.60	0.28	1833	5.35	1.50	0.28	1910
28	18	4.90	3.92	0.80	1509	4.50	3.60	0.80	1602	4.15	3.32	0.80	1663
28	20	5.15	3.50	0.68	1571	4.80	3.26	0.68	1648	4.45	3.03	0.68	1740
28	22	5.45	3.05	0.56	1632	5.10	2.86	0.56	1725	4.75	2.66	0.56	1786
28	24	5.75	2.53	0.44	1694	5.40	2.38	0.44	1771	5.10	2.24	0.44	1848
28	26	6.05	1.94	0.32	1756	5.70	1.82	0.32	1833	5.35	1.71	0.32	1910
29	18	4.90	4.12	0.84	1509	4.50	3.78	0.84	1602	4.15	3.49	0.84	1663
29	20	5.15	3.71	0.72	1571	4.80	3.46	0.72	1648	4.45	3.20	0.72	1740
29	22	5.45	3.27	0.60	1632	5.10	3.06	0.60	1725	4.75	2.85	0.60	1786
29	24	5.75	2.76	0.48	1694	5.40	2.59	0.48	1771	5.10	2.45	0.48	1848
29	26	6.05	2.18	0.36	1756	5.70	2.05	0.36	1833	5.35	1.93	0.36	1910
30	18	4.90	4.31	0.88	1509	4.50	3.96	0.88	1602	4.15	3.65	0.88	1663
30	20	5.15	3.91	0.76	1571	4.80	3.65	0.76	1648	4.45	3.38	0.76	1740
30	22	5.45	3.49	0.64	1632	5.10	3.26	0.64	1725	4.75	3.04	0.64	1786
30	24	5.75	2.99	0.52	1694	5.40	2.81	0.52	1771	5.10	2.65	0.52	1848
30	26	6.05	2.42	0.40	1756	5.70	2.28	0.40	1833	5.35	2.14	0.40	1910
31	18	4.90	4.51	0.92	1509	4.50	4.14	0.92	1602	4.15	3.82	0.92	1663
31	20	5.15	4.12	0.80	1571	4.80	3.84	0.80	1648	4.45	3.56	0.80	1740
31	22	5.45	3.71	0.68	1632	5.10	3.47	0.68	1725	4.75	3.23	0.68	1786
31	24	5.75	3.22	0.56	1694	5.40	3.02	0.56	1771	5.10	2.86	0.56	1848
31	26	6.05	2.66	0.44	1756	5.70	2.51	0.44	1833	5.35	2.35	0.44	1910
32	18	4.90	4.70	0.96	1509	4.50	4.32	0.96	1602	4.15	3.98	0.96	1663
32	20	5.15	4.33	0.84	1571	4.80	4.03	0.84	1648	4.45	3.74	0.84	1740
32	22	5.45	3.92	0.72	1632	5.10	3.67	0.72	1725	4.75	3.42	0.72	1786
32	24	5.75	3.45	0.60	1694	5.40	3.24	0.60	1771	5.10	3.06	0.60	1848
32	26	6.05	2.90	0.48	1756	5.70	2.74	0.48	1833	5.35	2.57	0.48	1910

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-SF25VE3: MUZ-SF25VE, MUZ-SF25VEH

CAPACITY: 2.5 kW SHF: 0.92 INPUT: 600 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.81	0.74	588	2.25	1.67	0.74	624	2.08	1.54	0.74	648
21	20	2.58	1.60	0.62	612	2.40	1.49	0.62	642	2.23	1.38	0.62	678
22	18	2.45	1.91	0.78	588	2.25	1.76	0.78	624	2.08	1.62	0.78	648
22	20	2.58	1.70	0.66	612	2.40	1.58	0.66	642	2.23	1.47	0.66	678
22	22	2.73	1.47	0.54	636	2.55	1.38	0.54	672	2.38	1.28	0.54	696
23	18	2.45	2.01	0.82	588	2.25	1.85	0.82	624	2.08	1.70	0.82	648
23	20	2.58	1.80	0.70	612	2.40	1.68	0.70	642	2.23	1.56	0.70	678
23	22	2.73	1.58	0.58	636	2.55	1.48	0.58	672	2.38	1.38	0.58	696
24	18	2.45	2.11	0.86	588	2.25	1.94	0.86	624	2.08	1.78	0.86	648
24	20	2.58	1.91	0.74	612	2.40	1.78	0.74	642	2.23	1.65	0.74	678
24	22	2.73	1.69	0.62	636	2.55	1.58	0.62	672	2.38	1.47	0.62	696
24	24	2.88	1.44	0.50	660	2.70	1.35	0.50	690	2.55	1.28	0.50	720
25	18	2.45	2.21	0.90	588	2.25	2.03	0.90	624	2.08	1.87	0.9	648
25	20	2.58	2.01	0.78	612	2.40	1.87	0.78	642	2.23	1.74	0.78	678
25	22	2.73	1.80	0.66	636	2.55	1.68	0.66	672	2.38	1.57	0.66	696
25	24	2.88	1.55	0.54	660	2.70	1.46	0.54	690	2.55	1.38	0.54	720
26	18	2.45	2.30	0.94	588	2.25	2.12	0.94	624	2.08	1.95	0.94	648
26	20	2.58	2.11	0.82	612	2.40	1.97	0.82	642	2.23	1.82	0.82	678
26	22	2.73	1.91	0.70	636	2.55	1.79	0.70	672	2.38	1.66	0.70	696
26	24	2.88	1.67	0.58	660	2.70	1.57	0.58	690	2.55	1.48	0.58	720
26	26	3.03	1.39	0.46	684	2.85	1.31	0.46	714	2.68	1.23	0.46	744
27	18	2.45	2.40	0.98	588	2.25	2.21	0.98	624	2.08	2.03	0.98	648
27	20	2.58	2.21	0.86	612	2.40	2.06	0.86	642	2.23	1.91	0.86	678
27	22	2.73	2.02	0.74	636	2.55	1.89	0.74	672	2.38	1.76	0.74	696
27	24	2.88	1.78	0.62	660	2.70	1.67	0.62	690	2.55	1.58	0.62	720
27	26	3.03	1.51	0.50	684	2.85	1.43	0.50	714	2.68	1.34	0.50	744
28	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
28	20	2.58	2.32	0.90	612	2.40	2.16	0.90	642	2.23	2.00	0.90	678
28	22	2.73	2.13	0.78	636	2.55	1.99	0.78	672	2.38	1.85	0.78	696
28	24	2.88	1.90	0.66	660	2.70	1.78	0.66	690	2.55	1.68	0.66	720
28	26	3.03	1.63	0.54	684	2.85	1.54	0.54	714	2.68	1.44	0.54	744
29	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
29	20	2.58	2.42	0.94	612	2.40	2.26	0.94	642	2.23	2.09	0.94	678
29	22	2.73	2.23	0.82	636	2.55	2.09	0.82	672	2.38	1.95	0.82	696
29	24	2.88	2.01	0.70	660	2.70	1.89	0.70	690	2.55	1.79	0.70	720
29	26	3.03	1.75	0.58	684	2.85	1.65	0.58	714	2.68	1.55	0.58	744
30	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
30	20	2.58	2.52	0.98	612	2.40	2.35	0.98	642	2.23	2.18	0.98	678
30	22	2.73	2.34	0.86	636	2.55	2.19	0.86	672	2.38	2.04	0.86	696
30	24	2.88	2.13	0.74	660	2.70	2.00	0.74	690	2.55	1.89	0.74	720
30	26	3.03	1.88	0.62	684	2.85	1.77	0.62	714	2.68	1.66	0.62	744
31	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
31	20	2.58	2.58	1.00	612	2.40	2.40	1.00	642	2.23	2.23	1.00	678
31	22	2.73	2.45	0.90	636	2.55	2.30	0.90	672	2.38	2.14	0.90	696
31	24	2.88	2.24	0.78	660	2.70	2.11	0.78	690	2.55	1.99	0.78	720
31	26	3.03	2.00	0.66	684	2.85	1.88	0.66	714	2.68	1.77	0.66	744
32	18	2.45	2.45	1.00	588	2.25	2.25	1.00	624	2.08	2.08	1.00	648
32	20	2.58	2.58	1.00	612	2.40	2.40	1.00	642	2.23	2.23	1.00	678
32	22	2.73	2.56	0.94	636	2.55	2.40	0.94	672	2.38	2.23	0.94	696
32	24	2.88	2.36	0.82	660	2.70	2.21	0.82	690	2.55	2.09	0.82	720
32	26	3.03	2.12	0.70	684	2.85	2.00	0.70	714	2.68	1.87	0.70	744

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-SF35VE3: MUZ-SF35VE, MUZ-SF35VEH

CAPACITY: 3.5 kW SHF: 0.80 INPUT: 1080 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.43	2.13	0.62	1058	3.15	1.95	0.62	1123	2.91	1.80	0.62	1166
21	20	3.61	1.80	0.50	1102	3.36	1.68	0.50	1156	3.12	1.56	0.50	1220
22	18	3.43	2.26	0.66	1058	3.15	2.08	0.66	1123	2.91	1.92	0.66	1166
22	20	3.61	1.95	0.54	1102	3.36	1.81	0.54	1156	3.12	1.68	0.54	1220
22	22	3.82	1.60	0.42	1145	3.57	1.50	0.42	1210	3.33	1.40	0.42	1253
23	18	3.43	2.40	0.70	1058	3.15	2.21	0.70	1123	2.91	2.03	0.70	1166
23	20	3.61	2.09	0.58	1102	3.36	1.95	0.58	1156	3.12	1.81	0.58	1220
23	22	3.82	1.75	0.46	1145	3.57	1.64	0.46	1210	3.33	1.53	0.46	1253
24	18	3.43	2.54	0.74	1058	3.15	2.33	0.74	1123	2.91	2.15	0.74	1166
24	20	3.61	2.24	0.62	1102	3.36	2.08	0.62	1156	3.12	1.93	0.62	1220
24	22	3.82	1.91	0.50	1145	3.57	1.79	0.50	1210	3.33	1.66	0.50	1253
24	24	4.03	1.53	0.38	1188	3.78	1.44	0.38	1242	3.57	1.36	0.38	1296
25	18	3.43	2.68	0.78	1058	3.15	2.46	0.78	1123	2.91	2.27	0.78	1166
25	20	3.61	2.38	0.66	1102	3.36	2.22	0.66	1156	3.12	2.06	0.66	1220
25	22	3.82	2.06	0.54	1145	3.57	1.93	0.54	1210	3.33	1.80	0.54	1253
25	24	4.03	1.69	0.42	1188	3.78	1.59	0.42	1242	3.57	1.50	0.42	1296
26	18	3.43	2.81	0.82	1058	3.15	2.58	0.82	1123	2.91	2.38	0.82	1166
26	20	3.61	2.52	0.70	1102	3.36	2.35	0.70	1156	3.12	2.18	0.70	1220
26	22	3.82	2.21	0.58	1145	3.57	2.07	0.58	1210	3.33	1.93	0.58	1253
26	24	4.03	1.85	0.46	1188	3.78	1.74	0.46	1242	3.57	1.64	0.46	1296
26	26	4.24	1.44	0.34	1231	3.99	1.36	0.34	1285	3.75	1.27	0.34	1339
27	18	3.43	2.95	0.86	1058	3.15	2.71	0.86	1123	2.91	2.50	0.86	1166
27	20	3.61	2.67	0.74	1102	3.36	2.49	0.74	1156	3.12	2.31	0.74	1220
27	22	3.82	2.37	0.62	1145	3.57	2.21	0.62	1210	3.33	2.06	0.62	1253
27	24	4.03	2.01	0.50	1188	3.78	1.89	0.50	1242	3.57	1.79	0.50	1296
27	26	4.24	1.61	0.38	1231	3.99	1.52	0.38	1285	3.75	1.42	0.38	1339
28	18	3.43	3.09	0.90	1058	3.15	2.84	0.90	1123	2.91	2.61	0.90	1166
28	20	3.61	2.81	0.78	1102	3.36	2.62	0.78	1156	3.12	2.43	0.78	1220
28	22	3.82	2.52	0.66	1145	3.57	2.36	0.66	1210	3.33	2.19	0.66	1253
28	24	4.03	2.17	0.54	1188	3.78	2.04	0.54	1242	3.57	1.93	0.54	1296
28	26	4.24	1.78	0.42	1231	3.99	1.68	0.42	1285	3.75	1.57	0.42	1339
29	18	3.43	3.22	0.94	1058	3.15	2.96	0.94	1123	2.91	2.73	0.94	1166
29	20	3.61	2.96	0.82	1102	3.36	2.76	0.82	1156	3.12	2.55	0.82	1220
29	22	3.82	2.67	0.70	1145	3.57	2.50	0.70	1210	3.33	2.33	0.70	1253
29	24	4.03	2.33	0.58	1188	3.78	2.19	0.58	1242	3.57	2.07	0.58	1296
29	26	4.24	1.95	0.46	1231	3.99	1.84	0.46	1285	3.75	1.72	0.46	1339
30	18	3.43	3.36	0.98	1058	3.15	3.09	0.98	1123	2.91	2.85	0.98	1166
30	20	3.61	3.10	0.86	1102	3.36	2.89	0.86	1156	3.12	2.68	0.86	1220
30	22	3.82	2.82	0.74	1145	3.57	2.64	0.74	1210	3.33	2.46	0.74	1253
30	24	4.03	2.50	0.62	1188	3.78	2.34	0.62	1242	3.57	2.21	0.62	1296
30	26	4.24	2.12	0.50	1231	3.99	2.00	0.50	1285	3.75	1.87	0.50	1339
31	18	3.43	3.43	1.00	1058	3.15	3.15	1.00	1123	2.91	2.91	1.00	1166
31	20	3.61	3.24	0.90	1102	3.36	3.02	0.90	1156	3.12	2.80	0.90	1220
31	22	3.82	2.98	0.78	1145	3.57	2.78	0.78	1210	3.33	2.59	0.78	1253
31	24	4.03	2.66	0.66	1188	3.78	2.49	0.66	1242	3.57	2.36	0.66	1296
31	26	4.24	2.29	0.54	1231	3.99	2.15	0.54	1285	3.75	2.02	0.54	1339
32	18	3.43	3.43	1.00	1058	3.15	3.15	1.00	1123	2.91	2.91	1.00	1166
32	20	3.61	3.39	0.94	1102	3.36	3.16	0.94	1156	3.12	2.93	0.94	1220
32	22	3.82	3.13	0.82	1145	3.57	2.93	0.82	1210	3.33	2.73	0.82	1253
32	24	4.03	2.82	0.70	1188	3.78	2.65	0.70	1242	3.57	2.50	0.70	1296
32	26	4.24	2.46	0.58	1231	3.99	2.31	0.58	1285	3.75	2.17	0.58	1339

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-SF42VE3: MUZ-SF42VE, MUZ-SF42VEH

CAPACITY: 4.2 kW SHF: 0.72 INPUT: 1340 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.12	2.22	0.54	1313	3.78	2.04	0.54	1394	3.49	1.88	0.54	1447
21	20	4.33	1.82	0.42	1367	4.03	1.69	0.42	1434	3.74	1.57	0.42	1514
22	18	4.12	2.39	0.58	1313	3.78	2.19	0.58	1394	3.49	2.02	0.58	1447
22	20	4.33	1.99	0.46	1367	4.03	1.85	0.46	1434	3.74	1.72	0.46	1514
22	22	4.58	1.56	0.34	1420	4.28	1.46	0.34	1501	3.99	1.36	0.34	1554
23	18	4.12	2.55	0.62	1313	3.78	2.34	0.62	1394	3.49	2.16	0.62	1447
23	20	4.33	2.16	0.50	1367	4.03	2.02	0.50	1434	3.74	1.87	0.50	1514
23	22	4.58	1.74	0.38	1420	4.28	1.63	0.38	1501	3.99	1.52	0.38	1554
24	18	4.12	2.72	0.66	1313	3.78	2.49	0.66	1394	3.49	2.30	0.66	1447
24	20	4.33	2.34	0.54	1367	4.03	2.18	0.54	1434	3.74	2.02	0.54	1514
24	22	4.58	1.92	0.42	1420	4.28	1.80	0.42	1501	3.99	1.68	0.42	1554
24	24	4.83	1.45	0.30	1474	4.54	1.36	0.30	1541	4.28	1.29	0.30	1608
25	18	4.12	2.88	0.70	1313	3.78	2.65	0.70	1394	3.49	2.44	0.7	1447
25	20	4.33	2.51	0.58	1367	4.03	2.34	0.58	1434	3.74	2.17	0.58	1514
25	22	4.58	2.11	0.46	1420	4.28	1.97	0.46	1501	3.99	1.84	0.46	1554
25	24	4.83	1.64	0.34	1474	4.54	1.54	0.34	1541	4.28	1.46	0.34	1608
26	18	4.12	3.05	0.74	1313	3.78	2.80	0.74	1394	3.49	2.58	0.74	1447
26	20	4.33	2.68	0.62	1367	4.03	2.50	0.62	1434	3.74	2.32	0.62	1514
26	22	4.58	2.29	0.50	1420	4.28	2.14	0.50	1501	3.99	2.00	0.50	1554
26	24	4.83	1.84	0.38	1474	4.54	1.72	0.38	1541	4.28	1.63	0.38	1608
26	26	5.08	1.32	0.26	1528	4.79	1.24	0.26	1595	4.49	1.17	0.26	1662
27	18	4.12	3.21	0.78	1313	3.78	2.95	0.78	1394	3.49	2.72	0.78	1447
27	20	4.33	2.86	0.66	1367	4.03	2.66	0.66	1434	3.74	2.47	0.66	1514
27	22	4.58	2.47	0.54	1420	4.28	2.31	0.54	1501	3.99	2.15	0.54	1554
27	24	4.83	2.03	0.42	1474	4.54	1.91	0.42	1541	4.28	1.80	0.42	1608
27	26	5.08	1.52	0.30	1528	4.79	1.44	0.30	1595	4.49	1.35	0.30	1662
28	18	4.12	3.38	0.82	1313	3.78	3.10	0.82	1394	3.49	2.86	0.82	1447
28	20	4.33	3.03	0.70	1367	4.03	2.82	0.70	1434	3.74	2.62	0.70	1514
28	22	4.58	2.66	0.58	1420	4.28	2.48	0.58	1501	3.99	2.31	0.58	1554
28	24	4.83	2.22	0.46	1474	4.54	2.09	0.46	1541	4.28	1.97	0.46	1608
28	26	5.08	1.73	0.34	1528	4.79	1.63	0.34	1595	4.49	1.53	0.34	1662
29	18	4.12	3.54	0.86	1313	3.78	3.25	0.86	1394	3.49	3.00	0.86	1447
29	20	4.33	3.20	0.74	1367	4.03	2.98	0.74	1434	3.74	2.77	0.74	1514
29	22	4.58	2.84	0.62	1420	4.28	2.66	0.62	1501	3.99	2.47	0.62	1554
29	24	4.83	2.42	0.50	1474	4.54	2.27	0.50	1541	4.28	2.14	0.50	1608
29	26	5.08	1.93	0.38	1528	4.79	1.82	0.38	1595	4.49	1.71	0.38	1662
30	18	4.12	3.70	0.90	1313	3.78	3.40	0.90	1394	3.49	3.14	0.90	1447
30	20	4.33	3.37	0.78	1367	4.03	3.14	0.78	1434	3.74	2.92	0.78	1514
30	22	4.58	3.02	0.66	1420	4.28	2.83	0.66	1501	3.99	2.63	0.66	1554
30	24	4.83	2.61	0.54	1474	4.54	2.45	0.54	1541	4.28	2.31	0.54	1608
30	26	5.08	2.13	0.42	1528	4.79	2.01	0.42	1595	4.49	1.89	0.42	1662
31	18	4.12	3.87	0.94	1313	3.78	3.55	0.94	1394	3.49	3.28	0.94	1447
31	20	4.33	3.55	0.82	1367	4.03	3.31	0.82	1434	3.74	3.07	0.82	1514
31	22	4.58	3.20	0.70	1420	4.28	3.00	0.70	1501	3.99	2.79	0.70	1554
31	24	4.83	2.80	0.58	1474	4.54	2.63	0.58	1541	4.28	2.48	0.58	1608
31	26	5.08	2.34	0.46	1528	4.79	2.20	0.46	1595	4.49	2.07	0.46	1662
32	18	4.12	4.03	0.98	1313	3.78	3.70	0.98	1394	3.49	3.42	0.98	1447
32	20	4.33	3.72	0.86	1367	4.03	3.47	0.86	1434	3.74	3.21	0.86	1514
32	22	4.58	3.39	0.74	1420	4.28	3.17	0.74	1501	3.99	2.95	0.74	1554
32	24	4.83	2.99	0.62	1474	4.54	2.81	0.62	1541	4.28	2.66	0.62	1608
32	26	5.08	2.54	0.50	1528	4.79	2.39	0.50	1595	4.49	2.25	0.50	1662

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency
MSZ-SF50VE3: MUZ-SF50VE, MUZ-SF50VEH

CAPACITY: 5.0 kW SHF: 0.70 INPUT: 1660 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.55	0.52	1627	4.50	2.34	0.52	1726	4.15	2.16	0.52	1793
21	20	5.15	2.06	0.40	1693	4.80	1.92	0.40	1776	4.45	1.78	0.40	1876
22	18	4.90	2.74	0.56	1627	4.50	2.52	0.56	1726	4.15	2.32	0.56	1793
22	20	5.15	2.27	0.44	1693	4.80	2.11	0.44	1776	4.45	1.96	0.44	1876
22	22	5.45	1.74	0.32	1760	5.10	1.63	0.32	1859	4.75	1.52	0.32	1926
23	18	4.90	2.94	0.60	1627	4.50	2.70	0.60	1726	4.15	2.49	0.60	1793
23	20	5.15	2.47	0.48	1693	4.80	2.30	0.48	1776	4.45	2.14	0.48	1876
23	22	5.45	1.96	0.36	1760	5.10	1.84	0.36	1859	4.75	1.71	0.36	1926
24	18	4.90	3.14	0.64	1627	4.50	2.88	0.64	1726	4.15	2.66	0.64	1793
24	20	5.15	2.68	0.52	1693	4.80	2.50	0.52	1776	4.45	2.31	0.52	1876
24	22	5.45	2.18	0.40	1760	5.10	2.04	0.40	1859	4.75	1.90	0.40	1926
24	24	5.75	1.61	0.28	1826	5.40	1.51	0.28	1909	5.10	1.43	0.28	1992
25	18	4.90	3.33	0.68	1627	4.50	3.06	0.68	1726	4.15	2.82	0.68	1793
25	20	5.15	2.88	0.56	1693	4.80	2.69	0.56	1776	4.45	2.49	0.56	1876
25	22	5.45	2.40	0.44	1760	5.10	2.24	0.44	1859	4.75	2.09	0.44	1926
25	24	5.75	1.84	0.32	1826	5.40	1.73	0.32	1909	5.10	1.63	0.32	1992
26	18	4.90	3.53	0.72	1627	4.50	3.24	0.72	1726	4.15	2.99	0.72	1793
26	20	5.15	3.09	0.60	1693	4.80	2.88	0.60	1776	4.45	2.67	0.60	1876
26	22	5.45	2.62	0.48	1760	5.10	2.45	0.48	1859	4.75	2.28	0.48	1926
26	24	5.75	2.07	0.36	1826	5.40	1.94	0.36	1909	5.10	1.84	0.36	1992
26	26	6.05	1.45	0.24	1892	5.70	1.37	0.24	1975	5.35	1.28	0.24	2058
27	18	4.90	3.72	0.76	1627	4.50	3.42	0.76	1726	4.15	3.15	0.76	1793
27	20	5.15	3.30	0.64	1693	4.80	3.07	0.64	1776	4.45	2.85	0.64	1876
27	22	5.45	2.83	0.52	1760	5.10	2.65	0.52	1859	4.75	2.47	0.52	1926
27	24	5.75	2.30	0.40	1826	5.40	2.16	0.40	1909	5.10	2.04	0.40	1992
27	26	6.05	1.69	0.28	1892	5.70	1.60	0.28	1975	5.35	1.50	0.28	2058
28	18	4.90	3.92	0.80	1627	4.50	3.60	0.80	1726	4.15	3.32	0.80	1793
28	20	5.15	3.50	0.68	1693	4.80	3.26	0.68	1776	4.45	3.03	0.68	1876
28	22	5.45	3.05	0.56	1760	5.10	2.86	0.56	1859	4.75	2.66	0.56	1926
28	24	5.75	2.53	0.44	1826	5.40	2.38	0.44	1909	5.10	2.24	0.44	1992
28	26	6.05	1.94	0.32	1892	5.70	1.82	0.32	1975	5.35	1.71	0.32	2058
29	18	4.90	4.12	0.84	1627	4.50	3.78	0.84	1726	4.15	3.49	0.84	1793
29	20	5.15	3.71	0.72	1693	4.80	3.46	0.72	1776	4.45	3.20	0.72	1876
29	22	5.45	3.27	0.60	1760	5.10	3.06	0.60	1859	4.75	2.85	0.60	1926
29	24	5.75	2.76	0.48	1826	5.40	2.59	0.48	1909	5.10	2.45	0.48	1992
29	26	6.05	2.18	0.36	1892	5.70	2.05	0.36	1975	5.35	1.93	0.36	2058
30	18	4.90	4.31	0.88	1627	4.50	3.96	0.88	1726	4.15	3.65	0.88	1793
30	20	5.15	3.91	0.76	1693	4.80	3.65	0.76	1776	4.45	3.38	0.76	1876
30	22	5.45	3.49	0.64	1760	5.10	3.26	0.64	1859	4.75	3.04	0.64	1926
30	24	5.75	2.99	0.52	1826	5.40	2.81	0.52	1909	5.10	2.65	0.52	1992
30	26	6.05	2.42	0.40	1892	5.70	2.28	0.40	1975	5.35	2.14	0.40	2058
31	18	4.90	4.51	0.92	1627	4.50	4.14	0.92	1726	4.15	3.82	0.92	1793
31	20	5.15	4.12	0.80	1693	4.80	3.84	0.80	1776	4.45	3.56	0.80	1876
31	22	5.45	3.71	0.68	1760	5.10	3.47	0.68	1859	4.75	3.23	0.68	1926
31	24	5.75	3.22	0.56	1826	5.40	3.02	0.56	1909	5.10	2.86	0.56	1992
31	26	6.05	2.66	0.44	1892	5.70	2.51	0.44	1975	5.35	2.35	0.44	2058
32	18	4.90	4.70	0.96	1627	4.50	4.32	0.96	1726	4.15	3.98	0.96	1793
32	20	5.15	4.33	0.84	1693	4.80	4.03	0.84	1776	4.45	3.74	0.84	1876
32	22	5.45	3.92	0.72	1760	5.10	3.67	0.72	1859	4.75	3.42	0.72	1926
32	24	5.75	3.45	0.60	1826	5.40	3.24	0.60	1909	5.10	3.06	0.60	1992
32	26	6.05	2.90	0.48	1892	5.70	2.74	0.48	1975	5.35	2.57	0.48	2058

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-GF60VE2: MUZ-GF60VE

CAPACITY: 6.1 kW SHF: 0.79 INPUT: 1790 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.98	3.65	0.61	1754	5.49	3.35	0.61	1862	5.06	3.09	0.61	1933
21	20	6.28	3.08	0.49	1826	5.86	2.87	0.49	1915	5.43	2.66	0.49	2023
22	18	5.98	3.89	0.65	1754	5.49	3.57	0.65	1862	5.06	3.29	0.65	1933
22	20	6.28	3.33	0.53	1826	5.86	3.10	0.53	1915	5.43	2.88	0.53	2023
22	22	6.65	2.73	0.41	1897	6.22	2.55	0.41	2005	5.79	2.38	0.41	2076
23	18	5.98	4.12	0.69	1754	5.49	3.79	0.69	1862	5.06	3.49	0.69	1933
23	20	6.28	3.58	0.57	1826	5.86	3.34	0.57	1915	5.43	3.09	0.57	2023
23	22	6.65	2.99	0.45	1897	6.22	2.80	0.45	2005	5.79	2.61	0.45	2076
24	18	5.98	4.36	0.73	1754	5.49	4.01	0.73	1862	5.06	3.70	0.73	1933
24	20	6.28	3.83	0.61	1826	5.86	3.57	0.61	1915	5.43	3.31	0.61	2023
24	22	6.65	3.26	0.49	1897	6.22	3.05	0.49	2005	5.79	2.84	0.49	2076
24	24	7.01	2.60	0.37	1969	6.59	2.44	0.37	2059	6.22	2.30	0.37	2148
25	18	5.98	4.60	0.77	1754	5.49	4.23	0.77	1862	5.06	3.90	0.77	1933
25	20	6.28	4.08	0.65	1826	5.86	3.81	0.65	1915	5.43	3.53	0.65	2023
25	22	6.65	3.52	0.53	1897	6.22	3.30	0.53	2005	5.79	3.07	0.53	2076
25	24	7.01	2.88	0.41	1969	6.59	2.70	0.41	2059	6.22	2.55	0.41	2148
26	18	5.98	4.84	0.81	1754	5.49	4.45	0.81	1862	5.06	4.10	0.81	1933
26	20	6.28	4.34	0.69	1826	5.86	4.04	0.69	1915	5.43	3.75	0.69	2023
26	22	6.65	3.79	0.57	1897	6.22	3.55	0.57	2005	5.79	3.30	0.57	2076
26	24	7.01	3.16	0.45	1969	6.59	2.96	0.45	2059	6.22	2.80	0.45	2148
26	26	7.38	2.44	0.33	2041	6.95	2.29	0.33	2130	6.53	2.15	0.33	2220
27	18	5.98	5.08	0.85	1754	5.49	4.67	0.85	1862	5.06	4.30	0.85	1933
27	20	6.28	4.59	0.73	1826	5.86	4.27	0.73	1915	5.43	3.96	0.73	2023
27	22	6.65	4.06	0.61	1897	6.22	3.80	0.61	2005	5.79	3.53	0.61	2076
27	24	7.01	3.44	0.49	1969	6.59	3.23	0.49	2059	6.22	3.05	0.49	2148
27	26	7.38	2.73	0.37	2041	6.95	2.57	0.37	2130	6.53	2.41	0.37	2220
28	18	5.98	5.32	0.89	1754	5.49	4.89	0.89	1862	5.06	4.51	0.89	1933
28	20	6.28	4.84	0.77	1826	5.86	4.51	0.77	1915	5.43	4.18	0.77	2023
28	22	6.65	4.32	0.65	1897	6.22	4.04	0.65	2005	5.79	3.77	0.65	2076
28	24	7.01	3.72	0.53	1969	6.59	3.49	0.53	2059	6.22	3.30	0.53	2148
28	26	7.38	3.03	0.41	2041	6.95	2.85	0.41	2130	6.53	2.68	0.41	2220
29	18	5.98	5.56	0.93	1754	5.49	5.11	0.93	1862	5.06	4.71	0.93	1933
29	20	6.28	5.09	0.81	1826	5.86	4.74	0.81	1915	5.43	4.40	0.81	2023
29	22	6.65	4.59	0.69	1897	6.22	4.29	0.69	2005	5.79	4.00	0.69	2076
29	24	7.01	4.00	0.57	1969	6.59	3.76	0.57	2059	6.22	3.55	0.57	2148
29	26	7.38	3.32	0.45	2041	6.95	3.13	0.45	2130	6.53	2.94	0.45	2220
30	18	5.98	5.80	0.97	1754	5.49	5.33	0.97	1862	5.06	4.91	0.97	1933
30	20	6.28	5.34	0.85	1826	5.86	4.98	0.85	1915	5.43	4.61	0.85	2023
30	22	6.65	4.85	0.73	1897	6.22	4.54	0.73	2005	5.79	4.23	0.73	2076
30	24	7.01	4.28	0.61	1969	6.59	4.02	0.61	2059	6.22	3.80	0.61	2148
30	26	7.38	3.62	0.49	2041	6.95	3.41	0.49	2130	6.53	3.20	0.49	2220
31	18	5.98	5.98	1.00	1754	5.49	5.49	1.00	1862	5.06	5.06	1.00	1933
31	20	6.28	5.59	0.89	1826	5.86	5.21	0.89	1915	5.43	4.83	0.89	2023
31	22	6.65	5.12	0.77	1897	6.22	4.79	0.77	2005	5.79	4.46	0.77	2076
31	24	7.01	4.56	0.65	1969	6.59	4.28	0.65	2059	6.22	4.04	0.65	2148
31	26	7.38	3.91	0.53	2041	6.95	3.69	0.53	2130	6.53	3.46	0.53	2220
32	18	5.98	5.98	1.00	1754	5.49	5.49	1.00	1862	5.06	5.06	1.00	1933
32	20	6.28	5.84	0.93	1826	5.86	5.45	0.93	1915	5.43	5.05	0.93	2023
32	22	6.65	5.39	0.81	1897	6.22	5.04	0.81	2005	5.79	4.69	0.81	2076
32	24	7.01	4.84	0.69	1969	6.59	4.55	0.69	2059	6.22	4.29	0.69	2148
32	26	7.38	4.21	0.57	2041	6.95	3.96	0.57	2130	6.53	3.72	0.57	2220

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-GF71VE2: MUZ-GF71VE

CAPACITY: 7.1 kW

SHF: 0.78

INPUT: 2130 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	6.96	4.17	0.60	2087	6.39	3.83	0.60	2215	5.89	3.54	0.60	2300
21	20	7.31	3.51	0.48	2173	6.82	3.27	0.48	2279	6.32	3.03	0.48	2407
22	18	6.96	4.45	0.64	2087	6.39	4.09	0.64	2215	5.89	3.77	0.64	2300
22	20	7.31	3.80	0.52	2173	6.82	3.54	0.52	2279	6.32	3.29	0.52	2407
22	22	7.74	3.10	0.40	2258	7.24	2.90	0.40	2386	6.75	2.70	0.40	2471
23	18	6.96	4.73	0.68	2087	6.39	4.35	0.68	2215	5.89	4.01	0.68	2300
23	20	7.31	4.10	0.56	2173	6.82	3.82	0.56	2279	6.32	3.54	0.56	2407
23	22	7.74	3.41	0.44	2258	7.24	3.19	0.44	2386	6.75	2.97	0.44	2471
24	18	6.96	5.01	0.72	2087	6.39	4.60	0.72	2215	5.89	4.24	0.72	2300
24	20	7.31	4.39	0.60	2173	6.82	4.09	0.60	2279	6.32	3.79	0.60	2407
24	22	7.74	3.71	0.48	2258	7.24	3.48	0.48	2386	6.75	3.24	0.48	2471
24	24	8.17	2.94	0.36	2343	7.67	2.76	0.36	2450	7.24	2.61	0.36	2556
25	18	6.96	5.29	0.76	2087	6.39	4.86	0.76	2215	5.89	4.48	0.76	2300
25	20	7.31	4.68	0.64	2173	6.82	4.36	0.64	2279	6.32	4.04	0.64	2407
25	22	7.74	4.02	0.52	2258	7.24	3.77	0.52	2386	6.75	3.51	0.52	2471
25	24	8.17	3.27	0.40	2343	7.67	3.07	0.40	2450	7.24	2.90	0.40	2556
26	18	6.96	5.57	0.80	2087	6.39	5.11	0.80	2215	5.89	4.71	0.80	2300
26	20	7.31	4.97	0.68	2173	6.82	4.63	0.68	2279	6.32	4.30	0.68	2407
26	22	7.74	4.33	0.56	2258	7.24	4.06	0.56	2386	6.75	3.78	0.56	2471
26	24	8.17	3.59	0.44	2343	7.67	3.37	0.44	2450	7.24	3.19	0.44	2556
26	26	8.59	2.75	0.32	2428	8.09	2.59	0.32	2535	7.60	2.43	0.32	2641
27	18	6.96	5.84	0.84	2087	6.39	5.37	0.84	2215	5.89	4.95	0.84	2300
27	20	7.31	5.27	0.72	2173	6.82	4.91	0.72	2279	6.32	4.55	0.72	2407
27	22	7.74	4.64	0.60	2258	7.24	4.35	0.60	2386	6.75	4.05	0.60	2471
27	24	8.17	3.92	0.48	2343	7.67	3.68	0.48	2450	7.24	3.48	0.48	2556
27	26	8.59	3.09	0.36	2428	8.09	2.91	0.36	2535	7.60	2.73	0.36	2641
28	18	6.96	6.12	0.88	2087	6.39	5.62	0.88	2215	5.89	5.19	0.88	2300
28	20	7.31	5.56	0.76	2173	6.82	5.18	0.76	2279	6.32	4.80	0.76	2407
28	22	7.74	4.95	0.64	2258	7.24	4.63	0.64	2386	6.75	4.32	0.64	2471
28	24	8.17	4.25	0.52	2343	7.67	3.99	0.52	2450	7.24	3.77	0.52	2556
28	26	8.59	3.44	0.40	2428	8.09	3.24	0.40	2535	7.60	3.04	0.40	2641
29	18	6.96	6.40	0.92	2087	6.39	5.88	0.92	2215	5.89	5.42	0.92	2300
29	20	7.31	5.85	0.80	2173	6.82	5.45	0.80	2279	6.32	5.06	0.80	2407
29	22	7.74	5.26	0.68	2258	7.24	4.92	0.68	2386	6.75	4.59	0.68	2471
29	24	8.17	4.57	0.56	2343	7.67	4.29	0.56	2450	7.24	4.06	0.56	2556
29	26	8.59	3.78	0.44	2428	8.09	3.56	0.44	2535	7.60	3.34	0.44	2641
30	18	6.96	6.68	0.96	2087	6.39	6.13	0.96	2215	5.89	5.66	0.96	2300
30	20	7.31	6.14	0.84	2173	6.82	5.73	0.84	2279	6.32	5.31	0.84	2407
30	22	7.74	5.57	0.72	2258	7.24	5.21	0.72	2386	6.75	4.86	0.72	2471
30	24	8.17	4.90	0.60	2343	7.67	4.60	0.60	2450	7.24	4.35	0.60	2556
30	26	8.59	4.12	0.48	2428	8.09	3.89	0.48	2535	7.60	3.65	0.48	2641
31	18	6.96	6.96	1.00	2087	6.39	6.39	1.00	2215	5.89	5.89	1.00	2300
31	20	7.31	6.44	0.88	2173	6.82	6.00	0.88	2279	6.32	5.56	0.88	2407
31	22	7.74	5.88	0.76	2258	7.24	5.50	0.76	2386	6.75	5.13	0.76	2471
31	24	8.17	5.23	0.64	2343	7.67	4.91	0.64	2450	7.24	4.63	0.64	2556
31	26	8.59	4.47	0.52	2428	8.09	4.21	0.52	2535	7.60	3.95	0.52	2641
32	18	6.96	6.96	1.00	2087	6.39	6.39	1.00	2215	5.89	5.89	1.00	2300
32	20	7.31	6.73	0.92	2173	6.82	6.27	0.92	2279	6.32	5.81	0.92	2407
32	22	7.74	6.19	0.80	2258	7.24	5.79	0.80	2386	6.75	5.40	0.80	2471
32	24	8.17	5.55	0.68	2343	7.67	5.21	0.68	2450	7.24	4.92	0.68	2556
32	26	8.59	4.81	0.56	2428	8.09	4.53	0.56	2535	7.60	4.25	0.56	2641

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency**MSZ-WN25VA: MUZ-WN25VA**

CAPACITY: 2.5 kW SHF: 0.89 INPUT: 710 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.09	0.71	568	2.81	2.00	0.71	596	2.70	1.92	0.71	625	2.60	1.85	0.71	653
21	20	3.06	1.81	0.59	596	2.94	1.73	0.59	632	2.85	1.68	0.59	646	2.75	1.62	0.59	675
22	18	2.94	2.20	0.75	568	2.81	2.11	0.75	596	2.70	2.03	0.75	625	2.60	1.95	0.75	653
22	20	3.06	1.93	0.63	596	2.94	1.85	0.63	632	2.85	1.80	0.63	646	2.75	1.73	0.63	675
22	22	3.19	1.63	0.51	618	3.08	1.57	0.51	657	3.00	1.53	0.51	675	2.88	1.47	0.51	703
23	18	2.94	2.32	0.79	568	2.81	2.22	0.79	596	2.70	2.13	0.79	625	2.60	2.05	0.79	653
23	20	3.06	2.05	0.67	596	2.94	1.97	0.67	632	2.85	1.91	0.67	646	2.75	1.84	0.67	675
23	22	3.19	1.75	0.55	618	3.08	1.69	0.55	657	3.00	1.65	0.55	675	2.88	1.58	0.55	703
24	18	2.94	2.44	0.83	568	2.81	2.33	0.83	596	2.70	2.24	0.83	625	2.60	2.16	0.83	653
24	20	3.06	2.17	0.71	596	2.94	2.09	0.71	632	2.85	2.02	0.71	646	2.75	1.95	0.71	675
24	22	3.19	1.88	0.59	618	3.08	1.81	0.59	657	3.00	1.77	0.59	675	2.88	1.70	0.59	703
24	24	3.35	1.57	0.47	646	3.23	1.52	0.47	682	3.15	1.48	0.47	703	3.05	1.43	0.47	738
25	18	2.94	2.56	0.87	568	2.81	2.45	0.87	596	2.70	2.35	0.87	625	2.60	2.26	0.87	653
25	20	3.06	2.30	0.75	596	2.94	2.20	0.75	632	2.85	2.14	0.75	646	2.75	2.06	0.75	675
25	22	3.19	2.01	0.63	618	3.08	1.94	0.63	657	3.00	1.89	0.63	675	2.88	1.81	0.63	703
25	24	3.35	1.71	0.51	646	3.23	1.64	0.51	682	3.15	1.61	0.51	703	3.05	1.56	0.51	738
26	18	2.94	2.67	0.91	568	2.81	2.56	0.91	596	2.70	2.46	0.91	625	2.60	2.37	0.91	653
26	20	3.06	2.42	0.79	596	2.94	2.32	0.79	632	2.85	2.25	0.79	646	2.75	2.17	0.79	675
26	22	3.19	2.14	0.67	618	3.08	2.06	0.67	657	3.00	2.01	0.67	675	2.88	1.93	0.67	703
26	24	3.35	1.84	0.55	646	3.23	1.77	0.55	682	3.15	1.73	0.55	703	3.05	1.68	0.55	738
26	26	3.45	1.48	0.43	682	3.35	1.44	0.43	717	3.30	1.42	0.43	738	3.20	1.38	0.43	760
27	18	2.94	2.79	0.95	568	2.81	2.67	0.95	596	2.70	2.57	0.95	625	2.60	2.47	0.95	653
27	20	3.06	2.54	0.83	596	2.94	2.44	0.83	632	2.85	2.37	0.83	646	2.75	2.28	0.83	675
27	22	3.19	2.26	0.71	618	3.08	2.18	0.71	657	3.00	2.13	0.71	675	2.88	2.04	0.71	703
27	24	3.35	1.98	0.59	646	3.23	1.90	0.59	682	3.15	1.86	0.59	703	3.05	1.80	0.59	738
27	26	3.45	1.62	0.47	682	3.35	1.57	0.47	717	3.30	1.55	0.47	738	3.20	1.50	0.47	760
28	18	2.94	2.91	0.99	568	2.81	2.78	0.99	596	2.70	2.67	0.99	625	2.60	2.57	0.99	653
28	20	3.06	2.66	0.87	596	2.94	2.56	0.87	632	2.85	2.48	0.87	646	2.75	2.39	0.87	675
28	22	3.19	2.39	0.75	618	3.08	2.31	0.75	657	3.00	2.25	0.75	675	2.88	2.16	0.75	703
28	24	3.35	2.11	0.63	646	3.23	2.03	0.63	682	3.15	1.98	0.63	703	3.05	1.92	0.63	738
28	26	3.45	1.76	0.51	682	3.35	1.71	0.51	717	3.30	1.68	0.51	738	3.20	1.63	0.51	760
29	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
29	20	3.06	2.79	0.91	596	2.94	2.67	0.91	632	2.85	2.59	0.91	646	2.75	2.50	0.91	675
29	22	3.19	2.52	0.79	618	3.08	2.43	0.79	657	3.00	2.37	0.79	675	2.88	2.27	0.79	703
29	24	3.35	2.24	0.67	646	3.23	2.16	0.67	682	3.15	2.11	0.67	703	3.05	2.04	0.67	738
29	26	3.45	1.90	0.55	682	3.35	1.84	0.55	717	3.30	1.82	0.55	738	3.20	1.76	0.55	760
30	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
30	20	3.06	2.91	0.95	596	2.94	2.79	0.95	632	2.85	2.71	0.95	646	2.75	2.61	0.95	675
30	22	3.19	2.65	0.83	618	3.08	2.55	0.83	657	3.00	2.49	0.83	675	2.88	2.39	0.83	703
30	24	3.35	2.38	0.71	646	3.23	2.29	0.71	682	3.15	2.24	0.71	703	3.05	2.17	0.71	738
30	26	3.45	2.04	0.59	682	3.35	1.98	0.59	717	3.30	1.95	0.59	738	3.20	1.89	0.59	760
31	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
31	20	3.06	3.03	0.99	596	2.94	2.91	0.99	632	2.85	2.82	0.99	646	2.75	2.72	0.99	675
31	22	3.19	2.77	0.87	618	3.08	2.68	0.87	657	3.00	2.61	0.87	675	2.88	2.50	0.87	703
31	24	3.35	2.51	0.75	646	3.23	2.42	0.75	682	3.15	2.36	0.75	703	3.05	2.29	0.75	738
31	26	3.45	2.17	0.63	682	3.35	2.11	0.63	717	3.30	2.08	0.63	738	3.20	2.02	0.63	760
32	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
32	20	3.06	3.06	1.00	596	2.94	2.94	1.00	632	2.85	2.85	1.00	646	2.75	2.75	1.00	675
32	22	3.19	2.90	0.91	618	3.08	2.80	0.91	657	3.00	2.73	0.91	675	2.88	2.62	0.91	703
32	24	3.35	2.65	0.79	646	3.23	2.55	0.79	682	3.15	2.49	0.79	703	3.05	2.41	0.79	738
32	26	3.45	2.31	0.67	682	3.35	2.24	0.67	717	3.30	2.21	0.67	738	3.20	2.14	0.67	760

WALL-MOUNTED PERFORMANCE DATA

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-WN25VA: MUZ-WN25VA

CAPACITY: 2.5 kW

SHF: 0.89

INPUT: 710 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.74	0.71	696	2.25	1.60	0.71	738	2.08	1.47	0.71	767
21	20	2.58	1.52	0.59	724	2.40	1.42	0.59	760	2.23	1.31	0.59	802
22	18	2.45	1.84	0.75	696	2.25	1.69	0.75	738	2.08	1.56	0.75	767
22	20	2.58	1.62	0.63	724	2.40	1.51	0.63	760	2.23	1.40	0.63	802
22	22	2.73	1.39	0.51	753	2.55	1.30	0.51	795	2.38	1.21	0.51	824
23	18	2.45	1.94	0.79	696	2.25	1.78	0.79	738	2.08	1.64	0.79	767
23	20	2.58	1.73	0.67	724	2.40	1.61	0.67	760	2.23	1.49	0.67	802
23	22	2.73	1.50	0.55	753	2.55	1.40	0.55	795	2.38	1.31	0.55	824
24	18	2.45	2.03	0.83	696	2.25	1.87	0.83	738	2.08	1.72	0.83	767
24	20	2.58	1.83	0.71	724	2.40	1.70	0.71	760	2.23	1.58	0.71	802
24	22	2.73	1.61	0.59	753	2.55	1.50	0.59	795	2.38	1.40	0.59	824
24	24	2.88	1.35	0.47	781	2.70	1.27	0.47	817	2.55	1.20	0.47	852
25	18	2.45	2.13	0.87	696	2.25	1.96	0.87	738	2.08	1.81	0.87	767
25	20	2.58	1.93	0.75	724	2.40	1.80	0.75	760	2.23	1.67	0.75	802
25	22	2.73	1.72	0.63	753	2.55	1.61	0.63	795	2.38	1.50	0.63	824
25	24	2.88	1.47	0.51	781	2.70	1.38	0.51	817	2.55	1.30	0.51	852
26	18	2.45	2.23	0.91	696	2.25	2.05	0.91	738	2.08	1.89	0.91	767
26	20	2.58	2.03	0.79	724	2.40	1.90	0.79	760	2.23	1.76	0.79	802
26	22	2.73	1.83	0.67	753	2.55	1.71	0.67	795	2.38	1.59	0.67	824
26	24	2.88	1.58	0.55	781	2.70	1.49	0.55	817	2.55	1.40	0.55	852
26	26	3.03	1.30	0.43	809	2.85	1.23	0.43	845	2.68	1.15	0.43	880
27	18	2.45	2.33	0.95	696	2.25	2.14	0.95	738	2.08	1.97	0.95	767
27	20	2.58	2.14	0.83	724	2.40	1.99	0.83	760	2.23	1.85	0.83	802
27	22	2.73	1.93	0.71	753	2.55	1.81	0.71	795	2.38	1.69	0.71	824
27	24	2.88	1.70	0.59	781	2.70	1.59	0.59	817	2.55	1.50	0.59	852
27	26	3.03	1.42	0.47	809	2.85	1.34	0.47	845	2.68	1.26	0.47	880
28	18	2.45	2.43	0.99	696	2.25	2.23	0.99	738	2.08	2.05	0.99	767
28	20	2.58	2.24	0.87	724	2.40	2.09	0.87	760	2.23	1.94	0.87	802
28	22	2.73	2.04	0.75	753	2.55	1.91	0.75	795	2.38	1.78	0.75	824
28	24	2.88	1.81	0.63	781	2.70	1.70	0.63	817	2.55	1.61	0.63	852
28	26	3.03	1.54	0.51	809	2.85	1.45	0.51	845	2.68	1.36	0.51	880
29	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
29	20	2.58	2.34	0.91	724	2.40	2.18	0.91	760	2.23	2.02	0.91	802
29	22	2.73	2.15	0.79	753	2.55	2.01	0.79	795	2.38	1.88	0.79	824
29	24	2.88	1.93	0.67	781	2.70	1.81	0.67	817	2.55	1.71	0.67	852
29	26	3.03	1.66	0.55	809	2.85	1.57	0.55	845	2.68	1.47	0.55	880
30	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
30	20	2.58	2.45	0.95	724	2.40	2.28	0.95	760	2.23	2.11	0.95	802
30	22	2.73	2.26	0.83	753	2.55	2.12	0.83	795	2.38	1.97	0.83	824
30	24	2.88	2.04	0.71	781	2.70	1.92	0.71	817	2.55	1.81	0.71	852
30	26	3.03	1.78	0.59	809	2.85	1.68	0.59	845	2.68	1.58	0.59	880
31	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
31	20	2.58	2.55	0.99	724	2.40	2.38	0.99	760	2.23	2.20	0.99	802
31	22	2.73	2.37	0.87	753	2.55	2.22	0.87	795	2.38	2.07	0.87	824
31	24	2.88	2.16	0.75	781	2.70	2.03	0.75	817	2.55	1.91	0.75	852
31	26	3.03	1.91	0.63	809	2.85	1.80	0.63	845	2.68	1.69	0.63	880
32	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
32	20	2.58	2.58	1.00	724	2.40	2.40	1.00	760	2.23	2.23	1.00	802
32	22	2.73	2.48	0.91	753	2.55	2.32	0.91	795	2.38	2.16	0.91	824
32	24	2.88	2.27	0.79	781	2.70	2.13	0.79	817	2.55	2.01	0.79	852
32	26	3.03	2.03	0.67	809	2.85	1.91	0.67	845	2.68	1.79	0.67	880

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-WN35VA: MUZ-WN35VA

CAPACITY: 3.15 kW SHF: 0.87 INPUT: 1020 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.70	2.55	0.69	816	3.54	2.45	0.69	857	3.40	2.35	0.69	898	3.28	2.26	0.69	938
21	20	3.86	2.20	0.57	857	3.70	2.11	0.57	908	3.59	2.05	0.57	928	3.47	1.98	0.57	969
22	18	3.70	2.70	0.73	816	3.54	2.59	0.73	857	3.40	2.48	0.73	898	3.28	2.39	0.73	938
22	20	3.86	2.35	0.61	857	3.70	2.26	0.61	908	3.59	2.19	0.61	928	3.47	2.11	0.61	969
22	22	4.02	1.97	0.49	887	3.87	1.90	0.49	944	3.78	1.85	0.49	969	3.62	1.78	0.49	1010
23	18	3.70	2.85	0.77	816	3.54	2.73	0.77	857	3.40	2.62	0.77	898	3.28	2.52	0.77	938
23	20	3.86	2.51	0.65	857	3.70	2.41	0.65	908	3.59	2.33	0.65	928	3.47	2.25	0.65	969
23	22	4.02	2.13	0.53	887	3.87	2.05	0.53	944	3.78	2.00	0.53	969	3.62	1.92	0.53	1010
24	18	3.70	3.00	0.81	816	3.54	2.87	0.81	857	3.40	2.76	0.81	898	3.28	2.65	0.81	938
24	20	3.86	2.66	0.69	857	3.70	2.55	0.69	908	3.59	2.48	0.69	928	3.47	2.39	0.69	969
24	22	4.02	2.29	0.57	887	3.87	2.21	0.57	944	3.78	2.15	0.57	969	3.62	2.06	0.57	1010
24	24	4.22	1.90	0.45	928	4.06	1.83	0.45	979	3.97	1.79	0.45	1010	3.84	1.73	0.45	1061
25	18	3.70	3.15	0.85	816	3.54	3.01	0.85	857	3.40	2.89	0.85	898	3.28	2.78	0.85	938
25	20	3.86	2.82	0.73	857	3.70	2.70	0.73	908	3.59	2.62	0.73	928	3.47	2.53	0.73	969
25	22	4.02	2.45	0.61	887	3.87	2.36	0.61	944	3.78	2.31	0.61	969	3.62	2.21	0.61	1010
25	24	4.22	2.07	0.49	928	4.06	1.99	0.49	979	3.97	1.94	0.49	1010	3.84	1.88	0.49	1061
26	18	3.70	3.29	0.89	816	3.54	3.15	0.89	857	3.40	3.03	0.89	898	3.28	2.92	0.89	938
26	20	3.86	2.97	0.77	857	3.70	2.85	0.77	908	3.59	2.77	0.77	928	3.47	2.67	0.77	969
26	22	4.02	2.61	0.65	887	3.87	2.52	0.65	944	3.78	2.46	0.65	969	3.62	2.35	0.65	1010
26	24	4.22	2.24	0.53	928	4.06	2.15	0.53	979	3.97	2.10	0.53	1010	3.84	2.04	0.53	1061
26	26	4.35	1.78	0.41	979	4.22	1.73	0.41	1030	4.16	1.70	0.41	1061	4.03	1.65	0.41	1091
27	18	3.70	3.44	0.93	816	3.54	3.30	0.93	857	3.40	3.16	0.93	898	3.28	3.05	0.93	938
27	20	3.86	3.13	0.81	857	3.70	3.00	0.81	908	3.59	2.91	0.81	928	3.47	2.81	0.81	969
27	22	4.02	2.77	0.69	887	3.87	2.67	0.69	944	3.78	2.61	0.69	969	3.62	2.50	0.69	1010
27	24	4.22	2.41	0.57	928	4.06	2.32	0.57	979	3.97	2.26	0.57	1010	3.84	2.19	0.57	1061
27	26	4.35	1.96	0.45	979	4.22	1.90	0.45	1030	4.16	1.87	0.45	1061	4.03	1.81	0.45	1091
28	18	3.70	3.59	0.97	816	3.54	3.44	0.97	857	3.40	3.30	0.97	898	3.28	3.18	0.97	938
28	20	3.86	3.28	0.85	857	3.70	3.15	0.85	908	3.59	3.05	0.85	928	3.47	2.95	0.85	969
28	22	4.02	2.93	0.73	887	3.87	2.83	0.73	944	3.78	2.76	0.73	969	3.62	2.64	0.73	1010
28	24	4.22	2.57	0.61	928	4.06	2.48	0.61	979	3.97	2.42	0.61	1010	3.84	2.34	0.61	1061
28	26	4.35	2.13	0.49	979	4.22	2.07	0.49	1030	4.16	2.04	0.49	1061	4.03	1.98	0.49	1091
29	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
29	20	3.86	3.43	0.89	857	3.70	3.29	0.89	908	3.59	3.20	0.89	928	3.47	3.08	0.89	969
29	22	4.02	3.09	0.77	887	3.87	2.98	0.77	944	3.78	2.91	0.77	969	3.62	2.79	0.77	1010
29	24	4.22	2.74	0.65	928	4.06	2.64	0.65	979	3.97	2.58	0.65	1010	3.84	2.50	0.65	1061
29	26	4.35	2.30	0.53	979	4.22	2.24	0.53	1030	4.16	2.20	0.53	1061	4.03	2.14	0.53	1091
30	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
30	20	3.86	3.59	0.93	857	3.70	3.44	0.93	908	3.59	3.34	0.93	928	3.47	3.22	0.93	969
30	22	4.02	3.25	0.81	887	3.87	3.14	0.81	944	3.78	3.06	0.81	969	3.62	2.93	0.81	1010
30	24	4.22	2.91	0.69	928	4.06	2.80	0.69	979	3.97	2.74	0.69	1010	3.84	2.65	0.69	1061
30	26	4.35	2.48	0.57	979	4.22	2.41	0.57	1030	4.16	2.37	0.57	1061	4.03	2.30	0.57	1091
31	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
31	20	3.86	3.74	0.97	857	3.70	3.59	0.97	908	3.59	3.48	0.97	928	3.47	3.36	0.97	969
31	22	4.02	3.41	0.85	887	3.87	3.29	0.85	944	3.78	3.21	0.85	969	3.62	3.08	0.85	1010
31	24	4.22	3.08	0.73	928	4.06	2.97	0.73	979	3.97	2.90	0.73	1010	3.84	2.81	0.73	1061
31	26	4.35	2.65	0.61	979	4.22	2.57	0.61	1030	4.16	2.54	0.61	1061	4.03	2.46	0.61	1091
32	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
32	20	3.86	3.86	1.00	857	3.70	3.70	1.00	908	3.59	3.59	1.00	928	3.47	3.47	1.00	969
32	22	4.02	3.57	0.89	887	3.87	3.45	0.89	944	3.78	3.36	0.89	969	3.62	3.22	0.89	1010
32	24	4.22	3.25	0.77	928	4.06	3.13	0.77	979	3.97	3.06	0.77	1010	3.84	2.96	0.77	1061
32	26	4.35	2.83	0.65	979	4.22	2.74	0.65	1030	4.16	2.70	0.65	1061	4.03	2.62	0.65	1091

WALL-MOUNTED PERFORMANCE DATA

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-WN35VA: MUZ-WN35VA

CAPACITY: 3.15 kW SHF: 0.87 INPUT: 1020 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.09	2.13	0.69	1000	2.84	1.96	0.69	1061	2.61	1.80	0.69	1102
21	20	3.24	1.85	0.57	1040	3.02	1.72	0.57	1091	2.80	1.60	0.57	1153
22	18	3.09	2.25	0.73	1000	2.84	2.07	0.73	1061	2.61	1.91	0.73	1102
22	20	3.24	1.98	0.61	1040	3.02	1.84	0.61	1091	2.80	1.71	0.61	1153
22	22	3.43	1.68	0.49	1081	3.21	1.57	0.49	1142	2.99	1.47	0.49	1183
23	18	3.09	2.38	0.77	1000	2.84	2.18	0.77	1061	2.61	2.01	0.77	1102
23	20	3.24	2.11	0.65	1040	3.02	1.97	0.65	1091	2.80	1.82	0.65	1153
23	22	3.43	1.82	0.53	1081	3.21	1.70	0.53	1142	2.99	1.59	0.53	1183
24	18	3.09	2.50	0.81	1000	2.84	2.30	0.81	1061	2.61	2.12	0.81	1102
24	20	3.24	2.24	0.69	1040	3.02	2.09	0.69	1091	2.80	1.93	0.69	1153
24	22	3.43	1.96	0.57	1081	3.21	1.83	0.57	1142	2.99	1.71	0.57	1183
24	24	3.62	1.63	0.45	1122	3.40	1.53	0.45	1173	3.21	1.45	0.45	1224
25	18	3.09	2.62	0.85	1000	2.84	2.41	0.85	1061	2.61	2.22	0.85	1102
25	20	3.24	2.37	0.73	1040	3.02	2.21	0.73	1091	2.80	2.05	0.73	1153
25	22	3.43	2.09	0.61	1081	3.21	1.96	0.61	1142	2.99	1.83	0.61	1183
25	24	3.62	1.78	0.49	1122	3.40	1.67	0.49	1173	3.21	1.57	0.49	1224
26	18	3.09	2.75	0.89	1000	2.84	2.52	0.89	1061	2.61	2.33	0.89	1102
26	20	3.24	2.50	0.77	1040	3.02	2.33	0.77	1091	2.80	2.16	0.77	1153
26	22	3.43	2.23	0.65	1081	3.21	2.09	0.65	1142	2.99	1.95	0.65	1183
26	24	3.62	1.92	0.53	1122	3.40	1.80	0.53	1173	3.21	1.70	0.53	1224
26	26	3.81	1.56	0.41	1163	3.59	1.47	0.41	1214	3.37	1.38	0.41	1265
27	18	3.09	2.87	0.93	1000	2.84	2.64	0.93	1061	2.61	2.43	0.93	1102
27	20	3.24	2.63	0.81	1040	3.02	2.45	0.81	1091	2.80	2.27	0.81	1153
27	22	3.43	2.37	0.69	1081	3.21	2.22	0.69	1142	2.99	2.06	0.69	1183
27	24	3.62	2.06	0.57	1122	3.40	1.94	0.57	1173	3.21	1.83	0.57	1224
27	26	3.81	1.72	0.45	1163	3.59	1.62	0.45	1214	3.37	1.52	0.45	1265
28	18	3.09	2.99	0.97	1000	2.84	2.75	0.97	1061	2.61	2.54	0.97	1102
28	20	3.24	2.76	0.85	1040	3.02	2.57	0.85	1091	2.80	2.38	0.85	1153
28	22	3.43	2.51	0.73	1081	3.21	2.35	0.73	1142	2.99	2.18	0.73	1183
28	24	3.62	2.21	0.61	1122	3.40	2.08	0.61	1173	3.21	1.96	0.61	1224
28	26	3.81	1.87	0.49	1163	3.59	1.76	0.49	1214	3.37	1.65	0.49	1265
29	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
29	20	3.24	2.89	0.89	1040	3.02	2.69	0.89	1091	2.80	2.50	0.89	1153
29	22	3.43	2.64	0.77	1081	3.21	2.47	0.77	1142	2.99	2.30	0.77	1183
29	24	3.62	2.35	0.65	1122	3.40	2.21	0.65	1173	3.21	2.09	0.65	1224
29	26	3.81	2.02	0.53	1163	3.59	1.90	0.53	1214	3.37	1.79	0.53	1265
30	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
30	20	3.24	3.02	0.93	1040	3.02	2.81	0.93	1091	2.80	2.61	0.93	1153
30	22	3.43	2.78	0.81	1081	3.21	2.60	0.81	1142	2.99	2.42	0.81	1183
30	24	3.62	2.50	0.69	1122	3.40	2.35	0.69	1173	3.21	2.22	0.69	1224
30	26	3.81	2.17	0.57	1163	3.59	2.05	0.57	1214	3.37	1.92	0.57	1265
31	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
31	20	3.24	3.15	0.97	1040	3.02	2.93	0.97	1091	2.80	2.72	0.97	1153
31	22	3.43	2.92	0.85	1081	3.21	2.73	0.85	1142	2.99	2.54	0.85	1183
31	24	3.62	2.64	0.73	1122	3.40	2.48	0.73	1173	3.21	2.35	0.73	1224
31	26	3.81	2.33	0.61	1163	3.59	2.19	0.61	1214	3.37	2.06	0.61	1265
32	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
32	20	3.24	3.24	1.00	1040	3.02	3.02	1.00	1091	2.80	2.80	1.00	1153
32	22	3.43	3.06	0.89	1081	3.21	2.86	0.89	1142	2.99	2.66	0.89	1183
32	24	3.62	2.79	0.77	1122	3.40	2.62	0.77	1173	3.21	2.47	0.77	1224
32	26	3.81	2.48	0.65	1163	3.59	2.33	0.65	1214	3.37	2.19	0.65	1265

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-DM25VA: MUZ-DM25VA

CAPACITY: 2.5 kW SHF: 0.89 INPUT: 710 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.09	0.71	568	2.81	2.00	0.71	596	2.70	1.92	0.71	625	2.60	1.85	0.71	653
21	20	3.06	1.81	0.59	596	2.94	1.73	0.59	632	2.85	1.68	0.59	646	2.75	1.62	0.59	675
22	18	2.94	2.20	0.75	568	2.81	2.11	0.75	596	2.70	2.03	0.75	625	2.60	1.95	0.75	653
22	20	3.06	1.93	0.63	596	2.94	1.85	0.63	632	2.85	1.80	0.63	646	2.75	1.73	0.63	675
22	22	3.19	1.63	0.51	618	3.08	1.57	0.51	657	3.00	1.53	0.51	675	2.88	1.47	0.51	703
23	18	2.94	2.32	0.79	568	2.81	2.22	0.79	596	2.70	2.13	0.79	625	2.60	2.05	0.79	653
23	20	3.06	2.05	0.67	596	2.94	1.97	0.67	632	2.85	1.91	0.67	646	2.75	1.84	0.67	675
23	22	3.19	1.75	0.55	618	3.08	1.69	0.55	657	3.00	1.65	0.55	675	2.88	1.58	0.55	703
24	18	2.94	2.44	0.83	568	2.81	2.33	0.83	596	2.70	2.24	0.83	625	2.60	2.16	0.83	653
24	20	3.06	2.17	0.71	596	2.94	2.09	0.71	632	2.85	2.02	0.71	646	2.75	1.95	0.71	675
24	22	3.19	1.88	0.59	618	3.08	1.81	0.59	657	3.00	1.77	0.59	675	2.88	1.70	0.59	703
24	24	3.35	1.57	0.47	646	3.23	1.52	0.47	682	3.15	1.48	0.47	703	3.05	1.43	0.47	738
25	18	2.94	2.56	0.87	568	2.81	2.45	0.87	596	2.70	2.35	0.87	625	2.60	2.26	0.87	653
25	20	3.06	2.30	0.75	596	2.94	2.20	0.75	632	2.85	2.14	0.75	646	2.75	2.06	0.75	675
25	22	3.19	2.01	0.63	618	3.08	1.94	0.63	657	3.00	1.89	0.63	675	2.88	1.81	0.63	703
25	24	3.35	1.71	0.51	646	3.23	1.64	0.51	682	3.15	1.61	0.51	703	3.05	1.56	0.51	738
26	18	2.94	2.67	0.91	568	2.81	2.56	0.91	596	2.70	2.46	0.91	625	2.60	2.37	0.91	653
26	20	3.06	2.42	0.79	596	2.94	2.32	0.79	632	2.85	2.25	0.79	646	2.75	2.17	0.79	675
26	22	3.19	2.14	0.67	618	3.08	2.06	0.67	657	3.00	2.01	0.67	675	2.88	1.93	0.67	703
26	24	3.35	1.84	0.55	646	3.23	1.77	0.55	682	3.15	1.73	0.55	703	3.05	1.68	0.55	738
26	26	3.45	1.48	0.43	682	3.35	1.44	0.43	717	3.30	1.42	0.43	738	3.20	1.38	0.43	760
27	18	2.94	2.79	0.95	568	2.81	2.67	0.95	596	2.70	2.57	0.95	625	2.60	2.47	0.95	653
27	20	3.06	2.54	0.83	596	2.94	2.44	0.83	632	2.85	2.37	0.83	646	2.75	2.28	0.83	675
27	22	3.19	2.26	0.71	618	3.08	2.18	0.71	657	3.00	2.13	0.71	675	2.88	2.04	0.71	703
27	24	3.35	1.98	0.59	646	3.23	1.90	0.59	682	3.15	1.86	0.59	703	3.05	1.80	0.59	738
27	26	3.45	1.62	0.47	682	3.35	1.57	0.47	717	3.30	1.55	0.47	738	3.20	1.50	0.47	760
28	18	2.94	2.91	0.99	568	2.81	2.78	0.99	596	2.70	2.67	0.99	625	2.60	2.57	0.99	653
28	20	3.06	2.66	0.87	596	2.94	2.56	0.87	632	2.85	2.48	0.87	646	2.75	2.39	0.87	675
28	22	3.19	2.39	0.75	618	3.08	2.31	0.75	657	3.00	2.25	0.75	675	2.88	2.16	0.75	703
28	24	3.35	2.11	0.63	646	3.23	2.03	0.63	682	3.15	1.98	0.63	703	3.05	1.92	0.63	738
28	26	3.45	1.76	0.51	682	3.35	1.71	0.51	717	3.30	1.68	0.51	738	3.20	1.63	0.51	760
29	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
29	20	3.06	2.79	0.91	596	2.94	2.67	0.91	632	2.85	2.59	0.91	646	2.75	2.50	0.91	675
29	22	3.19	2.52	0.79	618	3.08	2.43	0.79	657	3.00	2.37	0.79	675	2.88	2.27	0.79	703
29	24	3.35	2.24	0.67	646	3.23	2.16	0.67	682	3.15	2.11	0.67	703	3.05	2.04	0.67	738
29	26	3.45	1.90	0.55	682	3.35	1.84	0.55	717	3.30	1.82	0.55	738	3.20	1.76	0.55	760
30	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
30	20	3.06	2.91	0.95	596	2.94	2.79	0.95	632	2.85	2.71	0.95	646	2.75	2.61	0.95	675
30	22	3.19	2.65	0.83	618	3.08	2.55	0.83	657	3.00	2.49	0.83	675	2.88	2.39	0.83	703
30	24	3.35	2.38	0.71	646	3.23	2.29	0.71	682	3.15	2.24	0.71	703	3.05	2.17	0.71	738
30	26	3.45	2.04	0.59	682	3.35	1.98	0.59	717	3.30	1.95	0.59	738	3.20	1.89	0.59	760
31	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
31	20	3.06	3.03	0.99	596	2.94	2.91	0.99	632	2.85	2.82	0.99	646	2.75	2.72	0.99	675
31	22	3.19	2.77	0.87	618	3.08	2.68	0.87	657	3.00	2.61	0.87	675	2.88	2.50	0.87	703
31	24	3.35	2.51	0.75	646	3.23	2.42	0.75	682	3.15	2.36	0.75	703	3.05	2.29	0.75	738
31	26	3.45	2.17	0.63	682	3.35	2.11	0.63	717	3.30	2.08	0.63	738	3.20	2.02	0.63	760
32	18	2.94	2.94	1.00	568	2.81	2.81	1.00	596	2.70	2.70	1.00	625	2.60	2.60	1.00	653
32	20	3.06	3.06	1.00	596	2.94	2.94	1.00	632	2.85	2.85	1.00	646	2.75	2.75	1.00	675
32	22	3.19	2.90	0.91	618	3.08	2.80	0.91	657	3.00	2.73	0.91	675	2.88	2.62	0.91	703
32	24	3.35	2.65	0.79	646	3.23	2.55	0.79	682	3.15	2.49	0.79	703	3.05	2.41	0.79	738
32	26	3.45	2.31	0.67	682	3.35	2.24	0.67	717	3.30	2.21	0.67	738	3.20	2.14	0.67	760

WALL-MOUNTED PERFORMANCE DATA

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-DM25VA: MUZ-DM25VA

CAPACITY: 2.5 kW

SHF: 0.89

INPUT: 710 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.74	0.71	696	2.25	1.60	0.71	738	2.08	1.47	0.71	767
21	20	2.58	1.52	0.59	724	2.40	1.42	0.59	760	2.23	1.31	0.59	802
22	18	2.45	1.84	0.75	696	2.25	1.69	0.75	738	2.08	1.56	0.75	767
22	20	2.58	1.62	0.63	724	2.40	1.51	0.63	760	2.23	1.40	0.63	802
22	22	2.73	1.39	0.51	753	2.55	1.30	0.51	795	2.38	1.21	0.51	824
23	18	2.45	1.94	0.79	696	2.25	1.78	0.79	738	2.08	1.64	0.79	767
23	20	2.58	1.73	0.67	724	2.40	1.61	0.67	760	2.23	1.49	0.67	802
23	22	2.73	1.50	0.55	753	2.55	1.40	0.55	795	2.38	1.31	0.55	824
24	18	2.45	2.03	0.83	696	2.25	1.87	0.83	738	2.08	1.72	0.83	767
24	20	2.58	1.83	0.71	724	2.40	1.70	0.71	760	2.23	1.58	0.71	802
24	22	2.73	1.61	0.59	753	2.55	1.50	0.59	795	2.38	1.40	0.59	824
24	24	2.88	1.35	0.47	781	2.70	1.27	0.47	817	2.55	1.20	0.47	852
25	18	2.45	2.13	0.87	696	2.25	1.96	0.87	738	2.08	1.81	0.87	767
25	20	2.58	1.93	0.75	724	2.40	1.80	0.75	760	2.23	1.67	0.75	802
25	22	2.73	1.72	0.63	753	2.55	1.61	0.63	795	2.38	1.50	0.63	824
25	24	2.88	1.47	0.51	781	2.70	1.38	0.51	817	2.55	1.30	0.51	852
26	18	2.45	2.23	0.91	696	2.25	2.05	0.91	738	2.08	1.89	0.91	767
26	20	2.58	2.03	0.79	724	2.40	1.90	0.79	760	2.23	1.76	0.79	802
26	22	2.73	1.83	0.67	753	2.55	1.71	0.67	795	2.38	1.59	0.67	824
26	24	2.88	1.58	0.55	781	2.70	1.49	0.55	817	2.55	1.40	0.55	852
26	26	3.03	1.30	0.43	809	2.85	1.23	0.43	845	2.68	1.15	0.43	880
27	18	2.45	2.33	0.95	696	2.25	2.14	0.95	738	2.08	1.97	0.95	767
27	20	2.58	2.14	0.83	724	2.40	1.99	0.83	760	2.23	1.85	0.83	802
27	22	2.73	1.93	0.71	753	2.55	1.81	0.71	795	2.38	1.69	0.71	824
27	24	2.88	1.70	0.59	781	2.70	1.59	0.59	817	2.55	1.50	0.59	852
27	26	3.03	1.42	0.47	809	2.85	1.34	0.47	845	2.68	1.26	0.47	880
28	18	2.45	2.43	0.99	696	2.25	2.23	0.99	738	2.08	2.05	0.99	767
28	20	2.58	2.24	0.87	724	2.40	2.09	0.87	760	2.23	1.94	0.87	802
28	22	2.73	2.04	0.75	753	2.55	1.91	0.75	795	2.38	1.78	0.75	824
28	24	2.88	1.81	0.63	781	2.70	1.70	0.63	817	2.55	1.61	0.63	852
28	26	3.03	1.54	0.51	809	2.85	1.45	0.51	845	2.68	1.36	0.51	880
29	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
29	20	2.58	2.34	0.91	724	2.40	2.18	0.91	760	2.23	2.02	0.91	802
29	22	2.73	2.15	0.79	753	2.55	2.01	0.79	795	2.38	1.88	0.79	824
29	24	2.88	1.93	0.67	781	2.70	1.81	0.67	817	2.55	1.71	0.67	852
29	26	3.03	1.66	0.55	809	2.85	1.57	0.55	845	2.68	1.47	0.55	880
30	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
30	20	2.58	2.45	0.95	724	2.40	2.28	0.95	760	2.23	2.11	0.95	802
30	22	2.73	2.26	0.83	753	2.55	2.12	0.83	795	2.38	1.97	0.83	824
30	24	2.88	2.04	0.71	781	2.70	1.92	0.71	817	2.55	1.81	0.71	852
30	26	3.03	1.78	0.59	809	2.85	1.68	0.59	845	2.68	1.58	0.59	880
31	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
31	20	2.58	2.55	0.99	724	2.40	2.38	0.99	760	2.23	2.20	0.99	802
31	22	2.73	2.37	0.87	753	2.55	2.22	0.87	795	2.38	2.07	0.87	824
31	24	2.88	2.16	0.75	781	2.70	2.03	0.75	817	2.55	1.91	0.75	852
31	26	3.03	1.91	0.63	809	2.85	1.80	0.63	845	2.68	1.69	0.63	880
32	18	2.45	2.45	1.00	696	2.25	2.25	1.00	738	2.08	2.08	1.00	767
32	20	2.58	2.58	1.00	724	2.40	2.40	1.00	760	2.23	2.23	1.00	802
32	22	2.73	2.48	0.91	753	2.55	2.32	0.91	795	2.38	2.16	0.91	824
32	24	2.88	2.27	0.79	781	2.70	2.13	0.79	817	2.55	2.01	0.79	852
32	26	3.03	2.03	0.67	809	2.85	1.91	0.67	845	2.68	1.79	0.67	880

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-DM35VA: MUZ-DM35VA

CAPACITY: 3.15 kW SHF: 0.87 INPUT: 1020 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.70	2.55	0.69	816	3.54	2.45	0.69	857	3.40	2.35	0.69	898	3.28	2.26	0.69	938
21	20	3.86	2.20	0.57	857	3.70	2.11	0.57	908	3.59	2.05	0.57	928	3.47	1.98	0.57	969
22	18	3.70	2.70	0.73	816	3.54	2.59	0.73	857	3.40	2.48	0.73	898	3.28	2.39	0.73	938
22	20	3.86	2.35	0.61	857	3.70	2.26	0.61	908	3.59	2.19	0.61	928	3.47	2.11	0.61	969
22	22	4.02	1.97	0.49	887	3.87	1.90	0.49	944	3.78	1.85	0.49	969	3.62	1.78	0.49	1010
23	18	3.70	2.85	0.77	816	3.54	2.73	0.77	857	3.40	2.62	0.77	898	3.28	2.52	0.77	938
23	20	3.86	2.51	0.65	857	3.70	2.41	0.65	908	3.59	2.33	0.65	928	3.47	2.25	0.65	969
23	22	4.02	2.13	0.53	887	3.87	2.05	0.53	944	3.78	2.00	0.53	969	3.62	1.92	0.53	1010
24	18	3.70	3.00	0.81	816	3.54	2.87	0.81	857	3.40	2.76	0.81	898	3.28	2.65	0.81	938
24	20	3.86	2.66	0.69	857	3.70	2.55	0.69	908	3.59	2.48	0.69	928	3.47	2.39	0.69	969
24	22	4.02	2.29	0.57	887	3.87	2.21	0.57	944	3.78	2.15	0.57	969	3.62	2.06	0.57	1010
24	24	4.22	1.90	0.45	928	4.06	1.83	0.45	979	3.97	1.79	0.45	1010	3.84	1.73	0.45	1061
25	18	3.70	3.15	0.85	816	3.54	3.01	0.85	857	3.40	2.89	0.85	898	3.28	2.78	0.85	938
25	20	3.86	2.82	0.73	857	3.70	2.70	0.73	908	3.59	2.62	0.73	928	3.47	2.53	0.73	969
25	22	4.02	2.45	0.61	887	3.87	2.36	0.61	944	3.78	2.31	0.61	969	3.62	2.21	0.61	1010
25	24	4.22	2.07	0.49	928	4.06	1.99	0.49	979	3.97	1.94	0.49	1010	3.84	1.88	0.49	1061
26	18	3.70	3.29	0.89	816	3.54	3.15	0.89	857	3.40	3.03	0.89	898	3.28	2.92	0.89	938
26	20	3.86	2.97	0.77	857	3.70	2.85	0.77	908	3.59	2.77	0.77	928	3.47	2.67	0.77	969
26	22	4.02	2.61	0.65	887	3.87	2.52	0.65	944	3.78	2.46	0.65	969	3.62	2.35	0.65	1010
26	24	4.22	2.24	0.53	928	4.06	2.15	0.53	979	3.97	2.10	0.53	1010	3.84	2.04	0.53	1061
26	26	4.35	1.78	0.41	979	4.22	1.73	0.41	1030	4.16	1.70	0.41	1061	4.03	1.65	0.41	1091
27	18	3.70	3.44	0.93	816	3.54	3.30	0.93	857	3.40	3.16	0.93	898	3.28	3.05	0.93	938
27	20	3.86	3.13	0.81	857	3.70	3.00	0.81	908	3.59	2.91	0.81	928	3.47	2.81	0.81	969
27	22	4.02	2.77	0.69	887	3.87	2.67	0.69	944	3.78	2.61	0.69	969	3.62	2.50	0.69	1010
27	24	4.22	2.41	0.57	928	4.06	2.32	0.57	979	3.97	2.26	0.57	1010	3.84	2.19	0.57	1061
27	26	4.35	1.96	0.45	979	4.22	1.90	0.45	1030	4.16	1.87	0.45	1061	4.03	1.81	0.45	1091
28	18	3.70	3.59	0.97	816	3.54	3.44	0.97	857	3.40	3.30	0.97	898	3.28	3.18	0.97	938
28	20	3.86	3.28	0.85	857	3.70	3.15	0.85	908	3.59	3.05	0.85	928	3.47	2.95	0.85	969
28	22	4.02	2.93	0.73	887	3.87	2.83	0.73	944	3.78	2.76	0.73	969	3.62	2.64	0.73	1010
28	24	4.22	2.57	0.61	928	4.06	2.48	0.61	979	3.97	2.42	0.61	1010	3.84	2.34	0.61	1061
28	26	4.35	2.13	0.49	979	4.22	2.07	0.49	1030	4.16	2.04	0.49	1061	4.03	1.98	0.49	1091
29	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
29	20	3.86	3.43	0.89	857	3.70	3.29	0.89	908	3.59	3.20	0.89	928	3.47	3.08	0.89	969
29	22	4.02	3.09	0.77	887	3.87	2.98	0.77	944	3.78	2.91	0.77	969	3.62	2.79	0.77	1010
29	24	4.22	2.74	0.65	928	4.06	2.64	0.65	979	3.97	2.58	0.65	1010	3.84	2.50	0.65	1061
29	26	4.35	2.30	0.53	979	4.22	2.24	0.53	1030	4.16	2.20	0.53	1061	4.03	2.14	0.53	1091
30	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
30	20	3.86	3.59	0.93	857	3.70	3.44	0.93	908	3.59	3.34	0.93	928	3.47	3.22	0.93	969
30	22	4.02	3.25	0.81	887	3.87	3.14	0.81	944	3.78	3.06	0.81	969	3.62	2.93	0.81	1010
30	24	4.22	2.91	0.69	928	4.06	2.80	0.69	979	3.97	2.74	0.69	1010	3.84	2.65	0.69	1061
30	26	4.35	2.48	0.57	979	4.22	2.41	0.57	1030	4.16	2.37	0.57	1061	4.03	2.30	0.57	1091
31	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
31	20	3.86	3.74	0.97	857	3.70	3.59	0.97	908	3.59	3.48	0.97	928	3.47	3.36	0.97	969
31	22	4.02	3.41	0.85	887	3.87	3.29	0.85	944	3.78	3.21	0.85	969	3.62	3.08	0.85	1010
31	24	4.22	3.08	0.73	928	4.06	2.97	0.73	979	3.97	2.90	0.73	1010	3.84	2.81	0.73	1061
31	26	4.35	2.65	0.61	979	4.22	2.57	0.61	1030	4.16	2.54	0.61	1061	4.03	2.46	0.61	1091
32	18	3.70	3.70	1.00	816	3.54	3.54	1.00	857	3.40	3.40	1.00	898	3.28	3.28	1.00	938
32	20	3.86	3.86	1.00	857	3.70	3.70	1.00	908	3.59	3.59	1.00	928	3.47	3.47	1.00	969
32	22	4.02	3.57	0.89	887	3.87	3.45	0.89	944	3.78	3.36	0.89	969	3.62	3.22	0.89	1010
32	24	4.22	3.25	0.77	928	4.06	3.13	0.77	979	3.97	3.06	0.77	1010	3.84	2.96	0.77	1061
32	26	4.35	2.83	0.65	979	4.22	2.74	0.65	1030	4.16	2.70	0.65	1061	4.03	2.62	0.65	1091

WALL-MOUNTED PERFORMANCE DATA

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MSZ-DM35VA: MUZ-DM35VA

CAPACITY: 3.15 kW SHF: 0.87 INPUT: 1020 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.09	2.13	0.69	1000	2.84	1.96	0.69	1061	2.61	1.80	0.69	1102
21	20	3.24	1.85	0.57	1040	3.02	1.72	0.57	1091	2.80	1.60	0.57	1153
22	18	3.09	2.25	0.73	1000	2.84	2.07	0.73	1061	2.61	1.91	0.73	1102
22	20	3.24	1.98	0.61	1040	3.02	1.84	0.61	1091	2.80	1.71	0.61	1153
22	22	3.43	1.68	0.49	1081	3.21	1.57	0.49	1142	2.99	1.47	0.49	1183
23	18	3.09	2.38	0.77	1000	2.84	2.18	0.77	1061	2.61	2.01	0.77	1102
23	20	3.24	2.11	0.65	1040	3.02	1.97	0.65	1091	2.80	1.82	0.65	1153
23	22	3.43	1.82	0.53	1081	3.21	1.70	0.53	1142	2.99	1.59	0.53	1183
24	18	3.09	2.50	0.81	1000	2.84	2.30	0.81	1061	2.61	2.12	0.81	1102
24	20	3.24	2.24	0.69	1040	3.02	2.09	0.69	1091	2.80	1.93	0.69	1153
24	22	3.43	1.96	0.57	1081	3.21	1.83	0.57	1142	2.99	1.71	0.57	1183
24	24	3.62	1.63	0.45	1122	3.40	1.53	0.45	1173	3.21	1.45	0.45	1224
25	18	3.09	2.62	0.85	1000	2.84	2.41	0.85	1061	2.61	2.22	0.85	1102
25	20	3.24	2.37	0.73	1040	3.02	2.21	0.73	1091	2.80	2.05	0.73	1153
25	22	3.43	2.09	0.61	1081	3.21	1.96	0.61	1142	2.99	1.83	0.61	1183
25	24	3.62	1.78	0.49	1122	3.40	1.67	0.49	1173	3.21	1.57	0.49	1224
26	18	3.09	2.75	0.89	1000	2.84	2.52	0.89	1061	2.61	2.33	0.89	1102
26	20	3.24	2.50	0.77	1040	3.02	2.33	0.77	1091	2.80	2.16	0.77	1153
26	22	3.43	2.23	0.65	1081	3.21	2.09	0.65	1142	2.99	1.95	0.65	1183
26	24	3.62	1.92	0.53	1122	3.40	1.80	0.53	1173	3.21	1.70	0.53	1224
26	26	3.81	1.56	0.41	1163	3.59	1.47	0.41	1214	3.37	1.38	0.41	1265
27	18	3.09	2.87	0.93	1000	2.84	2.64	0.93	1061	2.61	2.43	0.93	1102
27	20	3.24	2.63	0.81	1040	3.02	2.45	0.81	1091	2.80	2.27	0.81	1153
27	22	3.43	2.37	0.69	1081	3.21	2.22	0.69	1142	2.99	2.06	0.69	1183
27	24	3.62	2.06	0.57	1122	3.40	1.94	0.57	1173	3.21	1.83	0.57	1224
27	26	3.81	1.72	0.45	1163	3.59	1.62	0.45	1214	3.37	1.52	0.45	1265
28	18	3.09	2.99	0.97	1000	2.84	2.75	0.97	1061	2.61	2.54	0.97	1102
28	20	3.24	2.76	0.85	1040	3.02	2.57	0.85	1091	2.80	2.38	0.85	1153
28	22	3.43	2.51	0.73	1081	3.21	2.35	0.73	1142	2.99	2.18	0.73	1183
28	24	3.62	2.21	0.61	1122	3.40	2.08	0.61	1173	3.21	1.96	0.61	1224
28	26	3.81	1.87	0.49	1163	3.59	1.76	0.49	1214	3.37	1.65	0.49	1265
29	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
29	20	3.24	2.89	0.89	1040	3.02	2.69	0.89	1091	2.80	2.50	0.89	1153
29	22	3.43	2.64	0.77	1081	3.21	2.47	0.77	1142	2.99	2.30	0.77	1183
29	24	3.62	2.35	0.65	1122	3.40	2.21	0.65	1173	3.21	2.09	0.65	1224
29	26	3.81	2.02	0.53	1163	3.59	1.90	0.53	1214	3.37	1.79	0.53	1265
30	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
30	20	3.24	3.02	0.93	1040	3.02	2.81	0.93	1091	2.80	2.61	0.93	1153
30	22	3.43	2.78	0.81	1081	3.21	2.60	0.81	1142	2.99	2.42	0.81	1183
30	24	3.62	2.50	0.69	1122	3.40	2.35	0.69	1173	3.21	2.22	0.69	1224
30	26	3.81	2.17	0.57	1163	3.59	2.05	0.57	1214	3.37	1.92	0.57	1265
31	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
31	20	3.24	3.15	0.97	1040	3.02	2.93	0.97	1091	2.80	2.72	0.97	1153
31	22	3.43	2.92	0.85	1081	3.21	2.73	0.85	1142	2.99	2.54	0.85	1183
31	24	3.62	2.64	0.73	1122	3.40	2.48	0.73	1173	3.21	2.35	0.73	1224
31	26	3.81	2.33	0.61	1163	3.59	2.19	0.61	1214	3.37	2.06	0.61	1265
32	18	3.09	3.09	1.00	1000	2.84	2.84	1.00	1061	2.61	2.61	1.00	1102
32	20	3.24	3.24	1.00	1040	3.02	3.02	1.00	1091	2.80	2.80	1.00	1153
32	22	3.43	3.06	0.89	1081	3.21	2.86	0.89	1142	2.99	2.66	0.89	1183
32	24	3.62	2.79	0.77	1122	3.40	2.62	0.77	1173	3.21	2.47	0.77	1224
32	26	3.81	2.48	0.65	1163	3.59	2.33	0.65	1214	3.37	2.19	0.65	1265

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-HJ25VA: MUZ-HJ25VA

CAPACITY: 2.5 kW

SHF: 0.89

INPUT: 730 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	2.09	0.71	584	2.81	2.00	0.71	613	2.70	1.92	0.71	642	2.60	1.85	0.71	672
21	20	3.06	1.81	0.59	613	2.94	1.73	0.59	650	2.85	1.68	0.59	664	2.75	1.62	0.59	694
22	18	2.94	2.20	0.75	584	2.81	2.11	0.75	613	2.70	2.03	0.75	642	2.60	1.95	0.75	672
22	20	3.06	1.93	0.63	613	2.94	1.85	0.63	650	2.85	1.80	0.63	664	2.75	1.73	0.63	694
22	22	3.19	1.63	0.51	635	3.08	1.57	0.51	675	3.00	1.53	0.51	694	2.88	1.47	0.51	723
23	18	2.94	2.32	0.79	584	2.81	2.22	0.79	613	2.70	2.13	0.79	642	2.60	2.05	0.79	672
23	20	3.06	2.05	0.67	613	2.94	1.97	0.67	650	2.85	1.91	0.67	664	2.75	1.84	0.67	694
23	22	3.19	1.75	0.55	635	3.08	1.69	0.55	675	3.00	1.65	0.55	694	2.88	1.58	0.55	723
24	18	2.94	2.44	0.83	584	2.81	2.33	0.83	613	2.70	2.24	0.83	642	2.60	2.16	0.83	672
24	20	3.06	2.17	0.71	613	2.94	2.09	0.71	650	2.85	2.02	0.71	664	2.75	1.95	0.71	694
24	22	3.19	1.88	0.59	635	3.08	1.81	0.59	675	3.00	1.77	0.59	694	2.88	1.70	0.59	723
24	24	3.35	1.57	0.47	664	3.23	1.52	0.47	701	3.15	1.48	0.47	723	3.05	1.43	0.47	759
25	18	2.94	2.56	0.87	584	2.81	2.45	0.87	613	2.70	2.35	0.87	642	2.60	2.26	0.87	672
25	20	3.06	2.30	0.75	613	2.94	2.20	0.75	650	2.85	2.14	0.75	664	2.75	2.06	0.75	694
25	22	3.19	2.01	0.63	635	3.08	1.94	0.63	675	3.00	1.89	0.63	694	2.88	1.81	0.63	723
25	24	3.35	1.71	0.51	664	3.23	1.64	0.51	701	3.15	1.61	0.51	723	3.05	1.56	0.51	759
26	18	2.94	2.67	0.91	584	2.81	2.56	0.91	613	2.70	2.46	0.91	642	2.60	2.37	0.91	672
26	20	3.06	2.42	0.79	613	2.94	2.32	0.79	650	2.85	2.25	0.79	664	2.75	2.17	0.79	694
26	22	3.19	2.14	0.67	635	3.08	2.06	0.67	675	3.00	2.01	0.67	694	2.88	1.93	0.67	723
26	24	3.35	1.84	0.55	664	3.23	1.77	0.55	701	3.15	1.73	0.55	723	3.05	1.68	0.55	759
26	26	3.45	1.48	0.43	701	3.35	1.44	0.43	737	3.30	1.42	0.43	759	3.20	1.38	0.43	781
27	18	2.94	2.79	0.95	584	2.81	2.67	0.95	613	2.70	2.57	0.95	642	2.60	2.47	0.95	672
27	20	3.06	2.54	0.83	613	2.94	2.44	0.83	650	2.85	2.37	0.83	664	2.75	2.28	0.83	694
27	22	3.19	2.26	0.71	635	3.08	2.18	0.71	675	3.00	2.13	0.71	694	2.88	2.04	0.71	723
27	24	3.35	1.98	0.59	664	3.23	1.90	0.59	701	3.15	1.86	0.59	723	3.05	1.80	0.59	759
27	26	3.45	1.62	0.47	701	3.35	1.57	0.47	737	3.30	1.55	0.47	759	3.20	1.50	0.47	781
28	18	2.94	2.91	0.99	584	2.81	2.78	0.99	613	2.70	2.67	0.99	642	2.60	2.57	0.99	672
28	20	3.06	2.66	0.87	613	2.94	2.56	0.87	650	2.85	2.48	0.87	664	2.75	2.39	0.87	694
28	22	3.19	2.39	0.75	635	3.08	2.31	0.75	675	3.00	2.25	0.75	694	2.88	2.16	0.75	723
28	24	3.35	2.11	0.63	664	3.23	2.03	0.63	701	3.15	1.98	0.63	723	3.05	1.92	0.63	759
28	26	3.45	1.76	0.51	701	3.35	1.71	0.51	737	3.30	1.68	0.51	759	3.20	1.63	0.51	781
29	18	2.94	2.94	1.00	584	2.81	2.81	1.00	613	2.70	2.70	1.00	642	2.60	2.60	1.00	672
29	20	3.06	2.79	0.91	613	2.94	2.67	0.91	650	2.85	2.59	0.91	664	2.75	2.50	0.91	694
29	22	3.19	2.52	0.79	635	3.08	2.43	0.79	675	3.00	2.37	0.79	694	2.88	2.27	0.79	723
29	24	3.35	2.24	0.67	664	3.23	2.16	0.67	701	3.15	2.11	0.67	723	3.05	2.04	0.67	759
29	26	3.45	1.90	0.55	701	3.35	1.84	0.55	737	3.30	1.82	0.55	759	3.20	1.76	0.55	781
30	18	2.94	2.94	1.00	584	2.81	2.81	1.00	613	2.70	2.70	1.00	642	2.60	2.60	1.00	672
30	20	3.06	2.91	0.95	613	2.94	2.79	0.95	650	2.85	2.71	0.95	664	2.75	2.61	0.95	694
30	22	3.19	2.65	0.83	635	3.08	2.55	0.83	675	3.00	2.49	0.83	694	2.88	2.39	0.83	723
30	24	3.35	2.38	0.71	664	3.23	2.29	0.71	701	3.15	2.24	0.71	723	3.05	2.17	0.71	759
30	26	3.45	2.04	0.59	701	3.35	1.98	0.59	737	3.30	1.95	0.59	759	3.20	1.89	0.59	781
31	18	2.94	2.94	1.00	584	2.81	2.81	1.00	613	2.70	2.70	1.00	642	2.60	2.60	1.00	672
31	20	3.06	3.03	0.99	613	2.94	2.91	0.99	650	2.85	2.82	0.99	664	2.75	2.72	0.99	694
31	22	3.19	2.77	0.87	635	3.08	2.68	0.87	675	3.00	2.61	0.87	694	2.88	2.50	0.87	723
31	24	3.35	2.51	0.75	664	3.23	2.42	0.75	701	3.15	2.36	0.75	723	3.05	2.29	0.75	759
31	26	3.45	2.17	0.63	701	3.35	2.11	0.63	737	3.30	2.08	0.63	759	3.20	2.02	0.63	781
32	18	2.94	2.94	1.00	584	2.81	2.81	1.00	613	2.70	2.70	1.00	642	2.60	2.60	1.00	672
32	20	3.06	3.06	1.00	613	2.94	2.94	1.00	650	2.85	2.85	1.00	664	2.75	2.75	1.00	694
32	22	3.19	2.90	0.91	635	3.08	2.80	0.91	675	3.00	2.73	0.91	694	2.88	2.62	0.91	723
32	24	3.35	2.65	0.79	664	3.23	2.55	0.79	701	3.15	2.49	0.79	723	3.05	2.41	0.79	759
32	26	3.45	2.31	0.67	701	3.35	2.24	0.67	737	3.30	2.21	0.67	759	3.20	2.14	0.67	781

WALL-MOUNTED PERFORMANCE DATA

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-HJ25VA: MUZ-HJ25VA

CAPACITY: 2.5 kW

SHF: 0.89

INPUT: 730 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.74	0.71	715	2.25	1.60	0.71	759	2.08	1.47	0.71	788
21	20	2.58	1.52	0.59	745	2.40	1.42	0.59	781	2.23	1.31	0.59	825
22	18	2.45	1.84	0.75	715	2.25	1.69	0.75	759	2.08	1.56	0.75	788
22	20	2.58	1.62	0.63	745	2.40	1.51	0.63	781	2.23	1.40	0.63	825
22	22	2.73	1.39	0.51	774	2.55	1.30	0.51	818	2.38	1.21	0.51	847
23	18	2.45	1.94	0.79	715	2.25	1.78	0.79	759	2.08	1.64	0.79	788
23	20	2.58	1.73	0.67	745	2.40	1.61	0.67	781	2.23	1.49	0.67	825
23	22	2.73	1.50	0.55	774	2.55	1.40	0.55	818	2.38	1.31	0.55	847
24	18	2.45	2.03	0.83	715	2.25	1.87	0.83	759	2.08	1.72	0.83	788
24	20	2.58	1.83	0.71	745	2.40	1.70	0.71	781	2.23	1.58	0.71	825
24	22	2.73	1.61	0.59	774	2.55	1.50	0.59	818	2.38	1.40	0.59	847
24	24	2.88	1.35	0.47	803	2.70	1.27	0.47	839	2.55	1.20	0.47	876
25	18	2.45	2.13	0.87	715	2.25	1.96	0.87	759	2.08	1.81	0.87	788
25	20	2.58	1.93	0.75	745	2.40	1.80	0.75	781	2.23	1.67	0.75	825
25	22	2.73	1.72	0.63	774	2.55	1.61	0.63	818	2.38	1.50	0.63	847
25	24	2.88	1.47	0.51	803	2.70	1.38	0.51	839	2.55	1.30	0.51	876
26	18	2.45	2.23	0.91	715	2.25	2.05	0.91	759	2.08	1.89	0.91	788
26	20	2.58	2.03	0.79	745	2.40	1.90	0.79	781	2.23	1.76	0.79	825
26	22	2.73	1.83	0.67	774	2.55	1.71	0.67	818	2.38	1.59	0.67	847
26	24	2.88	1.58	0.55	803	2.70	1.49	0.55	839	2.55	1.40	0.55	876
26	26	3.03	1.30	0.43	832	2.85	1.23	0.43	869	2.68	1.15	0.43	905
27	18	2.45	2.33	0.95	715	2.25	2.14	0.95	759	2.08	1.97	0.95	788
27	20	2.58	2.14	0.83	745	2.40	1.99	0.83	781	2.23	1.85	0.83	825
27	22	2.73	1.93	0.71	774	2.55	1.81	0.71	818	2.38	1.69	0.71	847
27	24	2.88	1.70	0.59	803	2.70	1.59	0.59	839	2.55	1.50	0.59	876
27	26	3.03	1.42	0.47	832	2.85	1.34	0.47	869	2.68	1.26	0.47	905
28	18	2.45	2.43	0.99	715	2.25	2.23	0.99	759	2.08	2.05	0.99	788
28	20	2.58	2.24	0.87	745	2.40	2.09	0.87	781	2.23	1.94	0.87	825
28	22	2.73	2.04	0.75	774	2.55	1.91	0.75	818	2.38	1.78	0.75	847
28	24	2.88	1.81	0.63	803	2.70	1.70	0.63	839	2.55	1.61	0.63	876
28	26	3.03	1.54	0.51	832	2.85	1.45	0.51	869	2.68	1.36	0.51	905
29	18	2.45	2.45	1.00	715	2.25	2.25	1.00	759	2.08	2.08	1.00	788
29	20	2.58	2.34	0.91	745	2.40	2.18	0.91	781	2.23	2.02	0.91	825
29	22	2.73	2.15	0.79	774	2.55	2.01	0.79	818	2.38	1.88	0.79	847
29	24	2.88	1.93	0.67	803	2.70	1.81	0.67	839	2.55	1.71	0.67	876
29	26	3.03	1.66	0.55	832	2.85	1.57	0.55	869	2.68	1.47	0.55	905
30	18	2.45	2.45	1.00	715	2.25	2.25	1.00	759	2.08	2.08	1.00	788
30	20	2.58	2.45	0.95	745	2.40	2.28	0.95	781	2.23	2.11	0.95	825
30	22	2.73	2.26	0.83	774	2.55	2.12	0.83	818	2.38	1.97	0.83	847
30	24	2.88	2.04	0.71	803	2.70	1.92	0.71	839	2.55	1.81	0.71	876
30	26	3.03	1.78	0.59	832	2.85	1.68	0.59	869	2.68	1.58	0.59	905
31	18	2.45	2.45	1.00	715	2.25	2.25	1.00	759	2.08	2.08	1.00	788
31	20	2.58	2.55	0.99	745	2.40	2.38	0.99	781	2.23	2.20	0.99	825
31	22	2.73	2.37	0.87	774	2.55	2.22	0.87	818	2.38	2.07	0.87	847
31	24	2.88	2.16	0.75	803	2.70	2.03	0.75	839	2.55	1.91	0.75	876
31	26	3.03	1.91	0.63	832	2.85	1.80	0.63	869	2.68	1.69	0.63	905
32	18	2.45	2.45	1.00	715	2.25	2.25	1.00	759	2.08	2.08	1.00	788
32	20	2.58	2.58	1.00	745	2.40	2.40	1.00	781	2.23	2.23	1.00	825
32	22	2.73	2.48	0.91	774	2.55	2.32	0.91	818	2.38	2.16	0.91	847
32	24	2.88	2.27	0.79	803	2.70	2.13	0.79	839	2.55	2.01	0.79	876
32	26	3.03	2.03	0.67	832	2.85	1.91	0.67	869	2.68	1.79	0.67	905

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-HJ35VA: MUZ-HJ35VA

CAPACITY: 3.15 kW SHF: 0.87 INPUT: 1040 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.09	2.13	0.69	1019	2.84	1.96	0.69	1082	2.61	1.80	0.69	1123
21	20	3.24	1.85	0.57	1061	3.02	1.72	0.57	1113	2.80	1.60	0.57	1175
22	18	3.09	2.25	0.73	1019	2.84	2.07	0.73	1082	2.61	1.91	0.73	1123
22	20	3.24	1.98	0.61	1061	3.02	1.84	0.61	1113	2.80	1.71	0.61	1175
22	22	3.43	1.68	0.49	1102	3.21	1.57	0.49	1165	2.99	1.47	0.49	1206
23	18	3.09	2.38	0.77	1019	2.84	2.18	0.77	1082	2.61	2.01	0.77	1123
23	20	3.24	2.11	0.65	1061	3.02	1.97	0.65	1113	2.80	1.82	0.65	1175
23	22	3.43	1.82	0.53	1102	3.21	1.70	0.53	1165	2.99	1.59	0.53	1206
24	18	3.09	2.50	0.81	1019	2.84	2.30	0.81	1082	2.61	2.12	0.81	1123
24	20	3.24	2.24	0.69	1061	3.02	2.09	0.69	1113	2.80	1.93	0.69	1175
24	22	3.43	1.96	0.57	1102	3.21	1.83	0.57	1165	2.99	1.71	0.57	1206
24	24	3.62	1.63	0.45	1144	3.40	1.53	0.45	1196	3.21	1.45	0.45	1248
25	18	3.09	2.62	0.85	1019	2.84	2.41	0.85	1082	2.61	2.22	0.85	1123
25	20	3.24	2.37	0.73	1061	3.02	2.21	0.73	1113	2.80	2.05	0.73	1175
25	22	3.43	2.09	0.61	1102	3.21	1.96	0.61	1165	2.99	1.83	0.61	1206
25	24	3.62	1.78	0.49	1144	3.40	1.67	0.49	1196	3.21	1.57	0.49	1248
26	18	3.09	2.75	0.89	1019	2.84	2.52	0.89	1082	2.61	2.33	0.89	1123
26	20	3.24	2.50	0.77	1061	3.02	2.33	0.77	1113	2.80	2.16	0.77	1175
26	22	3.43	2.23	0.65	1102	3.21	2.09	0.65	1165	2.99	1.95	0.65	1206
26	24	3.62	1.92	0.53	1144	3.40	1.80	0.53	1196	3.21	1.70	0.53	1248
26	26	3.81	1.56	0.41	1186	3.59	1.47	0.41	1238	3.37	1.38	0.41	1290
27	18	3.09	2.87	0.93	1019	2.84	2.64	0.93	1082	2.61	2.43	0.93	1123
27	20	3.24	2.63	0.81	1061	3.02	2.45	0.81	1113	2.80	2.27	0.81	1175
27	22	3.43	2.37	0.69	1102	3.21	2.22	0.69	1165	2.99	2.06	0.69	1206
27	24	3.62	2.06	0.57	1144	3.40	1.94	0.57	1196	3.21	1.83	0.57	1248
27	26	3.81	1.72	0.45	1186	3.59	1.62	0.45	1238	3.37	1.52	0.45	1290
28	18	3.09	2.99	0.97	1019	2.84	2.75	0.97	1082	2.61	2.54	0.97	1123
28	20	3.24	2.76	0.85	1061	3.02	2.57	0.85	1113	2.80	2.38	0.85	1175
28	22	3.43	2.51	0.73	1102	3.21	2.35	0.73	1165	2.99	2.18	0.73	1206
28	24	3.62	2.21	0.61	1144	3.40	2.08	0.61	1196	3.21	1.96	0.61	1248
28	26	3.81	1.87	0.49	1186	3.59	1.76	0.49	1238	3.37	1.65	0.49	1290
29	18	3.09	3.09	1.00	1019	2.84	2.84	1.00	1082	2.61	2.61	1.00	1123
29	20	3.24	2.89	0.89	1061	3.02	2.69	0.89	1113	2.80	2.50	0.89	1175
29	22	3.43	2.64	0.77	1102	3.21	2.47	0.77	1165	2.99	2.30	0.77	1206
29	24	3.62	2.35	0.65	1144	3.40	2.21	0.65	1196	3.21	2.09	0.65	1248
29	26	3.81	2.02	0.53	1186	3.59	1.90	0.53	1238	3.37	1.79	0.53	1290
30	18	3.09	3.09	1.00	1019	2.84	2.84	1.00	1082	2.61	2.61	1.00	1123
30	20	3.24	3.02	0.93	1061	3.02	2.81	0.93	1113	2.80	2.61	0.93	1175
30	22	3.43	2.78	0.81	1102	3.21	2.60	0.81	1165	2.99	2.42	0.81	1206
30	24	3.62	2.50	0.69	1144	3.40	2.35	0.69	1196	3.21	2.22	0.69	1248
30	26	3.81	2.17	0.57	1186	3.59	2.05	0.57	1238	3.37	1.92	0.57	1290
31	18	3.09	3.09	1.00	1019	2.84	2.84	1.00	1082	2.61	2.61	1.00	1123
31	20	3.24	3.15	0.97	1061	3.02	2.93	0.97	1113	2.80	2.72	0.97	1175
31	22	3.43	2.92	0.85	1102	3.21	2.73	0.85	1165	2.99	2.54	0.85	1206
31	24	3.62	2.64	0.73	1144	3.40	2.48	0.73	1196	3.21	2.35	0.73	1248
31	26	3.81	2.33	0.61	1186	3.59	2.19	0.61	1238	3.37	2.06	0.61	1290
32	18	3.09	3.09	1.00	1019	2.84	2.84	1.00	1082	2.61	2.61	1.00	1123
32	20	3.24	3.24	1.00	1061	3.02	3.02	1.00	1113	2.80	2.80	1.00	1175
32	22	3.43	3.06	0.89	1102	3.21	2.86	0.89	1165	2.99	2.66	0.89	1206
32	24	3.62	2.79	0.77	1144	3.40	2.62	0.77	1196	3.21	2.47	0.77	1248
32	26	3.81	2.48	0.65	1186	3.59	2.33	0.65	1238	3.37	2.19	0.65	1290

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-HJ50VA: MUZ-HJ50VA

CAPACITY: 5.0 kW

SHF: 0.70

INPUT: 2050 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.55	0.52	2009	4.50	2.34	0.52	2132	4.15	2.16	0.52	2214
21	20	5.15	2.06	0.40	2091	4.80	1.92	0.40	2194	4.45	1.78	0.40	2317
22	18	4.90	2.74	0.56	2009	4.50	2.52	0.56	2132	4.15	2.32	0.56	2214
22	20	5.15	2.27	0.44	2091	4.80	2.11	0.44	2194	4.45	1.96	0.44	2317
22	22	5.45	1.74	0.32	2173	5.10	1.63	0.32	2296	4.75	1.52	0.32	2378
23	18	4.90	2.94	0.60	2009	4.50	2.70	0.60	2132	4.15	2.49	0.60	2214
23	20	5.15	2.47	0.48	2091	4.80	2.30	0.48	2194	4.45	2.14	0.48	2317
23	22	5.45	1.96	0.36	2173	5.10	1.84	0.36	2296	4.75	1.71	0.36	2378
24	18	4.90	3.14	0.64	2009	4.50	2.88	0.64	2132	4.15	2.66	0.64	2214
24	20	5.15	2.68	0.52	2091	4.80	2.50	0.52	2194	4.45	2.31	0.52	2317
24	22	5.45	2.18	0.40	2173	5.10	2.04	0.40	2296	4.75	1.90	0.40	2378
24	24	5.75	1.61	0.28	2255	5.40	1.51	0.28	2358	5.10	1.43	0.28	2460
25	18	4.90	3.33	0.68	2009	4.50	3.06	0.68	2132	4.15	2.82	0.68	2214
25	20	5.15	2.88	0.56	2091	4.80	2.69	0.56	2194	4.45	2.49	0.56	2317
25	22	5.45	2.40	0.44	2173	5.10	2.24	0.44	2296	4.75	2.09	0.44	2378
25	24	5.75	1.84	0.32	2255	5.40	1.73	0.32	2358	5.10	1.63	0.32	2460
26	18	4.90	3.53	0.72	2009	4.50	3.24	0.72	2132	4.15	2.99	0.72	2214
26	20	5.15	3.09	0.60	2091	4.80	2.88	0.60	2194	4.45	2.67	0.60	2317
26	22	5.45	2.62	0.48	2173	5.10	2.45	0.48	2296	4.75	2.28	0.48	2378
26	24	5.75	2.07	0.36	2255	5.40	1.94	0.36	2358	5.10	1.84	0.36	2460
26	26	6.05	1.45	0.24	2337	5.70	1.37	0.24	2440	5.35	1.28	0.24	2542
27	18	4.90	3.72	0.76	2009	4.50	3.42	0.76	2132	4.15	3.15	0.76	2214
27	20	5.15	3.30	0.64	2091	4.80	3.07	0.64	2194	4.45	2.85	0.64	2317
27	22	5.45	2.83	0.52	2173	5.10	2.65	0.52	2296	4.75	2.47	0.52	2378
27	24	5.75	2.30	0.40	2255	5.40	2.16	0.40	2358	5.10	2.04	0.40	2460
27	26	6.05	1.69	0.28	2337	5.70	1.60	0.28	2440	5.35	1.50	0.28	2542
28	18	4.90	3.92	0.80	2009	4.50	3.60	0.80	2132	4.15	3.32	0.80	2214
28	20	5.15	3.50	0.68	2091	4.80	3.26	0.68	2194	4.45	3.03	0.68	2317
28	22	5.45	3.05	0.56	2173	5.10	2.86	0.56	2296	4.75	2.66	0.56	2378
28	24	5.75	2.53	0.44	2255	5.40	2.38	0.44	2358	5.10	2.24	0.44	2460
28	26	6.05	1.94	0.32	2337	5.70	1.82	0.32	2440	5.35	1.71	0.32	2542
29	18	4.90	4.12	0.84	2009	4.50	3.78	0.84	2132	4.15	3.49	0.84	2214
29	20	5.15	3.71	0.72	2091	4.80	3.46	0.72	2194	4.45	3.20	0.72	2317
29	22	5.45	3.27	0.60	2173	5.10	3.06	0.60	2296	4.75	2.85	0.60	2378
29	24	5.75	2.76	0.48	2255	5.40	2.59	0.48	2358	5.10	2.45	0.48	2460
29	26	6.05	2.18	0.36	2337	5.70	2.05	0.36	2440	5.35	1.93	0.36	2542
30	18	4.90	4.31	0.88	2009	4.50	3.96	0.88	2132	4.15	3.65	0.88	2214
30	20	5.15	3.91	0.76	2091	4.80	3.65	0.76	2194	4.45	3.38	0.76	2317
30	22	5.45	3.49	0.64	2173	5.10	3.26	0.64	2296	4.75	3.04	0.64	2378
30	24	5.75	2.99	0.52	2255	5.40	2.81	0.52	2358	5.10	2.65	0.52	2460
30	26	6.05	2.42	0.40	2337	5.70	2.28	0.40	2440	5.35	2.14	0.40	2542
31	18	4.90	4.51	0.92	2009	4.50	4.14	0.92	2132	4.15	3.82	0.92	2214
31	20	5.15	4.12	0.80	2091	4.80	3.84	0.80	2194	4.45	3.56	0.80	2317
31	22	5.45	3.71	0.68	2173	5.10	3.47	0.68	2296	4.75	3.23	0.68	2378
31	24	5.75	3.22	0.56	2255	5.40	3.02	0.56	2358	5.10	2.86	0.56	2460
31	26	6.05	2.66	0.44	2337	5.70	2.51	0.44	2440	5.35	2.35	0.44	2542
32	18	4.90	4.70	0.96	2009	4.50	4.32	0.96	2132	4.15	3.98	0.96	2214
32	20	5.15	4.33	0.84	2091	4.80	4.03	0.84	2194	4.45	3.74	0.84	2317
32	22	5.45	3.92	0.72	2173	5.10	3.67	0.72	2296	4.75	3.42	0.72	2378
32	24	5.75	3.45	0.60	2255	5.40	3.24	0.60	2358	5.10	3.06	0.60	2460
32	26	6.05	2.90	0.48	2337	5.70	2.74	0.48	2440	5.35	2.57	0.48	2542

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-HJ60VA: MUZ-HJ60VA

CAPACITY: 6.1 kW

SHF: 0.82

INPUT: 1900 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.98	3.83	0.64	1862	5.49	3.51	0.64	1976	5.06	3.24	0.64	2052
21	20	6.28	3.27	0.52	1938	5.86	3.05	0.52	2033	5.43	2.82	0.52	2147
22	18	5.98	4.07	0.68	1862	5.49	3.73	0.68	1976	5.06	3.44	0.68	2052
22	20	6.28	3.52	0.56	1938	5.86	3.28	0.56	2033	5.43	3.04	0.56	2147
22	22	6.65	2.93	0.44	2014	6.22	2.74	0.44	2128	5.79	2.55	0.44	2204
23	18	5.98	4.30	0.72	1862	5.49	3.95	0.72	1976	5.06	3.65	0.72	2052
23	20	6.28	3.77	0.60	1938	5.86	3.51	0.60	2033	5.43	3.26	0.60	2147
23	22	6.65	3.19	0.48	2014	6.22	2.99	0.48	2128	5.79	2.78	0.48	2204
24	18	5.98	4.54	0.76	1862	5.49	4.17	0.76	1976	5.06	3.85	0.76	2052
24	20	6.28	4.02	0.64	1938	5.86	3.75	0.64	2033	5.43	3.47	0.64	2147
24	22	6.65	3.46	0.52	2014	6.22	3.24	0.52	2128	5.79	3.01	0.52	2204
24	24	7.01	2.81	0.40	2090	6.59	2.64	0.40	2185	6.22	2.49	0.40	2280
25	18	5.98	4.78	0.80	1862	5.49	4.39	0.80	1976	5.06	4.05	0.8	2052
25	20	6.28	4.27	0.68	1938	5.86	3.98	0.68	2033	5.43	3.69	0.68	2147
25	22	6.65	3.72	0.56	2014	6.22	3.48	0.56	2128	5.79	3.25	0.56	2204
25	24	7.01	3.09	0.44	2090	6.59	2.90	0.44	2185	6.22	2.74	0.44	2280
26	18	5.98	5.02	0.84	1862	5.49	4.61	0.84	1976	5.06	4.25	0.84	2052
26	20	6.28	4.52	0.72	1938	5.86	4.22	0.72	2033	5.43	3.91	0.72	2147
26	22	6.65	3.99	0.60	2014	6.22	3.73	0.60	2128	5.79	3.48	0.60	2204
26	24	7.01	3.37	0.48	2090	6.59	3.16	0.48	2185	6.22	2.99	0.48	2280
26	26	7.38	2.66	0.36	2166	6.95	2.50	0.36	2261	6.53	2.35	0.36	2356
27	18	5.98	5.26	0.88	1862	5.49	4.83	0.88	1976	5.06	4.46	0.88	2052
27	20	6.28	4.78	0.76	1938	5.86	4.45	0.76	2033	5.43	4.13	0.76	2147
27	22	6.65	4.26	0.64	2014	6.22	3.98	0.64	2128	5.79	3.71	0.64	2204
27	24	7.01	3.65	0.52	2090	6.59	3.43	0.52	2185	6.22	3.24	0.52	2280
27	26	7.38	2.95	0.40	2166	6.95	2.78	0.40	2261	6.53	2.61	0.40	2356
28	18	5.98	5.50	0.92	1862	5.49	5.05	0.92	1976	5.06	4.66	0.92	2052
28	20	6.28	5.03	0.80	1938	5.86	4.68	0.80	2033	5.43	4.34	0.80	2147
28	22	6.65	4.52	0.68	2014	6.22	4.23	0.68	2128	5.79	3.94	0.68	2204
28	24	7.01	3.93	0.56	2090	6.59	3.69	0.56	2185	6.22	3.48	0.56	2280
28	26	7.38	3.25	0.44	2166	6.95	3.06	0.44	2261	6.53	2.87	0.44	2356
29	18	5.98	5.74	0.96	1862	5.49	5.27	0.96	1976	5.06	4.86	0.96	2052
29	20	6.28	5.28	0.84	1938	5.86	4.92	0.84	2033	5.43	4.56	0.84	2147
29	22	6.65	4.79	0.72	2014	6.22	4.48	0.72	2128	5.79	4.17	0.72	2204
29	24	7.01	4.21	0.60	2090	6.59	3.95	0.60	2185	6.22	3.73	0.60	2280
29	26	7.38	3.54	0.48	2166	6.95	3.34	0.48	2261	6.53	3.13	0.48	2356
30	18	5.98	5.98	1.00	1862	5.49	5.49	1.00	1976	5.06	5.06	1.00	2052
30	20	6.28	5.53	0.88	1938	5.86	5.15	0.88	2033	5.43	4.78	0.88	2147
30	22	6.65	5.05	0.76	2014	6.22	4.73	0.76	2128	5.79	4.40	0.76	2204
30	24	7.01	4.49	0.64	2090	6.59	4.22	0.64	2185	6.22	3.98	0.64	2280
30	26	7.38	3.84	0.52	2166	6.95	3.62	0.52	2261	6.53	3.39	0.52	2356
31	18	5.98	5.98	1.00	1862	5.49	5.49	1.00	1976	5.06	5.06	1.00	2052
31	20	6.28	5.78	0.92	1938	5.86	5.39	0.92	2033	5.43	4.99	0.92	2147
31	22	6.65	5.32	0.80	2014	6.22	4.98	0.80	2128	5.79	4.64	0.80	2204
31	24	7.01	4.77	0.68	2090	6.59	4.48	0.68	2185	6.22	4.23	0.68	2280
31	26	7.38	4.13	0.56	2166	6.95	3.89	0.56	2261	6.53	3.66	0.56	2356
32	18	5.98	5.98	1.00	1862	5.49	5.49	1.00	1976	5.06	5.06	1.00	2052
32	20	6.28	6.03	0.96	1938	5.86	5.62	0.96	2033	5.43	5.21	0.96	2147
32	22	6.65	5.59	0.84	2014	6.22	5.23	0.84	2128	5.79	4.87	0.84	2204
32	24	7.01	5.05	0.72	2090	6.59	4.74	0.72	2185	6.22	4.48	0.72	2280
32	26	7.38	4.43	0.60	2166	6.95	4.17	0.60	2261	6.53	3.92	0.60	2356

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES COOL operation at Rated frequency

MSZ-HJ71VA: MUZ-HJ71VA

CAPACITY: 7.1 kW

SHF: 0.77

INPUT: 2330 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	6.96	4.11	0.59	2283	6.39	3.77	0.59	2423	5.89	3.48	0.59	2516
21	20	7.31	3.44	0.47	2377	6.82	3.20	0.47	2493	6.32	2.97	0.47	2633
22	18	6.96	4.38	0.63	2283	6.39	4.03	0.63	2423	5.89	3.71	0.63	2516
22	20	7.31	3.73	0.51	2377	6.82	3.48	0.51	2493	6.32	3.22	0.51	2633
22	22	7.74	3.02	0.39	2470	7.24	2.82	0.39	2610	6.75	2.63	0.39	2703
23	18	6.96	4.66	0.67	2283	6.39	4.28	0.67	2423	5.89	3.95	0.67	2516
23	20	7.31	4.02	0.55	2377	6.82	3.75	0.55	2493	6.32	3.48	0.55	2633
23	22	7.74	3.33	0.43	2470	7.24	3.11	0.43	2610	6.75	2.90	0.43	2703
24	18	6.96	4.94	0.71	2283	6.39	4.54	0.71	2423	5.89	4.18	0.71	2516
24	20	7.31	4.31	0.59	2377	6.82	4.02	0.59	2493	6.32	3.73	0.59	2633
24	22	7.74	3.64	0.47	2470	7.24	3.40	0.47	2610	6.75	3.17	0.47	2703
24	24	8.17	2.86	0.35	2563	7.67	2.68	0.35	2680	7.24	2.53	0.35	2796
25	18	6.96	5.22	0.75	2283	6.39	4.79	0.75	2423	5.89	4.42	0.75	2516
25	20	7.31	4.61	0.63	2377	6.82	4.29	0.63	2493	6.32	3.98	0.63	2633
25	22	7.74	3.95	0.51	2470	7.24	3.69	0.51	2610	6.75	3.44	0.51	2703
25	24	8.17	3.18	0.39	2563	7.67	2.99	0.39	2680	7.24	2.82	0.39	2796
26	18	6.96	5.50	0.79	2283	6.39	5.05	0.79	2423	5.89	4.66	0.79	2516
26	20	7.31	4.90	0.67	2377	6.82	4.57	0.67	2493	6.32	4.23	0.67	2633
26	22	7.74	4.26	0.55	2470	7.24	3.98	0.55	2610	6.75	3.71	0.55	2703
26	24	8.17	3.51	0.43	2563	7.67	3.30	0.43	2680	7.24	3.11	0.43	2796
26	26	8.59	2.66	0.31	2656	8.09	2.51	0.31	2773	7.60	2.36	0.31	2889
27	18	6.96	5.78	0.83	2283	6.39	5.30	0.83	2423	5.89	4.89	0.83	2516
27	20	7.31	5.19	0.71	2377	6.82	4.84	0.71	2493	6.32	4.49	0.71	2633
27	22	7.74	4.57	0.59	2470	7.24	4.27	0.59	2610	6.75	3.98	0.59	2703
27	24	8.17	3.84	0.47	2563	7.67	3.60	0.47	2680	7.24	3.40	0.47	2796
27	26	8.59	3.01	0.35	2656	8.09	2.83	0.35	2773	7.60	2.66	0.35	2889
28	18	6.96	6.05	0.87	2283	6.39	5.56	0.87	2423	5.89	5.13	0.87	2516
28	20	7.31	5.48	0.75	2377	6.82	5.11	0.75	2493	6.32	4.74	0.75	2633
28	22	7.74	4.88	0.63	2470	7.24	4.56	0.63	2610	6.75	4.25	0.63	2703
28	24	8.17	4.16	0.51	2563	7.67	3.91	0.51	2680	7.24	3.69	0.51	2796
28	26	8.59	3.35	0.39	2656	8.09	3.16	0.39	2773	7.60	2.96	0.39	2889
29	18	6.96	6.33	0.91	2283	6.39	5.81	0.91	2423	5.89	5.36	0.91	2516
29	20	7.31	5.78	0.79	2377	6.82	5.38	0.79	2493	6.32	4.99	0.79	2633
29	22	7.74	5.19	0.67	2470	7.24	4.85	0.67	2610	6.75	4.52	0.67	2703
29	24	8.17	4.49	0.55	2563	7.67	4.22	0.55	2680	7.24	3.98	0.55	2796
29	26	8.59	3.69	0.43	2656	8.09	3.48	0.43	2773	7.60	3.27	0.43	2889
30	18	6.96	6.61	0.95	2283	6.39	6.07	0.95	2423	5.89	5.60	0.95	2516
30	20	7.31	6.07	0.83	2377	6.82	5.66	0.83	2493	6.32	5.24	0.83	2633
30	22	7.74	5.49	0.71	2470	7.24	5.14	0.71	2610	6.75	4.79	0.71	2703
30	24	8.17	4.82	0.59	2563	7.67	4.52	0.59	2680	7.24	4.27	0.59	2796
30	26	8.59	4.04	0.47	2656	8.09	3.80	0.47	2773	7.60	3.57	0.47	2889
31	18	6.96	6.89	0.99	2283	6.39	6.33	0.99	2423	5.89	5.83	0.99	2516
31	20	7.31	6.36	0.87	2377	6.82	5.93	0.87	2493	6.32	5.50	0.87	2633
31	22	7.74	5.80	0.75	2470	7.24	5.43	0.75	2610	6.75	5.06	0.75	2703
31	24	8.17	5.14	0.63	2563	7.67	4.83	0.63	2680	7.24	4.56	0.63	2796
31	26	8.59	4.38	0.51	2656	8.09	4.13	0.51	2773	7.60	3.87	0.51	2889
32	18	6.96	6.96	1.00	2283	6.39	6.39	1.00	2423	5.89	5.89	1.00	2516
32	20	7.31	6.65	0.91	2377	6.82	6.20	0.91	2493	6.32	5.75	0.91	2633
32	22	7.74	6.11	0.79	2470	7.24	5.72	0.79	2610	6.75	5.33	0.79	2703
32	24	8.17	5.47	0.67	2563	7.67	5.14	0.67	2680	7.24	4.85	0.67	2796
32	26	8.59	4.73	0.55	2656	8.09	4.45	0.55	2773	7.60	4.18	0.55	2889

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE CURVES Heat operation at Rated frequency**MSZ-LN25VGW/V/B/R: MUZ-LN25VG**

CAPACITY: 3.2 kW INPUT: 580 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	377	2.43	452	2.85	510	3.26	551	3.68	586	4.06	603	4.48	615
21	1.92	406	2.30	481	2.72	534	3.10	574	3.52	603	3.90	621	4.30	644
26	1.73	435	2.14	510	2.53	563	2.94	603	3.36	632	3.74	650	4.16	667

MSZ-LN25VGW/V/B/R: MUZ-LN25VGHZ

CAPACITY: 3.2 kW INPUT: 580 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	377	2.43	452	2.85	510	3.26	551	3.68	586	4.06	603	4.48	615
21	1.92	406	2.30	481	2.72	534	3.10	574	3.52	603	3.90	621	4.30	644
26	1.73	435	2.14	510	2.53	563	2.94	603	3.36	632	3.74	650	4.16	667

MSZ-LN35VGW/V/B/R: MUZ-LN35VG

CAPACITY: 4.0 kW INPUT: 800 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	520	3.04	624	3.56	704	4.08	760	4.60	808	5.08	832	5.60	848
21	2.40	560	2.88	664	3.40	736	3.88	792	4.40	832	4.88	856	5.38	888
26	2.16	600	2.68	704	3.16	776	3.68	832	4.20	872	4.68	896	5.20	920

MSZ-LN35VGW/V/B/R: MUZ-LN35VGHZ

CAPACITY: 4.0 kW INPUT: 800 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	520	3.04	624	3.56	704	4.08	760	4.60	808	5.08	832	5.60	848
21	2.40	560	2.88	664	3.40	736	3.88	792	4.40	832	4.88	856	5.38	888
26	2.16	600	2.68	704	3.16	776	3.68	832	4.20	872	4.68	896	5.20	920

MSZ-LN50VGW/V/B/R: MUZ-LN50VG

CAPACITY: 6.0 kW INPUT: 1480 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.78	962	4.56	1154	5.34	1302	6.12	1406	6.90	1495	7.62	1539	8.40	1569
21	3.60	1036	4.32	1228	5.10	1362	5.82	1465	6.60	1539	7.32	1584	8.07	1643
26	3.24	1110	4.02	1302	4.74	1436	5.52	1539	6.30	1613	7.02	1658	7.80	1702

MSZ-LN50VGW/V/B/R: MUZ-LN50VGHZ

CAPACITY: 6.0 kW INPUT: 1480 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.78	962	4.56	1154	5.34	1302	6.12	1406	6.90	1495	7.62	1539	8.40	1569
21	3.60	1036	4.32	1228	5.10	1362	5.82	1465	6.60	1539	7.32	1584	8.07	1643
26	3.24	1110	4.02	1302	4.74	1436	5.52	1539	6.30	1613	7.02	1658	7.80	1702

MSZ-LN60VGW/V/B/R: MUZ-LN60VG

CAPACITY: 6.8 kW INPUT: 1810 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	4.28	1177	5.17	1412	6.05	1593	6.94	1720	7.82	1828	8.64	1882	9.52	1919
21	4.08	1267	4.90	1502	5.78	1665	6.60	1792	7.48	1882	8.30	1937	9.15	2009
26	3.67	1358	4.56	1593	5.37	1756	6.26	1882	7.14	1973	7.96	2027	8.84	2082

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

PERFORMANCE CURVES Heat operation at Rated frequency

MUZ-AP20VG

CAPACITY: 2.5 kW INPUT: 580 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	1.58	377	1.90	452	2.23	510	2.55	551	2.88	586	3.18	603	3.50	615
21	1.50	406	1.80	481	2.13	534	2.43	574	2.75	603	3.05	621	3.36	644
26	1.35	435	1.68	510	1.98	563	2.30	603	2.63	632	2.93	650	3.25	667

MSZ-AP25VG, MSZ-AP25VGK: MUZ-AP25VG

CAPACITY: 3.2 kW INPUT: 780 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	507	2.43	608	2.85	686	3.26	741	3.68	788	4.06	811	4.48	827
21	1.92	546	2.30	647	2.72	718	3.10	772	3.52	811	3.90	835	4.30	866
26	1.73	585	2.14	686	2.53	757	2.94	811	3.36	850	3.74	874	4.16	897

MSZ-AP35VG, MSZ-AP35VGK: MUZ-AP35VG

CAPACITY: 4.0 kW INPUT: 1030 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	670	3.04	803	3.56	906	4.08	979	4.60	1040	5.08	1071	5.60	1092
21	2.40	721	2.88	855	3.40	948	3.88	1020	4.40	1071	4.88	1102	5.38	1143
26	2.16	773	2.68	906	3.16	999	3.68	1071	4.20	1123	4.68	1154	5.20	1185

MSZ-AP42VG, MSZ-AP42VGK: MUZ-AP42VG

CAPACITY: 5.4 kW INPUT: 1490 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.40	969	4.10	1162	4.81	1311	5.51	1416	6.21	1505	6.86	1550	7.56	1579
21	3.24	1043	3.89	1237	4.59	1371	5.24	1475	5.94	1550	6.59	1594	7.26	1654
26	2.92	1118	3.62	1311	4.27	1445	4.97	1550	5.67	1624	6.32	1669	7.02	1714

MSZ-AP50VG, MSZ-AP50VGK: MUZ-AP50VG

CAPACITY: 5.8 kW INPUT: 1600 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.65	1040	4.41	1248	5.16	1408	5.92	1520	6.67	1616	7.37	1664	8.12	1696
21	3.48	1120	4.18	1328	4.93	1472	5.63	1584	6.38	1664	7.08	1712	7.80	1776
26	3.13	1200	3.89	1408	4.58	1552	5.34	1664	6.09	1744	6.79	1792	7.54	1840

MSZ-AP60VG, MSZ-AP60VGK: MUZ-AP60VG

CAPACITY: 6.8 kW INPUT: 1670 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	4.28	1086	5.17	1303	6.05	1470	6.94	1587	7.82	1687	8.64	1737	9.52	1770
21	4.08	1169	4.90	1386	5.78	1536	6.60	1653	7.48	1737	8.30	1787	9.15	1854
26	3.67	1253	4.56	1470	5.37	1620	6.26	1737	7.14	1820	7.96	1870	8.84	1921

MSZ-AP71VG, MSZ-AP71VGK: MUZ-AP71VG

CAPACITY: 8.1 kW INPUT: 2120 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	5.10	1378	6.16	1654	7.21	1866	8.26	2014	9.32	2141	10.29	2205	11.34	2247
21	4.86	1484	5.83	1760	6.89	1950	7.86	2099	8.91	2205	9.88	2268	10.89	2353
26	4.37	1590	5.43	1866	6.40	2056	7.45	2205	8.51	2311	9.48	2374	10.53	2438

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

PERFORMANCE CURVES Heat operation at Rated frequency

MSZ-AP25VG, MSZ-AP25VGK: MUZ-AP25VGH

CAPACITY: 3.2 kW INPUT: 780 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	507	2.43	608	2.85	686	3.26	741	3.68	788	4.06	811	4.48	827
21	1.92	546	2.30	647	2.72	718	3.10	772	3.52	811	3.90	835	4.30	866
26	1.73	585	2.14	686	2.53	757	2.94	811	3.36	850	3.74	874	4.16	897

MSZ-AP35VG, MSZ-AP35VGK: MUZ-AP35VGH

CAPACITY: 4.0 kW INPUT: 1030 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	670	3.04	803	3.56	906	4.08	979	4.60	1040	5.08	1071	5.60	1092
21	2.40	721	2.88	855	3.40	948	3.88	1020	4.40	1071	4.88	1102	5.38	1143
26	2.16	773	2.68	906	3.16	999	3.68	1071	4.20	1123	4.68	1154	5.20	1185

MSZ-AP42VG, MSZ-AP42VGK: MUZ-AP42VGH

CAPACITY: 5.4 kW INPUT: 1490 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.40	969	4.10	1162	4.81	1311	5.51	1416	6.21	1505	6.86	1550	7.56	1579
21	3.24	1043	3.89	1237	4.59	1371	5.24	1475	5.94	1550	6.59	1594	7.26	1654
26	2.92	1118	3.62	1311	4.27	1445	4.97	1550	5.67	1624	6.32	1669	7.02	1714

MSZ-AP50VG, MSZ-AP50VGK: MUZ-AP50VGH

CAPACITY: 5.8 kW INPUT: 1600 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.65	1040	4.41	1248	5.16	1408	5.92	1520	6.67	1616	7.37	1664	8.12	1696
21	3.48	1120	4.18	1328	4.93	1472	5.63	1584	6.38	1664	7.08	1712	7.80	1776
26	3.13	1200	3.89	1408	4.58	1552	5.34	1664	6.09	1744	6.79	1792	7.54	1840

MSZ-HR25VF: MUZ-HR25VF

CAPACITY: 3.15 kW INPUT: 850 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	1.98	553	2.39	663	2.80	748	3.21	808	3.62	859	4.00	884	4.41	901
21	1.89	595	2.27	706	2.68	782	3.06	842	3.47	884	3.84	910	4.24	944
26	1.70	638	2.11	748	2.49	825	2.90	884	3.31	927	3.69	952	4.10	978

MSZ-HR35VF: MUZ-HR35VF

CAPACITY: 3.60 kW INPUT: 975 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.27	634	2.74	761	3.20	858	3.67	926	4.14	985	4.57	1014	5.04	1034
21	2.16	683	2.59	809	3.06	897	3.49	965	3.96	1014	4.39	1043	4.84	1082
26	1.94	731	2.41	858	2.84	946	3.31	1014	3.78	1063	4.21	1092	4.68	1121

MSZ-HR42VF: MUZ-HR42VF

CAPACITY: 4.70 kW INPUT: 1300 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.96	845	3.57	1014	4.18	1144	4.79	1235	5.41	1313	5.97	1352	6.58	1378
21	2.82	910	3.38	1079	4.00	1196	4.56	1287	5.17	1352	5.73	1391	6.32	1443
26	2.54	975	3.15	1144	3.71	1261	4.32	1352	4.94	1417	5.50	1456	6.11	1495

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

WALL-MOUNTED PERFORMANCE DATA

PERFORMANCE CURVES Heat operation at Rated frequency

MSZ-HR50VF: MUZ-HR50VF

CAPACITY: 5.40 kW INPUT: 1550 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.40	1008	4.10	1209	4.81	1364	5.51	1473	6.21	1566	6.86	1612	7.56	1643
21	3.24	1085	3.89	1287	4.59	1426	5.24	1535	5.94	1612	6.59	1659	7.26	1721
26	2.92	1163	3.62	1364	4.27	1504	4.97	1612	5.67	1690	6.32	1736	7.02	1783

MSZ-FH25VE2: MUZ-FH25VE

CAPACITY: 3.2 kW INPUT: 580 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	377	2.43	452	2.85	510	3.26	551	3.68	586	4.06	603	4.48	615
21	1.92	406	2.30	481	2.72	534	3.10	574	3.52	603	3.90	621	4.30	644
26	1.73	435	2.14	510	2.53	563	2.94	603	3.36	632	3.74	650	4.16	667

MSZ-FH35VE2: MUZ-FH35VE

CAPACITY: 4.0 kW INPUT: 800 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	520	3.04	624	3.56	704	4.08	760	4.60	808	5.08	832	5.60	848
21	2.40	560	2.88	664	3.40	736	3.88	792	4.40	832	4.88	856	5.38	888
26	2.16	600	2.68	704	3.16	776	3.68	832	4.20	872	4.68	896	5.20	920

MSZ-FH50VE2: MUZ-FH50VE

CAPACITY: 6.0 kW INPUT: 1480 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.78	962	4.56	1154	5.34	1302	6.12	1406	6.90	1495	7.62	1539	8.40	1569
21	3.60	1036	4.32	1228	5.10	1362	5.82	1465	6.60	1539	7.32	1584	8.07	1643
26	3.24	1110	4.02	1302	4.74	1436	5.52	1539	6.30	1613	7.02	1658	7.80	1702

MSZ-FH25VE2: MUZ-FH25VEHZ

CAPACITY: 3.2 kW INPUT: 580 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	377	2.43	452	2.85	510	3.26	551	3.68	586	4.06	603	4.48	615
21	1.92	406	2.30	481	2.72	534	3.10	574	3.52	603	3.90	621	4.30	644
26	1.73	435	2.14	510	2.53	563	2.94	603	3.36	632	3.74	650	4.16	667

MSZ-FH35VE2: MUZ-FH35VEHZ

CAPACITY: 4.0 kW INPUT: 800 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	520	3.04	624	3.56	704	4.08	760	4.60	808	5.08	832	5.60	848
21	2.40	560	2.88	664	3.40	736	3.88	792	4.40	832	4.88	856	5.38	888
26	2.16	600	2.68	704	3.16	776	3.68	832	4.20	872	4.68	896	5.20	920

MSZ-FH50VE2: MUZ-FH50VEHZ

CAPACITY: 6.0 kW INPUT: 1480 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.78	962	4.56	1154	5.34	1302	6.12	1406	6.90	1495	7.62	1539	8.40	1569
21	3.60	1036	4.32	1228	5.10	1362	5.82	1465	6.60	1539	7.32	1584	8.07	1643
26	3.24	1110	4.02	1302	4.74	1436	5.52	1539	6.30	1613	7.02	1658	7.80	1702

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

PERFORMANCE CURVES Heat operation at Rated frequency**MSZ-EF25VGW/B/S: MUZ-EF25VG, MUZ-EF25VGH**

CAPACITY: 3.2 kW INPUT: 700 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	455	2.43	546	2.85	616	3.26	665	3.68	707	4.06	728	4.48	742
21	1.92	490	2.30	581	2.72	644	3.10	693	3.52	728	3.90	749	4.30	777
26	1.73	525	2.14	616	2.53	679	2.94	728	3.36	763	3.74	784	4.16	805

MSZ-EF35VGW/B/S: MUZ-EF35VG, MUZ-EF35VGH

CAPACITY: 4.0 kW INPUT: 950 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	618	3.04	741	3.56	836	4.08	903	4.60	960	5.08	988	5.60	1007
21	2.40	665	2.88	789	3.40	874	3.88	941	4.40	988	4.88	1017	5.38	1055
26	2.16	713	2.68	836	3.16	922	3.68	988	4.20	1036	4.68	1064	5.20	1093

MSZ-EF42VGW/B/S: MUZ-EF42VG

CAPACITY: 5.4 kW INPUT: 1455 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.40	946	4.10	1135	4.81	1280	5.51	1382	6.21	1470	6.86	1513	7.56	1542
21	3.24	1019	3.89	1208	4.59	1339	5.24	1440	5.94	1513	6.59	1557	7.26	1615
26	2.92	1091	3.62	1280	4.27	1411	4.97	1513	5.67	1586	6.32	1630	7.02	1673

MSZ-EF50VGW/B/S: MUZ-EF50VG

CAPACITY: 5.8 kW INPUT: 1560 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.65	1014	4.41	1217	5.16	1373	5.92	1482	6.67	1576	7.37	1622	8.12	1654
21	3.48	1092	4.18	1295	4.93	1435	5.63	1544	6.38	1622	7.08	1669	7.80	1732
26	3.13	1170	3.89	1373	4.58	1513	5.34	1622	6.09	1700	6.79	1747	7.54	1794

MSZ-SF25VE3: MUZ-SF25VE, MUZ-SF25VEH

CAPACITY: 3.2 kW INPUT: 780 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.02	507	2.43	608	2.85	686	3.26	741	3.68	788	4.06	811	4.48	827
21	1.92	546	2.30	647	2.72	718	3.10	772	3.52	811	3.90	835	4.30	866
26	1.73	585	2.14	686	2.53	757	2.94	811	3.36	850	3.74	874	4.16	897

MSZ-SF35VE3: MUZ-SF35VE, MUZ-SF35VEH

CAPACITY: 4.0 kW INPUT: 1030 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.52	670	3.04	803	3.56	906	4.08	979	4.60	1040	5.08	1071	5.60	1092
21	2.40	721	2.88	855	3.40	948	3.88	1020	4.40	1071	4.88	1102	5.38	1143
26	2.16	773	2.68	906	3.16	999	3.68	1071	4.20	1123	4.68	1154	5.20	1185

MSZ-SF42VE3: MUZ-SF42VE, MUZ-SF42VEH

CAPACITY: 5.4 kW INPUT: 1580 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.40	1027	4.10	1232	4.81	1390	5.51	1501	6.21	1596	6.86	1643	7.56	1675
21	3.24	1106	3.89	1311	4.59	1454	5.24	1564	5.94	1643	6.59	1691	7.26	1754
26	2.92	1185	3.62	1390	4.27	1533	4.97	1643	5.67	1722	6.32	1770	7.02	1817

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

PERFORMANCE CURVES Heat operation at Rated frequency

MSZ-SF50VE3: MUZ-SF50VE, MUZ-SF50VEH

CAPACITY: 5.8 kW INPUT: 1700 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.65	1105	4.41	1326	5.16	1496	5.92	1615	6.67	1717	7.37	1768	8.12	1802
21	3.48	1190	4.18	1411	4.93	1564	5.63	1683	6.38	1768	7.08	1819	7.80	1887
26	3.13	1275	3.89	1496	4.58	1649	5.34	1768	6.09	1853	6.79	1904	7.54	1955

MSZ-GF60VE2: MUZ-GF60VE

CAPACITY: 6.8 kW INPUT: 1810 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	4.28	1177	5.17	1412	6.05	1593	6.94	1720	7.82	1828	8.64	1882	9.52	1919
21	4.08	1267	4.90	1502	5.78	1665	6.60	1792	7.48	1882	8.30	1937	9.15	2009
26	3.67	1358	4.56	1593	5.37	1756	6.26	1882	7.14	1973	7.96	2027	8.84	2082

MSZ-GF71VE2: MUZ-GF71VE

CAPACITY: 8.1 kW INPUT: 2230 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	5.10	1450	6.16	1739	7.21	1962	8.26	2119	9.32	2252	10.29	2319	11.34	2364
21	4.86	1561	5.83	1851	6.89	2052	7.86	2208	8.91	2319	9.88	2386	10.89	2475
26	4.37	1673	5.43	1962	6.40	2163	7.45	2319	8.51	2431	9.48	2498	10.53	2565

MUZ-WN25VA: MUZ-WN25VA

CAPACITY: 3.15 kW INPUT: 850 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	1.98	553	2.39	663	2.80	748	3.21	808	3.62	859	4.00	884	4.41	901
21	1.89	595	2.27	706	2.68	782	3.06	842	3.47	884	3.84	910	4.24	944
26	1.70	638	2.11	748	2.49	825	2.90	884	3.31	927	3.69	952	4.10	978

MUZ-WN35VA: MUZ-WN35VA

CAPACITY: 3.6 kW INPUT: 975 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.27	634	2.74	761	3.20	858	3.67	926	4.14	985	4.57	1014	5.04	1034
21	2.16	683	2.59	809	3.06	897	3.49	965	3.96	1014	4.39	1043	4.84	1082
26	1.94	731	2.41	858	2.84	946	3.31	1014	3.78	1063	4.21	1092	4.68	1121

MSZ-DM25VA: MUZ-DM25VA

CAPACITY: 3.15 kW INPUT: 850 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	1.98	553	2.39	663	2.80	748	3.21	808	3.62	859	4.00	884	4.41	901
21	1.89	595	2.27	706	2.68	782	3.06	842	3.47	884	3.84	910	4.24	944
26	1.70	638	2.11	748	2.49	825	2.90	884	3.31	927	3.69	952	4.10	978

MSZ-DM35VA: MUZ-DM35VA

CAPACITY: 3.6 kW INPUT: 975 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.27	634	2.74	761	3.20	858	3.67	926	4.14	985	4.57	1014	5.04	1034
21	2.16	683	2.59	809	3.06	897	3.49	965	3.96	1014	4.39	1043	4.84	1082
26	1.94	731	2.41	858	2.84	946	3.31	1014	3.78	1063	4.21	1092	4.68	1121

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

PERFORMANCE CURVES Heat operation at Rated frequency**MSZ-HJ25VA: MUZ-HJ25VA**

CAPACITY: 3.15 kW INPUT: 870 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	1.98	566	2.39	679	2.80	766	3.21	827	3.62	879	4.00	905	4.41	922
21	1.89	609	2.27	722	2.68	800	3.06	861	3.47	905	3.84	931	4.24	966
26	1.70	653	2.11	766	2.49	844	2.90	905	3.31	948	3.69	974	4.10	1001

MSZ-HJ35VA: MUZ-HJ35VA

CAPACITY: 3.6 kW INPUT: 995 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.27	647	2.74	776	3.20	876	3.67	945	4.14	1005	4.57	1035	5.04	1055
21	2.16	697	2.59	826	3.06	915	3.49	985	3.96	1035	4.39	1065	4.84	1104
26	1.94	746	2.41	876	2.84	965	3.31	1035	3.78	1085	4.21	1114	4.68	1144

MSZ-HJ50VA: MUZ-HJ50VA

CAPACITY: 5.4 kW INPUT: 1480 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.40	962	4.10	1154	4.81	1302	5.51	1406	6.21	1495	6.86	1539	7.56	1569
21	3.24	1036	3.89	1228	4.59	1362	5.24	1465	5.94	1539	6.59	1584	7.26	1643
26	2.92	1110	3.62	1302	4.27	1436	4.97	1539	5.67	1613	6.32	1658	7.02	1702

MSZ-HJ60VA: MUZ-HJ60VA

CAPACITY: 6.8 kW INPUT: 1970 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	4.28	1281	5.17	1537	6.05	1734	6.94	1872	7.82	1990	8.64	2049	9.52	2088
21	4.08	1379	4.90	1635	5.78	1812	6.60	1950	7.48	2049	8.30	2108	9.15	2187
26	3.67	1478	4.56	1734	5.37	1911	6.26	2049	7.14	2147	7.96	2206	8.84	2266

MSZ-HJ71VA: MUZ-HJ71VA

CAPACITY: 8.1 kW INPUT: 2440 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	5.10	1586	6.16	1903	7.21	2147	8.26	2318	9.32	2464	10.29	2538	11.34	2586
21	4.86	1708	5.83	2025	6.89	2245	7.86	2416	8.91	2538	9.88	2611	10.89	2708
26	4.37	1830	5.43	2147	6.40	2367	7.45	2538	8.51	2660	9.48	2733	10.53	2806

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature

C.1.7 NOISE CRITERIA CURVES


C.1.7.1 Indoor Unit

MSZ-LN18VGW
MSZ-LN18VGV
MSZ-LN25VGW
MSZ-LN25VGV

MSZ-LN18VGB
MSZ-LN18VGR
MSZ-LN25VGB
MSZ-LN25VGR

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	45	○—○

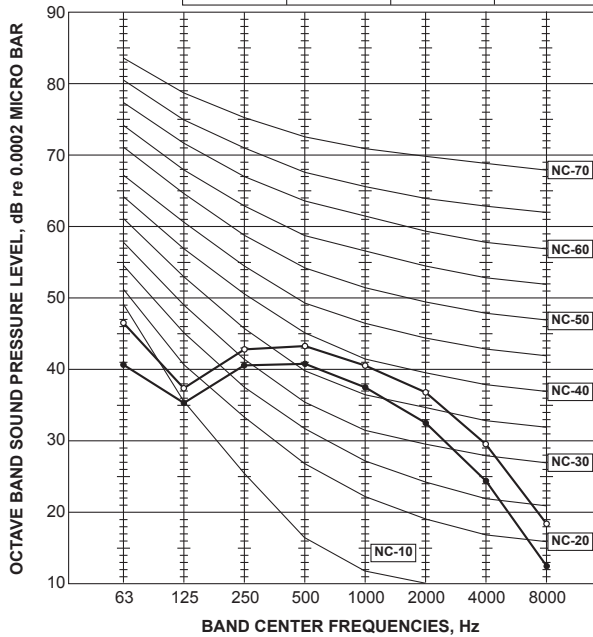


MSZ-LN35VGW
MSZ-LN35VGV

MSZ-LN35VGB
MSZ-LN35VGR

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	43	●—●
	HEATING	45	○—○

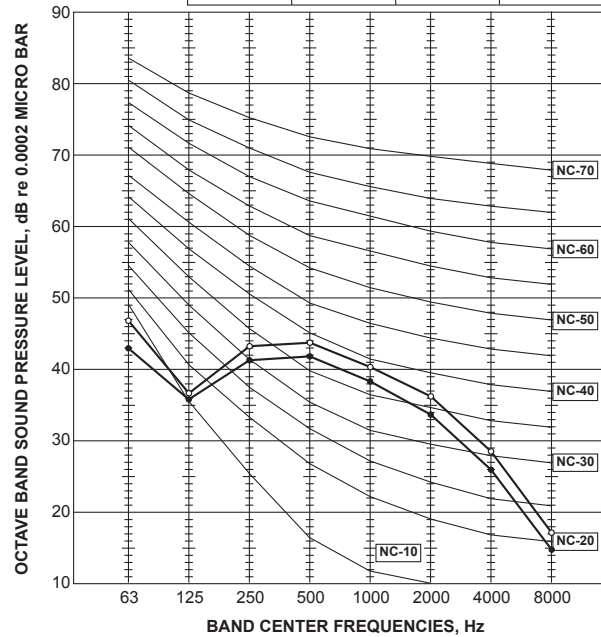


MSZ-LN50VGW
MSZ-LN50VGV

MSZ-LN50VGB
MSZ-LN50VGR

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	46	●—●
	HEATING	47	○—○

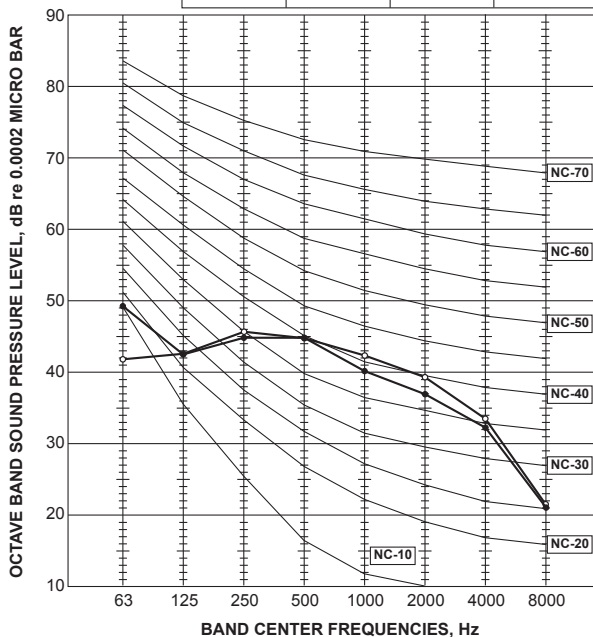


MSZ-LN60VGW
MSZ-LN60VGV

MSZ-LN60VGB
MSZ-LN60VGR

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	49	●—●
	HEATING	49	○—○

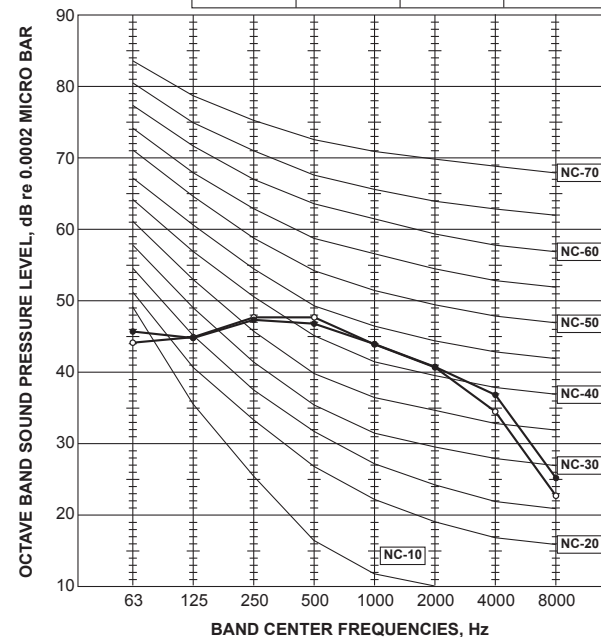


NOISE CRITERIA CURVES WALL-MOUNTED

MSZ-AP15VG

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	40	●—●
	HEATING	40	○—○

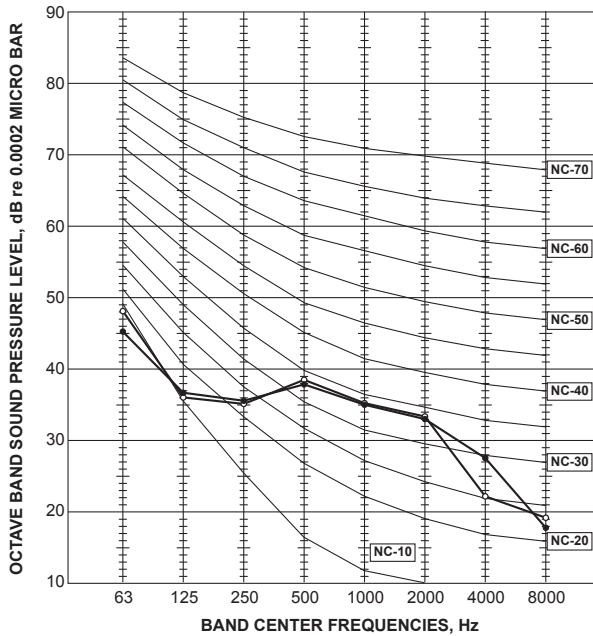

MSZ-AP20VG

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	42	○—○

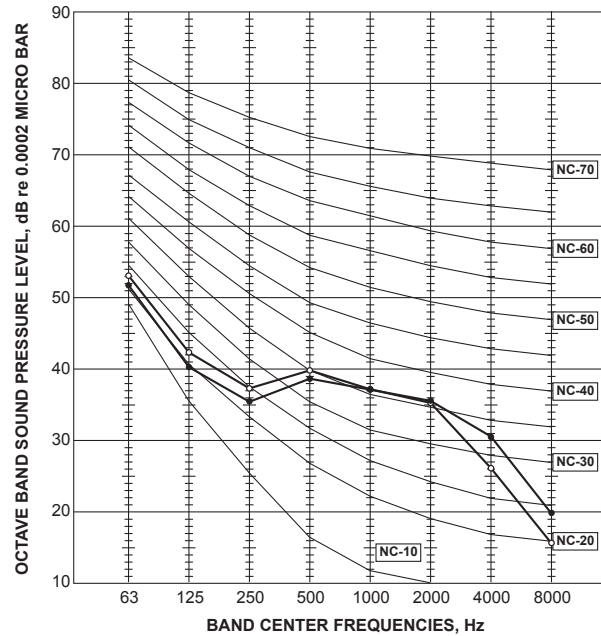

MSZ-AP25VG MSZ-AP25VGK

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	45	○—○

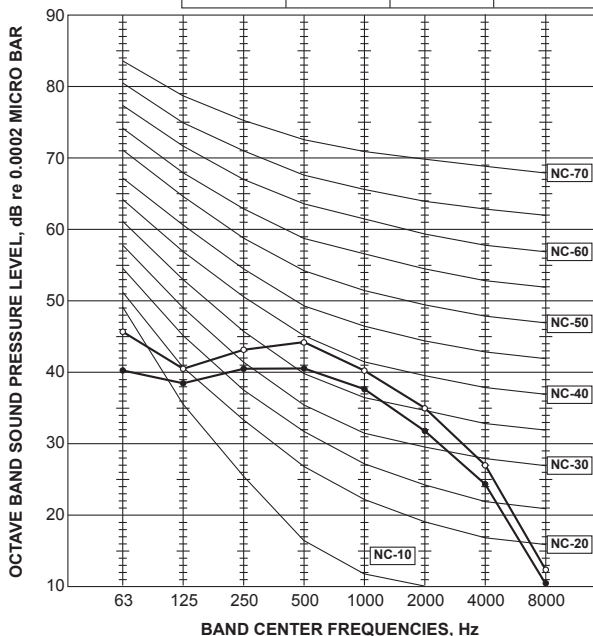

MSZ-AP35VG MSZ-AP35VGK

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	45	○—○

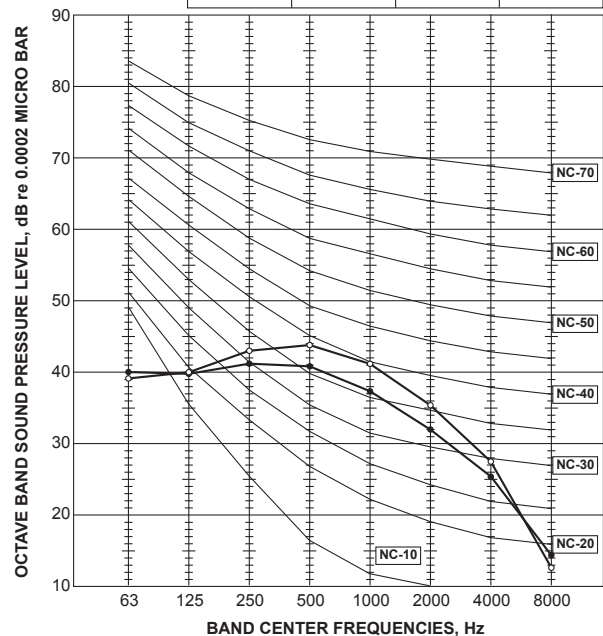

MSZ-AP42VG MSZ-AP42VGK

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	45	○—○

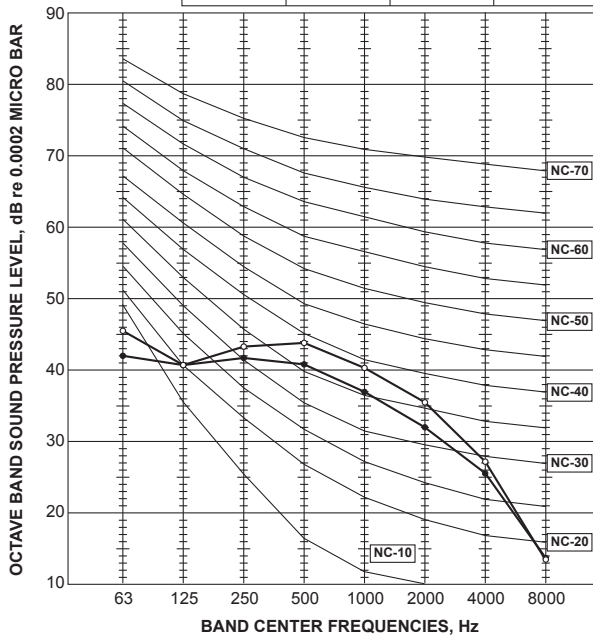

MSZ-AP50VG MSZ-AP50VGK

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	44	●—●
	HEATING	48	○—○

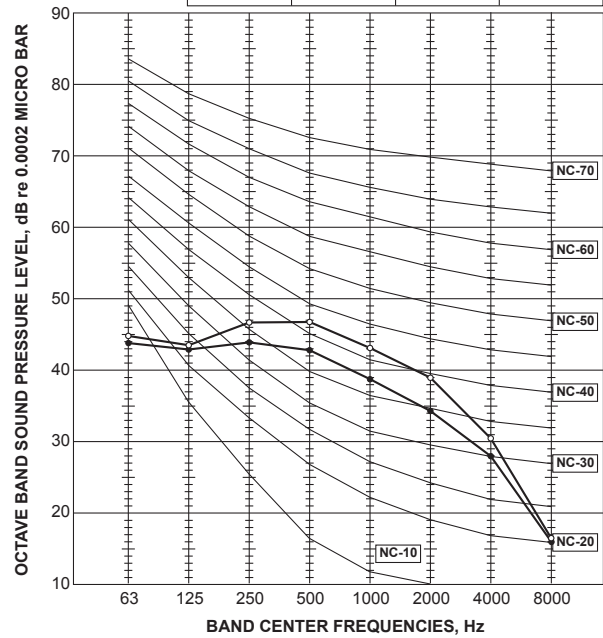

MSZ-AP60VG MSZ-AP60VGK

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	48	●—●
	HEATING	48	○—○

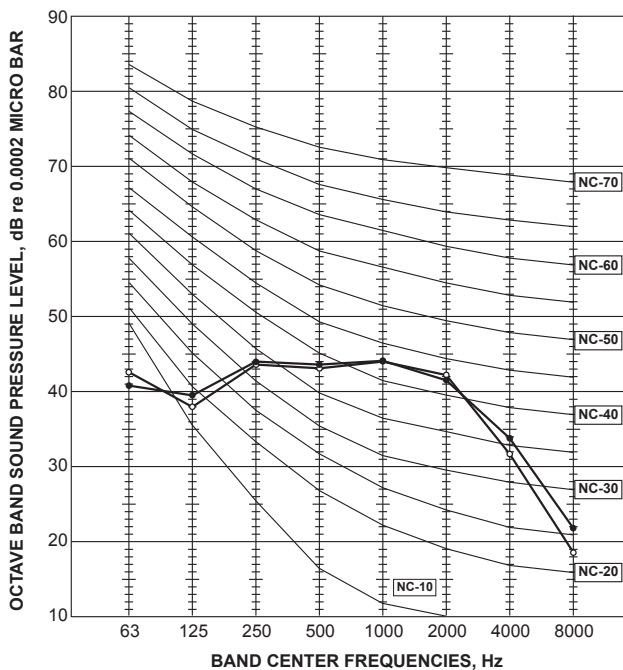

MSZ-AP71VG MSZ-AP71VGK

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	49	●—●
	HEATING	51	○—○

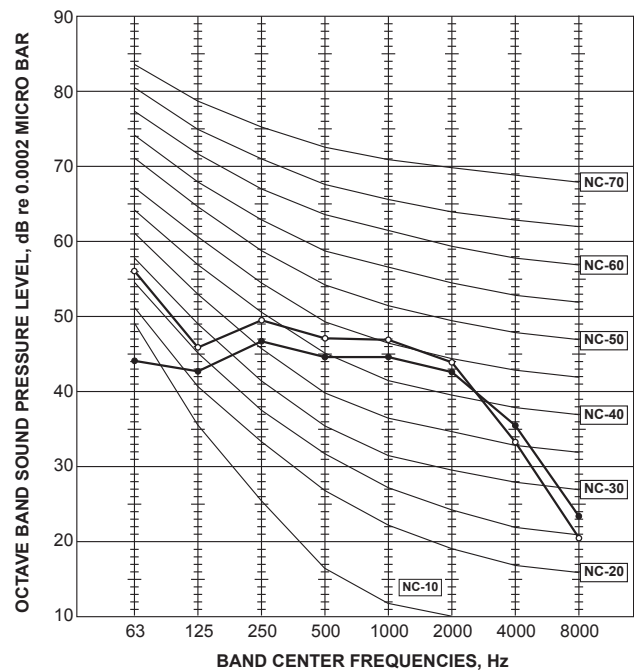


NOISE CRITERIA CURVES WALL-MOUNTED

MSZ-HR25VF

INDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	43	●—●
HEATING	43	○—○

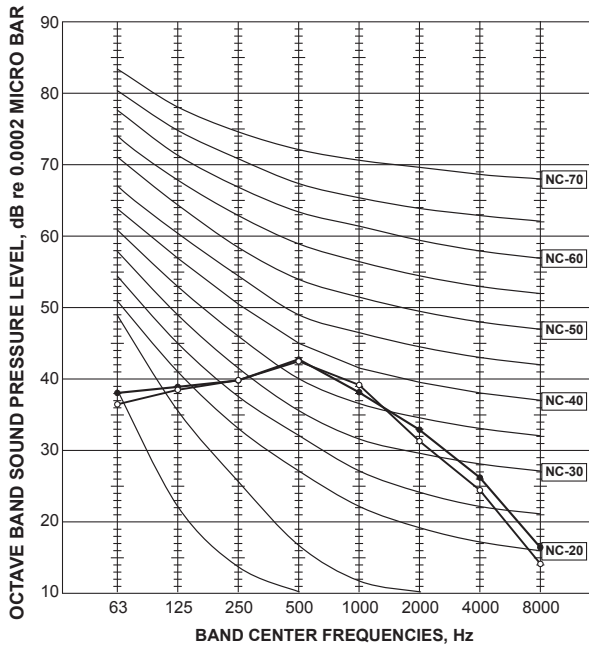

MSZ-HR35VF

INDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	46	●—●
HEATING	44	○—○

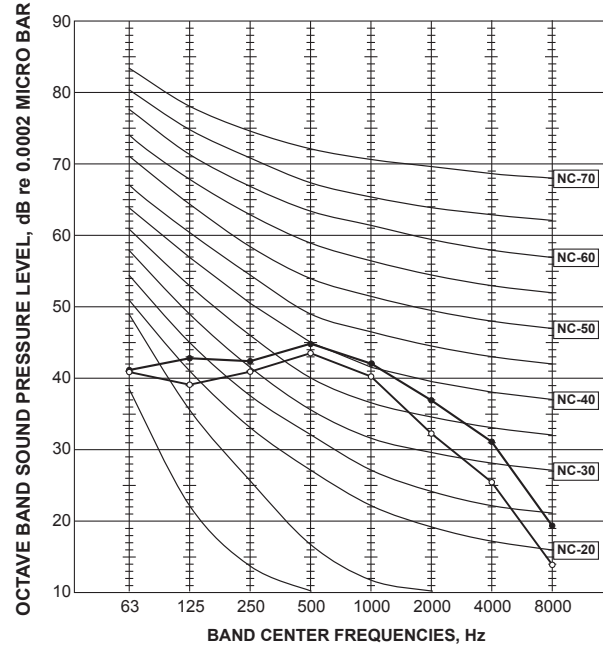

MSZ-HR42VF

INDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	45	●—●
HEATING	46	○—○

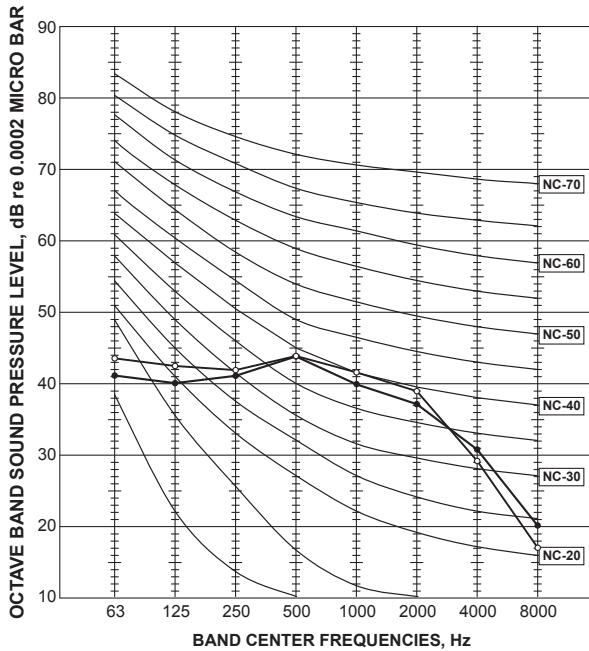

MSZ-HR50VF

INDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	45	●—●
HEATING	47	○—○

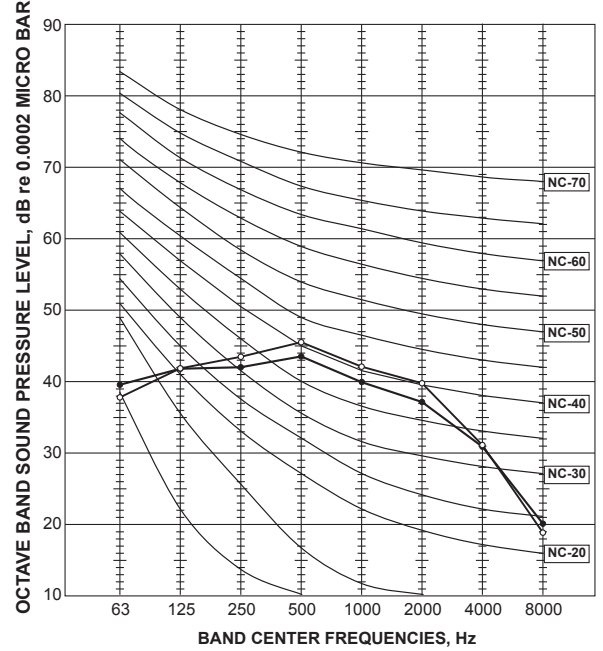

MSY-TP35VF

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	45	●—●

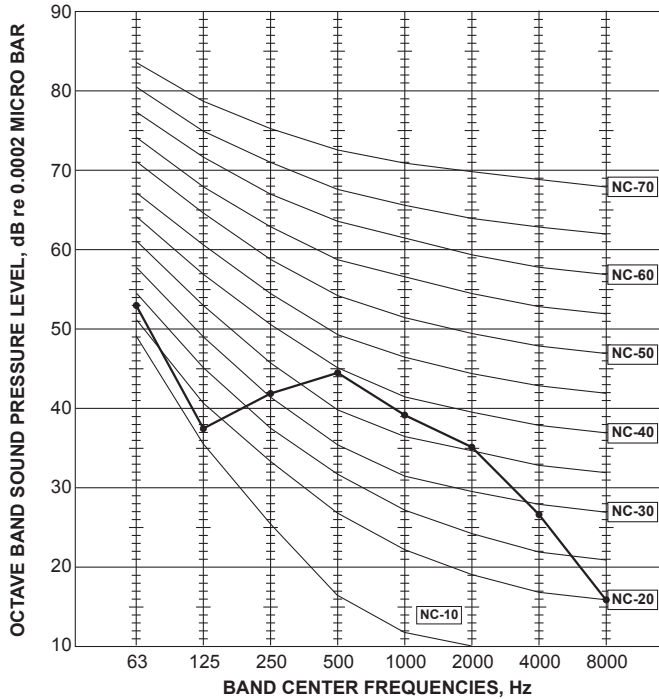

MSY-TP50VF

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	45	●—●

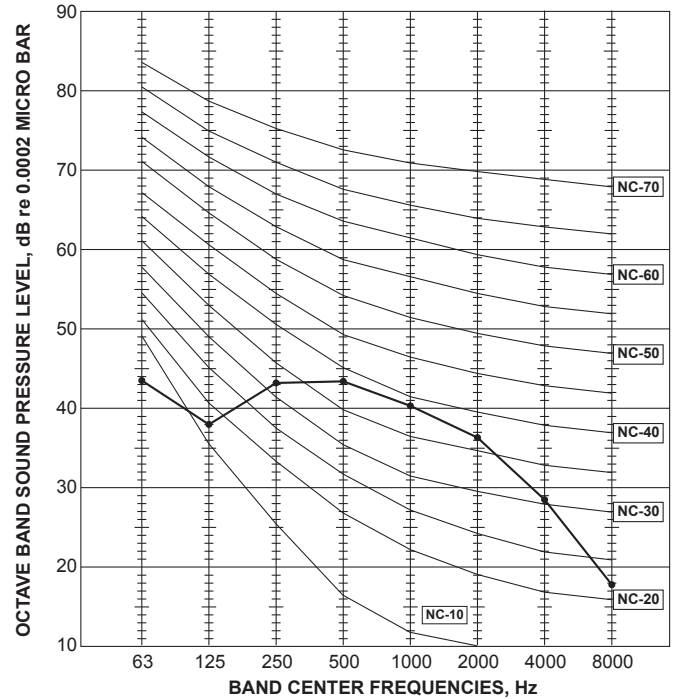

MSZ-FH25VE2 MSZ-FH35VE2

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	44	○—○

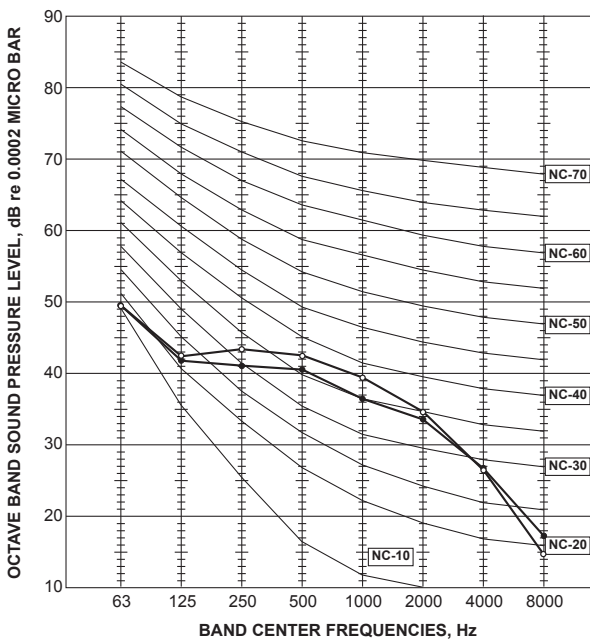

MSZ-FH50VE2

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	44	●—●
	HEATING	46	○—○

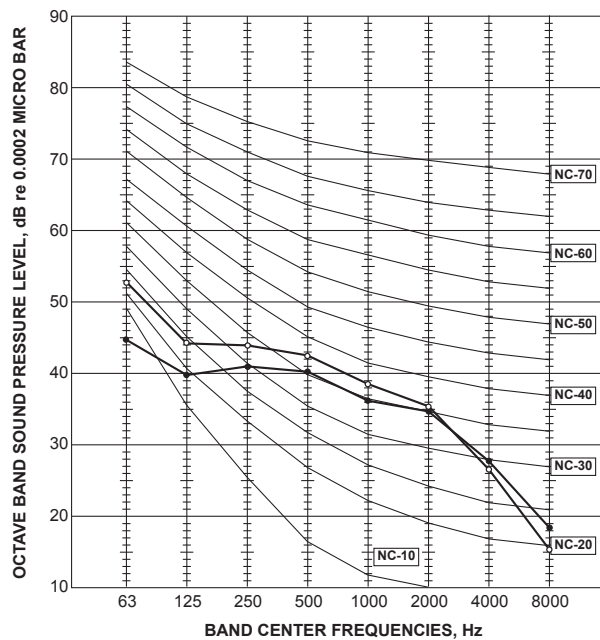


NOISE CRITERIA CURVES WALL-MOUNTED

MSZ-EF18VGW MSZ-EF22VGW MSZ-EF25VGW
 MSZ-EF18VGB MSZ-EF22VGB MSZ-EF25VGB
 MSZ-EF18VGS MSZ-EF22VGS MSZ-EF25VGS

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	45	○—○

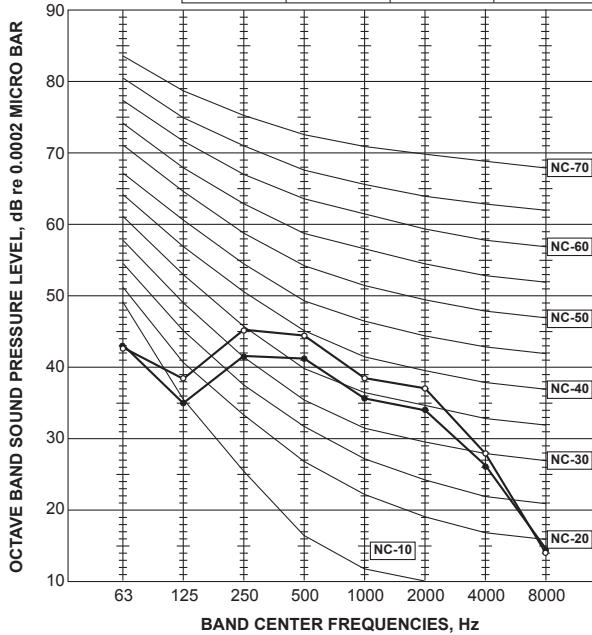

MSZ-EF35VGW
 MSZ-EF35VGB
 MSZ-EF35VGS

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	46	○—○

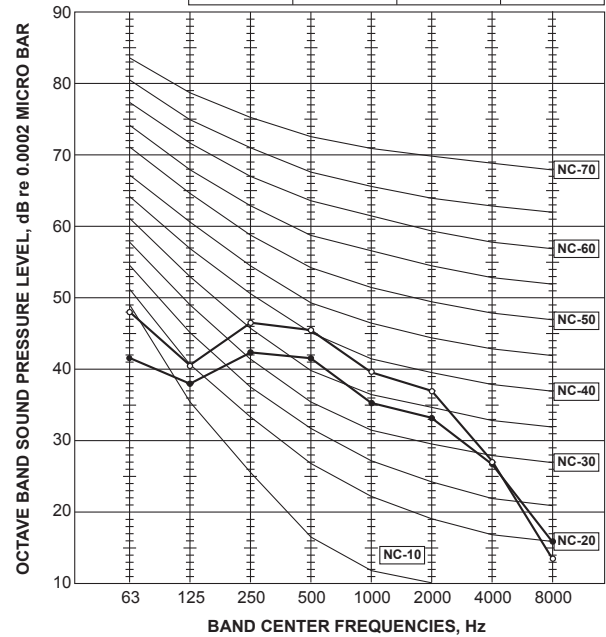

MSZ-EF42VGW
 MSZ-EF42VGB
 MSZ-EF42VGS

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	43	●—●
	HEATING	48	○—○

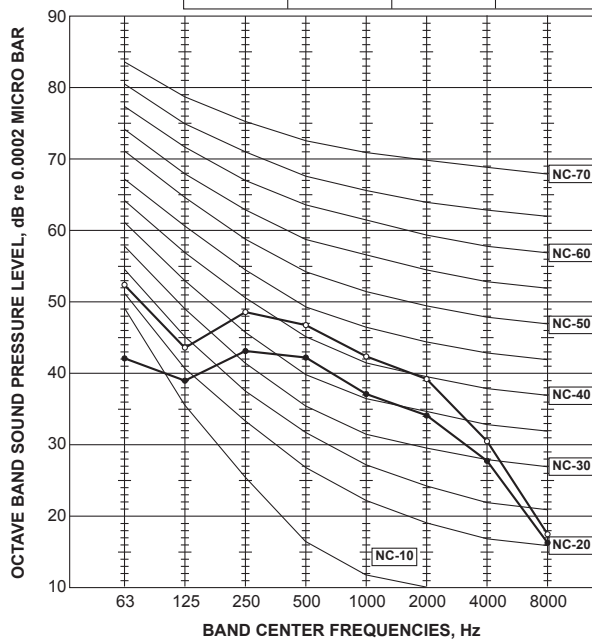

MSZ-EF50VGW
 MSZ-EF50VGB
 MSZ-EF50VGS

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	43	●—●
	HEATING	49	○—○

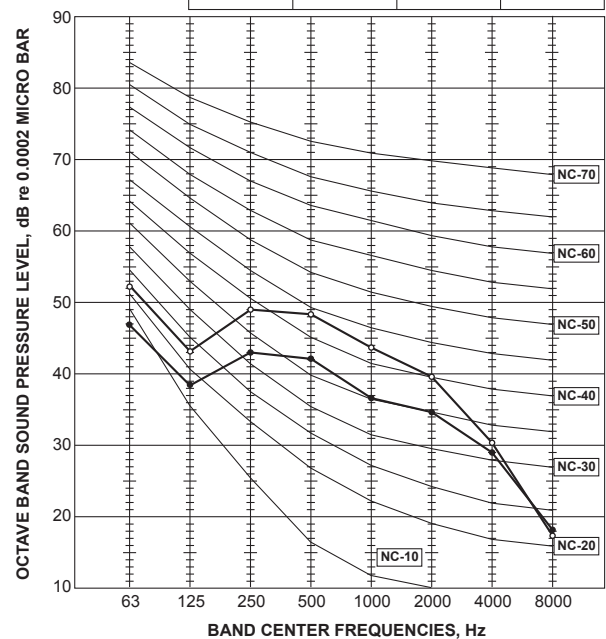

MSZ-SF15VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	40	●—●
	HEATING	40	○—○

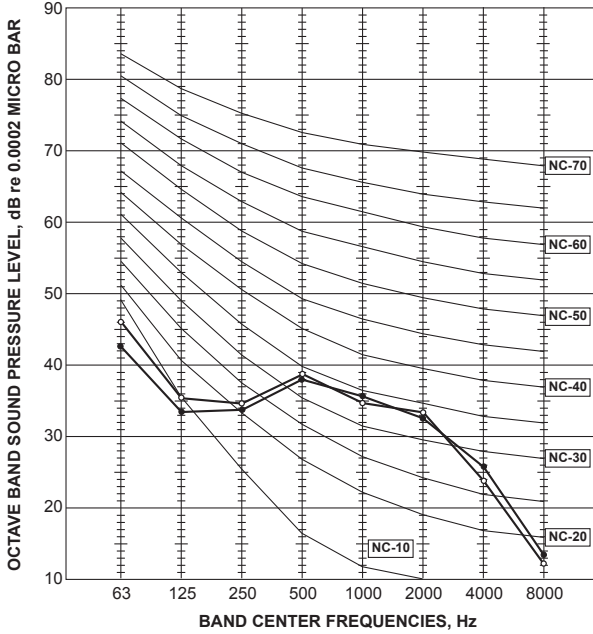

MSZ-SF20VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	42	○—○

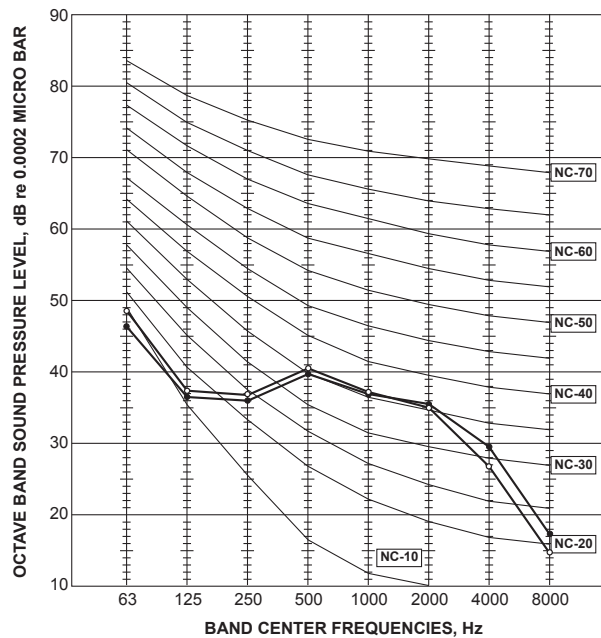

MSZ-SF25VE3

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	45	○—○

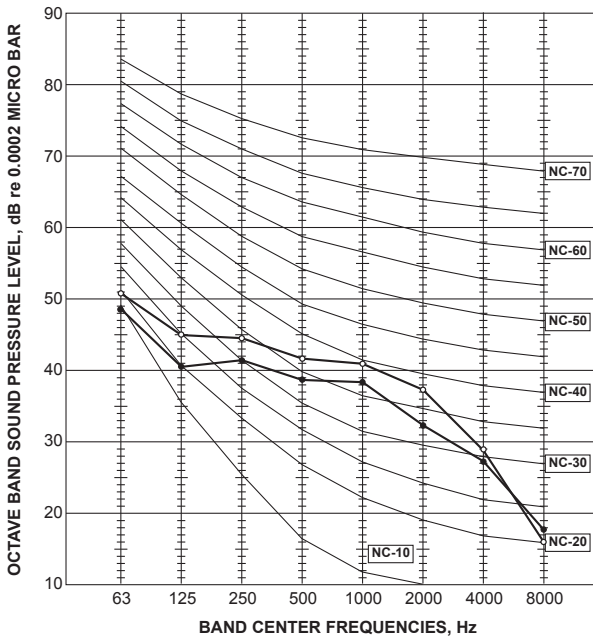

MSZ-SF35VE3

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	46	○—○

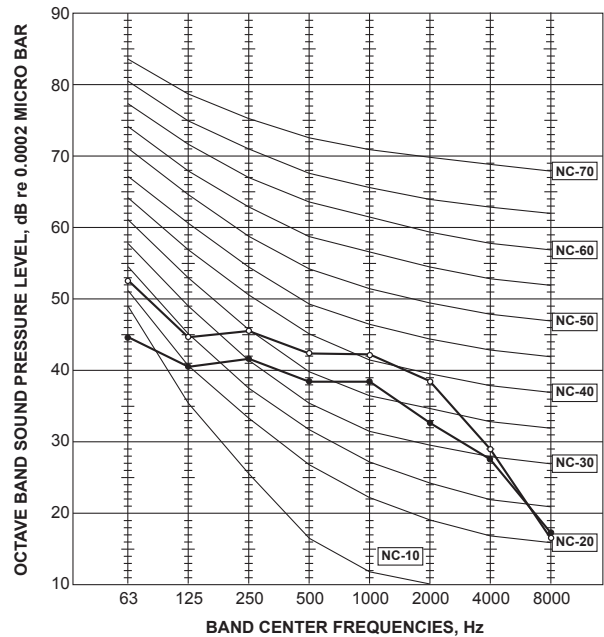


NOISE CRITERIA CURVES WALL-MOUNTED

MSZ-SF42VE3

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	42	●—●
	HEATING	47	○—○

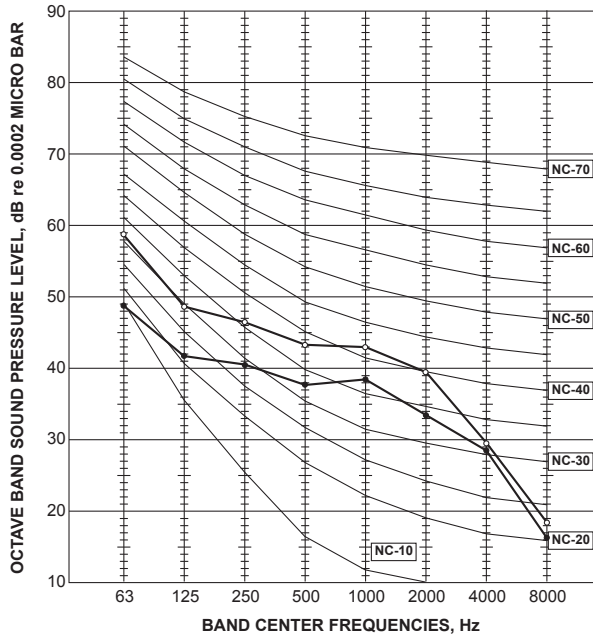

MSZ-SF50VE3

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	45	●—●
	HEATING	49	○—○

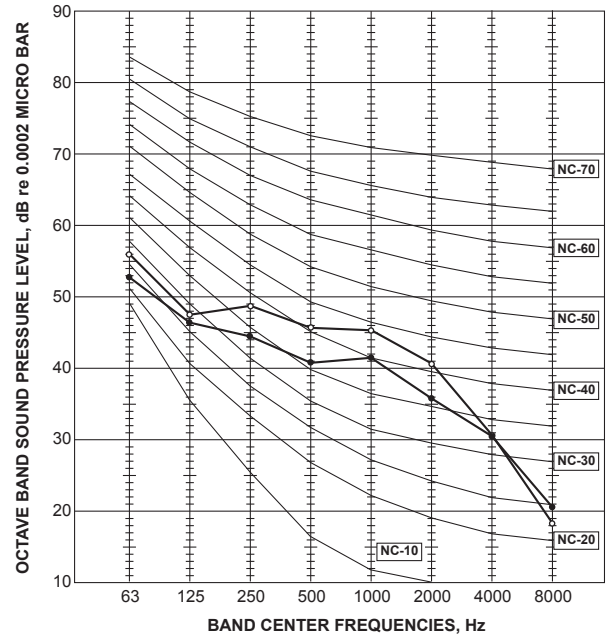

MSZ-GF60VE2

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	49	●—●
	HEATING	49	○—○

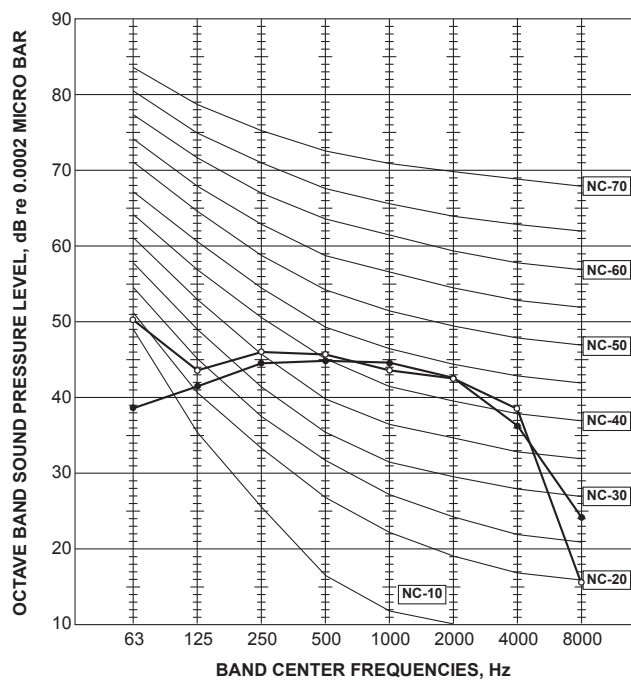

MSZ-GF71VE2

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	49	●—●
	HEATING	49	○—○

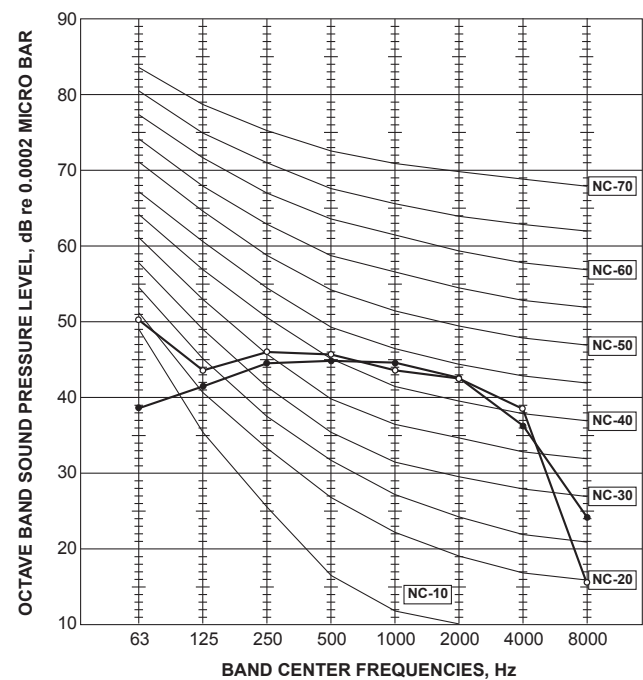


WALL-MOUNTED NOISE CRITERIA CURVES

MSZ-WN25VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	43	●—●
	HEATING	43	○—○

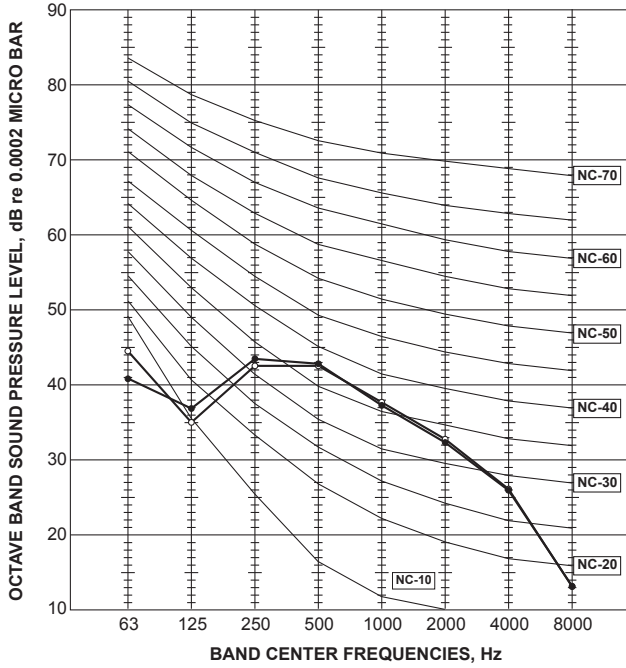

MSZ-WN35VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	46	●—●
	HEATING	44	○—○

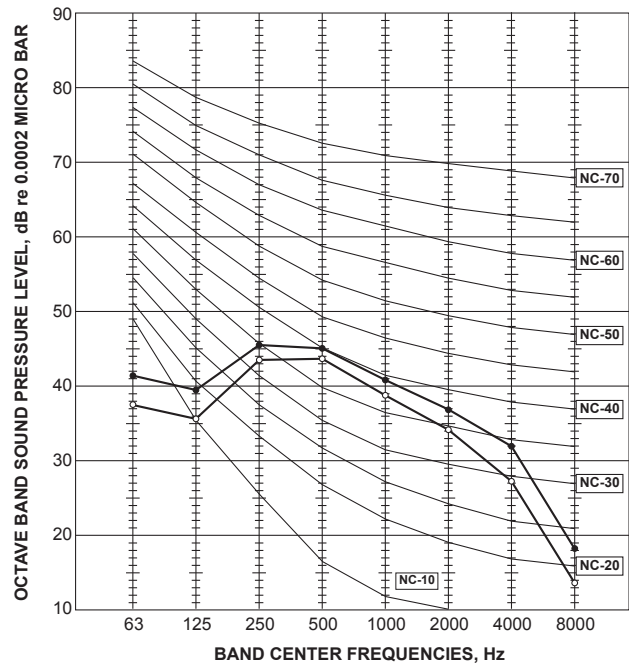

MSZ-DM25VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	43	●—●
	HEATING	43	○—○

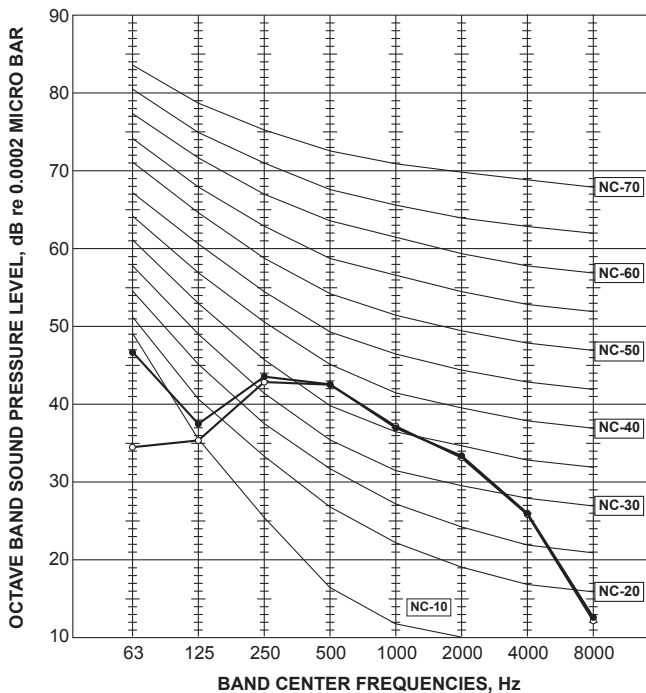

MSZ-DM35VA

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	45	●—●
	HEATING	44	○—○

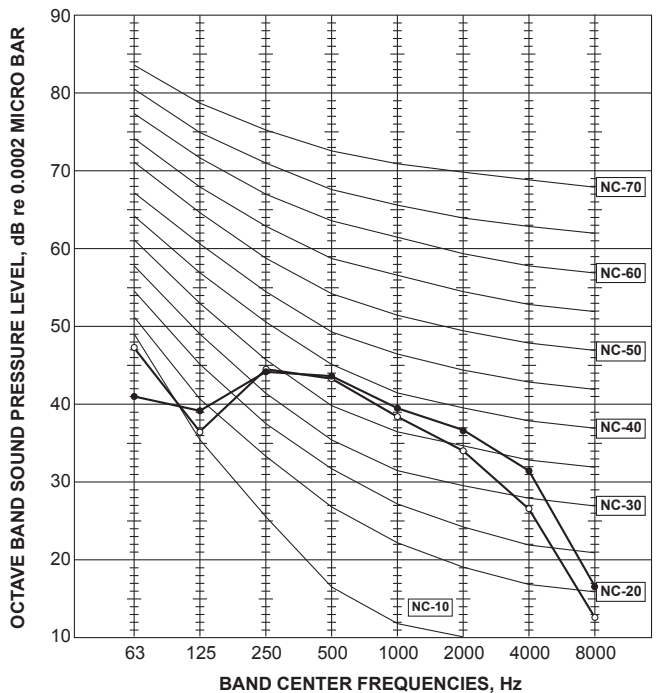


NOISE CRITERIA CURVES WALL-MOUNTED

MSZ-HJ25VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	43	●—●
	HEATING	43	○—○

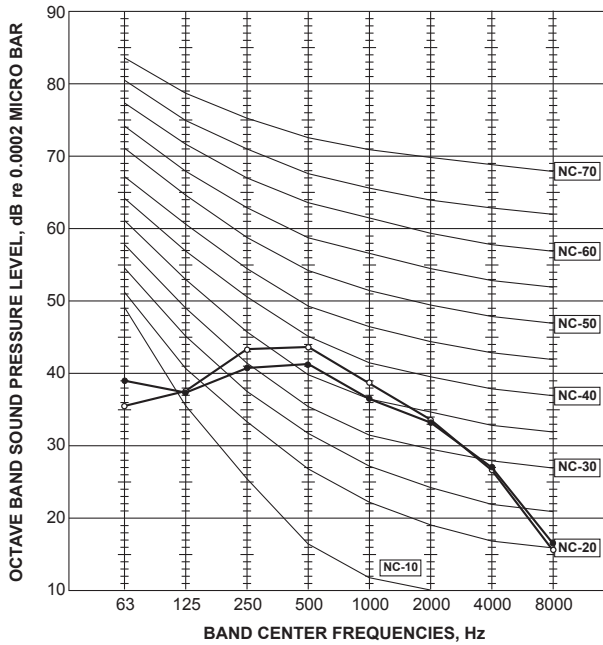

MSZ-HJ35VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	45	●—●
	HEATING	44	○—○

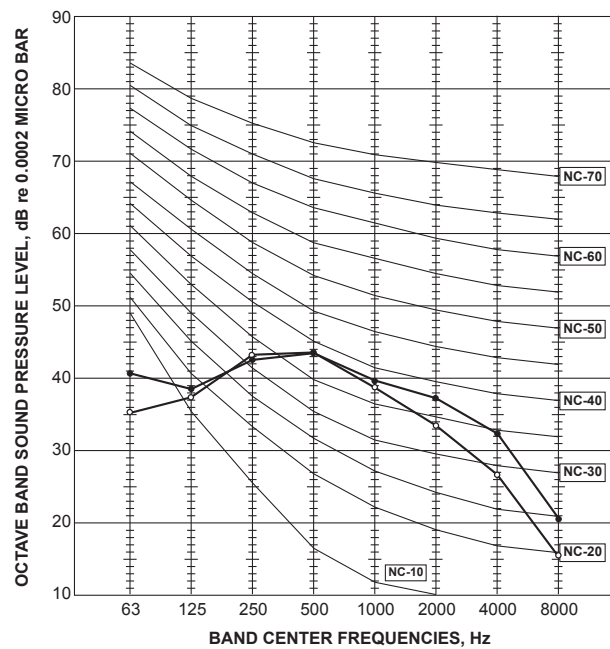

MSZ-HJ50VA

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	45	●—●
	HEATING	47	○—○

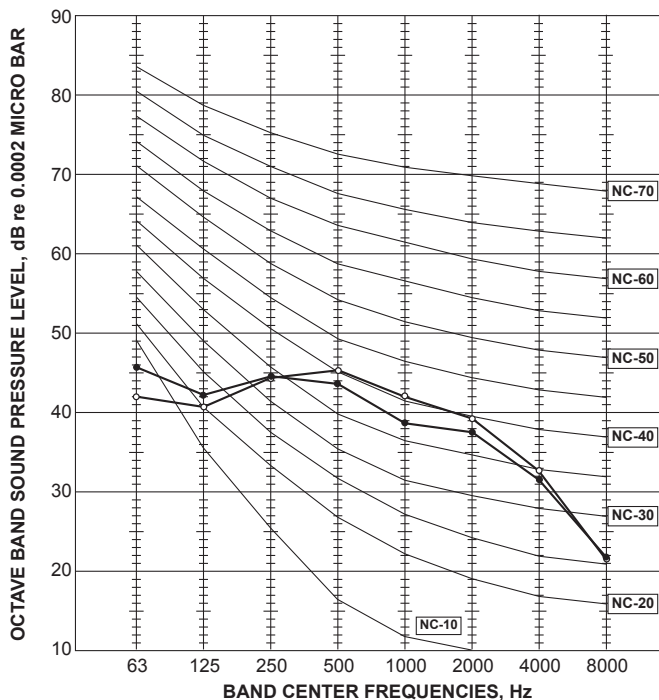

MSZ-HJ60VA

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	50	●—●
	HEATING	49	○—○

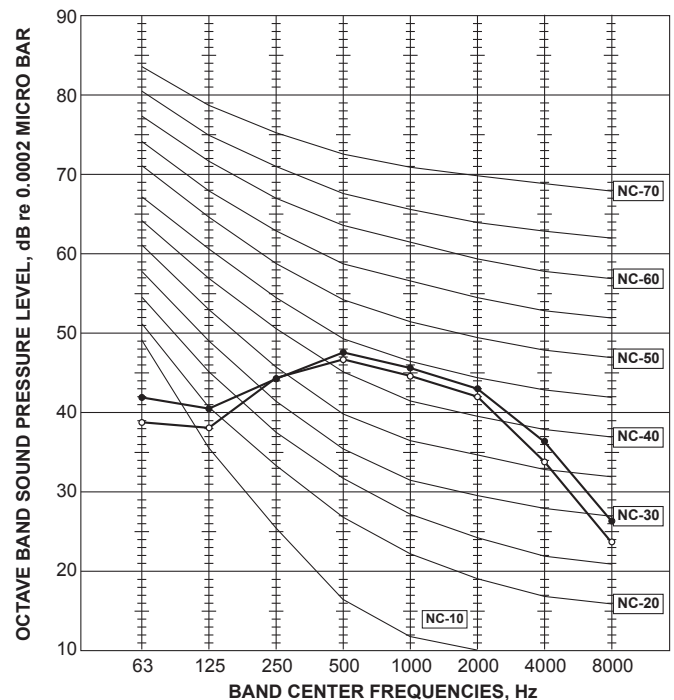



MSZ-HJ71VA

INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	50	●—●
	HEATING	49	○—○

Test conditions

Cooling: Dry-bulb temperature 27 °C Wet-bulb temperature 19 °C
 Heating: Dry-bulb temperature 20 °C (MSZ)

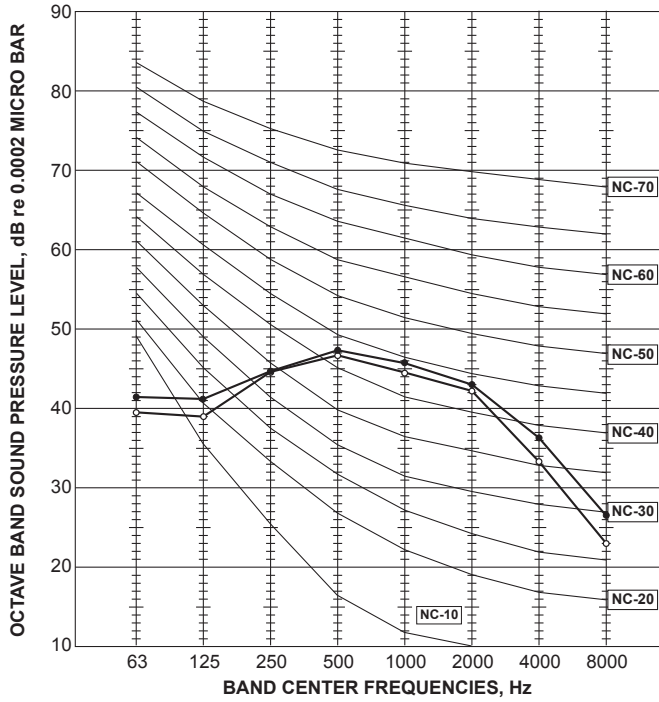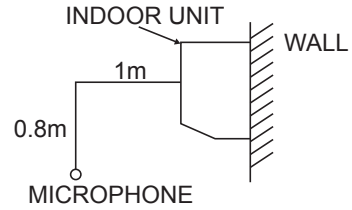


NOISE CRITERIA CURVES WALL-MOUNTED

C.1.7.2 Outdoor Unit
MUZ-LN25VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	46	●—●
HEATING	49	○—○

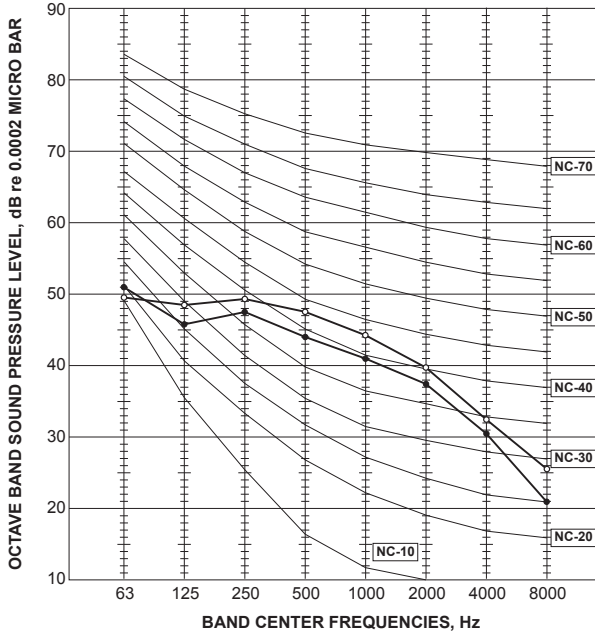

MUZ-LN35VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

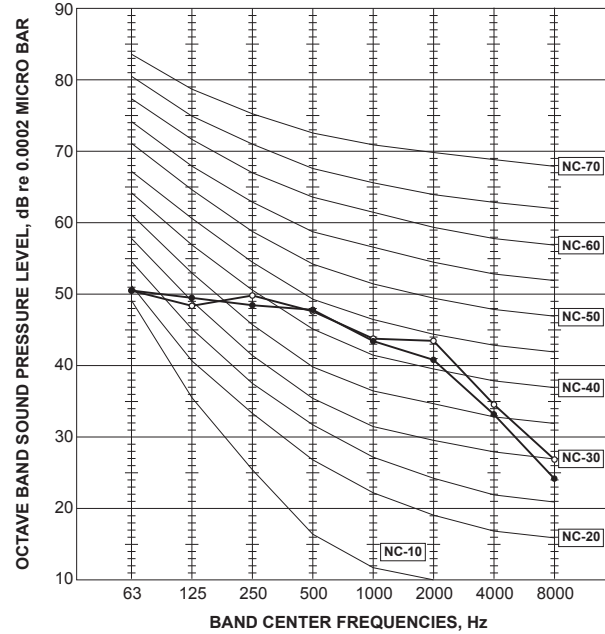

MUZ-LN50VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	51	●—●
HEATING	54	○—○

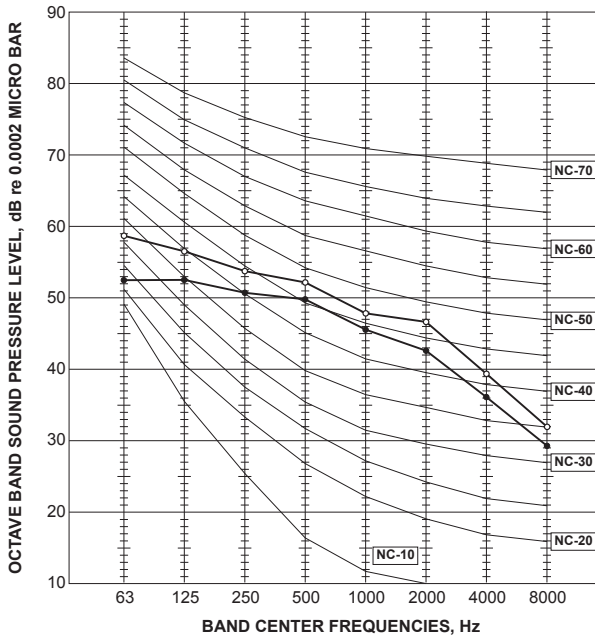

MUZ-LN60VG

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	55	●—●
HEATING	55	○—○

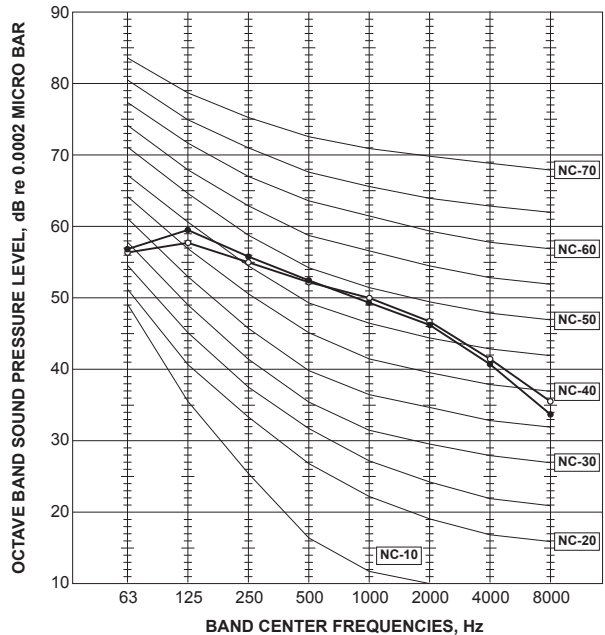


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-LN25VGHZ

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	46	●—●
HEATING	49	○—○

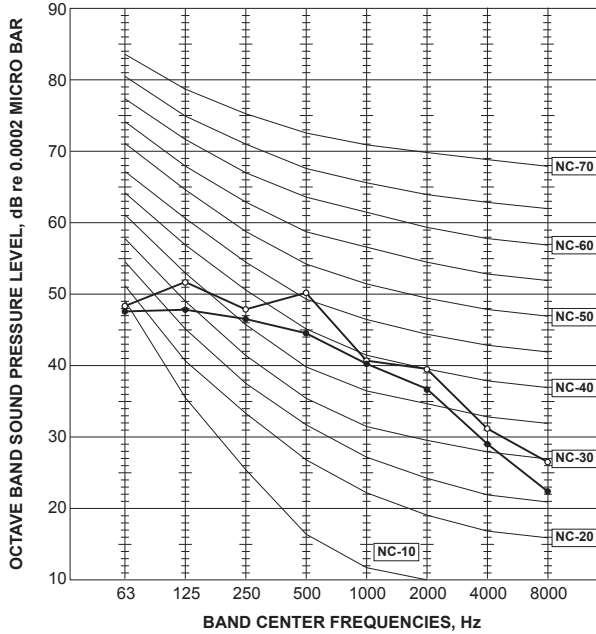

MUZ-LN35VGHZ

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

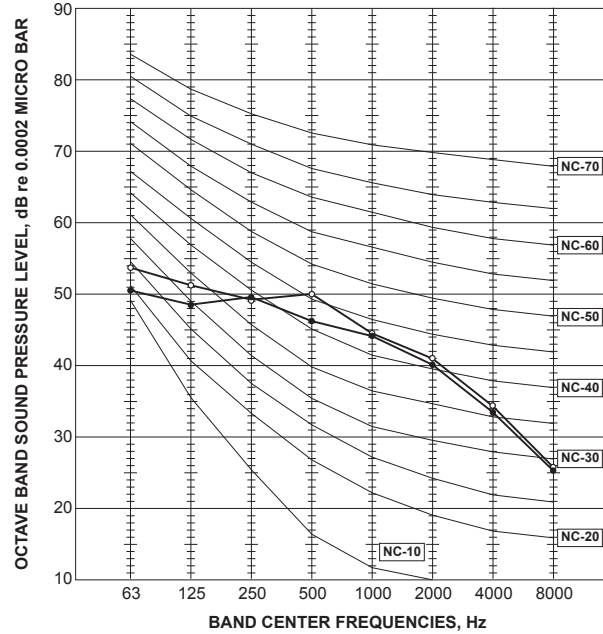

MUZ-LN50VGHZ

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	51	●—●
HEATING	54	○—○

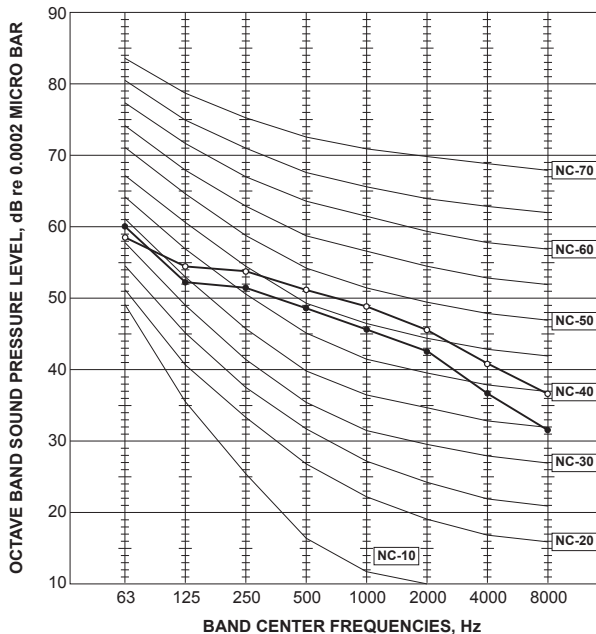

MUZ-AP20VG

OUTDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	47	●—●
	HEATING	48	○—○

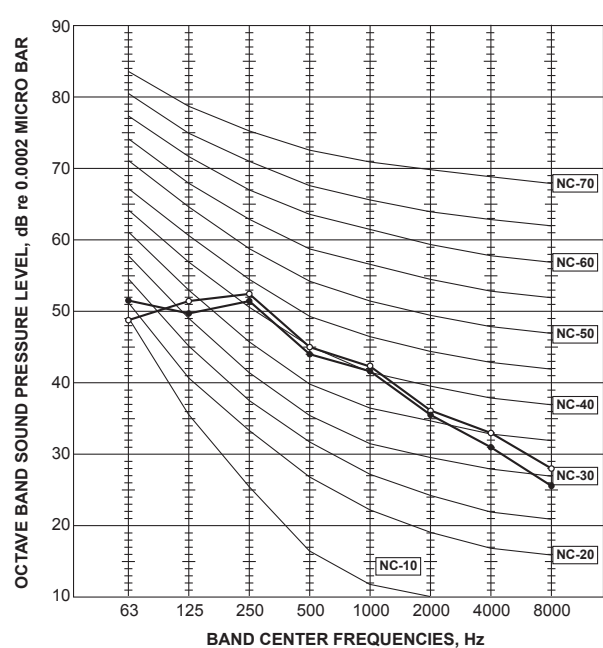


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-AP25VG MUZ-AP25VGH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	47	●—●
HEATING	48	○—○

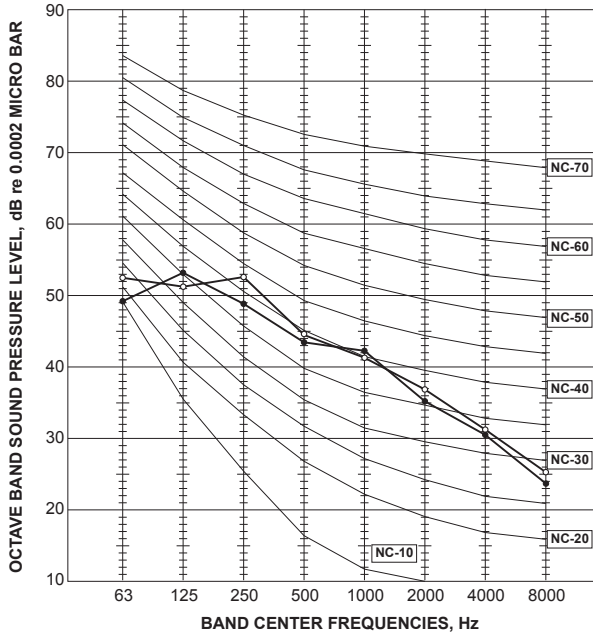

MUZ-AP35VG MUZ-AP35VGH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

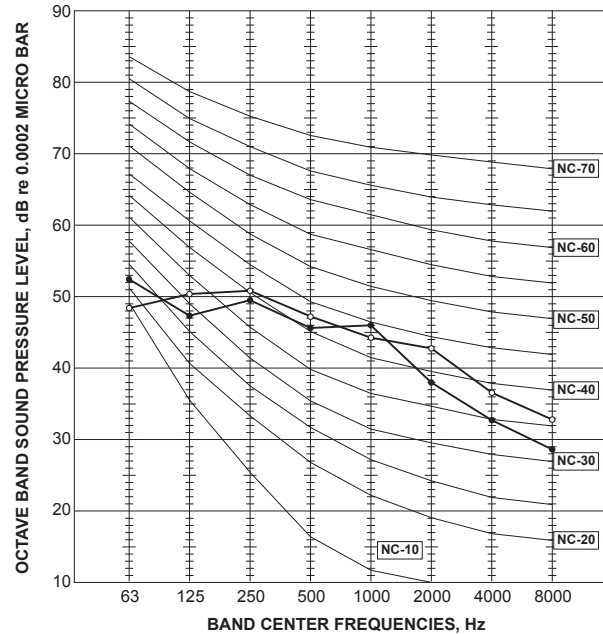

MUZ-AP42VG MUZ-AP42VGH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	51	○—○

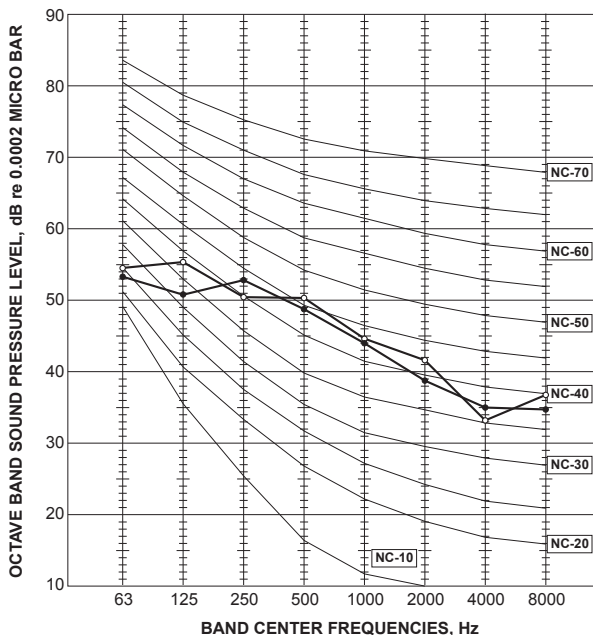

MUZ-AP50VG MUZ-AP50VGH

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	52	●—●
HEATING	52	○—○

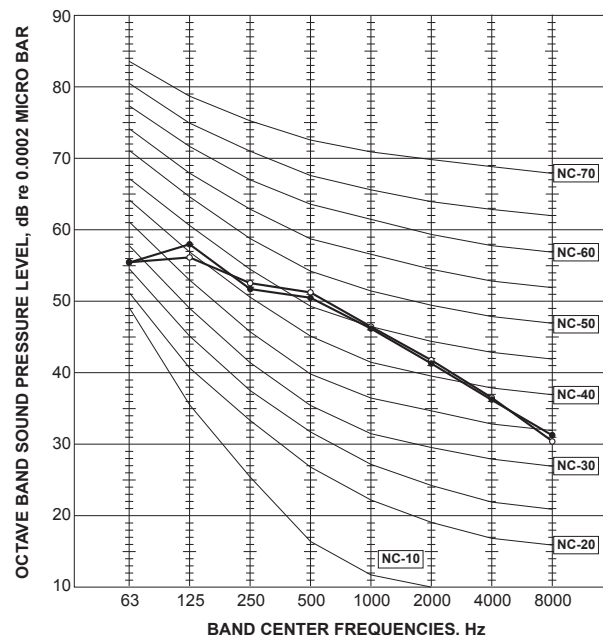


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-AP60VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	56	●—●
HEATING	57	○—○

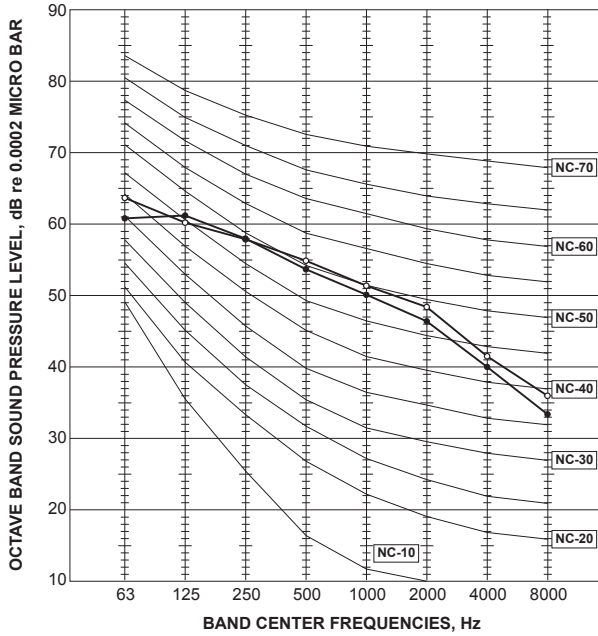

MUZ-AP71VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	56	●—●
HEATING	55	○—○

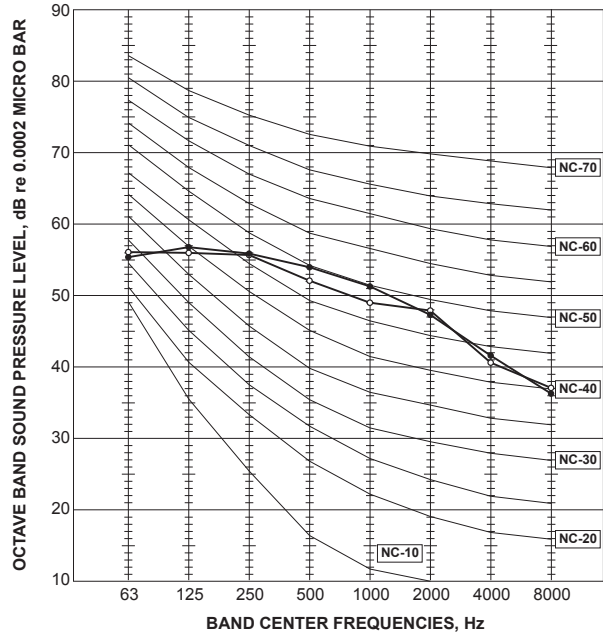

MUZ-HR25VF

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	50	○—○

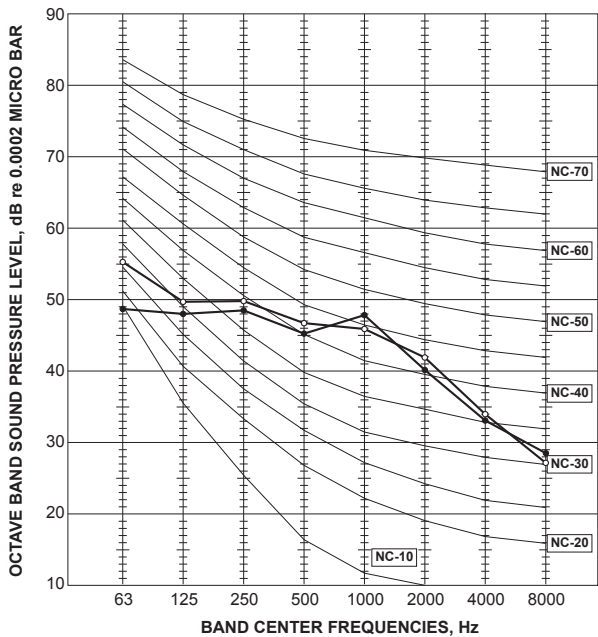

MUZ-HR35VF

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	51	●—●
HEATING	51	○—○

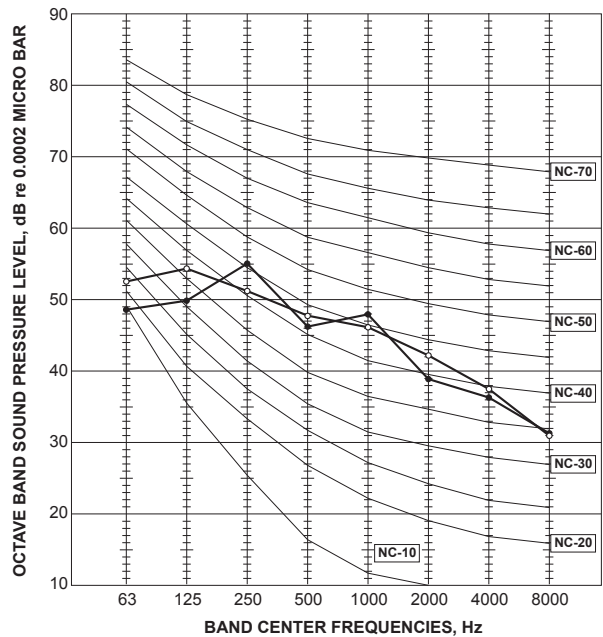


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-HR42VF

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	51	○—○

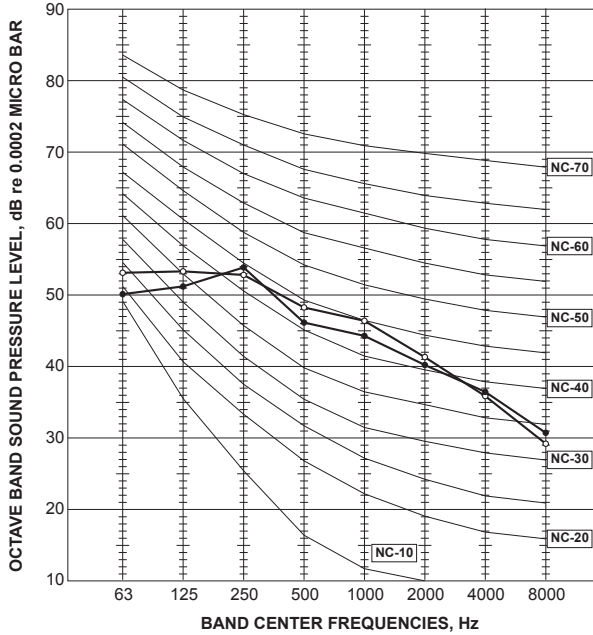

MUZ-HR50VF

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	51	○—○

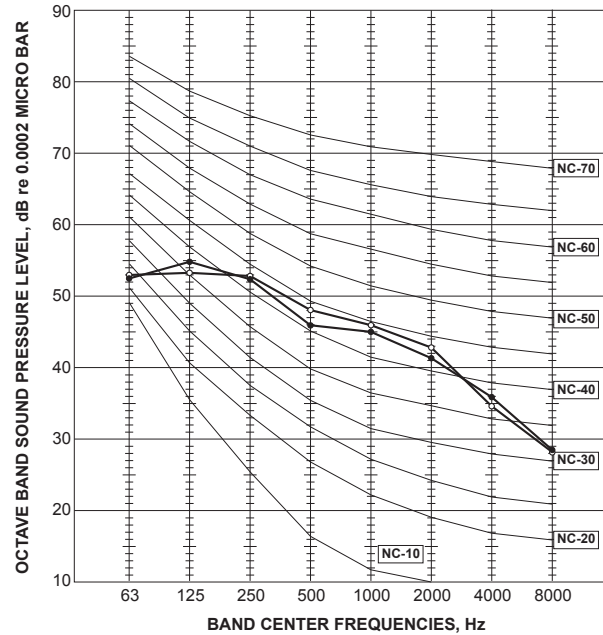

MUY-TP35VF

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	45	●—●

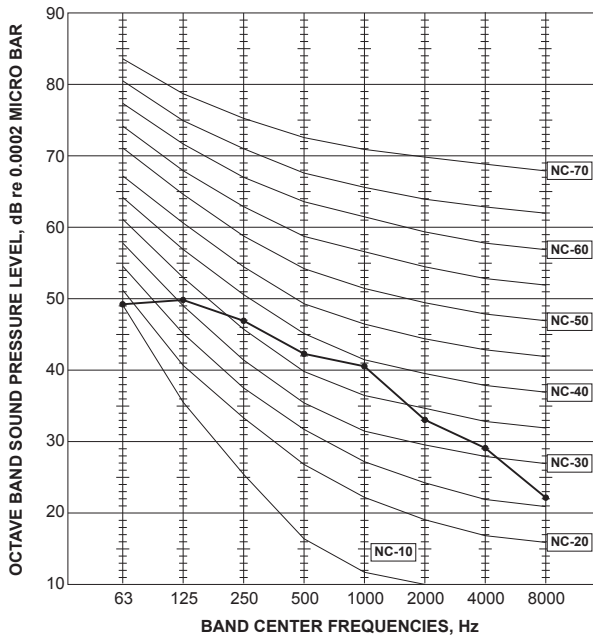

MUY-TP50VF

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	47	●—●

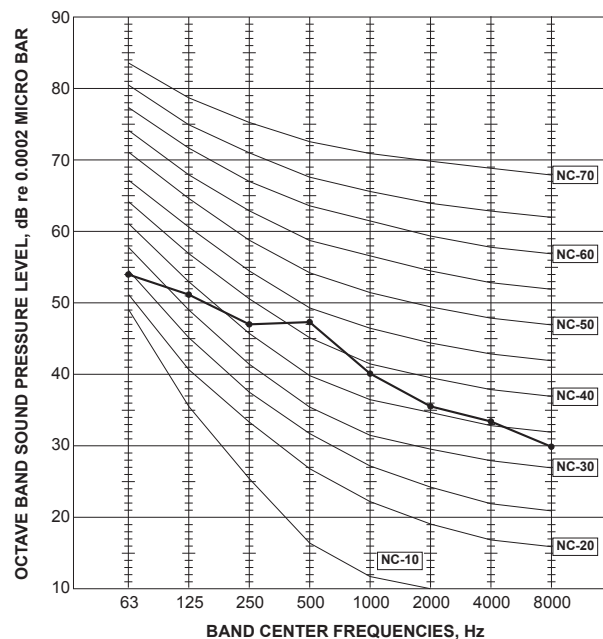


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-FH25VE

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	46	●—●
HEATING	49	○—○

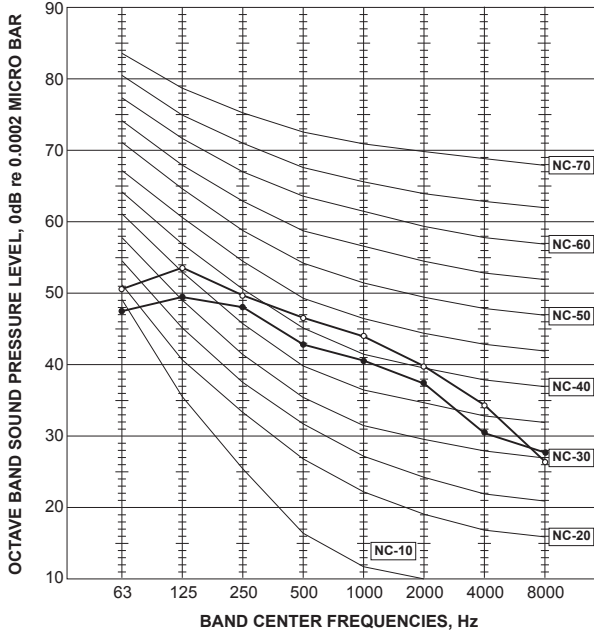

MUZ-FH35VE

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

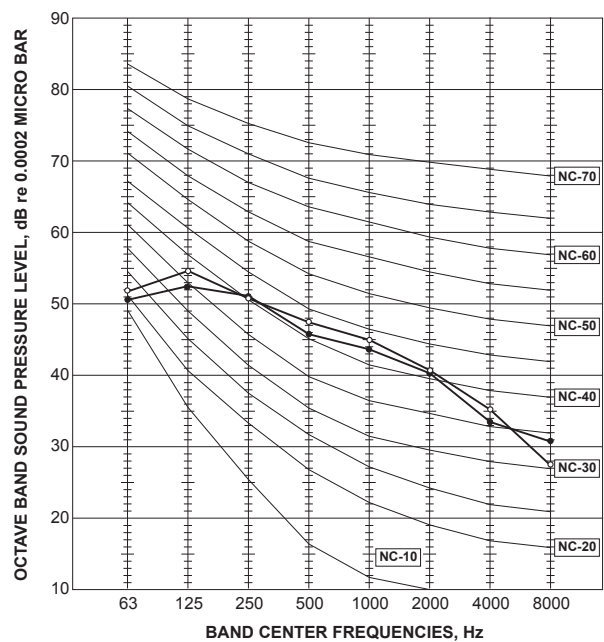

MUZ-FH50VE

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	51	●—●
HEATING	54	○—○

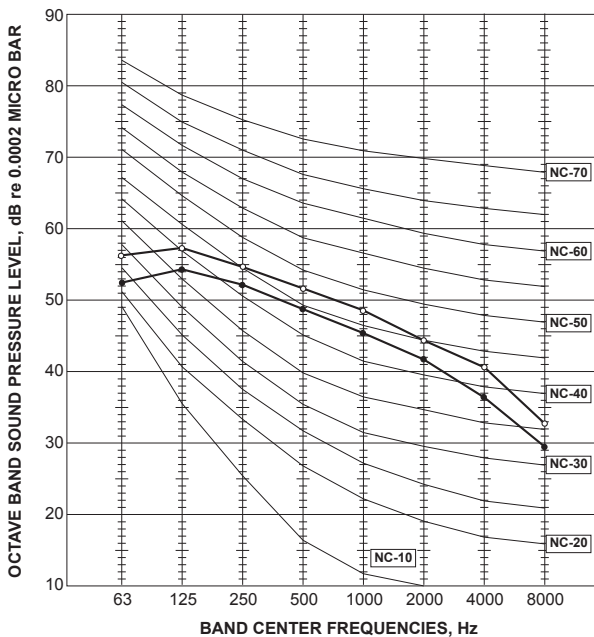

MUZ-FH25VEHZ

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	46	●—●
HEATING	49	○—○

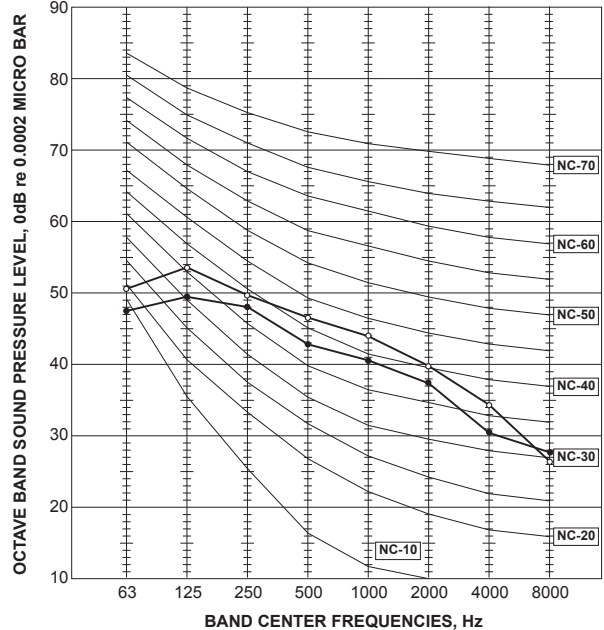


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-FH35VEHZ

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

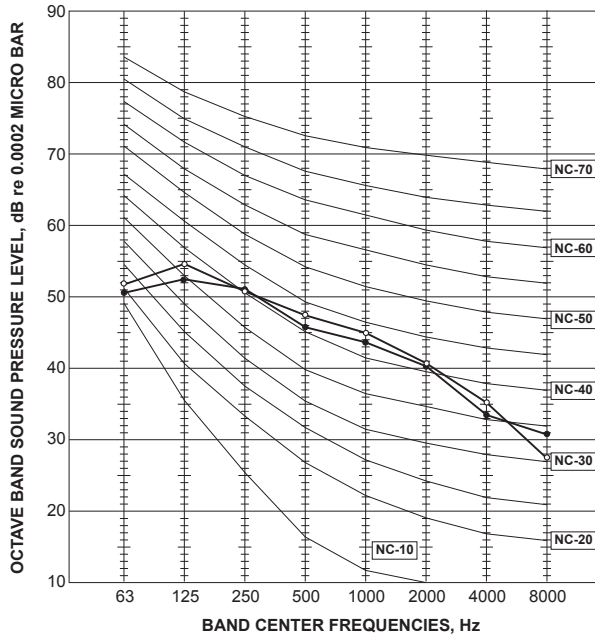

MUZ-FH50VEHZ

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	51	●—●
HEATING	54	○—○

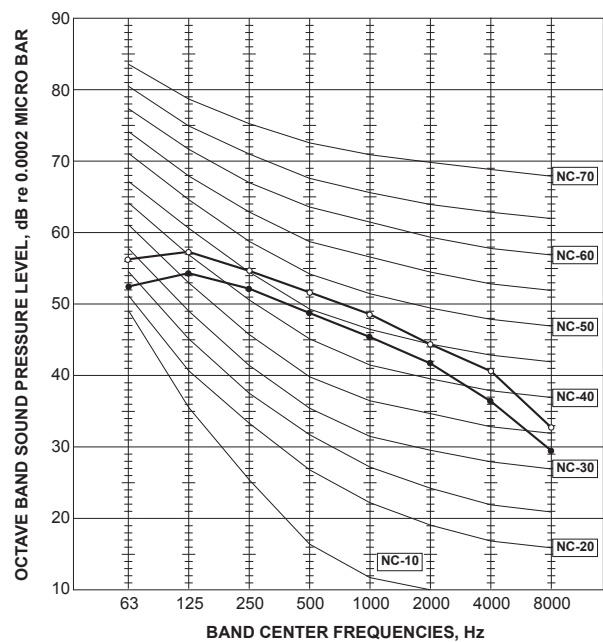

MUZ-EF25VG MUZ-EF25VGH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	47	●—●
HEATING	48	○—○

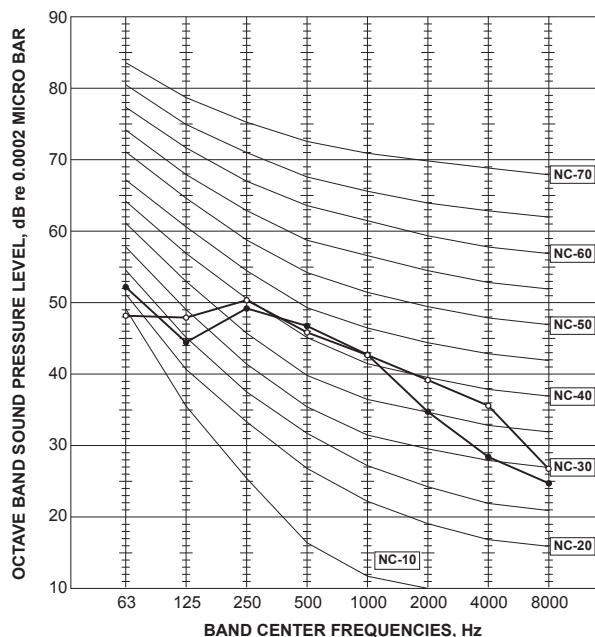

MUZ-EF35VG MUZ-EF35VGH

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

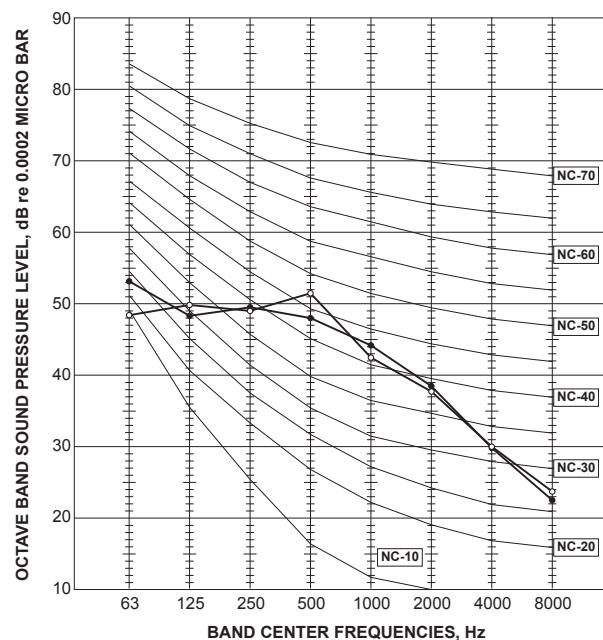


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-EF42VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	51	○—○

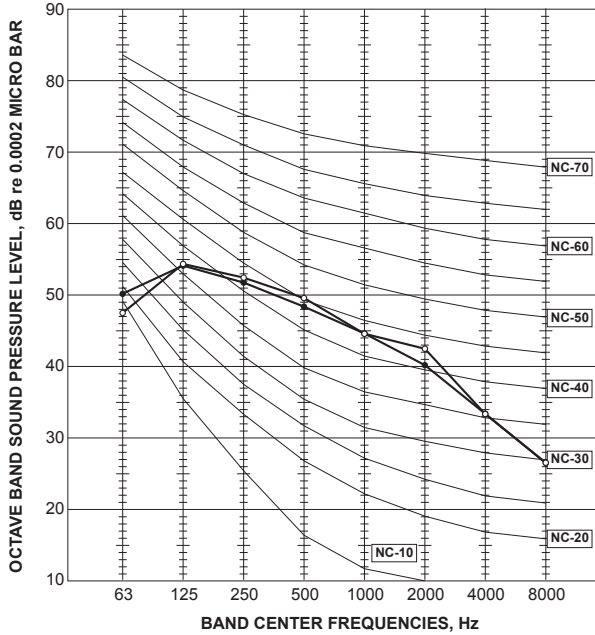

MUZ-EF50VG

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	52	●—●
HEATING	52	○—○

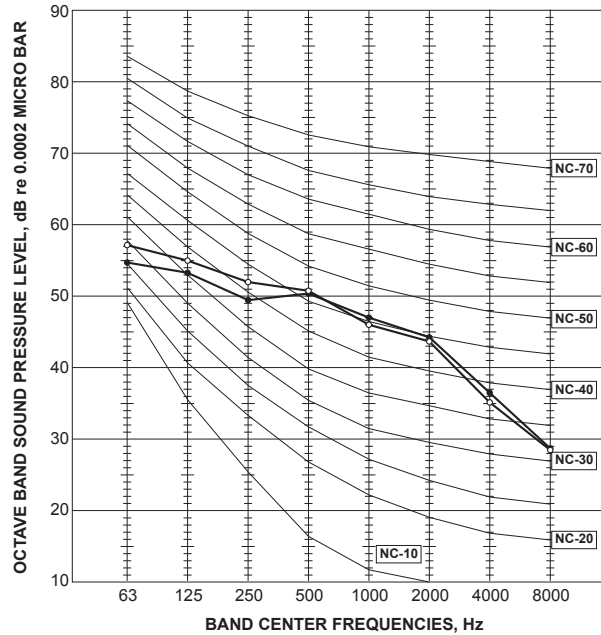

MUZ-SF25VE MUZ-SF25VEH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	47	●—●
HEATING	48	○—○

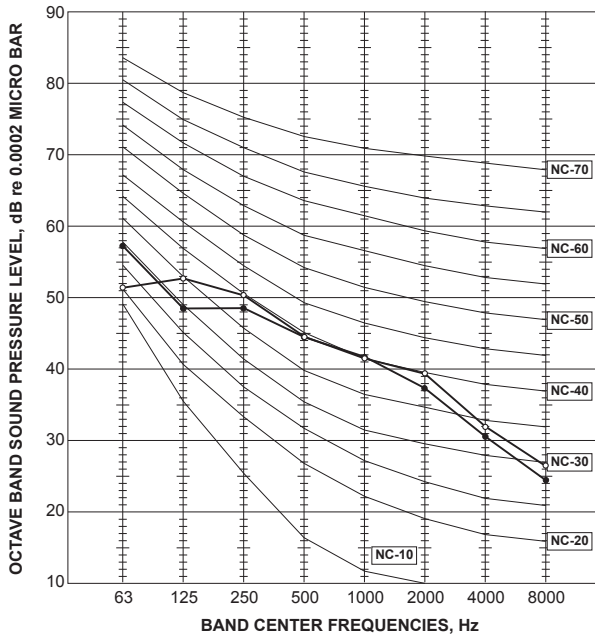

MUZ-SF35VE MUZ-SF35VEH

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	50	○—○

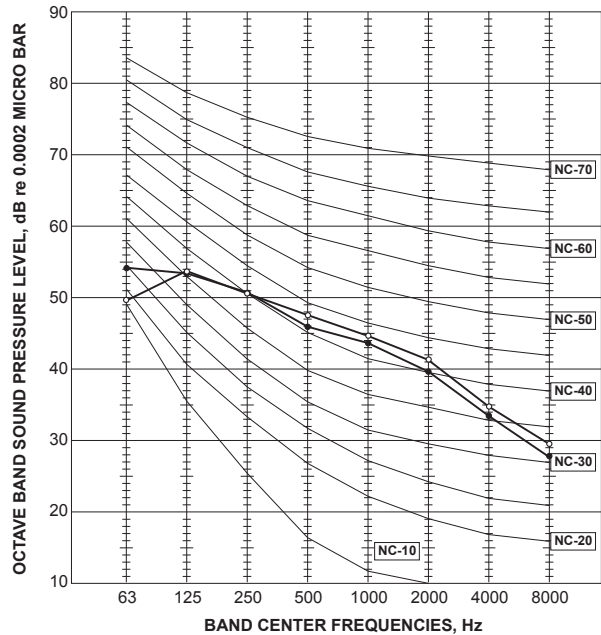


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-SF42VE MUZ-SF42VEH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	51	○—○

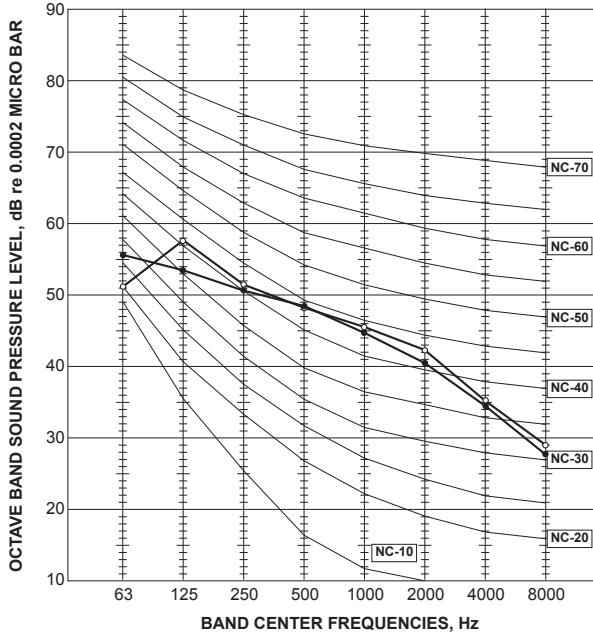

MUZ-SF50VE MUZ-SF50VEH

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	52	●—●
HEATING	52	○—○

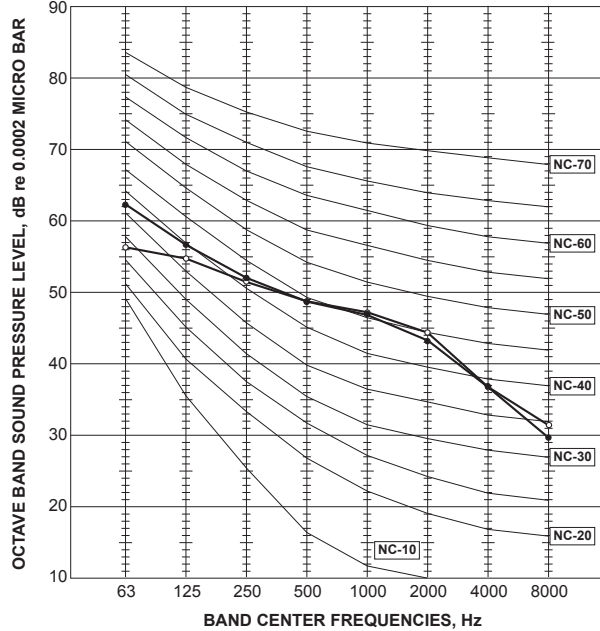

MUZ-GF60VE

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	55	●—●
HEATING	55	○—○

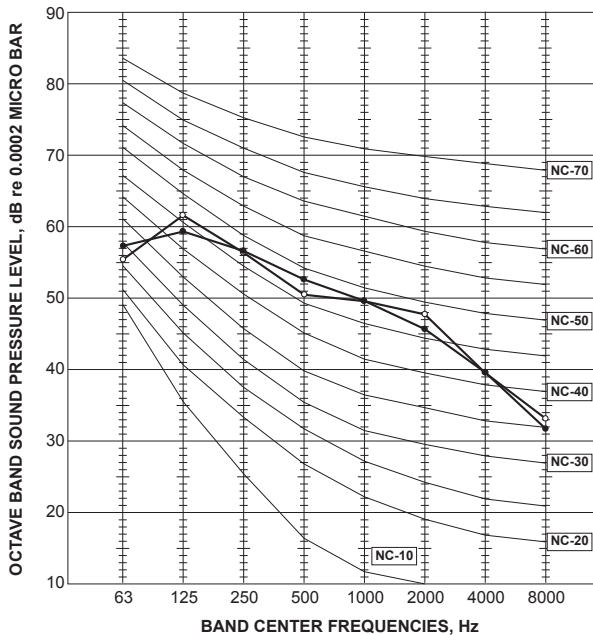

MUZ-GF71VE

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	55	●—●
HEATING	55	○—○

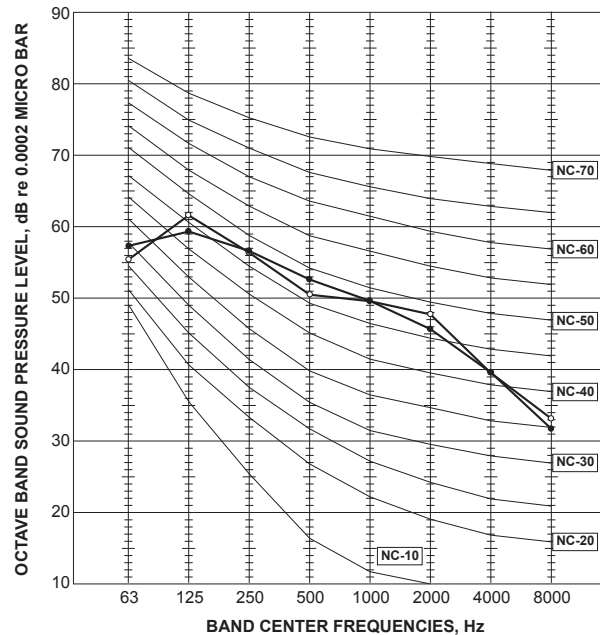


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-WN25VA

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	50	○—○

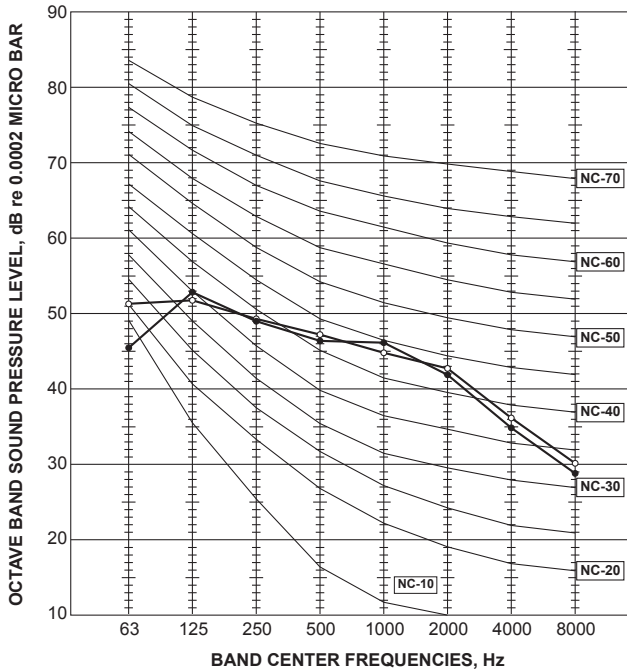

MUZ-WN35VA

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	52	●—●
HEATING	52	○—○

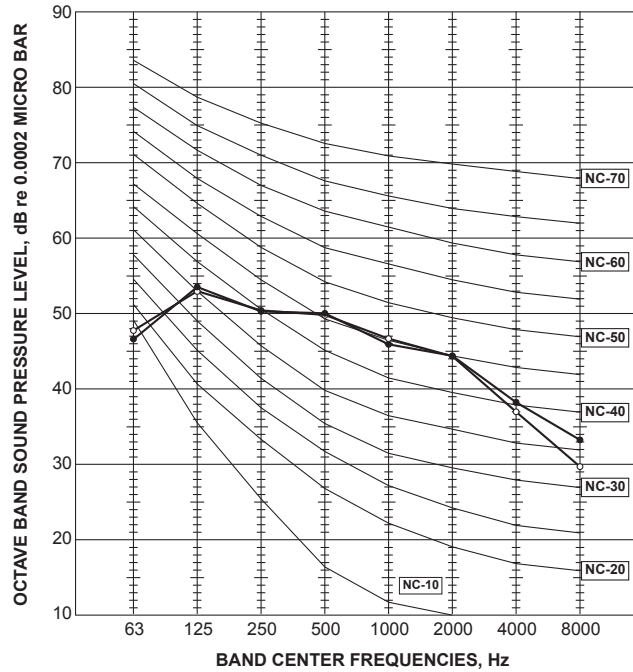

MUZ-DM25VA

OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	50	○—○

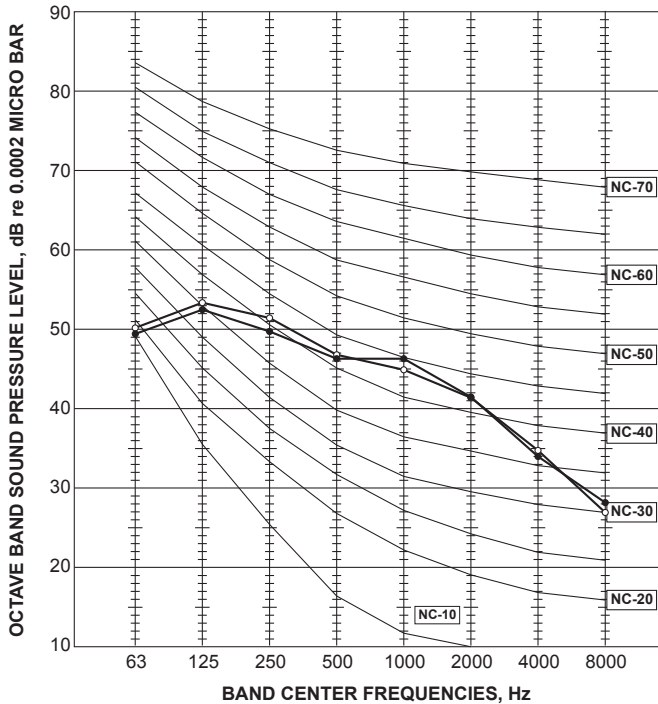

MUZ-DM35VA

OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	51	●—●
HEATING	51	○—○

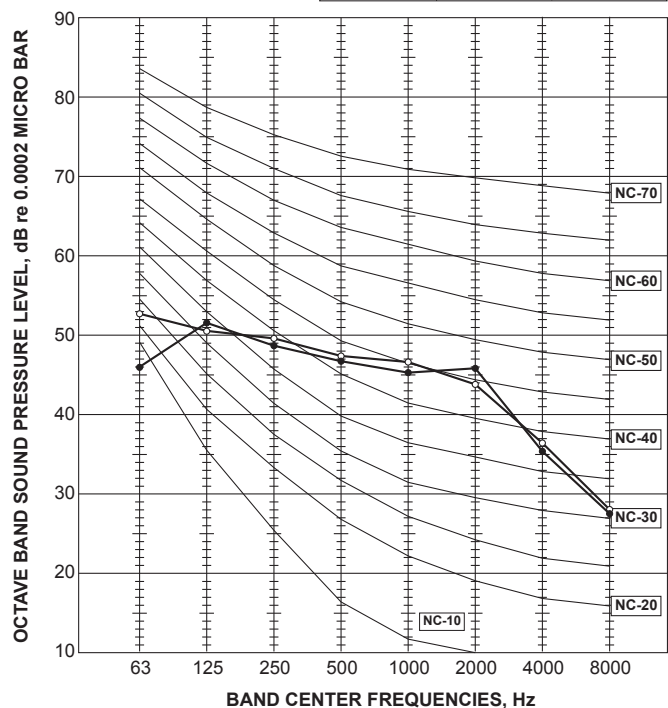


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


MUZ-HJ25VA
OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	50	○—○

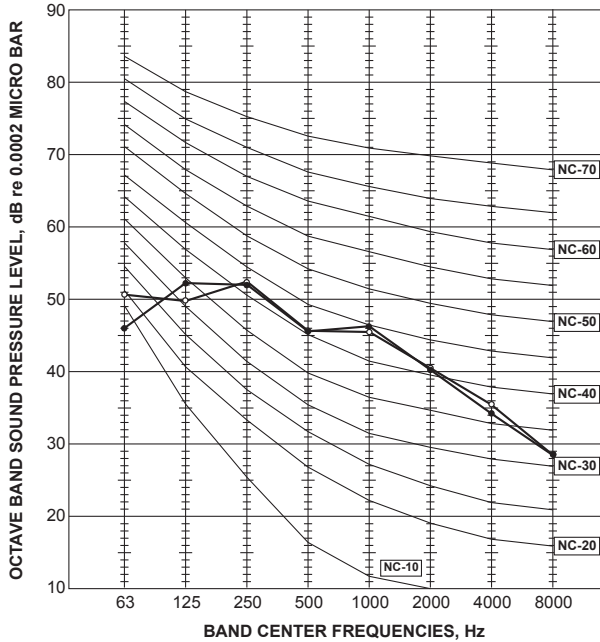


MUZ-HJ35VA
OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	50	○—○

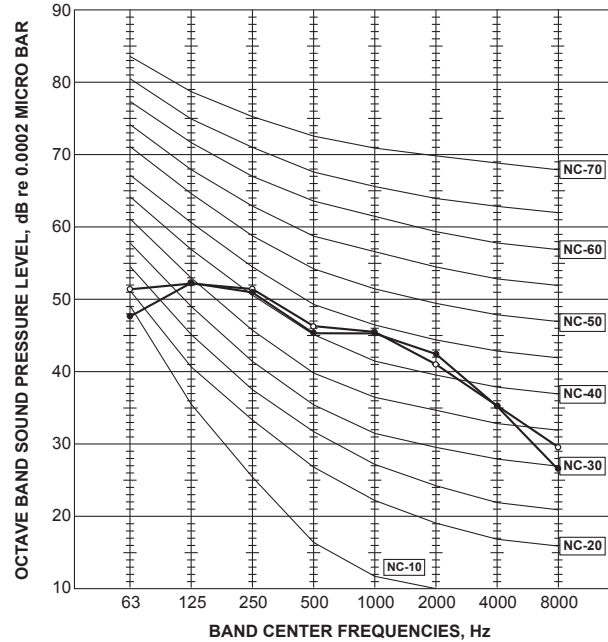


MUZ-HJ50VE
OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	50	●—●
HEATING	51	○—○

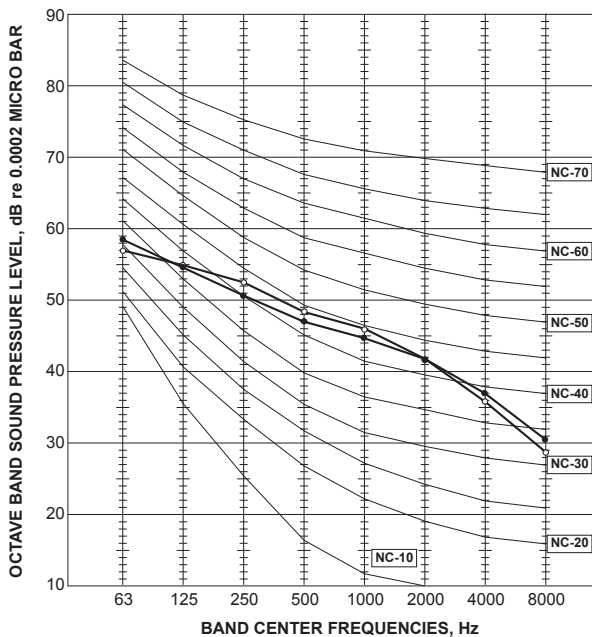

MUZ-HJ60VA
OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	55	●—●
HEATING	55	○—○

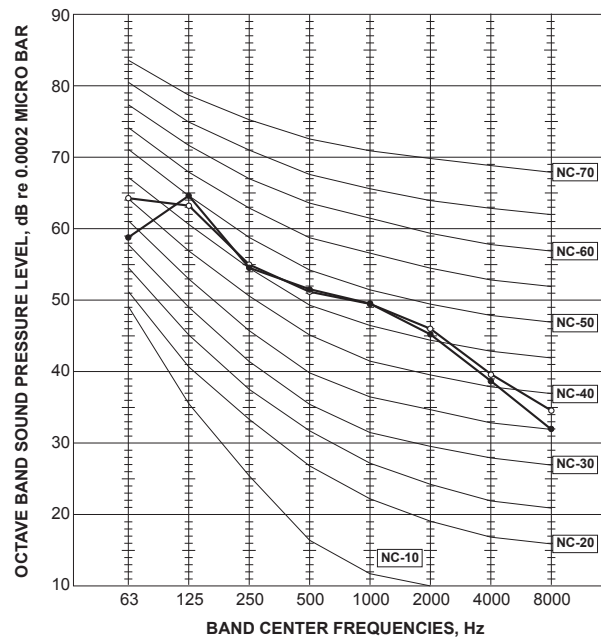


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MUZ-HJ71VA


OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	55	●—●
HEATING	55	○—○

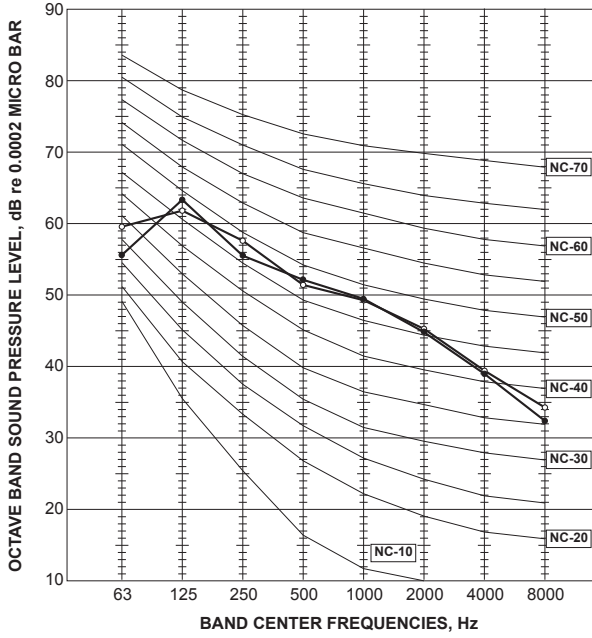

Test conditions

Cooling: Dry-bulb temperature 35°C Wet-bulb temperature 24°C
 Heating: Dry-bulb temperature 7°C Wet-bulb temperature 6°C (MUZ)

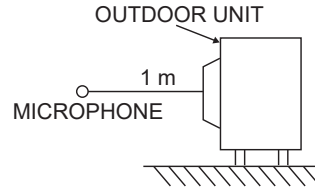

NOISE CRITERIA CURVES WALL-MOUNTED

<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


C.1.8 TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-LN18VGW MSZ-LN18VGV MSZ-LN18VGB MSZ-LN18VGR
MSZ-LN25VGW MSZ-LN25VGV MSZ-LN25VGB MSZ-LN25VGR

Temperature distribution


<Cooling mode>

Air volume: high
 Air direction: auto (upward air flow)

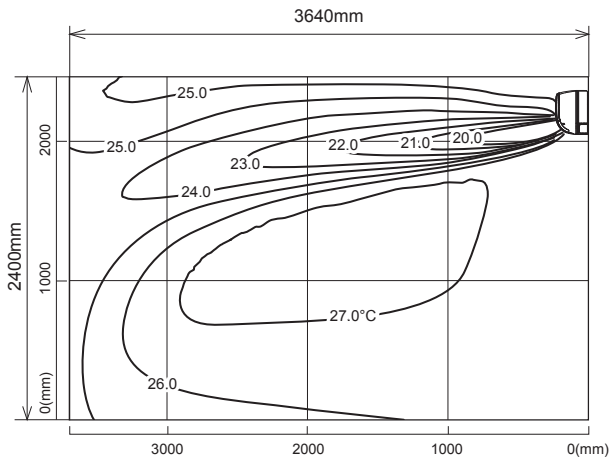

<Heating mode>


Air volume: high
 Air direction: auto (downward air flow)

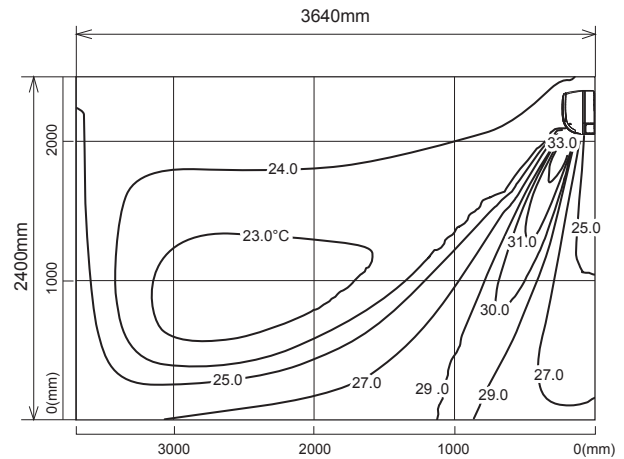

Airflow distribution


<Cooling mode>

Air volume: high
 Air direction: auto (upward air flow)

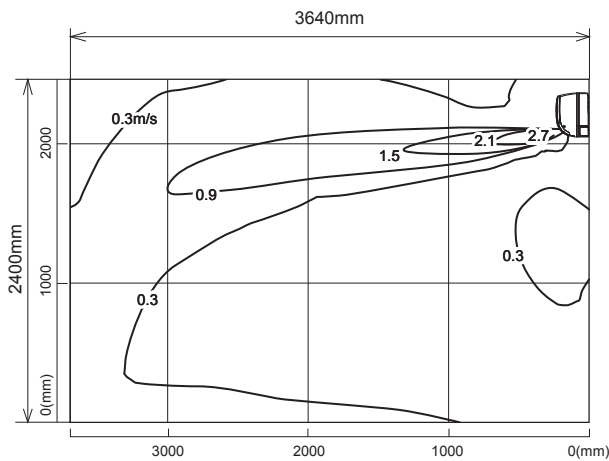

<Heating mode>

Air volume: high
 Air direction: auto (downward air flow)

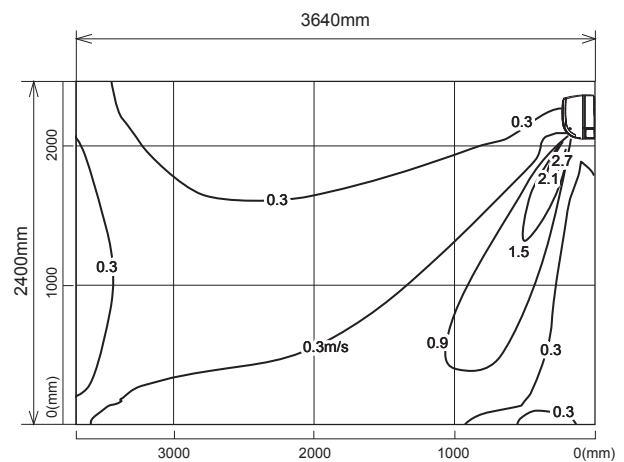

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-LN35VGW MSZ-LN35VGV MSZ-LN35VGB MSZ-LN35VGR

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

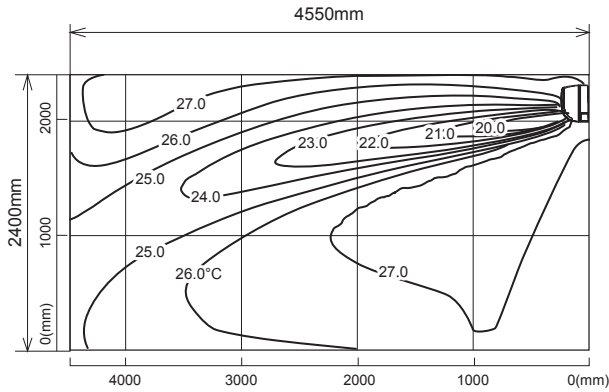

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

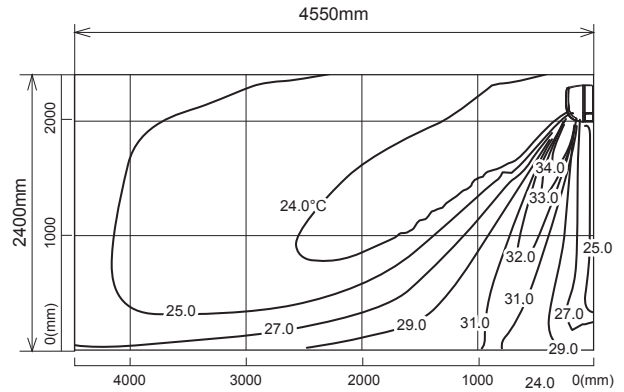

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

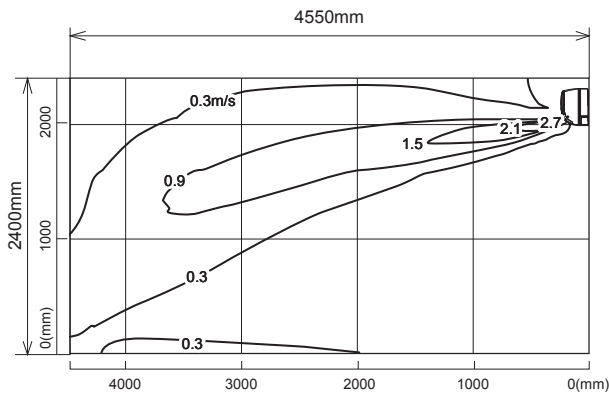

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

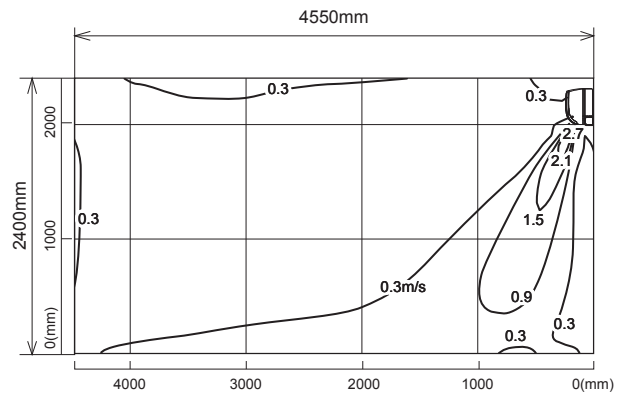

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-LN50VGW MSZ-LN50VGV MSZ-LN50VGB MSZ-LN50VGR

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

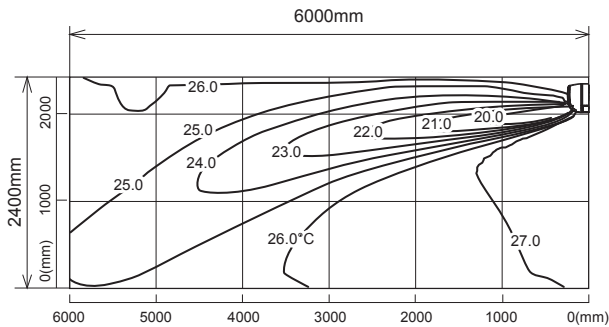

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

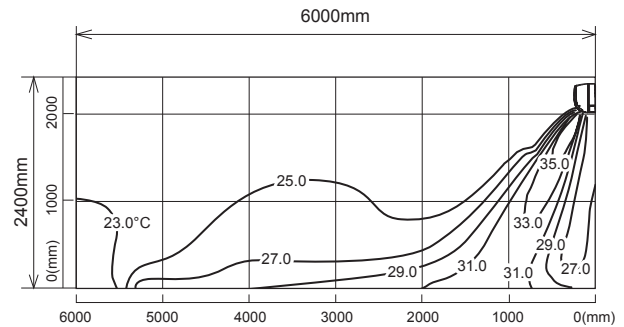

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

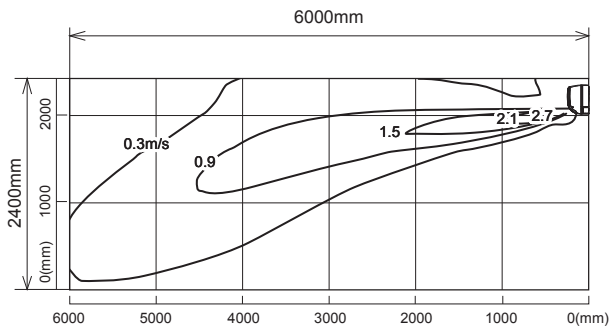

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

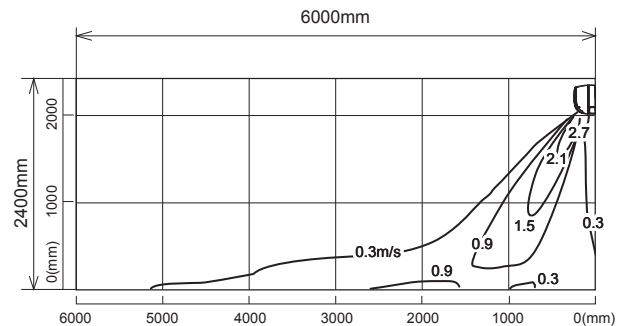


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-LN60VGW MSZ-LN60VGV MSZ-LN60VGB MSZ-LN60VGR

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

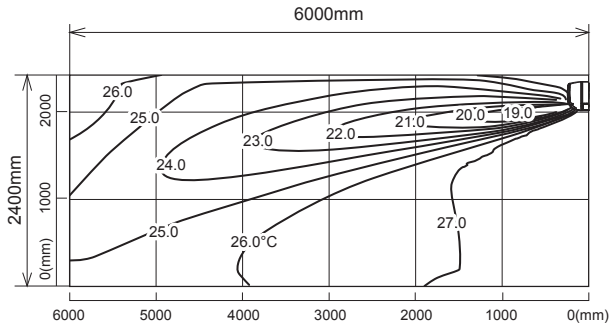

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

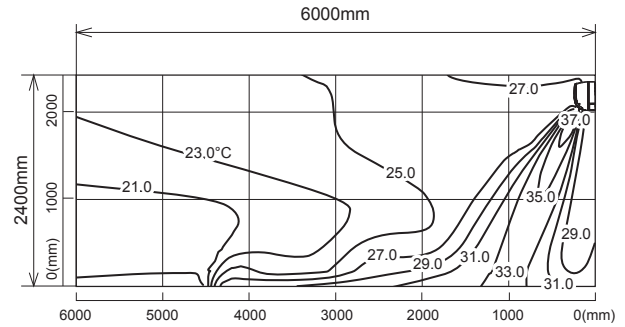

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

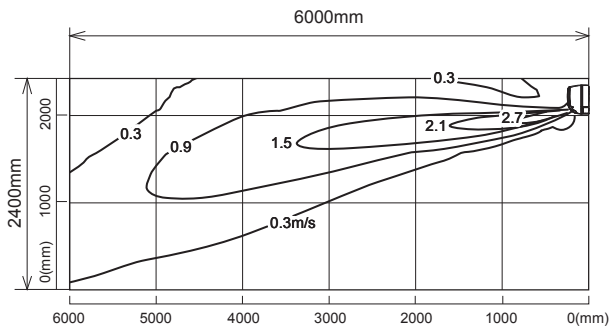

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

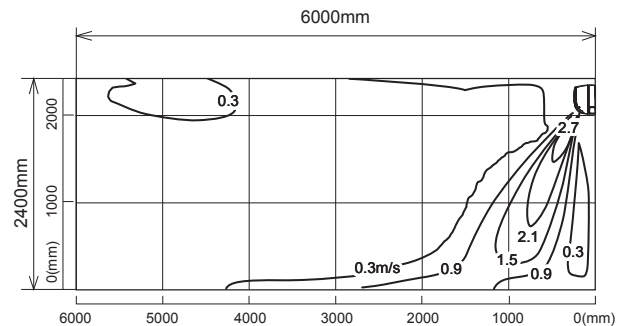

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-AP15VG

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

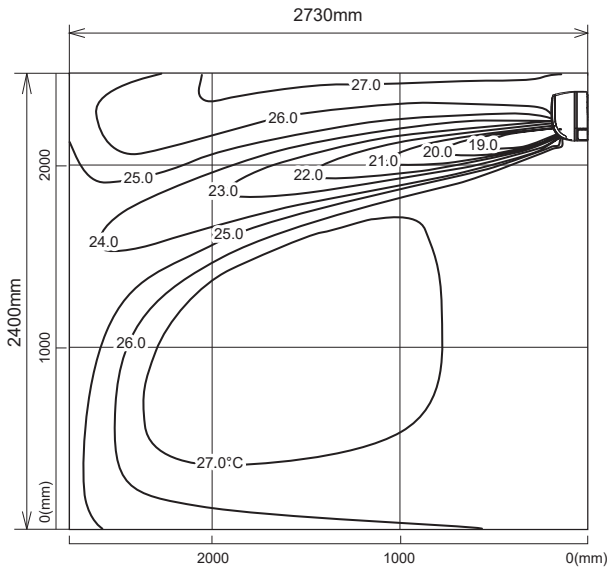

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

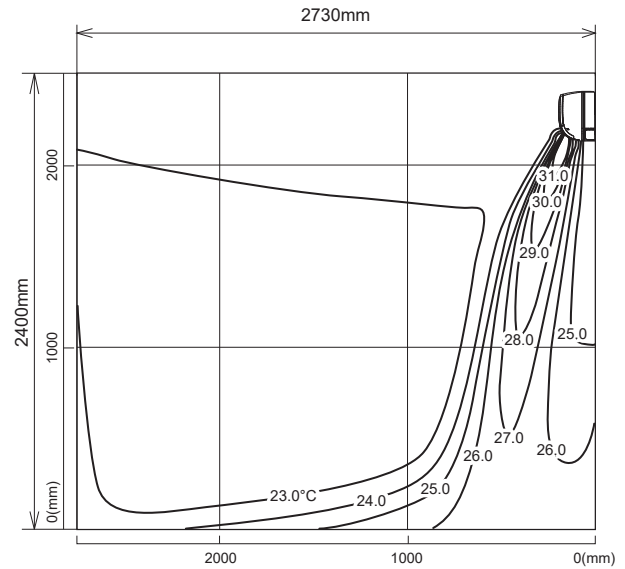

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

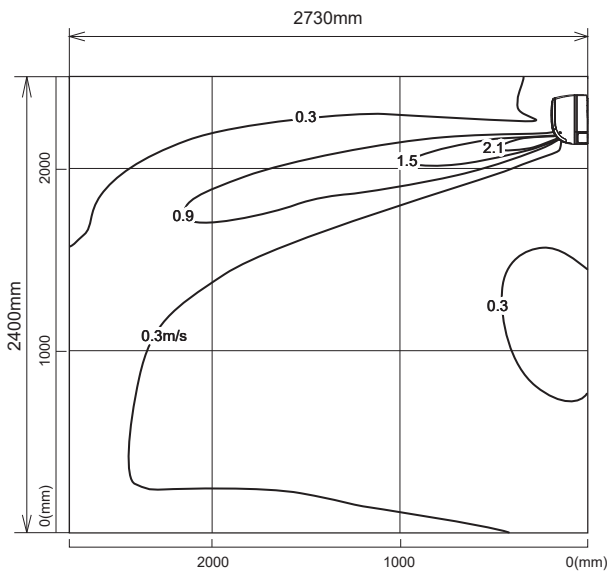

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

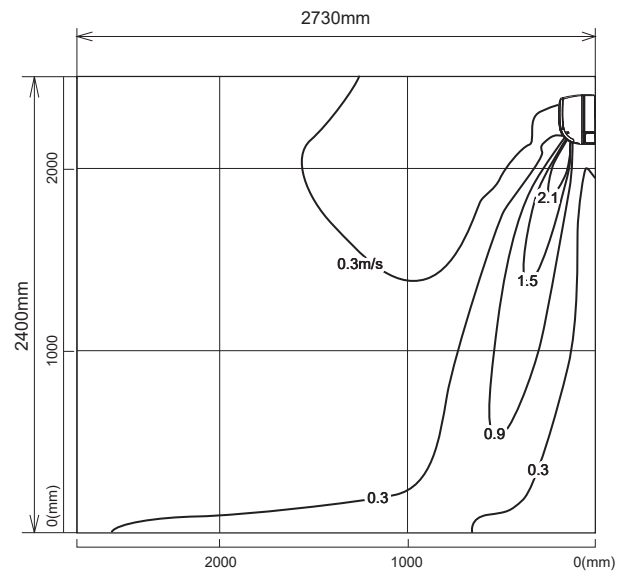

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-AP20VG

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

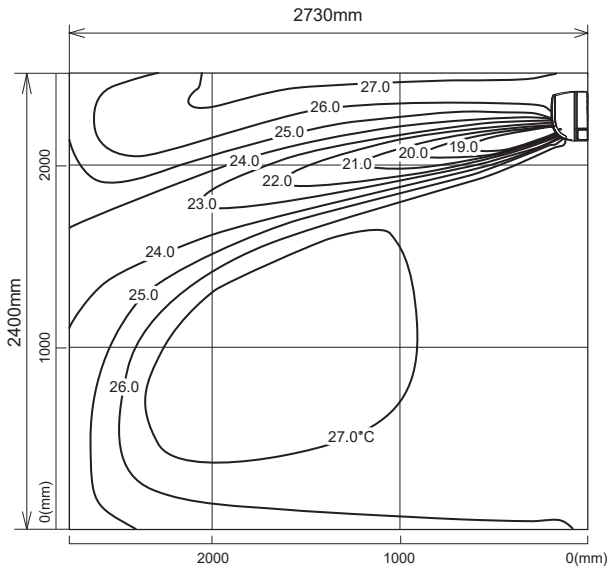

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

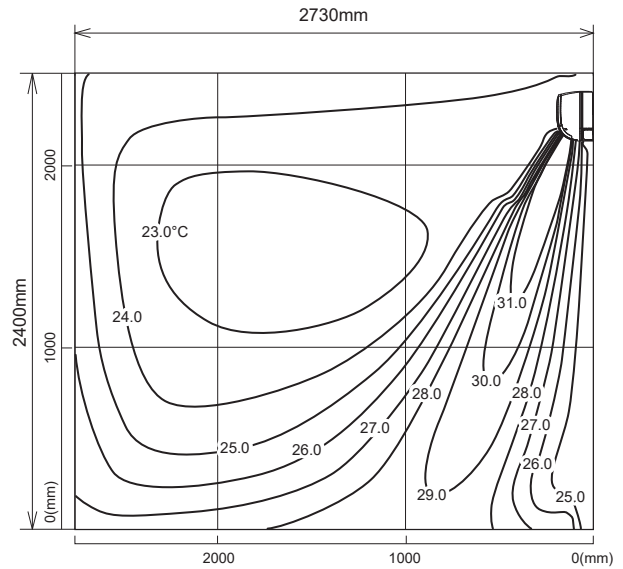

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

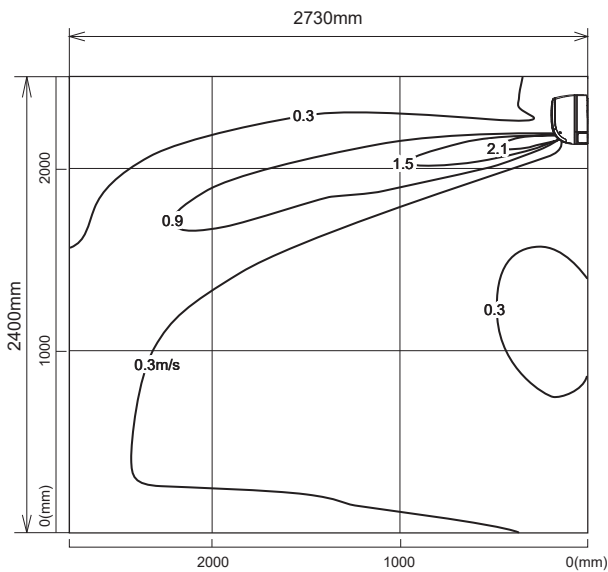

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

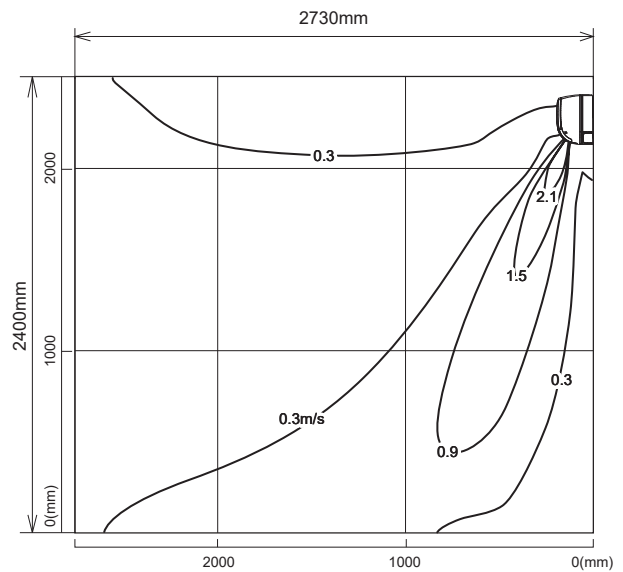

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-AP25VG MSZ-AP25VGK

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

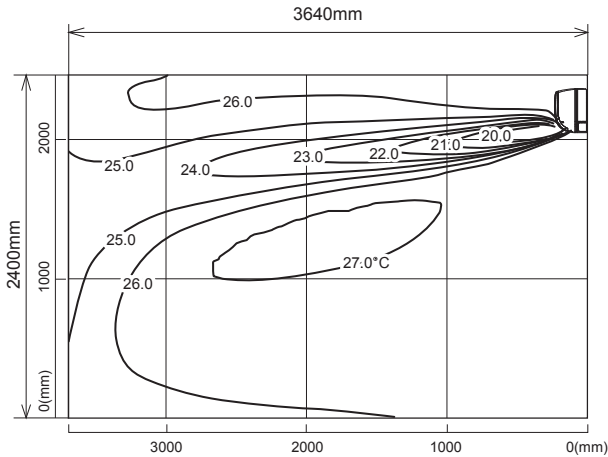

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

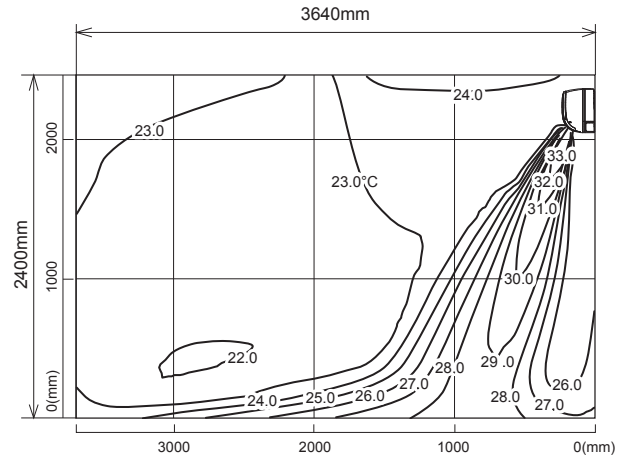

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

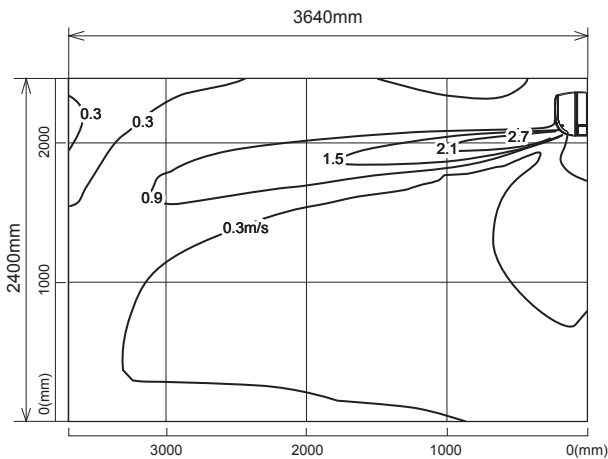

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

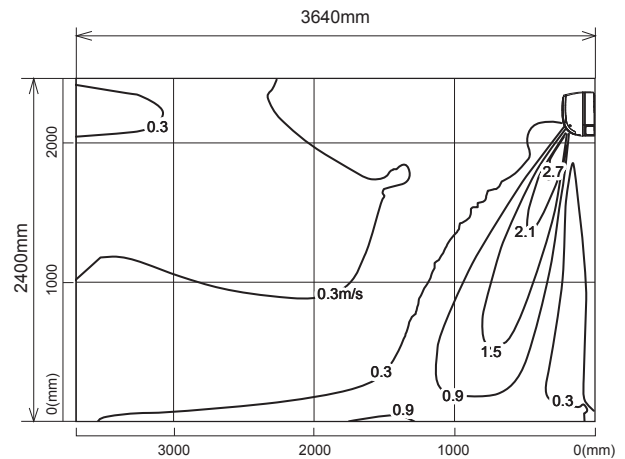

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-AP35VG MSZ-AP35VGK

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

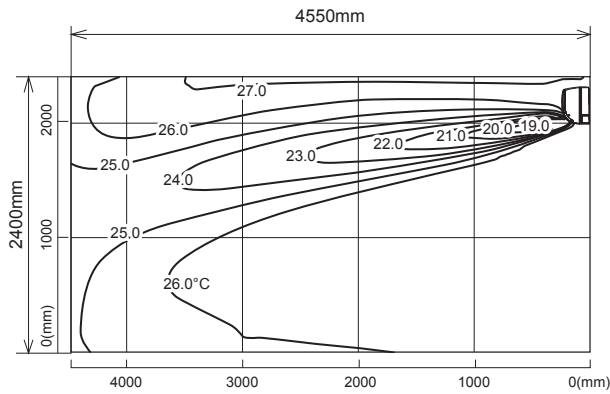

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

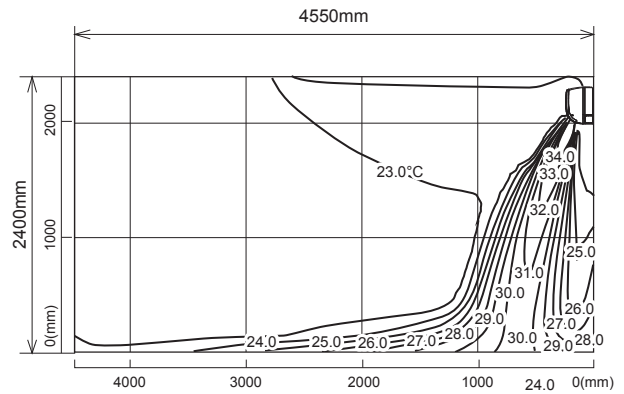

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

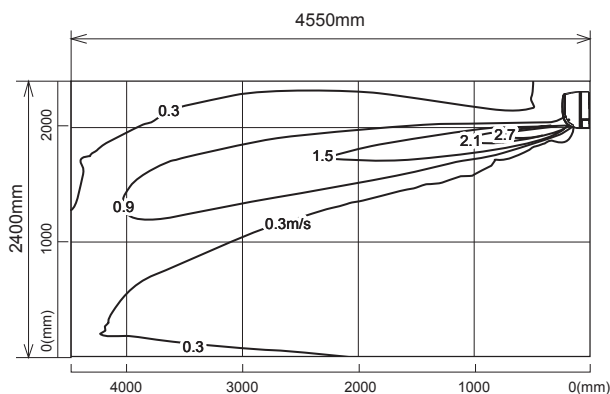

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

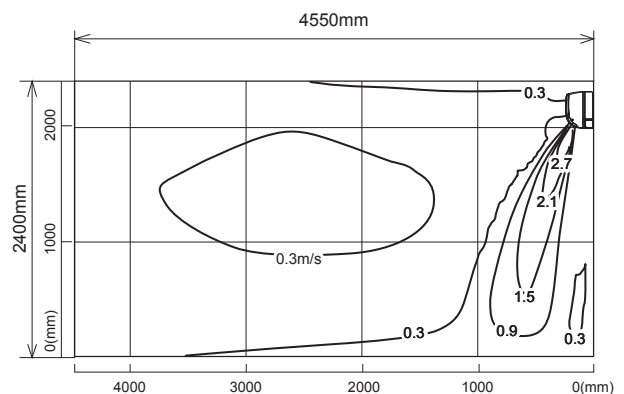

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-AP42VG MSZ-AP42VGK

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

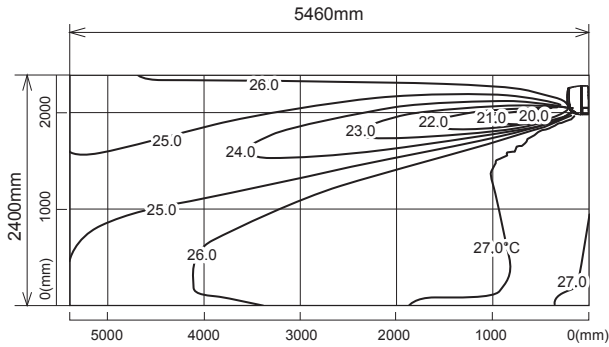

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

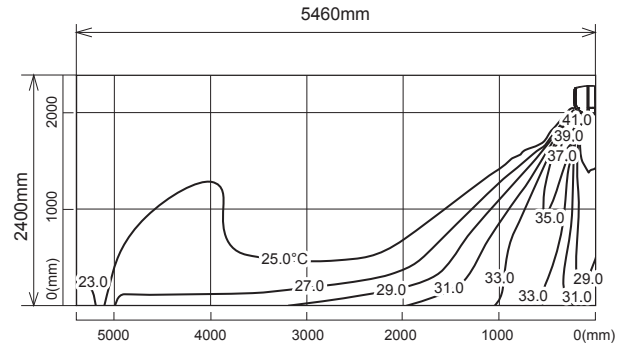

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

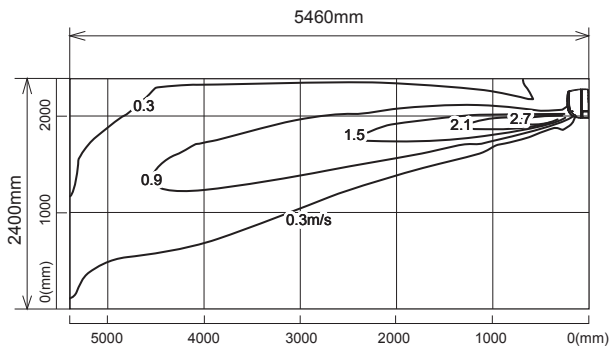

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

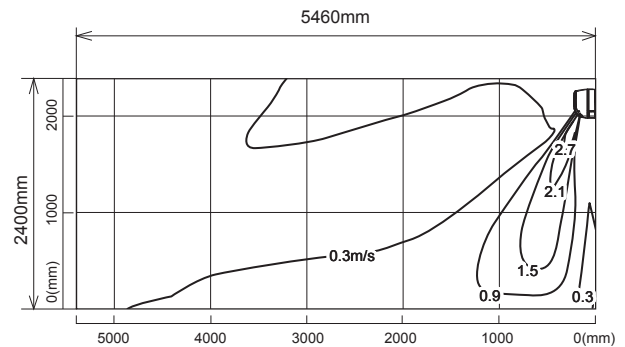

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-AP50VG MSZ-AP50VGK

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

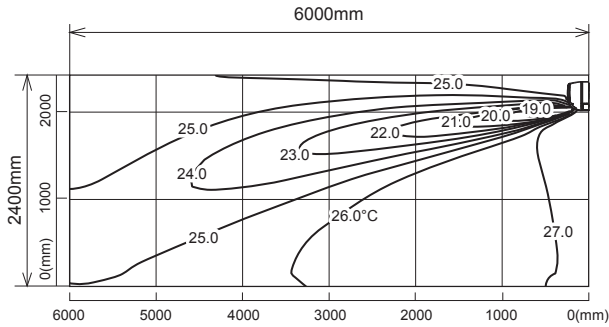

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

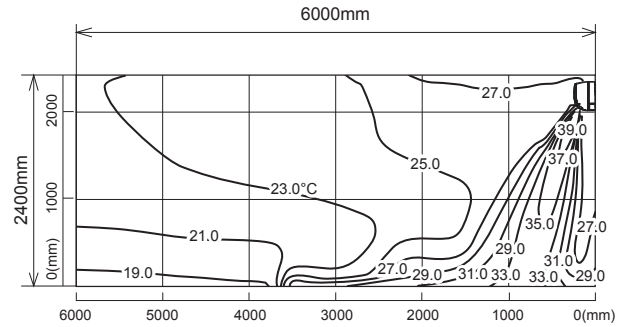

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

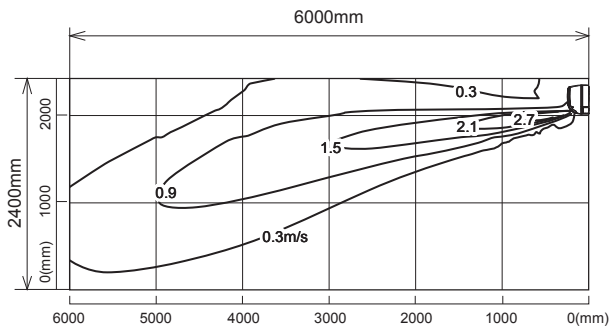

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

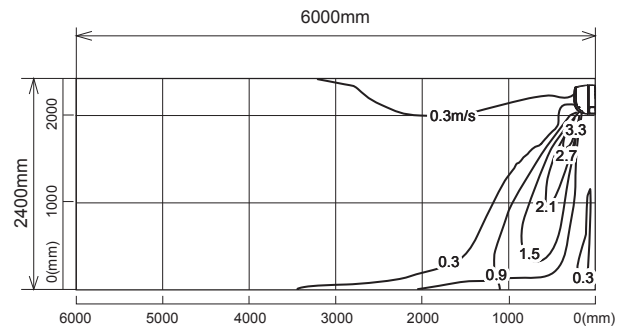

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-AP60VG MSZ-AP60VGK

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

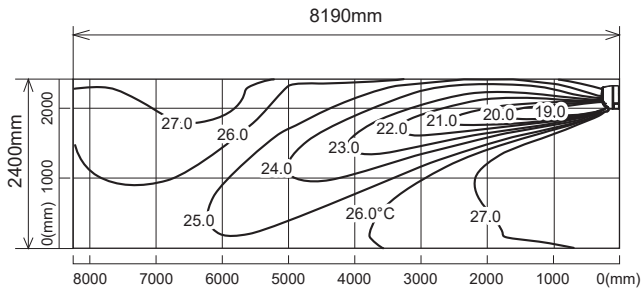

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

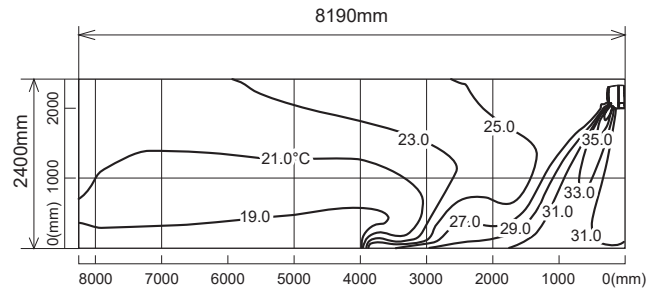

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

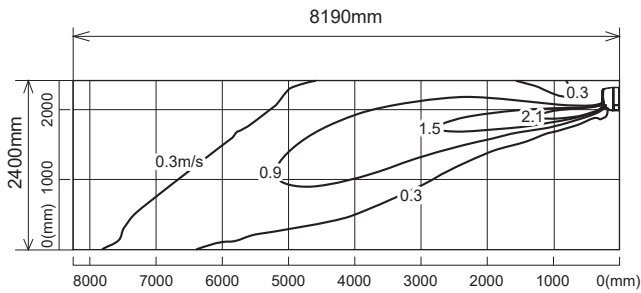

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

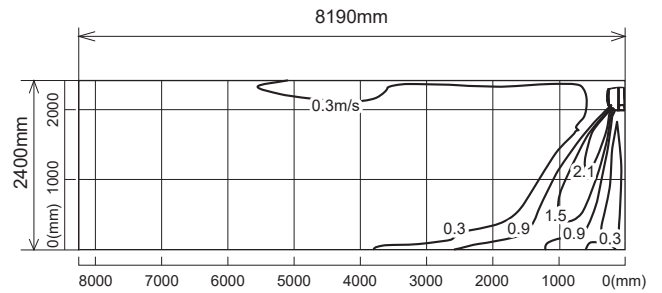

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-AP71VG MSZ-AP71VGK

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

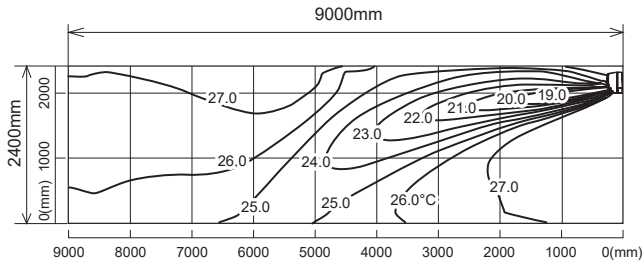

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

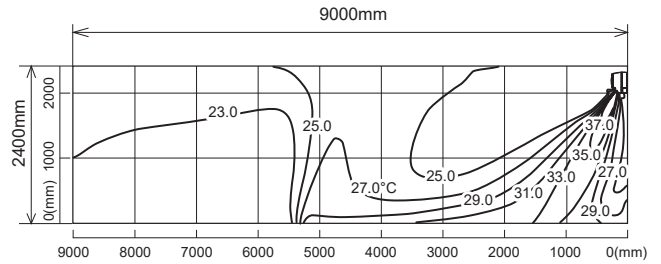

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

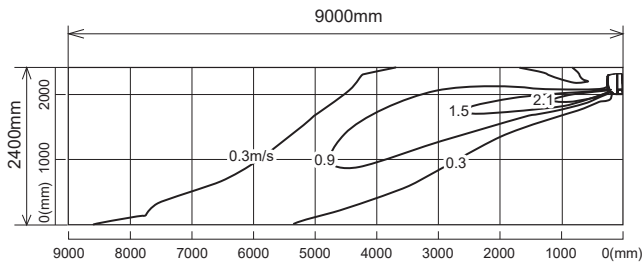

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

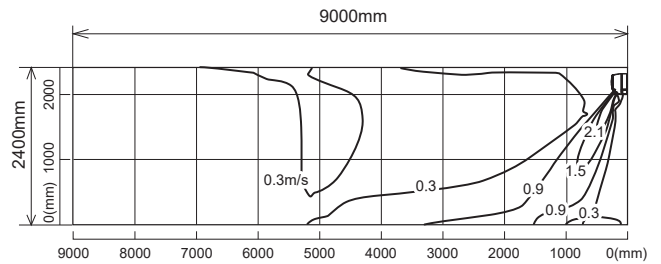

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-HR25VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

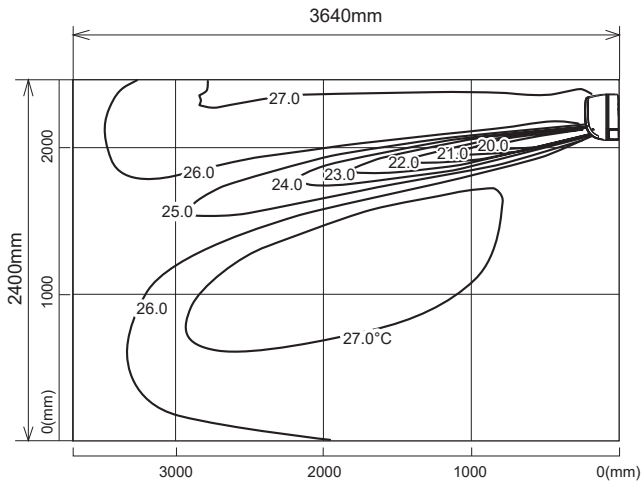

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

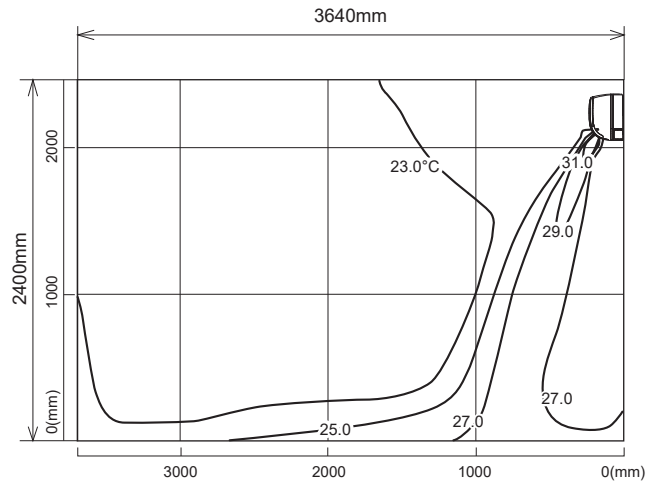

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

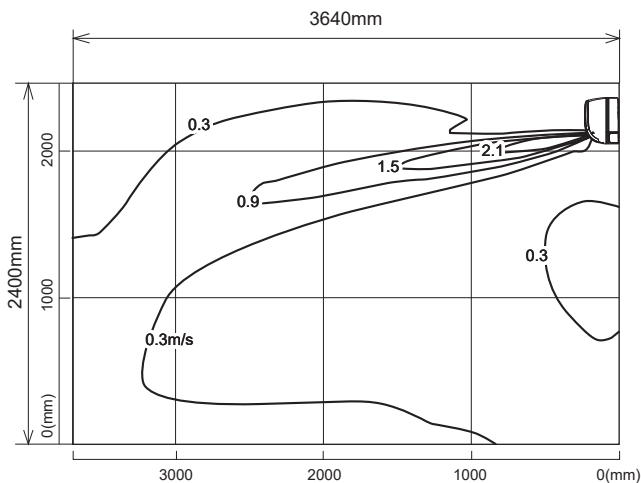

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

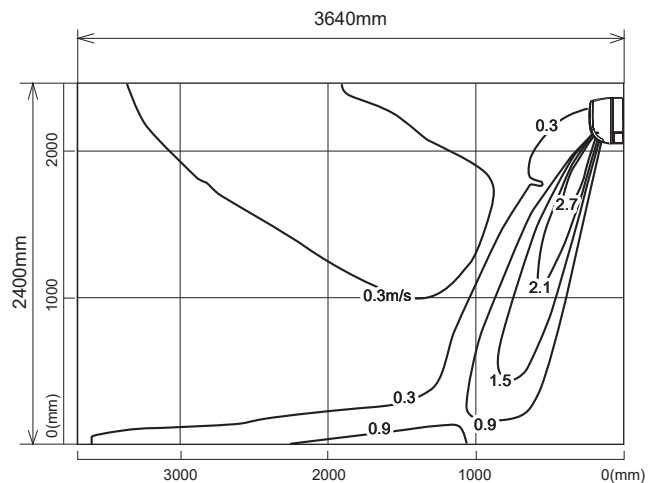


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-HR35VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

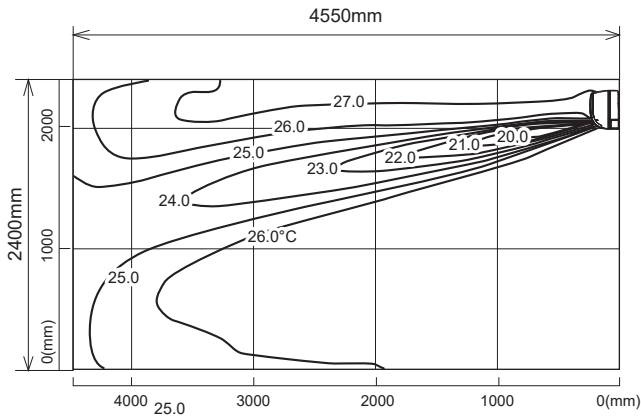

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

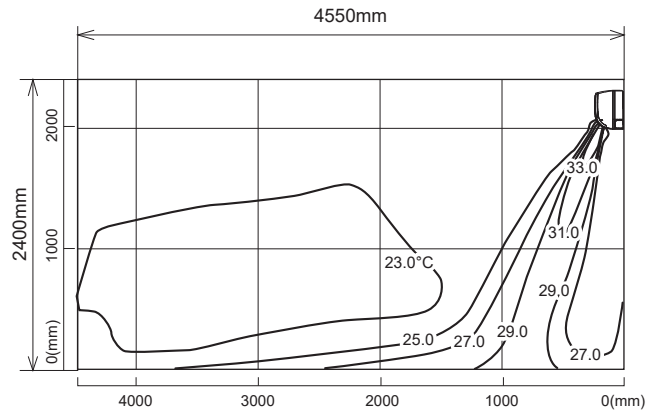

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

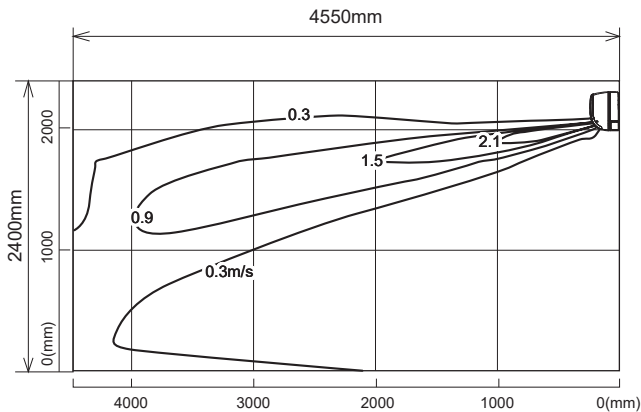

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

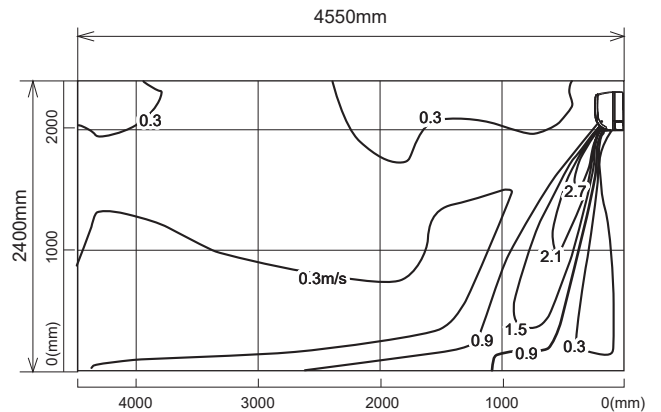

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-HR42VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

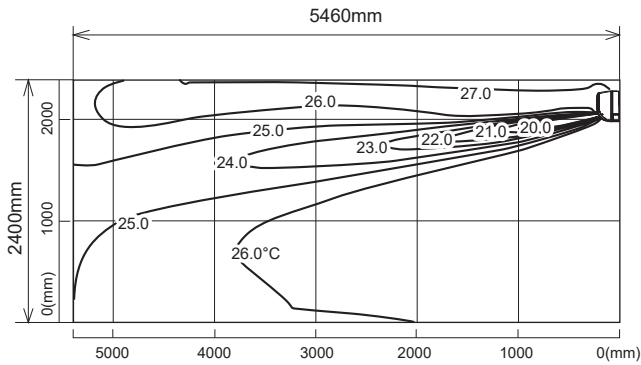

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

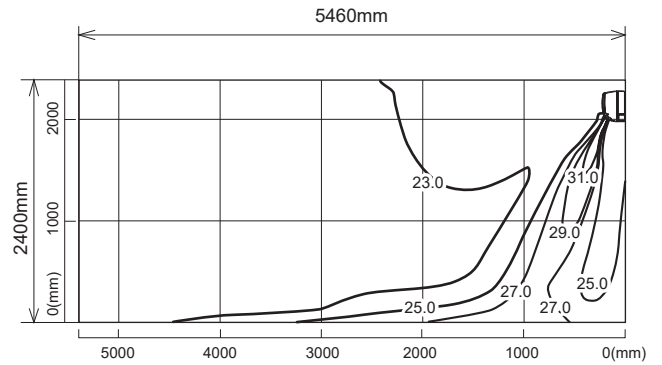

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

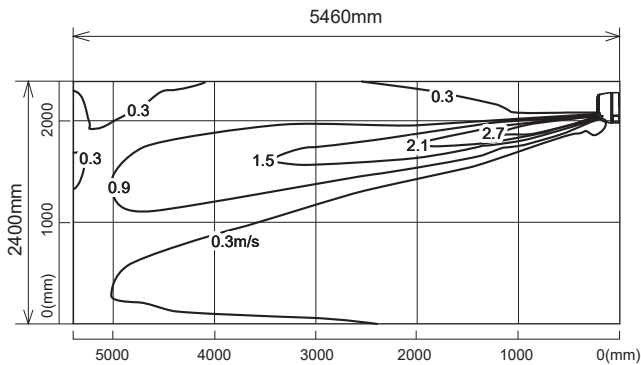

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

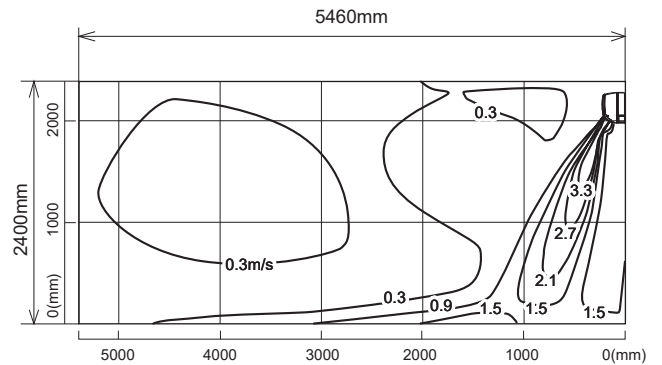

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-HR50VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

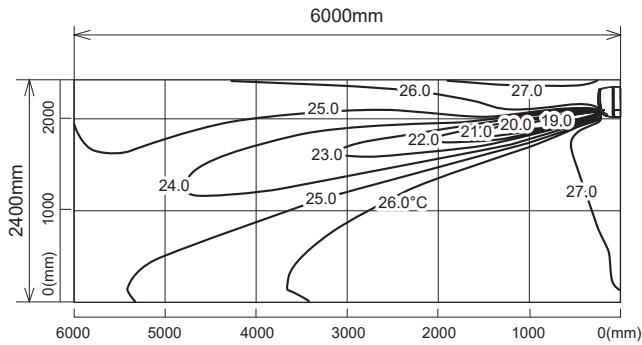

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

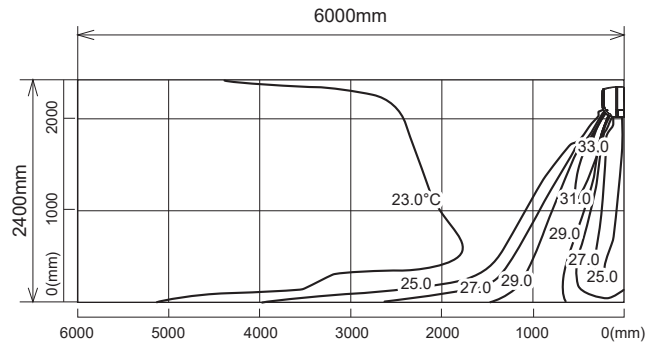

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

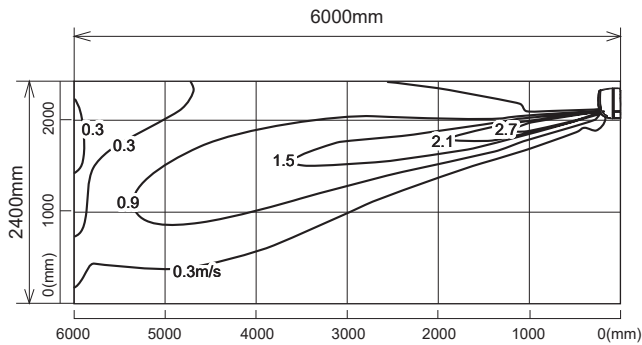

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

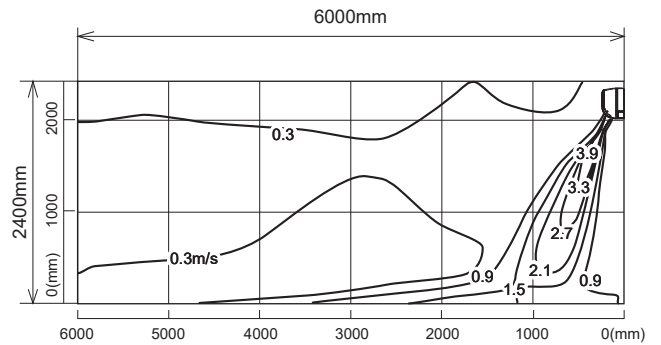

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED


MST-TP35VF

Temperature distribution

<Cooling mode>

Air volume: high

Air direction: auto (upward air flow)

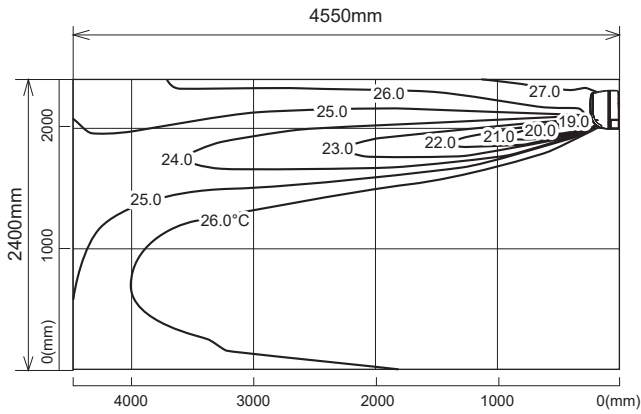


Airflow distribution

<Cooling mode>

Air volume: high

Air direction: auto (upward air flow)

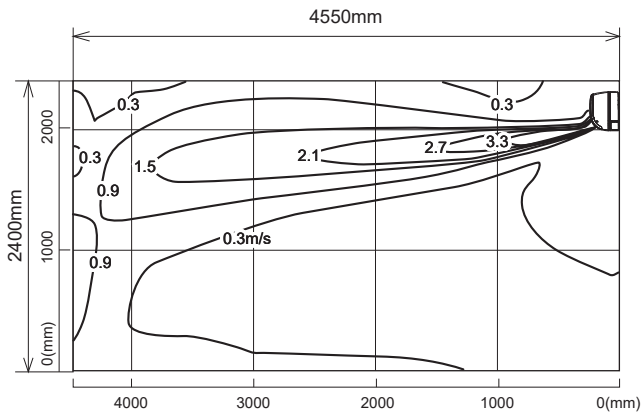


MST-TP50VF

Temperature distribution

<Cooling mode>

Air volume: high

Air direction: auto (upward air flow)

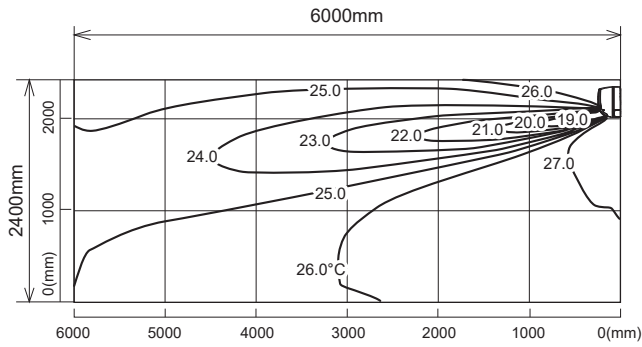


Airflow distribution

<Cooling mode>

Air volume: high

Air direction: auto (upward air flow)

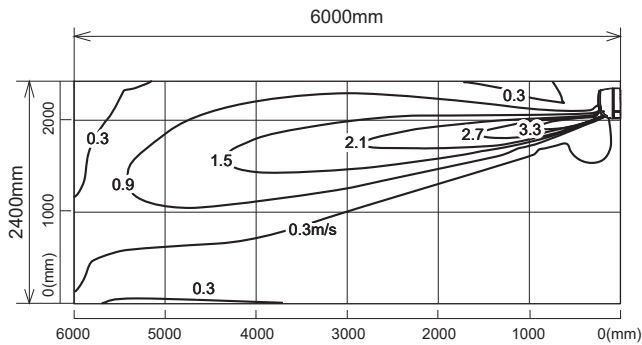


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-FH25VE2

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

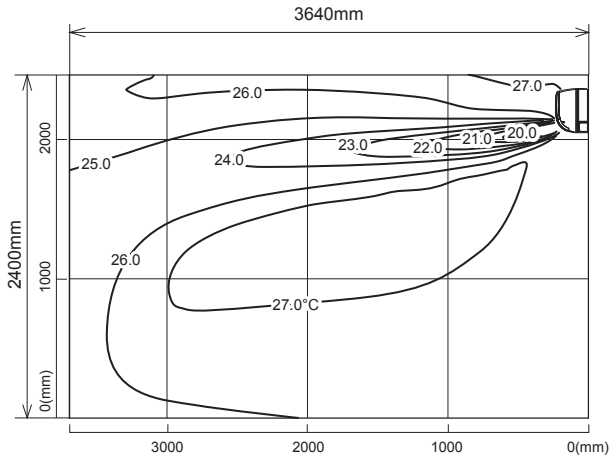

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

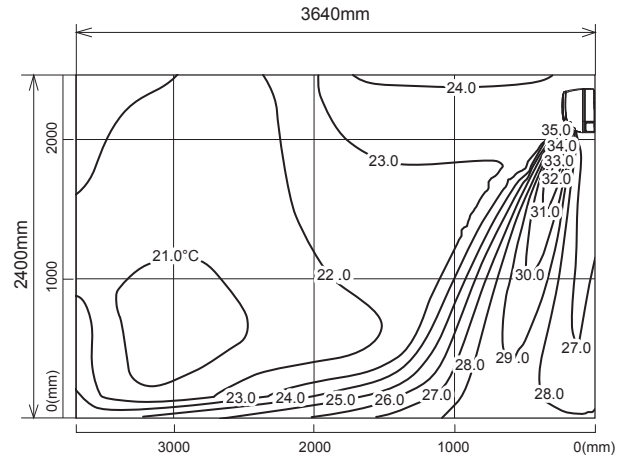

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

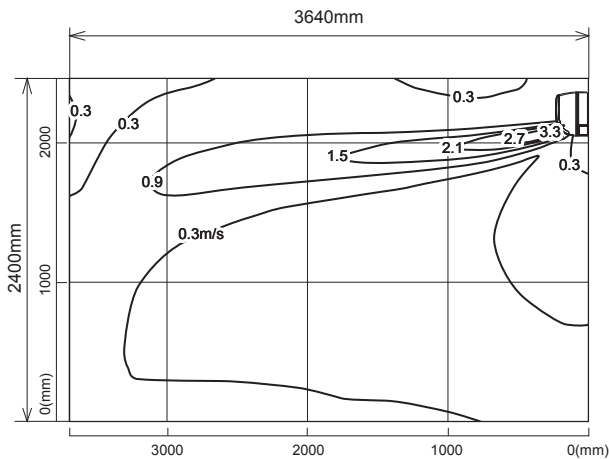

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

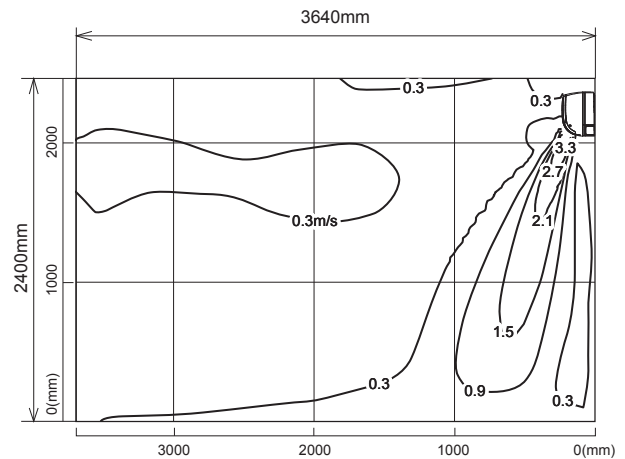

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-FH35VE2

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

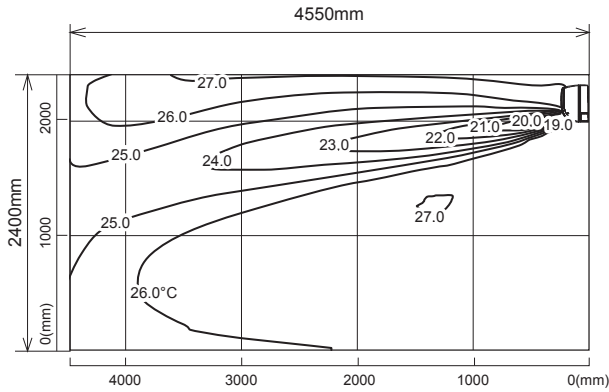

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

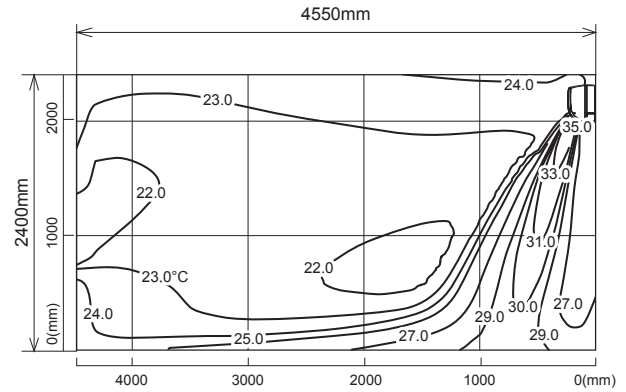

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

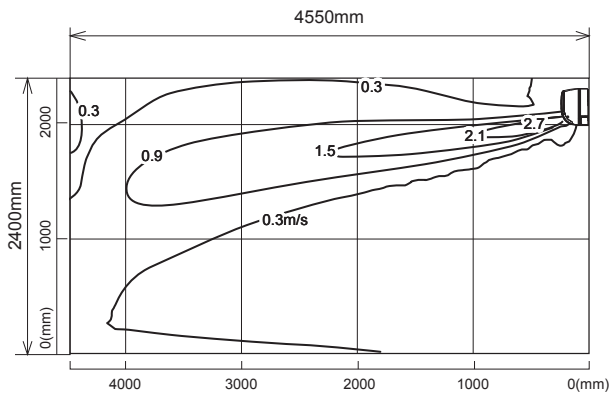

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

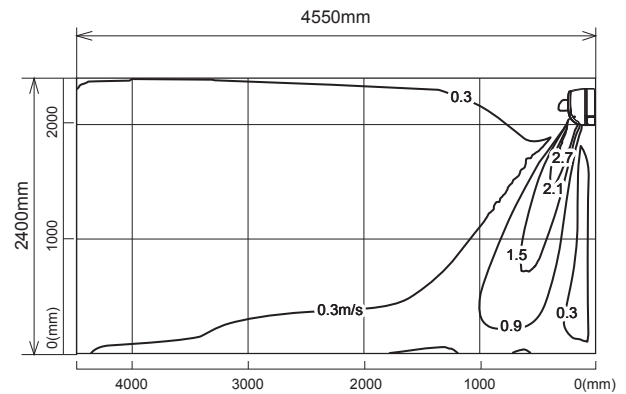

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-FH50VE2

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

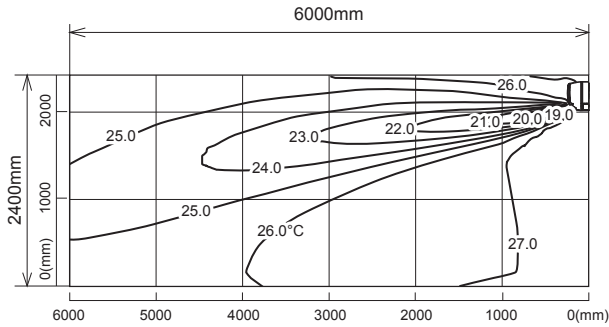

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

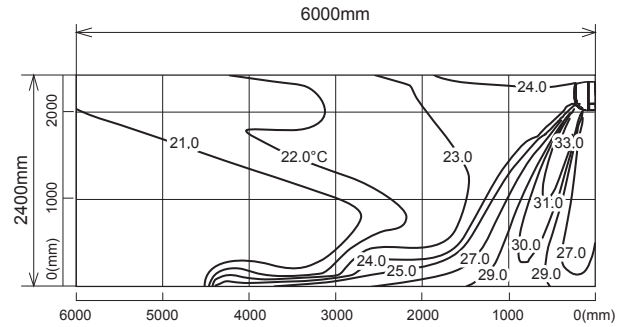

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

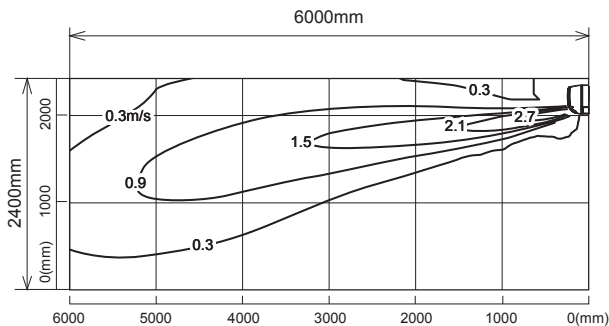

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

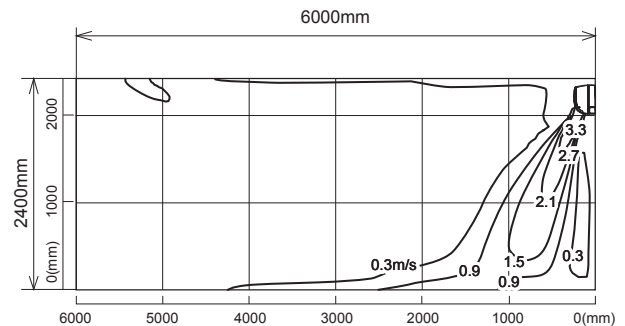


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-EF18VGW MSZ-EF18VGB MSZ-EF18VGS

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

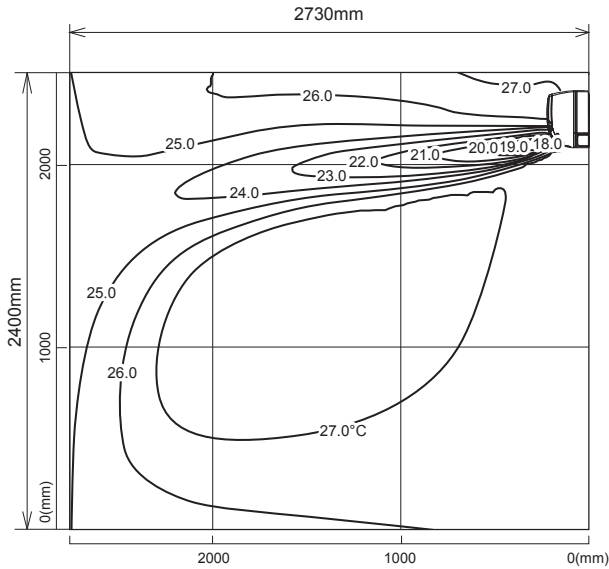

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

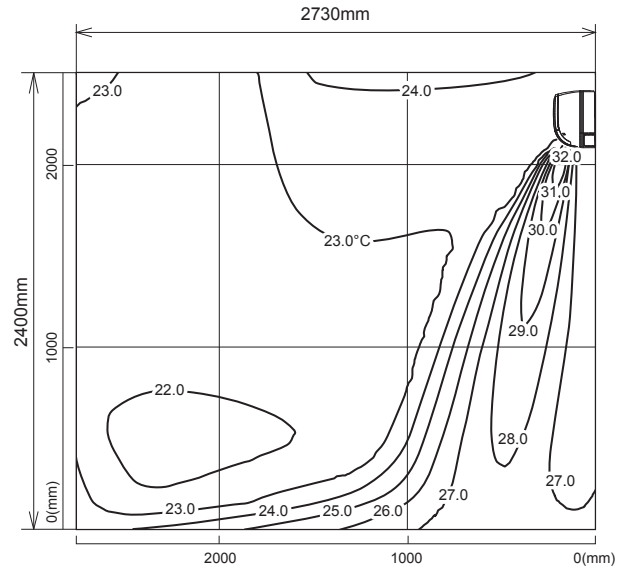

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

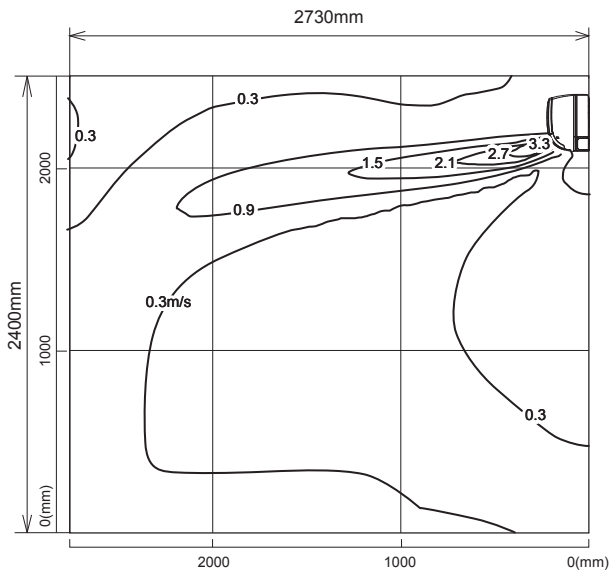

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

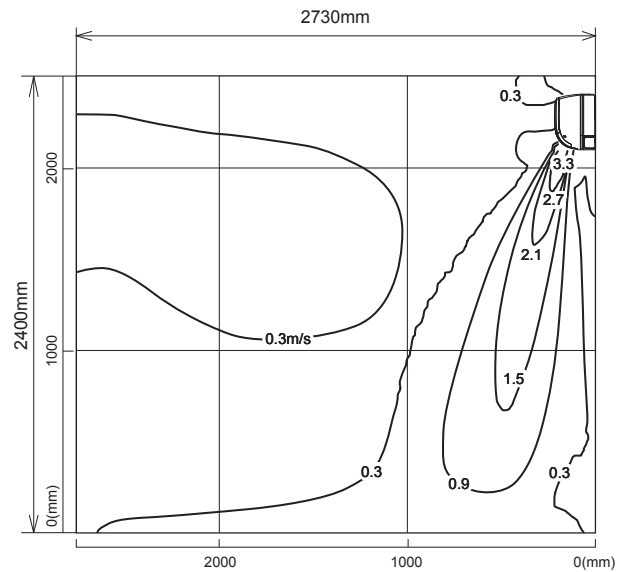

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-EF22VGW MSZ-EF22VGB MSZ-EF22VGS

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

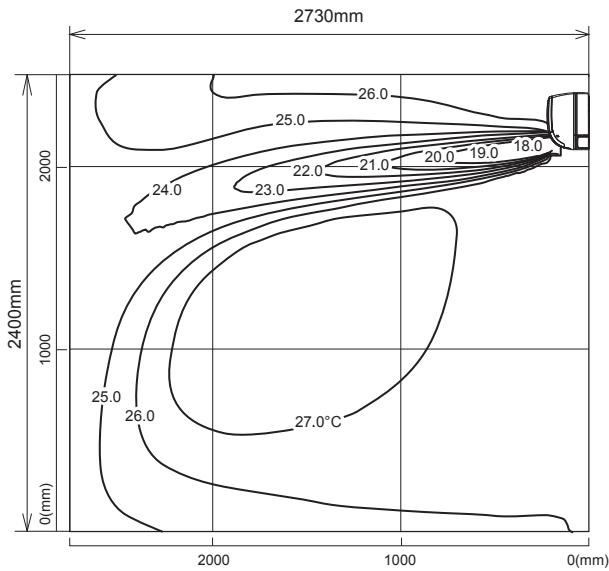

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

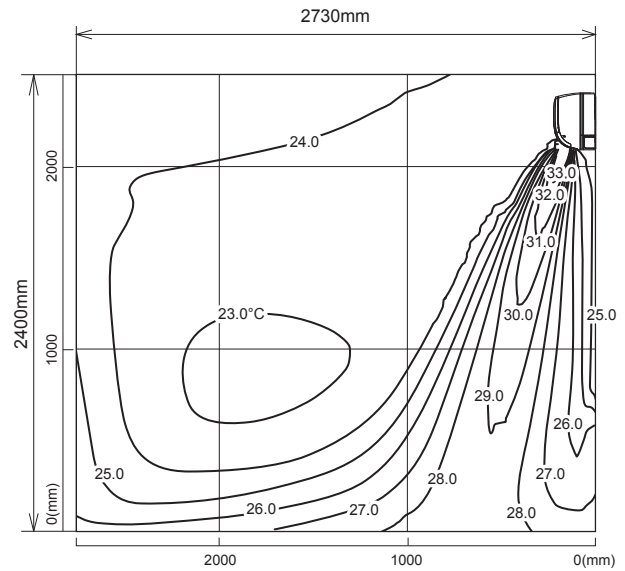

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

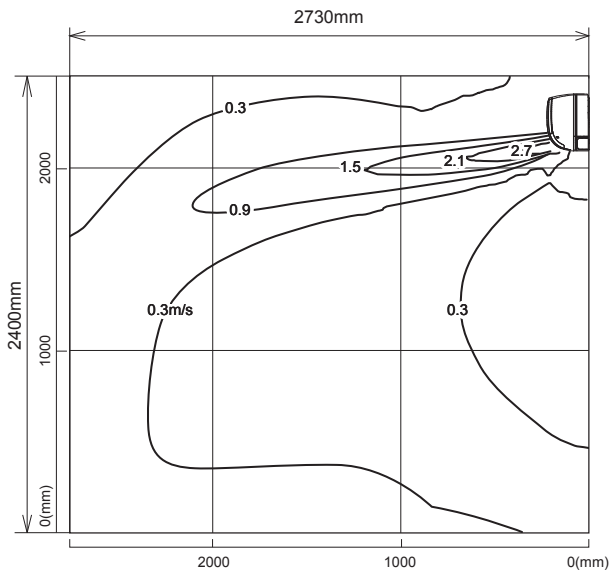

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

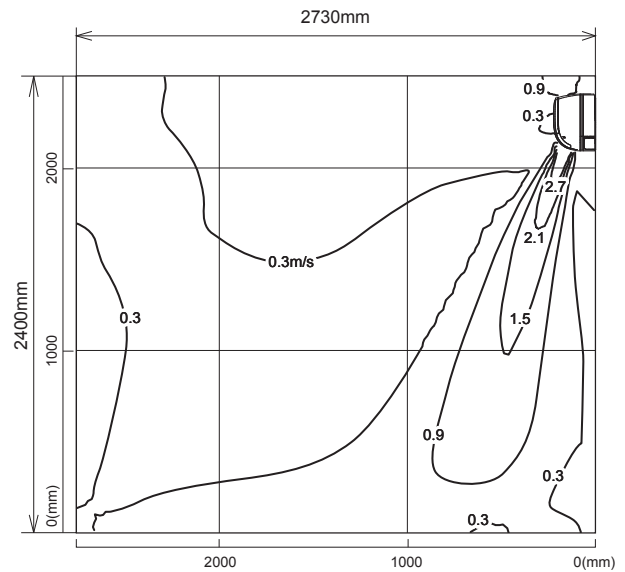

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-EF25VGW MSZ-EF25VGB MSZ-EF25VGS

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

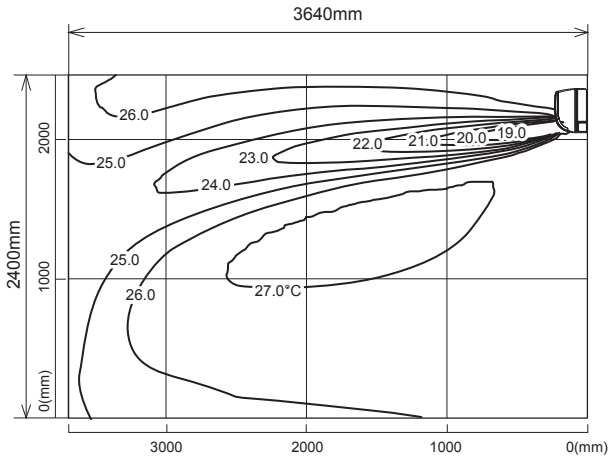

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

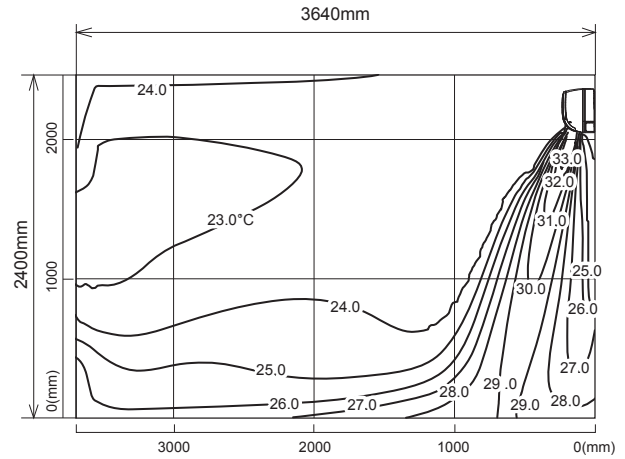

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

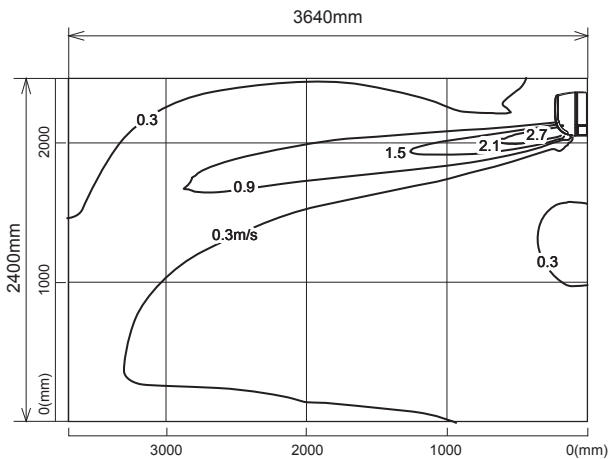

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

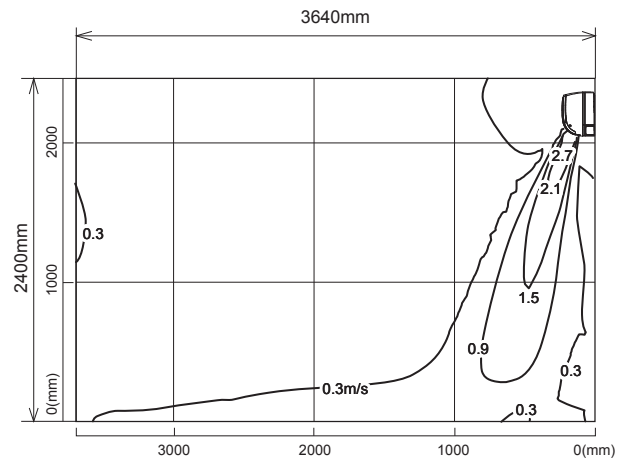

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-EF35VGW MSZ-EF35VGB MSZ-EF35VGS

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

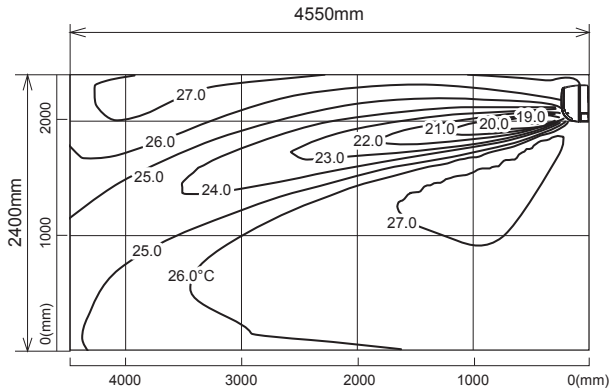

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

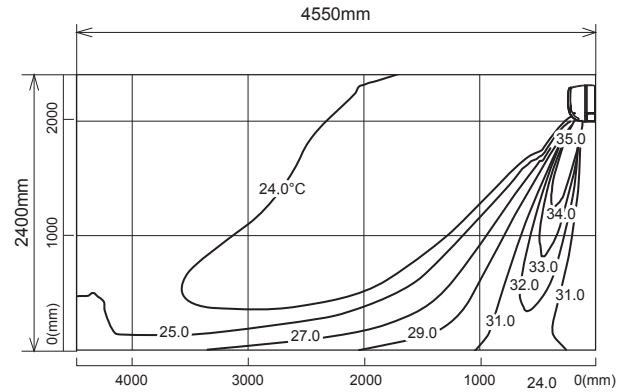

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

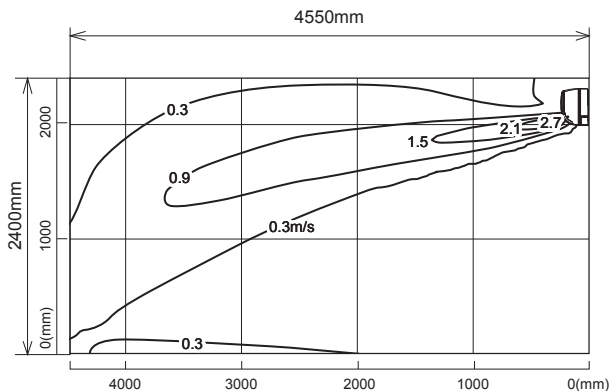

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

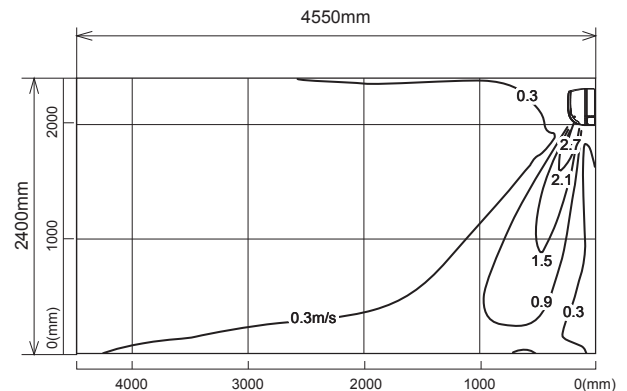


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-EF42VGW MSZ-EF42VGB MSZ-EF42VGS

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

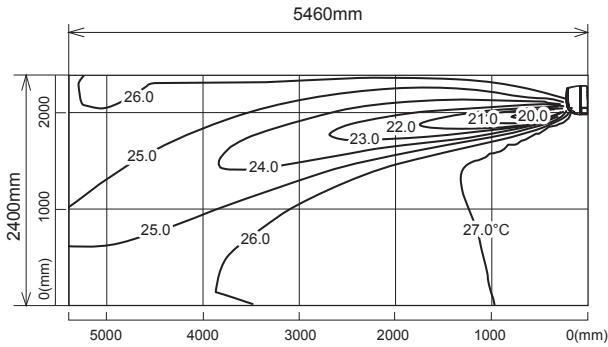

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

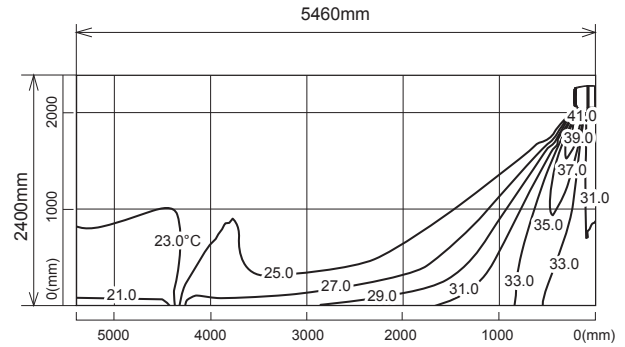

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

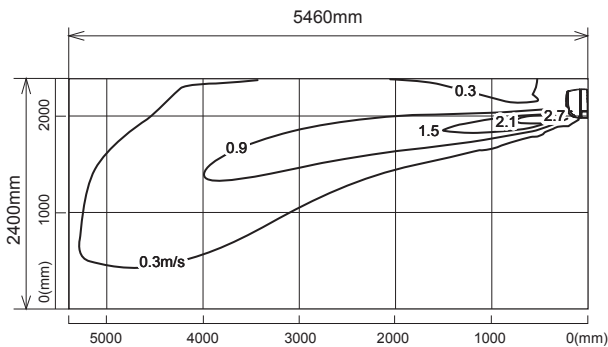

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

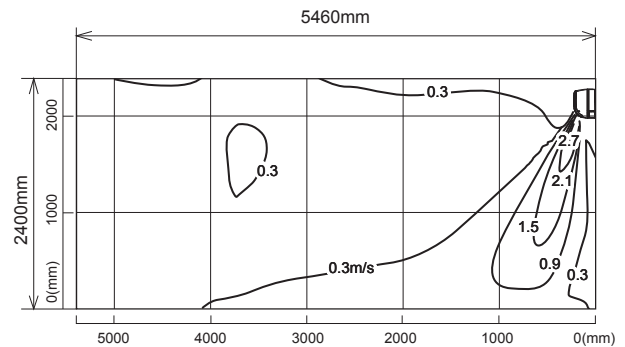

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-EF50VGW MSZ-EF50VGB MSZ-EF50VGS

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

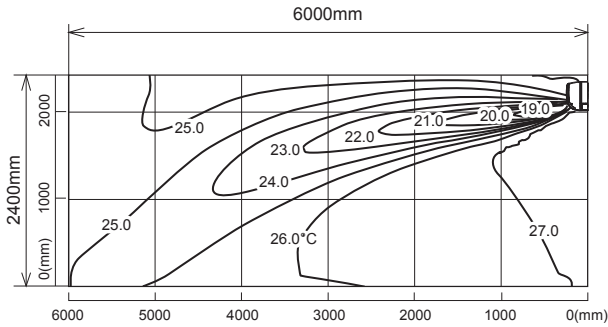

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

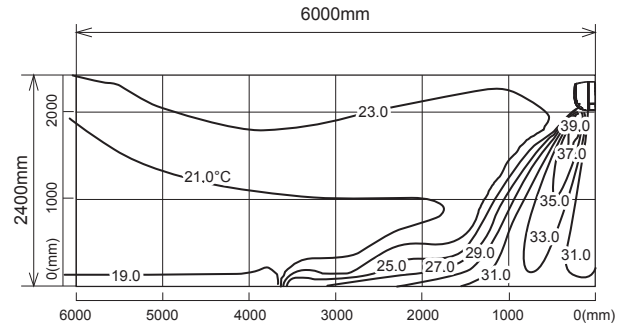

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

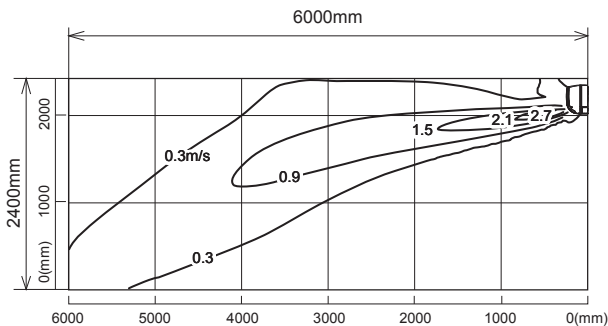

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

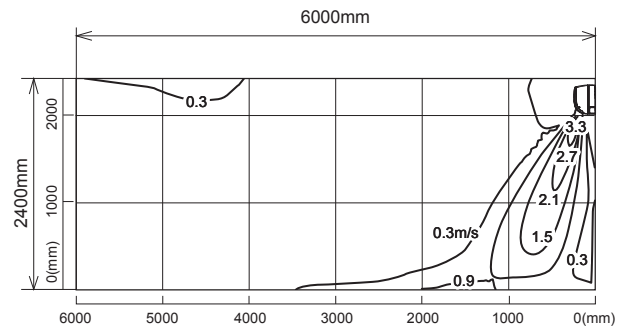

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-SF15VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

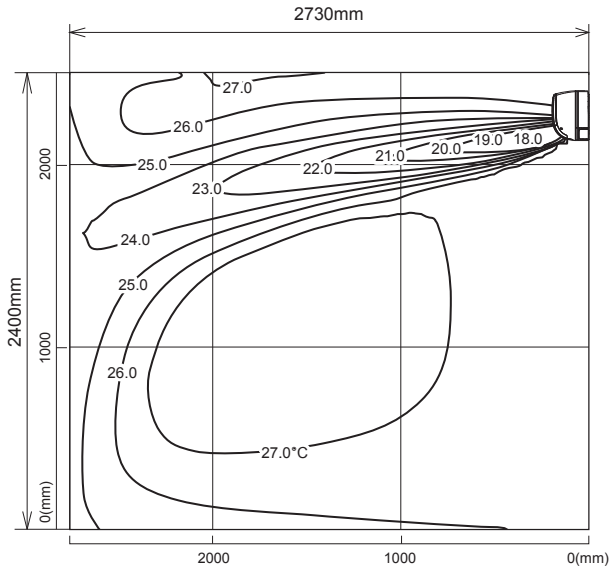

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

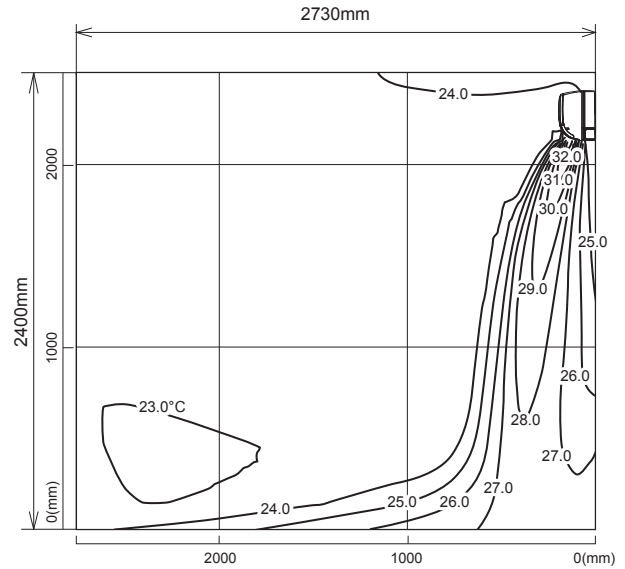

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

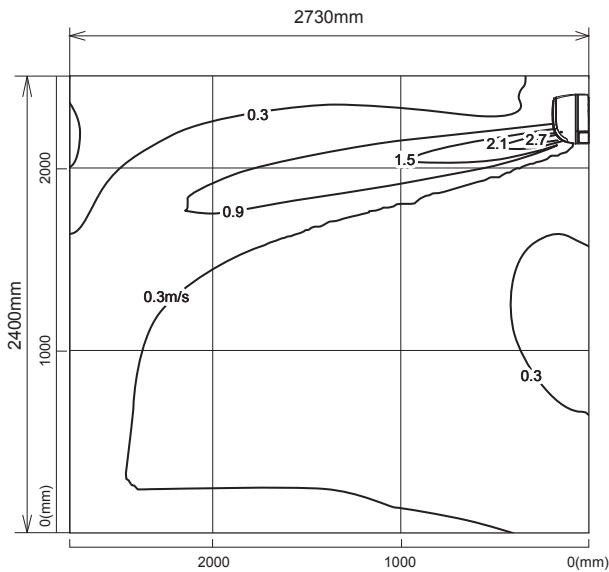

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

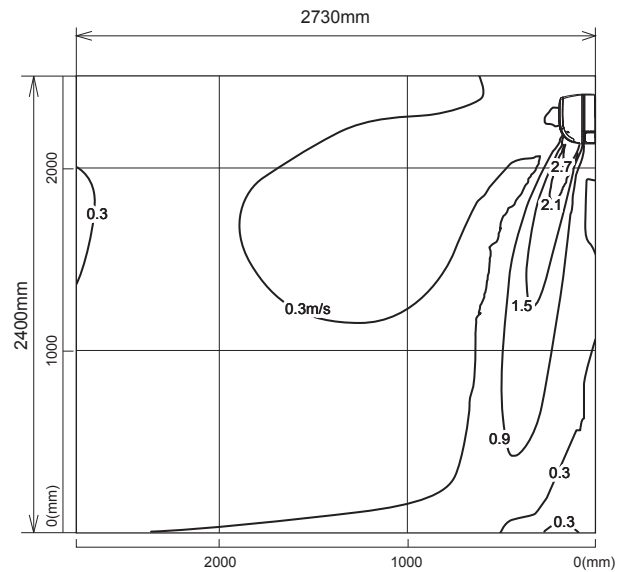

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-SF20VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

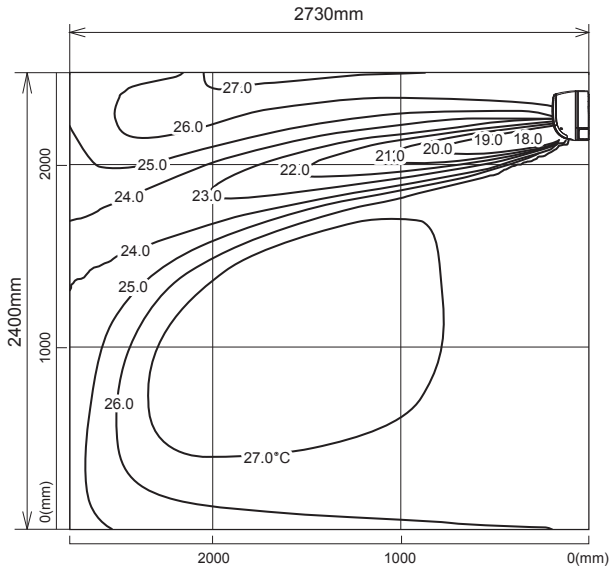

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

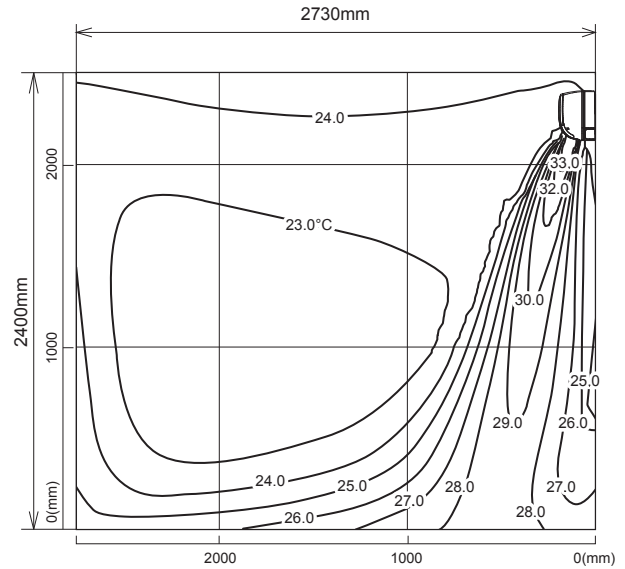

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

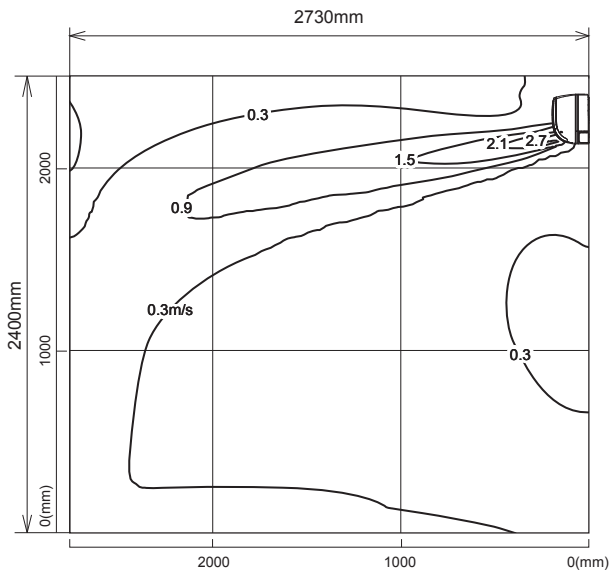

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

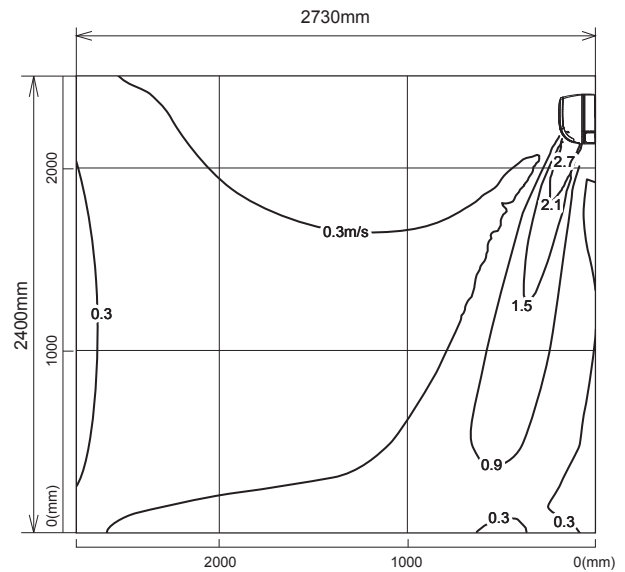

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-SF25VE3

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

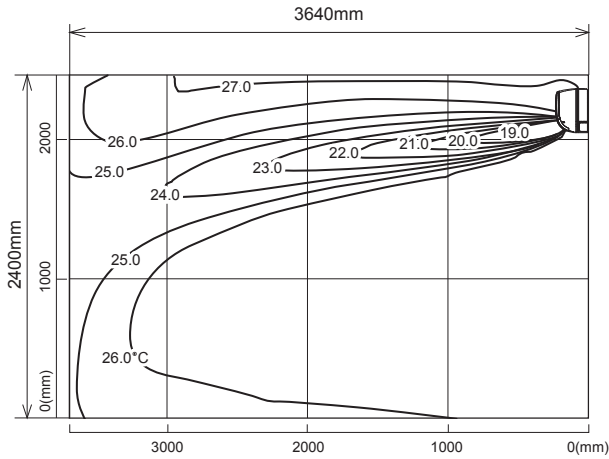

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

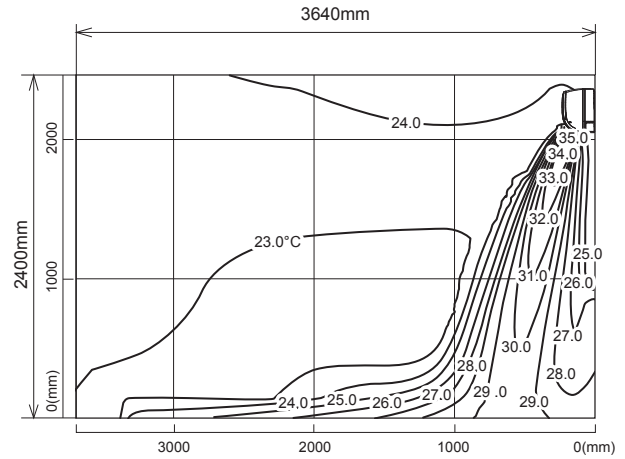

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

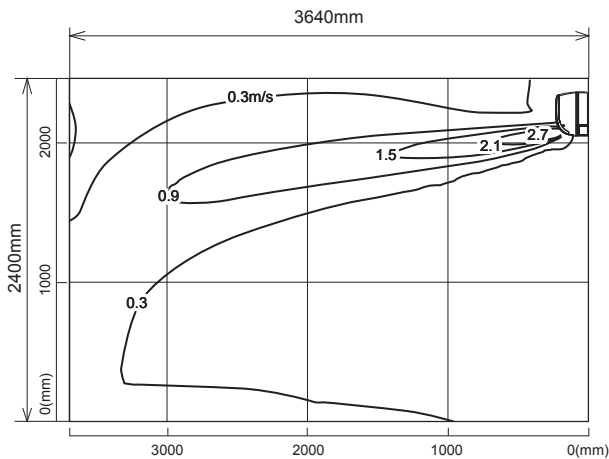

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

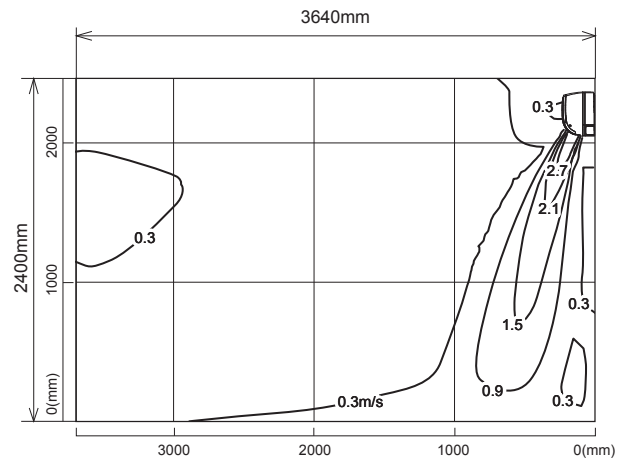

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-SF35VE3

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

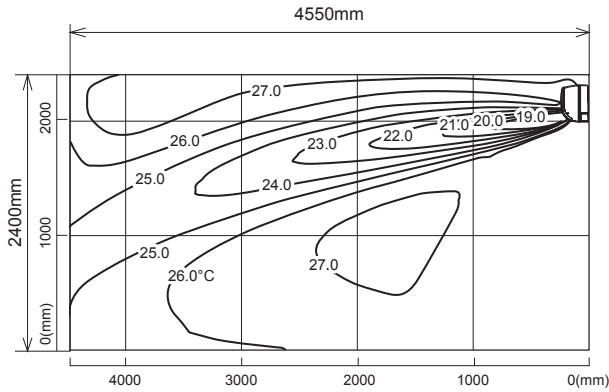

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

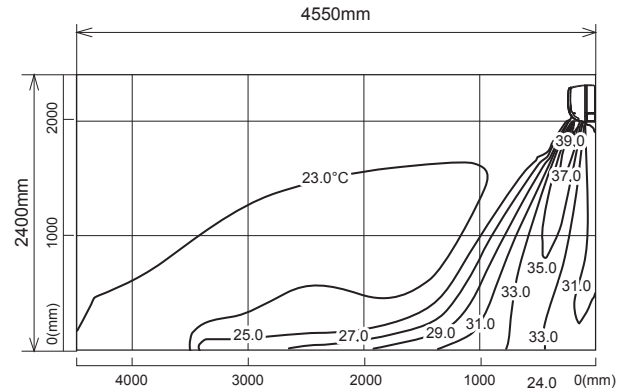

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

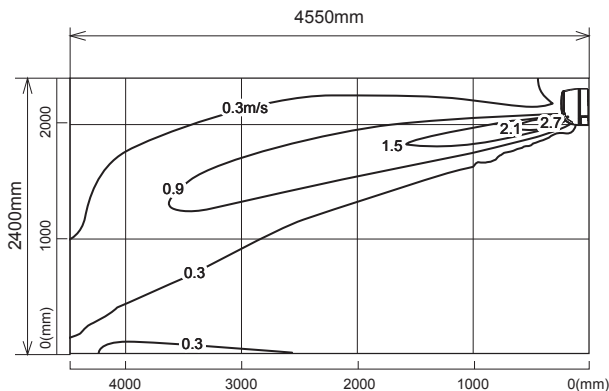

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

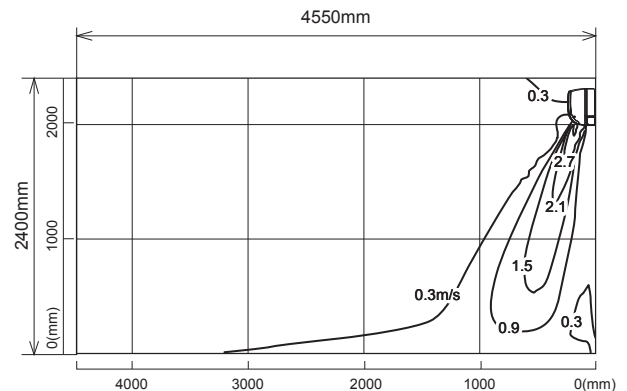


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-SF42VE3

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

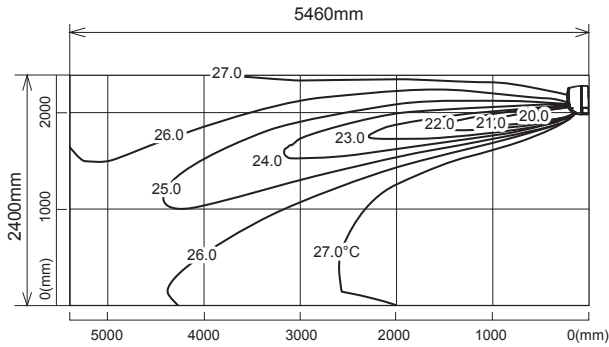

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

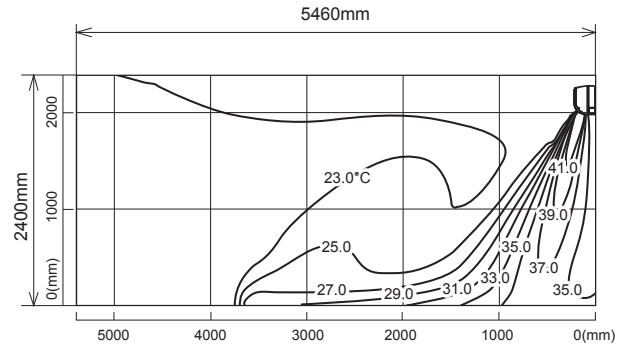

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

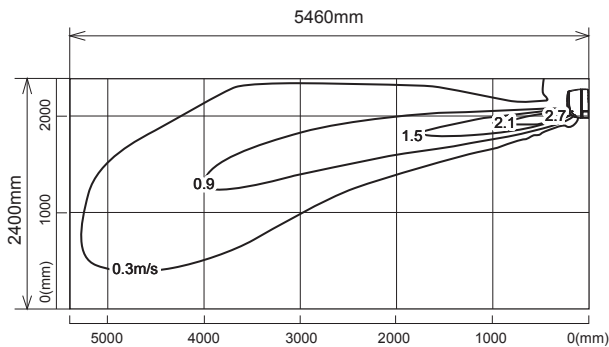

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

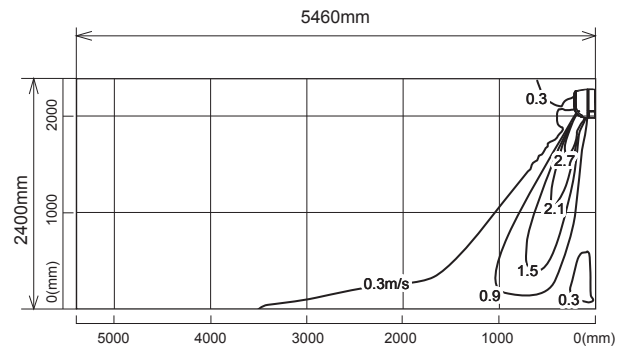

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-SF50VE3

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

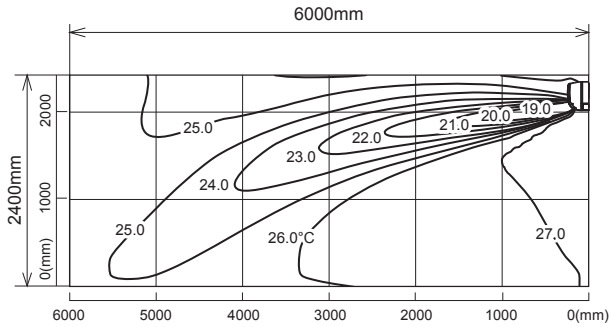

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

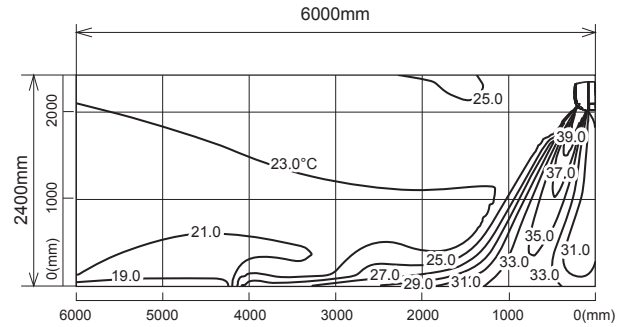

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

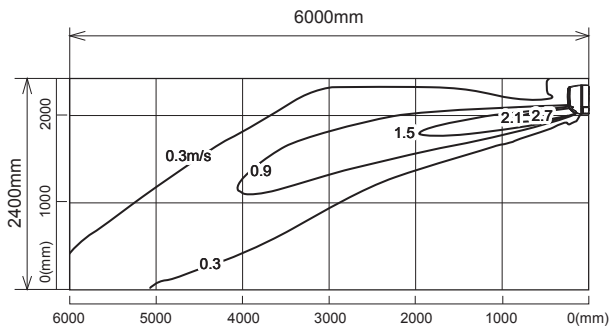

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

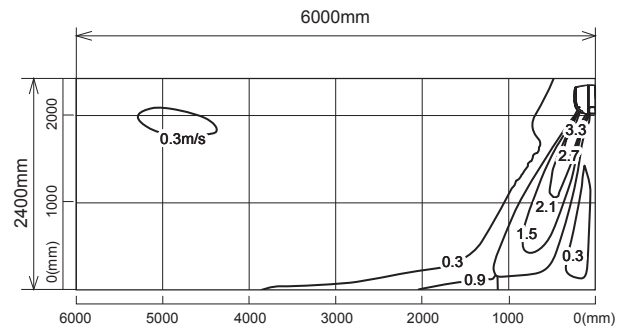


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-GF60VE2

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

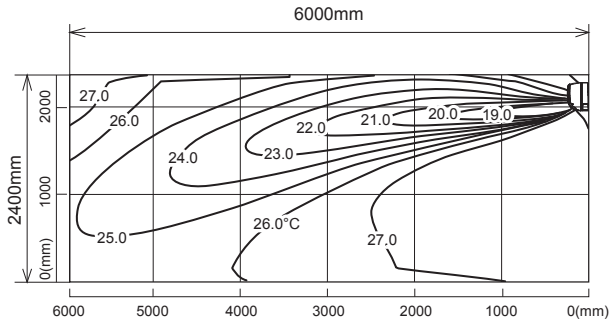

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

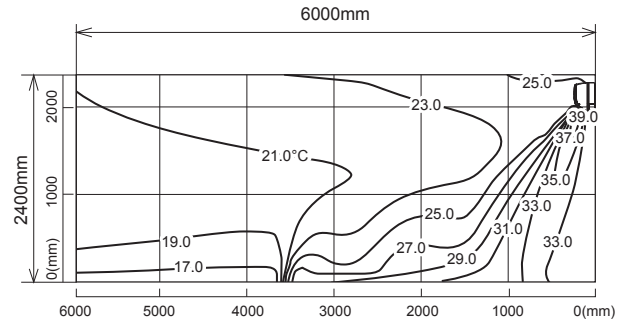

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

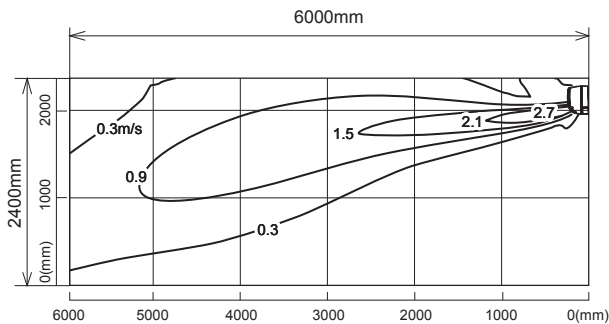

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

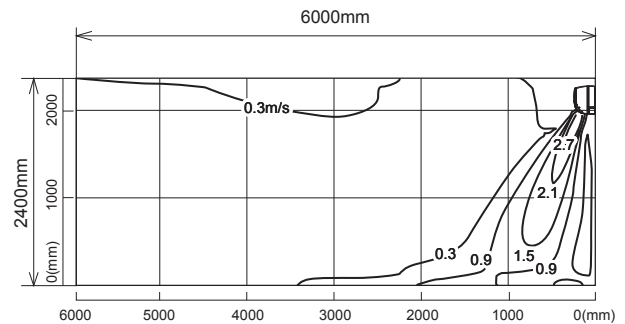

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-GF71VE2

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

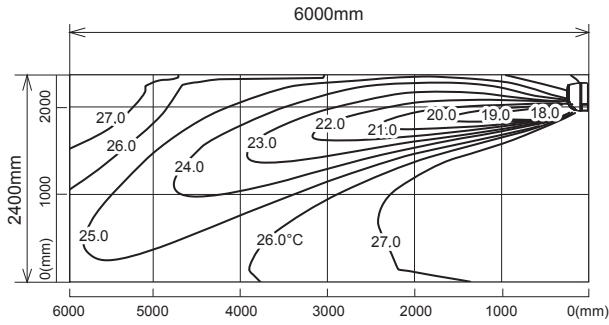

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

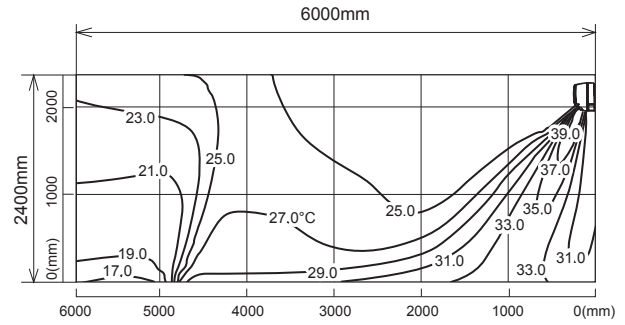

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

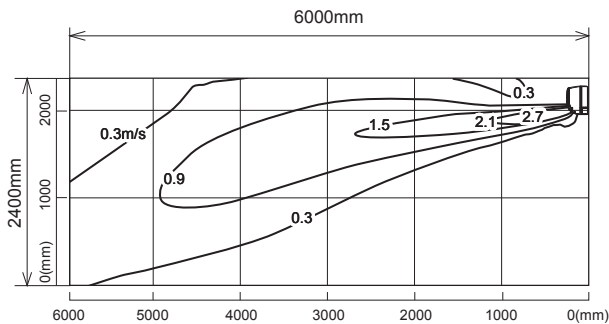

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

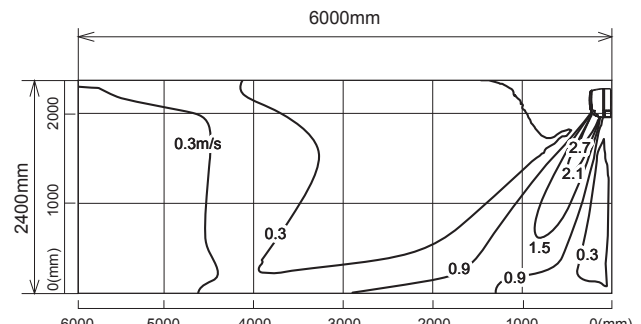

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-WN25VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

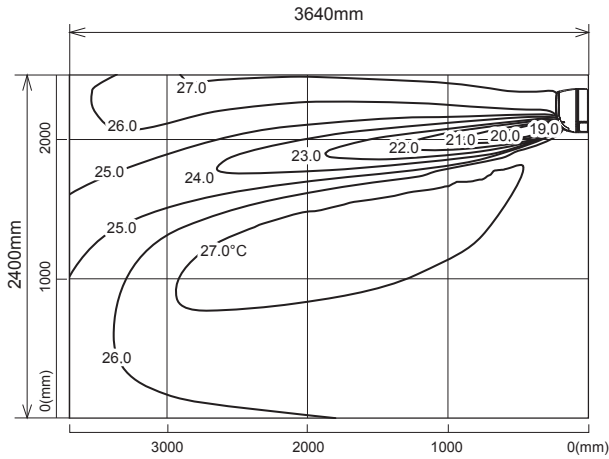

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

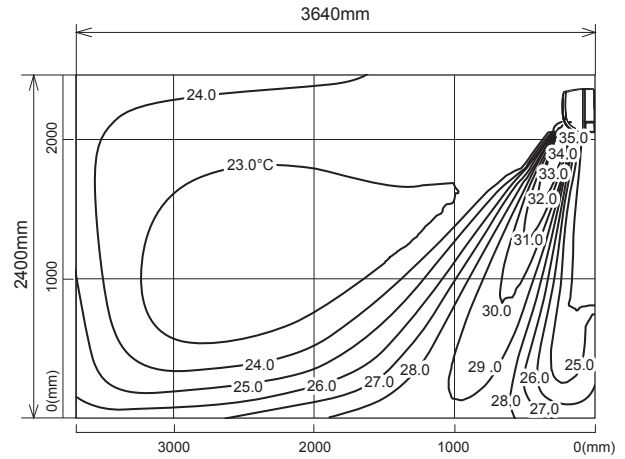

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

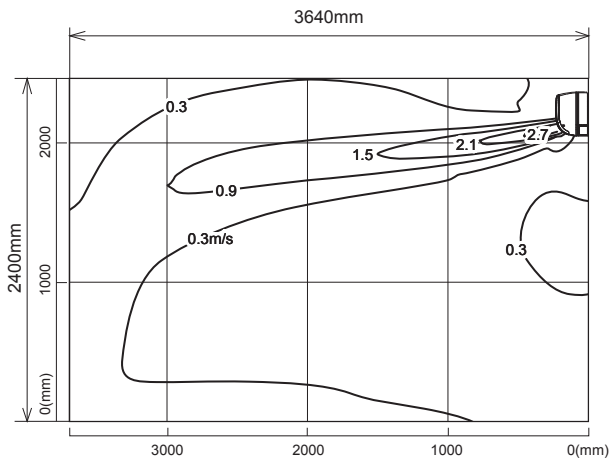

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

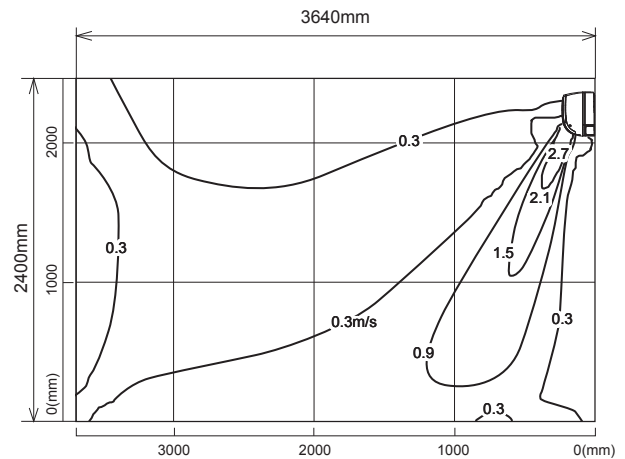

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-WN35VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

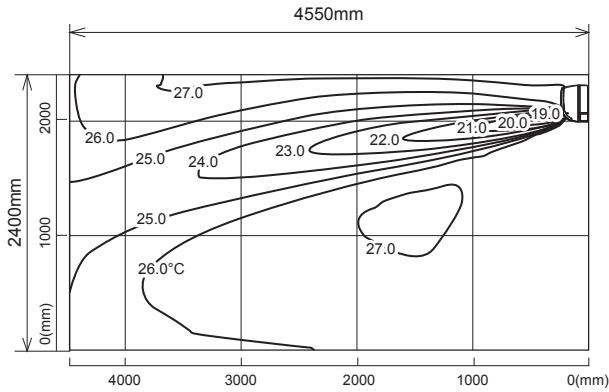

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

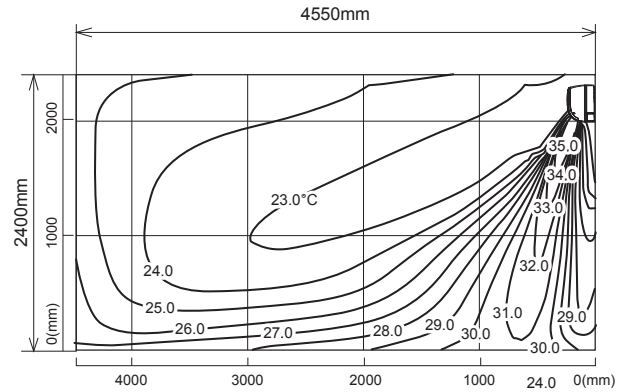

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

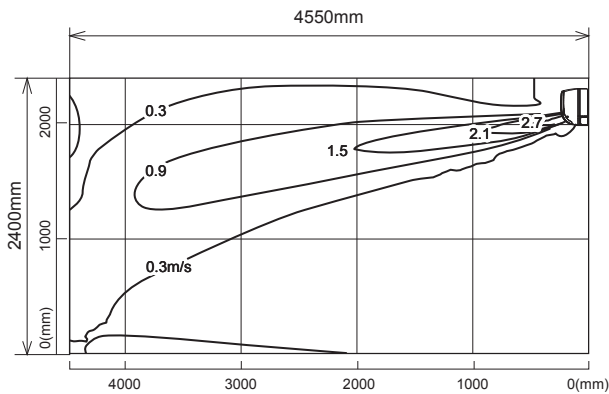

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

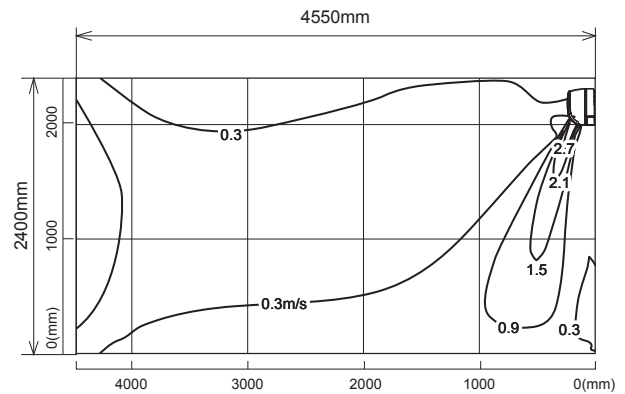

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-DM25VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

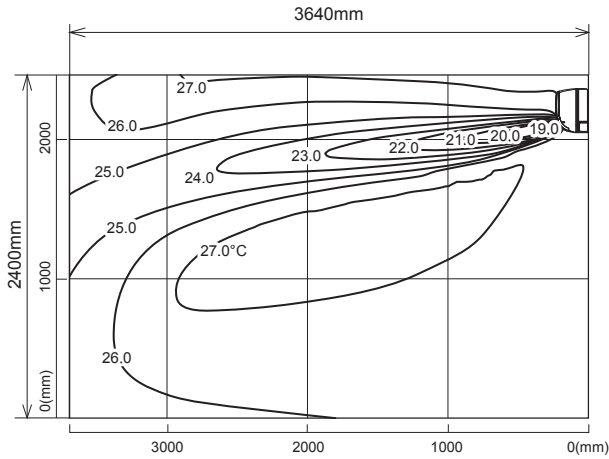

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

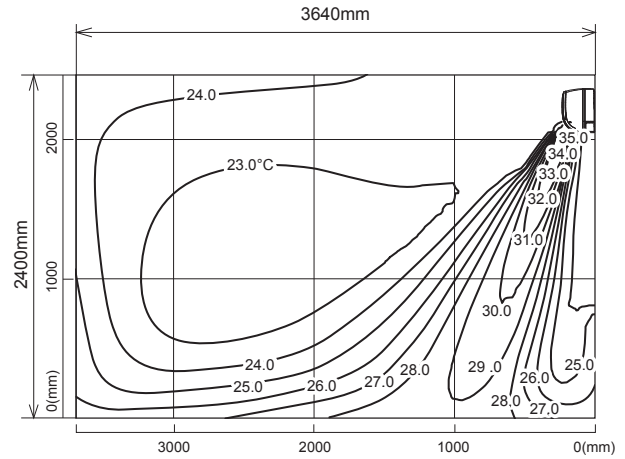

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

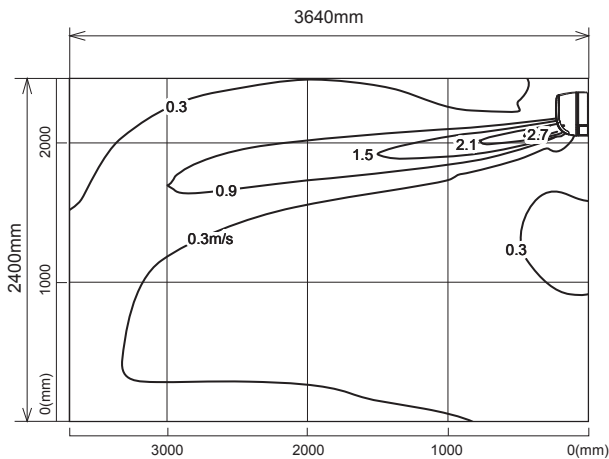

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

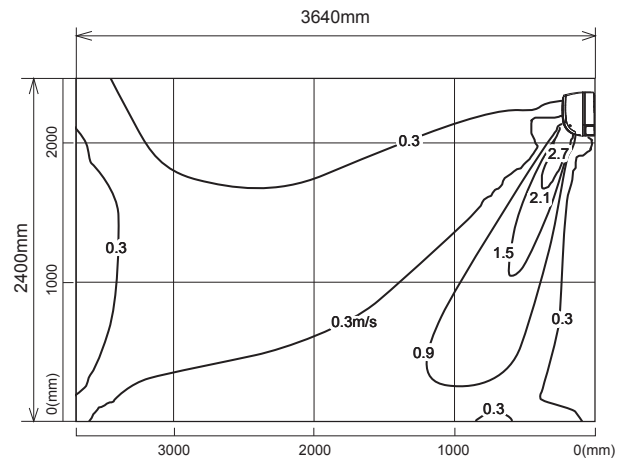

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-DM35VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

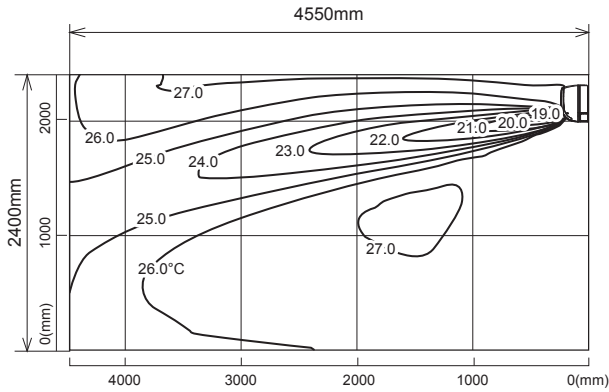

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

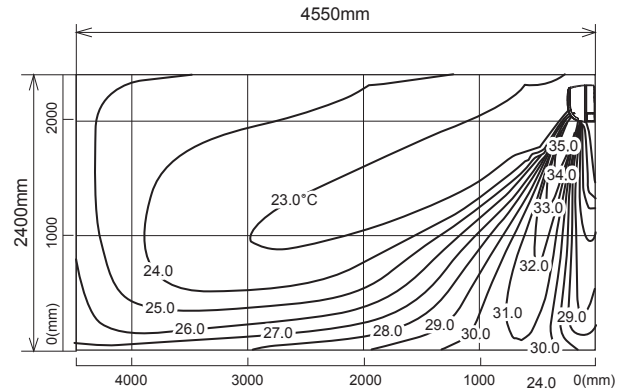

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

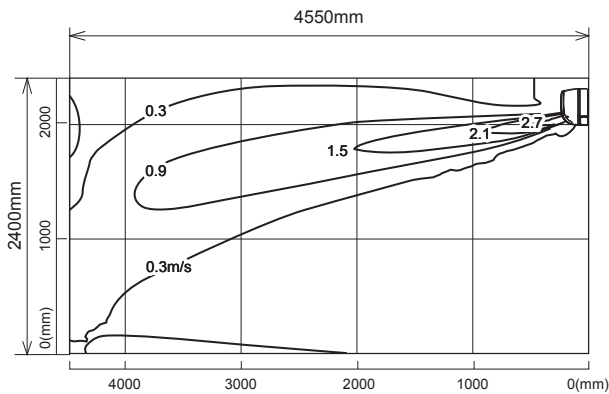

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

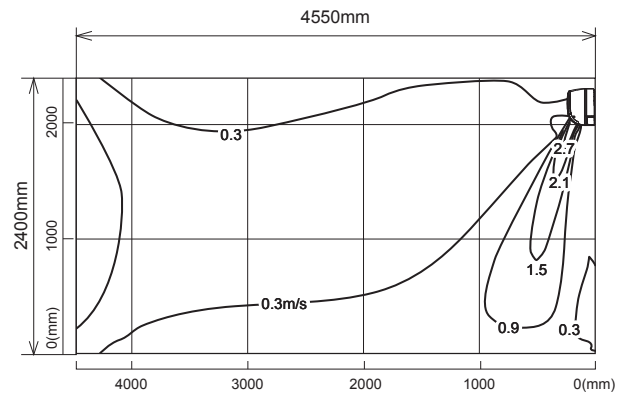

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-HJ25VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

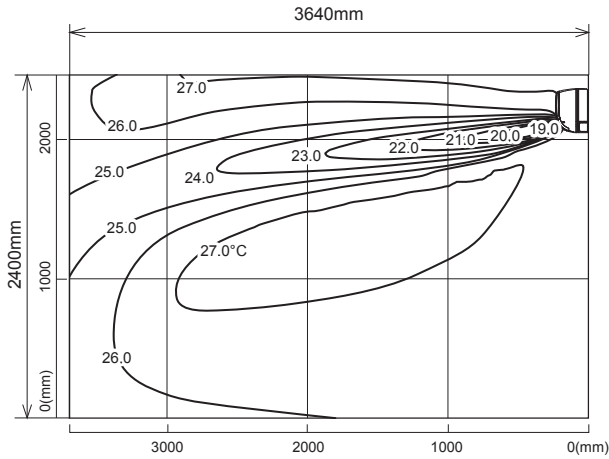

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

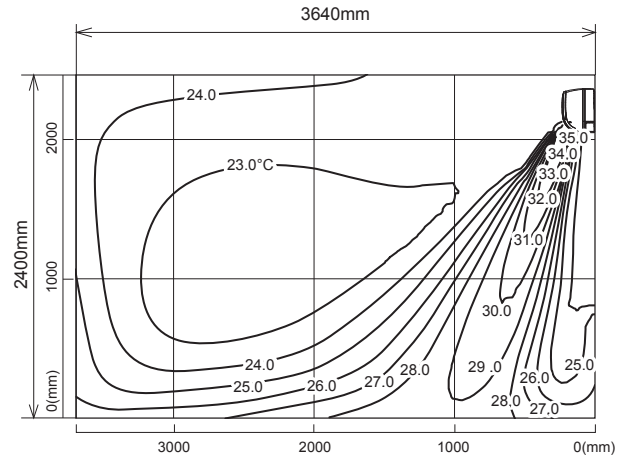

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

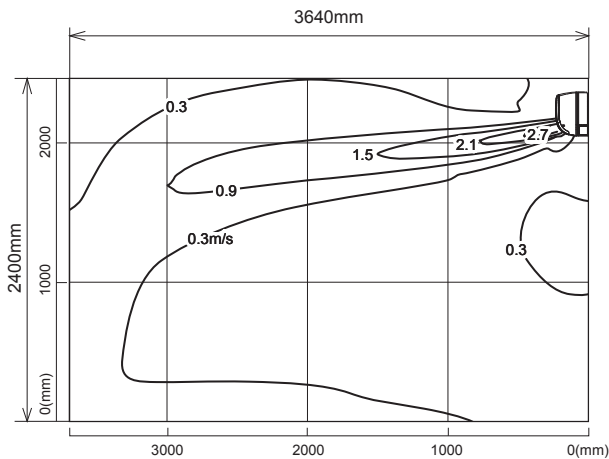

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

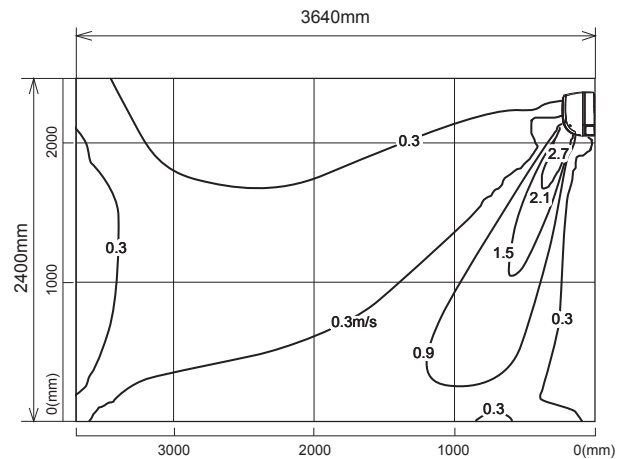

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-HJ35VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

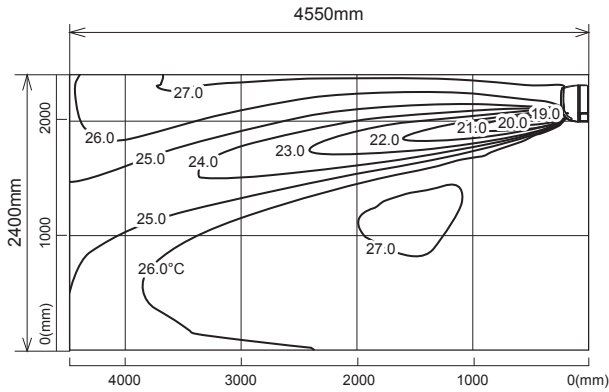

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

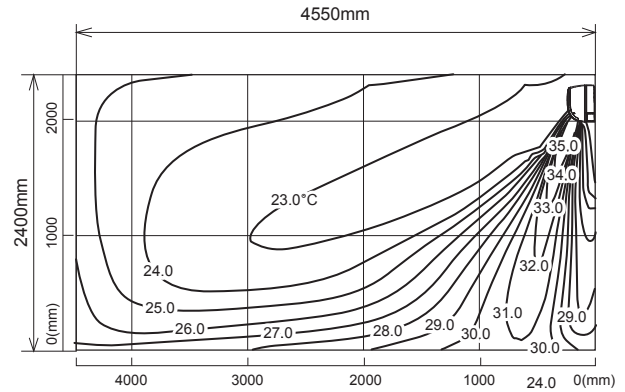

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

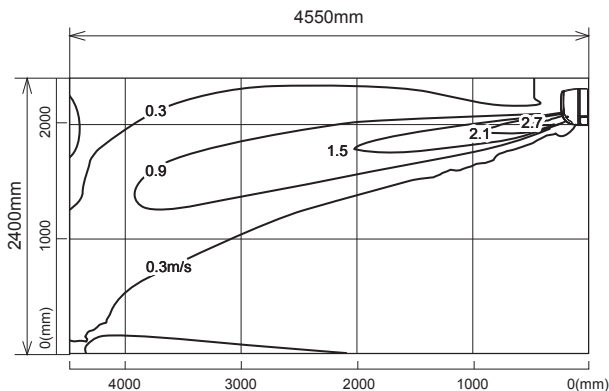

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

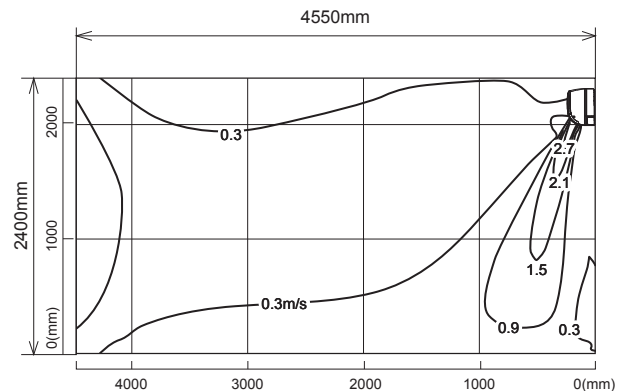

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


WALL-MOUNTED TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MSZ-HJ50VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

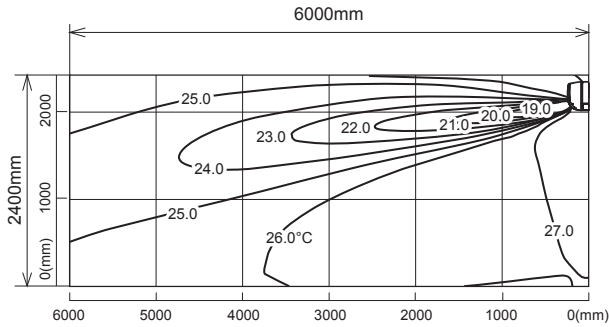

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

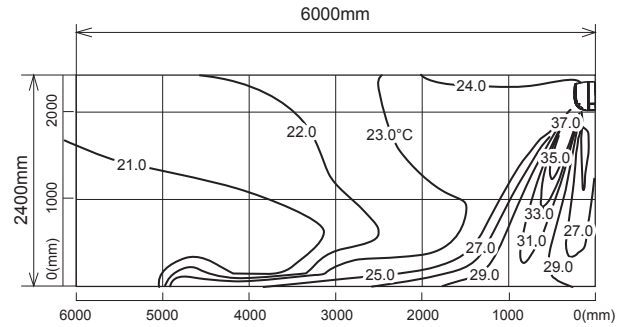

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

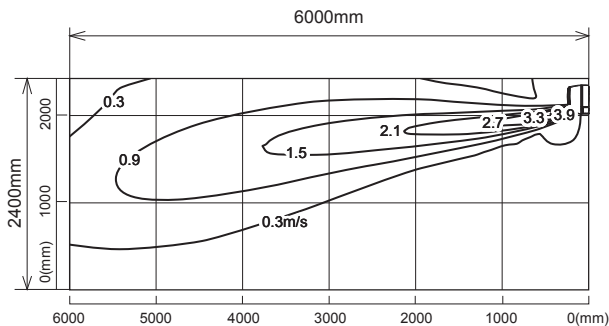

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

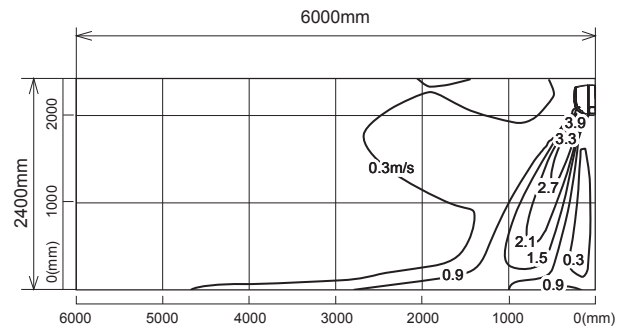

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

MSZ-HJ60VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

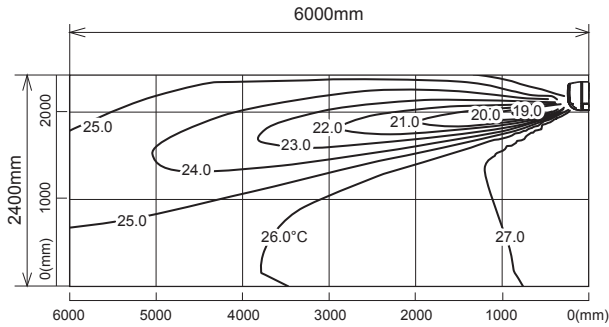

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

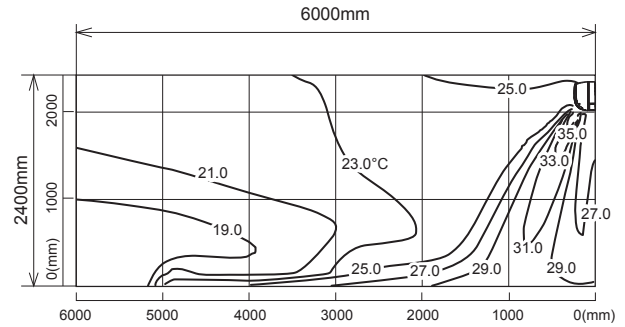

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

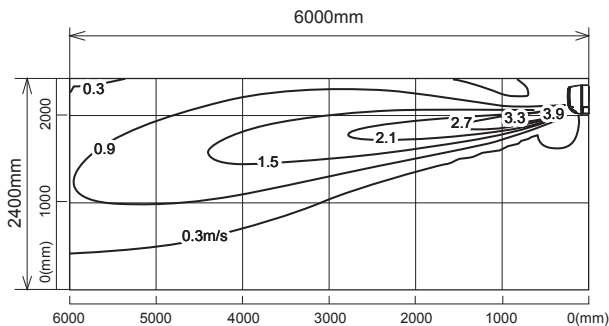

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

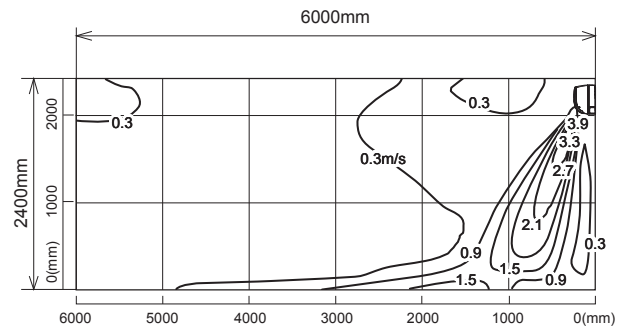


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MSZ-HJ71VA

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

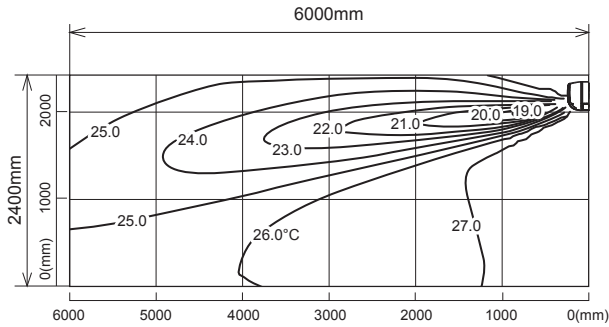

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

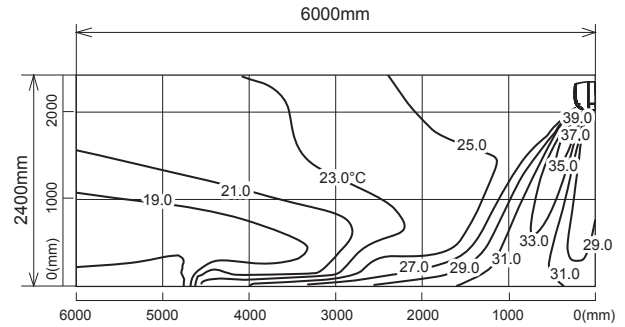

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

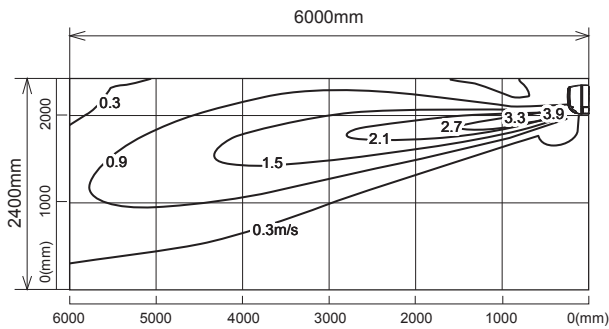

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

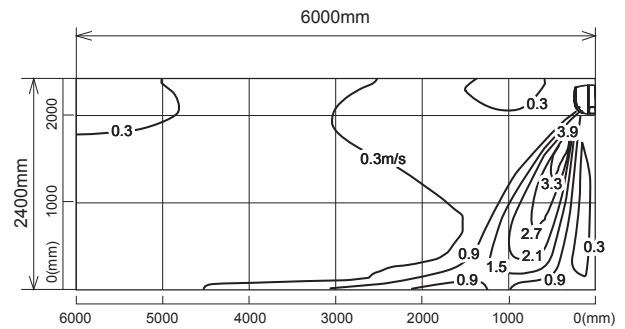

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS WALL-MOUNTED

C.1.9 OPERATION AND ACTUATOR CONTROL

C.1.9.1 MSZ-LN•VGW/V/B/R Series

- | | | | | |
|-------------|--------------|-------------|-------------|-------------|
| MSZ-LN18VGW | MSZ-LN25VGW | MSZ-LN35VGW | MSZ-LN50VGW | MSZ-LN60VGW |
| MSZ-LN18VGV | MSZ-LN25VGV | MSZ-LN35VGV | MSZ-LN50VGV | MSZ-LN60VGV |
| MSZ-LN18VGB | MSZ-LN25VGB | MSZ-LN35VGB | MSZ-LN50VGB | MSZ-LN60VGB |
| MSZ-LN18VGR | MSZ-LN25VGR | MSZ-LN35VGR | MSZ-LN50VGR | MSZ-LN60VGR |
| MUZ-LN25VG | MUZ-LN25VGHZ | | | |
| MUZ-LN35VG | MUZ-LN35VGHZ | | | |
| MUZ-LN50VG | MUZ-LN50VGHZ | | | |
| MUZ-LN60VG | | | | |

WIRELESS REMOTE CONTROLLER

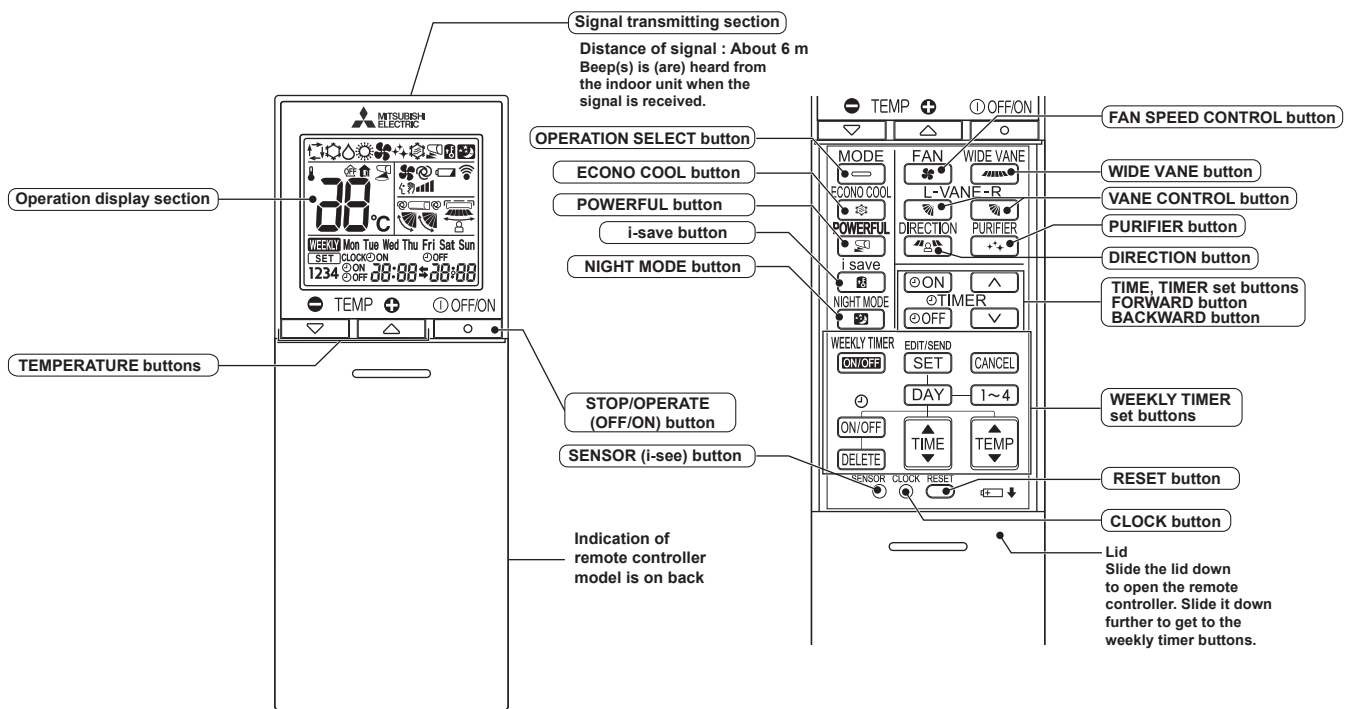



NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
 	Standby mode (Only during multi system operation)	—

-  Lit
-  Blinking
-  Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

3. Indoor fan speed control

When the thermostat turns OFF, the indoor fan operates very Low to reduce power consumption.

When the room temperature rises and the thermostat is ON, the indoor fan operates according to the settings on the remote controller.

b. DRY (☀️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

3. Indoor fan speed control

Indoor fan speed control works the same way as that in COOL mode. (a.3.)

c. FAN (🌀) OPERATION

- (1) OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (🔥) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 10 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection

- (1) Initial mode
When unit starts the operation with AUTO operation from OFF:
 - If the room temperature is higher than the set temperature, operation starts in COOL mode.
 - If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.
- (2) Mode change
COOL mode changes to HEAT mode when about 15 minutes have passed with the room temperature 1°C below the set temperature.
HEAT mode changes to COOL mode when about 15 minutes have passed with the room temperature 1°C above the set temperature.

NOTE 1:

If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.

Refer to **NOTE 2 “FOR MULTI SYSTEM AIR CONDITIONER”**.

NOTE 2:


FOR MULTI SYSTEM AIR CONDITIONER

OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect 2 or more indoor units with one outdoor unit.

- When you try to operate 2 or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp flashes as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR



- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with stepping motors for the horizontal vanes. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL () button.



NOTE: The right and left horizontal vanes set to the same level may not align perfectly.

(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation

Vane angle is fixed to Horizontal position.



In HEAT operation

Vane angle is fixed to Angle 4.



(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the lower position when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 1 for dew prevention.

(7) SWING (🌀) mode

By selecting SWING mode with VANE CONTROL button, the horizontal vanes swing vertically.
When COOL, DRY or FAN mode is selected, only the upper vane swings.

(8) Cold air prevention in HEAT operation

The horizontal vane position is set to Upward.

NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.

(9) ECONO COOL (🌡️) operation (ECONOMical operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed. Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.

To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, VANE CONTROL, LONG or POWERFUL button.

(10) POWERFUL (🔥) operation

The air conditioner automatically adjusts the fan speed and the set temperature, and operates the POWERFUL mode. The POWERFUL mode is cancelled automatically 15 minutes after operation starts, or when POWERFUL button is pressed once again within 15 minutes after operation starts. The operation mode returns to the mode prior to POWERFUL operation. To cancel this operation manually, select a different mode or press one of the following buttons within 15 minutes after operation starts: STOP/OPERATE (OFF/ON), ECONO COOL, FAN SPEED CONTROL or i-save button.


2. Vertical vane

(1) Vane motor drive

These models are equipped with a stepping motor for the vertical vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from microprocessor.

(2) The vertical vane angle and mode change as follows by pressing WIDE VANE CONTROL button.

(3) Positioning



To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

(a) STOP/OPERATE (OFF/ON) button is pressed (POWER ON).

(4) SWING (🌀) MODE

By selecting SWING mode with WIDE VANE CONTROL button, the vertical vane swings horizontally. The remote controller displays "🌀". Swing mode is cancelled when WIDE MODE CONTROL button is pressed once again.

g. TIMER OPERATION

1. How to set the time

(1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially “0:00” blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK button.

How to set the current time

(a) Press the CLOCK button.

(b) Press the TIME SET buttons (▲) and (▼) to set the current time.

- Each time FORWARD button (▲) is pressed, the set time increases by 1 minute, and each time BACKWARD button (▼) is pressed, the set time decreases by 1 minute.
- Pressing those buttons longer, the set time increases/decreases by 10 minutes.

(c) Press the CLOCK set button.

(2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.

(3) Set the time of timer.

ON timer setting

(a) Press ON TIMER button (⊕ON) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).

OFF timer setting

(a) Press OFF TIMER button (⊕OFF) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).

*Each time FORWARD button (▲) is pressed, the set time increases by 10 minutes: each time BACKWARD button (▼) is pressed, the set time decreases by 10 minutes.

2. To release the timer

To release ON timer, press ON TIMER button (⊕ON).

To release OFF timer, press OFF TIMER button (⊕OFF).

TIMER is cancelled and the display of set time disappears.

PROGRAM TIMER



- OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.
- “→” and “←” display shows the order of OFF timer and ON timer operation.

(Example 1) The current time is 8:00 PM.

The unit turns off at 11:00 PM, and on at 6:00 AM.

(Example 2) The current time is 11:00 AM.


The unit turns on at 5:00 PM, and off at 9:00 PM.

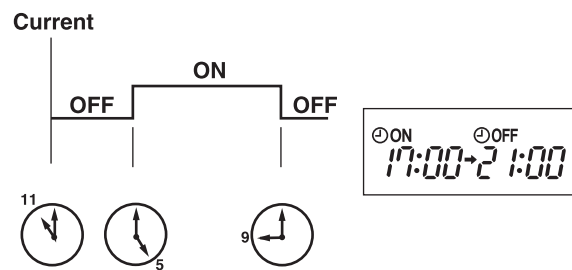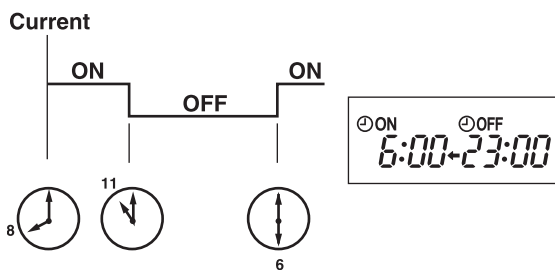

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

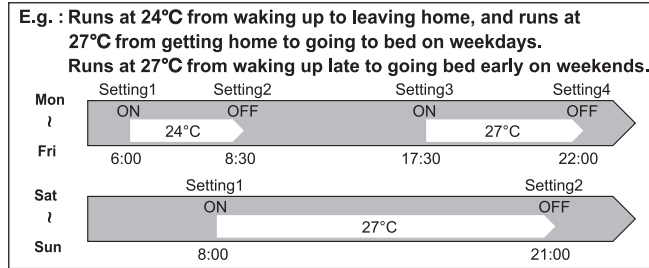


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

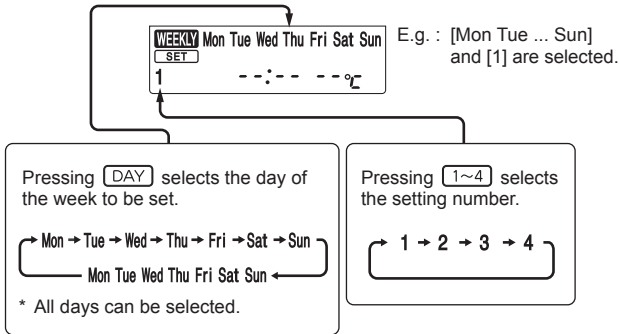


(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

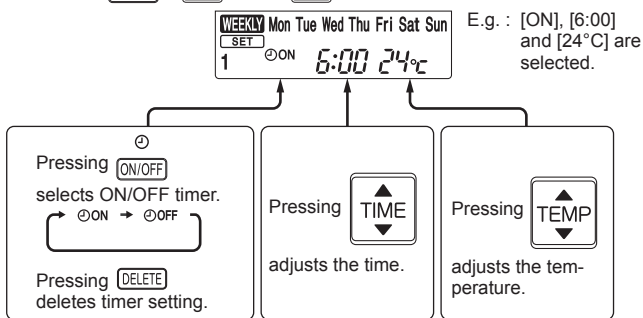


- * Hold down the button to change the time quickly.
- * The temperature can be set between 16°C and 31°C at COOL operation.
- * The temperature can be set between 10°C and 31°C at HEAT operation.






Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.



(4) Press  button to complete and transmit the weekly timer setting.





*  which was blinking goes out, and the current time will be displayed.

NOTE:

- Press  button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number,  button does not have to be pressed per each setting. Press  button once after all the settings are complete. All the weekly timer settings will be saved.
- Press  button to enter the weekly timer setting mode, and press and hold  button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press  button to turn the weekly timer ON. ( lights.)


•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press  button again to turn the weekly timer OFF. ( goes out.)



NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

(1) Press  button to enter the weekly timer setting mode.

*  blinks.

(2) Press  or  buttons to view the setting of the particular day or number.


(3) Press  button to exit the weekly timer setting.

NOTE:


When all days of the week are selected to view the settings and a different setting is included among them, --:-- °C will be displayed.

i. i-see CONTROL () MODE AND ABSENCE DETECTION

In the i-see control mode, the room temperature is controlled based on the sensible temperature.

(1) Press SENSOR button with a thin instrument during COOL, DRY, HEAT and AUTO mode to activate i-see control mode (). The default setting is "active".

(2) Press SENSOR button several times to cancel i-see control mode.



NOTE:

Any person at the following places cannot be detected:

- Along the wall on which the air conditioner is installed
- Directly under the air conditioner
- Where any obstacle, such as furniture, is between the person and the air conditioner

A person may not be detected in the following situations:

- Room temperature is high.
- A person wears heavy clothes and his/her skin is not exposed.
- A heating element of which temperature changes significantly is present.
- Some heat sources, such as a small child or pet, may not be sensed.
- A heat source and the air conditioner are more than 6 m apart.
- A heat source does not move for a long time.



Do not touch the i-see SENSOR. This may cause malfunction of the i-see SENSOR.

The intermittent operating sound is a normal sound produced when the i-see SENSOR is moving from side to side.

ABSENCE DETECTION (🏠)

This function automatically changes the operation to No occupancy energy-saving mode or No occupancy Auto-OFF mode when nobody is in the room.

- (1) To activate this No occupancy energy-saving mode, press SENSOR button until 🏠 appears on the operation display of the remote controller.
- (2) To activate this No occupancy Auto-OFF mode, press SENSOR button until OFF appears on the operation display of the remote controller.
- (3) Press SENSOR button again to cancel the ABSENCE DETECTION.

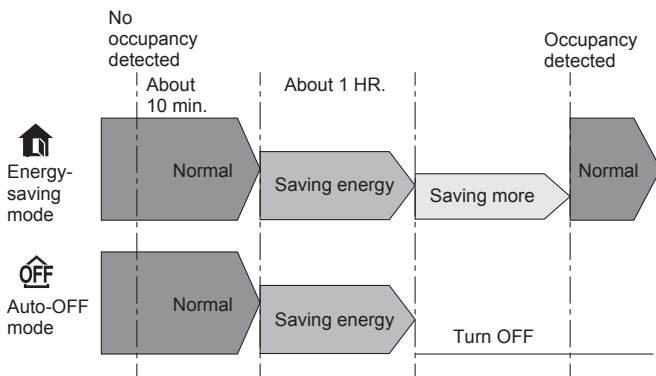


- Even if the unit is turned OFF due to No occupancy Auto-OFF mode, the display of the remote controller remains to indicate the unit is in operation. Press STOP/OPERATE(OFF/ON) button then press STOP/OPERATE(OFF/ON) button again to restart operation.
- When OFF timer is set, a priority is given to OFF timer.
- No occupancy energy saving mode or No occupancy Auto-OFF mode are not available during POWERFUL operation.
- The unit will not be turned off if no one is detected during normal operation mode, even though No occupancy Auto-OFF mode is activated.

j. AIRFLOW CONTROL MODE

AIRFLOW CONTROL mode offers air conditioning according to a location of an occupant in a room detected by i-see SENSOR.

- (1) Press DIRECTION button during COOL, DRY, HEAT or AUTO mode to activate the AIRFLOW CONTROL mode. This mode is only available when the i-see control mode is effective.

- (2) Each press of DIRECTION button changes AIRFLOW CONTROL in the following order:



- 🏠 (INDIRECT) : An occupant will be less exposed to direct airflow.
- 🏠 (DIRECT) : Mainly the vicinity of an occupant will be air-conditioned.
- 🏠 (EVEN) : The unit learns the area where an occupant spend most of the time, and evens out the temperature of that area.

NOTE:

- Horizontal and vertical airflow directions will be automatically selected.
- When more than a couple of people are in a room, the AIRFLOW CONTROL mode may work less effectively.
- If you still feel uncomfortable with the air direction determined by the INDIRECT mode, adjust the air direction manually.

- (3) Cancelling the i-see control mode automatically cancels the AIRFLOW CONTROL mode.
 - The AIRFLOW CONTROL mode is also cancelled when the VANE CONTROL or WIDE VANE buttons is pressed.

k. NIGHT MODE (🌙) OPERATION

NIGHT MODE changed the brightness of the operation indicator, disables the beep sound and limits the noise level of the outdoor unit.

(1) Press NIGHT MODE button during operation to activate NIGHT mode (🌙).

- The operation indicator lamp dims.
- The beep sound will be disabled except that emitted when the operation is started or stopped.
- Noise level of the outdoor unit will be lower than that mentioned in SPECIFICATIONS. (Except the connection to MXZ.)

(2) Press NIGHT MODE button to cancel NIGHT mode (🌙).

NOTE:

- Noise level of the outdoor unit may not change after startup of the unit, during the protection operation, or depending on other operating conditions.
- The fan speed of the indoor unit will not change.
- The operation indicator lamp will be hard to be seen in a bright room.
- Operating POWERFUL operation during NIGHT mode will increase the noise level of the outdoor unit.
- Noise level of the outdoor unit will not decrease during Multi system operation.

l. AIR PURIFYING (✚) OPERATION

In the AIR PURIFYING operation, the indoor unit built-in device reduces airborne fungi, viruses, mold, and allergens.

(1) Press PURIFIER button to start AIR PURIFYING operation.

- AIR PURIFYING lamp turns on. (Display section)

(2) Press PURIFIER button again to cancel AIR PURIFYING operation.

- AIR PURIFYING lamp turns off. (Display section)

NOTE:

- Never touch the air purifying device during operation. Although the air purifying device is safety-conscious design, touching this device could be the cause of trouble as this device discharge high voltage electricity.
- A "hissing" sound may be heard during the air purifying operation. This sound is produced when plasma is being discharged. This is not a malfunction.
- AIR PURIFYING lamp does not turn on if the front panel is not closed completely.

m. i-save (🔋) OPERATION**1. How to set i-save operation**

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL, HEAT or ECONO COOL mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY, FAN or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)



2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing POWERFUL button or OPERATION SELECT button to change the operation mode.



The same setting is select from the next time by simply pressing i-save button.




n. OPERATION LOCK

This function locks operation mode only. Other functions, such as OFF/ON, temperature setting, or airflow direction adjustment, are available.

(1) Hold down  button and  button simultaneously for 2 seconds while the unit is not operating to enable OPERATION LOCK.

The icon for the locked operation mode blinks.

(2) Hold down  button and  button simultaneously for 2 seconds again while the unit is not operating to disable OPERATION LOCK.

- The icon for the locked operation mode blinks when  button and  button are held down to enable or disable OPERATION LOCK or  button is pressed during operation while OPERATION LOCK is enabled.
- AIR PURIFYING operation is not available when OPERATION LOCK is enabled in a mode other than FAN mode.

o. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up. The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.



In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

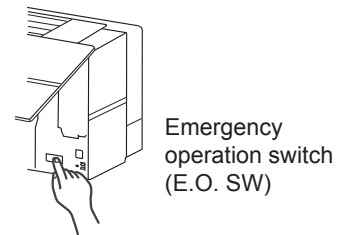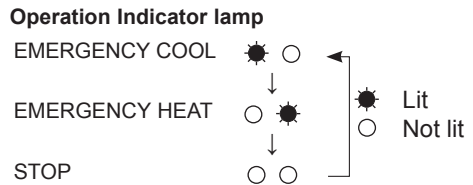

p. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


q. ACTUATOR CONTROL

q-1. OUTDOOR FAN MOTOR CONTROL

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.


[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

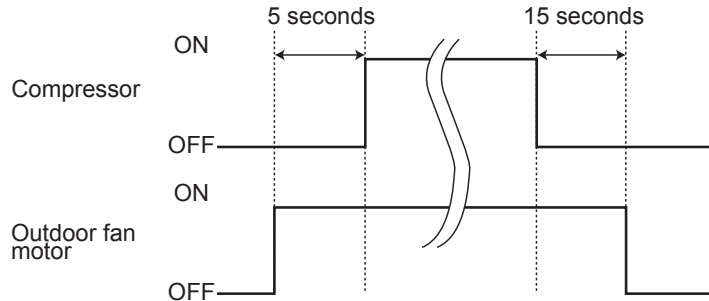

q-2. R.V. COIL CONTROL

- Heating ON
- Cooling OFF
- Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before startup of the compressor.

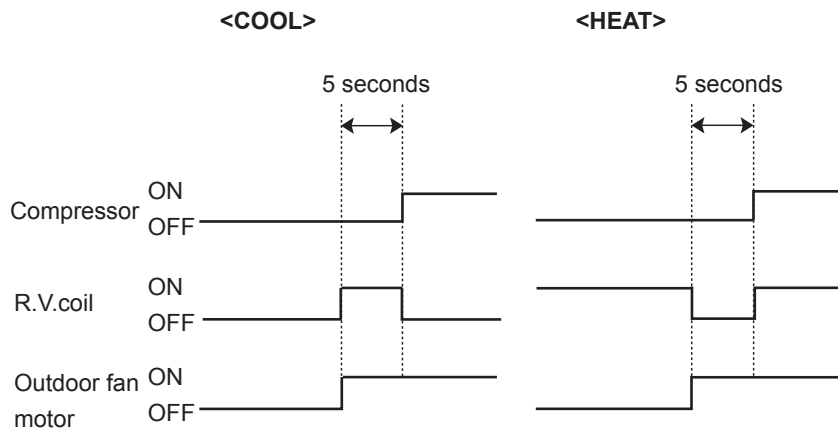


q-3. RELATION BETWEEN MAIN SENSOR AND ACTUATOR

Sensor	Purpose	Actuator					
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor	Defrost heater
Discharge temperature thermistor	Protection	○	○				
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○					
	Heating: High pressure protection	○	○				
Defrost thermistor	Heating: Defrosting	○	○	○	○	○	
Fin temperature thermistor	Protection	○		○			
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Heating: Defrosting (Heater)						○
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Cooling: High pressure protection	○	○	○			

C.1.9.2 MSZ-AP•VG Series
MSZ-AP15VG MSZ-AP20VG
MUZ-AP20VG

WIRELESS REMOTE CONTROLLER

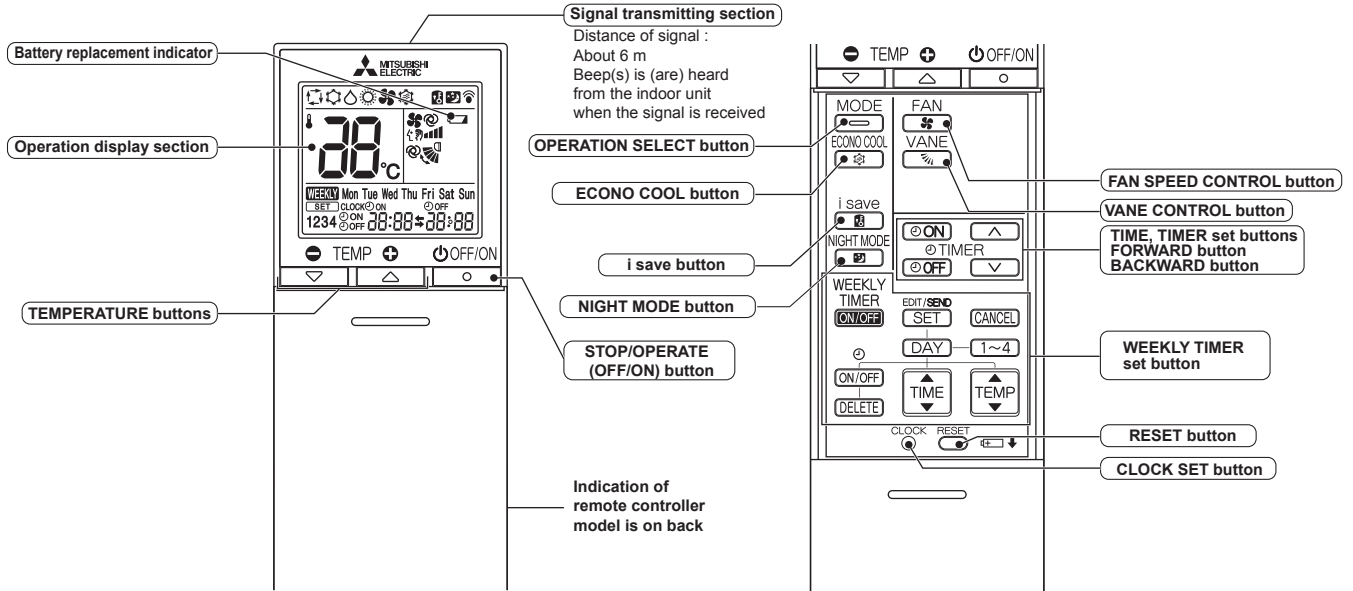

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
● ●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
● ○	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
● ☀	Standby mode (Only during multi system operation)	—

- Lit
- ☀ Blinking
- Not lit

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE(OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TEMP \ominus or \oplus button) to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

b. DRY (☀️) OPERATION

- (1) Press STOP/OPERATE(OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

c. FAN (🌀) OPERATION

- (1) OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (🔥) OPERATION

- (1) Press STOP/OPERATE(OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TEMP \ominus or \oplus button) to select the desired temperature. The setting range is 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection

(1) Initial mode

When unit starts the operation with AUTO operation from OFF:

- If the room temperature is higher than the set temperature, operation starts in COOL mode.
- If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.

(2) Mode change

COOL mode changes to HEAT mode when about 15 minutes has passed with the room temperature 1°C below the set temperature.

HEAT mode changes to COOL mode when about 15 minutes has passed with the room temperature 1°C above the set temperature.

NOTE 1

If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.

Refer to **NOTE 2 “FOR MULTI SYSTEM AIR CONDITIONER”**.


NOTE 2

FOR MULTI SYSTEM AIR CONDITIONER OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect 2 or more indoor units with one outdoor unit.

- When you try to operate 2 or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp blinks as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR

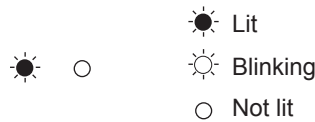

- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In HEAT operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.


Confirming of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation
Vane angle is fixed to Horizontal position.



In HEAT operation
Vane angle is fixed to Angle 4.



- (5) STOP (operation OFF) and ON TIMER standby
 In the following cases, the horizontal vane returns to the closed position.
 (a) When STOP/OPERATE(OFF/ON) button is pressed (POWER OFF).
 (b) When the operation is stopped by the emergency operation.
 (c) When ON TIMER is ON standby.
- (6) Dew prevention
 During COOL or DRY operation with the vane angle at Angle 4 or 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 1 for dew prevention.
- (7) SWING (🌀) mode
 By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.
- (8) Cold air prevention in HEAT operation
 The horizontal vane position is set to Upward.
NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.
- (9) ECONO COOL (🌀) operation (ECONOMical operation)
 When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed.
 Also the horizontal vane swings in various cycle.
 SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.
 To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation:
 ECONO COOL, VANE CONTROL button.

g. TIMER OPERATION

1. How to set the time

- (1) Check that the current time is set correctly.
NOTE: Timer operation will not work without setting the current time. Initially "0:00" blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.
- How to set the current time**
- (a) Press the CLOCK set button.
- (b) Press the TIME SET buttons (⏮) and (⏭) to set the current time.
- Each time FORWARD button (⏮) is pressed, the set time increases by 1 minute, and each time BACKWARD button (⏭) is pressed, the set time decreases by 1 minute.
 - Pressing those buttons longer, the set time increases/decreases by 10 minutes.
- (c) Press the CLOCK set button.
- (2) Press STOP/OPERATE(OFF/ON) button to start the air conditioner.
- (3) Set the time of timer.

ON timer setting

- (a) Press ON TIMER button (⏻) during operation.
- (b) Set the time of the timer using TIME SET buttons (⏮) and (⏭). ※

OFF timer setting

- (a) Press OFF TIMER button (⏻) during operation.
- (b) Set the time of the timer using TIME SET buttons (⏮) and (⏭). ※
- ※ Each time FORWARD button (⏮) is pressed, the set time increases by 10 minutes: each time BACKWARD button (⏭) is pressed, the set time decreases by 10 minutes.


2. To release the timer

- To release ON timer, press ON TIMER button (⏻).
- To release OFF timer, press OFF TIMER button (⏻).
- TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

- OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.
- “←” and “→” display shows the order of OFF timer and ON timer operation.

(Example 1) The current time is 8:00 PM.
The unit turns off at 11:00 PM, and on at 6:00 AM.

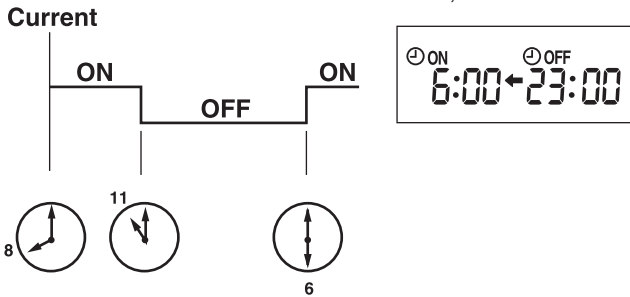


(Example 2) The current time is 11:00 AM.
The unit turns on at 5:00 PM, and off at 9:00 PM.

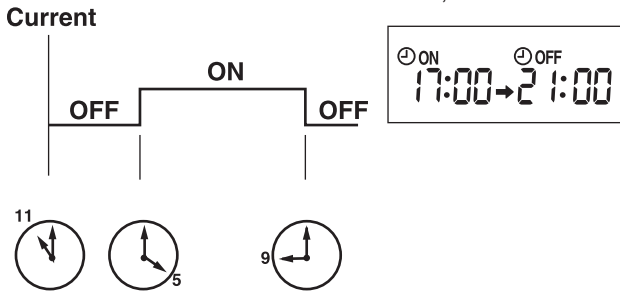

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

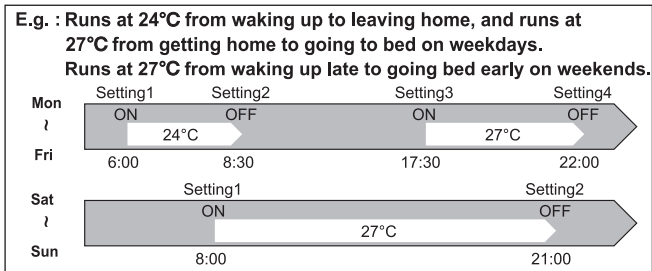


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature cannot be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.



1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND** **SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

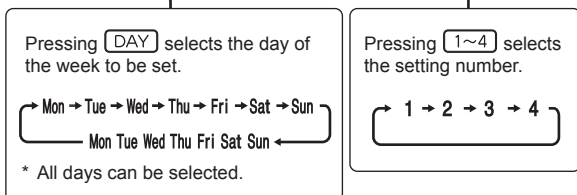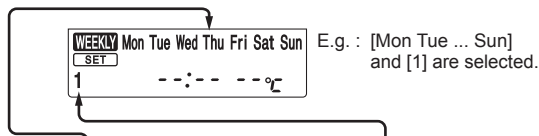


(3) Press , , and buttons to set ON/OFF, time, and temperature.

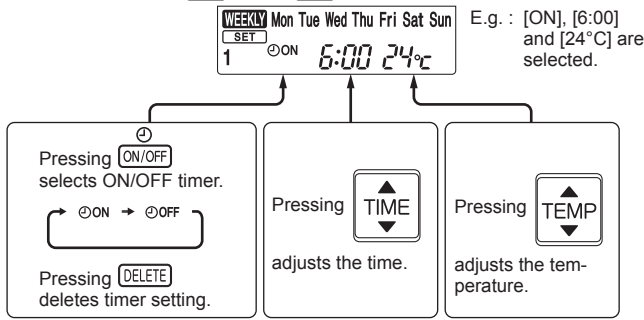

* Hold down the button to change the time quickly.

Press and to continue setting the timer for other days and/or numbers.

(4) Press button to complete and transmit the weekly timer setting.



NOTE:

- Press button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number, button does not have to be pressed per each setting. Press button once after all the settings are complete. All the weekly timer settings will be saved.
- Press button to enter the weekly timer setting mode, and press and hold button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press button to turn the weekly timer ON. ()

•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press button again to turn the weekly timer OFF. ()

NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

(1) Press button to enter the weekly timer setting mode.

* blinks.

(2) Press or buttons to view the setting of the particular day or number.

(3) Press button to exit the weekly timer setting.

NOTE:

When all days of the week are selected to view the settings and a different setting is included among them, will be displayed.

i. NIGHT MODE (🌙) OPERATION

NIGHT MODE changes the brightness of the operation indicator, disables the beep sound and limits the noise level of the outdoor unit.

(1) Press NIGHT MODE button during operation to activate NIGHT MODE (🌙).

- The operation indicator lamp dims.
- The beep sound will be disabled except that emitted when the operation is started or stopped.
- Noise level of the outdoor unit will be lower than that mentioned in SPECIFICATIONS.(Except the connection to **MXZ**.)

(2) Press NIGHT MODE button to cancel NIGHT MODE (🌙).

NOTE:

- The cooling / heating capacity may drop.
- Noise level of the outdoor unit may not change after startup of the unit, during the protection operation, or depending on other operating conditions.
- The fan speed of the indoor unit will not change.
- The operation indicator lamp will be hard to be seen in a bright room.
- Noise level of the outdoor unit will not decrease during Multi system operation.
- Operating POWERFUL operation during NIGHT MODE operation will increase the noise level of the outdoor unit.
- Noise level of the outdoor unit will not decrease during Multi system operation.

j. i-save (i) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE(OFF/ON) button.
- (2) Select COOL, HEAT, ECONO COOL or NIGHT MODE.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.

2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode. The same setting is selected from the next time by simply pressing i-save button.

k. EMERGENCY/TEST OPERATION


In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work. After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med. The coil frost prevention works even in the test run or the emergency operation. In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode. Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.


Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Medium
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

Operation Indicator lamp

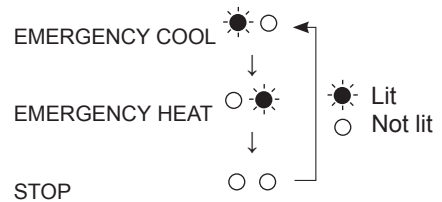

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

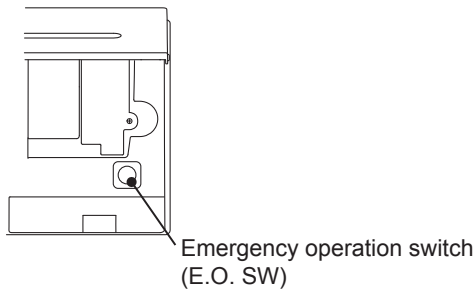

l. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED


m. ACTUATOR CONTROL

m-1. OUTDOOR FAN MOTOR CONTROL

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

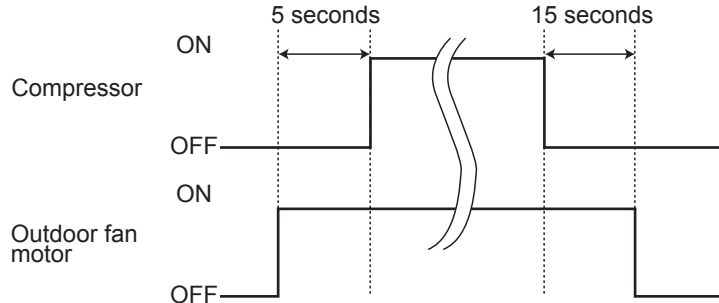


m-2. R.V. COIL CONTROL

Heating ON

Cooling OFF

Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

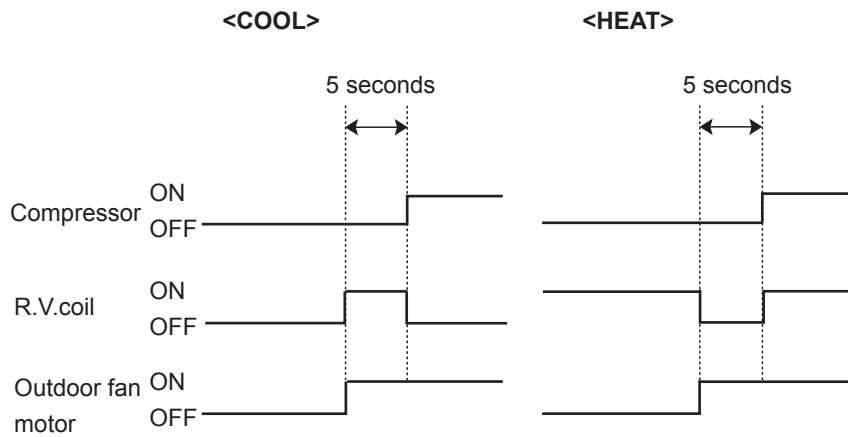

m-3. RELATION BETWEEN MAIN SENSOR AND ACTUATOR


Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○	○			
Defrost thermistor	Heating: Defrosting	○	○	○	○	○
Fin temperature thermistor	Protection	○		○		
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○		
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○		
	Cooling: High pressure protection	○	○	○		

C.1.9.3 MSZ-AP•VG(K) Series


MSZ-AP25VG	MSZ-AP25VGK	MUZ-AP25VG	MUZ-AP25VGH
MSZ-AP35VG	MSZ-AP35VGK	MUZ-AP35VG	MUZ-AP35VGH
MSZ-AP42VG	MSZ-AP42VGK	MUZ-AP42VG	MUZ-AP42VGH
MSZ-AP50VG	MSZ-AP50VGK	MUZ-AP50VG	MUZ-AP50VGH
MSZ-AP60VG	MSZ-AP60VGK	MUZ-AP60VG	
MSZ-AP71VG	MSZ-AP71VGK	MUZ-AP71VG	

WIRELESS REMOTE CONTROLLER

MSZ-AP25VG	MSZ-AP25VGK	MUZ-AP25VG	MUZ-AP25VGH
MSZ-AP35VG	MSZ-AP35VGK	MUZ-AP35VG	MUZ-AP35VGH
MSZ-AP42VG	MSZ-AP42VGK	MUZ-AP42VG	MUZ-AP42VGH
MSZ-AP50VG	MSZ-AP50VGK	MUZ-AP50VG	MUZ-AP50VGH

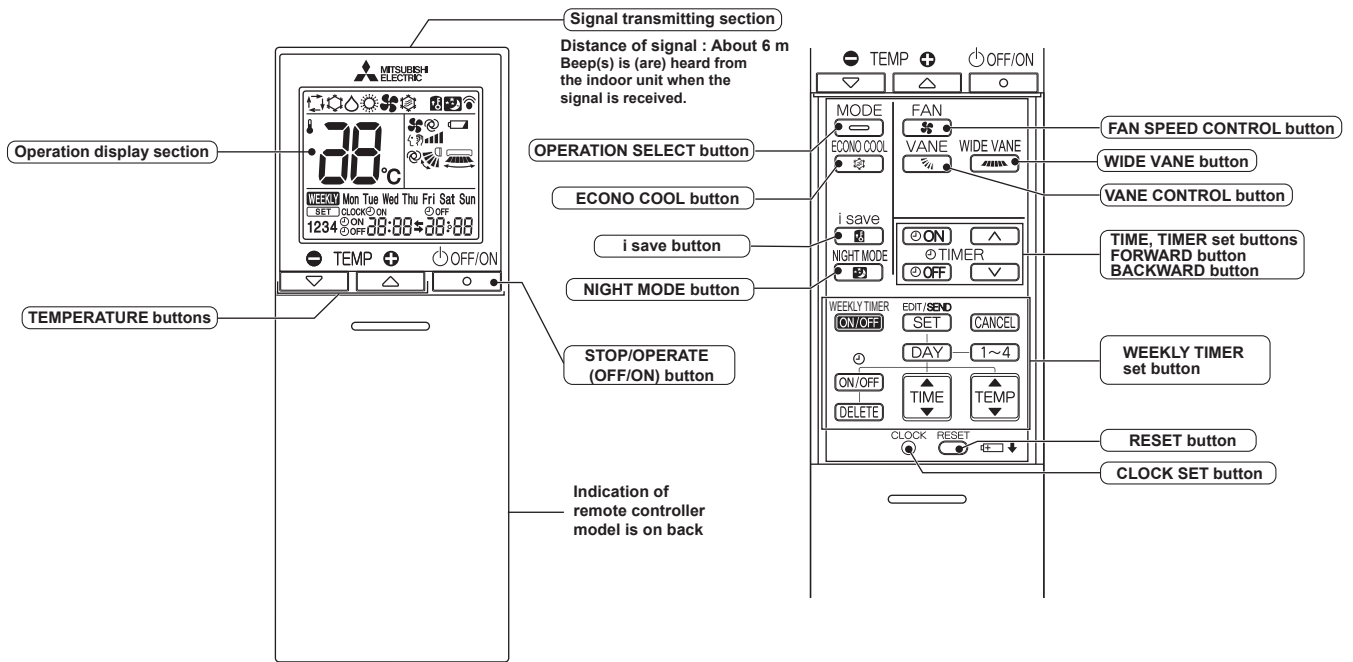

MSZ-AP60VG	MSZ-AP60VGK	MUZ-AP60VG
MSZ-AP71VG	MSZ-AP71VGK	MUZ-AP71VG

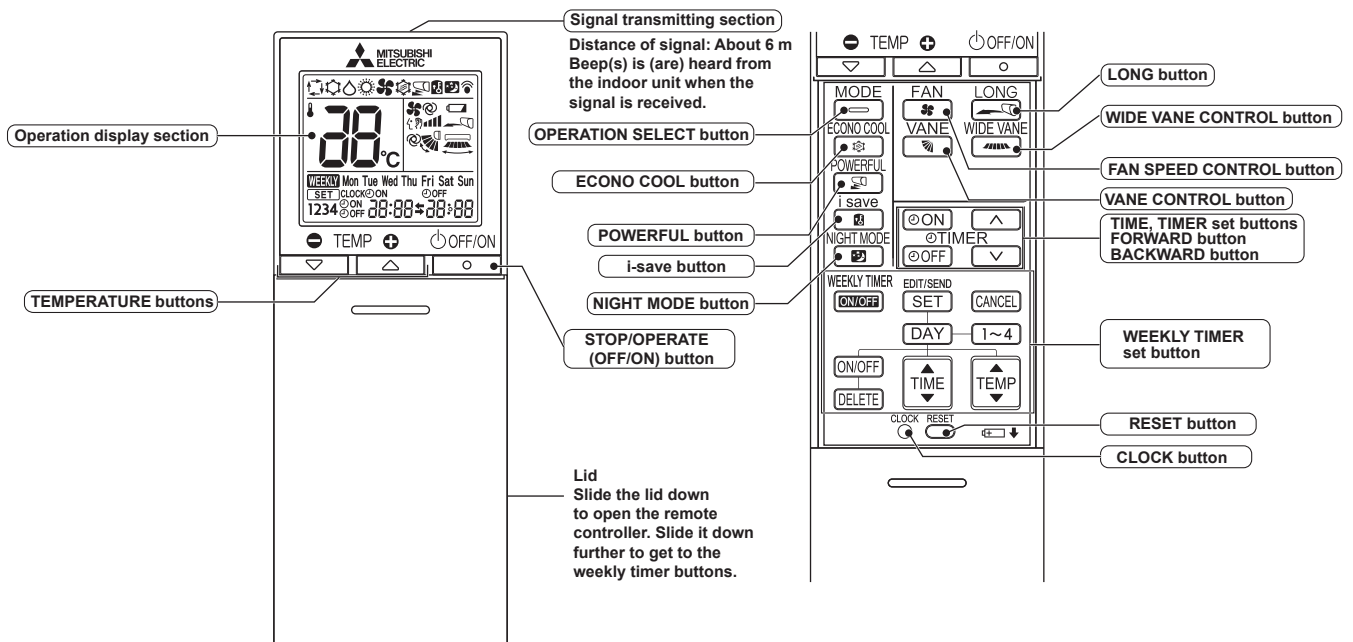







NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

- The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
 	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
 	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
 	Standby mode (Only during multi system operation)	—

-  Lit
-  Blinking
-  Not lit

a. COOL (❄️) OPERATION

- Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- Select COOL mode with OPERATION SELECT button.
- Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

3. Indoor fan speed control

When the thermostat turns OFF, the indoor fan operates very Low to reduce power consumption.

When the room temperature rises and the thermostat is ON, the indoor fan operates according to the settings on the remote controller.

b. DRY (☀️) OPERATION

- Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- Select DRY mode with OPERATION SELECT button.
- The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

3. Indoor fan speed control

Indoor fan speed control works the same way as that in COOL mode. (a.3.)

c. FAN (🌀) OPERATION

- OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- Select FAN mode with OPERATION SELECT button.
- Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (☀) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 10 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection**(1) Initial mode**

When unit starts the operation with AUTO operation from OFF:

- If the room temperature is higher than the set temperature, operation starts in COOL mode.
- If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.

(2) Mode change

COOL mode changes to HEAT mode when about 15 minutes have passed with the room temperature 1°C below the set temperature.

HEAT mode changes to COOL mode when about 15 minutes have passed with the room temperature 1°C above the set temperature.

NOTE 1


If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.

Refer to **NOTE 2 "FOR MULTI SYSTEM AIR CONDITIONER"**.

NOTE 2**FOR MULTI SYSTEM AIR CONDITIONER****OUTDOOR UNIT: MXZ series**

Multi system air conditioner can connect 2 or more indoor units with 1 outdoor unit.

- When you try to operate 2 or more indoor units with 1 outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp blinks as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR

- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit is not operating, it may get warm or the sound of refrigerant flow may be heard. It is not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirming of standard position is performed in the following cases:

- When the operation starts or finishes (including timer operation).
- When the test run starts.
- When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation

Vane angle is fixed to Horizontal position.



In HEAT operation

Vane angle is fixed to Angle 4.



(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- When the operation is stopped by the emergency operation.
- When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the vane angle at Angle 5 [MSZ-AP25/35/42/50VG(K)] Angle 4 or 5 [MSZ-AP60/71VG(K)] when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 4 [MSZ-AP25/35/42/50VG(K)] / Angle 3 [MSZ-AP60/71VG(K)] for dew prevention.

(7) SWING (fan icon) mode

By selecting SWING mode with VANE CONTROL button, the horizontal vanes swing vertically.

When COOL, DRY or FAN mode is selected, only the upper vane swings.

(8) Cold air prevention in HEAT operation

The horizontal vane position is set to upward.

NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.

(9) ECONO COOL (snowflake icon) operation (ECONOMical operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed. Also the horizontal vane swings in various cycle.



SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.


To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, VANE CONTROL, LONG [MSZ-AP60/71VG(K)] or POWERFUL [MSZ-AP60/71VG(K)] button.

(10) POWERFUL (power icon) operation [MSZ-AP60/71VG(K)]

The air conditioner automatically adjusts the fan speed and the set temperature, and operates the POWERFUL mode. The POWERFUL mode is cancelled automatically 15 minutes after operation starts, or when POWERFUL button is pressed once again within 15 minutes after operation starts. The operation mode returns to the mode prior to POWERFUL operation. POWERFUL mode also is cancelled, when the STOP/OPERATE (OFF/ON), ECONO COOL, FAN SPEED CONTROL or i-save button is pressed within 15 minutes after operation starts, or operation mode is changed.

(11) LONG MODE () (MSZ-AP60/71VG(K))

By pressing LONG button indoor fan speed becomes faster than setting fan speed on the remote controller, and the horizontal vane moves to the position for LONG mode. The remote controller displays “  ”. LONG mode is cancelled when STOP/OPERATE (OFF/ON), LONG, VANE CONTROL or ECONO COOL button is pressed. In the following example, the vertical vane is set to  (front.).

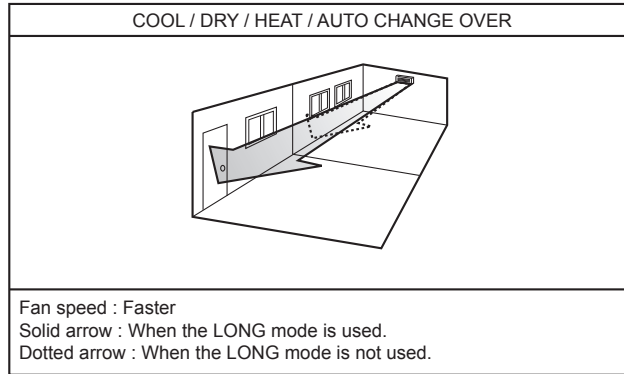

2. Vertical vane


(1) Vane motor drive

These models are equipped with a stepping motor for the vertical vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from microprocessor.

(2) The vertical vane angle and mode change as follows by pressing WIDE VANE CONTROL button.

(3) Positioning

MSZ-AP25/35/42/50VG(K)



MSZ-AP60/71VG(K)




To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

(a) STOP/OPERATE (OFF/ON) button is pressed (POWER ON).

(4) SWING () MODE

By selecting SWING mode with WIDE VANE CONTROL button, the vertical vane swings horizontally. The remote controller displays “  ”. Swing mode is cancelled when WIDE MODE CONTROL button is pressed once again.

g. TIMER OPERATION



1. How to set the time



(1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially “0:00” blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.

How to set the current time

(a) Press the CLOCK set button.

(b) Press the TIME SET buttons () and () to set the current time.

- Each time FORWARD button () is pressed, the set time increases by 1 minute, and each time BACKWARD button () is pressed, the set time decreases by 1 minute.

- Pressing those buttons longer, the set time increases/decreases by 10 minutes.

(c) Press the CLOCK set button.

(2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.

(3) Set the time of timer.

ON timer setting



(a) Press ON TIMER button () during operation.

(b) Set the time of the timer using TIME SET buttons () and () . ※


OFF timer setting


(a) Press OFF TIMER button () during operation.

(b) Set the time of the timer using TIME SET buttons () and () . ※

※ Each time FORWARD button () is pressed, the set time increases by 10 minutes: each time BACKWARD button () is pressed, the set time decreases by 10 minutes.

2. To release the timer

To release ON timer, press ON TIMER button ().


To release OFF timer, press OFF TIMER button ().

TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

- OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.
- “←” and “→” display shows the order of OFF timer and ON timer operation.

(Example 1) The current time is 8:00 PM.
The unit turns off at 11:00 PM, and on at 6:00 AM.

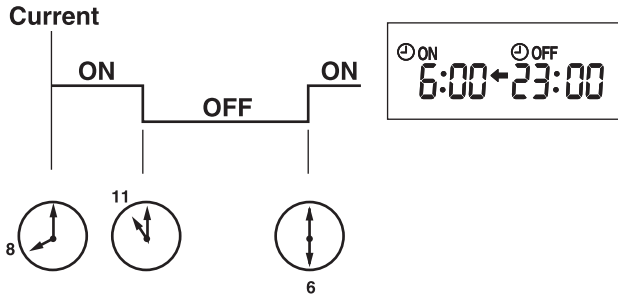


(Example 2) The current time is 11:00 AM.
The unit turns on at 5:00 PM, and off at 9:00 PM.

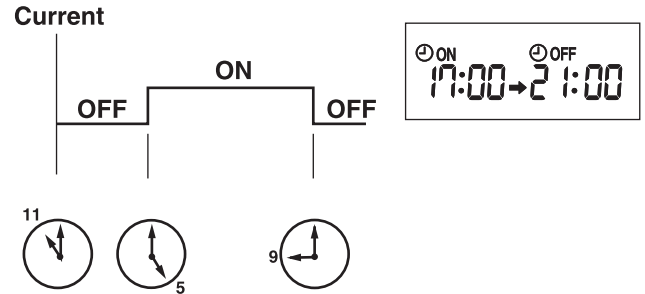

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

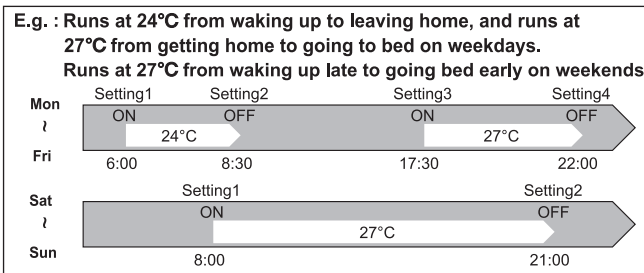


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND** **SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

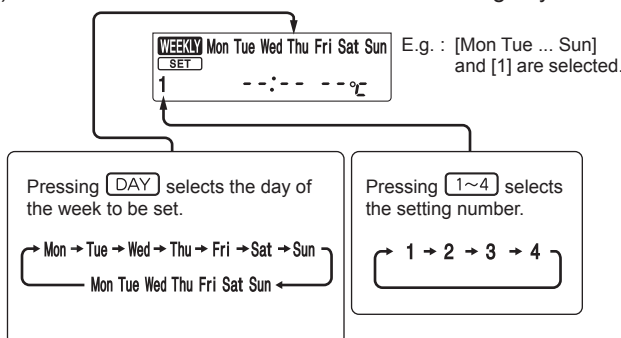


(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

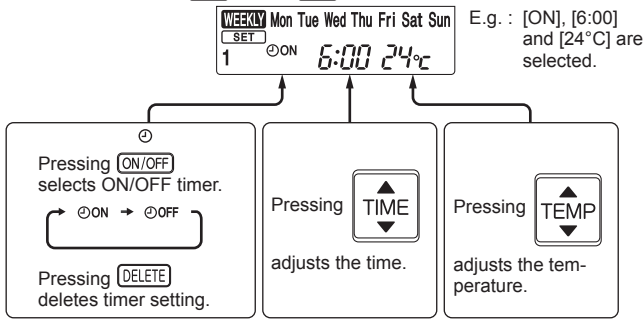

- * Hold down the button to change the time quickly.
- * The temperature can be set between 16°C and 31°C at cool operation.
- * The temperature can be set between 10°C and 31°C at HEAT operation.

Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.

(4) Press **EDIT/SEND SET** button to complete and transmit the weekly timer setting.



NOTE:

- Press **EDIT/SEND SET** button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number, **EDIT/SEND SET** button does not have to be pressed per each setting. Press **EDIT/SEND SET** button once after all the settings are complete. All the weekly timer settings will be saved.
- Press **EDIT/SEND SET** button to enter the weekly timer setting mode, and press and hold **DELETE** button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press **WEEKLY TIMER ON/OFF** button to turn the weekly timer ON. (**WEEKLY** lights.)

- When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press **WEEKLY TIMER ON/OFF** button again to turn the weekly timer OFF. (**WEEKLY** goes out.)

NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

(1) Press **EDIT/SEND SET** button to enter the weekly timer setting mode.

* **SET** blinks.

(2) Press **DAY** or **1~4** buttons to view the setting of the particular day or number.

(3) Press **CANCEL** button to exit the weekly timer setting.

NOTE:

When all days of the week are selected to view the settings and a different setting is included among them, **--:-- --°C** will be displayed.

i. NIGHT MODE () OPERATION

NIGHT MODE changes the brightness of the operation indicator, disables the beep sound and limits the noise level of the outdoor unit.

(1) Press NIGHT MODE button during operation to activate NIGHT MODE ().

- The operation indicator lamp dims.
- The beep sound will be disabled except that emitted when the operation is started or stopped.
- Noise level of the outdoor unit will be lower than that mentioned in SPECIFICATIONS.(Except the connection to **MXZ**.)

(2) Press NIGHT MODE button to cancel NIGHT MODE ().

NOTE:

- The cooling / heating capacity may drop.
- Noise level of the outdoor unit may not change after startup of the unit, during the protection operation, or depending on other operating conditions.
- The fan speed of the indoor unit will not change.
- The operation indicator lamp will be hard to be seen in a bright room.
- Noise level of the outdoor unit will not decrease during Multi system operation.

j. i-save (i) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL, ECONO COOL, HEAT or NIGHT mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:



- i-save operation cannot be selected during DRY or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)

2. How to cancel operation



- Press i-save button again.
- i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode. The same setting is selected from the next time by simply pressing i-save button.

k. OPERATION LOCK

This function locks operation mode only. Other functions, such as OFF/ON, temperature setting, or airflow direction adjustment, are available.

- (1) Hold down  button and  button simultaneously for 2 seconds while the unit is not operating to enable OPERATION LOCK.

The icon for the locked operation mode blinks.

- (2) Hold down  button and  button simultaneously for 2 seconds again while the unit is not operating to disable OPERATION LOCK.

- The icon for the locked operation mode blinks when  button and  button are held down to enable or disable OPERATION LOCK or  button is pressed during operation while OPERATION LOCK is enabled.

l. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C.

The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.


In the test run or emergency operation, the horizontal vane operates in VANE AUTO (Ⓢ) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto


The operation mode is indicated by the Operation Indicator lamp as following

Operation Indicator lamp

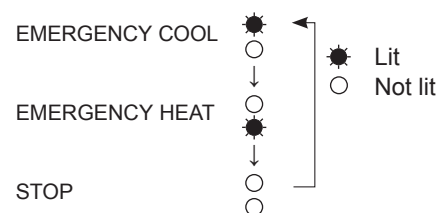


NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

MSZ-AP25/35/42/50VG(K)

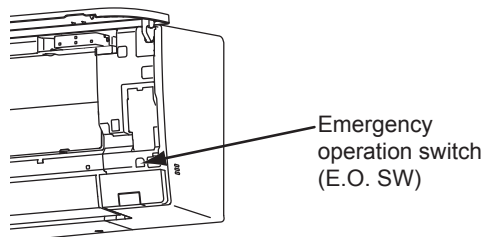

MSZ-AP60/71VG(K)

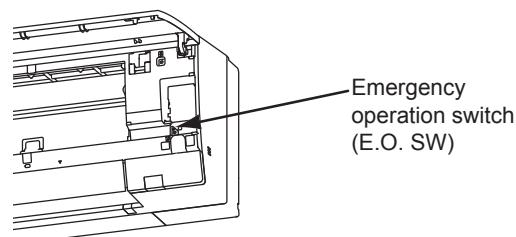

m. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


n. ACTUATOR CONTROL

n-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

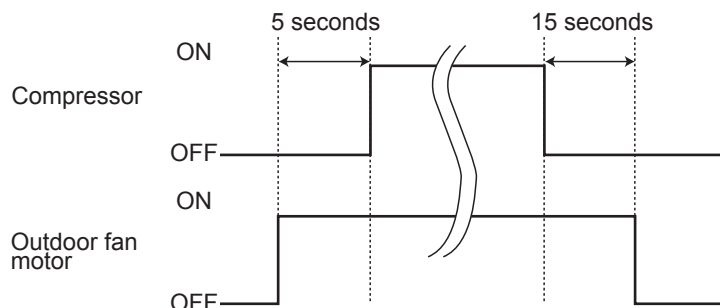


n-2. R.V. COIL CONTROL

Heating ON

Cooling OFF

Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

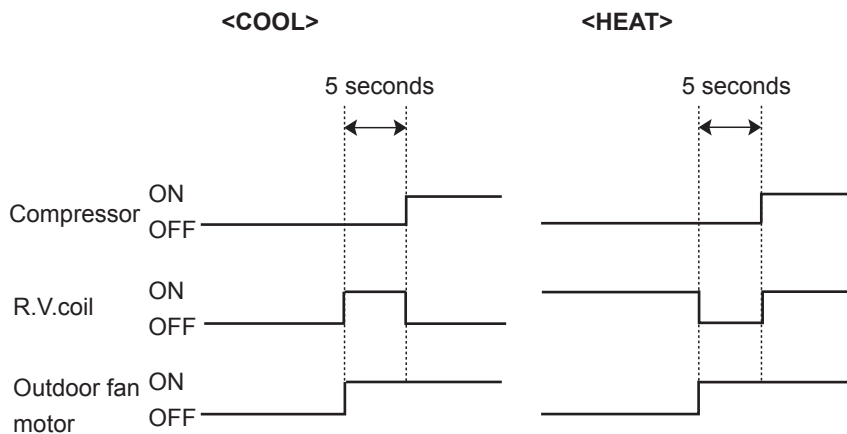

n-3. RELATION BETWEEN MAIN SENSOR AND ACTUATOR


Sensor	Purpose	Actuator					
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor	Defrost heater
Discharge temperature thermistor	Protection	○	○				
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○					
	Heating: High pressure protection	○	○				
Defrost thermistor	Heating: Defrosting	○	○	○	○	○	
Fin temperature thermistor	Protection	○		○			
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Heating: Defrosting (Heater)						○
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Cooling: High pressure protection	○	○	○			

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED

C.1.9.4 MSZ-HR•VF Series

- MSZ-HR25VF MUZ-HR25VF
- MSZ-HR35VF MUZ-HR35VF
- MSZ-HR42VF MUZ-HR42VF
- MSZ-HR50VF MUZ-HR50VF

WIRELESS REMOTE CONTROLLER

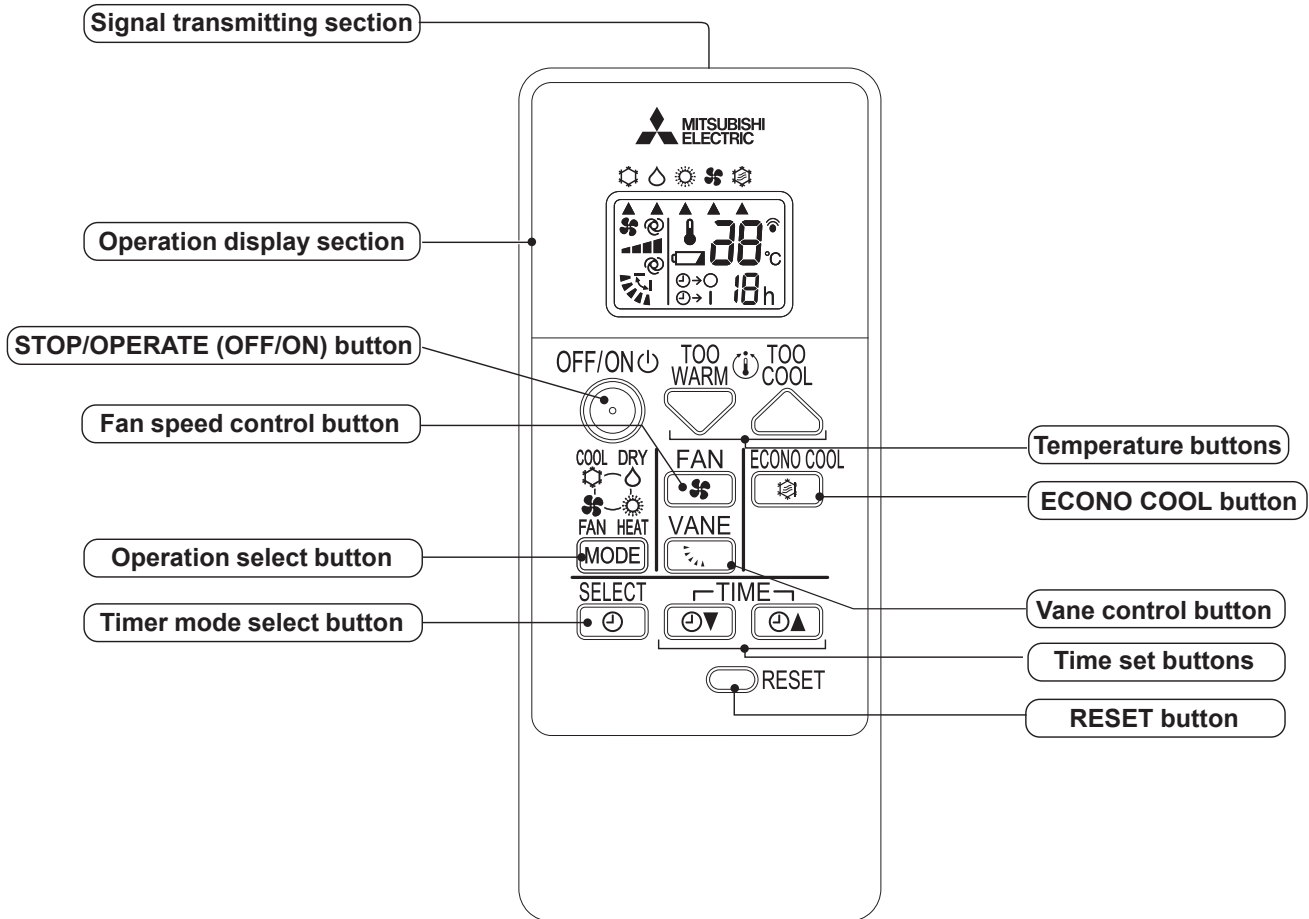

WALL-MOUNTED OPERATION AND ACTUATOR CONTROL

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
● ●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
● ○	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
● ●	Standby mode (only during multi system operation)	—

● Lit
 ○ Blinking
 ○ Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

b. DRY (☀️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

c. FAN (🌀) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns ON with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates. Outdoor unit does not operate.

d. HEAT (🔥) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.


This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

**e. MULTI SYSTEM OPERATION
FOR MULTI SYSTEM AIR CONDITIONER
OUTDOOR UNIT: MXZ series**

Multi system air conditioner can connect 2 or more indoor units with 1 outdoor unit.

- When you try to operate 2 or more indoor units with 1 outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp blinks as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR



- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit is not operating, it may get warm or the sound of refrigerant flow may be heard. It is not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation

Vane angle is fixed to Horizontal position.

In HEAT operation

Vane angle is fixed to Angle 4.



(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the vane angle at Angle 3 to 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 2 for dew prevention.

(7) SWING () mode

By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.

(8) ECONO COOL () operation (ECONOMical operation)



When ECONO COOL button is pressed in COOL mode, set temperature and the air flow direction is automatically changed by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed. Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.

To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, VANE CONTROL button.

g. TIMER OPERATION (ON/OFF TIMER)

1. How to set the timer

- (1) Press STOP/OPERATE/ (OFF/ON) button to start the air conditioner.
- (2) Select the timer mode by pressing the  button during operation.
Each time this button is pressed, the timer mode is changed in sequence:
☉→○ (OFF TIMER) → ☉→| (ON TIMER) → TIMER RELEASE
- (3) Set the time of the timer using the  button.
Each time this button is pressed, the set time increase or decrease by 1 hour to 12 hours.

2. To release the timer

Press the  button until ☉→○ (OFF TIMER) and ☉→| (ON TIMER) are not displayed.

NOTE :

- The OFF TIMER and the ON TIMER cannot be set at the same time.
- The displayed time is the time remaining and will decrease in 1-hour increments as time passes.

h. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch in the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.



In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

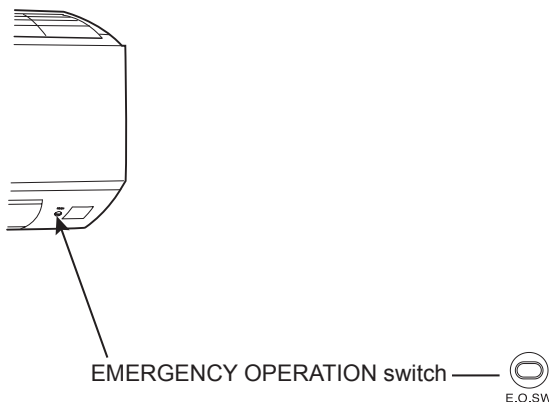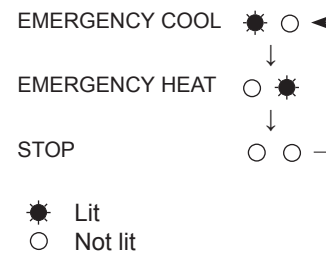

i. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED


j. ACTUATOR CONTROL

j-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

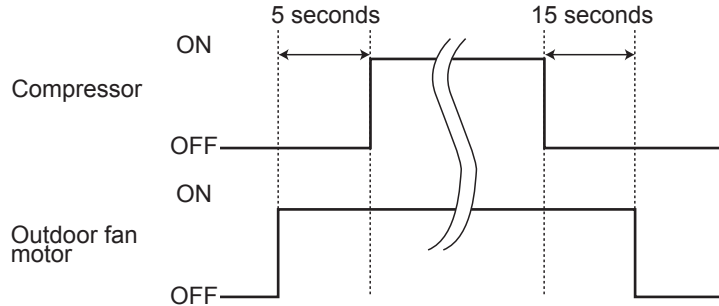


j-2. R.V. Coil control

Heating ON

Cooling OFF

Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

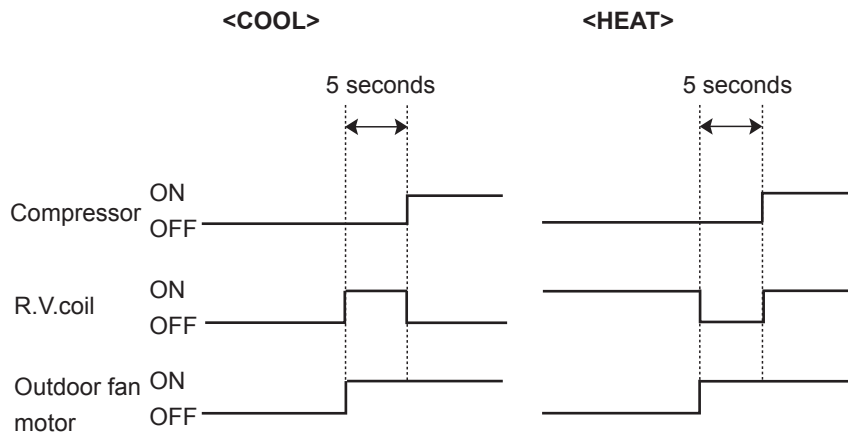

j-3. Relation between main sensor and actuator

Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○	○			
Defrost thermistor	Heating: Defrosting	○	○	○	○	○
Fin temperature thermistor	Protection	○		○		
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○		
	Heating: Defrosting (Heater)					
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○		
	Cooling: High pressure protection	○	○	○		


C.1.9.5 MSY-TP•VF Series
MSY-TP35VF MSY-TP50VF

WIRED REMOTE CONTROLLER (Option : Example) PAR-33MAA


Display

The main display can be displayed in 2 different modes: "Full" and "Basic."
The initial setting is "Full."

Full mode

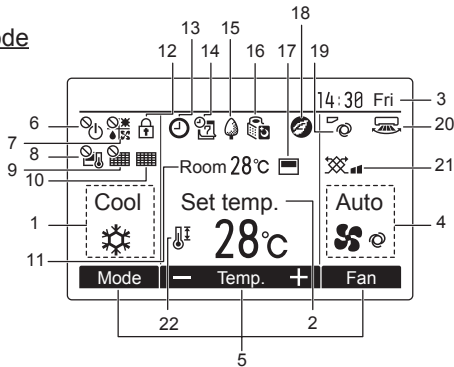


Basic mode

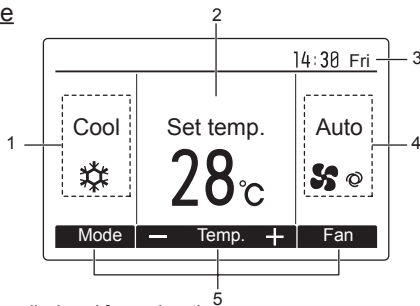

Note: All icons are displayed for explanation.

- 1 Operation mode**
Indoor unit operation mode appears here.
- 2 Preset temperature**
Preset temperature appears here.
- 3 Clock**
(See the Installation Manual.)
Current time appears here.
- 4 Fan speed**
Fan speed setting appears here.
- 5 Button function guide**
Functions of the corresponding buttons appear here.
- 6**
Appears when the ON/OFF operation is centrally controlled.
- 7**
Appears when the operation mode is centrally controlled.
- 8**
Appears when the preset temperature is centrally controlled.
- 9**
Appears when the filter reset function is centrally controlled.
- 10**
Indicates when filter needs maintenance.
- 11 Room temperature**
(See the Installation Manual.)
Current room temperature appears here.
- 12**
Appears when the buttons are locked.
- 13**
Appears when the On/Off timer or Night setback function is enabled.
- 14**
Appears when the Weekly timer is enabled.
- 15**
Appears while the units are operated in the energy-saving mode.
- 16**
Appears while the outdoor units are operated in the silent mode.
- 17**
Appears when the built-in thermistor on the remote controller is activated to monitor the room temperature (a).
Appears when the thermistor on the indoor unit is activated to monitor the room temperature.
- 18**
Appears when the units are operated in the energy-saving mode with 3D i-see Sensor.
- 19**
Indicates the vane setting.
- 20**
Indicates the lower setting.
- 21**
Indicates the ventilation setting.
- 22**
Appears when the preset temperature range is restricted.


Controller interface

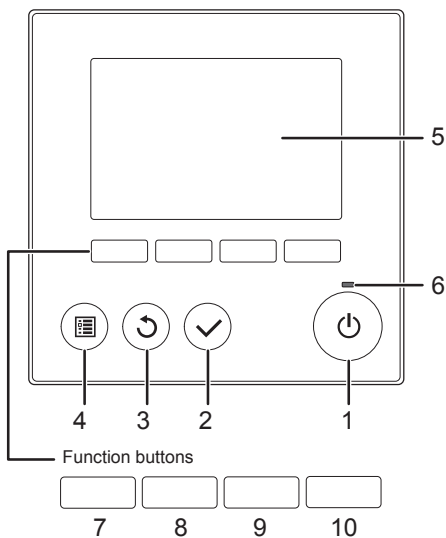

- When the backlight is off, pressing any button turns the backlight on and does not perform its function. (except for the OFF/ON button)
- Most settings (except OFF/ON, mode, fan speed, temperature) can be made from the Menu screen.


- 1 OFF/ON button**
Press to turn ON/OFF the indoor unit.
- 2 SELECT button**
Press to save the setting.
- 3 RETURN button**
Press to return to the previous screen.
- 4 MENU button**
Press to bring up the Main menu.
- 5 Backlit LCD**
Operation settings will appear. When the backlight is off, pressing any button turns the backlight on and it will stay lit for a certain period of time depending on the screen.
- 6 ON/OFF lamp**
This lamp lights up in green while the unit is in operation. It blinks while the remote controller is starting up or when there is an error.

The functions of the function buttons change depending on the screen. Refer to the button function guide that appears at the bottom of the LCD for the functions they serve on a given screen. When the system is centrally controlled, the button function guide that corresponds to the locked button will not appear.

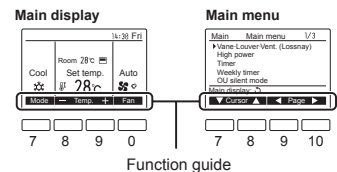

- 7 Function button [F1]**
Main display: Press to change the operation mode.
Main menu: Press to move the cursor down.
- 8 Function button [F2]**
Main display: Press to decrease temperature.
Main menu: Press to move the cursor up.
- 9 Function button [F3]**
Main display: Press to increase temperature.
Main menu: Press to go to the previous page.
- 10 Function button [F4]**
Main display: Press to change the fan speed.
Main menu: Press to go to the next page.

Menu structure

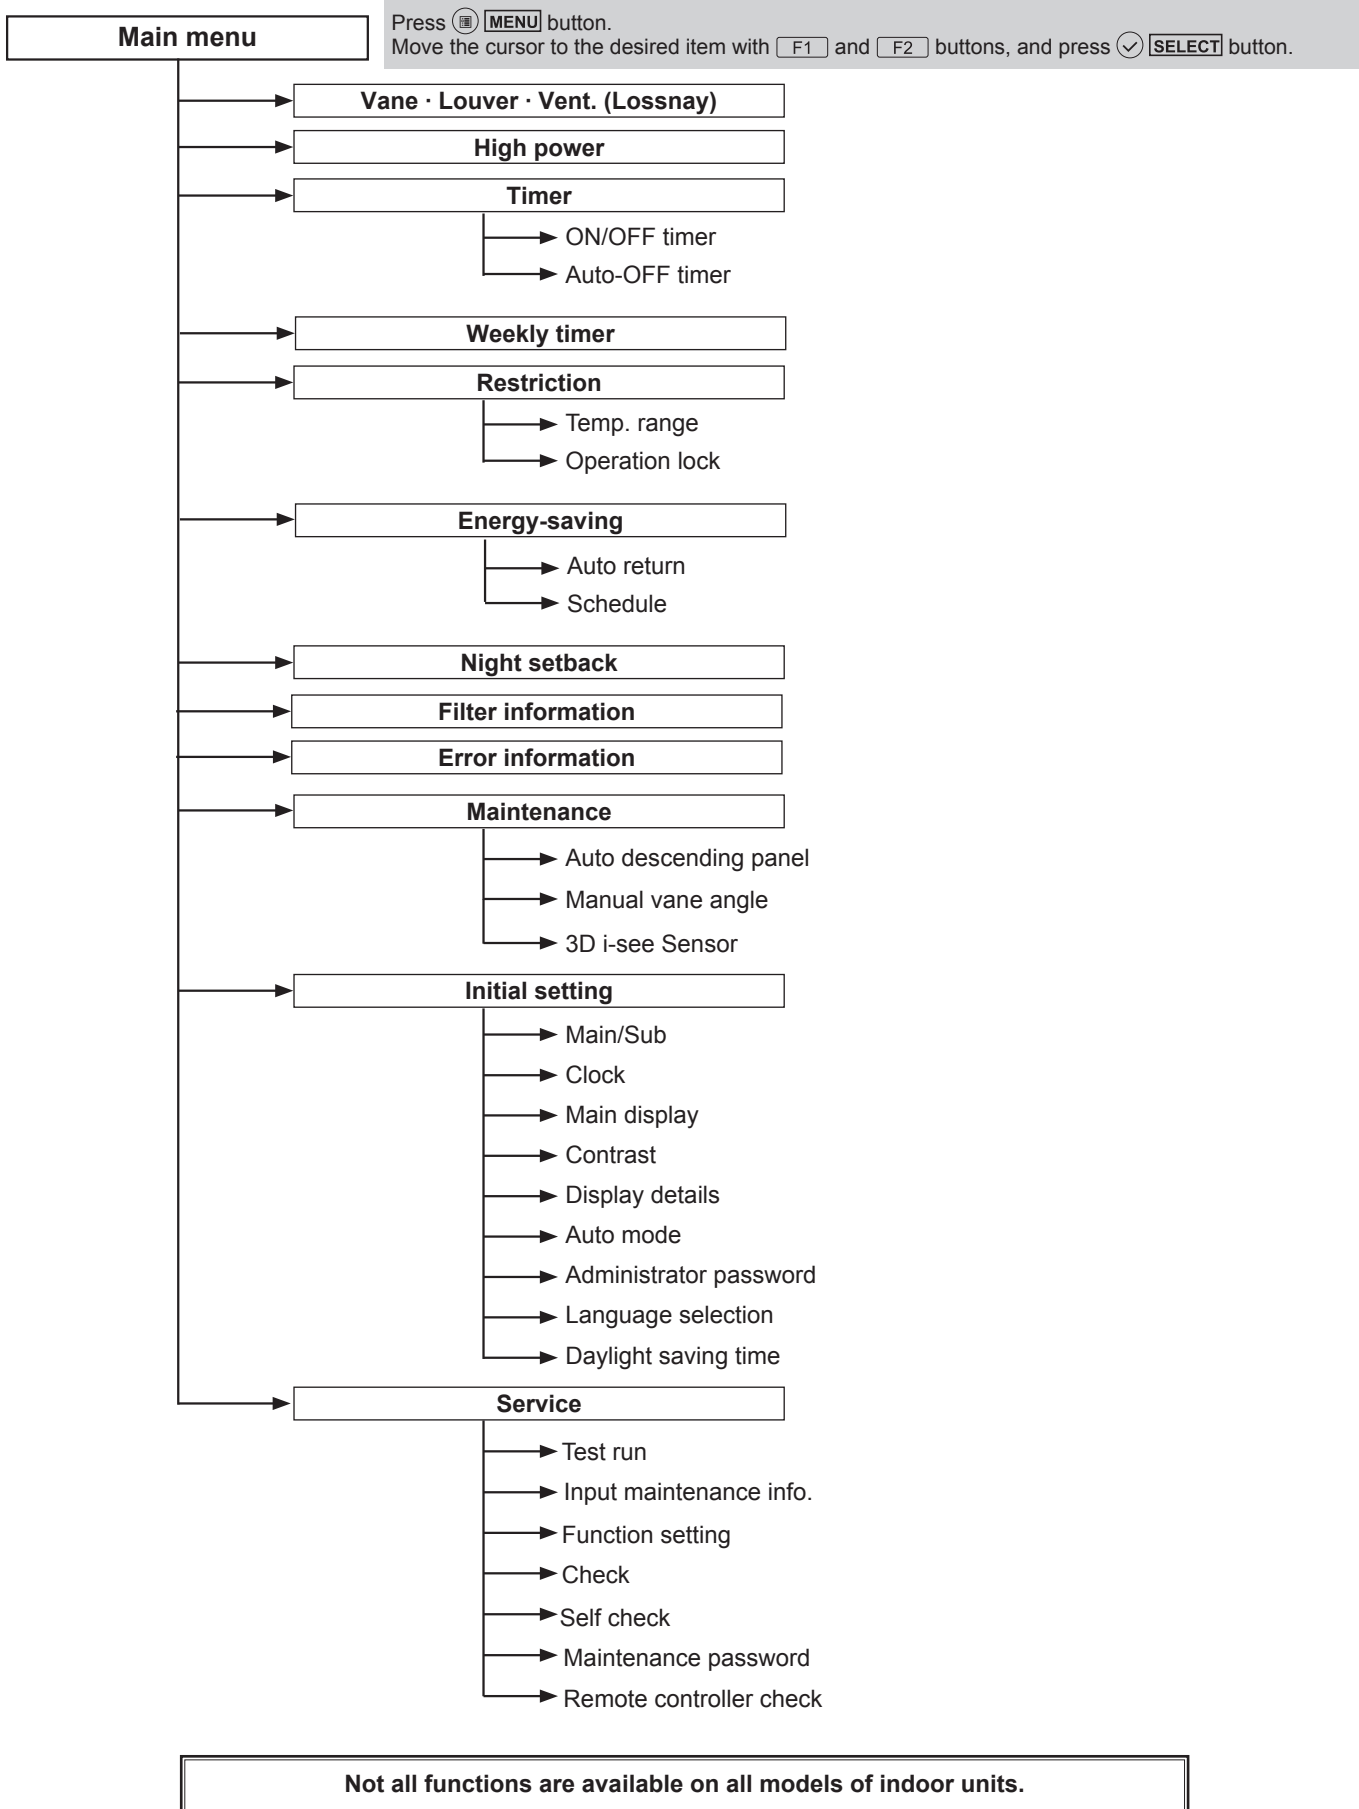

Main menu list

Setting and display items		Setting details
Vane · Louver · Vent. (Lossnay)		<p>Use to set the vane angle.</p> <ul style="list-style-type: none"> • Select a desired vane setting from 5 different settings. <p>Use to turn ON/OFF the louver.</p> <p>Not available</p> <p>Use to set the amount of ventilation.</p> <p>Not available</p>
High power		<p>Use to reach the comfortable room temperature quickly.</p> <p>Not available</p>
Timer	ON/OFF timer*	<p>Use to set the operation ON/OFF times.</p> <ul style="list-style-type: none"> • Time can be set in 5-minute increments.
	Auto-Off timer	<p>Use to set the Auto-OFF time.</p> <ul style="list-style-type: none"> • Time can be set to a value from 30 to 240 in 10-minute increments.
Filter information		<p>Use to check the filter status.</p> <p>Not available</p>
Error information		<p>Use to check error information when an error occurs.</p> <ul style="list-style-type: none"> • Check code, error source, refrigerant address, unit model, manufacturing number, contact information (dealer's phone number) can be displayed. (The unit model, manufacturing number, and contact information need to be registered in advance to be displayed.)
Weekly timer*		<p>Use to set the weekly operation ON/OFF times.</p> <ul style="list-style-type: none"> • Up to 8 operation patterns can be set for each day. (Not valid when the ON/OFF timer is enabled.)
Energy saving	Auto return	<p>Use to get the units to operate at the preset temperature after performing energy-saving operation for a specified time period.</p> <ul style="list-style-type: none"> • Time can be set to a value from 30 and 120 in 10-minute increments. (This function will not be valid when the preset temperature ranges are restricted.)
	Schedule*	<p>Set the start/stop times to operate the units in the energy-saving mode for each day of the week, and set the energy-saving rate.</p> <p>Not available</p>
Night setback*		<p>Use to make Night setback settings.</p> <ul style="list-style-type: none"> • Select "Yes" to enable the setting, and "No" to disable the setting. The temperature range and the start/stop times can be set.
Restriction	Temp. range	<p>Use to restrict the preset temperature range.</p> <ul style="list-style-type: none"> • Different temperature ranges can be set for different operation modes.
	Operation lock	<p>Use to lock selected functions.</p> <ul style="list-style-type: none"> • The locked functions cannot be operated.
Maintenance	Auto descending panel	Not available
	Manual vane angle	Not available
	3D i-see Sensor	Not available
Initial setting	Main/Sub	When connecting 2 remote controllers, one of them needs to be designated as a sub controller.
	Clock	Use to set the current time.
	Main display	<p>Use to switch between "Full" and "Basic" modes for the Main display.</p> <ul style="list-style-type: none"> • The initial setting is "Full."
	Contrast	Use to adjust screen contrast.
	Display details	<p>Make the settings for the remote controller related items as necessary.</p> <p>Clock: The initial settings are "Yes" and "24h" format. Temperature: Set either Celsius (°C) or Fahrenheit (°F). Room temp. : Set Show or Hide. Auto mode: Set the Auto mode display or Only Auto display.</p>
	Auto mode	<p>Whether or not to use the AUTO mode can be selected by using the button.</p> <p>This setting is valid only when indoor units with the AUTO mode function are connected.</p>
	Administrator password	<p>The administrator password is required to make the settings for the following items.</p> <ul style="list-style-type: none"> • Timer setting • Energy-saving setting • Weekly timer setting • Restriction setting • Outdoor unit silent mode setting • Night set back
	Language selection	Use to select the desired language.
	Daylight saving time	Sets the daylight saving time.
	Service	Test run
Input maintenance		<p>Select "Input maintenance Info." from the Service menu to bring up the Maintenance information screen.</p> <p>The following settings can be made from the Maintenance Information screen.</p> <ul style="list-style-type: none"> • Model name input • Serial No. input • Dealer information input
Function setting		Not available
Check		<p>Error history: Display the error history and delete the error history. Refrigerant leak check: Not available Smooth maintenance: Not available Request code: Not available</p>
Self check		Error history of each unit can be checked via the remote controller.
Maintenance password		Use to change the maintenance password.
Remote controller check		When the remote controller does not work properly, use the remote controller checking function to troubleshoot the problem.

* Clock setting is required.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.
 •The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
	The unit is operating to reach the set temperature.	About 2°C or more away from set temperature
	The room temperature is approaching the set temperature.	About 1 to 2°C from set temperature

- Lit
- Blinking
- Not lit


Operation status memory

	Remote controller setting
Operation mode	Operation mode before the power was turned off
Preset temperature	Preset temperature before the power was turned off
Fan speed	Fan speed before the power was turned off

Settable preset temperature range

Operation mode	Preset temperature range
Cool/Dry	16 ~ 31°C
Fan/Ventilation	Not settable

Mode selection

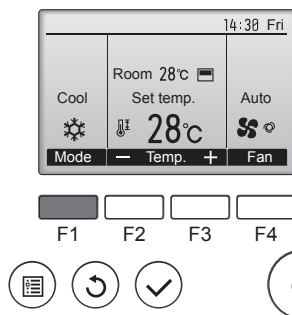

Press **[F1]** button to go through the operation modes in the order of "Cool", "Dry", and "Fan". Select the desired operation mode.





a. COOL (❄️) OPERATION

- (1) Press **[OFF/ON]** button.
 OFF/ON lamp will light up in green and the operation will start.
- (2) Select COOL mode with **[F1]** button.
- (3) Press **[F2]** button to decrease the preset temperature, and **[F3]** button to increase.
 The setting range is 16 ~ 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.
 When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works. The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

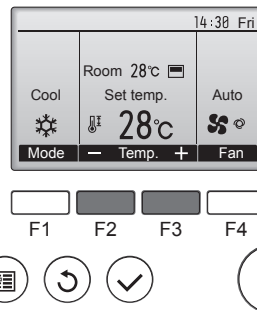

Example display (Centigrade in 0.5-degree increments)

b. DRY (🌵) OPERATION




- (1) Press **[OFF/ON]** button.
 OFF/ON lamp will light up in green and the operation will start.
- (2) Select DRY mode with **[F1]** button.
- (3) Press **[F2]** button to decrease the preset temperature, and **[F3]** button to increase.


1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)



- Preset temperature will be displayed either in Centigrade in 0.5- or 1-degree increments, or in Fahrenheit, depending on the display mode setting on the remote controller.

c. FAN()OPERATION

- (1) Press  **OFF/ON** button. OFF/ON lamp will light up in green and the operation will start.
 - (2) Select FAN mode with  button.
 - (3) Press  button to select the desired fan speed. When AUTO, it becomes Low.
- Only indoor fan operates. Outdoor unit does not operate.







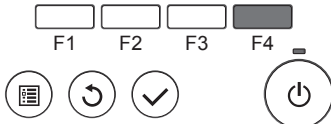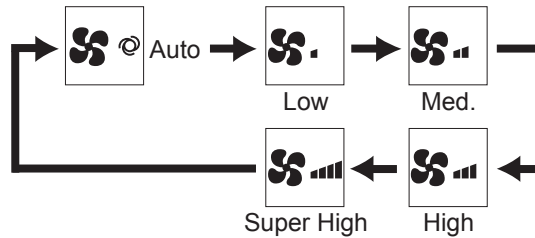Press  button to go through the fan speeds in the following order.







d. AUTO VANE OPERATION



1. Horizontal vane

- (1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.
- (2) How to set the vane angle
 - ① Press the  **MENU** button.
 - ② Select "Vane-Louver-Vent. (Lossnay)" with  or  button, and press  **SELECT** button.



- ③ Press  or  button to go through the vane setting options: "Auto", "Step 1", "Step 2", "Step 3", "Step 4", "Step 5" and "Swing", and select the desired setting.

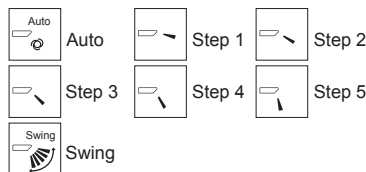

- ④ Press  **RETURN** button to go back to the Main menu.

(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

- Confirmation of standard position is performed in the following cases:
- (a) When the operation starts or finishes (including timer operation).
 - (b) When the test run starts.

- (4) VANE AUTO (Auto) mode
In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation
Vane angle is fixed to Horizontal position.



- (5) STOP (operation OFF) and ON TIMER standby
In the following cases, the horizontal vane returns to the closed position.
 - (a) When OFF/ON button is pressed (POWER OFF).
 - (b) When the operation is stopped by the emergency operation.
 - (c) When ON TIMER is ON standby.
- (6) Dew prevention
During COOL or DRY operation with the vane angle at Angle 3 ~ 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 2 for dew prevention.
- (7) SWING (Swing) mode
Select "Swing" to move the vanes up and down automatically.
When set to "Step 1" through "Step 5", the vane will be fixed at the selected angle.

e. TIMER OPERATION (ON/OFF TIMER)

The unit automatically turns on or off at the preset time.

Select "Timer" from the Main menu, and press SELECT button (Refer to the appropriate operation manual include with remote controller.).

f. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up. The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work. After 30 minutes of test run operation, the system shifts to EMERGENCY COOL MODE with a set temperature of 24°C. The fan speed shifts to Med. The coil frost prevention works even in the test run or the emergency operation. In the test run or emergency operation, the horizontal vane operates in VANE AUTO (Auto) mode. Emergency operation continues until EMERGENCY OPERATION switch is pressed once or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.




EMERGENCY OPERATION switch — E.O.SW

Operation mode	COOL
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as follows:

Operation Indicator lamp

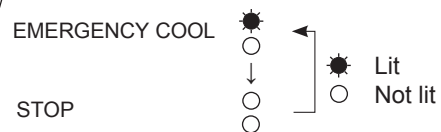

g. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


h. ACTUATOR CONTROL

h-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

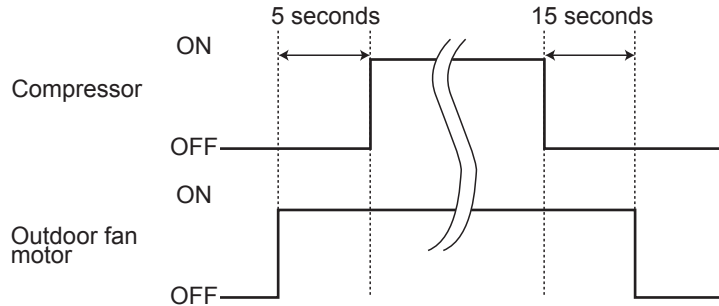

h-2. Relation between main sensor and actuator


Sensor	Purpose	Actuator		
		Compressor	LEV	Outdoor fan motor
Discharge temperature thermistor	Protection	○	○	
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○		
Fin temperature thermistor	Protection	○		○
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○
	Cooling: High pressure protection	○	○	○

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED

C.1.9.6 MSZ-FH•VE2 Series

MSZ-FH25VE2 MUZ-FH25VE MUZ-FH25VEHZ
 MSZ-FH35VE2 MUZ-FH35VE MUZ-FH35VEHZ
 MSZ-FH50VE2 MUZ-FH50VE MUZ-FH50VEHZ

WIRELESS REMOTE CONTROLLER

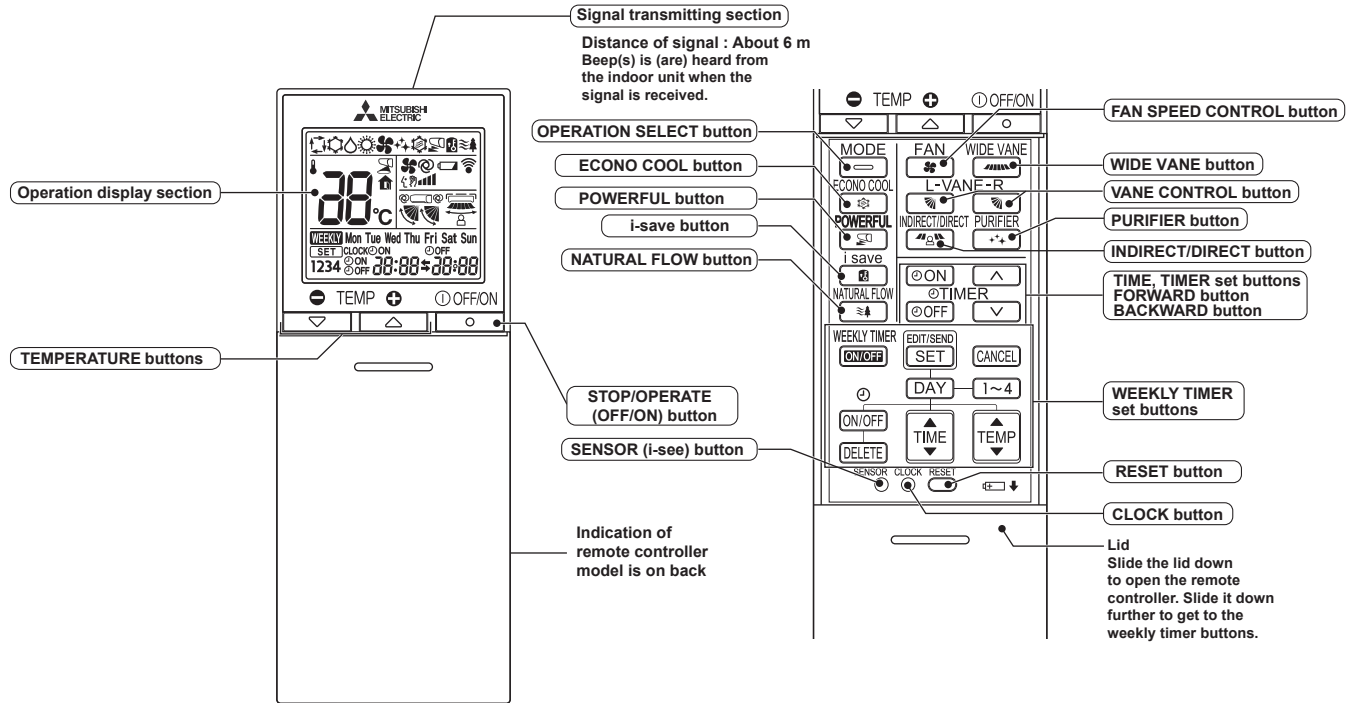



NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
 	Standby mode (Only during multi system operation)	—

-  Lit
-  Blinking
-  Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

3. Indoor fan speed control

When the thermostat turns OFF, the indoor fan operates very Low to reduce power consumption.

When the room temperature rises and the thermostat is ON, the indoor fan operates according to the settings on the remote controller.

b. DRY (△) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

3. Indoor fan speed control

Indoor fan speed control works the same way as that in COOL mode. (a.3.)

c. FAN (⚙️) OPERATION

- (1) OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (☀️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection

- (1) Initial mode
When unit starts the operation with AUTO operation from OFF:
 - If the room temperature is higher than the set temperature, operation starts in COOL mode.
 - If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.
- (2) Mode change
COOL mode changes to HEAT mode when about 15 minutes have passed with the room temperature 1°C below the set temperature.
HEAT mode changes to COOL mode when about 15 minutes have passed with the room temperature 1°C above the set temperature.

NOTE 1

If two or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.


Refer to **NOTE 2 "FOR MULTI SYSTEM AIR CONDITIONER"**.

NOTE 2
FOR MULTI SYSTEM AIR CONDITIONER
OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect two or more indoor units with one outdoor unit.

- When you try to operate two or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp flashes as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR



- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with stepping motors for the horizontal vanes. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

- (2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL () button.



NOTE: The right and left horizontal vanes set to the same level may not align perfectly.

(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation

Vane angle is fixed to Horizontal position.



In HEAT operation

Vane angle is fixed to Angle 4.



(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the vane angle at Angle 4 or 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 3 for dew prevention.

(7) SWING (🌀) mode

By selecting SWING mode with VANE CONTROL button, the horizontal vanes swing vertically.
When COOL, DRY or FAN mode is selected, only the upper vane swings.

(8) Cold air prevention in HEAT operation

The horizontal vane position is set to Upward.

NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.

(9) ECONO COOL (🌡️) operation (ECONOMical operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed. Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.

To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, VANE CONTROL, POWERFUL or NATURAL FLOW button.

(10) POWERFUL (🔥) operation

The air conditioner automatically adjusts the fan speed and the set temperature, and operates the POWERFUL mode.

The POWERFUL mode is cancelled automatically 15 minutes after operation starts, or when POWERFUL button is pressed once again within 15 minutes after operation starts. The operation mode returns to the mode prior to POWERFUL operation. To cancel this operation manually, select a different mode or press one of the following buttons within 15 minutes after operation starts: STOP/OPERATE (OFF/ON), ECONO COOL, FAN SPEED CONTROL, NATURAL FLOW or i-save button.


2. Vertical vane

(1) Vane motor drive

These models are equipped with a stepping motor for the vertical vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from microprocessor.

(2) The vertical vane angle and mode change as follows by pressing WIDE VANE CONTROL button.

(3) Positioning



To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

(a) When STOP/OPERATE (OFF/ON) button is pressed (POWER ON).

(4) SWING (🌀) MODE

By selecting SWING mode with WIDE VANE CONTROL button, the vertical vane swings horizontally. The remote controller displays “🌀”. Swing mode is cancelled when WIDE MODE CONTROL button is pressed once again.

g. TIMER OPERATION

1. How to set the time

(1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially “0:00” blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK button.

How to set the current time

(a) Press the CLOCK button.

(b) Press the TIME SET buttons (▲) and (▼) to set the current time.

- Each time FORWARD button (▲) is pressed, the set time increases by 1 minute, and each time BACKWARD button (▼) is pressed, the set time decreases by 1 minute.
- Pressing those buttons longer, the set time increases/decreases by 10 minutes.

(c) Press the CLOCK set button.

(2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.

(3) Set the time of timer.

ON timer setting

(a) Press ON TIMER button (ⓄON) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).*

OFF timer setting

(a) Press OFF TIMER button (ⓄOFF) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).*

* Each time FORWARD button (▲) is pressed, the set time increases by 10 minutes: each time BACKWARD button (▼) is pressed, the set time decreases by 10 minutes.

2. To release the timer

To release ON timer, press ON TIMER button (ⓄON).

To release OFF timer, press OFF TIMER button (ⓄOFF).

TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

• OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.

• “←” and “→” display shows the order of OFF timer and ON timer operation.


(Example 1) The current time is 8:00 PM.

The unit turns off at 11:00 PM, and on at 6:00 AM.

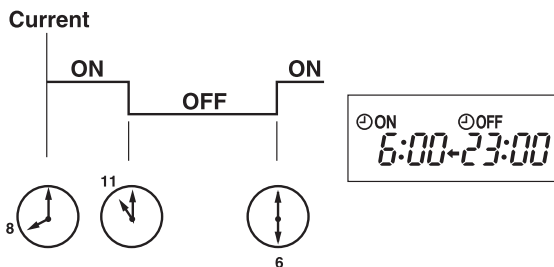

(Example 2) The current time is 11:00 AM.


The unit turns on at 5:00 PM, and off at 9:00 PM.

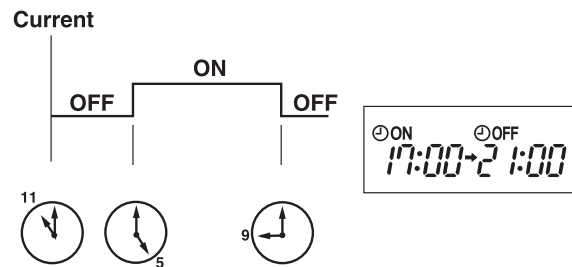

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

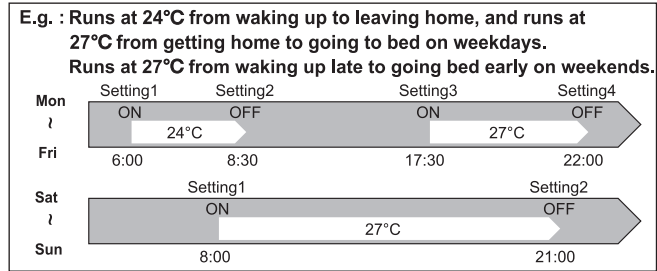


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature cannot be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

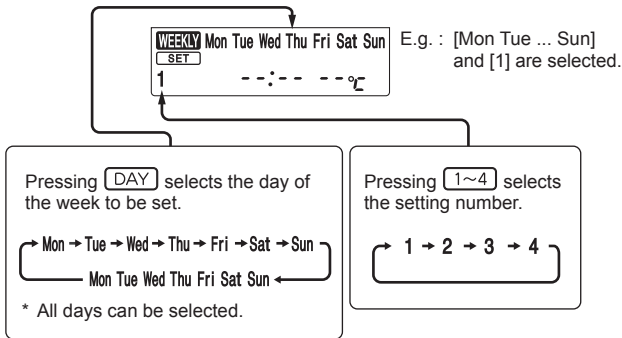


(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

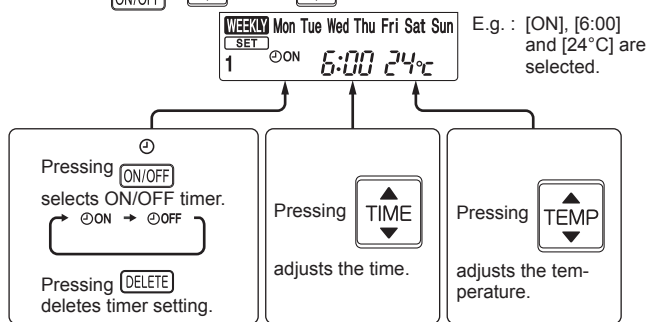


- * Hold down the button to change the time quickly.
- * The temperature can be set between 16°C and 31°C at weekly timer.






Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.



(4) Press  button to complete and transmit the weekly timer setting.





*  which was blinking goes out, and the current time will be displayed.

NOTE:

- Press  button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number,  button does not have to be pressed per each setting. Press  button once after all the settings are complete. All the weekly timer settings will be saved.
- Press  button to enter the weekly timer setting mode, and press and hold  button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press  button to turn the weekly timer ON. ( lights.)


•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press  button again to turn the weekly timer OFF. ( goes out.)



NOTE:


The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting


(1) Press  button to enter the weekly timer setting mode.

* blinks.

(2) Press  or  buttons to view the setting of the particular day or number.



(3) Press  button to exit the weekly timer setting.

NOTE:

When all days of the week are selected to view the settings and a different setting is included among them,  will be displayed.


i. i-see CONTROL () MODE

In the i-see control mode, the room temperature is controlled based on the sensible temperature.

- (1) Press SENSOR button with a thin instrument during COOL, DRY, HEAT and AUTO mode to activate i-see control mode ().
The default setting is “active”.
- (2) Press SENSOR button again to activate ABSENCE DETECTION ().
- (3) Press SENSOR button again to release i-see control mode.

ABSENCE DETECTION ()

This function automatically changes the operation to energy-saving operation when nobody is in the room.


- (1) To activate this function, press SENSOR button until  appears on the operation display of the remote controller during the i-see control mode.
- (2) Press SENSOR button again to release ABSENCE DETECTION.


j. INDIRECT/DIRECT MODE

The INDIRECT/DIRECT mode offers finely-tuned operation by locating where an occupant is in the room.

- (1) Press INDIRECT/DIRECT button during COOL, DRY, HEAT or AUTO mode to activate INDIRECT/DIRECT mode.
This mode is only available when the i-see control mode is effective.
- (2) Each press of INDIRECT/DIRECT button changes INDIRECT/DIRECT in the following order:



 (INDIRECT): An occupant will be less exposed to direct airflow.

 (DIRECT) : Mainly the vicinity of an occupant will be air-conditioned.

NOTE:

- Horizontal and vertical airflow directions will be automatically selected.
- If you still feel uncomfortable with the air direction determined by the INDIRECT mode, adjust the air direction manually.
- Cancelling the i-see control mode automatically cancels the INDIRECT/DIRECT mode.
INDIRECT/DIRECT mode is also cancelled when the VANE or WIDE VANE buttons is pressed.
- Do not touch the i-see SENSOR. This may cause malfunction of the i-see SENSOR.

k. NATURAL FLOW (≈) OPERATION

In NATURAL FLOW operation, air flow will become more like natural wind. An occupant will not be directly exposed to the air flow and feel more comfortable.

- (1) Press NATURAL FLOW button during COOL or FAN mode to start NATURAL FLOW operation.
- (2) Press NATURAL FLOW button again to cancel NATURAL FLOW operation.
 - NATURAL FLOW operation is also cancelled when the POWERFUL or ECONO COOL button is pressed.

NOTE: As the fan speed changes constantly during NATURAL FLOW operation, the sound of air flow, wind velocity and air flow temperature also change. This is not a malfunction.

l. AIR PURIFYING (✚) OPERATION

In the AIR PURIFYING operation, the indoor unit built-in device reduces airborne fungi, viruses, mold, and allergens.

- (1) Press PURIFIER button to start AIR PURIFYING operation.
 - AIR PURIFYING lamp turns on. (Display section)
- (2) Press PURIFIER button again to cancel AIR PURIFYING operation.
 - AIR PURIFYING lamp turns off. (Display section)

NOTE:

- Never touch the air purifying device during operation. Although the air purifying device is safety-conscious design, touching this device could be the cause of trouble as this device discharge high voltage electricity.
- A “hissing” sound may be heard during the air purifying operation. This sound is produced when plasma is being discharged. This is not a malfunction.
- AIR PURIFYING lamp does not turn on if the front panel is not closed completely.

m. i-save (Ⓜ) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL, HEAT or ECONO COOL mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.

2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing POWERFUL button or OPERATION SELECT button to change the operation mode.

The same setting is select from the next time by simply pressing i-save button.

n. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.



In the test run or emergency operation, the horizontal vane operates in VANE AUTO (Ⓜ) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

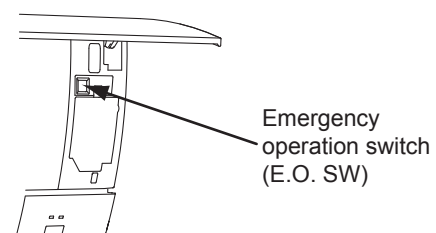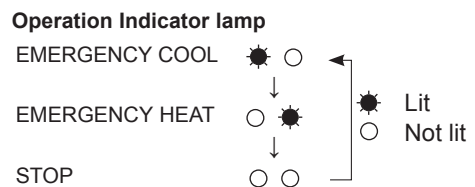

o. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED


p. ACTUATOR CONTROL

p-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

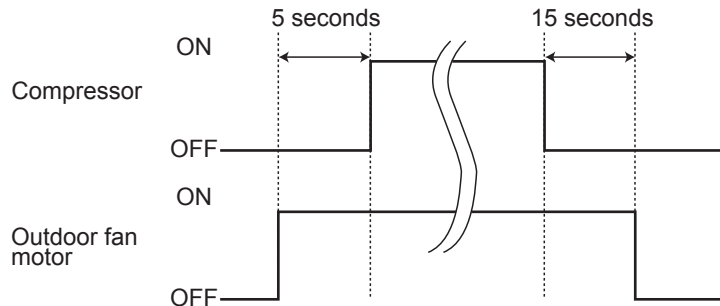


p-2. R.V. coil control

Heating ON

Cooling OFF

Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

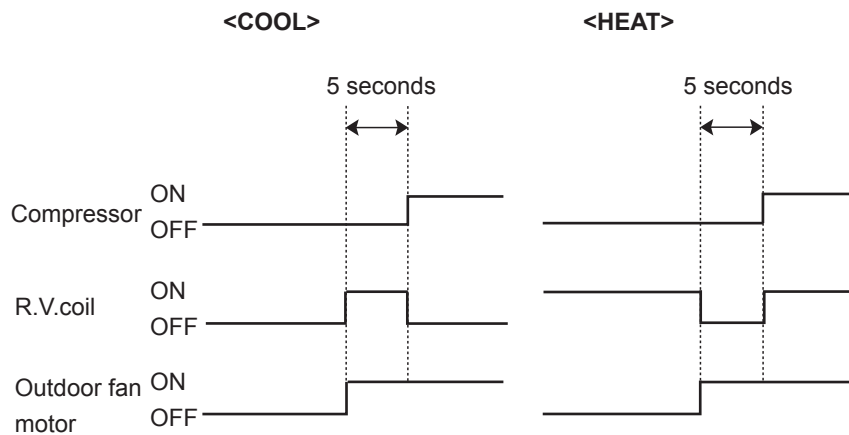

p-3. Relation between main sensor and actuator

Sensor	Purpose	Actuator					
		Compressor	LEV	Outdoor fan motor	R.V.coil	Indoor fan motor	Defrost heater
Discharge temperature thermistor	Protection	○	○				
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○					
	Heating: High pressure protection	○	○				
Defrost thermistor	Heating: Defrosting	○	○	○	○	○	
Fin temperature thermistor	Protection	○		○			
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Heating: Defrosting (Heater)						○
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Cooling: High pressure protection	○	○	○			


C.1.9.7 MSZ-EF•VGW/B/S, SF•VE3 Series

MSZ-EF18VGW	MSZ-EF18VGB	MSZ-EF18VGS		
MSZ-EF22VGW	MSZ-EF22VGB	MSZ-EF22VGS		
MSZ-EF25VGW	MSZ-EF25VGB	MSZ-EF25VGS	MUZ-EF25VG	MUZ-EF25VGH
MSZ-EF35VGW	MSZ-EF35VGB	MSZ-EF35VGS	MUZ-EF35VG	MUZ-EF35VGH
MSZ-EF42VGW	MSZ-EF42VGB	MSZ-EF42VGS	MUZ-EF42VG	
MSZ-EF50VGW	MSZ-EF50VGB	MSZ-EF50VGS	MUZ-EF50VG	

MSZ-SF25VE3	MUZ-SF25VE
	MUZ-SF25VEH
MSZ-SF35VE3	MUZ-SF35VE
	MUZ-SF35VEH
MSZ-SF42VE3	MUZ-SF42VE
	MUZ-SF42VEH
MSZ-SF50VE3	MUZ-SF50VE
	MUZ-SF50VEH

WIRELESS REMOTE CONTROLLER

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED

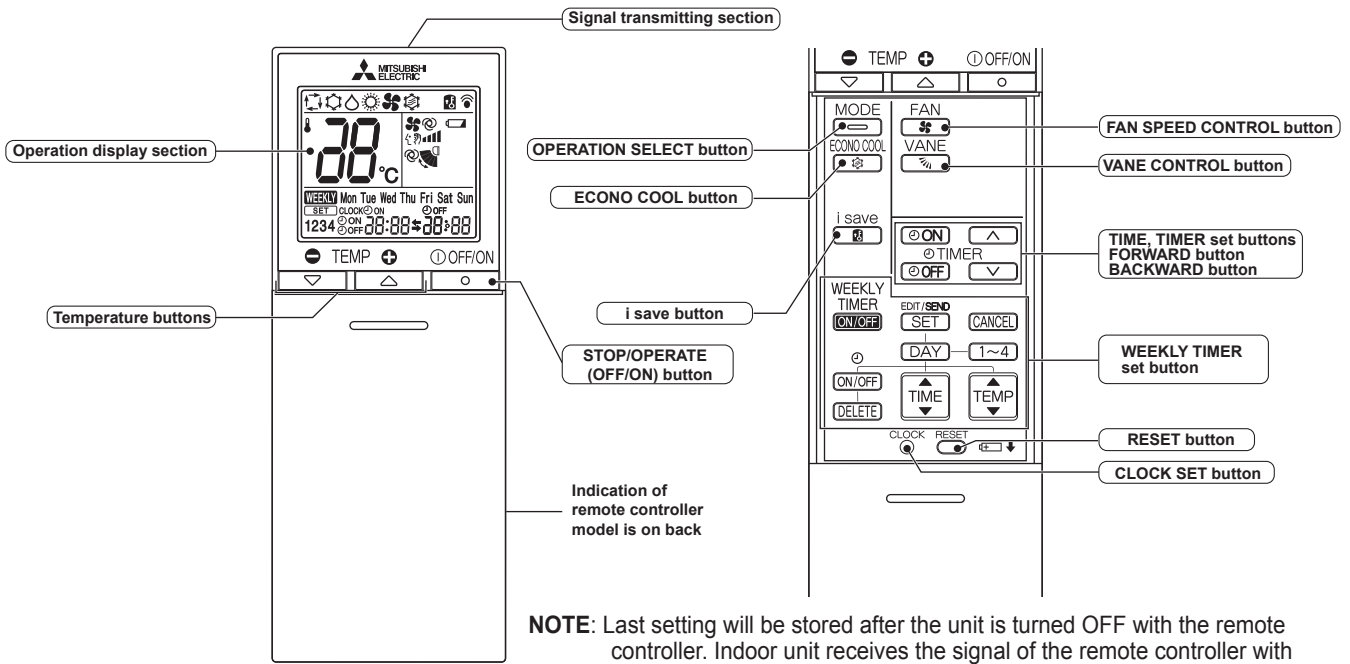

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
● ●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
● ○	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
● ●	Standby mode (Only during multi system operation)	—

- Lit
- Blinking
- Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

3. Indoor fan speed control

When the thermostat turns OFF, the indoor fan operates very Low to reduce power consumption.

When the room temperature rises and the thermostat is ON, the indoor fan operates according to the settings on the remote controller.

b. DRY (☀️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

3. Indoor fan speed control

Indoor fan speed control works the same way as that in COOL mode. (a.3.)

c. FAN (🌀) OPERATION

- (1) OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (🔥) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection

- (1) Initial mode
When unit starts the operation with AUTO operation from OFF:
 - If the room temperature is higher than the set temperature, operation starts in COOL mode.
 - If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.
- (2) Mode change
COOL mode changes to HEAT mode when about 15 minutes have passed with the room temperature 1°C below the set temperature.
HEAT mode changes to COOL mode when about 15 minutes have passed with the room temperature 1°C above the set temperature.

NOTE 1

If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in ☐ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.

Refer to **NOTE 2 "FOR MULTI SYSTEM AIR CONDITIONER"**.

NOTE 2


FOR MULTI SYSTEM AIR CONDITIONER

OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect 2 or more indoor units with one outdoor unit.

- When you try to operate 2 or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp flashes as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR



- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirming of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation

Vane angle is fixed to Horizontal position.



In HEAT operation

Vane angle is fixed to Angle 4.



(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the vane angle at Angle 4 or 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 1 for dew prevention.

(7) SWING (with vane icon) mode

By selecting SWING mode with VANE CONTROL button, the horizontal vanes swing vertically.

When COOL, DRY or FAN mode is selected, only the upper vane swings.

(8) Cold air prevention in HEAT operation

The horizontal vane position is set to Upward.

NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.

(9) ECONO COOL (🌀) operation (ECONOMical operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by microprocessor. However, the temperature on the LCD screen on the remote controller is not changed.

Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.

To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, or VANE CONTROL button.

g. TIMER OPERATION

1. How to set the time

(1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially “0:00” blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.

How to set the current time

(a) Press the CLOCK set button.

(b) Press the TIME SET buttons (⏮ and ⏭) to set the current time.

- Each time FORWARD button (⏮) is pressed, the set time increases by 1 minute, and each time BACKWARD button (⏭) is pressed, the set time decreases by 1 minute.
- Pressing those buttons longer, the set time increases/decreases by 10 minutes.

(c) Press the CLOCK set button.

(2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.

(3) Set the time of timer.

ON timer setting

(a) Press ON TIMER button (🕒ON) during operation.

(b) Set the time of the timer using TIME SET buttons (⏮ and ⏭).*

OFF timer setting

(a) Press OFF TIMER button (🕒OFF) during operation.

(b) Set the time of the timer using TIME SET buttons (⏮ and ⏭).*

* Each time FORWARD button (⏮) is pressed, the set time increases by 10 minutes: each time BACKWARD button (⏭) is pressed, the set time decreases by 10 minutes.

2. To release the timer

To release ON timer, press ON TIMER button (🕒ON).

To release OFF timer, press OFF TIMER button (🕒OFF).

TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

• OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.

• “←” and “→” display shows the order of OFF timer and ON timer operation.


(Example 1) The current time is 8:00 PM.

The unit turns off at 11:00 PM, and on at 6:00 AM.

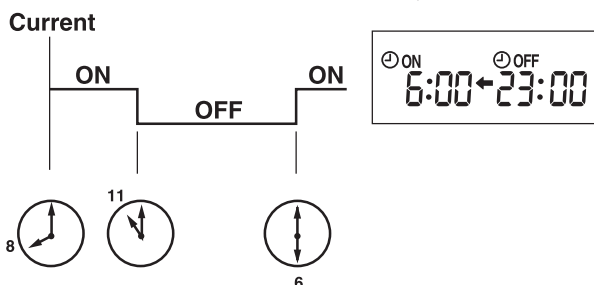

(Example 2) The current time is 11:00 AM.


The unit turns on at 5:00 PM, and off at 9:00 PM.

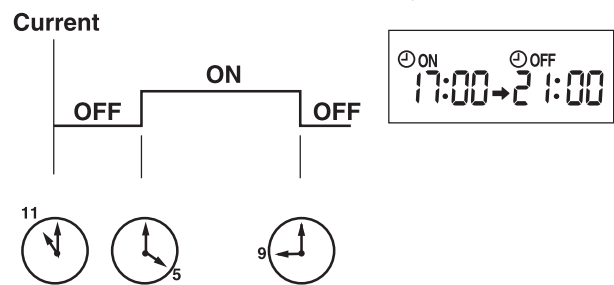

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

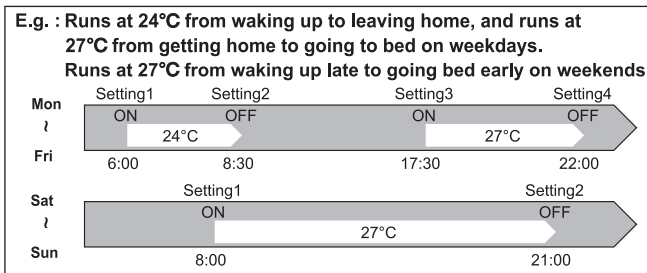


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature cannot be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND** **SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

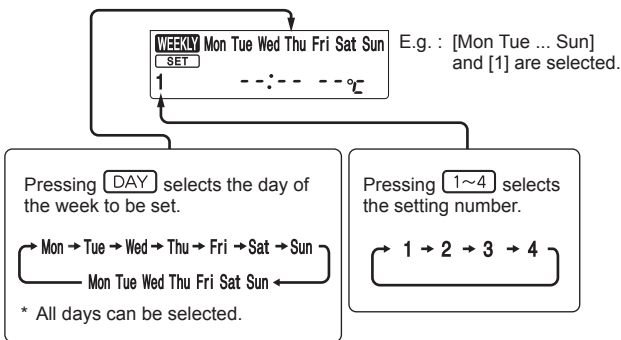


(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

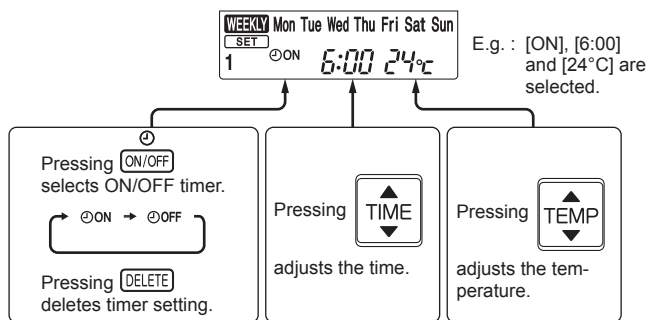


* Hold down the button to change the time quickly.






Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.



(4) Press  button to complete and transmit the weekly timer setting.





*  which was blinking goes out, and the current time will be displayed.

NOTE:

- Press  button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number,  button does not have to be pressed per each setting. Press  button once after all the settings are complete. All the weekly timer settings will be saved.
- Press  button to enter the weekly timer setting mode, and press and hold  button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press  button to turn the weekly timer ON. ()


•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press  button again to turn the weekly timer OFF. ( goes out.)



NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

(1) Press  button to enter the weekly timer setting mode.

* blinks.

(2) Press  or  buttons to view the setting of the particular day or number.

(3) Press  button to exit the weekly timer setting.

NOTE:

When all days of the week are selected to view the settings and a different setting is included among them, --:-- --° will be displayed.

i. i-save (i) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL, HEAT or ECONO COOL mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.


2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode. The same setting is select from the next time by simply pressing i-save button.

j. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up. The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work. After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med. The coil frost prevention works even in the test run or the emergency operation. In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode. Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

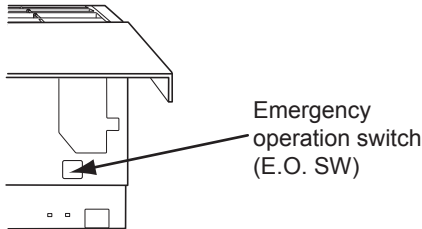


k. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

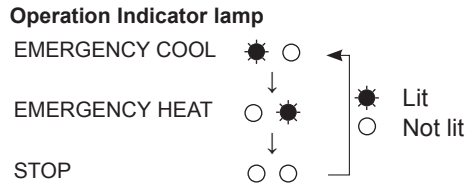

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED


I. ACTUATOR CONTROL

I-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

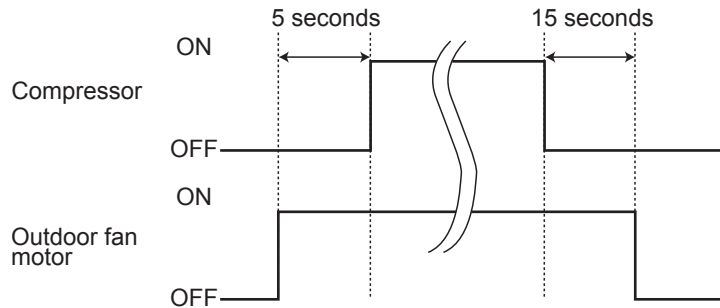


I-2. R.V. coil control

Heating ON

Cooling OFF

Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

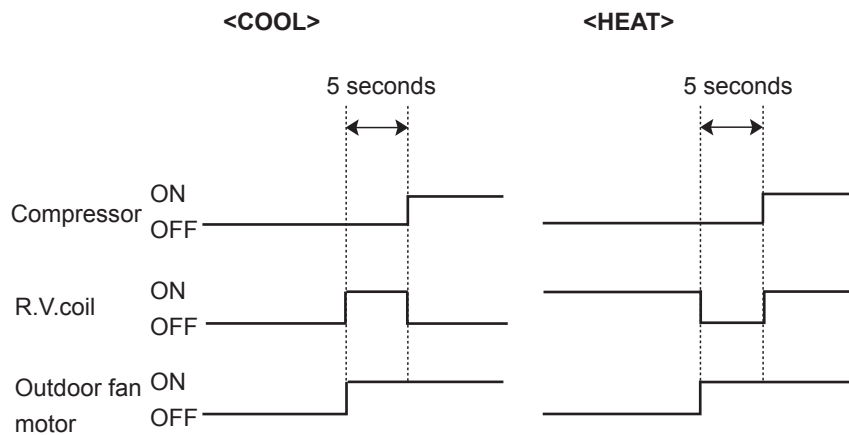


I-3. Relation between main sensor and actuator

Sensor	Purpose	Actuator					
		Compressor	LEV	Outdoor fan motor	R.V.coil	Indoor fan motor	Defrost heater
Discharge temperature thermistor	Protection	○	○				
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○					
	Heating: High pressure protection	○	○				
Defrost thermistor	Heating: Defrosting	○	○	○	○	○	
Fin temperature thermistor	Protection	○		○			
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Heating: Defrosting (Heater)						○
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Cooling: High pressure protection	○	○	○			

C.1.9.8 MSZ-SF•VA Series
MSZ-SF15VA
MSZ-SF20VA

WIRELESS REMOTE CONTROLLER

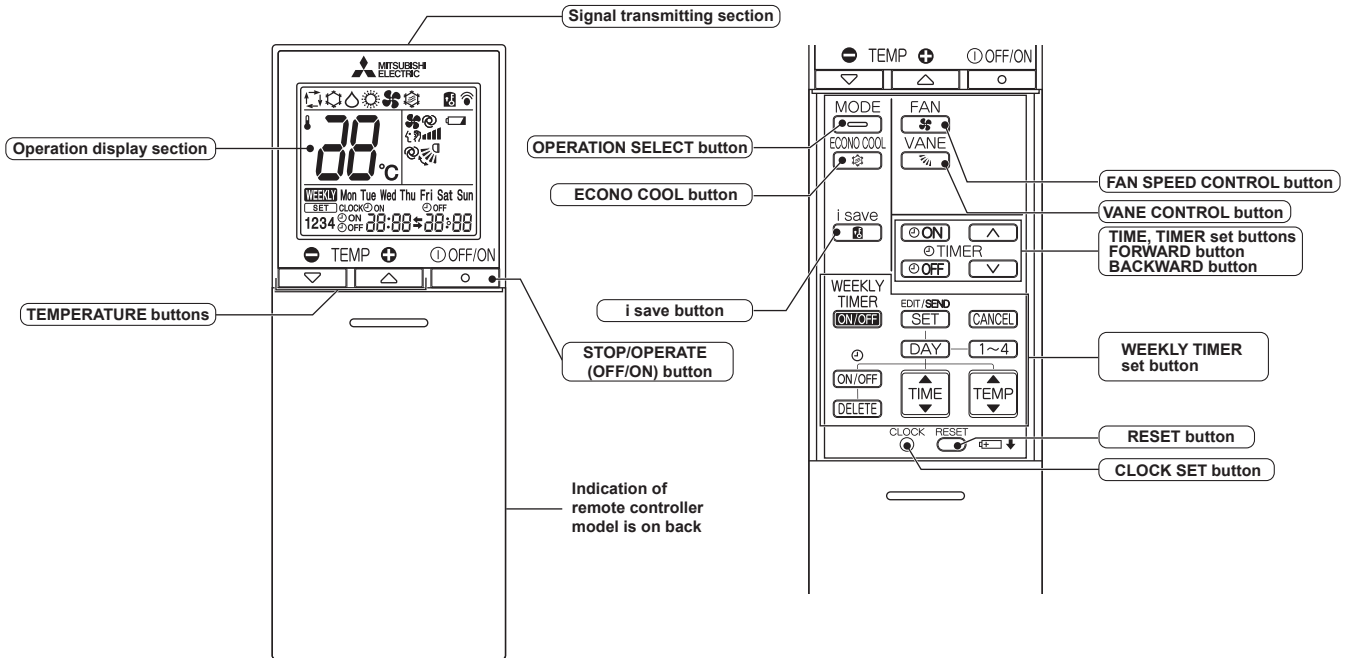

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
	Standby mode (Only during multi system operation)	—

Lit
 Blinking
 Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TEMP \ominus or \oplus button) to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

b. DRY (△) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

c. FAN (⚙️) OPERATION

- (1) OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (☀️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TEMP \ominus or \oplus button) to select the desired temperature. The setting range is 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection

(1) Initial mode

When unit starts the operation with AUTO operation from OFF:

- If the room temperature is higher than the set temperature, operation starts in COOL mode.
- If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.

(2) Mode change

COOL mode changes to HEAT mode when about 15 minutes has passed with the room temperature 1°C below the set temperature.

HEAT mode changes to COOL mode when about 15 minutes has passed with the room temperature 1°C above the set temperature.

NOTE 1

If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.

Refer to **NOTE 2 “FOR MULTI SYSTEM AIR CONDITIONER”**.


NOTE 2

FOR MULTI SYSTEM AIR CONDITIONER OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect 2 or more indoor units with one outdoor unit.

- When you try to operate 2 or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp flashes as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR

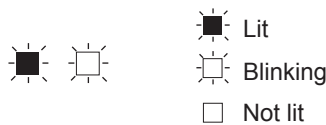

- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirming of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation
Vane angle is fixed to Horizontal position.



In HEAT operation
Vane angle is fixed to Angle 4.



- (5) STOP (operation OFF) and ON TIMER standby
In the following cases, the horizontal vane returns to the closed position.
- When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
 - When the operation is stopped by the emergency operation.
 - When ON TIMER is ON standby.
- (6) Dew prevention
During COOL or DRY operation with the vane angle at Angle 4 or 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 1 for dew prevention.
- (7) SWING (🌀) mode
By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.
- (8) Cold air prevention in HEAT operation
The horizontal vane position is set to Upward.
NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.
- (9) ECONO COOL (🌀) operation (ECONOMICAL operation)
When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed.
Also the horizontal vane swings in various cycle.
SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.
To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation:
ECONO COOL, VANE CONTROL button.

g. TIMER OPERATION

1. How to set the time

- (1) Check that the current time is set correctly.
NOTE: Timer operation will not work without setting the current time. Initially "0:00" blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.
- How to set the current time**
- Press the CLOCK set button.
 - Press the TIME SET buttons (⏮) and (⏭) to set the current time.
 - Each time FORWARD button (⏮) is pressed, the set time increases by 1 minute, and each time BACKWARD button (⏭) is pressed, the set time decreases by 1 minute.
 - Pressing those buttons longer, the set time increases/decreases by 10 minutes.
 - Press the CLOCK set button.
- (2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.
- (3) Set the time of timer.

ON timer setting

- Press ON TIMER button (⏻) during operation.
- Set the time of the timer using TIME SET buttons (⏮) and (⏭).*

OFF timer setting

- Press OFF TIMER button (⏻) during operation.
 - Set the time of the timer using TIME SET buttons (⏮) and (⏭).*
- * Each time FORWARD button (⏮) is pressed, the set time increases by 10 minutes: each time BACKWARD button (⏭) is pressed, the set time decreases by 10 minutes.


2. To release the timer

- To release ON timer, press ON TIMER button (⏻).
- To release OFF timer, press OFF TIMER button (⏻).
- TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

- OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.
- “←” and “→” display shows the order of OFF timer and ON timer operation.

(Example 1) The current time is 8:00 PM.
The unit turns off at 11:00 PM, and on at 6:00 AM.

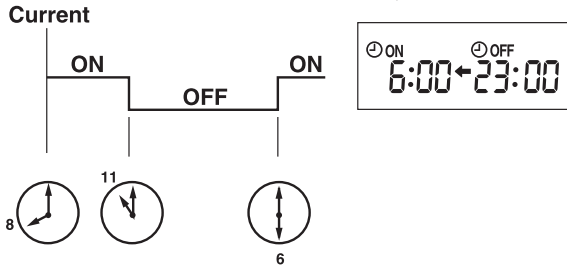


(Example 2) The current time is 11:00 AM.
The unit turns on at 5:00 PM, and off at 9:00 PM.

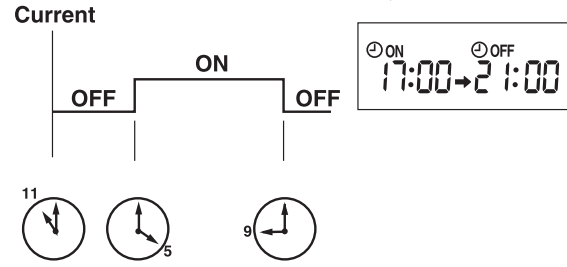

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

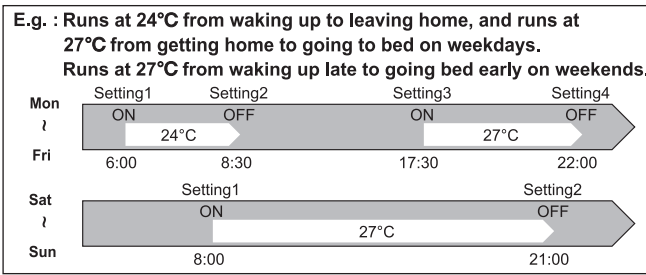


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature cannot be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

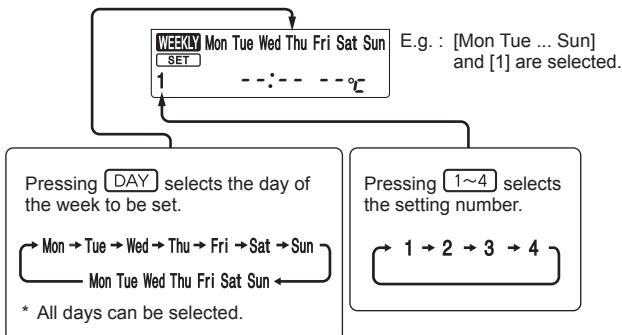

(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

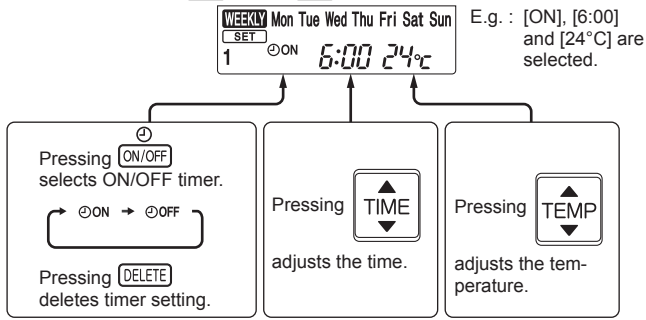

* Hold down the button to change the time quickly.

Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.

(4) Press **EDIT/SEND SET** button to complete and transmit the weekly timer setting.



NOTE:

- Press **EDIT/SEND SET** button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number, **EDIT/SEND SET** button does not have to be pressed per each setting. Press **EDIT/SEND SET** button once after all the settings are complete. All the weekly timer settings will be saved.
- Press **EDIT/SEND SET** button to enter the weekly timer setting mode, and press and hold **DELETE** button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press **WEEKLY TIMER ON/OFF** button to turn the weekly timer ON. (**WEEKLY** lights.)

•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press **WEEKLY TIMER ON/OFF** button again to turn the weekly timer OFF. (**WEEKLY** goes out.)

NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

(1) Press **EDIT/SEND SET** button to enter the weekly timer setting mode.

***[SET]** blinks.

(2) Press **DAY** or **1~4** buttons to view the setting of the particular day or number.

(3) Press **CANCEL** button to exit the weekly timer setting.

NOTE:

When all days of the week are selected to view the settings and a different setting is included among them, --:-- °C will be displayed.

i. i-save (i) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL, HEAT or ECONO COOL mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.


2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode. The same setting is selected from the next time by simply pressing i-save button.

j. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up. The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work. After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med. The coil frost prevention works even in the test run or the emergency operation. In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode. Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.


NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

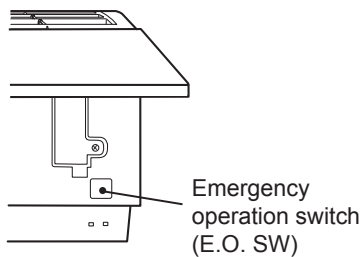

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

Operation Indicator lamp

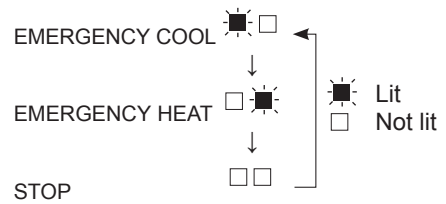


k. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.

C.1.9.9 MSZ-GF•VE2 Series
MSZ-GF60VE2 MUZ-GF60VE
MSZ-GF71VE2 MUZ-GF71VE

WIRELESS REMOTE CONTROLLER

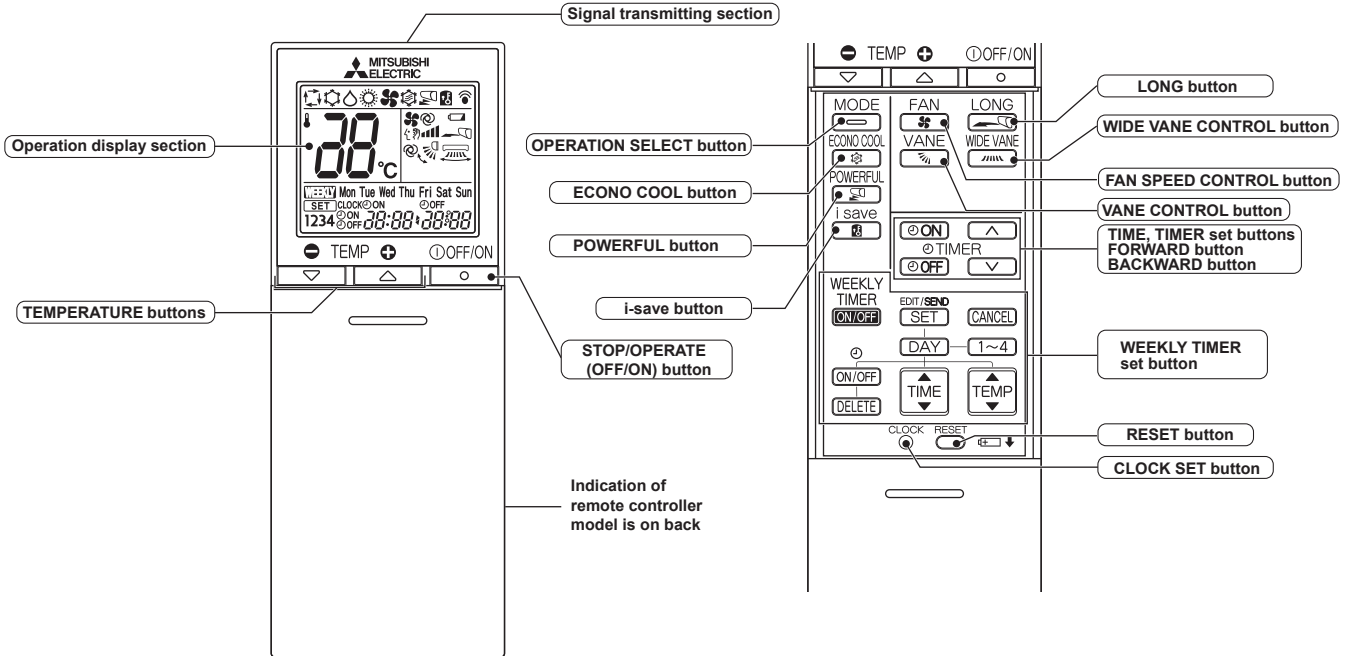

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
○	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
●	Standby mode (Only during multi system operation)	—

- Lit
- Blinking
- Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TEMP ⊖ or ⊕ button) to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

3. Indoor fan speed control

When the thermostat turns OFF, the indoor fan stops running to reduce power consumption.

After that, the indoor fan stops for 60 seconds and then operates at Very Low for 10 seconds to sense accurate room temperature. The indoor fan alternates ON and OFF at this interval while the thermostat is OFF.

When the room temperature rises and the thermostat is ON, the indoor fan starts running according to the settings on the remote controller.

b. DRY (☀️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

3. Indoor fan speed control

Indoor fan speed control works the same way as that in COOL mode. (a.3.)

c. HEAT (🔥) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TEMP ⊖ or ⊕ button) to select the desired temperature. The setting range is 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

d. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection

- (1) Initial mode
When unit starts the operation with AUTO operation from OFF:
 - If the room temperature is higher than the set temperature, operation starts in COOL mode.
 - If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.
- (2) Mode change
COOL mode changes to HEAT mode when about 15 minutes have passed with the room temperature 1°C below the set temperature.
HEAT mode changes to COOL mode when about 15 minutes have passed with the room temperature 1°C above the set temperature.

NOTE 1

If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.


Refer to **NOTE 2 "FOR MULTI SYSTEM AIR CONDITIONER"**.

NOTE 2
FOR MULTI SYSTEM AIR CONDITIONER
OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect 2 or more indoor units with one outdoor unit.

- When you try to operate 2 or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp flashes as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR



- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


e. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirming of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation

Vane angle is fixed to Horizontal position.



In HEAT operation

Vane angle is fixed to Angle 5.




(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the vane angle at Angle 4 or 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 1 for dew prevention.


(7) SWING () mode

By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.

(8) Cold air prevention in HEAT operation

The horizontal vane position is set to Upward.


NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.

(9) ECONO COOL () operation (ECONOMical operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed. Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.



To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, VANE CONTROL, LONG or POWERFUL button.


(10) POWERFUL () operation

The air conditioner automatically adjusts the fan speed and the set temperature, and operates the POWERFUL mode.

The POWERFUL mode is cancelled automatically 15 minutes after operation starts, or when POWERFUL button is pressed once again within 15 minutes after operation starts. The operation mode returns to the mode prior to POWERFUL operation. POWERFUL mode also is cancelled, when the STOP/OPERATE (OFF/ON), ECONO COOL, FAN SPEED CONTROL or i-save button is pressed within 15 minutes after operation starts, or operation mode is changed.

(11) LONG MODE ()

By pressing LONG button indoor fan speed becomes faster than setting fan speed on the remote controller, and the horizontal vane moves to the position for LONG mode. The remote controller displays "  ". LONG mode is cancelled when LONG button is pressed once again or STOP/OPERATE (OFF/ON) or VANE CONTROL button is pressed or ECONO COOL button is pressed in COOL mode. In the following example, the vertical vane is set to  (front.).

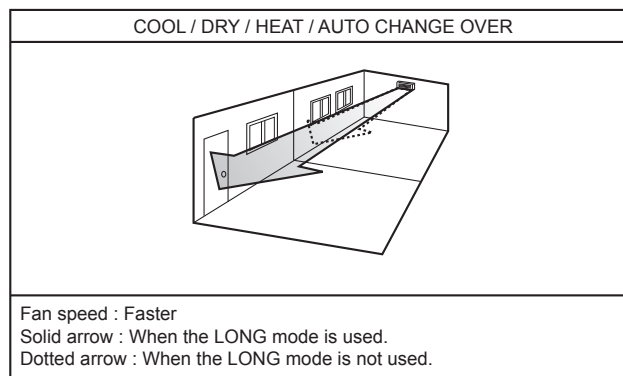

2. Vertical vane


(1) Vane motor drive

These models are equipped with a stepping motor for the vertical vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from microprocessor.

(2) The vertical vane angle and mode change as follows by pressing WIDE VANE CONTROL button.

(3) Positioning


To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.



Confirmation of standard position is performed in the following cases:

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER ON).
- (b) SWING is started.

(4) SWING () MODE

By selecting SWING mode with WIDE VANE CONTROL button, the vertical vane swings horizontally. The remote controller displays "  ". Swing mode is cancelled when WIDE MODE CONTROL button is pressed once again.

f. TIMER OPERATION

1. How to set the time

(1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially “0:00” blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.

How to set the current time

(a) Press the CLOCK set button.

(b) Press the TIME SET buttons (▲) and (▼) to set the current time.

- Each time FORWARD button (▲) is pressed, the set time increases by 1 minute, and each time BACKWARD button (▼) is pressed, the set time decreases by 1 minute.
- Pressing those buttons longer, the set time increases/decreases by 10 minutes.

(c) Press the CLOCK set button.

(2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.

(3) Set the time of timer.

ON timer setting

(a) Press ON TIMER button (ⓄON) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).*

OFF timer setting

(a) Press OFF TIMER button (ⓄOFF) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).*

* Each time FORWARD button (▲) is pressed, the set time increases by 10 minutes: each time BACKWARD button (▼) is pressed, the set time decreases by 10 minutes.

2. To release the timer

To release ON timer, press ON TIMER button (ⓄON).

To release OFF timer, press OFF TIMER button (ⓄOFF).

TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

• OFF timer and ON timer can be used in combination. The timer of the set time that is reached first will operate first.

• “◀” and “▶” display shows the order of OFF timer and ON timer operation.


(Example 1) The current time is 8:00 PM.

The unit turns off at 11:00 PM, and on at 6:00 AM.

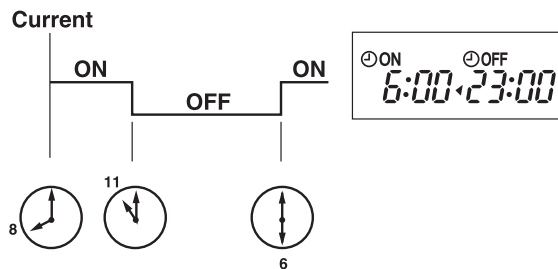

(Example 2) The current time is 11:00 AM.


The unit turns on at 5:00 PM, and off at 9:00 PM.

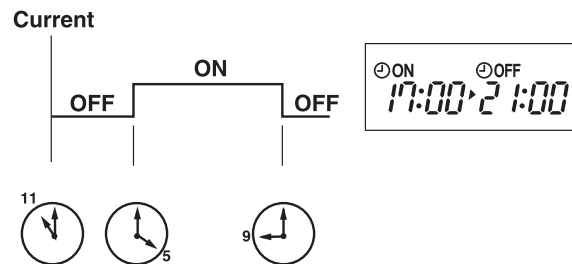

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

g. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

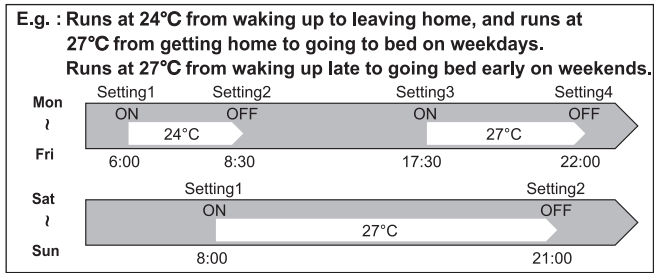


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature can not be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.



1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

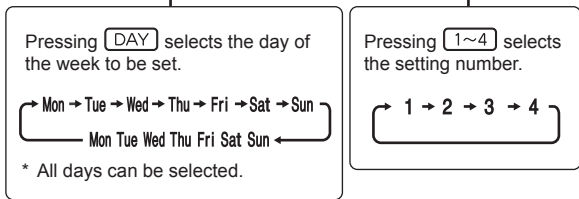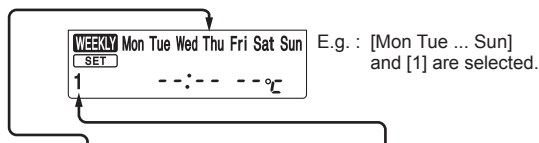

(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

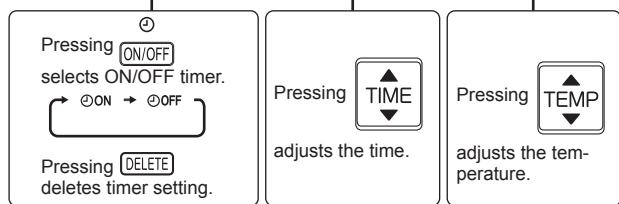

* Hold down the button to change the time quickly.

* The temperature can be set between 16°C and 31°C at weekly timer.



Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.

(4) Press **EDIT/SEND SET** button to complete and transmit the weekly timer setting.





NOTE:

- Press **EDIT/SEND SET** button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number, **EDIT/SEND SET** button does not have to be pressed per each setting. Press **EDIT/SEND SET** button once after all the settings are complete. All the weekly timer settings will be saved.
- Press **EDIT/SEND SET** button to enter the weekly timer setting mode, and press and hold **DELETE** button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press  button to turn the weekly timer ON. ( lights.)


•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press  button again to turn the weekly timer OFF. ( goes out.)


NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting


(1) Press  button to enter the weekly timer setting mode.

* blinks.

(2) Press  or  buttons to view the setting of the particular day or number.

(3) Press  button to exit the weekly timer setting.

NOTE:

When all days of the week are selected to view the settings and a different setting is included among them,  will be displayed.

h. i-save (i) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL, HEAT or ECONO COOL mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL/ECONO COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.

2. How to cancel operation

- Press i-save button again.
 - i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode.
- The same setting is select from the next time by simply pressing i-save button.

i. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up. The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.

In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.



Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Med.
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as follows:

Operation Indicator lamp

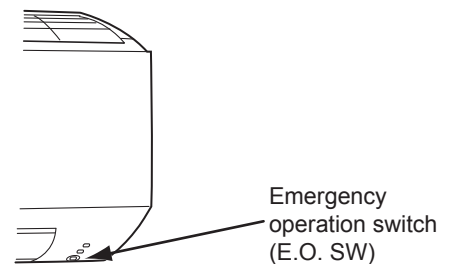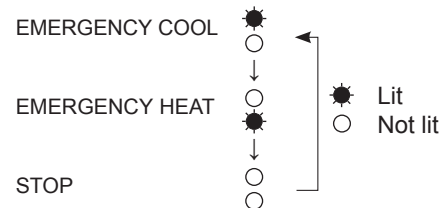

j. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


k. ACTUATOR CONTROL

k-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.


[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

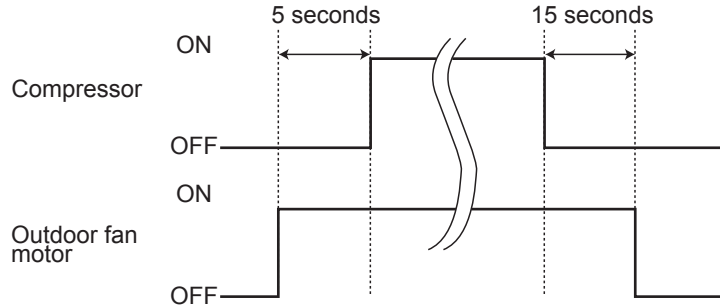

k-2. R.V. coil control

- Heating ON
- Cooling OFF
- Dry OFF

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

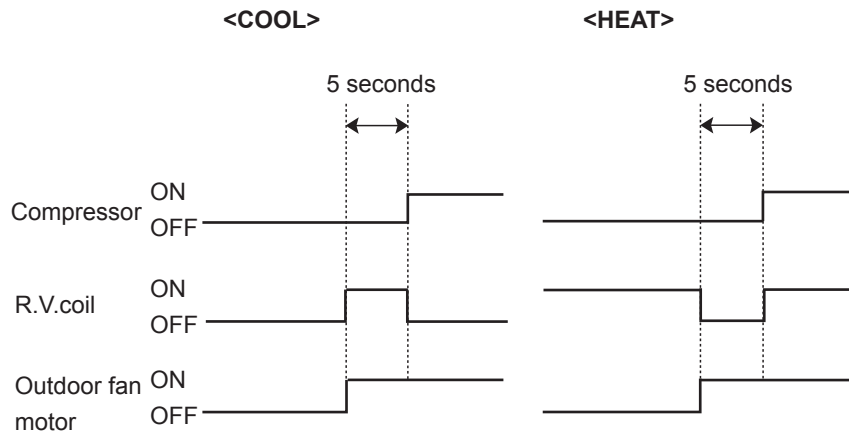


k-3. Relation between main sensor and actuator

Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V.coil	Indoor fan motor
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○	○			
Defrost thermistor	Heating: Defrosting	○	○	○	○	○
Fin temperature thermistor	Protection	○		○		
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○		
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○		
	Cooling: High pressure protection	○	○	○		

C.1.9.10 MSZ-WN•VA Series

MSZ-WN25VA MUZ-WN25VA
MSZ-WN35VA MUZ-WN35VA

WIRELESS REMOTE CONTROLLER

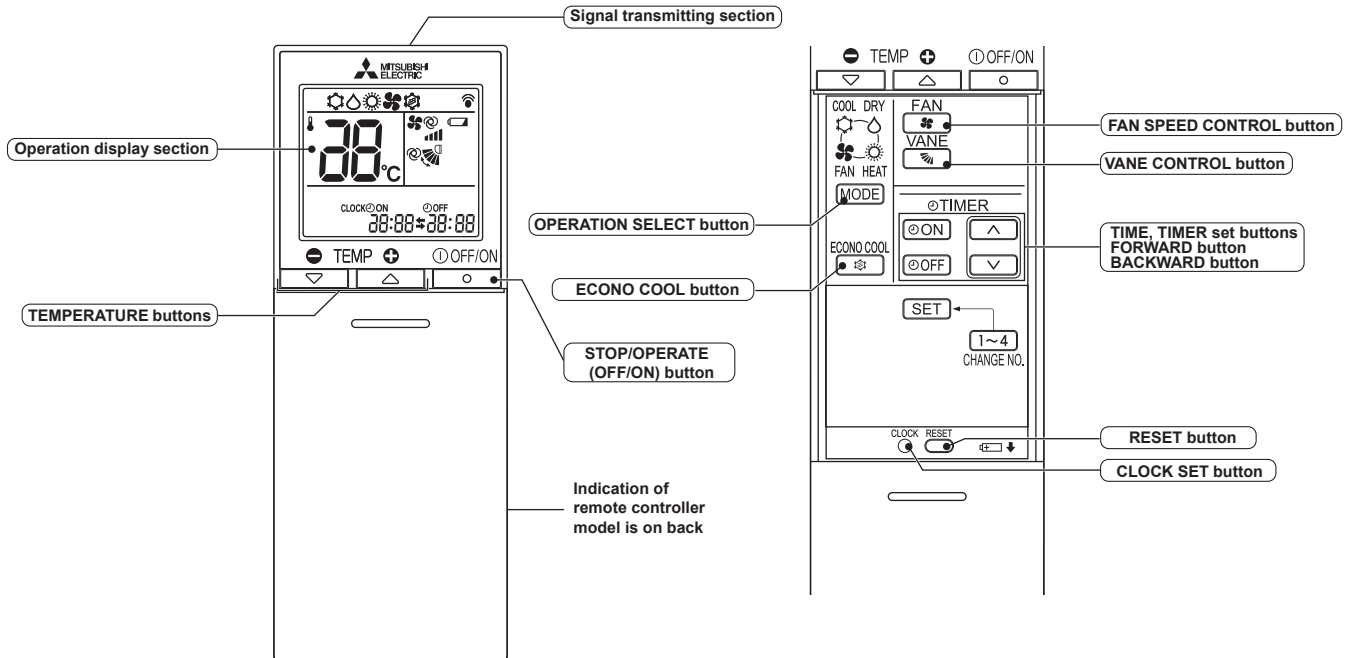

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
●		
●	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
○		

● Lit
● Blinking
○ Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE/ (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works. The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

b. DRY (Δ) OPERATION

- (1) Press STOP/OPERATE/ (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

c. HEAT (☀) OPERATION

- (1) Press STOP/OPERATE/ (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.


The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

d. AUTO VANE OPERATION

1. Horizontal vane

- (1) Vane motor drive
These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.
- (2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.




- (3) Positioning
To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.
Confirmation of standard position is performed in the following cases:
(a) When the operation starts or finishes (including timer operation).
(b) When the test run starts.
(c) When standby mode (only during multi system operation) starts or finishes.

- (4) VANE AUTO (Ⓢ) mode
In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation
Vane angle is fixed to Horizontal position.



In HEAT operation
Vane angle is fixed to Angle 4.



- (5) STOP (operation OFF) and ON TIMER standby
In the following cases, the horizontal vane returns to the closed position.
- When STOP/OPERATE/ (OFF/ON) button is pressed (POWER OFF).
 - When the operation is stopped by the emergency operation.
 - When ON TIMER is ON standby.
- (6) Dew prevention
During COOL or DRY operation with the vane angle at Angle 3 ~ 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 2 for dew prevention.
- (7) SWING (🌀) mode
By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.
- (8) Cold air prevention in HEAT operation.
The horizontal vane position is set to Upward.
NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.
- (9) ECONO COOL (🌿) operation (ECONOMICAL operation)
When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. (However, the temperature on the LCD screen on the remote controller is not changed.)
Also the horizontal vane swings in various cycle.
SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.
To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, or VANE CONTROL button.

e. TIMER OPERATION (ON/OFF TIMER)

1. How to set the time

- (1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially "0:00" blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.

How to set the current time

- Press the CLOCK set button.
 - Press the TIME SET buttons (⏮ and ⏭) to set the current time.
 - Each time FORWARD button (⏮) is pressed, the set time increases by 1 minute, and each time BACKWARD button (⏭) is pressed, the set time decreases by 1 minute.
 - Pressing those buttons longer, the set time increases/decreases by 10 minutes.
 - Press the CLOCK set button.
- (2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.
- (3) Set the time of timer.

ON timer setting

- Press ON TIMER button (⏻) during operation.
- Set the time of the timer using TIME SET buttons (⏮ and ⏭).*

OFF timer setting

- Press OFF TIMER button (⏻) during operation.
 - Set the time of the timer using TIME SET buttons (⏮ and ⏭).*
- * Each time FORWARD button (⏮) is pressed, the set time increases by 10 minutes: each time BACKWARD button (⏭) is pressed, the set time decreases by 10 minutes.

2. To release the timer


- To release ON timer, press ON TIMER button (⏻).
- To release OFF timer, press OFF TIMER button (⏻).
- TIMER is cancelled and the display of set time disappears.

PROGRAM TIMER

- OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.
- “←” and “→” display show the order of OFF timer and ON timer operation.


(Example 1) The current time is 8:00 PM.

The unit turns off at 11:00 PM, and on at 6:00 AM.

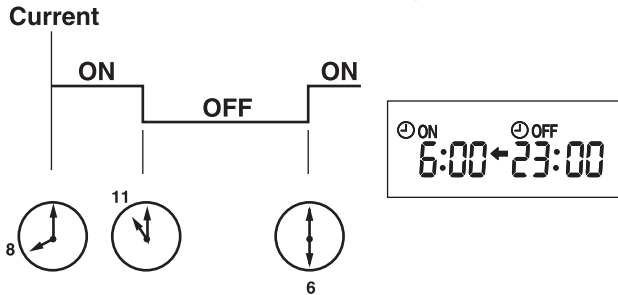

(Example 2) The current time is 11:00 AM.

The unit turns on at 5:00 PM, and off at 9:00 PM.

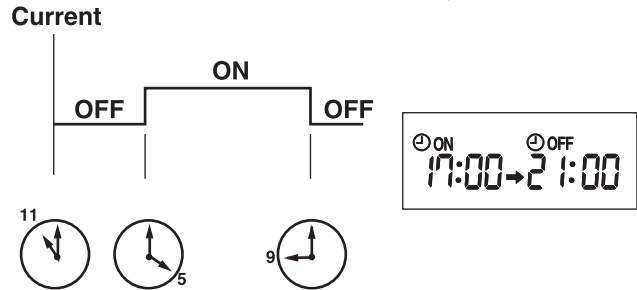

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

f. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.

In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.


NOTE: Do not press EMERGENCY OPERATION switch during normal operation.



Operation mode	COOL	HEAT
Set temperature	24°C	24°C
Fan speed	Med.	Med.
Horizontal vane	Auto	Auto

The operation mode is indicated by the Operation Indicator lamp as follows:

Operation Indicator lamp

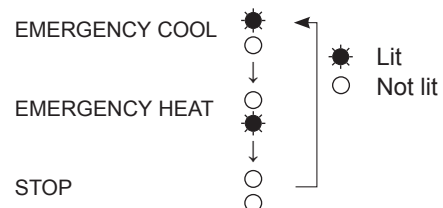

g. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


h. ACTUATOR CONTROL

h-1. OUTDOOR FAN MOTOR CONTROL

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

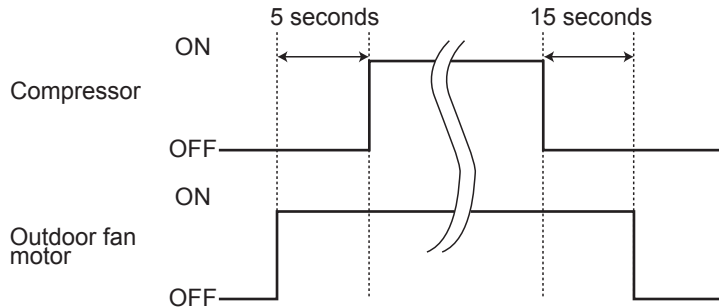

h-2. R.V. COIL CONTROL


R.V. COIL CONTROL

Heating OFF

Cooling ON

Dry ON

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

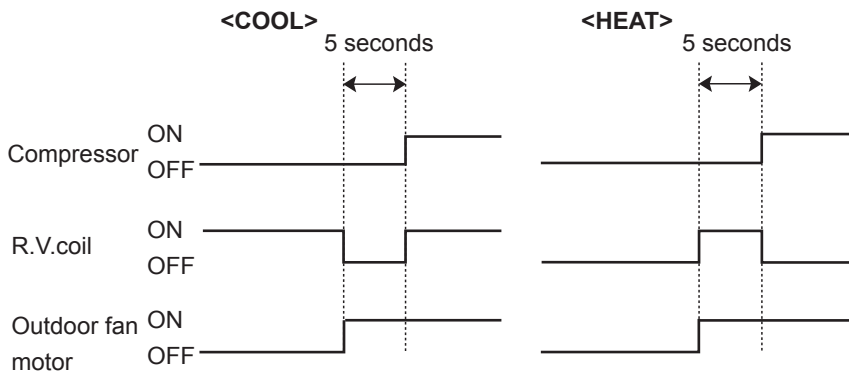


h-3. RELATION BETWEEN MAIN SENSOR AND ACTUATOR

Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○				
Defrost thermistor	Cooling: High pressure protection	○	○	○		
	Heating: Defrosting	○	○	○	○	○
Fin temperature thermistor	Protection	○		○		

C.1.9.11 MSZ-DM•VA Series

MSZ-DM25VA MUZ-DM25VA
MSZ-DM35VA MUZ-DM35VA

WIRELESS REMOTE CONTROLLER

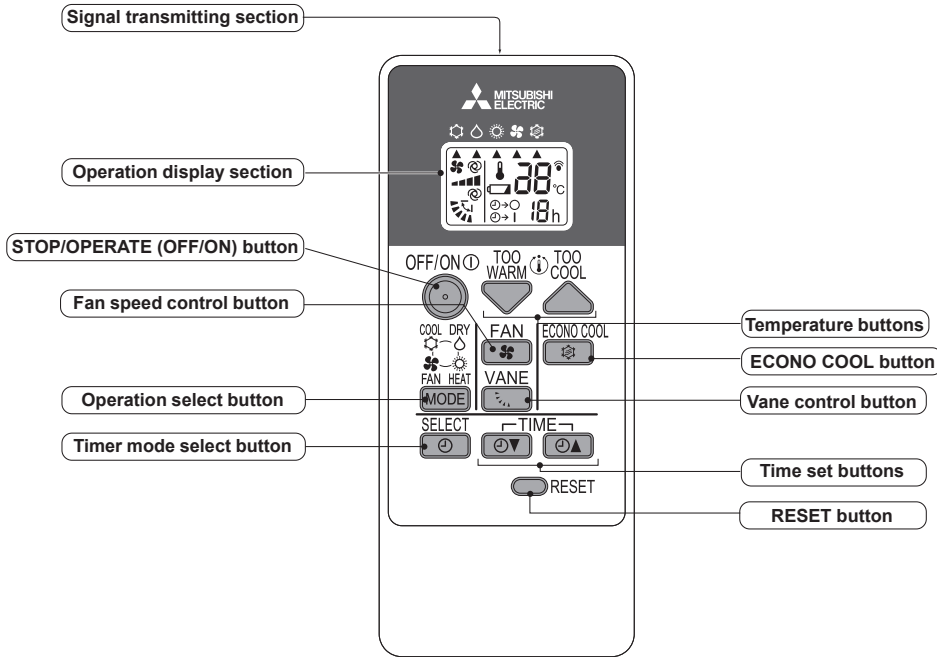

NOTE : Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
○		
●	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
○		
●	Standby mode (Only during multi system operation)	—
○		

● Lit
○ Blinking
○ Not lit

a. COOL (❄️) OPERATION

- Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- Select COOL mode with OPERATION SELECT button.
- Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works. The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

b. DRY (Δ) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

c. HEAT (☀) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.


The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

d. AUTO VANE OPERATION

1. Horizontal vane

- (1) Vane motor drive
These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.
- (2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.


(4) VANE AUTO (⊙) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation
Vane angle is fixed to Horizontal position.



In HEAT operation
Vane angle is fixed to Angle 4.



(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.

(6) Dew prevention

During COOL or DRY operation with the vane angle at Angle 3 ~ 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 2 for dew prevention.

(7) SWING (↕) mode

By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.

(8) Cold air prevention in HEAT operation.

The horizontal vane position is set to Upward.

NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.

(9) ECONO COOL (🌿) operation (ECONOMICAL operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher.

Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.

ECONO COOL operation is cancelled when ECONO COOL button is pressed once again or VANE CONTROL button is pressed or change to other operation mode.



e. TIMER OPERATION (ON/OFF TIMER)**1. How to set the timer**

(1) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.

(2) Select the timer mode by pressing the  button during operation.

Each time this button is pressed, the timer mode is changed in sequence:

☉→○ (OFF TIMER) → ☉→| (ON TIMER) → TIMER RELEASE

(3) Set the time of the timer using the   button.

Each time this button is pressed, the set time increase or decrease by 1 hour to 12 hours.

2. To release the timer

Press the  button until ☉→○ (OFF TIMER) and ☉→| (ON TIMER) are not displayed.

NOTE :

- The OFF TIMER and the ON TIMER cannot be set at the same time.
- The displayed time is the time remaining and will decrease in 1-hour increments as time passes.

f. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.

In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.


NOTE: Do not press EMERGENCY OPERATION switch during normal operation.



Operation mode	COOL	HEAT
Set temperature	24°C	24°C
Fan speed	Med.	Med.
Horizontal vane	Auto	Auto

The operation mode is indicated by the Operation Indicator lamp as follows:

Operation Indicator lamp

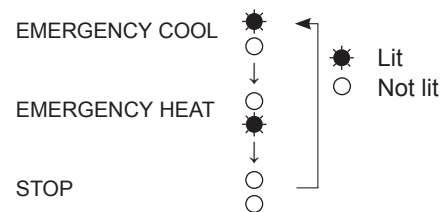

g. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


h. ACTUATOR CONTROL

h-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

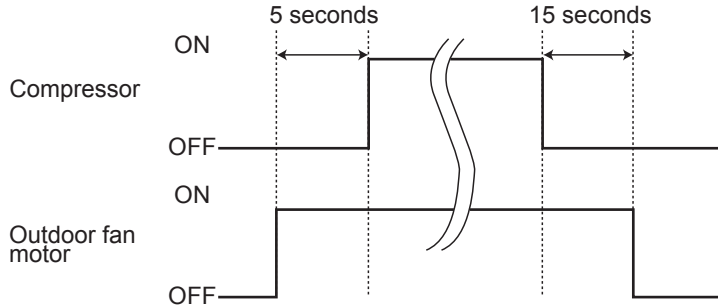


h-2. R.V. Coil control

Heating OFF

Cooling ON

Dry ON

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

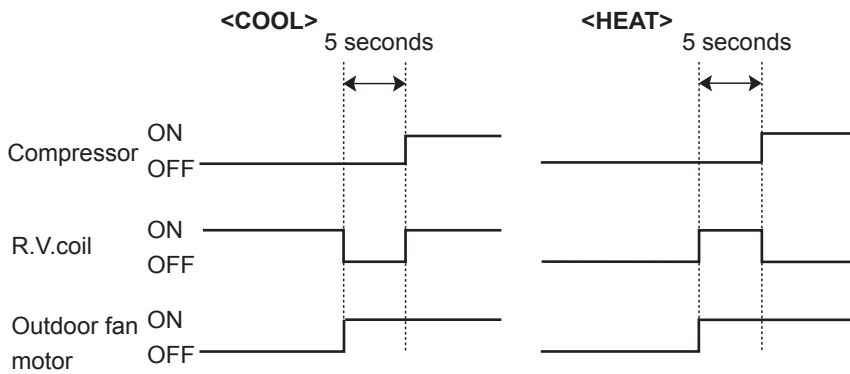

h-3. Relation between main sensor and actuator


Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○				
Defrost thermistor	Cooling: High pressure protection	○	○	○		
	Heating: Defrosting	○	○	○	○	○
Fin temperature thermistor	Protection	○		○		

OPERATION AND ACTUATOR CONTROL WALL-MOUNTED

C.1.9.12 MSZ-HJ•VA Series

- MSZ-HJ25VA MUZ-HJ25VA
- MSZ-HJ35VA MUZ-HJ35VA
- MSZ-HJ50VA MUZ-HJ50VA
- MSZ-HJ60VA MUZ-HJ60VA
- MSZ-HJ71VA MUZ-HJ71VA

WIRELESS REMOTE CONTROLLER

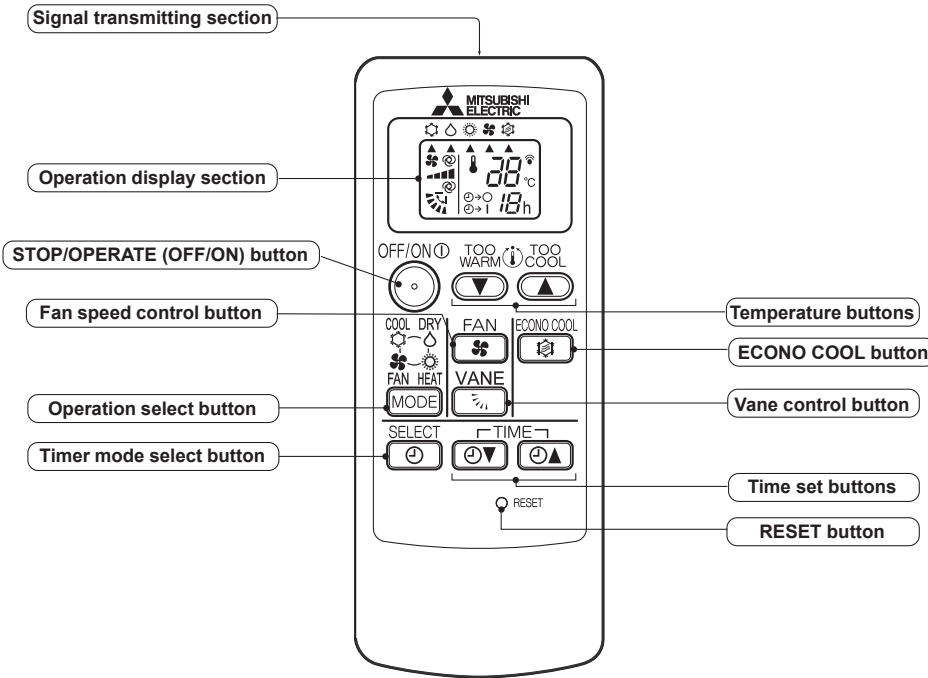

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

- The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
●	The unit is operating to reach the set temperature.	About 2°C or more away from set temperature
○	The room temperature is approaching the set temperature.	About 1 to 2°C from set temperature
●	Standby mode (Only during multi system operation)	—

- Lit
- Blinking
- Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works. The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

b. DRY (△) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

c. HEAT (⊙) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons (TOO WARM or TOO COOL button) to select the desired temperature.
The setting range is 16 ~ 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

The indoor fan operates following the cold air prevention control. This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting


Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

d. AUTO VANE OPERATION**1. Horizontal vane**

- (1) Vane motor drive
These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.
- (2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.

**(3) Positioning**

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirmation of standard position is performed in the following cases:

- (a) When the operation starts or finishes (including timer operation).
- (b) When the test run starts.
- (c) When standby mode (only during multi system operation) starts or finishes.


(4) VANE AUTO (⊙) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL and DRY operation
Vane angle is fixed to Horizontal position.





In HEAT operation
Vane angle is fixed to Angle 4.



- (5) STOP (operation OFF) and ON TIMER standby
 In the following cases, the horizontal vane returns to the closed position.
 (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
 (b) When the operation is stopped by the emergency operation.
 (c) When ON TIMER is ON standby.
- (6) Dew prevention
 During COOL or DRY operation with the vane angle at Angle 3 ~ 5 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 2 for dew prevention.
- (7) SWING (↕) mode
 By selecting SWING mode with VANE CONTROL button, the horizontal vane swings vertically.
- (8) Cold air prevention in HEAT operation.
 The horizontal vane position is set to Upward.
NOTE: When 2 or more indoor units are operated with multi outdoor unit, even if any indoor unit turns thermostat off, this control does not work in the indoor unit.
- (9) ECONO COOL (🌡️) operation (ECONOMical operation)
 When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher.
 Also the horizontal vane swings in various cycle.
 SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.
 ECONO COOL operation is cancelled when ECONO COOL button is pressed once again or VANE CONTROL button is pressed or change to other operation mode.

e. TIMER OPERATION (ON/OFF TIMER)

1. How to set the timer

- (1) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.
- (2) Select the timer mode by pressing the  button during operation.
 Each time this button is pressed, the timer mode is changed in sequence:
 ☉→○ (OFF TIMER) → ☉→| (ON TIMER) → TIMER RELEASE
- (3) Set the time of the timer using the  button.
 Each time this button is pressed, the set time increase or decrease by 1 hour to 12 hours.

2. To release the timer

Press the  button until ☉→○ (OFF TIMER) and ☉→| (ON TIMER) are not displayed.

NOTE :

- The OFF TIMER and the ON TIMER cannot be set at the same time.
- The displayed time is the time remaining and will decrease in 1-hour increments as time passes.

f. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.


After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Med.

The coil frost prevention works even in the test run or the emergency operation.

In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.




EMERGENCY OPERATION switch



Operation mode	COOL	HEAT
Set temperature	24°C	24°C
Fan speed	Med.	Med.
Horizontal vane	Auto	Auto

The operation mode is indicated by the Operation Indicator lamp as follows:

Operation Indicator lamp

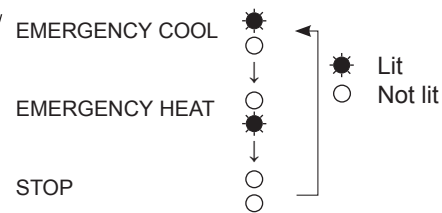

g. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


h. ACTUATOR CONTROL

h-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.

[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

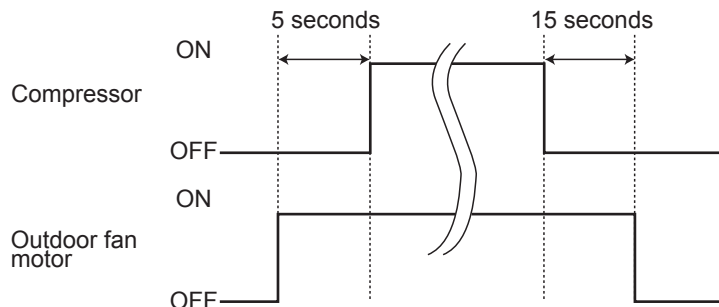

h-2. R.V. coil control


MUZ-HJ25VA MUZ-HJ35VA

Heating OFF

Cooling ON

Dry ON

NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

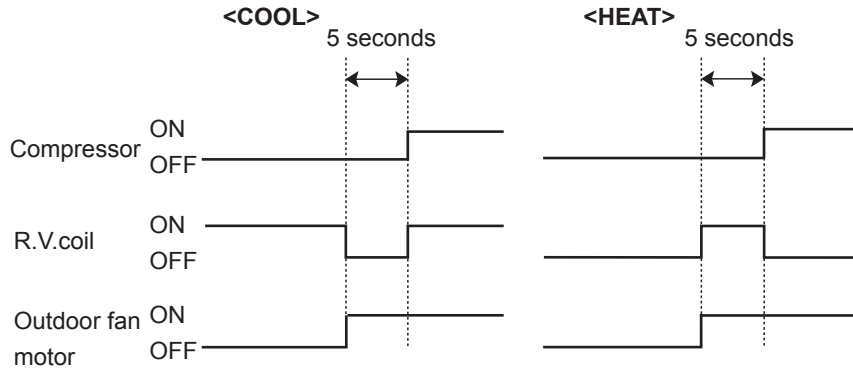


MUZ-HJ50VA MUZ-HJ60VA MUZ-HJ71VA

Heating ON

Cooling OFF

Dry OFF



NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

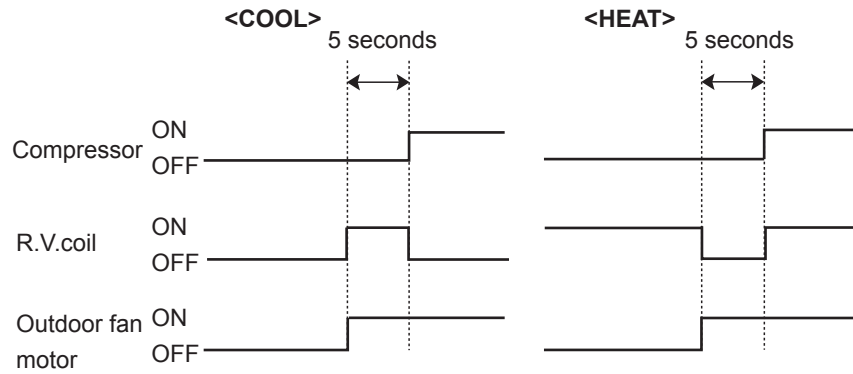

h-3. Relation between main sensor and actuator

Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V. coil	Indoor fan motor
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○				
Defrost thermistor	Cooling: High pressure protection	○	○	○		
	Heating: Defrosting	○	○	○	○	○
Fin temperature thermistor	Protection	○		○		

C.1.10 CAPACITY CORRECTION RATIO CURVE FOR PIPING LENGTH

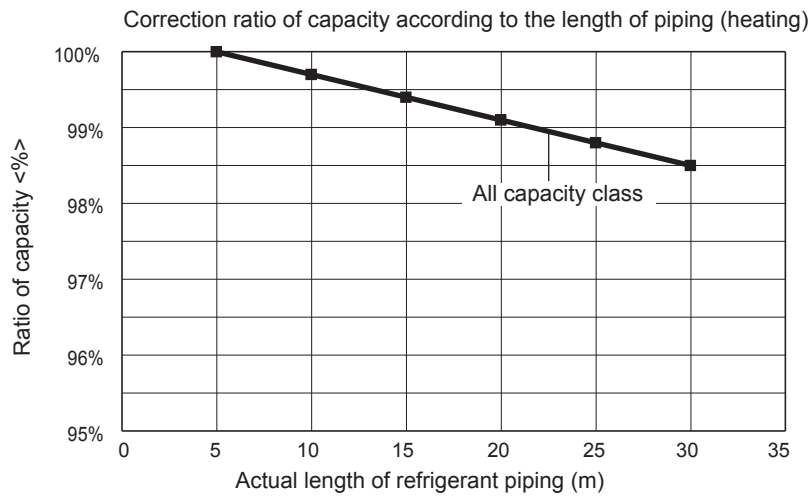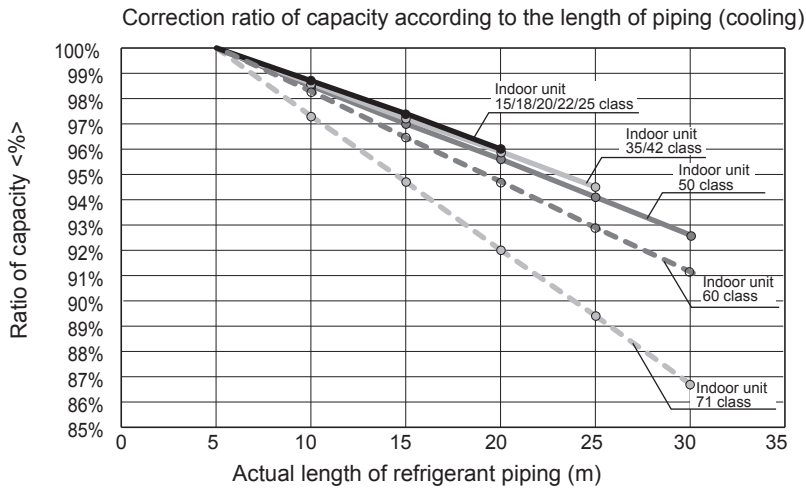

The length intended for the capacity calculation, which counts the length of refrigerant piping and the number of bends, is called actual length.

$$\text{Length of refrigerant piping (m)} + (\text{Number of bends} \times 0.3 \text{ m}) = \text{Actual length of refrigerant piping (m)}$$

CAPACITY CORRECTION RATIO CURVE PIPING LENGTH WALL-MOUNTED

C.2 FLOOR-STANDING

C.2.1	SPECIFICATIONS	C-386
	C.2.1.1 Inverter Heat Pump	C-386
C.2.2	OUTLINES AND DIMENSIONS.....	C-388
	C.2.2.1 Indoor Unit.....	C-388
	C.2.2.2 Outdoor Unit.....	C-389
C.2.3	WIRING DIAGRAM.....	C-390
	C.2.3.1 Indoor Unit.....	C-390
	C.2.3.2 Outdoor Unit.....	C-391
C.2.4	REFRIGERANT SYSTEM DIAGRAM	C-394
	C.2.4.1 Inverter Heat Pump	C-394
C.2.5	PERFORMANCE CURVES	C-395
	C.2.5.1 Inverter Heat Pump	C-395
C.2.6	PERFORMANCE DATA.....	C-401
	C.2.6.1 Inverter Heat Pump	C-401
C.2.7	NOISE CRITERIA CURVES	C-408
	C.2.7.1 Inverter Heat Pump	C-408
C.2.8	TEMPERATURE AND AIR FLOW DISTRIBUTIONS.....	C-410
C.2.9	OPERATION AND ACTUATOR CONTROL.....	C-416
	C.2.9.1 MFZ-KJ·VE2 Series	C-416
C.2.10	CAPACITY CORRECTION RATIO CURVE FOR PIPING LENGTH.....	C-424

C.2.1 SPECIFICATIONS

C.2.1.1 Inverter Heat Pump

Indoor Unit				MFZ-KJ25VE2	MFZ-KJ35VE2	MFZ-KJ50VE2	
Outdoor Unit				MUFZ-KJ25VE	MUFZ-KJ35VE	MUFZ-KJ50VE	
Refrigerant				R410A(*1)			
Power Supply	Source			Outdoor Power supply		Outdoor Power supply	
	Outdoor (V/Phase/Hz)			230V/Single/50Hz		230V/Single/50Hz	
Cooling	Capacity	Rated	kW	2.5	3.5	5.0	
		Min. - Max.	kW	0.5 - 3.4	0.5 - 3.7	1.6 - 5.7	
	SHF			0.85	0.73	0.71	
	Total Input	Rated	kW	0.540	0.940	1.410	
	EER			4.63	3.72	3.55	
	EEL Rank			A	A	A	
	Design load		kW	2.5	3.5	5.0	
	Annual electricity consumption (*2)			kWh/a	102	150	266
	SEER			8.5	8.1	6.5	
	Energy efficiency class			A+++	A++	A++	
Heating (Average Season)	Capacity	Rated	kW	3.4	4.3	6.0	
		Min. - Max.	kW	1.2 - 4.6	1.2 - 5.5	2.2 - 8.2	
	Total Input	Rated	kW	0.770	1.100	1.610	
	COP			4.42	3.91	3.73	
	EEL Rank			A	A	A	
	Design load		kW	3.4(-10°C)	3.5(-10°C)	4.4(-10°C)	
	Declared Capacity	at reference design temperature	kW	3.4(-10°C)	3.5(-10°C)	4.4(-10°C)	
		at bivalent temperature	kW	3.4(-10°C)	3.5(-10°C)	4.4(-10°C)	
		at operation limit temperature	kW	2.4(-15°C)	2.9(-15°C)	6.0(-15°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)
	Annual electricity consumption (*2)			kWh/a	1059	1110	1406
	SCOP			4.5	4.4	4.3	
	Energy efficiency class			A+	A+	A+	
Operating Current (Max.)			A	9.4	9.4	14.0	
Indoor Unit	Input	Rated	kW	0.016	0.016	0.038	
		Operating Current (Max.)	A	0.17	0.17	0.34	
	Dimensions			H x W x D	600 x 750 x 215	600 x 750 x 215	600 x 750 x 215
	Weight			kg	15	15	15
	Air Volume (Silent-Lo-Mid-Hi-SHi (*3) (Dry/Wet))	Cooling	m ³ /min.	3.9 - 4.9 - 5.9 - 7.1 - 8.2	3.9 - 4.9 - 5.9 - 7.1 - 8.2	5.6 - 6.7 - 8.0 - 9.3 - 10.6	
		Heating	m ³ /min.	3.9 - 5.1 - 6.2 - 7.7 - 9.7	3.9 - 5.1 - 6.2 - 7.7 - 9.7	6.0 - 7.4 - 9.4 - 11.6 - 14.0	
	Sound Level (SPL) (Silent-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)	20 - 25 - 30 - 35 - 39	20 - 25 - 30 - 35 - 39	27 - 31 - 35 - 39 - 44	
		Heating	dB(A)	19 - 25 - 30 - 35 - 41	19 - 25 - 30 - 35 - 41	29 - 35 - 40 - 45 - 50	
	Sound Level (PWL)	Cooling	dB(A)	49	50	56	
Outdoor Unit	Dimensions			H x W x D	550 x 800 x 285	550 x 800 x 285	880 x 840 x 330
	Weight			kg	37	37	55
	Air Volume	Cooling	m ³ /min.	31.3	31.3	45.8	
		Heating	m ³ /min.	33.6	33.6	45.8	
	Sound Level (SPL)	Cooling	dB(A)	46	47	49	
		Heating	dB(A)	51	51	51	
	Sound Level (PWL)	Cooling	dB(A)	59	60	63	
		Heating	dB(A)	59	60	63	
	Operating Current (Max.)			A	9.2	9.2	13.6
Breaker Size			A	10	10	16	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7	
	Max.Length	Out-In	m	20	20	30	
	Max.Height	Out-In	m	12	12	15	
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46
			Heating	°C	-15 ~ +24	-15 ~ +24	-15 ~ +24

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

Indoor Unit				MFZ-KJ25VE2	MFZ-KJ35VE2	MFZ-KJ50VE2		
Outdoor Unit				MUFZ-KJ25VEHZ	MUFZ-KJ35VEHZ	MUFZ-KJ50VEHZ		
Refrigerant				R410A(*1)	R410A(*1)	R410A(*1)		
Power Supply	Source			Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
	Outdoor (V/Phase/Hz)			230V/Single/50Hz	230V/Single/50Hz	230V/Single/50Hz		
Cooling	Capacity	Rated	kW	2.5	3.5	5.0		
		Min. - Max.	kW	0.5 - 3.4	0.5 - 3.7	1.6 - 5.7		
	SHF			0.85	0.73	0.71		
	Total Input	Rated	kW	0.540	0.940	1.410		
		EER			4.63	3.72	3.55	
	EEL Rank			A	A	A		
	Design load			kW	2.5	3.5	5.0	
	Annual electricity consumption (*2)			kWh/a	102	150	266	
	SEER			8.5	8.1	6.5		
	Energy efficiency class			A+++	A++	A++		
Heating (Average Season)	Capacity	Rated	kW	3.4	4.3	6.0		
		Min. - Max.	kW	1.2 - 5.1	1.2 - 5.8	2.2 - 8.4		
	Total Input	Rated	kW	0.770	1.100	1.610		
		COP			4.42	3.91	3.73	
	EEL Rank			A	A	A		
	Design load			kW	3.5(-10°C)	3.6(-10°C)	4.5(-10°C)	
	Declared Capacity	at reference design temperature		kW	3.5(-10°C)	3.6(-10°C)	4.5(-10°C)	
		at bivalent temperature		kW	3.5(-10°C)	3.6(-10°C)	4.5(-10°C)	
		at operation limit temperature		kW	1.6(-25°C)	2.3(-25°C)	3.3(-25°C)	
	Back up heating capacity			kW	0.0(-10°C)	0.0(-10°C)	0.0(-10°C)	
	Annual electricity consumption (*2)			kWh/a	1104	1158	1467	
	SCOP			4.4	4.3	4.2		
	Energy efficiency class			A+	A+	A+		
Operating Current (Max.)			A	9.4	10.2	14.0		
Indoor Unit	Input	Rated	kW	0.016	0.016	0.038		
		Operating Current (Max.)			A	0.17	0.34	
	Dimensions			H x W x D	mm	600 x 750 x 215	600 x 750 x 215	600 x 750 x 215
	Weight			kg	15	15	15	
	Air Volume	Cooling	m ³ /min.	3.9 - 4.9 - 5.9 - 7.1 - 8.2	3.9 - 4.9 - 5.9 - 7.1 - 8.2	5.6 - 6.7 - 8.0 - 9.3 - 10.6		
		Heating	m ³ /min.	3.9 - 5.1 - 6.2 - 7.7 - 9.7	3.9 - 5.1 - 6.2 - 7.7 - 9.7	6.0 - 7.4 - 9.4 - 11.6 - 14.0		
	Sound Level (SPL)	Cooling	dB(A)	20 - 25 - 30 - 35 - 39	20 - 25 - 30 - 35 - 39	27 - 31 - 35 - 39 - 44		
		Heating	dB(A)	19 - 25 - 30 - 35 - 41	19 - 25 - 30 - 35 - 41	29 - 35 - 40 - 45 - 50		
	Sound Level (PWL)	Cooling	dB(A)	49	50	56		
Outdoor Unit	Dimensions			H x W x D	mm	550 x 800 x 285	550 x 800 x 285	880 x 840 x 330
	Weight			kg	37	37	55	
	Air Volume	Cooling	m ³ /min.	31.3	31.3	45.8		
		Heating	m ³ /min.	33.6	33.6	45.8		
	Sound Level (SPL)	Cooling	dB(A)	46	47	49		
		Heating	dB(A)	51	51	51		
	Sound Level (PWL)	Cooling	dB(A)	59	60	63		
	Operating Current (Max.)			A	9.2	10	13.6	
	Breaker Size			A	10	12	16	
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7		
	Max.Length	Out-In	m	20	20	30		
	Max.Height	Out-In	m	12	12	15		
Guaranteed Operating Range (Outdoor)			Cooling	°C	-10 ~ +46	-10 ~ +46	-10 ~ +46	
			Heating	°C	-25 ~ +24	-25 ~ +24	-25 ~ +24	

- (*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.
- (*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.
- (*3) SHi: Super High.


C.2.2 OUTLINES AND DIMENSIONS

C.2.2.1 Indoor Unit

MFZ-KJ25VE2 MFZ-KJ35VE2 MFZ-KJ50VE2

Unit: mm

INDOOR UNIT

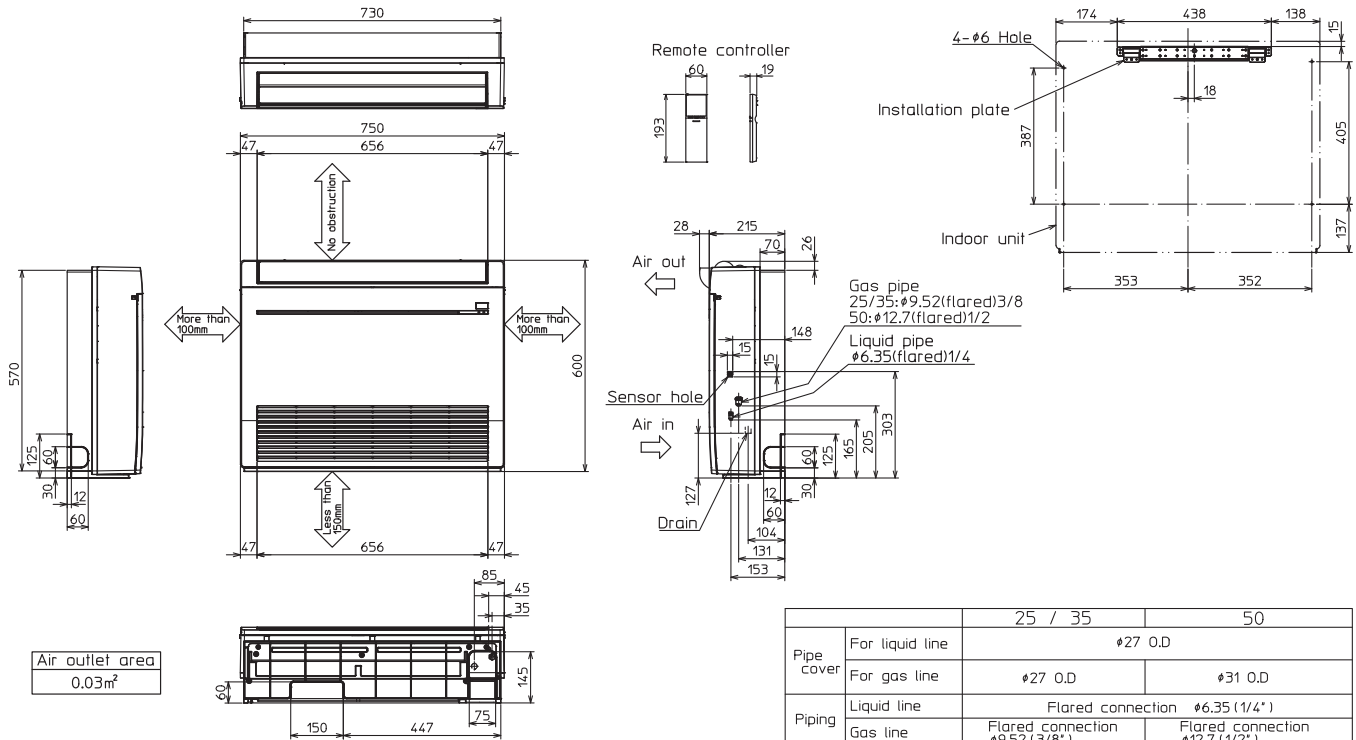


OUTLINES AND DIMENSIONS FLOOR-STANDING

Unit: mm

C.2.2.2 Outdoor Unit



MUFZ-KJ25VE MUFZ-KJ35VE
MUFZ-KJ25VEHZ MUFZ-KJ35VEHZ

OUTDOOR UNIT

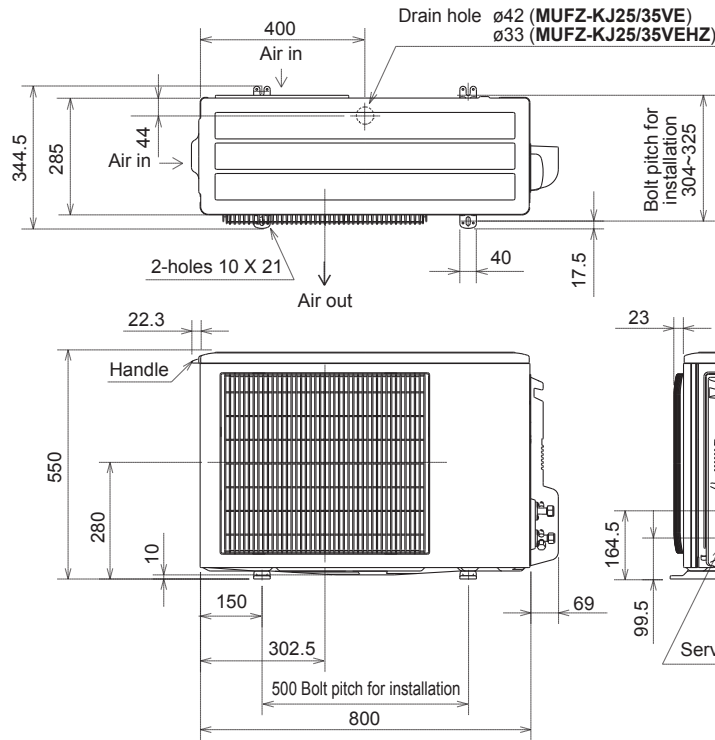


REQUIRED SPACE

*1 100 mm or more when front and sides of the unit are clear

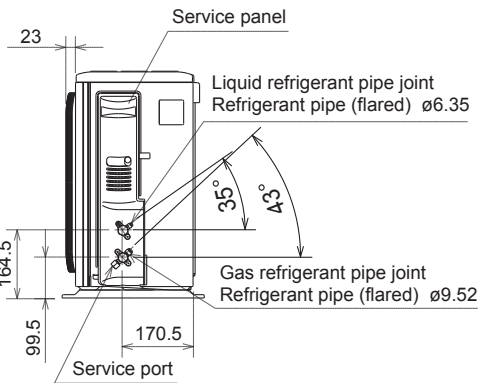
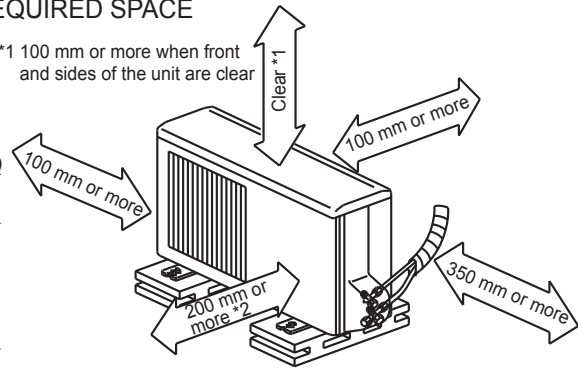


MUFZ-KJ50VE
MUFZ-KJ50VEHZ
OUTDOOR UNIT

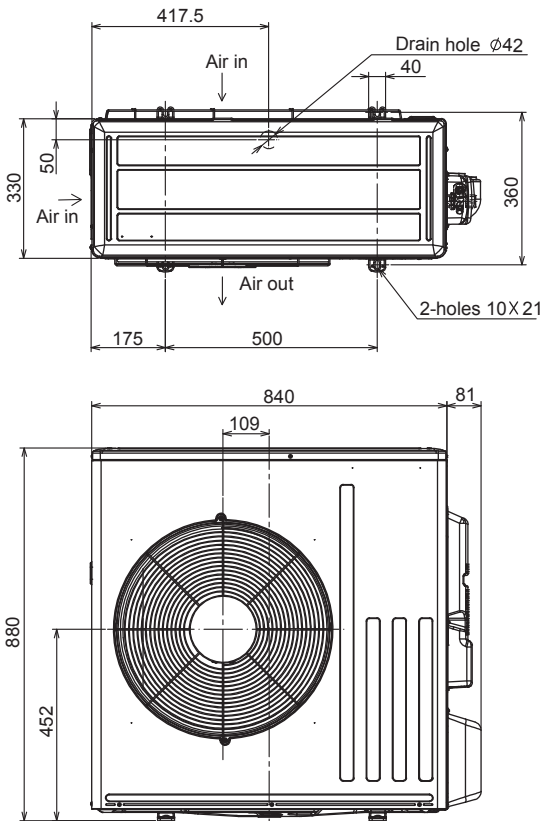

REQUIRED SPACE

*1 500 mm or more when front and sides of the unit are clear

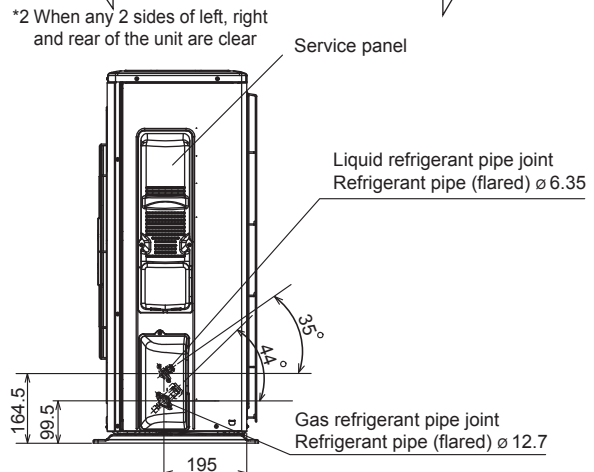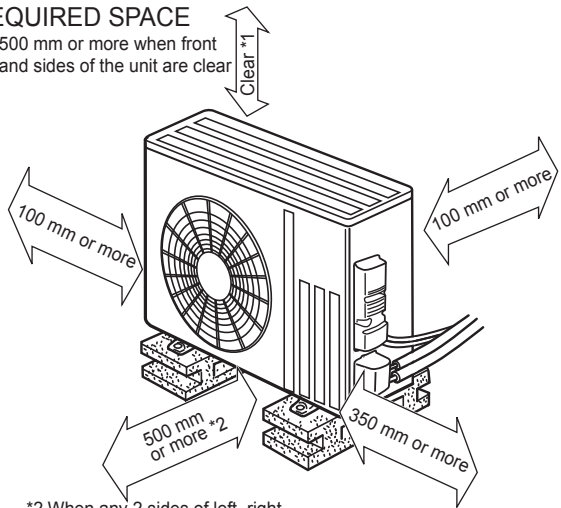


FLOOR-STANDING OUTLINE S AND DIMENSIONS

C.2.3 WIRING DIAGRAM

C.2.3.1 Indoor Unit


MFZ-KJ25VE2 MFZ-KJ35VE2 MFZ-KJ50VE2

INDOOR UNIT

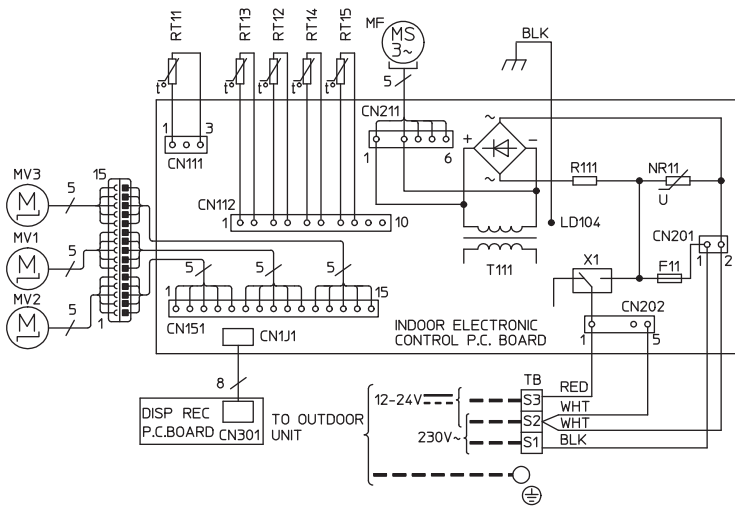


SYMBOL	NAME	SYMBOL	NAME
MF	FAN MOTOR	RT11	ROOM TEMP. THERMISTOR
MV1	HORIZONTAL VANE MOTOR (FRONT)	RT12	COIL TEMP. THERMISTOR(MAIN1)
MV2	HORIZONTAL VANE MOTOR (BACK)	RT13	COIL TEMP. THERMISTOR(SUB)
MV3	MULTI-FLOW VANE MOTOR	RT14	COIL TEMP. THERMISTOR(MAIN2)
F11	FUSE (T3.15AL250V)	RT15	COIL TEMP. THERMISTOR(MAIN3)
T11	TRANSFORMER	NR11	VARISTOR
X1	RELAY	R111	RESISTOR
TB	TERMINAL BLOCK		

NOTES:
 1.About the outdoor side electric wiring refer to the outdoor unit electric wiring diagram for servicing.
 2.Use copper conductors only. (For field wiring)
 3.Symbols below indicate.



C.2.3.2 Outdoor Unit
MUFZ-KJ25VE MUFZ-KJ35VE

OUTDOOR UNIT

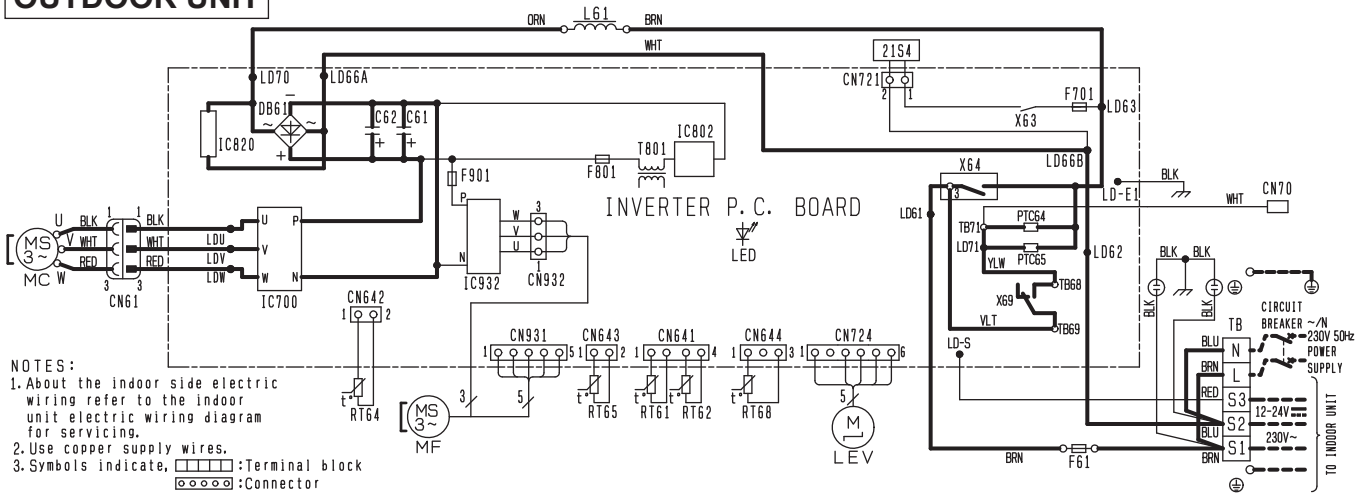


NOTES:
1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
2. Use copper supply wires.
3. Symbols indicate, : Terminal block : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR
C61, C62	SMOOTHING CAPACITOR	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR
DB61	DIODE MODULE	LG1	REACTOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
F61	FUSE (T20AL250V)	MC	COMPRESSOR	TB	TERMINAL BLOCK
F701, F801, F901	FUSE (T3. 15AL250V)	MF	FAN MOTOR	T801	TRANSFORMER
IC700, IC820	POWER MODULE	PTC64, PTC65	CIRCUIT PROTECTION	X63, X64, X69	RELAY
IC932		RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC802	POWER DEVICE	RT62	DISCHARGE TEMP. THERMISTOR		

MUFZ-KJ50VE

OUTDOOR UNIT

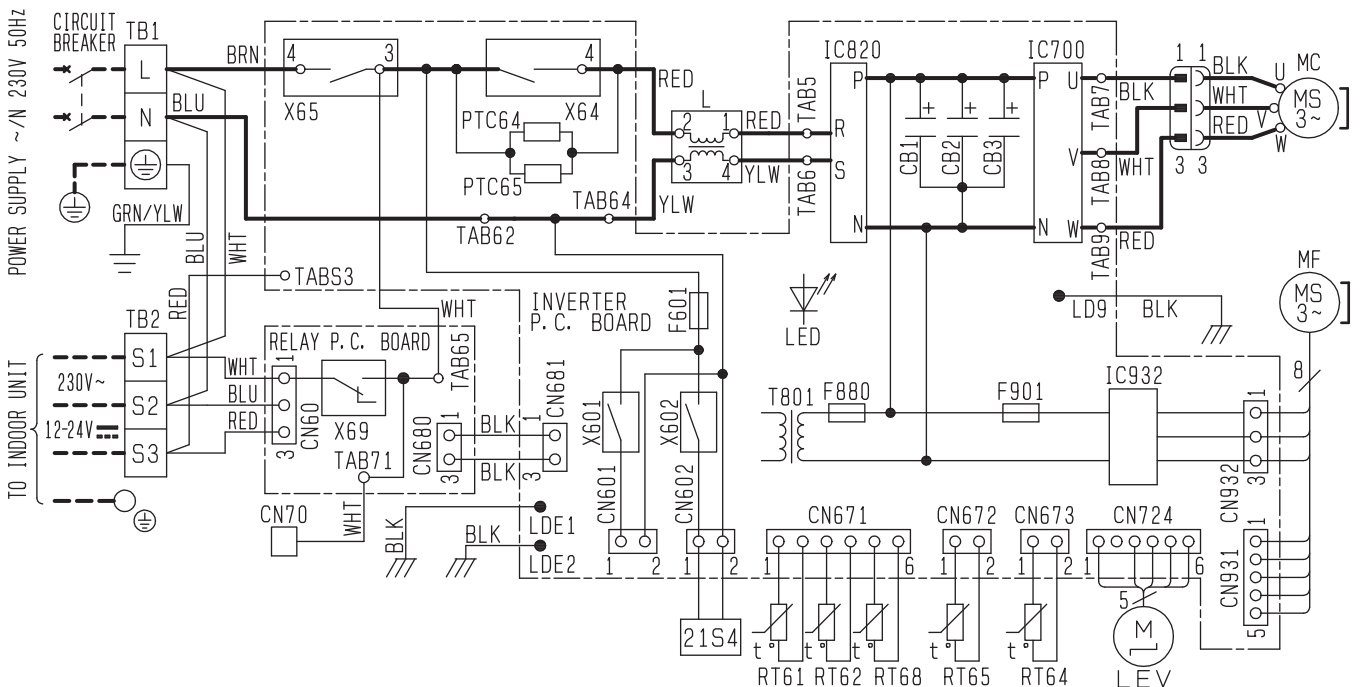


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1~3	SMOOTHING CAPACITOR	L	REACTOR	RT62	DISCHARGE TEMP. THERMISTOR	X602	RELAY
CN70	CONNECTOR	LED	LED	RT64	FIN TEMP. THERMISTOR	X64	RELAY
F601	FUSE (T3. 15AL250V)	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR	X65	RELAY
F880	FUSE (T3. 15AL250V)	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR	X69	RELAY
F901	FUSE (T3. 15AL250V)	MF	FAN MOTOR	21S4	REVERSING VALVE COIL		
IC700	IGBT Module	PTC64	CIRCUIT PROTECTION	TB1, TB2	TERMINAL BLOCK		
IC820	DIODE Module	PTC65	CIRCUIT PROTECTION	T801	TRANSFORMER		
IC932	IGBT Module	RT61	DEFROST THERMISTOR	X601	RELAY		

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
2. Use copper supply wires. 3. Symbols indicate, : Terminal block : Connector

FLOOR-STANDING WIRING DIAGRAM

MUFZ-KJ25VEHZ MUFZ-KJ35VEHZ


OUTDOOR UNIT

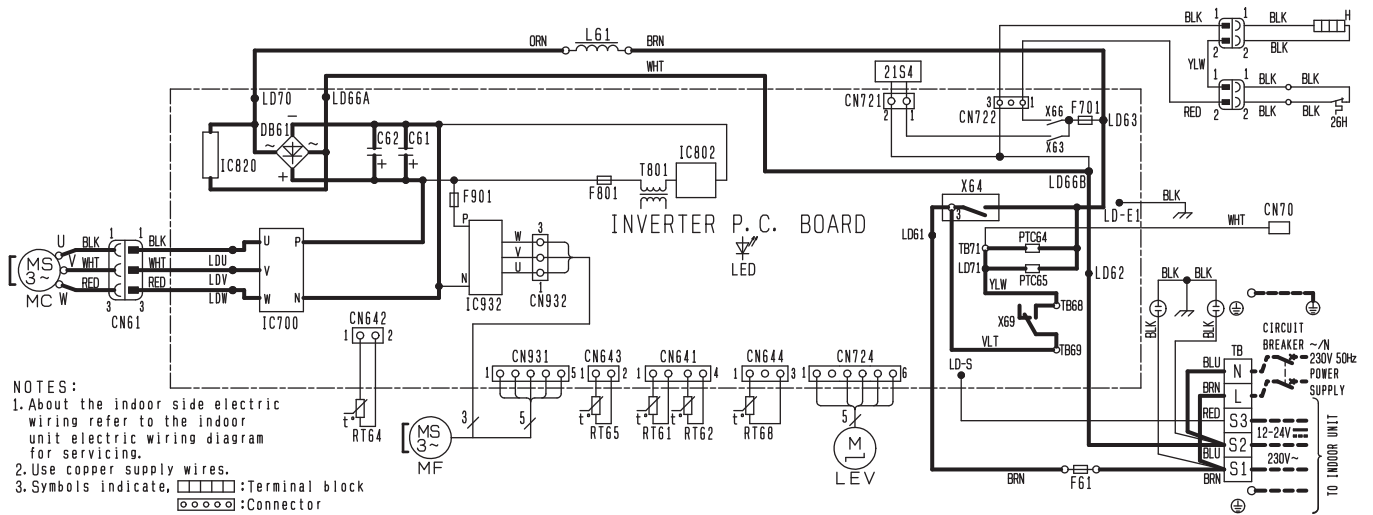

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CN70	CONNECTOR	LED	LED	RT65	AMBIENT TEMP. THERMISTOR
C61, C62	SMOOTHING CAPACITOR	LEV	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR.
DB61	DIODE MODULE	L61	REACTOR	TB	TERMINAL BLOCK
F61	FUSE (T20AL250V)	MC	COMPRESSOR	T801	TRANSFORMER
F701, F801, F901	FUSE (T3.15AL250V)	MF	FAN MOTOR	X63, X64	RELAY
H	DEFROST HEATER	PTC64, PTC65	CIRCUIT PROTECTION	X66, X69	
IC700, IC820	POWER MODULE	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC932		RT62	DISCHARGE TEMP. THERMISTOR	26H	HEATER PROTECTOR
IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR		

MUFZ-KJ50VEHZ

OUTDOOR UNIT

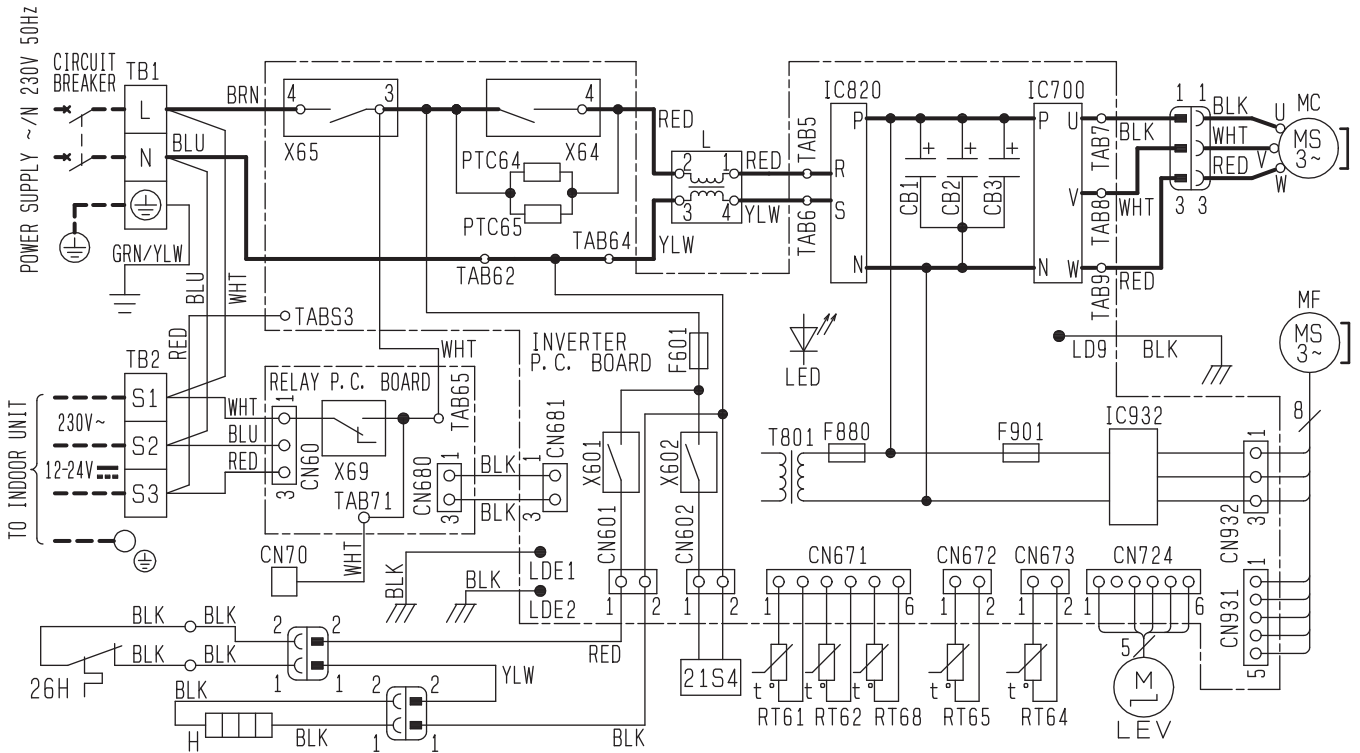

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1~3	SMOOTHING CAPACITOR	IC932	IGBT Module	RT61	DEFROST THERMISTOR	X601	RELAY
CN70	CONNECTOR	L	REACTOR	RT62	DISCHARGE TEMP. THERMISTOR	X602	RELAY
F601	FUSE (T3. 15A/250V)	LED	LED	RT64	FIN TEMP. THERMISTOR	X64	RELAY
F880	FUSE (T3. 15A/250V)	LEV	EXPANSION VALVE COIL	RT65	AMBIENT TEMP. THERMISTOR	X65	RELAY
F901	FUSE (T3. 15A/250V)	MC	COMPRESSOR	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR	X69	RELAY
H	DEFROST HEATER	MF	FAN MOTOR	TB1, TB2	TERMINAL BLOCK	21S4	REVERSING VALVE COIL
IC700	IGBT Module	PTC64	CIRCUIT PROTECTION	T801	TRANSFORMER	26H	HEATER PROTECTOR
IC820	DIODE Module	PTC65	CIRCUIT PROTECTION				

NOTES 1. About the indoor side electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper supply wires. 3. Symbols indicate, :Terminal block :Connector

FLOOR-STANDING WIRING DIAGRAM


C.2.4 REFRIGERANT SYSTEM DIAGRAM

C.2.4.1 Inverter Heat Pump

MFZ-KJ25VE2
MFZ-KJ35VE2


Unit: mm

MUFZ-KJ25VE
MUFZ-KJ25VEHZ
MUFZ-KJ35VE
MUFZ-KJ35VEHZ

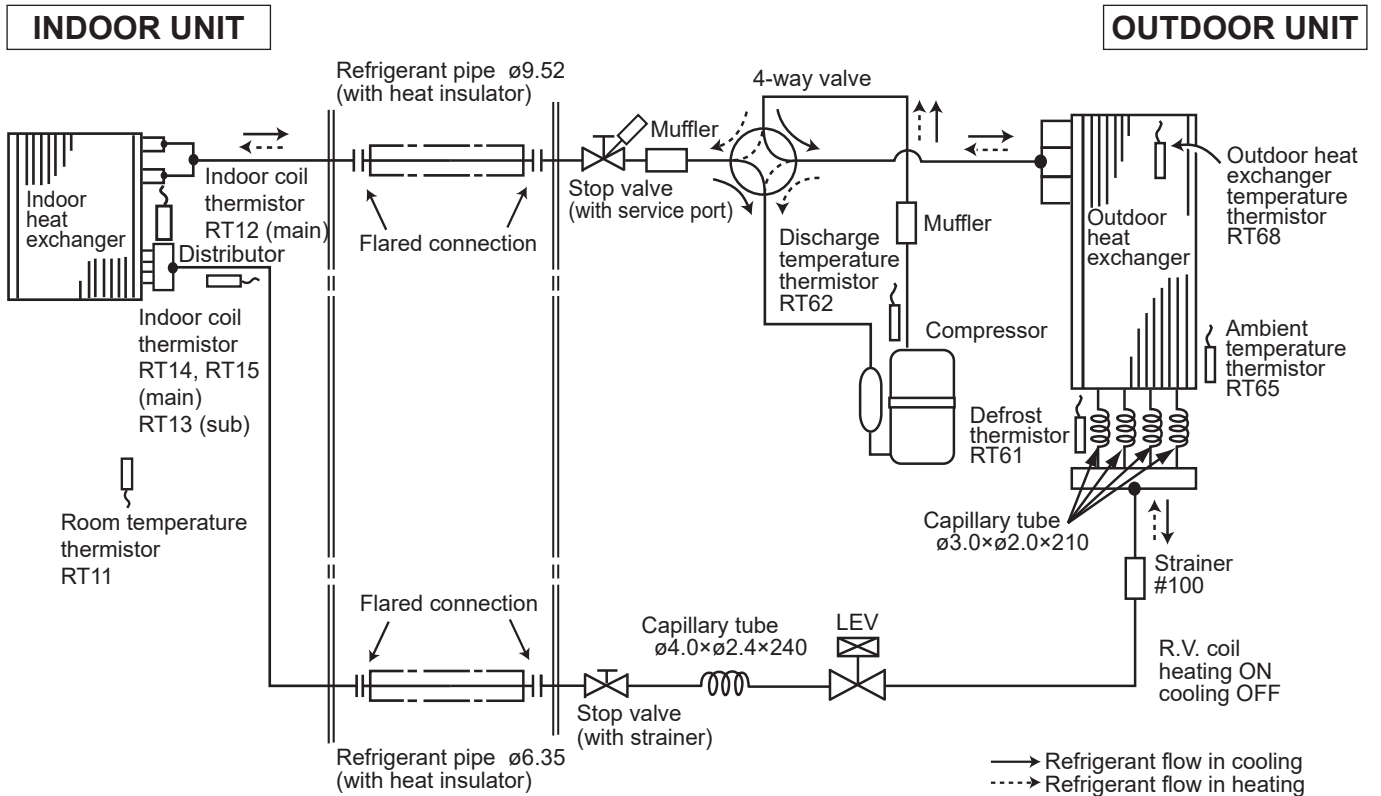

MFZ-KJ50VE2

MUFZ-KJ50VE
MUFZ-KJ50VEHZ

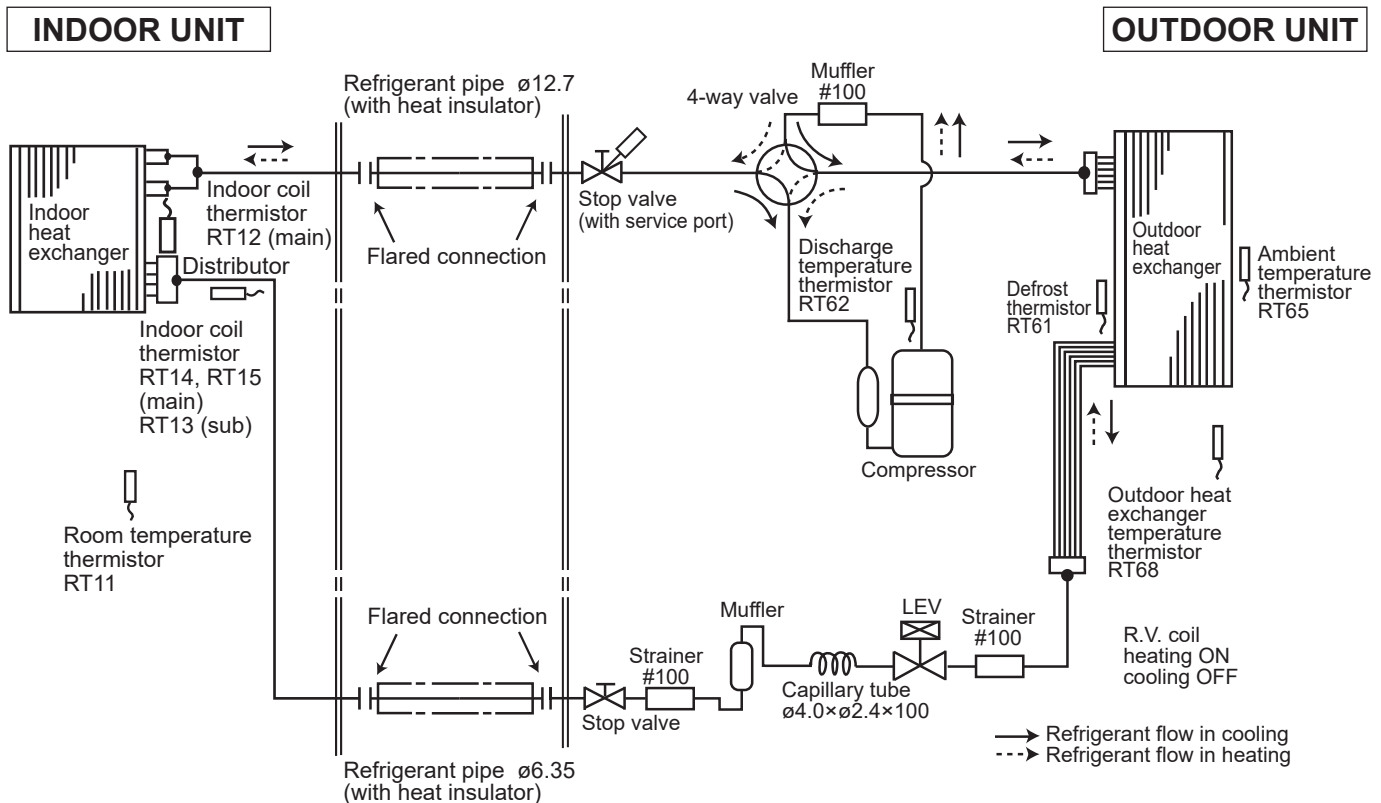

REFRIGERANT SYSTEM DIAGRAM FLOOR-STANDING

C.2.5 PERFORMANCE CURVES

C.2.5.1 Inverter Heat Pump

MUFZ-KJ25VE MUFZ-KJ35VE MUFZ-KJ50VE
MUFZ-KJ25VEHZ MUFZ-KJ35VEHZ MUFZ-KJ50VEHZ

The standard specifications apply only to the operation of the air conditioner under normal conditions, since operating conditions vary according to the areas where these units are installed. The following information has been provided to clarify the operating characteristics of the air conditioner under the conditions indicated by the performance curve.

(1) GUARANTEED VOLTAGE

198~264 V, (50 Hz)

(2) AIR FLOW

Air flow should be set at MAX.


(3) MAIN READINGS

- | | | |
|---|------|-----------|
| (1) Indoor intake air wet-bulb temperature : | °CWB | } Cooling |
| (2) Indoor outlet air wet-bulb temperature : | °CWB | |
| (3) Outdoor intake air dry-bulb temperature : | °CDB | |
| (4) Total input: | W | } Heating |
| (5) Indoor intake air dry-bulb temperature : | °CDB | |
| (6) Outdoor intake air wet-bulb temperature : | °CWB | |
| (7) Total input : | W | |


Indoor air wet and dry bulb temperature difference on the left side of the following chart shows the difference between the indoor intake air wet and dry bulb temperature and the indoor outlet air wet and dry bulb temperature for your reference at service.

How to measure the indoor air wet/dry bulb temperature difference




- Attach at least 2 sets of wet and dry bulb thermometers to the indoor air intake as shown in the figure, and at least 2 sets of wet and dry bulb thermometers to the indoor air outlet. The thermometers must be attached to the position where air speed is high.
- Attach at least 2 sets of wet and dry bulb thermometers to the outdoor air intake.
Cover the thermometers to prevent direct rays of the sun.
- Check that the air filter is cleaned.
- Open windows and doors of room.
- Press the EMERGENCY OPERATION switch once (twice) to start the EMERGENCY COOL (HEAT) MODE.
- When system stabilizes after more than 15 minutes, measure temperature and take an average temperature.
- 10 minutes later, measure temperature again and check that the temperature does not change.

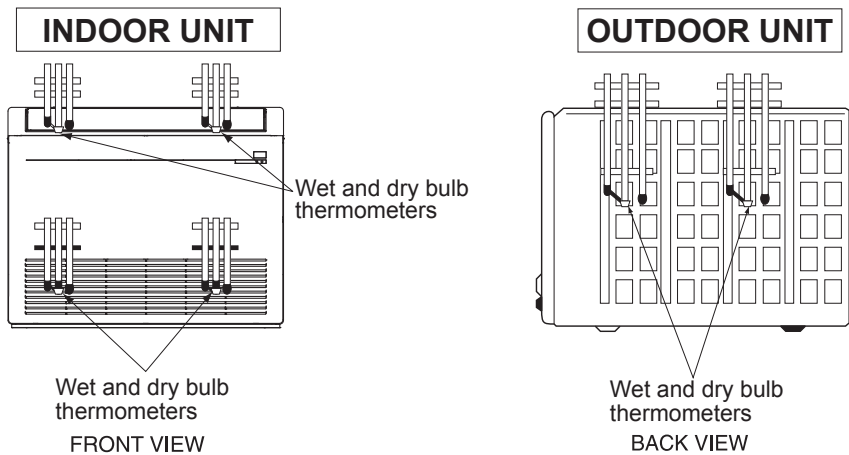

CAPACITY AND INPUT CURVES

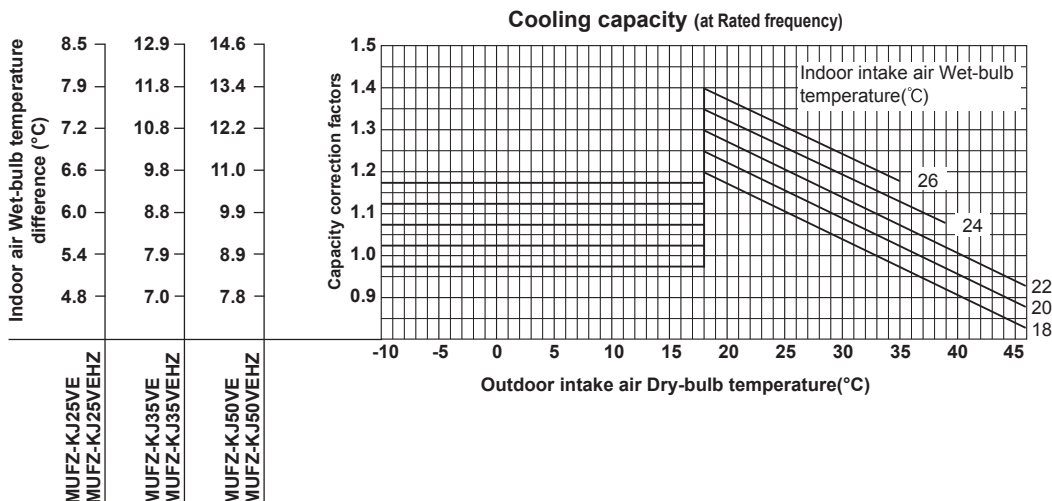



FLOOR-STANDING PERFORMANCE CURVES

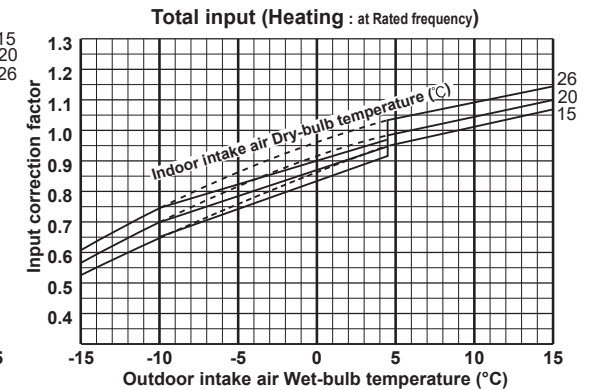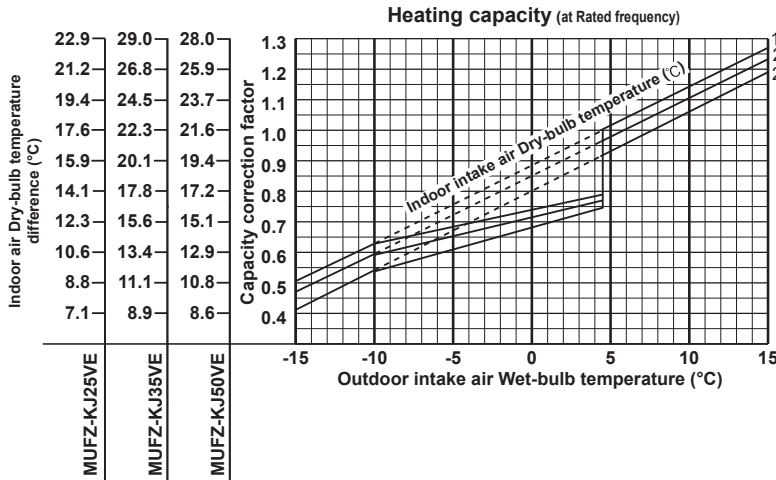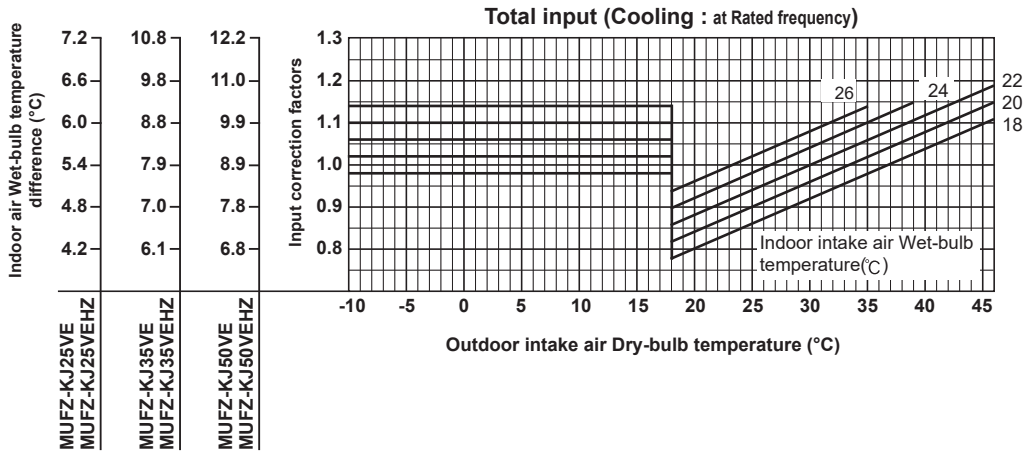

NOTE: The above broken lines are for the heating operation without any frost and defrost operation.

MUFZ-KJ25VEHZ


MUFZ-KJ35VEHZ

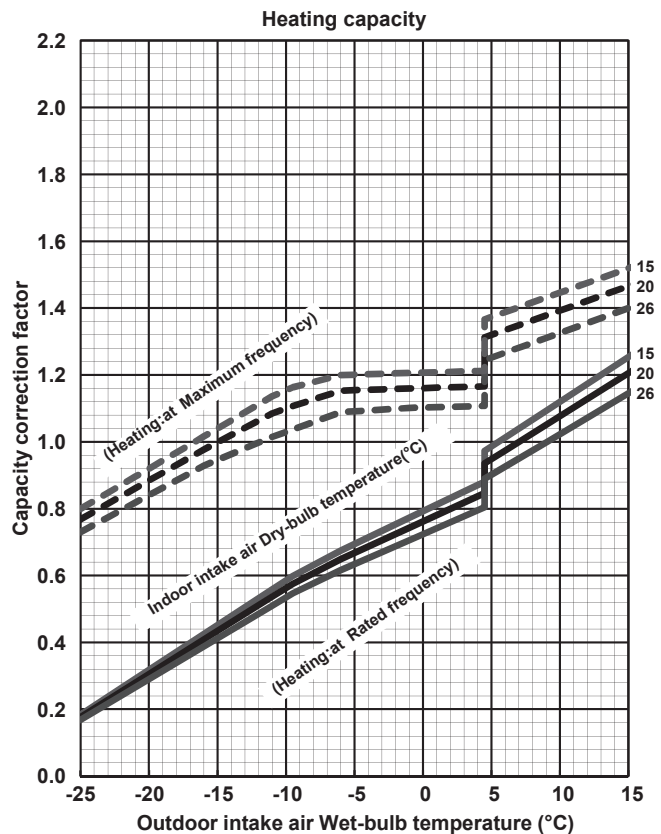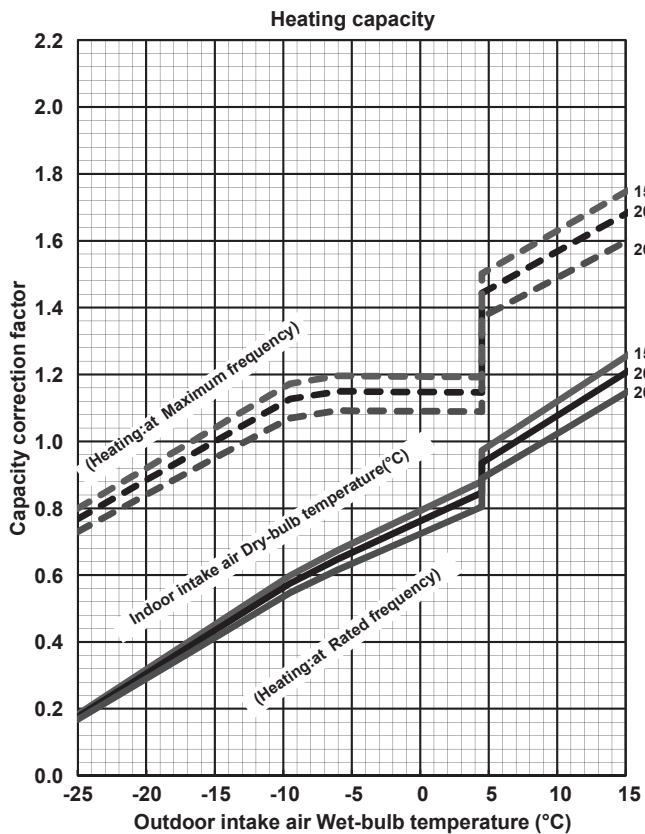


NOTE: The above broken lines are for the heating operation without any frost and defrost operation.

PERFORMANCE CURVES FLOOR-STANDING


MUFZ-KJ50VEHZ

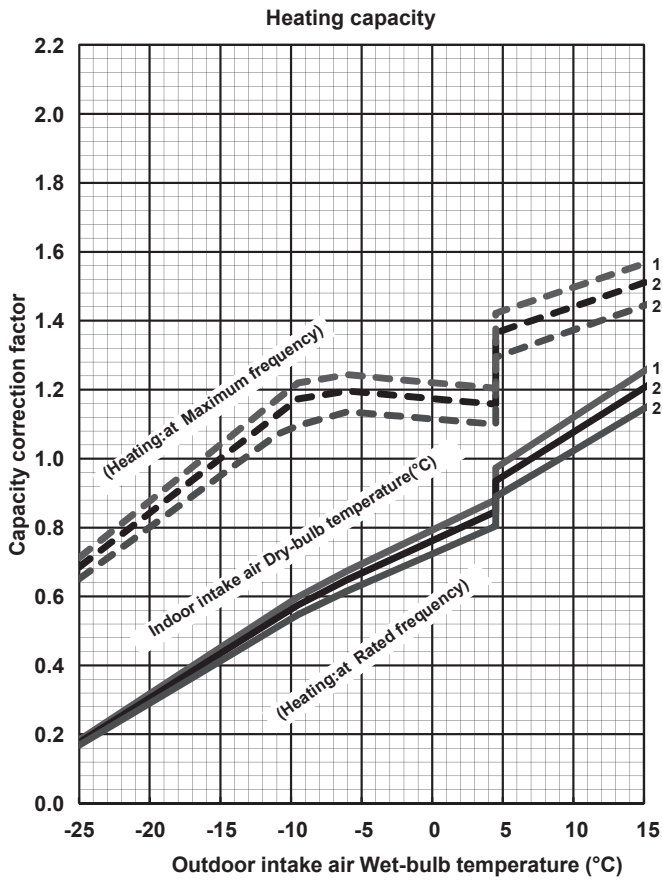


MUFZ-KJ25VEHZ

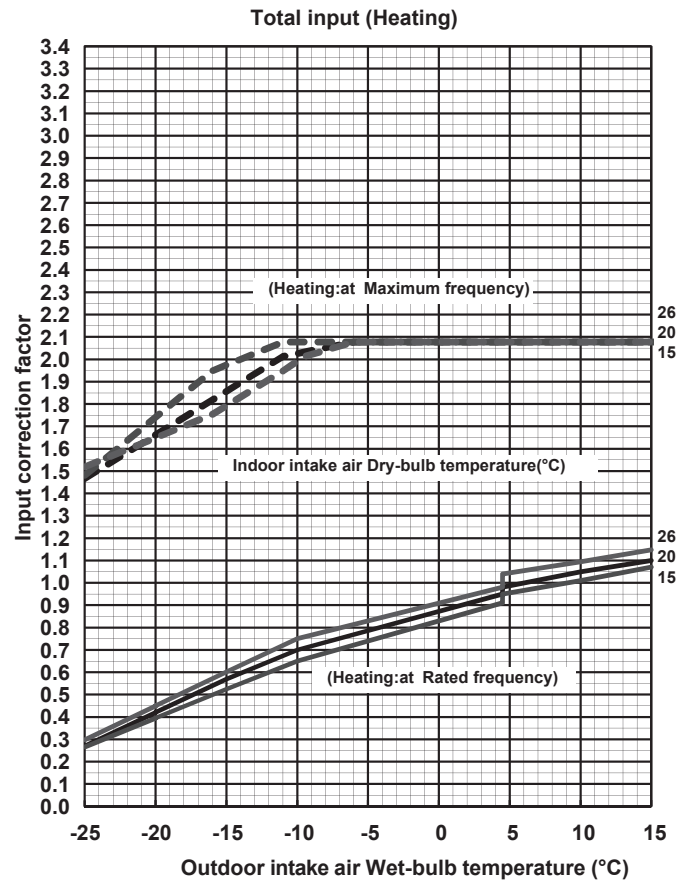

MUFZ-KJ35VEHZ

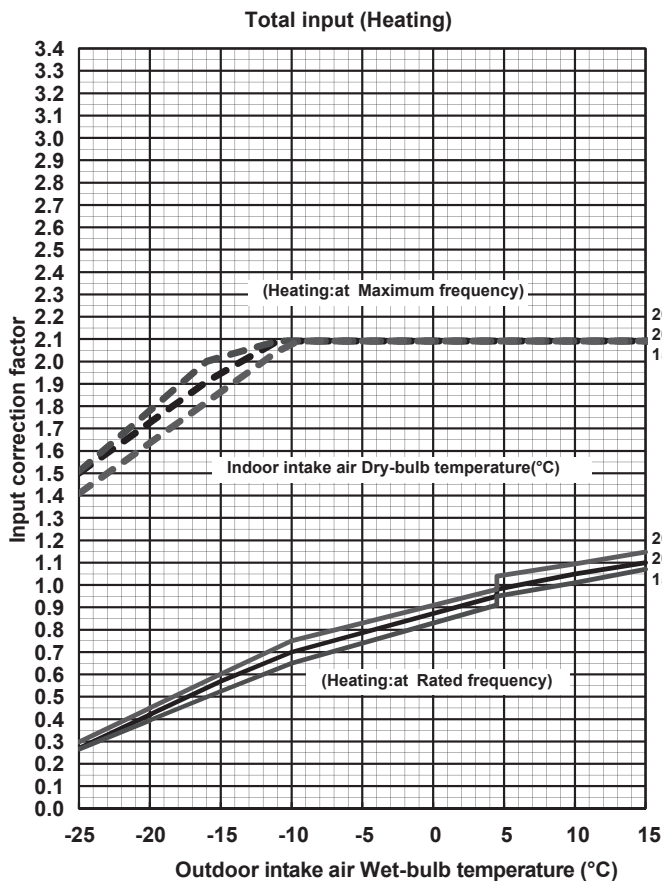


MUFZ-KJ50VEHZ

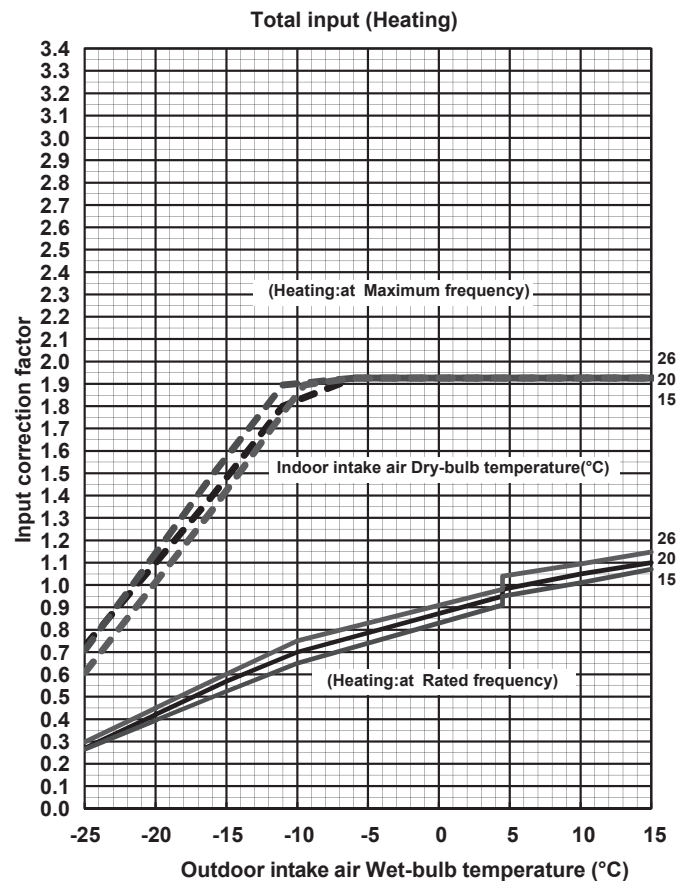


NOTE: The above broken lines are for the heating operation without any frost and defrost operation.

CAPACITY AND INPUT CORRECTION BY OPERATIONAL FREQUENCY OF COMPRESSOR


MUFZ-KJ25VE

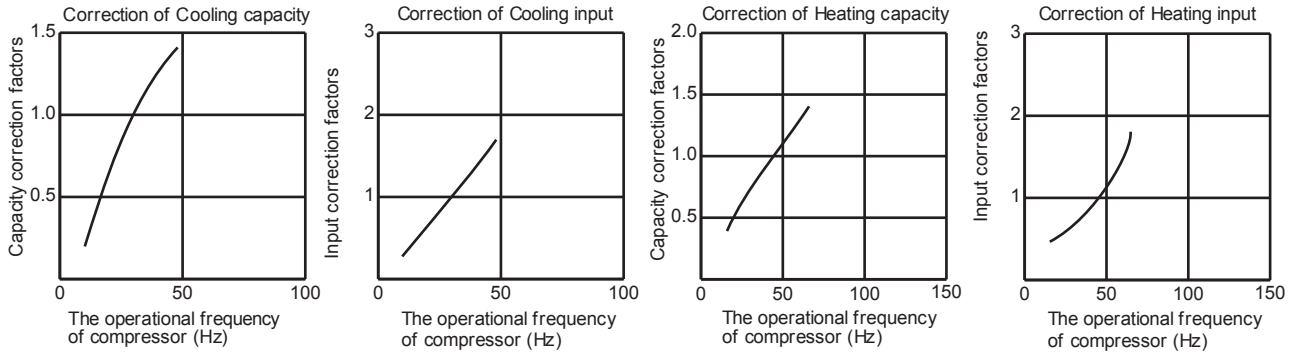

MUFZ-KJ35VE

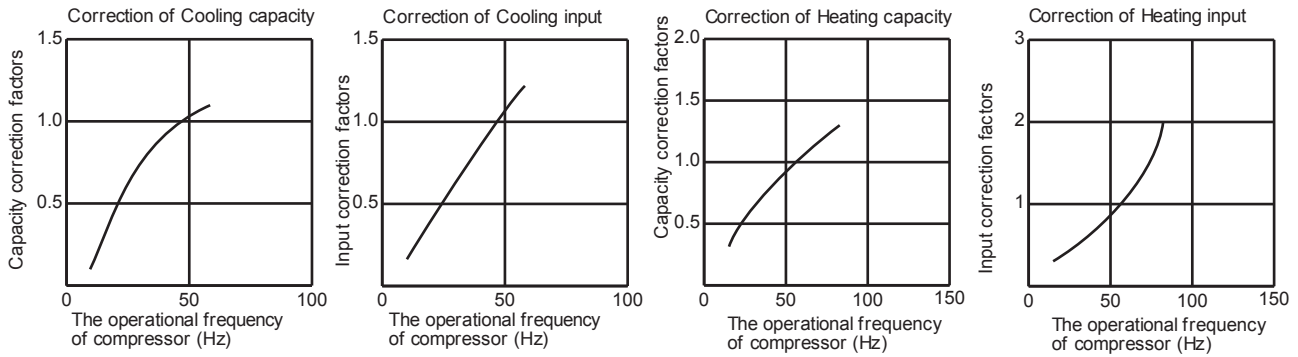


MUFZ-KJ50VE

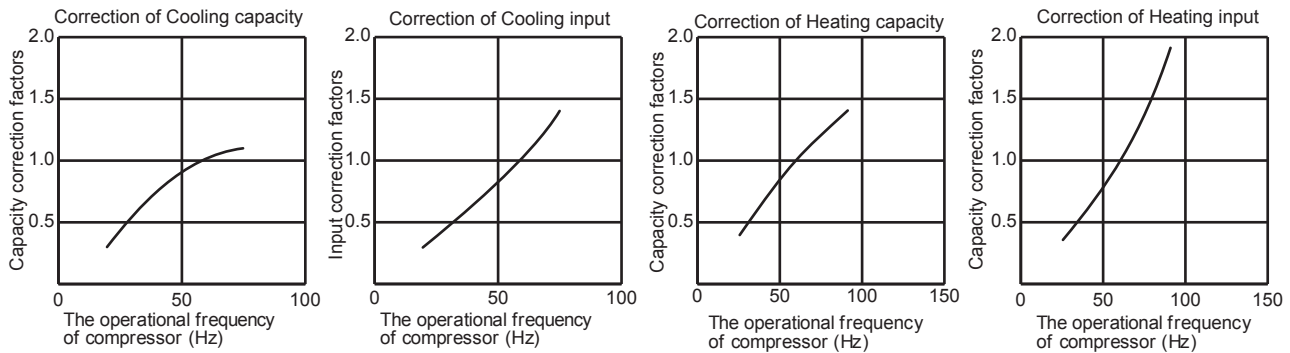


PERFORMANCE CURVES FLOOR-STANDING


MUFZ-KJ25VEHZ

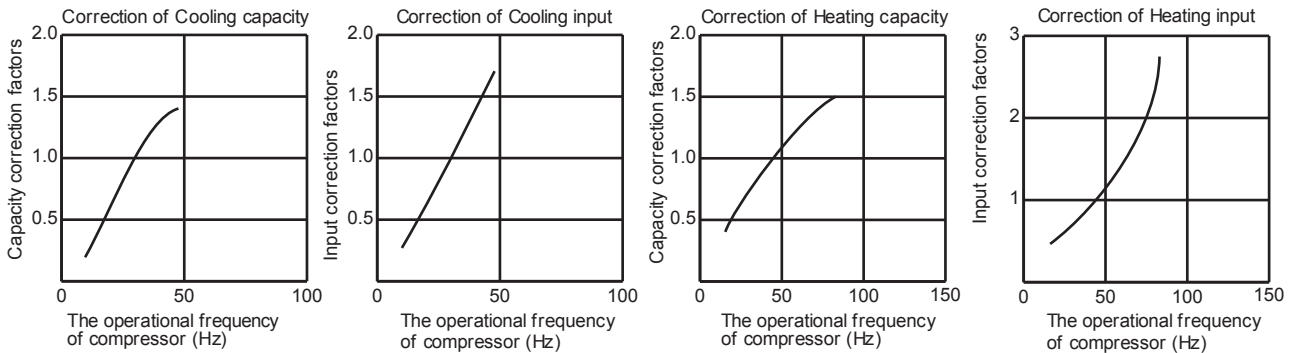

MUFZ-KJ35VEHZ

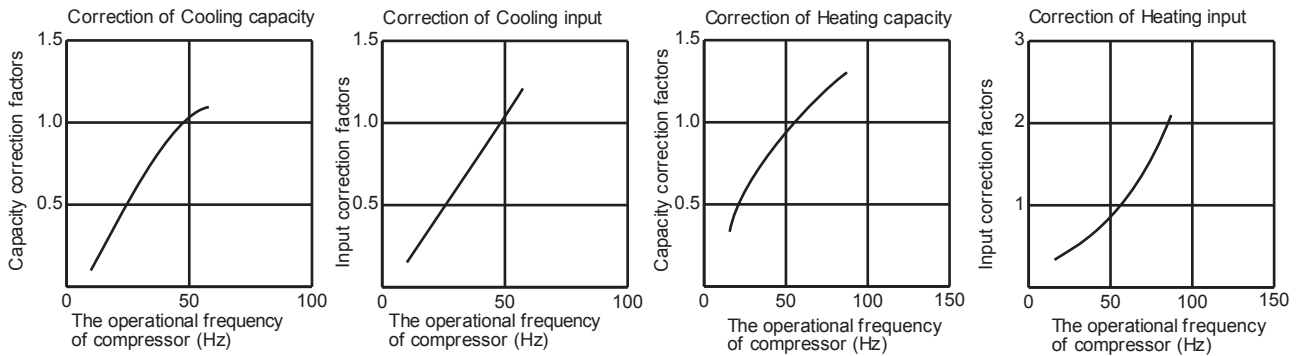

MUFZ-KJ50VEHZ

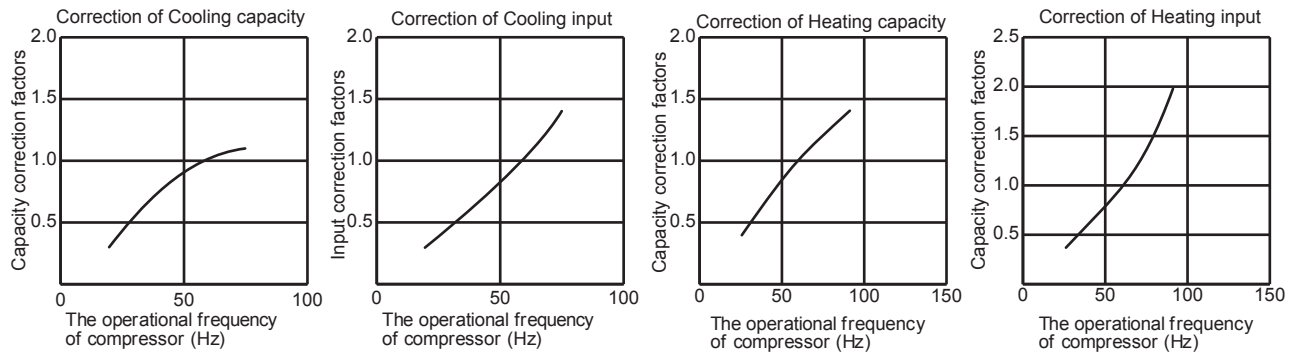

HOW TO OPERATE FIXED-FREQUENCY OPERATION

<Test run operation>

1. Press EMERGENCY OPERATION switch to start COOL or HEAT mode (COOL: Press once, HEAT: Press twice).
2. Test run operation starts and continues to operate for 30 minutes.
3. Compressor operates at rated frequency in COOL mode or 58 Hz in HEAT mode.
4. Indoor fan operates at High speed.
5. After 30 minutes, test run operation finishes and EMERGENCY OPERATION starts (operation frequency of compressor varies).
6. To cancel test run operation (EMERGENCY OPERATION), press EMERGENCY OPERATION switch or any button on remote controller.

OUTDOOR LOW PRESSURE AND OUTDOOR UNIT CURRENT


COOL operation

- ① Both indoor and outdoor unit are under the same temperature/humidity condition.
- ② Operation: TEST RUN OPERATION (Refer to 8-3.)


Dry-bulb temperature (°C)	Relative humidity (%)
20	50
25	60
30	70

Outdoor low pressure


MUFZ-KJ25VE
MUFZ-KJ25VEHZ

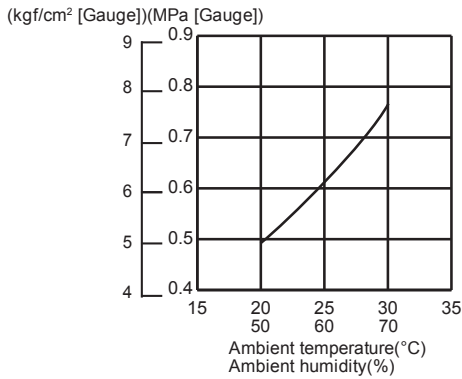

MUFZ-KJ35VE
MUFZ-KJ35VEHZ

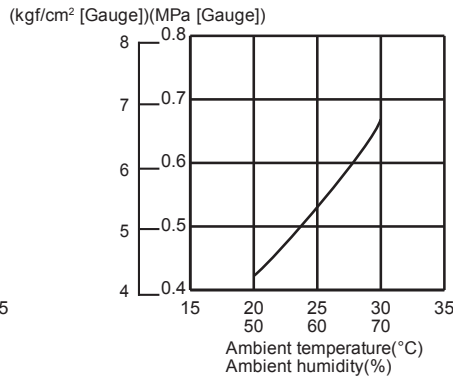

MUFZ-KJ50VE
MUFZ-KJ50VEHZ

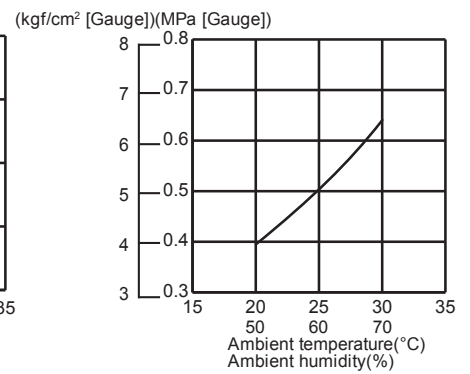


NOTE:


The unit of pressure has been changed to MPa on the international system of units (SI unit system)
The conversion factor is: **1 (MPa [Gauge]) = 10.2 (kgf/cm² [Gauge])**

Outdoor unit current


MUFZ-KJ25VE
MUFZ-KJ25VEHZ

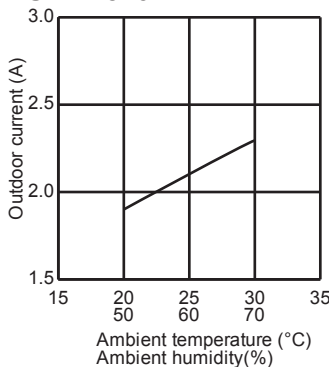

MUFZ-KJ35VE
MUFZ-KJ35VEHZ

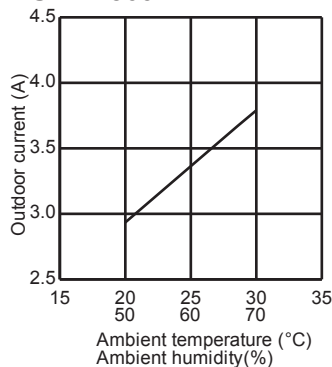

MUFZ-KJ50VE
MUFZ-KJ50VEHZ

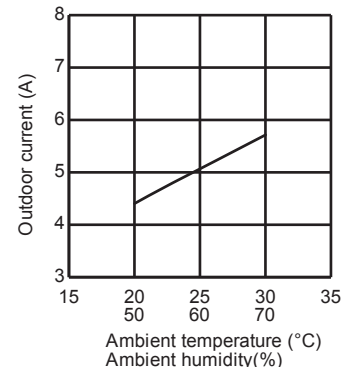

HEAT operation


- ① Condition:

	Indoor	Outdoor			
Dry bulb temperature (°C)	20.0	2	7	15	20.0
Wet bulb temperature (°C)	14.5	1	6	12	14.5


- ② Operation: Test run operation (Refer to 8-3.)

Outdoor unit current


MUFZ-KJ25VE
MUFZ-KJ25VEHZ

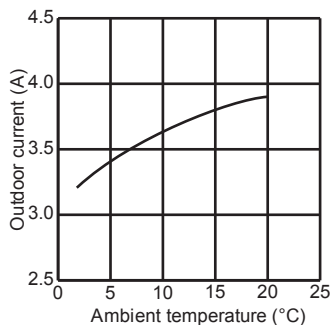

MUFZ-KJ35VE
MUFZ-KJ35VEHZ

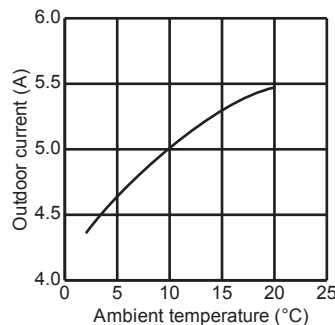

MUFZ-KJ50VE
MUFZ-KJ50VEHZ

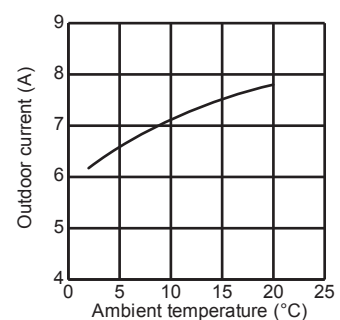

C.2.6 PERFORMANCE DATA**C.2.6.1 Inverter Heat Pump**

PERFORMANCE DATA COOL operation at Rated frequency

MFZ-KJ25VE2: MUFZ-KJ25VE MUFZ-KJ25VEHZ

CAPACITY: 2.5 kW

SHF: 0.85

INPUT: 540 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.94	1.97	0.67	432	2.81	1.88	0.67	454	2.70	1.81	0.67	475	2.60	1.74	0.67	497
21	20	3.06	1.68	0.55	454	2.94	1.62	0.55	481	2.85	1.57	0.55	491	2.75	1.51	0.55	513
22	18	2.94	2.09	0.71	432	2.81	2.00	0.71	454	2.70	1.92	0.71	475	2.60	1.85	0.71	497
22	20	3.06	1.81	0.59	454	2.94	1.73	0.59	481	2.85	1.68	0.59	491	2.75	1.62	0.59	513
22	22	3.19	1.50	0.47	470	3.08	1.45	0.47	500	3.00	1.41	0.47	513	2.88	1.35	0.47	535
23	18	2.94	2.20	0.75	432	2.81	2.11	0.75	454	2.70	2.03	0.75	475	2.60	1.95	0.75	497
23	20	3.06	1.93	0.63	454	2.94	1.85	0.63	481	2.85	1.80	0.63	491	2.75	1.73	0.63	513
23	22	3.19	1.63	0.51	470	3.08	1.57	0.51	500	3.00	1.53	0.51	513	2.88	1.47	0.51	535
24	18	2.94	2.32	0.79	432	2.81	2.22	0.79	454	2.70	2.13	0.79	475	2.60	2.05	0.79	497
24	20	3.06	2.05	0.67	454	2.94	1.97	0.67	481	2.85	1.91	0.67	491	2.75	1.84	0.67	513
24	22	3.19	1.75	0.55	470	3.08	1.69	0.55	500	3.00	1.65	0.55	513	2.88	1.58	0.55	535
24	24	3.35	1.44	0.43	491	3.23	1.39	0.43	518	3.15	1.35	0.43	535	3.05	1.31	0.43	562
25	18	2.94	2.44	0.83	432	2.81	2.33	0.83	454	2.70	2.24	0.83	475	2.60	2.16	0.83	497
25	20	3.06	2.17	0.71	454	2.94	2.09	0.71	481	2.85	2.02	0.71	491	2.75	1.95	0.71	513
25	22	3.19	1.88	0.59	470	3.08	1.81	0.59	500	3.00	1.77	0.59	513	2.88	1.70	0.59	535
25	24	3.35	1.57	0.47	491	3.23	1.52	0.47	518	3.15	1.48	0.47	535	3.05	1.43	0.47	562
26	18	2.94	2.56	0.87	432	2.81	2.45	0.87	454	2.70	2.35	0.87	475	2.60	2.26	0.87	497
26	20	3.06	2.30	0.75	454	2.94	2.20	0.75	481	2.85	2.14	0.75	491	2.75	2.06	0.75	513
26	22	3.19	2.01	0.63	470	3.08	1.94	0.63	500	3.00	1.89	0.63	513	2.88	1.81	0.63	535
26	24	3.35	1.71	0.51	491	3.23	1.64	0.51	518	3.15	1.61	0.51	535	3.05	1.56	0.51	562
26	26	3.45	1.35	0.39	518	3.35	1.31	0.39	545	3.30	1.29	0.39	562	3.20	1.25	0.39	578
27	18	2.94	2.67	0.91	432	2.81	2.56	0.91	454	2.70	2.46	0.91	475	2.60	2.37	0.91	497
27	20	3.06	2.42	0.79	454	2.94	2.32	0.79	481	2.85	2.25	0.79	491	2.75	2.17	0.79	513
27	22	3.19	2.14	0.67	470	3.08	2.06	0.67	500	3.00	2.01	0.67	513	2.88	1.93	0.67	535
27	24	3.35	1.84	0.55	491	3.23	1.77	0.55	518	3.15	1.73	0.55	535	3.05	1.68	0.55	562
27	26	3.45	1.48	0.43	518	3.35	1.44	0.43	545	3.30	1.42	0.43	562	3.20	1.38	0.43	578
28	18	2.94	2.79	0.95	432	2.81	2.67	0.95	454	2.70	2.57	0.95	475	2.60	2.47	0.95	497
28	20	3.06	2.54	0.83	454	2.94	2.44	0.83	481	2.85	2.37	0.83	491	2.75	2.28	0.83	513
28	22	3.19	2.26	0.71	470	3.08	2.18	0.71	500	3.00	2.13	0.71	513	2.88	2.04	0.71	535
28	24	3.35	1.98	0.59	491	3.23	1.90	0.59	518	3.15	1.86	0.59	535	3.05	1.80	0.59	562
28	26	3.45	1.62	0.47	518	3.35	1.57	0.47	545	3.30	1.55	0.47	562	3.20	1.50	0.47	578
29	18	2.94	2.91	0.99	432	2.81	2.78	0.99	454	2.70	2.67	0.99	475	2.60	2.57	0.99	497
29	20	3.06	2.66	0.87	454	2.94	2.56	0.87	481	2.85	2.48	0.87	491	2.75	2.39	0.87	513
29	22	3.19	2.39	0.75	470	3.08	2.31	0.75	500	3.00	2.25	0.75	513	2.88	2.16	0.75	535
29	24	3.35	2.11	0.63	491	3.23	2.03	0.63	518	3.15	1.98	0.63	535	3.05	1.92	0.63	562
29	26	3.45	1.76	0.51	518	3.35	1.71	0.51	545	3.30	1.68	0.51	562	3.20	1.63	0.51	578
30	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
30	20	3.06	2.79	0.91	454	2.94	2.67	0.91	481	2.85	2.59	0.91	491	2.75	2.50	0.91	513
30	22	3.19	2.52	0.79	470	3.08	2.43	0.79	500	3.00	2.37	0.79	513	2.88	2.27	0.79	535
30	24	3.35	2.24	0.67	491	3.23	2.16	0.67	518	3.15	2.11	0.67	535	3.05	2.04	0.67	562
30	26	3.45	1.90	0.55	518	3.35	1.84	0.55	545	3.30	1.82	0.55	562	3.20	1.76	0.55	578
31	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
31	20	3.06	2.91	0.95	454	2.94	2.79	0.95	481	2.85	2.71	0.95	491	2.75	2.61	0.95	513
31	22	3.19	2.65	0.83	470	3.08	2.55	0.83	500	3.00	2.49	0.83	513	2.88	2.39	0.83	535
31	24	3.35	2.38	0.71	491	3.23	2.29	0.71	518	3.15	2.24	0.71	535	3.05	2.17	0.71	562
31	26	3.45	2.04	0.59	518	3.35	1.98	0.59	545	3.30	1.95	0.59	562	3.20	1.89	0.59	578
32	18	2.94	2.94	1.00	432	2.81	2.81	1.00	454	2.70	2.70	1.00	475	2.60	2.60	1.00	497
32	20	3.06	3.03	0.99	454	2.94	2.91	0.99	481	2.85	2.82	0.99	491	2.75	2.72	0.99	513
32	22	3.19	2.77	0.87	470	3.08	2.68	0.87	500	3.00	2.61	0.87	513	2.88	2.50	0.87	535
32	24	3.35	2.51	0.75	491	3.23	2.42	0.75	518	3.15	2.36	0.75	535	3.05	2.29	0.75	562
32	26	3.45	2.17	0.63	518	3.35	2.11	0.63	545	3.30	2.08	0.63	562	3.20	2.02	0.63	578

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MFZ-KJ25VE2: MUFZ-KJ25VE MUFZ-KJ25VEHZ

CAPACITY: 2.5 kW SHF: 0.85 INPUT: 540 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	2.45	1.64	0.67	529	2.25	1.51	0.67	562	2.08	1.39	0.67	583
21	20	2.58	1.42	0.55	551	2.40	1.32	0.55	578	2.23	1.22	0.55	610
22	18	2.45	1.74	0.71	529	2.25	1.60	0.71	562	2.08	1.47	0.71	583
22	20	2.58	1.52	0.59	551	2.40	1.42	0.59	578	2.23	1.31	0.59	610
22	22	2.73	1.28	0.47	572	2.55	1.20	0.47	605	2.38	1.12	0.47	626
23	18	2.45	1.84	0.75	529	2.25	1.69	0.75	562	2.08	1.56	0.75	583
23	20	2.58	1.62	0.63	551	2.40	1.51	0.63	578	2.23	1.40	0.63	610
23	22	2.73	1.39	0.51	572	2.55	1.30	0.51	605	2.38	1.21	0.51	626
24	18	2.45	1.94	0.79	529	2.25	1.78	0.79	562	2.08	1.64	0.79	583
24	20	2.58	1.73	0.67	551	2.40	1.61	0.67	578	2.23	1.49	0.67	610
24	22	2.73	1.50	0.55	572	2.55	1.40	0.55	605	2.38	1.31	0.55	626
24	24	2.88	1.24	0.43	594	2.70	1.16	0.43	621	2.55	1.10	0.43	648
25	18	2.45	2.03	0.83	529	2.25	1.87	0.83	562	2.08	1.72	0.83	583
25	20	2.58	1.83	0.71	551	2.40	1.70	0.71	578	2.23	1.58	0.71	610
25	22	2.73	1.61	0.59	572	2.55	1.50	0.59	605	2.38	1.40	0.59	626
25	24	2.88	1.35	0.47	594	2.70	1.27	0.47	621	2.55	1.20	0.47	648
26	18	2.45	2.13	0.87	529	2.25	1.96	0.87	562	2.08	1.81	0.87	583
26	20	2.58	1.93	0.75	551	2.40	1.80	0.75	578	2.23	1.67	0.75	610
26	22	2.73	1.72	0.63	572	2.55	1.61	0.63	605	2.38	1.50	0.63	626
26	24	2.88	1.47	0.51	594	2.70	1.38	0.51	621	2.55	1.30	0.51	648
26	26	3.03	1.18	0.39	616	2.85	1.11	0.39	643	2.68	1.04	0.39	670
27	18	2.45	2.23	0.91	529	2.25	2.05	0.91	562	2.08	1.89	0.91	583
27	20	2.58	2.03	0.79	551	2.40	1.90	0.79	578	2.23	1.76	0.79	610
27	22	2.73	1.83	0.67	572	2.55	1.71	0.67	605	2.38	1.59	0.67	626
27	24	2.88	1.58	0.55	594	2.70	1.49	0.55	621	2.55	1.40	0.55	648
27	26	3.03	1.30	0.43	616	2.85	1.23	0.43	643	2.68	1.15	0.43	670
28	18	2.45	2.33	0.95	529	2.25	2.14	0.95	562	2.08	1.97	0.95	583
28	20	2.58	2.14	0.83	551	2.40	1.99	0.83	578	2.23	1.85	0.83	610
28	22	2.73	1.93	0.71	572	2.55	1.81	0.71	605	2.38	1.69	0.71	626
28	24	2.88	1.70	0.59	594	2.70	1.59	0.59	621	2.55	1.50	0.59	648
28	26	3.03	1.42	0.47	616	2.85	1.34	0.47	643	2.68	1.26	0.47	670
29	18	2.45	2.43	0.99	529	2.25	2.23	0.99	562	2.08	2.05	0.99	583
29	20	2.58	2.24	0.87	551	2.40	2.09	0.87	578	2.23	1.94	0.87	610
29	22	2.73	2.04	0.75	572	2.55	1.91	0.75	605	2.38	1.78	0.75	626
29	24	2.88	1.81	0.63	594	2.70	1.70	0.63	621	2.55	1.61	0.63	648
29	26	3.03	1.54	0.51	616	2.85	1.45	0.51	643	2.68	1.36	0.51	670
30	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
30	20	2.58	2.34	0.91	551	2.40	2.18	0.91	578	2.23	2.02	0.91	610
30	22	2.73	2.15	0.79	572	2.55	2.01	0.79	605	2.38	1.88	0.79	626
30	24	2.88	1.93	0.67	594	2.70	1.81	0.67	621	2.55	1.71	0.67	648
30	26	3.03	1.66	0.55	616	2.85	1.57	0.55	643	2.68	1.47	0.55	670
31	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
31	20	2.58	2.45	0.95	551	2.40	2.28	0.95	578	2.23	2.11	0.95	610
31	22	2.73	2.26	0.83	572	2.55	2.12	0.83	605	2.38	1.97	0.83	626
31	24	2.88	2.04	0.71	594	2.70	1.92	0.71	621	2.55	1.81	0.71	648
31	26	3.03	1.78	0.59	616	2.85	1.68	0.59	643	2.68	1.58	0.59	670
32	18	2.45	2.45	1.00	529	2.25	2.25	1.00	562	2.08	2.08	1.00	583
32	20	2.58	2.55	0.99	551	2.40	2.38	0.99	578	2.23	2.20	0.99	610
32	22	2.73	2.37	0.87	572	2.55	2.22	0.87	605	2.38	2.07	0.87	626
32	24	2.88	2.16	0.75	594	2.70	2.03	0.75	621	2.55	1.91	0.75	648
32	26	3.03	1.91	0.63	616	2.85	1.80	0.63	643	2.68	1.69	0.63	670

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency
MFZ-KJ35VE2: MUFZ-KJ35VE MUFZ-KJ35VEHZ

CAPACITY: 3.5 kW SHF: 0.73 INPUT: 940 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.11	2.26	0.55	752	3.94	2.17	0.55	790	3.78	2.08	0.55	827	3.64	2.00	0.55	865
21	20	4.29	1.84	0.43	790	4.11	1.77	0.43	837	3.99	1.72	0.43	855	3.85	1.66	0.43	893
22	18	4.11	2.43	0.59	752	3.94	2.32	0.59	790	3.78	2.23	0.59	827	3.64	2.15	0.59	865
22	20	4.29	2.02	0.47	790	4.11	1.93	0.47	837	3.99	1.88	0.47	855	3.85	1.81	0.47	893
22	22	4.46	1.56	0.35	818	4.31	1.51	0.35	870	4.20	1.47	0.35	893	4.03	1.41	0.35	931
23	18	4.11	2.59	0.63	752	3.94	2.48	0.63	790	3.78	2.38	0.63	827	3.64	2.29	0.63	865
23	20	4.29	2.19	0.51	790	4.11	2.10	0.51	837	3.99	2.03	0.51	855	3.85	1.96	0.51	893
23	22	4.46	1.74	0.39	818	4.31	1.68	0.39	870	4.20	1.64	0.39	893	4.03	1.57	0.39	931
24	18	4.11	2.76	0.67	752	3.94	2.64	0.67	790	3.78	2.53	0.67	827	3.64	2.44	0.67	865
24	20	4.29	2.36	0.55	790	4.11	2.26	0.55	837	3.99	2.19	0.55	855	3.85	2.12	0.55	893
24	22	4.46	1.92	0.43	818	4.31	1.85	0.43	870	4.20	1.81	0.43	893	4.03	1.73	0.43	931
24	24	4.69	1.45	0.31	855	4.52	1.40	0.31	902	4.41	1.37	0.31	931	4.27	1.32	0.31	978
25	18	4.11	2.92	0.71	752	3.94	2.80	0.71	790	3.78	2.68	0.71	827	3.64	2.58	0.71	865
25	20	4.29	2.53	0.59	790	4.11	2.43	0.59	837	3.99	2.35	0.59	855	3.85	2.27	0.59	893
25	22	4.46	2.10	0.47	818	4.31	2.02	0.47	870	4.20	1.97	0.47	893	4.03	1.89	0.47	931
25	24	4.69	1.64	0.35	855	4.52	1.58	0.35	902	4.41	1.54	0.35	931	4.27	1.49	0.35	978
26	18	4.11	3.08	0.75	752	3.94	2.95	0.75	790	3.78	2.84	0.75	827	3.64	2.73	0.75	865
26	20	4.29	2.70	0.63	790	4.11	2.59	0.63	837	3.99	2.51	0.63	855	3.85	2.43	0.63	893
26	22	4.46	2.28	0.51	818	4.31	2.20	0.51	870	4.20	2.14	0.51	893	4.03	2.05	0.51	931
26	24	4.69	1.83	0.39	855	4.52	1.76	0.39	902	4.41	1.72	0.39	931	4.27	1.67	0.39	978
26	26	4.83	1.30	0.27	902	4.69	1.27	0.27	949	4.62	1.25	0.27	978	4.48	1.21	0.27	1006
27	18	4.11	3.25	0.79	752	3.94	3.11	0.79	790	3.78	2.99	0.79	827	3.64	2.88	0.79	865
27	20	4.29	2.87	0.67	790	4.11	2.76	0.67	837	3.99	2.67	0.67	855	3.85	2.58	0.67	893
27	22	4.46	2.45	0.55	818	4.31	2.37	0.55	870	4.20	2.31	0.55	893	4.03	2.21	0.55	931
27	24	4.69	2.02	0.43	855	4.52	1.94	0.43	902	4.41	1.90	0.43	931	4.27	1.84	0.43	978
27	26	4.83	1.50	0.31	902	4.69	1.45	0.31	949	4.62	1.43	0.31	978	4.48	1.39	0.31	1006
28	18	4.11	3.41	0.83	752	3.94	3.27	0.83	790	3.78	3.14	0.83	827	3.64	3.02	0.83	865
28	20	4.29	3.04	0.71	790	4.11	2.92	0.71	837	3.99	2.83	0.71	855	3.85	2.73	0.71	893
28	22	4.46	2.63	0.59	818	4.31	2.54	0.59	870	4.20	2.48	0.59	893	4.03	2.37	0.59	931
28	24	4.69	2.20	0.47	855	4.52	2.12	0.47	902	4.41	2.07	0.47	931	4.27	2.01	0.47	978
28	26	4.83	1.69	0.35	902	4.69	1.64	0.35	949	4.62	1.62	0.35	978	4.48	1.57	0.35	1006
29	18	4.11	3.58	0.87	752	3.94	3.43	0.87	790	3.78	3.29	0.87	827	3.64	3.17	0.87	865
29	20	4.29	3.22	0.75	790	4.11	3.08	0.75	837	3.99	2.99	0.75	855	3.85	2.89	0.75	893
29	22	4.46	2.81	0.63	818	4.31	2.71	0.63	870	4.20	2.65	0.63	893	4.03	2.54	0.63	931
29	24	4.69	2.39	0.51	855	4.52	2.30	0.51	902	4.41	2.25	0.51	931	4.27	2.18	0.51	978
29	26	4.83	1.88	0.39	902	4.69	1.83	0.39	949	4.62	1.80	0.39	978	4.48	1.75	0.39	1006
30	18	4.11	3.74	0.91	752	3.94	3.58	0.91	790	3.78	3.44	0.91	827	3.64	3.31	0.91	865
30	20	4.29	3.39	0.79	790	4.11	3.25	0.79	837	3.99	3.15	0.79	855	3.85	3.04	0.79	893
30	22	4.46	2.99	0.67	818	4.31	2.88	0.67	870	4.20	2.81	0.67	893	4.03	2.70	0.67	931
30	24	4.69	2.58	0.55	855	4.52	2.48	0.55	902	4.41	2.43	0.55	931	4.27	2.35	0.55	978
30	26	4.83	2.08	0.43	902	4.69	2.02	0.43	949	4.62	1.99	0.43	978	4.48	1.93	0.43	1006
31	18	4.11	3.91	0.95	752	3.94	3.74	0.95	790	3.78	3.59	0.95	827	3.64	3.46	0.95	865
31	20	4.29	3.56	0.83	790	4.11	3.41	0.83	837	3.99	3.31	0.83	855	3.85	3.20	0.83	893
31	22	4.46	3.17	0.71	818	4.31	3.06	0.71	870	4.20	2.98	0.71	893	4.03	2.86	0.71	931
31	24	4.69	2.77	0.59	855	4.52	2.66	0.59	902	4.41	2.60	0.59	931	4.27	2.52	0.59	978
31	26	4.83	2.27	0.47	902	4.69	2.20	0.47	949	4.62	2.17	0.47	978	4.48	2.11	0.47	1006
32	18	4.11	4.07	0.99	752	3.94	3.90	0.99	790	3.78	3.74	0.99	827	3.64	3.60	0.99	865
32	20	4.29	3.73	0.87	790	4.11	3.58	0.87	837	3.99	3.47	0.87	855	3.85	3.35	0.87	893
32	22	4.46	3.35	0.75	818	4.31	3.23	0.75	870	4.20	3.15	0.75	893	4.03	3.02	0.75	931
32	24	4.69	2.95	0.63	855	4.52	2.84	0.63	902	4.41	2.78	0.63	931	4.27	2.69	0.63	978
32	26	4.83	2.46	0.51	902	4.69	2.39	0.51	949	4.62	2.36	0.51	978	4.48	2.28	0.51	1006

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

FLOOR-STANDING PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency
MFZ-KJ35VE2: MUFZ-KJ35VE MUFZ-KJ35VEHZ

CAPACITY: 3.5 kW SHF: 0.73 INPUT: 940 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	3.43	1.89	0.55	921	3.15	1.73	0.55	978	2.91	1.60	0.55	1015
21	20	3.61	1.55	0.43	959	3.36	1.44	0.43	1006	3.12	1.34	0.43	1062
22	18	3.43	2.02	0.59	921	3.15	1.86	0.59	978	2.91	1.71	0.59	1015
22	20	3.61	1.69	0.47	959	3.36	1.58	0.47	1006	3.12	1.46	0.47	1062
22	22	3.82	1.34	0.35	996	3.57	1.25	0.35	1053	3.33	1.16	0.35	1090
23	18	3.43	2.16	0.63	921	3.15	1.98	0.63	978	2.91	1.83	0.63	1015
23	20	3.61	1.84	0.51	959	3.36	1.71	0.51	1006	3.12	1.59	0.51	1062
23	22	3.82	1.49	0.39	996	3.57	1.39	0.39	1053	3.33	1.30	0.39	1090
24	18	3.43	2.30	0.67	921	3.15	2.11	0.67	978	2.91	1.95	0.67	1015
24	20	3.61	1.98	0.55	959	3.36	1.85	0.55	1006	3.12	1.71	0.55	1062
24	22	3.82	1.64	0.43	996	3.57	1.54	0.43	1053	3.33	1.43	0.43	1090
24	24	4.03	1.25	0.31	1034	3.78	1.17	0.31	1081	3.57	1.11	0.31	1128
25	18	3.43	2.44	0.71	921	3.15	2.24	0.71	978	2.91	2.06	0.71	1015
25	20	3.61	2.13	0.59	959	3.36	1.98	0.59	1006	3.12	1.84	0.59	1062
25	22	3.82	1.79	0.47	996	3.57	1.68	0.47	1053	3.33	1.56	0.47	1090
25	24	4.03	1.41	0.35	1034	3.78	1.32	0.35	1081	3.57	1.25	0.35	1128
26	18	3.43	2.57	0.75	921	3.15	2.36	0.75	978	2.91	2.18	0.75	1015
26	20	3.61	2.27	0.63	959	3.36	2.12	0.63	1006	3.12	1.96	0.63	1062
26	22	3.82	1.95	0.51	996	3.57	1.82	0.51	1053	3.33	1.70	0.51	1090
26	24	4.03	1.57	0.39	1034	3.78	1.47	0.39	1081	3.57	1.39	0.39	1128
26	26	4.24	1.14	0.27	1072	3.99	1.08	0.27	1119	3.75	1.01	0.27	1166
27	18	3.43	2.71	0.79	921	3.15	2.49	0.79	978	2.91	2.29	0.79	1015
27	20	3.61	2.42	0.67	959	3.36	2.25	0.67	1006	3.12	2.09	0.67	1062
27	22	3.82	2.10	0.55	996	3.57	1.96	0.55	1053	3.33	1.83	0.55	1090
27	24	4.03	1.73	0.43	1034	3.78	1.63	0.43	1081	3.57	1.54	0.43	1128
27	26	4.24	1.31	0.31	1072	3.99	1.24	0.31	1119	3.75	1.16	0.31	1166
28	18	3.43	2.85	0.83	921	3.15	2.61	0.83	978	2.91	2.41	0.83	1015
28	20	3.61	2.56	0.71	959	3.36	2.39	0.71	1006	3.12	2.21	0.71	1062
28	22	3.82	2.25	0.59	996	3.57	2.11	0.59	1053	3.33	1.96	0.59	1090
28	24	4.03	1.89	0.47	1034	3.78	1.78	0.47	1081	3.57	1.68	0.47	1128
28	26	4.24	1.48	0.35	1072	3.99	1.40	0.35	1119	3.75	1.31	0.35	1166
29	18	3.43	2.98	0.87	921	3.15	2.74	0.87	978	2.91	2.53	0.87	1015
29	20	3.61	2.70	0.75	959	3.36	2.52	0.75	1006	3.12	2.34	0.75	1062
29	22	3.82	2.40	0.63	996	3.57	2.25	0.63	1053	3.33	2.09	0.63	1090
29	24	4.03	2.05	0.51	1034	3.78	1.93	0.51	1081	3.57	1.82	0.51	1128
29	26	4.24	1.65	0.39	1072	3.99	1.56	0.39	1119	3.75	1.46	0.39	1166
30	18	3.43	3.12	0.91	921	3.15	2.87	0.91	978	2.91	2.64	0.91	1015
30	20	3.61	2.85	0.79	959	3.36	2.65	0.79	1006	3.12	2.46	0.79	1062
30	22	3.82	2.56	0.67	996	3.57	2.39	0.67	1053	3.33	2.23	0.67	1090
30	24	4.03	2.21	0.55	1034	3.78	2.08	0.55	1081	3.57	1.96	0.55	1128
30	26	4.24	1.82	0.43	1072	3.99	1.72	0.43	1119	3.75	1.61	0.43	1166
31	18	3.43	3.26	0.95	921	3.15	2.99	0.95	978	2.91	2.76	0.95	1015
31	20	3.61	2.99	0.83	959	3.36	2.79	0.83	1006	3.12	2.59	0.83	1062
31	22	3.82	2.71	0.71	996	3.57	2.53	0.71	1053	3.33	2.36	0.71	1090
31	24	4.03	2.37	0.59	1034	3.78	2.23	0.59	1081	3.57	2.11	0.59	1128
31	26	4.24	1.99	0.47	1072	3.99	1.88	0.47	1119	3.75	1.76	0.47	1166
32	18	3.43	3.40	0.99	921	3.15	3.12	0.99	978	2.91	2.88	0.99	1015
32	20	3.61	3.14	0.87	959	3.36	2.92	0.87	1006	3.12	2.71	0.87	1062
32	22	3.82	2.86	0.75	996	3.57	2.68	0.75	1053	3.33	2.49	0.75	1090
32	24	4.03	2.54	0.63	1034	3.78	2.38	0.63	1081	3.57	2.25	0.63	1128
32	26	4.24	2.16	0.51	1072	3.99	2.03	0.51	1119	3.75	1.91	0.51	1166

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA COOL operation at Rated frequency

MFZ-KJ50VE2: MUFZ-KJ50VE MUFZ-KJ50VEHZ

CAPACITY: 5.0 kW SHF: 0.71 INPUT: 1410 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)															
		21				25				27				30			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	5.88	3.11	0.53	1128	5.63	2.98	0.53	1184	5.40	2.86	0.53	1241	5.20	2.76	0.53	1297
21	20	6.13	2.51	0.41	1184	5.88	2.41	0.41	1255	5.70	2.34	0.41	1283	5.50	2.26	0.41	1340
22	18	5.88	3.35	0.57	1128	5.63	3.21	0.57	1184	5.40	3.08	0.57	1241	5.20	2.96	0.57	1297
22	20	6.13	2.76	0.45	1184	5.88	2.64	0.45	1255	5.70	2.57	0.45	1283	5.50	2.48	0.45	1340
22	22	6.38	2.10	0.33	1227	6.15	2.03	0.33	1304	6.00	1.98	0.33	1340	5.75	1.90	0.33	1396
23	18	5.88	3.58	0.61	1128	5.63	3.43	0.61	1184	5.40	3.29	0.61	1241	5.20	3.17	0.61	1297
23	20	6.13	3.00	0.49	1184	5.88	2.88	0.49	1255	5.70	2.79	0.49	1283	5.50	2.70	0.49	1340
23	22	6.38	2.36	0.37	1227	6.15	2.28	0.37	1304	6.00	2.22	0.37	1340	5.75	2.13	0.37	1396
24	18	5.88	3.82	0.65	1128	5.63	3.66	0.65	1184	5.40	3.51	0.65	1241	5.20	3.38	0.65	1297
24	20	6.13	3.25	0.53	1184	5.88	3.11	0.53	1255	5.70	3.02	0.53	1283	5.50	2.92	0.53	1340
24	22	6.38	2.61	0.41	1227	6.15	2.52	0.41	1304	6.00	2.46	0.41	1340	5.75	2.36	0.41	1396
24	24	6.70	1.94	0.29	1283	6.45	1.87	0.29	1354	6.30	1.83	0.29	1396	6.10	1.77	0.29	1466
25	18	5.88	4.05	0.69	1128	5.63	3.88	0.69	1184	5.40	3.73	0.69	1241	5.20	3.59	0.69	1297
25	20	6.13	3.49	0.57	1184	5.88	3.35	0.57	1255	5.70	3.25	0.57	1283	5.50	3.14	0.57	1340
25	22	6.38	2.87	0.45	1227	6.15	2.77	0.45	1304	6.00	2.70	0.45	1340	5.75	2.59	0.45	1396
25	24	6.70	2.21	0.33	1283	6.45	2.13	0.33	1354	6.30	2.08	0.33	1396	6.10	2.01	0.33	1466
26	18	5.88	4.29	0.73	1128	5.63	4.11	0.73	1184	5.40	3.94	0.73	1241	5.20	3.80	0.73	1297
26	20	6.13	3.74	0.61	1184	5.88	3.58	0.61	1255	5.70	3.48	0.61	1283	5.50	3.36	0.61	1340
26	22	6.38	3.12	0.49	1227	6.15	3.01	0.49	1304	6.00	2.94	0.49	1340	5.75	2.82	0.49	1396
26	24	6.70	2.48	0.37	1283	6.45	2.39	0.37	1354	6.30	2.33	0.37	1396	6.10	2.26	0.37	1466
26	26	6.90	1.73	0.25	1354	6.70	1.68	0.25	1424	6.60	1.65	0.25	1466	6.40	1.60	0.25	1509
27	18	5.88	4.52	0.77	1128	5.63	4.33	0.77	1184	5.40	4.16	0.77	1241	5.20	4.00	0.77	1297
27	20	6.13	3.98	0.65	1184	5.88	3.82	0.65	1255	5.70	3.71	0.65	1283	5.50	3.58	0.65	1340
27	22	6.38	3.38	0.53	1227	6.15	3.26	0.53	1304	6.00	3.18	0.53	1340	5.75	3.05	0.53	1396
27	24	6.70	2.75	0.41	1283	6.45	2.64	0.41	1354	6.30	2.58	0.41	1396	6.10	2.50	0.41	1466
27	26	6.90	2.00	0.29	1354	6.70	1.94	0.29	1424	6.60	1.91	0.29	1466	6.40	1.86	0.29	1509
28	18	5.88	4.76	0.81	1128	5.63	4.56	0.81	1184	5.40	4.37	0.81	1241	5.20	4.21	0.81	1297
28	20	6.13	4.23	0.69	1184	5.88	4.05	0.69	1255	5.70	3.93	0.69	1283	5.50	3.80	0.69	1340
28	22	6.38	3.63	0.57	1227	6.15	3.51	0.57	1304	6.00	3.42	0.57	1340	5.75	3.28	0.57	1396
28	24	6.70	3.02	0.45	1283	6.45	2.90	0.45	1354	6.30	2.84	0.45	1396	6.10	2.75	0.45	1466
28	26	6.90	2.28	0.33	1354	6.70	2.21	0.33	1424	6.60	2.18	0.33	1466	6.40	2.11	0.33	1509
29	18	5.88	4.99	0.85	1128	5.63	4.78	0.85	1184	5.40	4.59	0.85	1241	5.20	4.42	0.85	1297
29	20	6.13	4.47	0.73	1184	5.88	4.29	0.73	1255	5.70	4.16	0.73	1283	5.50	4.02	0.73	1340
29	22	6.38	3.89	0.61	1227	6.15	3.75	0.61	1304	6.00	3.66	0.61	1340	5.75	3.51	0.61	1396
29	24	6.70	3.28	0.49	1283	6.45	3.16	0.49	1354	6.30	3.09	0.49	1396	6.10	2.99	0.49	1466
29	26	6.90	2.55	0.37	1354	6.70	2.48	0.37	1424	6.60	2.44	0.37	1466	6.40	2.37	0.37	1509
30	18	5.88	5.23	0.89	1128	5.63	5.01	0.89	1184	5.40	4.81	0.89	1241	5.20	4.63	0.89	1297
30	20	6.13	4.72	0.77	1184	5.88	4.52	0.77	1255	5.70	4.39	0.77	1283	5.50	4.24	0.77	1340
30	22	6.38	4.14	0.65	1227	6.15	4.00	0.65	1304	6.00	3.90	0.65	1340	5.75	3.74	0.65	1396
30	24	6.70	3.55	0.53	1283	6.45	3.42	0.53	1354	6.30	3.34	0.53	1396	6.10	3.23	0.53	1466
30	26	6.90	2.83	0.41	1354	6.70	2.75	0.41	1424	6.60	2.71	0.41	1466	6.40	2.62	0.41	1509
31	18	5.88	5.46	0.93	1128	5.63	5.23	0.93	1184	5.40	5.02	0.93	1241	5.20	4.84	0.93	1297
31	20	6.13	4.96	0.81	1184	5.88	4.76	0.81	1255	5.70	4.62	0.81	1283	5.50	4.46	0.81	1340
31	22	6.38	4.40	0.69	1227	6.15	4.24	0.69	1304	6.00	4.14	0.69	1340	5.75	3.97	0.69	1396
31	24	6.70	3.82	0.57	1283	6.45	3.68	0.57	1354	6.30	3.59	0.57	1396	6.10	3.48	0.57	1466
31	26	6.90	3.11	0.45	1354	6.70	3.02	0.45	1424	6.60	2.97	0.45	1466	6.40	2.88	0.45	1509
32	18	5.88	5.70	0.97	1128	5.63	5.46	0.97	1184	5.40	5.24	0.97	1241	5.20	5.04	0.97	1297
32	20	6.13	5.21	0.85	1184	5.88	4.99	0.85	1255	5.70	4.84	0.85	1283	5.50	4.68	0.85	1340
32	22	6.38	4.65	0.73	1227	6.15	4.49	0.73	1304	6.00	4.38	0.73	1340	5.75	4.20	0.73	1396
32	24	6.70	4.09	0.61	1283	6.45	3.93	0.61	1354	6.30	3.84	0.61	1396	6.10	3.72	0.61	1466
32	26	6.90	3.38	0.49	1354	6.70	3.28	0.49	1424	6.60	3.23	0.49	1466	6.40	3.14	0.49	1509

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

FLOOR-STANDING PERFORMANCE DATA

PERFORMANCE DATA COOL operation at Rated frequency

MFZ-KJ50VE2: MUFZ-KJ50VE MUFZ-KJ50VEHZ

CAPACITY: 5.0 kW SHF: 0.71 INPUT: 1410 W

INDOOR DB (°C)	INDOOR WB (°C)	OUTDOOR DB (°C)											
		35				40				46			
		Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT	Q	SHC	SHF	INPUT
21	18	4.90	2.60	0.53	1382	4.50	2.39	0.53	1466	4.15	2.20	0.53	1523
21	20	5.15	2.11	0.41	1438	4.80	1.97	0.41	1509	4.45	1.82	0.41	1593
22	18	4.90	2.79	0.57	1382	4.50	2.57	0.57	1466	4.15	2.37	0.57	1523
22	20	5.15	2.32	0.45	1438	4.80	2.16	0.45	1509	4.45	2.00	0.45	1593
22	22	5.45	1.80	0.33	1495	5.10	1.68	0.33	1579	4.75	1.57	0.33	1636
23	18	4.90	2.99	0.61	1382	4.50	2.75	0.61	1466	4.15	2.53	0.61	1523
23	20	5.15	2.52	0.49	1438	4.80	2.35	0.49	1509	4.45	2.18	0.49	1593
23	22	5.45	2.02	0.37	1495	5.10	1.89	0.37	1579	4.75	1.76	0.37	1636
24	18	4.90	3.19	0.65	1382	4.50	2.93	0.65	1466	4.15	2.70	0.65	1523
24	20	5.15	2.73	0.53	1438	4.80	2.54	0.53	1509	4.45	2.36	0.53	1593
24	22	5.45	2.23	0.41	1495	5.10	2.09	0.41	1579	4.75	1.95	0.41	1636
24	24	5.75	1.67	0.29	1551	5.40	1.57	0.29	1621	5.10	1.48	0.29	1692
25	18	4.90	3.38	0.69	1382	4.50	3.11	0.69	1466	4.15	2.86	0.69	1523
25	20	5.15	2.94	0.57	1438	4.80	2.74	0.57	1509	4.45	2.54	0.57	1593
25	22	5.45	2.45	0.45	1495	5.10	2.30	0.45	1579	4.75	2.14	0.45	1636
25	24	5.75	1.90	0.33	1551	5.40	1.78	0.33	1621	5.10	1.68	0.33	1692
26	18	4.90	3.58	0.73	1382	4.50	3.29	0.73	1466	4.15	3.03	0.73	1523
26	20	5.15	3.14	0.61	1438	4.80	2.93	0.61	1509	4.45	2.71	0.61	1593
26	22	5.45	2.67	0.49	1495	5.10	2.50	0.49	1579	4.75	2.33	0.49	1636
26	24	5.75	2.13	0.37	1551	5.40	2.00	0.37	1621	5.10	1.89	0.37	1692
26	26	6.05	1.51	0.25	1607	5.70	1.43	0.25	1678	5.35	1.34	0.25	1748
27	18	4.90	3.77	0.77	1382	4.50	3.47	0.77	1466	4.15	3.20	0.77	1523
27	20	5.15	3.35	0.65	1438	4.80	3.12	0.65	1509	4.45	2.89	0.65	1593
27	22	5.45	2.89	0.53	1495	5.10	2.70	0.53	1579	4.75	2.52	0.53	1636
27	24	5.75	2.36	0.41	1551	5.40	2.21	0.41	1621	5.10	2.09	0.41	1692
27	26	6.05	1.75	0.29	1607	5.70	1.65	0.29	1678	5.35	1.55	0.29	1748
28	18	4.90	3.97	0.81	1382	4.50	3.65	0.81	1466	4.15	3.36	0.81	1523
28	20	5.15	3.55	0.69	1438	4.80	3.31	0.69	1509	4.45	3.07	0.69	1593
28	22	5.45	3.11	0.57	1495	5.10	2.91	0.57	1579	4.75	2.71	0.57	1636
28	24	5.75	2.59	0.45	1551	5.40	2.43	0.45	1621	5.10	2.30	0.45	1692
28	26	6.05	2.00	0.33	1607	5.70	1.88	0.33	1678	5.35	1.77	0.33	1748
29	18	4.90	4.17	0.85	1382	4.50	3.83	0.85	1466	4.15	3.53	0.85	1523
29	20	5.15	3.76	0.73	1438	4.80	3.50	0.73	1509	4.45	3.25	0.73	1593
29	22	5.45	3.32	0.61	1495	5.10	3.11	0.61	1579	4.75	2.90	0.61	1636
29	24	5.75	2.82	0.49	1551	5.40	2.65	0.49	1621	5.10	2.50	0.49	1692
29	26	6.05	2.24	0.37	1607	5.70	2.11	0.37	1678	5.35	1.98	0.37	1748
30	18	4.90	4.36	0.89	1382	4.50	4.01	0.89	1466	4.15	3.69	0.89	1523
30	20	5.15	3.97	0.77	1438	4.80	3.70	0.77	1509	4.45	3.43	0.77	1593
30	22	5.45	3.54	0.65	1495	5.10	3.32	0.65	1579	4.75	3.09	0.65	1636
30	24	5.75	3.05	0.53	1551	5.40	2.86	0.53	1621	5.10	2.70	0.53	1692
30	26	6.05	2.48	0.41	1607	5.70	2.34	0.41	1678	5.35	2.19	0.41	1748
31	18	4.90	4.56	0.93	1382	4.50	4.19	0.93	1466	4.15	3.86	0.93	1523
31	20	5.15	4.17	0.81	1438	4.80	3.89	0.81	1509	4.45	3.60	0.81	1593
31	22	5.45	3.76	0.69	1495	5.10	3.52	0.69	1579	4.75	3.28	0.69	1636
31	24	5.75	3.28	0.57	1551	5.40	3.08	0.57	1621	5.10	2.91	0.57	1692
31	26	6.05	2.72	0.45	1607	5.70	2.57	0.45	1678	5.35	2.41	0.45	1748
32	18	4.90	4.75	0.97	1382	4.50	4.37	0.97	1466	4.15	4.03	0.97	1523
32	20	5.15	4.38	0.85	1438	4.80	4.08	0.85	1509	4.45	3.78	0.85	1593
32	22	5.45	3.98	0.73	1495	5.10	3.72	0.73	1579	4.75	3.47	0.73	1636
32	24	5.75	3.51	0.61	1551	5.40	3.29	0.61	1621	5.10	3.11	0.61	1692
32	26	6.05	2.96	0.49	1607	5.70	2.79	0.49	1678	5.35	2.62	0.49	1748

NOTE Q : Total capacity (kW) SHF : Sensible heat factor DB : Dry-bulb temperature
 SHC : Sensible heat capacity (kW) INPUT : Total power input (W) WB : Wet-bulb temperature

PERFORMANCE DATA HEAT operation at Rated frequency

MFZ-KJ25VE2: MUFZ-KJ25VE MUFZ-KJ25VEHZ

CAPACITY: 3.4 kW INPUT: 770 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.14	501	2.58	601	3.03	678	3.47	732	3.91	778	4.32	801	4.76	816
21	2.04	539	2.45	639	2.89	708	3.30	762	3.74	801	4.15	824	4.57	855
26	1.84	578	2.28	678	2.69	747	3.13	801	3.57	839	3.98	862	4.42	886

MFZ-KJ35VE2: MUFZ-KJ35VE MUFZ-KJ35VEHZ

CAPACITY: 4.3 kW INPUT: 1100 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	2.71	715	3.27	858	3.83	968	4.39	1045	4.95	1111	5.46	1144	6.02	1166
21	2.58	770	3.10	913	3.66	1012	4.17	1089	4.73	1144	5.25	1177	5.78	1221
26	2.32	825	2.88	968	3.40	1067	3.96	1144	4.52	1199	5.03	1232	5.59	1265

MFZ-KJ50VE2: MUFZ-KJ50VE MUFZ-KJ50VEHZ

CAPACITY: 6.0 kW INPUT: 1610 W

INDOOR DB (°C)	OUTDOOR WB (°C)													
	-10		-5		0		5		10		15		20	
	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT	Q	INPUT
15	3.78	1047	4.56	1256	5.34	1417	6.12	1530	6.90	1626	7.62	1674	8.40	1707
21	3.60	1127	4.32	1336	5.10	1481	5.82	1594	6.60	1674	7.32	1723	8.07	1787
26	3.24	1208	4.02	1417	4.74	1562	5.52	1674	6.30	1755	7.02	1803	7.80	1852

NOTE: Q: Total capacity (kW) INPUT : Total power input (W) DB: Dry-bulb temperature WB: Wet-bulb temperature


C.2.7 NOISE CRITERIA CURVES

C.2.7.1 Inverter Heat Pump

MFZ-KJ25VE2

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	39	●—●
	HEATING	41	○—○

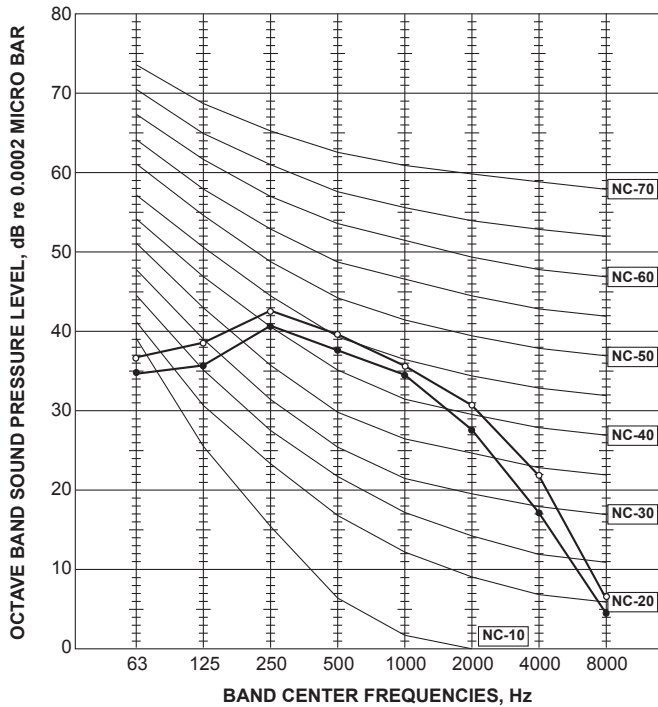

MFZ-KJ35VE2

INDOOR UNIT


FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	39	●—●
	HEATING	41	○—○

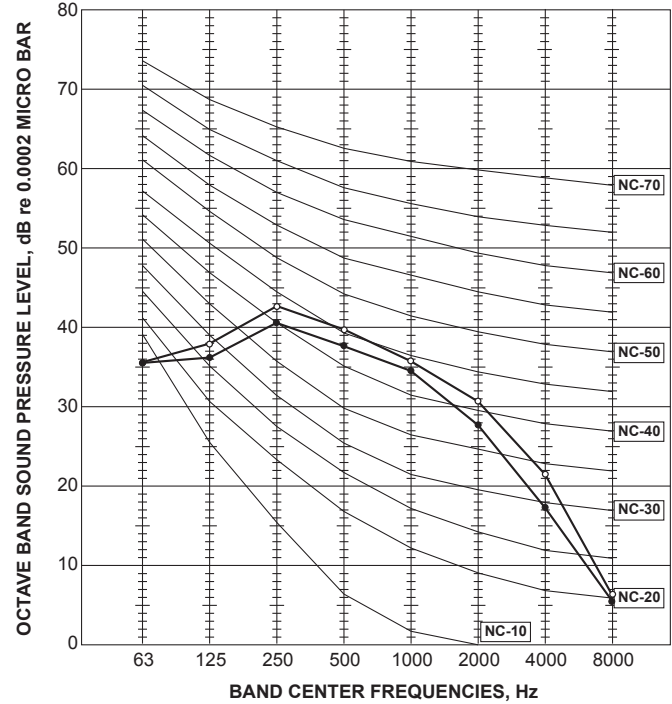

MFZ-KJ50VE2


INDOOR UNIT

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
Super High	COOLING	44	●—●
	HEATING	50	○—○

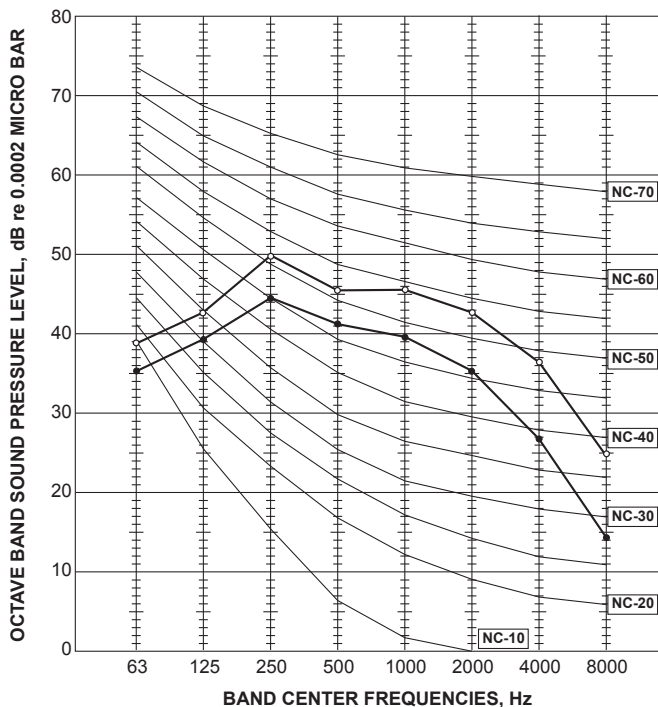

Test conditions


Cooling : Dry-bulb temperature 27 °C Wet-bulb temperature 19 °C
 Heating : Dry-bulb temperature 20 °C

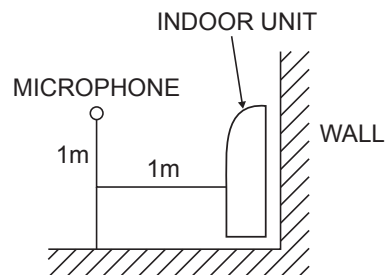

NOISE CRITERIA CURVES FLOOR-STANDING


MUFZ-KJ25VE MUFZ-KJ25VEHZ
OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	46	●—●
HEATING	51	○—○

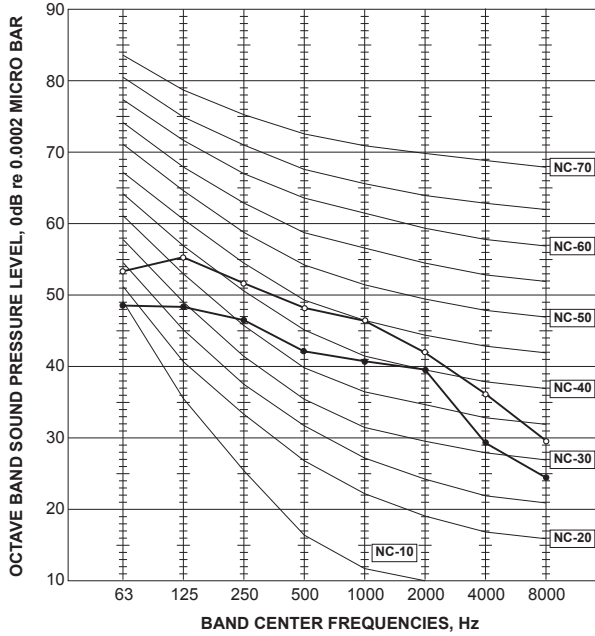


MUFZ-KJ35VE MUFZ-KJ35VEHZ
OUTDOOR UNIT

FUNCTION	SPL(dB(A))	LINE
COOLING	47	●—●
HEATING	51	○—○

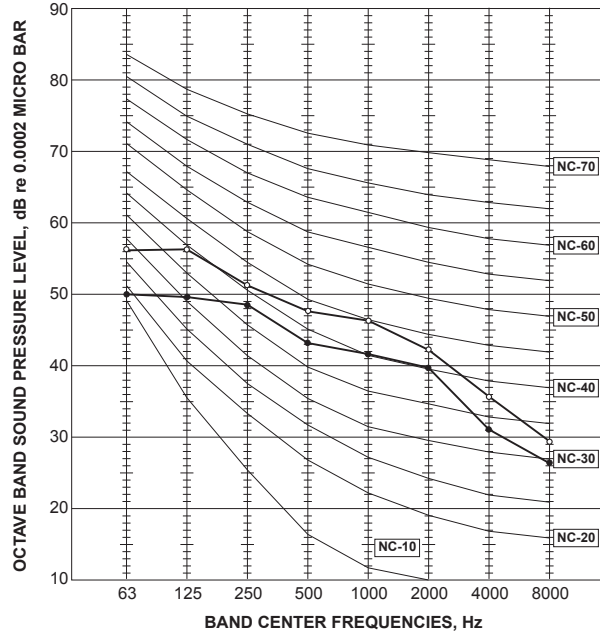

MUFZ-KJ50VE MUFZ-KJ50VEHZ
OUTDOOR UNIT


FUNCTION	SPL(dB(A))	LINE
COOLING	49	●—●
HEATING	51	○—○

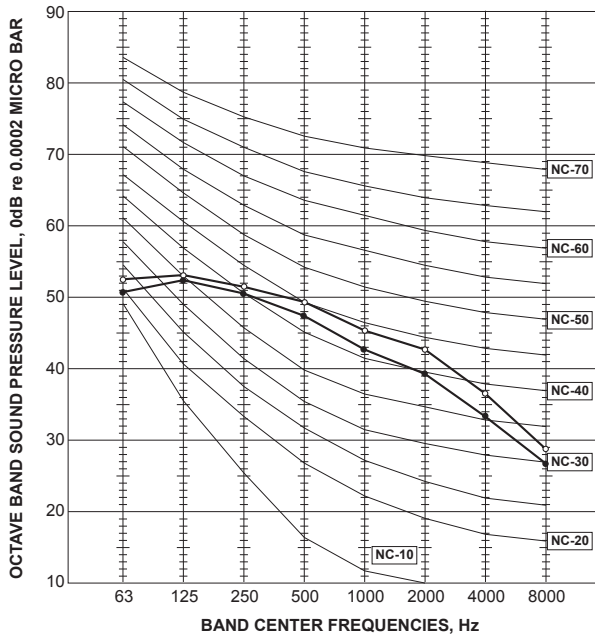

Test conditions

Cooling: Dry-bulb temperature 35°C

Heating: Dry-bulb temperature 7°C Wet-bulb temperature 6°C

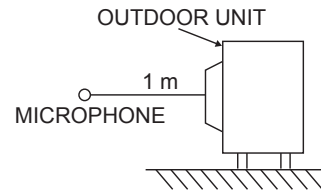

C.2.8 TEMPERATURE AND AIR FLOW DISTRIBUTIONS


MFZ-KJ25VE2

Standard installation (One-direction air flow)

Temperature distribution


<Cooling mode>

Air volume: super high
Air direction: auto

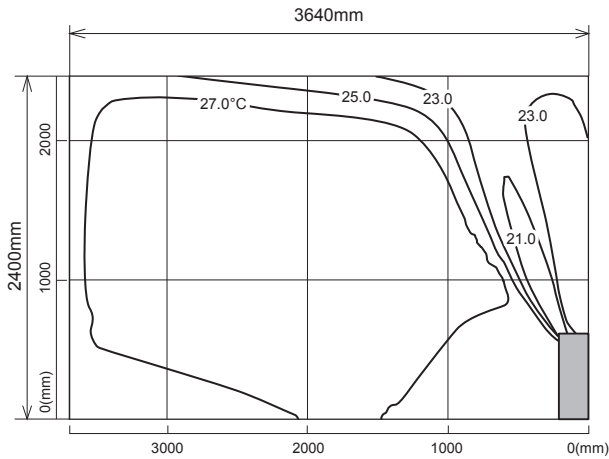

<Heating mode>


Air volume: super high
Air direction: auto

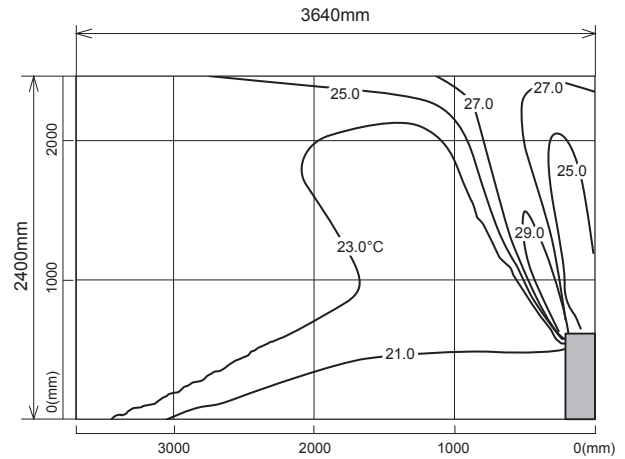

Airflow distribution


<Cooling mode>

Air volume: super high
Air direction: auto

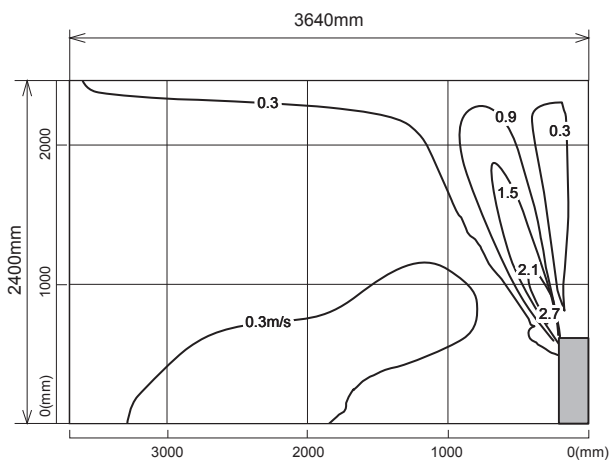

<Heating mode>

Air volume: super high
Air direction: auto

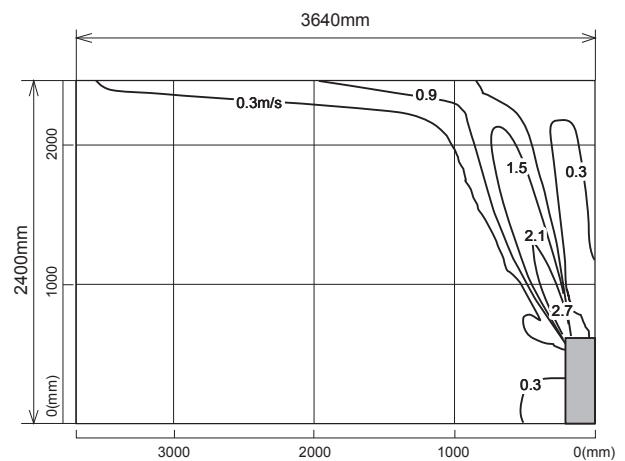

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

TEMPERATURE AND AIR FLOW DISTRIBUTIONS FLOOR-STANDING


MFZ-KJ25VE2

Standard installation (Two-direction air flow)

Temperature distribution


<Cooling mode>

Air volume: super high
Air direction: auto

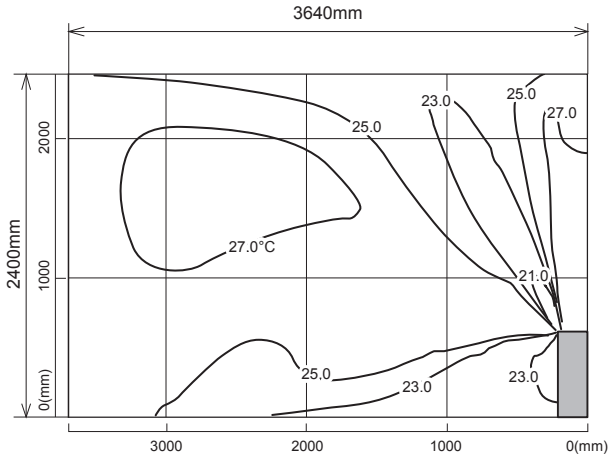

<Heating mode>


Air volume: super high
Air direction: auto

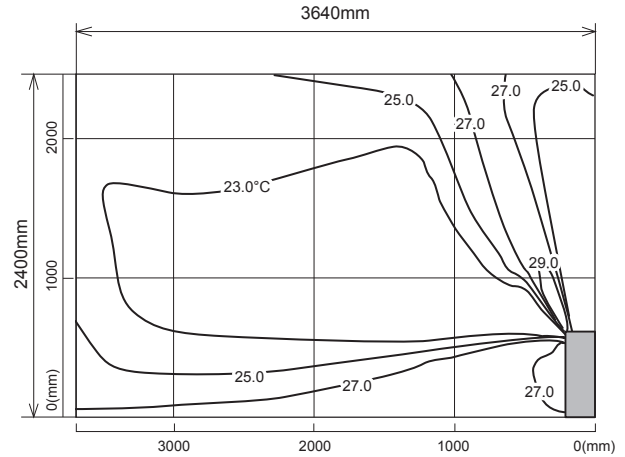

Airflow distribution


<Cooling mode>

Air volume: super high
Air direction: auto

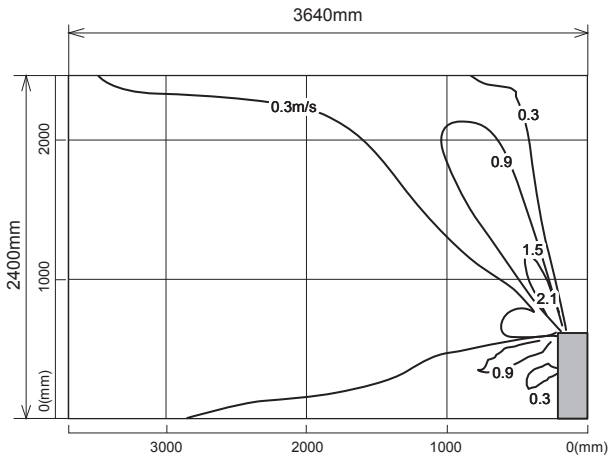

<Heating mode>

Air volume: super high
Air direction: auto

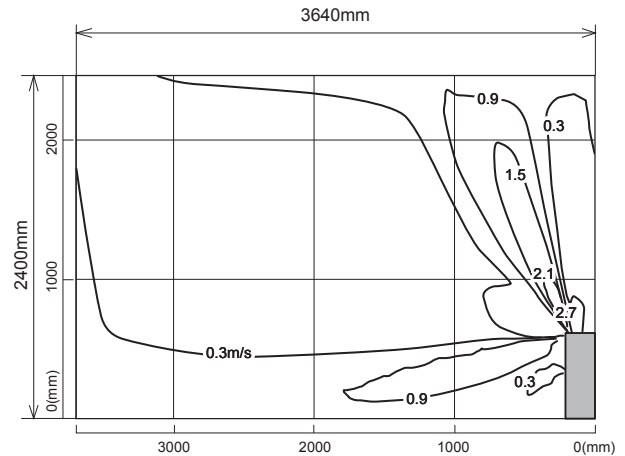

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

FLOOR-STANDING TEMPERATURE AND AIR FLOW DISTRIBUTIONS


MFZ-KJ35VE2

Standard installation (One-direction air flow)

Temperature distribution


<Cooling mode>

Air volume: super high
Air direction: auto

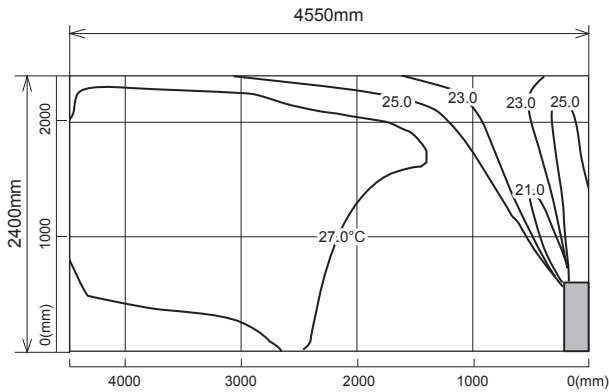

<Heating mode>


Air volume: super high
Air direction: auto

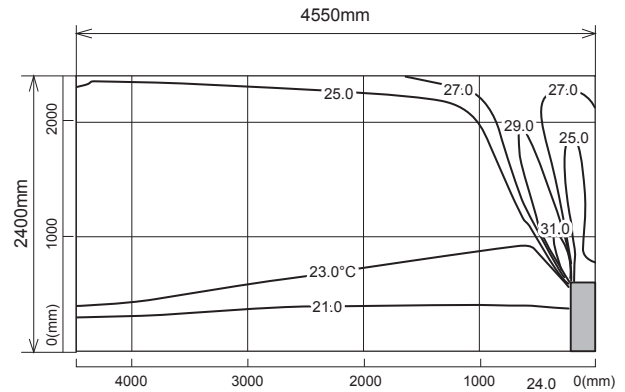

Airflow distribution


<Cooling mode>

Air volume: super high
Air direction: auto

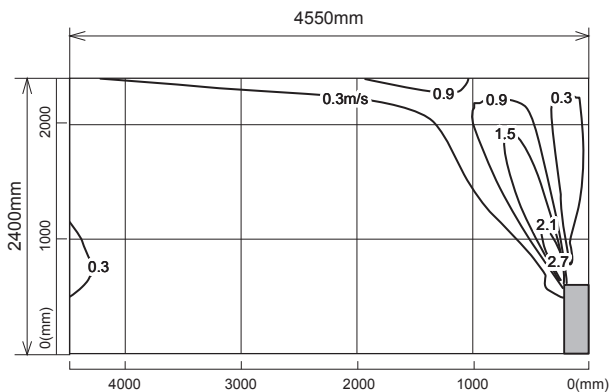

<Heating mode>

Air volume: super high
Air direction: auto

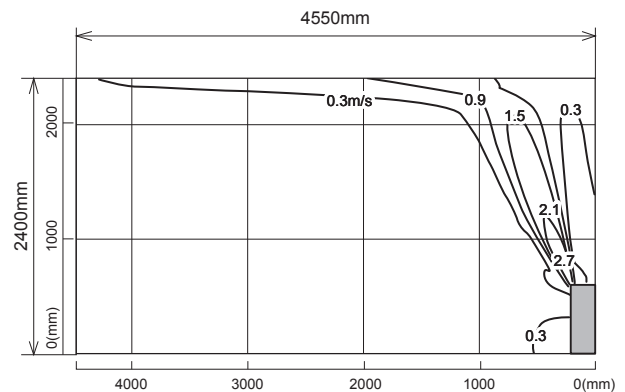

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

TEMPERATURE AND AIR FLOW DISTRIBUTIONS FLOOR-STANDING


MFZ-KJ35VE2

Standard installation (Two-direction air flow)

Temperature distribution


<Cooling mode>

Air volume: super high
Air direction: auto

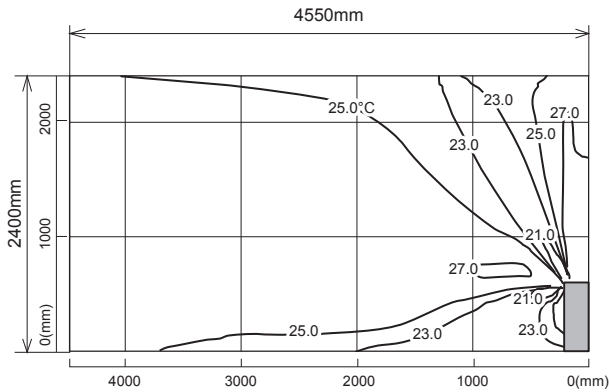

<Heating mode>


Air volume: super high
Air direction: auto

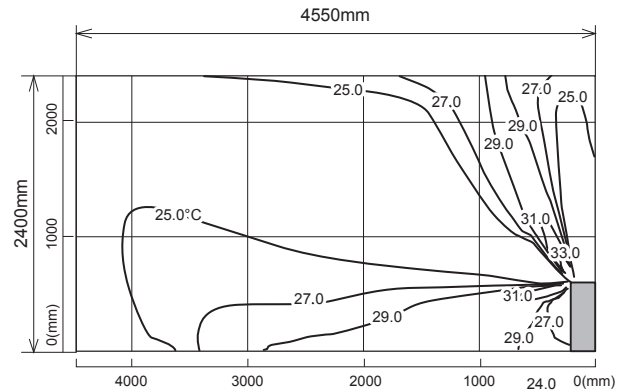

Airflow distribution


<Cooling mode>

Air volume: super high
Air direction: auto

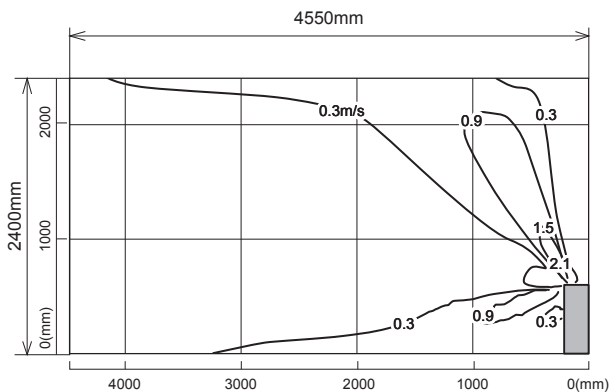

<Heating mode>

Air volume: super high
Air direction: auto

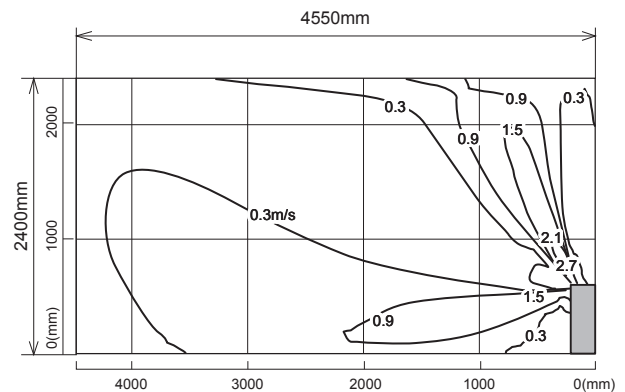

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

FLOOR-STANDING TEMPERATURE AND AIR FLOW DISTRIBUTIONS


MFZ-KJ50VE2

Standard installation (One-direction air flow)

Temperature distribution


<Cooling mode>

Air volume: super high
Air direction: auto

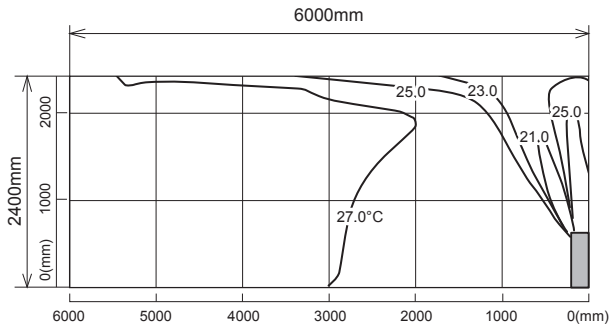

<Heating mode>


Air volume: super high
Air direction: auto

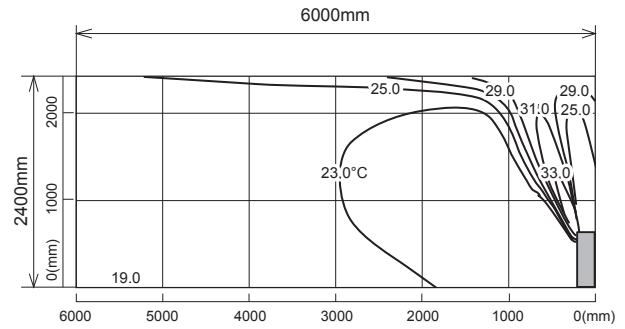

Airflow distribution


<Cooling mode>

Air volume: super high
Air direction: auto

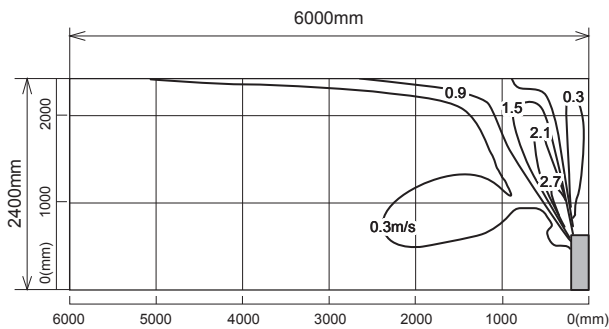

<Heating mode>

Air volume: super high
Air direction: auto

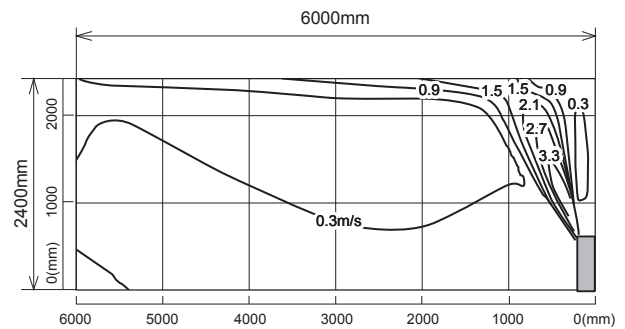

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

TEMPERATURE AND AIR FLOW DISTRIBUTIONS FLOOR-STANDING


MFZ-KJ50VE2

Standard installation (Two-direction air flow)

Temperature distribution


<Cooling mode>

Air volume: super high
Air direction: auto

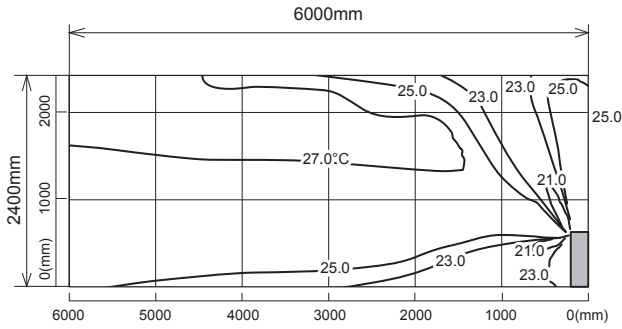

<Heating mode>


Air volume: super high
Air direction: auto

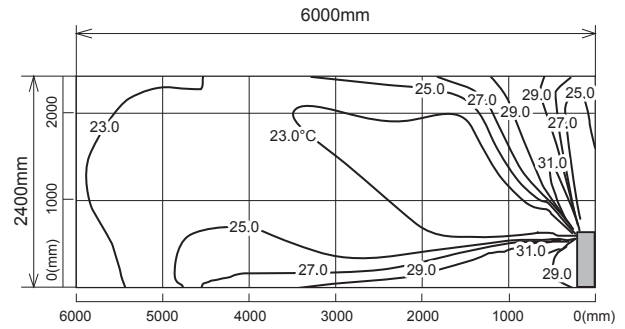

Airflow distribution


<Cooling mode>

Air volume: super high
Air direction: auto

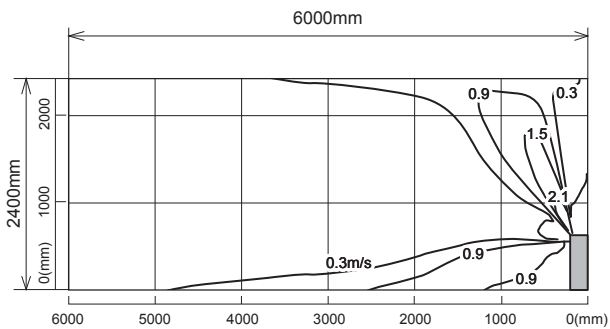

<Heating mode>

Air volume: super high
Air direction: auto

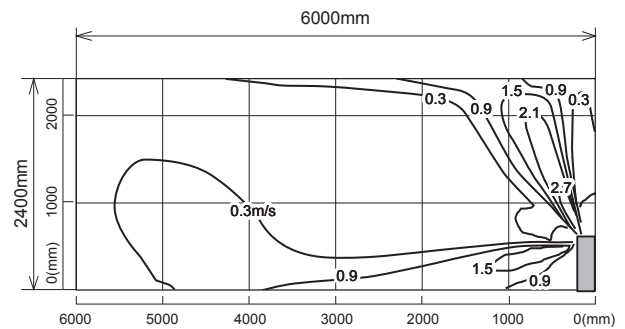


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

C.2.9 OPERATION AND ACTUATOR CONTROL

C.2.9.1 MFZ-KJ·VE2 Series

MFZ-KJ25VE2 MFZ-KJ35VE2 MFZ-KJ50VE2

WIRELESS REMOTE CONTROLLER

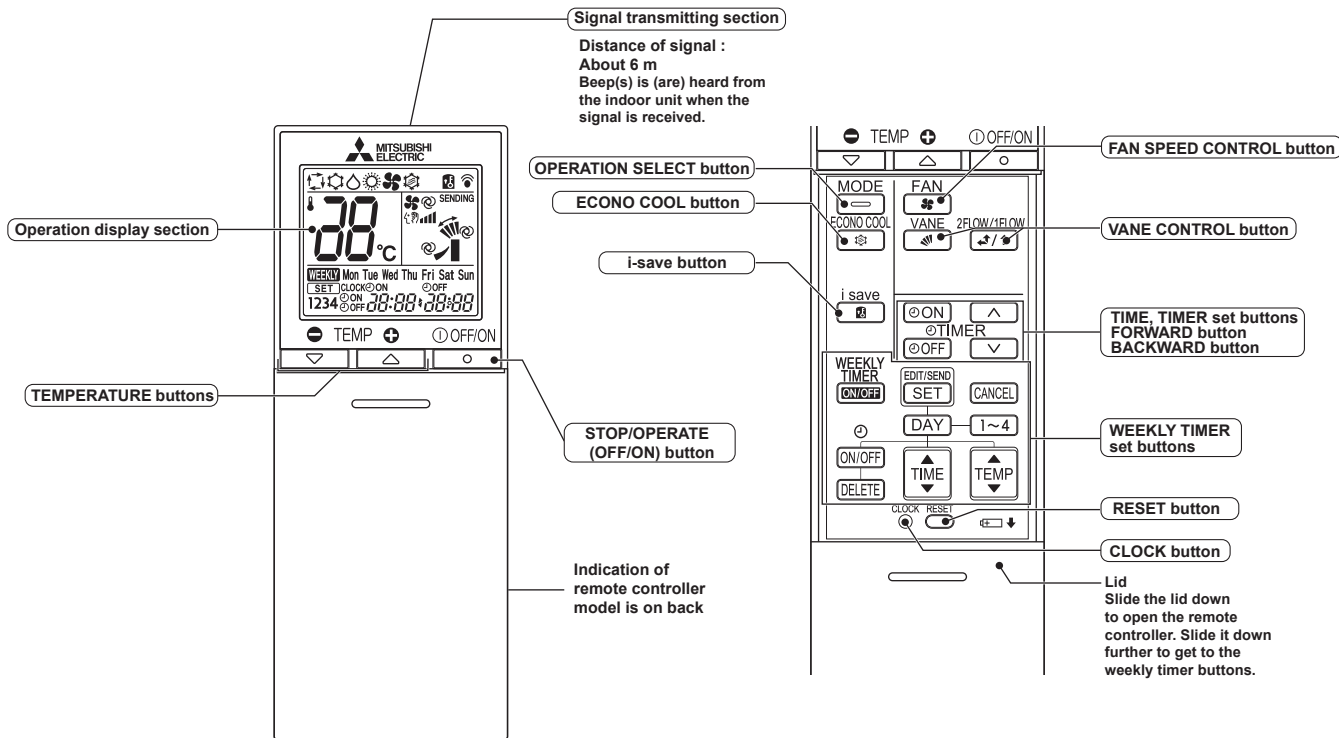

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
● ●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
● ○	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
● ☀	Standby mode (only during multi system operation)	—

- Lighted
- ☀ Blinking
- Not lighted

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

2. Low outside temperature operation

When the outside temperature is lower, low outside temperature operation starts, and the outdoor fan slows or stops.

3. Indoor fan speed control

When the thermostat turns OFF, the indoor fan operates at the setting fan speed.

b. DRY (△) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

2. Low outside temperature operation

Low outside temperature operation works the same way as that in COOL mode. (a.2.)

3. Indoor fan speed control

Indoor fan speed control works the same way as that in COOL mode. (a.3.)

However in AUTO setting, the fan speed changes.

c. FAN (✿) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
 - (2) Select FAN mode with OPERATION SELECT button.
 - (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.
- NOTE:** Temperature cannot be set during FAN mode.

d. HEAT (☀) OPERATION

- (1) Press STOP/OPERATE (OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. High pressure protection

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the condensing pressure from increasing excessively.

When the temperature of indoor heat exchanger becomes too high, the high pressure protection works.

This mode continues until the temperature of indoor heat exchanger falls.

3. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

1. Mode selection

- (1) Initial mode
At first indoor unit operates only indoor fan with outdoor unit OFF for 3 minutes to detect present room temperature.
Following the conditions below, operation mode is selected.
 - ① If the room temperature thermistor RT11 reads more than set temperature, COOL mode is selected.
 - ② If the room temperature thermistor RT11 reads set temperature or less, HEAT mode is selected.

(2) Mode change

In case of the following conditions the operation mode is changed.

- ① COOL mode changes to HEAT mode when 15 minutes have passed with the room temperature 2 degrees below the set temperature.
- ② HEAT mode changes to COOL mode when 15 minutes have passed with the room temperature 2 degrees below the set temperature.

In the other cases than the above conditions, the present operation mode is continued.

NOTE 1: Mode selection is performed when multi standby (refer to **NOTE 2**) is released and the unit starts operation with ON-timer.

NOTE 2: If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in AUTO (□), cannot change over the other operating mode (COOL ↔ HEAT) and becomes a state of standby.


NOTE 3: At the beginning of AUTO mode, the air flow direction and the fan speed are set to AUTO and the air outlet selection is set to 2 FLOW.

f. AUTO VANE OPERATION

1. Horizontal vane (Horizontal vane/Multi-flow vane)

(1) Vane motor drive

These models are equipped with a stepping motors for the horizontal vanes. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL () button.




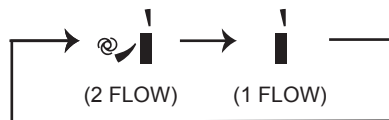
(3) Positioning

The vane presses the vane stopper once to confirm the standard position and then moves to the set angle. Confirming of standard position is performed in case of follows.

- (a) The power supply turns on.
- (b) The operation starts or finishes (including timer operation).
- (c) The test run starts.
- (d) The multi-standby starts or finishes.
- (e) Every time the vane has swung more than the specified numbers of times.
- (f) The horizontal vane automatically moves in certain intervals to determine its position, and then it returns to set position.
- (g) The vane operates for the dew prevention.

(4) Air outlet selection

The air outlet(s) can be selected by pressing to VANE CONTROL () button. When 2 FLOW is selected, air blows from the top and the front of the unit. When 1 FLOW is selected, air blows only from the top of the unit.



The multi-flow vane is automatically set to the appropriate position.

In HEAT, the multi-flow vane automatically changes its position according to the indoor fan speed.

Even if 2 FLOW is selected, air will blow only from the top of the unit in the following conditions:

- During COOL/DRY: The room temperature is close to set temperature.
The air conditioner has operated for 0.5 to 1 hour.
- During HEAT: The air flow temperature is low. (During defrosting operation, start of operation, etc.)

NOTE:

Movement at the start of the 2 FLOW operation

- COOL/DRY, HEAT: It takes 0.5 to 1 minute to start the 2 FLOW operation.
- HEAT: When cold air blows out from the air outlet, the multi-flow vane may stop moving for up to 10 minutes to make and blow out warm air.

(5) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle to make the optimum room temperature distribution.

In COOL, DRY and FAN operation

2 FLOW: Vane angle is fixed to position 2.




1 FLOW: Vane angle is fixed to position 1.



In HEAT operation

2 FLOW: Vane angle is fixed to position 2.



1 FLOW: Vane angle is fixed to position 3.



- (6) STOP (operation OFF) and ON TIMER standby
 In the following cases, the horizontal vane returns to the closed position.
 - (a) When STOP/OPERATE (OFF/ON) button is pressed (POWER OFF).
 - (b) When the operation is stopped by the emergency operation.
 - (c) When ON TIMER is ON standby.
- (7) Dew prevention
 During COOL or DRY operation with the vane angle at Angle 3 or 4 when the compressor cumulative operation time exceeds 1 hour, the vane angle automatically changes to Angle 1 for dew prevention.
- (8) SWING (🌀) mode
 By selecting SWING mode with VANE CONTROL button, the horizontal vanes swing vertically.
 The remote controller displays "🌀". SWING mode is cancelled when VANE CONTROL button is pressed once again.
- (9) Cold air prevention in HEAT operation
 The horizontal vane position is set to Upward.
- (10) ECONO COOL (🌿) operation (ECONOMical operation)
 When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by the microprocessor. However, the temperature on the LCD screen on the remote controller is not changed. Also the horizontal vane swings in various cycle.
 SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.
 To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, VANE CONTROL button.

9. TIMER OPERATION

1. How to set the time

- (1) Check that the current time is set correctly.
NOTE: Timer operation will not work without setting the current time. Initially "0:00" blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK button.

How to set the current time

- (a) Press the CLOCK button.
- (b) Press the TIME SET buttons (⏮ and ⏭) to set the current time.
 - Each time FORWARD button (⏮) is pressed, the set time increases by 1 minute, and each time BACKWARD button (⏭) is pressed, the set time decreases by 1 minute.
 - Pressing those buttons longer, the set time increases/decreases by 10 minutes.
- (c) Press the CLOCK set button.
- (2) Press STOP/OPERATE (OFF/ON) button to start the air conditioner.
- (3) Set the time of timer.

ON timer setting

- (a) Press ON TIMER button(⏻) during operation.
- (b) Set the time of the timer using TIME SET buttons (⏮ and ⏭).*

OFF timer setting

- (a) Press OFF TIMER button(⏻) during operation.
- (b) Set the time of the timer using TIME SET buttons (⏮ and ⏭).*

* Each time FORWARD button (⏮) is pressed, the set time increases by 10 minutes: each time BACKWARD button (⏭) is pressed, the set time decreases by 10 minutes.


2. To release the timer

To release ON timer, press ON TIMER button (⏻).
 To release OFF timer, press OFF TIMER button(⏻).
 TIMER is cancelled and the display of set time disappears.


PROGRAM TIMER

- OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.
- "🕒" and "🕒" display shows the order of OFF timer and ON timer operation.

(Example 1) The current time is 8:00 PM.
 The unit turns off at 11:00 PM, and on at 6:00 AM.

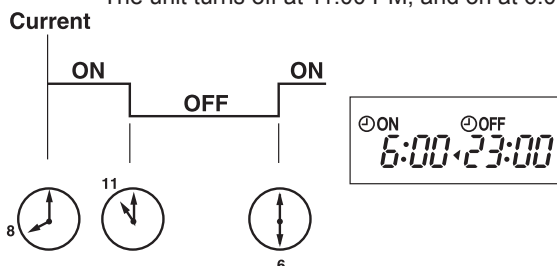


(Example 2) The current time is 11:00 AM.
 The unit turns on at 5:00 PM, and off at 9:00 PM.

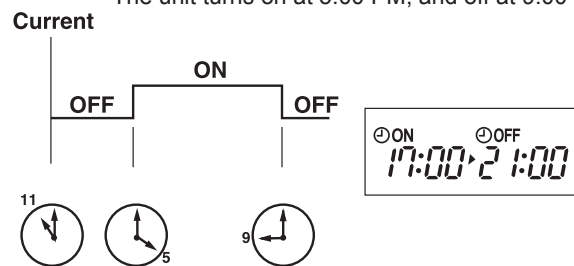

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

h. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

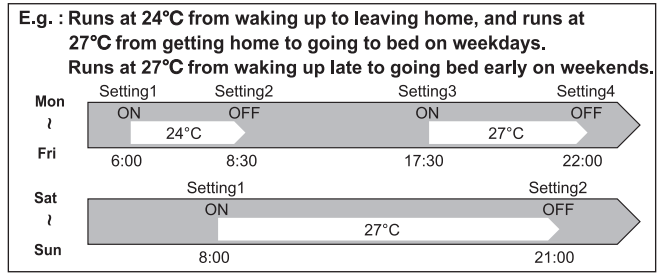


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature cannot be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting day and number.

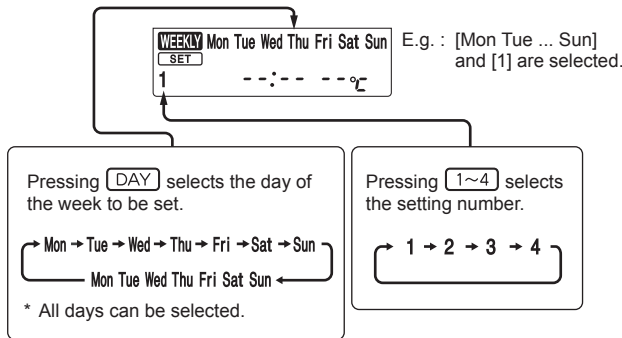


(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

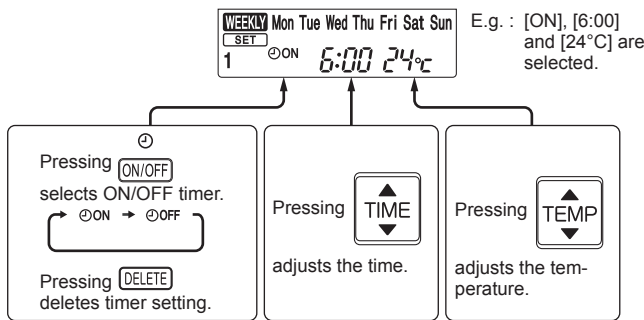


- * Hold down the button to change the time quickly.
- * The temperature can be set between 16 °C and 31 °C at weekly timer.






Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.



- (4) Press  button to complete and transmit the weekly timer setting.





*  which was blinking goes out, and the current time will be displayed.

NOTE:

- Press  button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number,  button does not have to be pressed per each setting. Press  button once after all the settings are complete. All the weekly timer settings will be saved.
- Press  button to enter the weekly timer setting mode, and press and hold  button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

- (5) Press  button to turn the weekly timer ON. ( lights.)


• When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press  button again to turn the weekly timer OFF. ( goes out.)




NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

- (1) Press  button to enter the weekly timer setting mode.

*  blinks.

- (2) Press  or  buttons to view the setting of the particular day or number.
- (3) Press  button to exit the weekly timer setting.

i. i-save OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE (OFF/ON) button.
- (2) Select COOL or HEAT mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, airflow direction, and 2 FLOW/1 FLOW for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY, FAN or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.

2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode. The same setting is selected from the next time by simply pressing i-save button.

j. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or when the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up. The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work. In COOL MODE, the air outlet selection is set to 2 FLOW during the test run operation.

After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Medium.

The coil frost prevention works even in the test run or the emergency operation.



In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case, normal operation will start.

NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Medium
Horizontal vane	Auto
Air outlet	2 FLOW

The operation mode is indicated by the Operation Indicator lamp as following

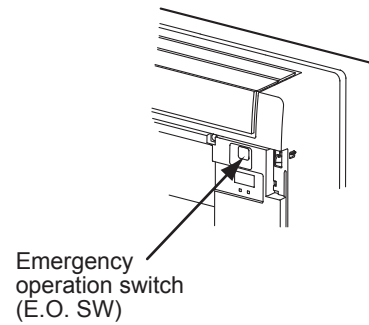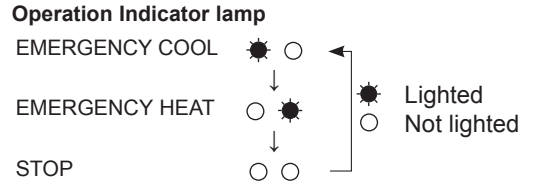

k. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.


I. ACTUATOR CONTROL

I-1. Outdoor fan motor control

The fan motor turns ON/OFF, interlocking with the compressor.

[ON] The fan motor turns ON 5 seconds before the compressor starts up.


[OFF] The fan motor turns OFF 15 seconds after the compressor has stopped running.

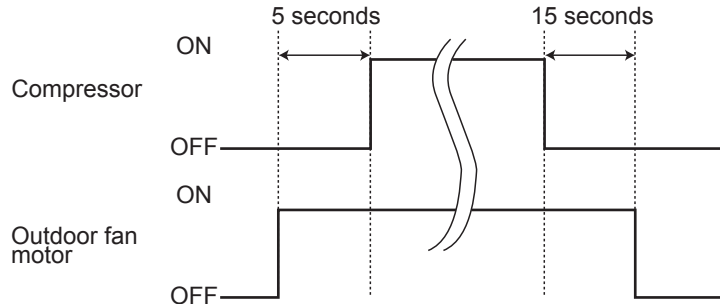

I-2. R.V. Coil control

- Heating ON
- Cooling OFF
- Dry OFF



NOTE: The 4-way valve reverses for 5 seconds right before start-up of the compressor.

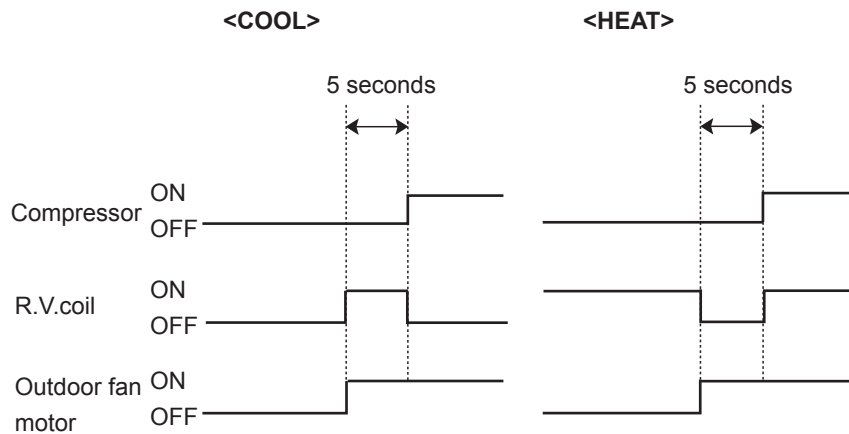

I-3. Relation between main sensor and actuator

Sensor	Purpose	Actuator					
		Compressor	LEV	Outdoor fan motor	R.V.coil	Indoor fan motor	Defrost heater
Discharge temperature thermistor	Protection	○	○				
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○					
	Heating: High pressure protection	○	○				
Defrost thermistor	Heating: Defrosting	○	○	○	○	○	
Fin temperature thermistor	Protection	○		○			
Ambient temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Heating: Defrosting (Heater)						○
Outdoor heat exchanger temperature thermistor	Cooling: Low ambient temperature operation	○	○	○			
	Cooling: High pressure protection	○	○	○			

C.2.10 CAPACITY CORRECTION RATIO CURVE FOR PIPING LENGTH

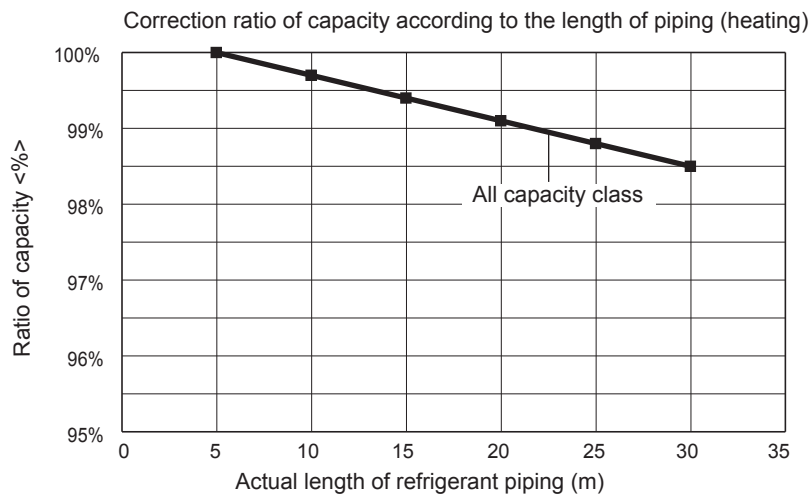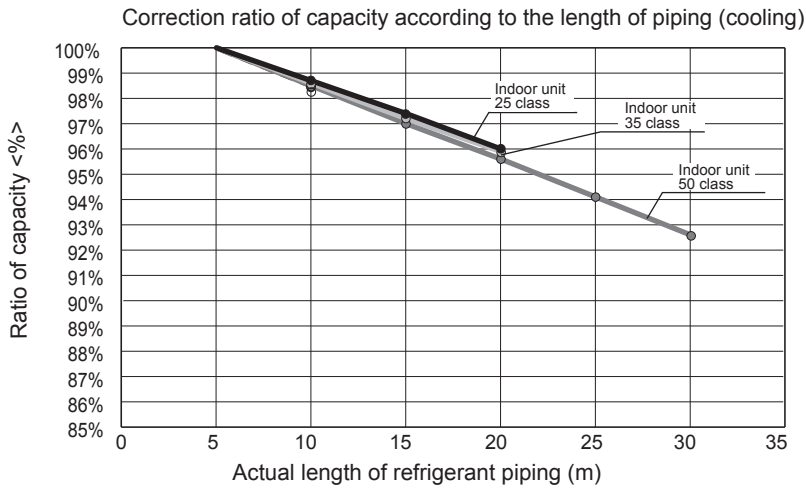

The length intended for the capacity calculation, which counts the length of refrigerant piping and the number of bends, is called actual length.

$$\text{Length of refrigerant piping (m)} + (\text{Number of bends} \times 0.3 \text{ m}) = \text{Actual length of refrigerant piping (m)}$$

CAPACITY CORRECTION RATIO CURVE PIPING LENGTH FLOOR-STANDING

C.3 CEILING CASSETTE

C.3.1	SPECIFICATIONS	C-426
	C.3.1.1 Inverter Heat Pump	C-426
C.3.2	OUTLINES AND DIMENSIONS.....	C-427
	C.3.2.1 Indoor Unit.....	C-427
C.3.3	WIRING DIAGRAM.....	C-428
	C.3.3.1 Indoor Unit.....	C-428
C.3.4	REFRIGERANT SYSTEM DIAGRAM	C-429
	C.3.4.1 Inverter Heat Pump	C-429
C.3.5	NOISE CRITERIA CURVES	C-430
	C.3.5.1 Inverter Heat Pump	C-430
C.3.6	TEMPERATURE AND AIR FLOW DISTRIBUTIONS.....	C-431
C.3.7	OPERATION	C-434
	C.3.7.1 MLZ-KP • VF Series	C-434

C.3.1 SPECIFICATIONS

C.3.1.1 Inverter Heat Pump

Indoor Unit				MLZ-KP25VF	MLZ-KP35VF	MLZ-KP50VF		
Outdoor Unit				for MXZ connection	for MXZ connection	for MXZ connection		
Refrigerant				R32 / R410A	R32 / R410A	R32 / R410A		
Power Supply				Outdoor Power supply	Outdoor Power supply	Outdoor Power supply		
Source				230V/SinglePhase/50Hz	230V/SinglePhase/50Hz	230V/SinglePhase/50Hz		
Cooling	Capacity	Rated	kW	2.5	3.5	5.0		
		Min-Max.	kW	-	-	-		
	SHF			-	-	-		
	Total Input	Rated	kW	-	-	-		
		EER			-	-	-	
	EEL Rank				-	-		
	Design load			kW	-	-		
	Annual electricity consumption (*2)			kWh/a	-	-		
	SEER				-	-		
	Energy efficiency class				-	-		
Heating (Average Season)	Capacity	Rated	kW	-	-	-		
		Min-Max.	kW	-	-	-		
	Total Input	Rated	kW	-	-	-		
		COP			-	-	-	
	EEL Rank				-	-		
	Design load			kW	-	-		
	Declared Capacity	at reference design temperature		kW	-	-	-	
		at bivalent temperature		kW	-	-	-	
		at operation limit temperature		kW	-	-	-	
	Back up heating capacity			kW	-	-		
Annual electricity consumption (*2)			kWh/a	-	-			
SCOP				-	-			
Energy efficiency class				-	-			
Operating Current (Max.)			A	0.4	0.4	0.4		
Indoor Unit	Input	Rated	kW	0.040	0.040	0.040		
	Operating Current (Max.)			A	-	-		
	Dimensions			H x W x D	mm	185 x 1102 x 360	185 x 1102 x 360	185 x 1102 x 360
	Weight			kg	15.5	15.5	15.5	
	Air Volume (SLo-Lo-Mid-Hi-SHi (*3) (Dry))	Cooling	m ³ /min.		6.0 - 7.2 - 8.0 - 8.8	6.0 - 7.3 - 8.4 - 9.4	6.0 - 8.3 - 9.8 - 11.4	
		Heating	m ³ /min.		6.0 - 7.0 - 8.2 - 9.2	6.0 - 7.7 - 8.8 - 9.9	6.0 - 8.8 - 10.3 - 11.8	
	Sound Level (SPL) (SLo-Lo-Mid-Hi-SHi (*3))	Cooling	dB(A)		27 - 31 - 34 - 38	27 - 32 - 36 - 40	29 - 36 - 41 - 47	
		Heating	dB(A)		26 - 29 - 34 - 37	26 - 32 - 36 - 40	26 - 37 - 42 - 48	
Sound Level (PWL)	Cooling	dB(A)		52	53	59		
Outdoor Unit	Dimensions			H x W x D	mm	-	-	-
	Weight			kg	-	-	-	
	Air Volume	Cooling	m ³ /min.		-	-	-	
		Heating	m ³ /min.		-	-	-	
	Sound Level (SPL)	Cooling	dB(A)		-	-	-	
		Heating	dB(A)		-	-	-	
	Sound Level (PWL)	Cooling	dB(A)		-	-	-	
	Operating Current (Max.)			A	-	-	-	
Breaker Size			A	-	-	-		
Ext.Piping	Diameter	Liquid/Gas	mm	6.35/9.52	6.35/9.52	6.35/12.7		
	Max.Length	Out-In	m	-	-	-		
	Max.Height	Out-In	m	-	-	-		
Guaranteed Operating Range (Outdoor)	Cooling		°C	-	-	-		
	Heating		°C	-	-	-		

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) SHi: Super High.

C.3.2 OUTLINES AND DIMENSIONS


C.3.2.1 Indoor Unit

MLZ-KP25VF MLZ-KP35VF MLZ-KP50VF


Unit: mm

INDOOR UNIT

INDOOR UNIT OUTLINE DRAWING

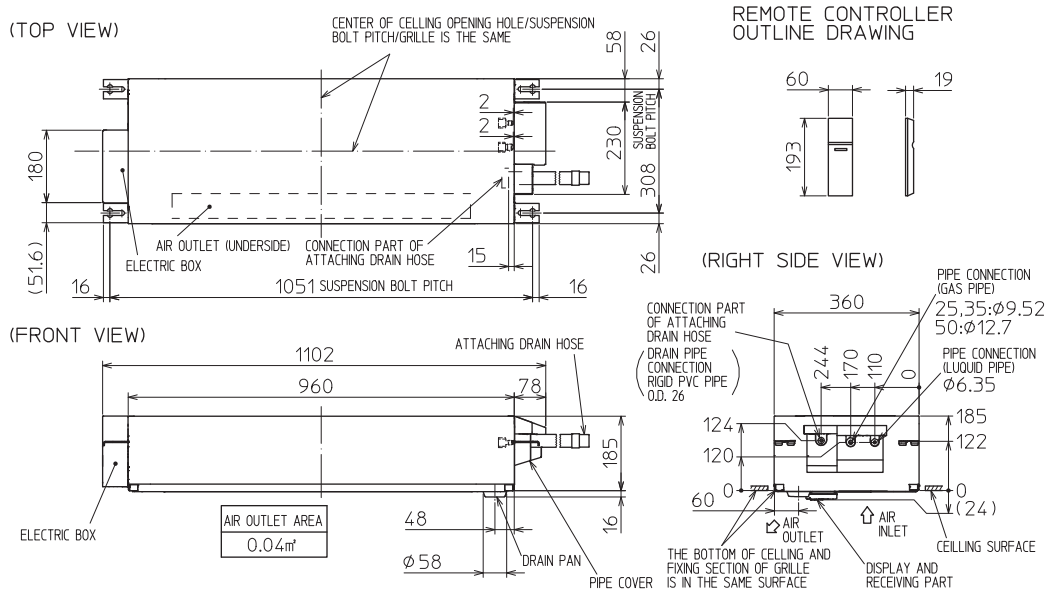


GRILLE OUTLINE DRAWING (MLP-444W)

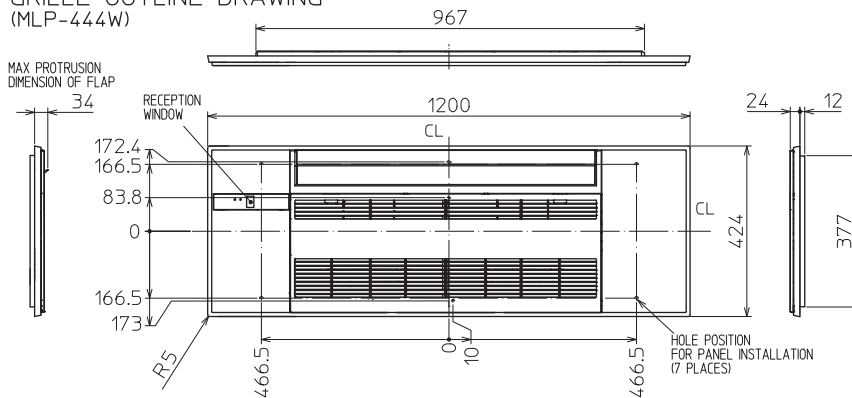


		KP25/35VF	KP50VF
EXTENSION PIPE	LIQUID PIPE O.D.	ø6.35	
	GAS PIPE O.D.	ø9.52	ø12.7
CONNECTION OF PIPE	LIQUID PIPE	FLARED CONNECTION ø6.35	
	GAS PIPE	FLARED CONNECTION ø9.52	FLARED CONNECTION ø12.7
DRAIN HOSE	HEAT INSULATOR O.D.	CONNECTION I.D.	EFFECTIVE LENGTH
DRAIN PIPE CONNECTION	ø32	ø25	480
		RIGID PVC PIPE O.D. 26	

NOTE1. CUT THE DRAIN HOSE (ACCESSORY) FOR USE, IF NECESSARY.

INDOOR UNIT DETAIL VIEW (TOP VIEW)

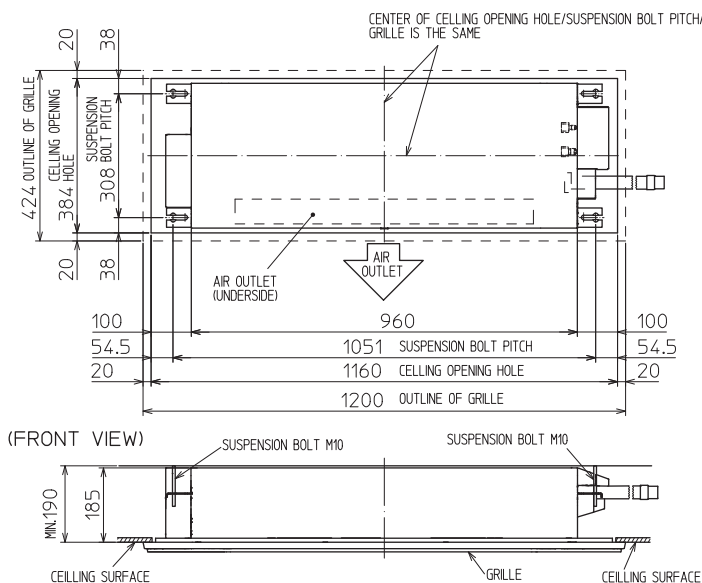

THE METHOD FOR STANDING DRAIN FROM INDOOR UNIT
※ CUT THE DRAIN HOSE (ACCESSORY) FOR USE, IF NECESSARY.

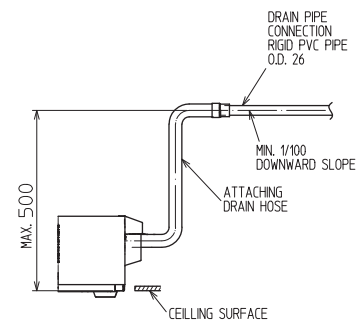

CEILING CASSETTE OUTLINES AND DIMENSIONS


C.3.3 WIRING DIAGRAM

C.3.3.1 Indoor Unit

MLZ-KP25VF

MLZ-KP35VF


INDOOR UNIT

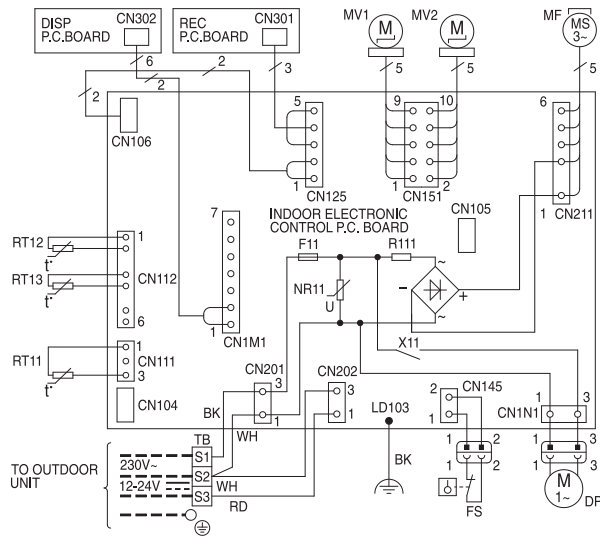

SYMBOL	NAME	SYMBOL	NAME
MF	FAN MOTOR	RT11	ROOM TEMP. THERMISTOR
MV1	HORIZONTAL VANE MOTOR	RT12	COIL TEMP. THERMISTOR(MAIN)
MV2	VERTICAL VANE MOTOR	RT13	COIL TEMP. THERMISTOR(SUB)
DP	DRAIN PUMP	NR11	VARIATOR
FS	FLOAT SENSOR	R111	RESISTOR
F11	FUSE (T3.15AL250V)		
X11	RELAY		
TB	TERMINAL BLOCK		


NOTES :

- About the outdoor side electric wiring refer to the outdoor unit electric wiring diagram for servicing.
- Use copper conductors only.
- Symbols below indicate.



MLZ-KP50VF


INDOOR UNIT

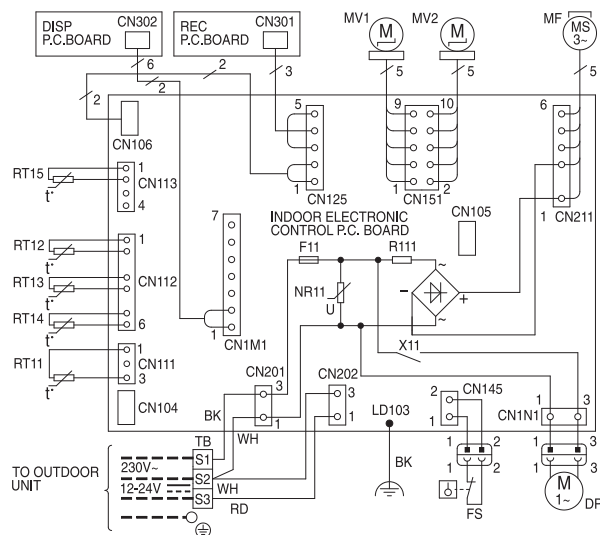

SYMBOL	NAME	SYMBOL	NAME
MF	FAN MOTOR	RT11	ROOM TEMP. THERMISTOR
MV1	HORIZONTAL VANE MOTOR	RT12	COIL TEMP. THERMISTOR(MAIN1)
MV2	VERTICAL VANE MOTOR	RT13	COIL TEMP. THERMISTOR(SUB)
DP	DRAIN PUMP	RT14	COIL TEMP. THERMISTOR(MAIN2)
FS	FLOAT SENSOR	RT15	COIL TEMP. THERMISTOR(MAIN3)
F11	FUSE (T3.15AL250V)	NR11	VARIATOR
X11	RELAY	R111	RESISTOR
TB	TERMINAL BLOCK		

NOTES :

- About the outdoor side electric wiring refer to the outdoor unit electric wiring diagram for servicing.
- Use copper conductors only.
- Symbols below indicate.



C.3.4 REFRIGERANT SYSTEM DIAGRAM


C.3.4.1 Inverter Heat Pump

Unit: mm

MLZ-KP25VF

MLZ-KP35VF

INDOOR UNIT

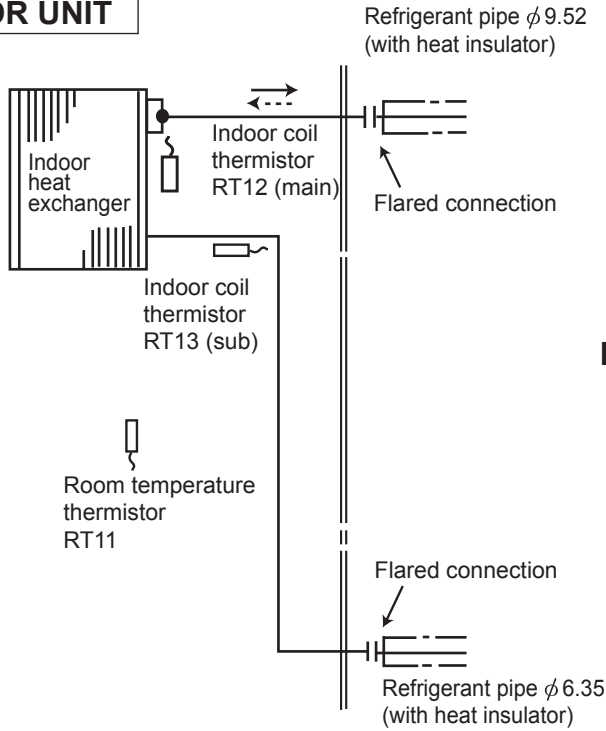


For MXZ connection

→ Refrigerant flow in cooling
 ····· Refrigerant flow in heating

MLZ-KP50VF

INDOOR UNIT

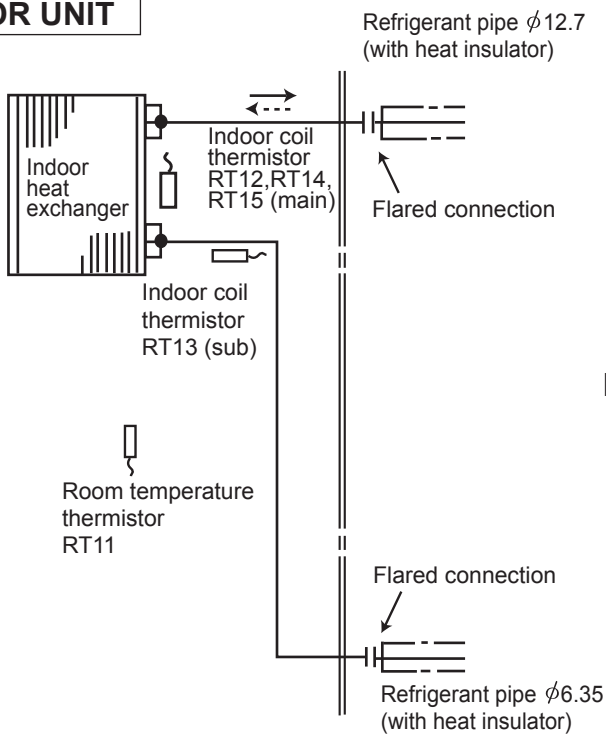

For MXZ connection


→ Refrigerant flow in cooling
 ····· Refrigerant flow in heating

C.3.5 NOISE CRITERIA CURVES

C.3.5.1 Inverter Heat Pump


MLZ-KP25VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	COOLING	38	●—●
	HEATING	37	○—○

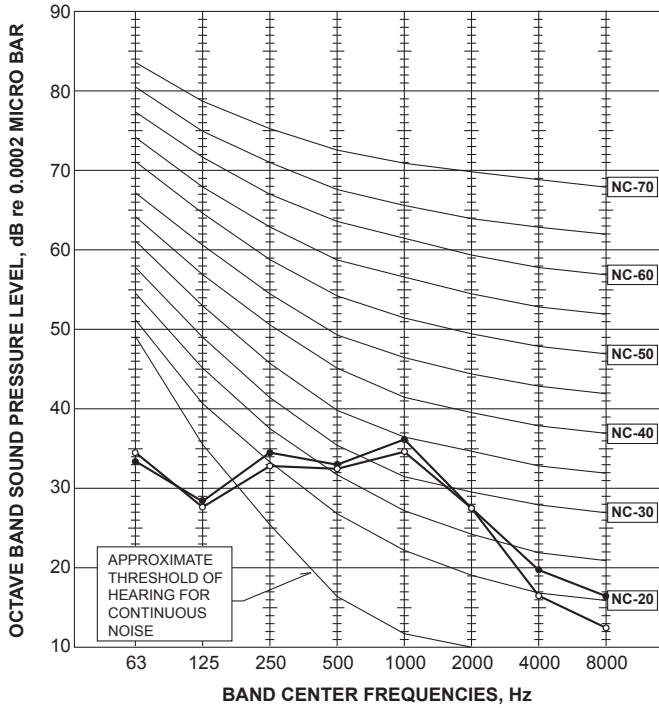


MLZ-KP35VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	COOLING	40	●—●
	HEATING	40	○—○

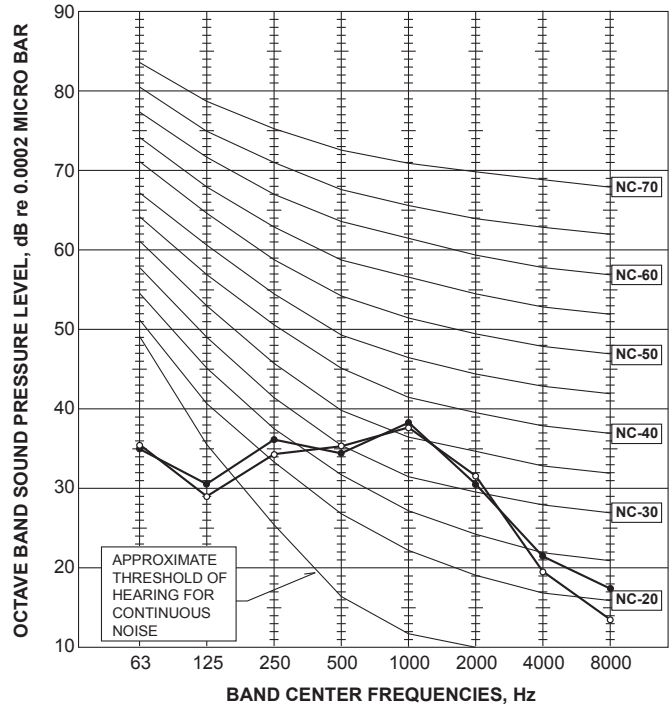


MLZ-KP50VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	COOLING	47	●—●
	HEATING	48	○—○

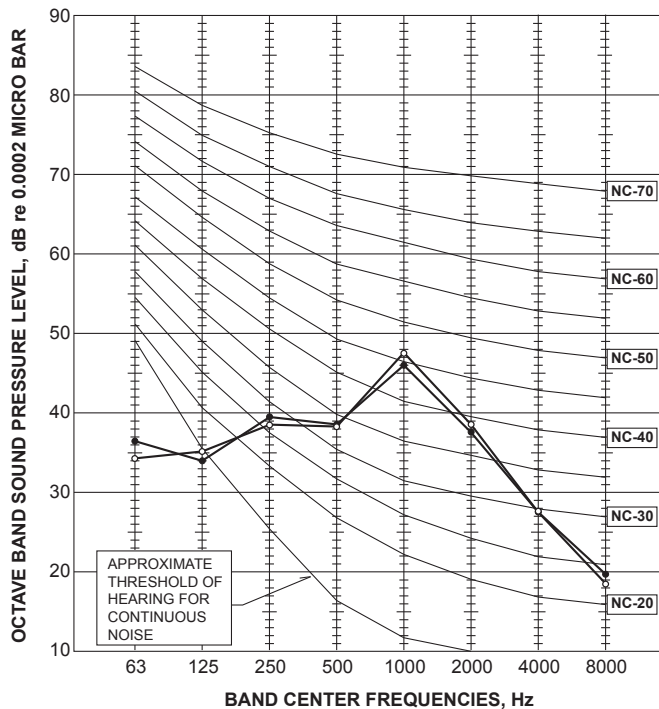

Test conditions

Cooling : Dry-bulb temperature 27 °C Wet-bulb temperature 19 °C
 Heating : Dry-bulb temperature 20 °C

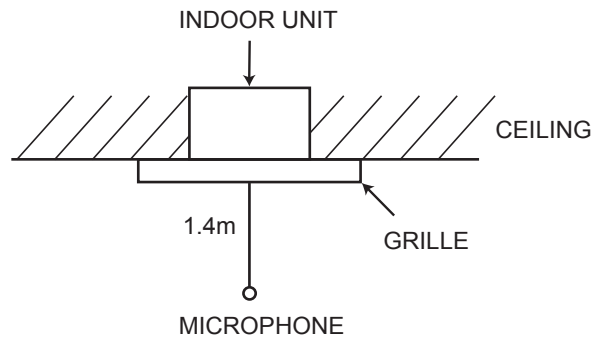

NOISE CRITERIA CURVES CEILING CASSETTE


C.3.6 TEMPERATURE AND AIR FLOW DISTRIBUTIONS

MLZ-KP25VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

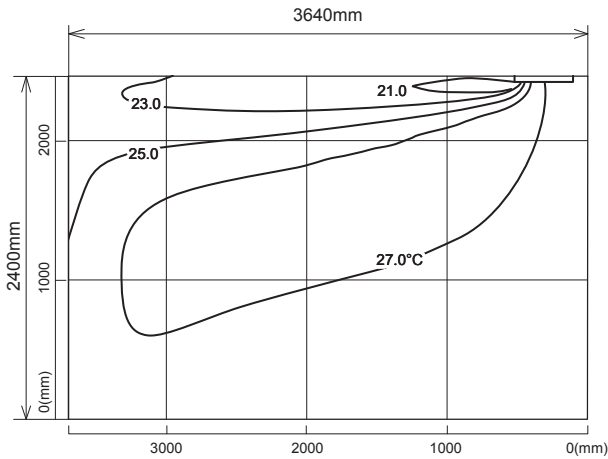

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

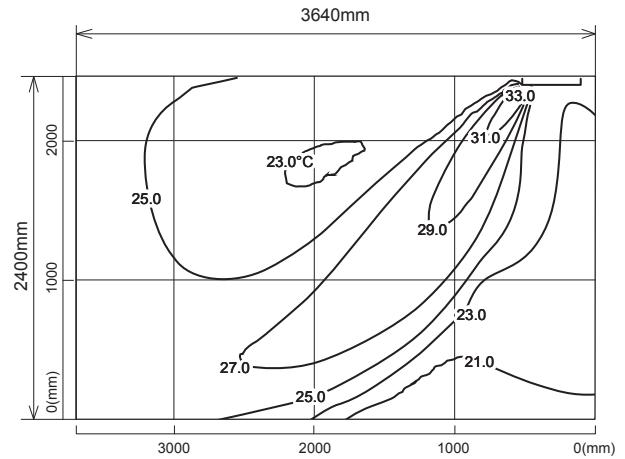

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

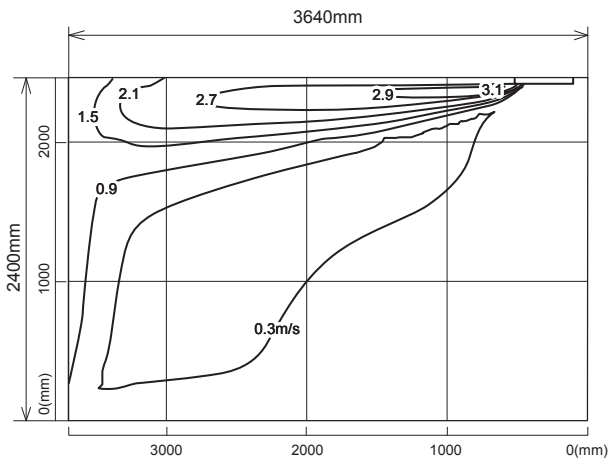

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

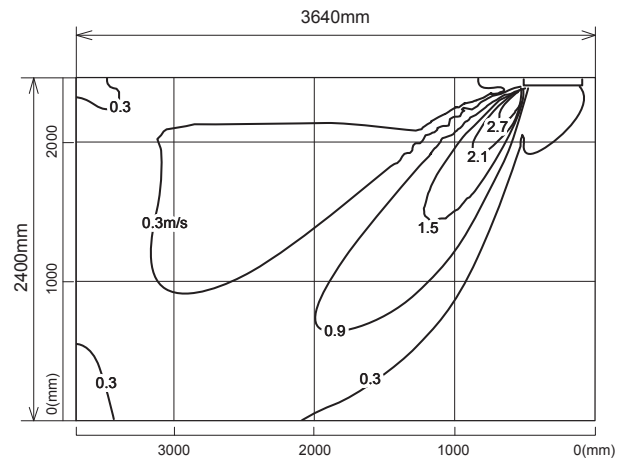


Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

MLZ-KP35VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

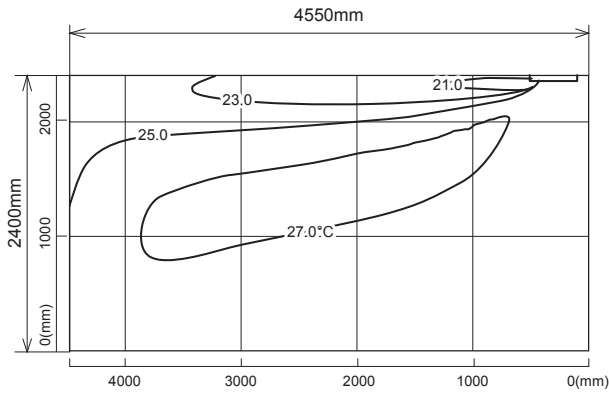

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

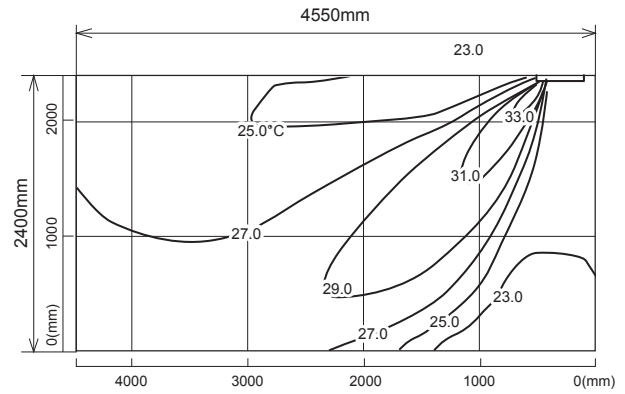

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

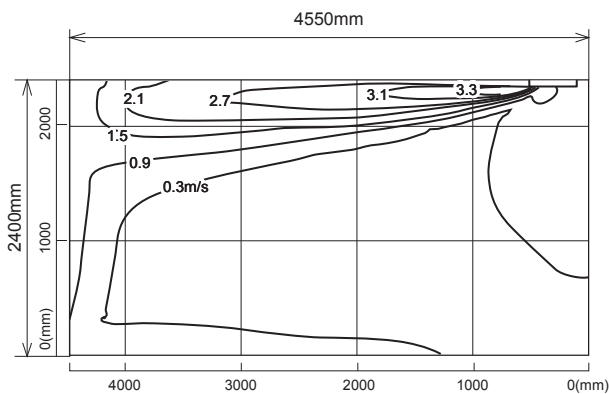

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

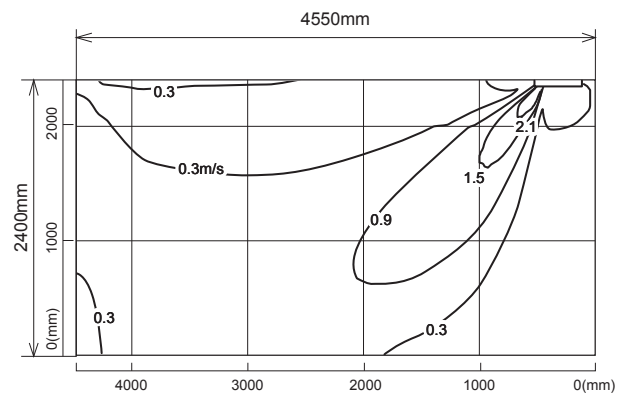

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.


TEMPERATURE AND AIR FLOW DISTRIBUTIONS CEILING CASSETTE

MLZ-KP50VF

Temperature distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

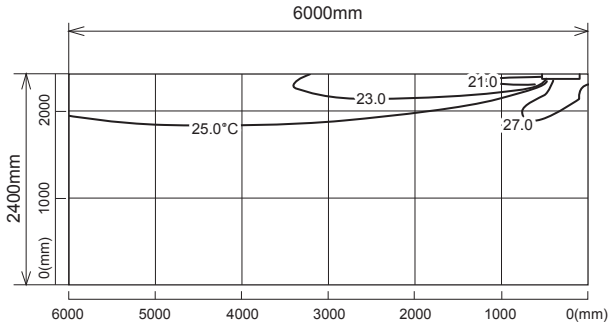

<Heating mode>


Air volume: high
Air direction: auto (downward air flow)

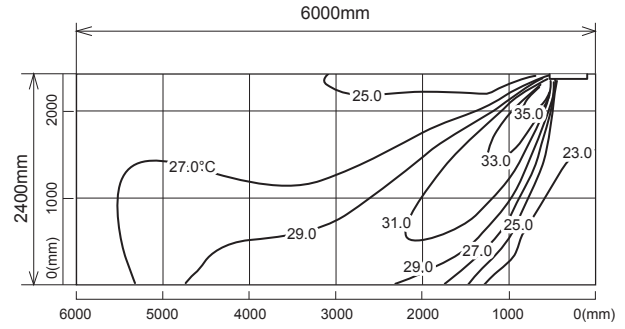

Airflow distribution


<Cooling mode>

Air volume: high
Air direction: auto (upward air flow)

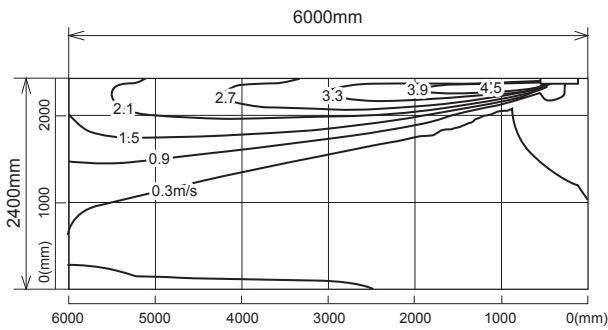

<Heating mode>

Air volume: high
Air direction: auto (downward air flow)

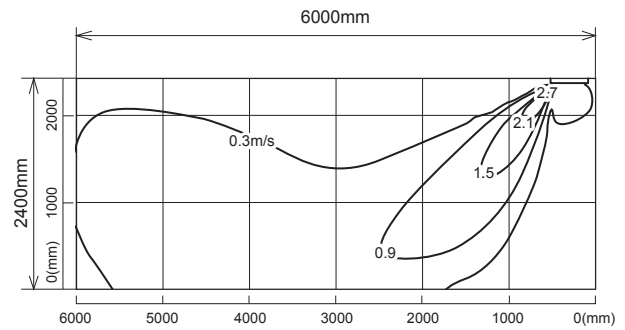

Note : These figures show typical airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

CEILING CASSETTE TEMPERATURE AND AIR FLOW DISTRIBUTIONS

C.3.7 OPERATION


C.3.7.1 MLZ-KP·VF Series

MLZ-KP25VF

MLZ-KP35VF

MLZ-KP50VF

WIRELESS REMOTE CONTROLLER

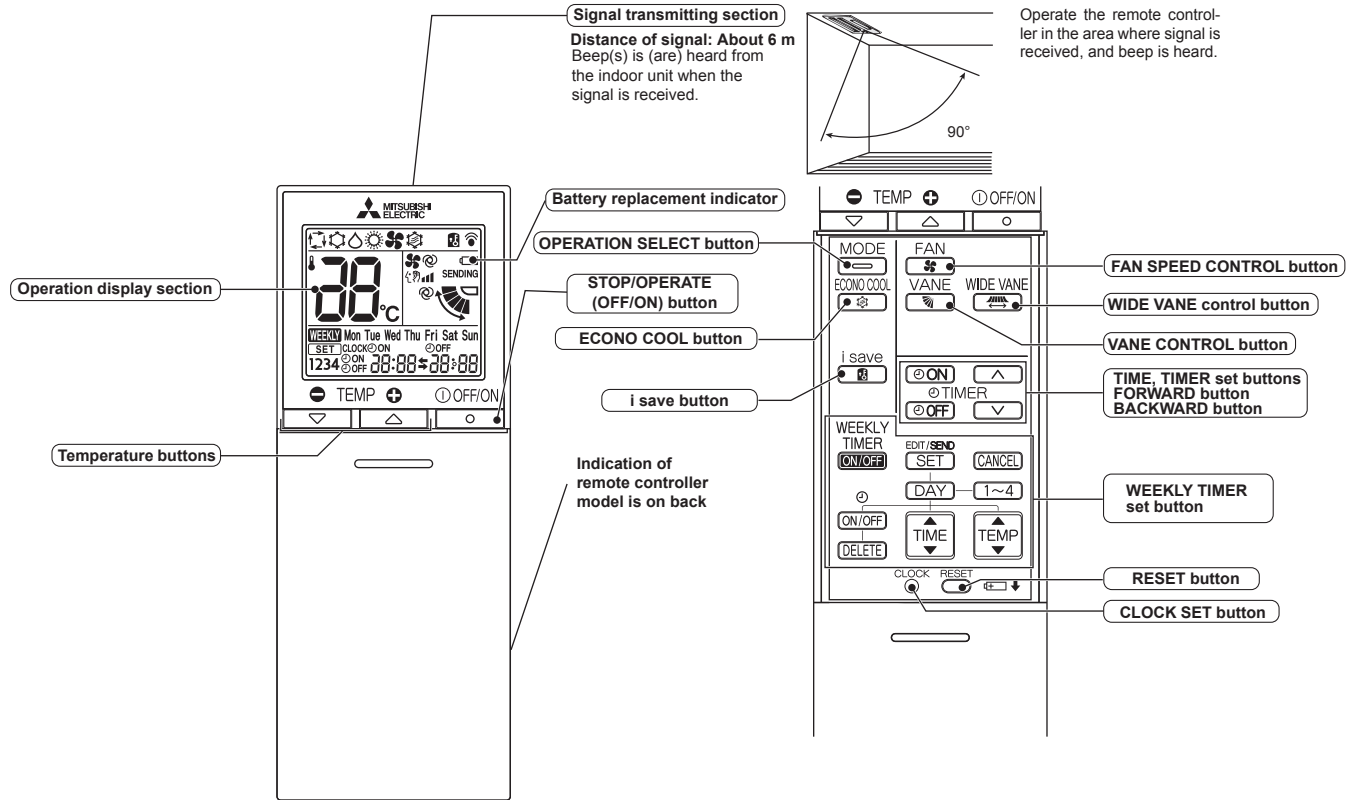

NOTE: Last setting will be stored after the unit is turned OFF with the remote controller. Indoor unit receives the signal of the remote controller with beeps.

INDOOR UNIT DISPLAY SECTION

Operation Indicator lamp

The operation indicator at the right side of the indoor unit indicates the operation state.

•The following indication applies regardless of shape of the indication.

Indication	Operation state	Room temperature
● ●	The unit is operating to reach the set temperature	About 2°C or more away from set temperature
● ○	The room temperature is approaching the set temperature	About 1 to 2°C from set temperature
● ☉	Standby mode (Refer to multi system operation)	—

- Lit
- ☉ Blinking
- Not lit

a. COOL (❄️) OPERATION

- (1) Press STOP/OPERATE(OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select COOL mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 16 - 31°C.

1. Coil frost prevention

The compressor operational frequency is controlled by the temperature of the indoor heat exchanger to prevent the coil from frosting.

When the temperature of indoor heat exchanger becomes too low, the coil frost prevention mode works.

The indoor fan operates at the set speed and the compressor stops. This mode continues until the temperature of indoor heat exchanger rises.

b. DRY (☀️) OPERATION

- (1) Press STOP/OPERATE(OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select DRY mode with OPERATION SELECT button.
- (3) The set temperature is determined from the initial room temperature.

1. Coil frost prevention

Coil frost prevention works the same way as that in COOL mode. (a.1.)

c. FAN (🌀) OPERATION

- (1) OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select FAN mode with OPERATION SELECT button.
- (3) Select the desired fan speed. When AUTO, it becomes Low.
Only indoor fan operates.
Outdoor unit does not operate.

d. HEAT (🔥) OPERATION

- (1) Press STOP/OPERATE(OFF/ON) button.
OPERATION INDICATOR lamp of the indoor unit turns on with a beep tone.
- (2) Select HEAT mode with OPERATION SELECT button.
- (3) Press TEMPERATURE buttons TEMP \ominus or \oplus button to select the desired temperature. The setting range is 10°C and 16 - 31°C.

1. Cold air prevention control

When the compressor is not operating or is starting, and the temperature of indoor heat exchanger and/or the room temperature is low or when defrosting is being done, the indoor fan will stop or rotate in Very Low speed.

2. Defrosting

Defrosting starts when the temperature of outdoor heat exchanger becomes too low.

The compressor stops once, the indoor/outdoor fans stop, the 4-way valve reverses, and the compressor re-starts.

This mode continues until the temperature of outdoor heat exchanger rises or the fixed time passes.

e. AUTO CHANGE OVER ... AUTO MODE OPERATION

Once desired temperature is set, unit operation is switched automatically between COOL and HEAT operation.

Mode selection**(1) Initial mode**

When unit starts the operation with AUTO operation from OFF:

- If the room temperature is higher than the set temperature, operation starts in COOL mode.
- If the room temperature is equal to or lower than the set temperature, operation starts in HEAT mode.

(2) Mode change

COOL mode changes to HEAT mode when about 15 minutes have passed with the room temperature 2°C below the set temperature.

HEAT mode changes to COOL mode when about 15 minutes have passed with the room temperature 2°C above the set temperature.

NOTE 1

If 2 or more indoor units are operating in multi system, there might be a case that the indoor unit, which is operating in □ (AUTO), cannot change over to the other operating mode (COOL ↔ HEAT) and becomes a state of standby.

Refer to **NOTE 2 "FOR MULTI SYSTEM AIR CONDITIONER"**.

NOTE 2


FOR MULTI SYSTEM AIR CONDITIONER

OUTDOOR UNIT: MXZ series

Multi system air conditioner can connect 2 or more indoor units with one outdoor unit.

- When you try to operate 2 or more indoor units with one outdoor unit simultaneously, one for the cooling and the others for heating, the operation mode of the indoor unit that operates first is selected. Other indoor units cannot operate, and operation indicator lamp flashes as shown in the figure below. In this case, please set all the indoor units to the same operation mode.

OPERATION INDICATOR



- When indoor unit starts the operation while the defrosting of outdoor unit is being done, it takes a few minutes (max. 10 minutes) to blow out the warm air.
- In the heating operation, though indoor unit that does not operate may get warm or the sound of refrigerant flowing may be heard, they are not malfunction. The reason is that the refrigerant continuously flows into it.


f. AUTO VANE OPERATION

1. Horizontal vane

(1) Vane motor drive

These models are equipped with a stepping motor for the horizontal vane. The rotating direction, speed, and angle of the motor are controlled by pulse signals (approximately 12 V) transmitted from indoor microprocessor.

(2) The horizontal vane angle and mode change as follows by pressing VANE CONTROL button.



NOTE:

The setting when the lower airflow is preferred in the Airflow direction (1)

The angle of airflow direction (1) can be slightly lowered by changing SWV1 to normal when the lower airflow is preferred or the airflow causes the dirt on the ceiling.

Factory setting is up.

(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane is set to the selected angle.

Confirming of standard position is performed in the following cases:


- (a) When the power supply turns on.
- (b) When the operation starts or finishes (including timer operation).
- (c) When the test run starts.
- (d) When multi-standby starts or finishes.
- (e) When the swing operation finishes.

(4) VANE AUTO (@) mode

In VANE AUTO mode, the microprocessor automatically determines the vane angle and operation to make the optimum room-temperature distribution.

(1) In COOL and DRY operation Vane angle is fixed to Angle 1.

(2) In HEAT operation Vane angle is fixed to Angle 4.

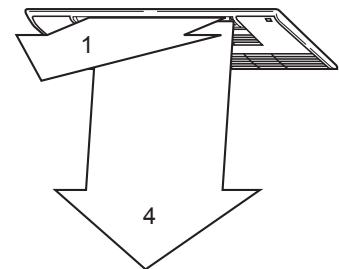

(5) STOP (operation OFF) and ON TIMER standby

In the following cases, the horizontal vane returns to the closed position.

- (a) When STOP/OPERATE(OFF/ON) button is pressed (POWER OFF).
- (b) When the operation is stopped by the emergency operation.
- (c) When ON TIMER is ON standby.


(6) SWING () mode

By selecting SWING mode with VANE CONTROL button, the horizontal vanes swing vertically.

When COOL, DRY or FAN mode is selected, only the upper vane swings.

(7) Cold air prevention in HEAT operation

The horizontal vane position is set to upward.

(8) ECONO COOL () operation (ECONOMical operation)

When ECONO COOL button is pressed in COOL mode, set temperature is automatically set 2°C higher by microprocessor. However, the temperature on the LCD screen on the remote controller is not changed.

Also the horizontal vane swings in various cycle.

SWING operation makes you feel cooler than set temperature. So, even though the set temperature is higher, the air conditioner can keep comfort. As a result, energy can be saved.

To cancel this operation, select a different mode or press one of the following buttons in ECONO COOL operation: ECONO COOL, WIDE VANE CONTROL or VANE CONTROL button.

2. Vertical vane

(1) Press WIDE VANE button to change horizontal airflow direction.

- The vertical vane moves for about 30 seconds.

(After 30 seconds, the vertical vane moves to its original position. In this case, press WIDE VANE button again.)

(2) Press WIDE VANE button again to set horizontal airflow direction.

- The vertical vane stops and the airflow direction is set.

(3) Positioning

To confirm the standard position, the vane moves until it touches the vane stopper. Then the vane set to the desired angle.

Confirming of standard position is performed in the following cases:

- When STOP/OPERATE(OFF/ON) button is pressed (POWER ON).
- When SWING is started.

g. DRAIN PUMP/ FLOAT SENSOR CONTROL**1. Drain pump**

Operating condition:


- During COOL, DRY, or emergency COOL operation
- When float sensor detects water level above fixed point during:
 - HEAT operation.
 - emergency HEAT operation.
 - standby when during multi system operation.
 - standby when ON timer is set.
 - operation STOP.

Drain pump operates in conditions 1 or 2.

2. Float sensor

Float moves with the up and down of water surface inside the drain pan, and judges water level.

(Fixed point differs at raised and lowered water levels.)

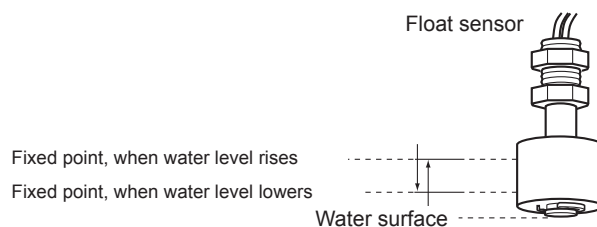

h. TIMER OPERATION

1. How to set the time

(1) Check that the current time is set correctly.

NOTE: Timer operation will not work without setting the current time. Initially “0:00” blinks at the current time display of TIME MONITOR, so set the current time correctly with CLOCK SET button.

How to set the current time

(a) Press the CLOCK set button.

(b) Press the TIME SET buttons (▲) and (▼) to set the current time.

- Each time FORWARD button (▲) is pressed, the set time increases by 1 minute, and each time BACKWARD button (▼) is pressed, the set time decreases by 1 minute.
- Pressing those buttons longer, the set time increases/decreases by 10 minutes.

(c) Press the CLOCK set button.

(2) Press STOP/OPERATE(OFF/ON) button to start the air conditioner.

(3) Set the time of timer.

ON timer setting

(a) Press ON TIMER button (ⓄON) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).*

OFF timer setting

(a) Press OFF TIMER button (ⓄOFF) during operation.

(b) Set the time of the timer using TIME SET buttons (▲) and (▼).*

* Each time FORWARD button (▲) is pressed, the set time increases by 10 minutes: each time BACKWARD button (▼) is pressed, the set time decreases by 10 minutes.

2. To release the timer

To release ON timer, press ON TIMER button (ⓄON).

To release OFF timer, press OFF TIMER button (ⓄOFF).

TIMER is cancelled and the display of set time disappears.

PROGRAM TIMER

• OFF timer and ON timer can be used in combination. The set time that is reached first will operate first.



• “←” and “→” display shows the order of OFF timer and ON timer operation.

(Example 1) The current time is 8:00 PM.

The unit turns off at 11:00 PM, and on at 6:00 AM.

(Example 2) The current time is 11:00 AM.


The unit turns on at 5:00 PM, and off at 9:00 PM.

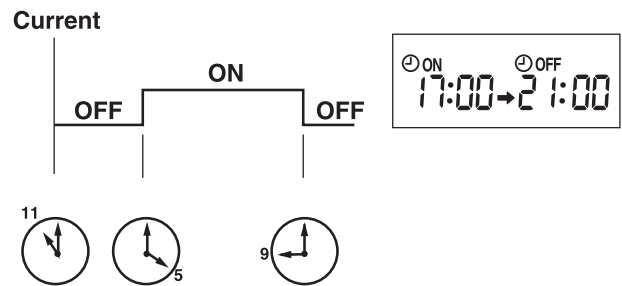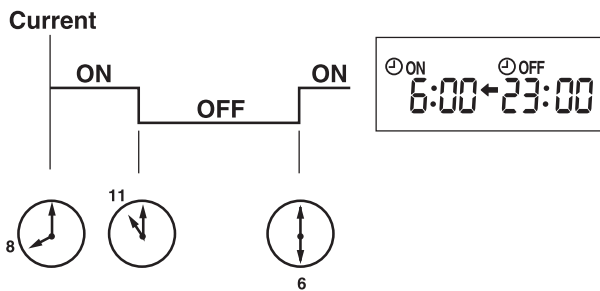

NOTE: If the main power is turned OFF or a power failure occurs while ON/OFF timer is active, the timer setting is cancelled. As these models are equipped with an auto restart function, the air conditioner starts operating with timer cancelled when power is restored.

i. WEEKLY TIMER OPERATION

- A maximum of 4 ON or OFF timers can be set for individual days of the week.
- A maximum of 28 ON or OFF timers can be set for a week.

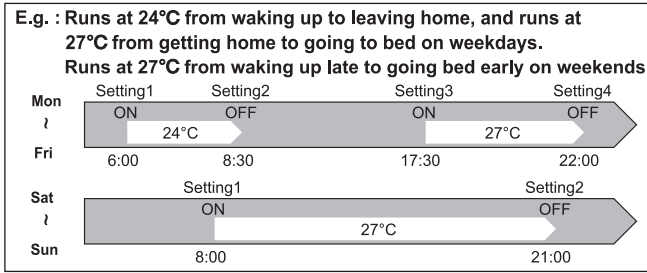


NOTE:

- The simple ON/OFF timer setting is available while the weekly timer is on. In this case, the ON/OFF timer has priority over the weekly timer; the weekly timer operation will start again after the simple ON/OFF timer is complete.
- When the weekly timer is set, temperature cannot be set to 10°C.
- The weekly timer operation and i-save operation cannot be used together.


1. How to set the weekly timer

* Make sure that the current time and day are set correctly.


(1) Press **EDIT/SEND** **SET** button to enter the weekly timer setting mode.



(2) Press **DAY** and **1~4** buttons to select setting days and/or numbers.

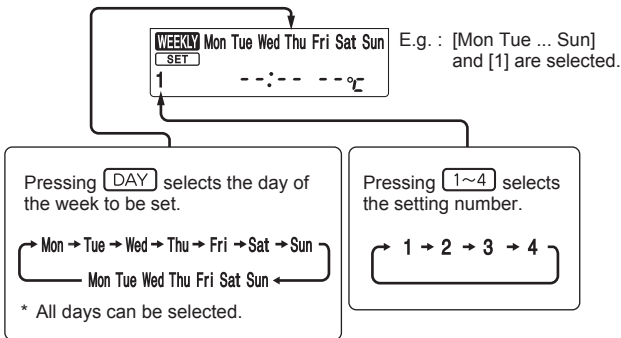


(3) Press **ON/OFF**, **TIME**, and **TEMP** buttons to set ON/OFF, time, and temperature.

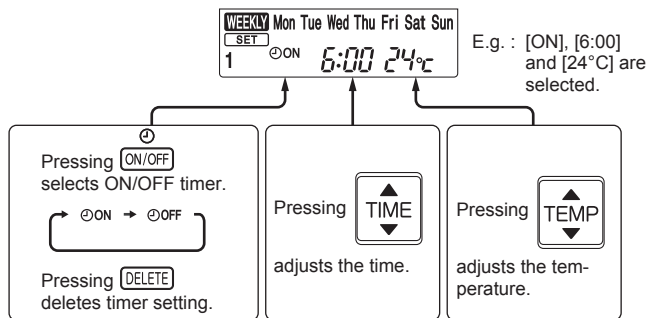


- * Hold down the button to change the time quickly.
- * The temperature can be set between 16°C and 31°C at weekly timer.






Press **DAY** and **1~4** buttons to continue setting the timer for other days and/or numbers.



(4) Press  button to complete and transmit the weekly timer setting.





*  which was blinking goes out, and the current time will be displayed.

NOTE:

- Press  button to transmit the setting information of weekly timer to the indoor unit. Point the remote controller toward the indoor unit for 3 seconds.
- When setting the timer for more than one day of the week or one number,  button does not have to be pressed per each setting. Press  button once after all the settings are complete. All the weekly timer settings will be saved.
- Press  button to enter the weekly timer setting mode, and press and hold  button for 5 seconds to erase all weekly timer settings. Point the remote controller toward the indoor unit.

(5) Press  button to turn the weekly timer ON. ()


•When the weekly timer is ON, the day of the week whose timer setting is complete, will light.

Press  button again to turn the weekly timer OFF. ()



NOTE:

The saved settings will not be cleared when the weekly timer is turned OFF.

2. Checking weekly timer setting

(1) Press  button to enter the weekly timer setting mode.

* blinks.

(2) Press  or  buttons to view the setting of the particular day or number.

(3) Press  button to exit the weekly timer setting.

j. i-save (i) OPERATION

1. How to set i-save operation

- (1) Press STOP/OPERATE(OFF/ON) button.
- (2) Select COOL or HEAT mode.
- (3) Press i-save button.
- (4) Set the temperature, fan speed, and airflow direction for i-save operation.

NOTE:

- i-save operation cannot be selected during DRY, FAN or AUTO mode operation.
- The setting range of HEAT mode i-save operation is 10°C and 16 - 31°C.
- 2 groups of setting can be saved. (One for COOL, one for HEAT)
- i-save operation and the weekly timer operation cannot be used together.

2. How to cancel operation

- Press i-save button again.
- i-save operation can also be cancelled by pressing OPERATION SELECT button to change the operation mode. The same setting is selected from the next time by simply pressing i-save button.

k. EMERGENCY/TEST OPERATION

In the case of test run operation or emergency operation, use EMERGENCY OPERATION switch on the right side of the indoor unit. Emergency operation is available when the remote controller is missing or has failed, or the batteries in the remote controller are running down. The unit will start and OPERATION INDICATOR lamp will light up.

The first 30 minutes of operation is the test run operation. This operation is for servicing. The indoor fan runs at High speed and the temperature control does not work.


After 30 minutes of test run operation, the system shifts to EMERGENCY COOL/HEAT MODE with a set temperature of 24°C. The fan speed shifts to Medium.

The coil frost prevention works even in the test run or the emergency operation.

In the test run or emergency operation, the horizontal vane operates in VANE AUTO (@) mode.

Emergency operation continues until EMERGENCY OPERATION switch is pressed once or twice or the unit receives any signal from the remote controller. In the latter case normal operation will start.


NOTE: Do not press EMERGENCY OPERATION switch during normal operation.

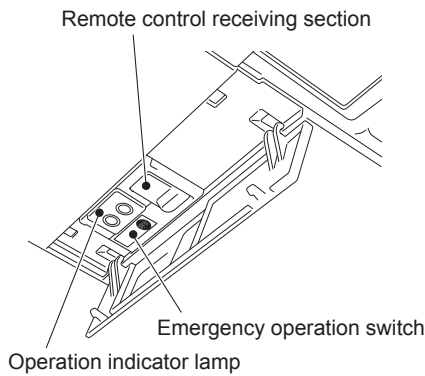

Operation mode	COOL/HEAT
Set temperature	24°C
Fan speed	Medium
Horizontal vane	Auto

The operation mode is indicated by the Operation Indicator lamp as following

Operation Indicator lamp

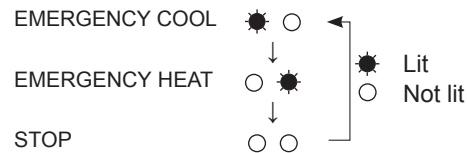

I. 3-MINUTE TIME DELAY OPERATION

When the system turns OFF, compressor will not restart for 3 minutes as 3-minute time delay function operates to protect compressor from overload.

C.4 MULTI SYSTEM

C.4.1	SPECIFICATIONS	C-444
	C.4.1.1 Inverter Heat Pump.....	C-444
C.4.2	OUTLINES AND DIMENSIONS	C-453
	C.4.2.1 Inverter Heat Pump.....	C-453
C.4.3	WIRING DIAGRAM.....	C-462
	C.4.3.1 Inverter Heat Pump.....	C-462
C.4.4	REFRIGERANT SYSTEM DIAGRAM	C-479
	C.4.4.1 Inverter Heat Pump.....	C-479
	C.4.4.2 Refrigerant Pipe Length and Pipe Size	C-487
C.4.5	PERFORMANCE CURVES	C-497
	C.4.5.1 Inverter Heat Pump.....	C-497
C.4.6	NOISE CRITERIA CURVES	C-574
	C.4.6.1 Inverter Heat Pump.....	C-574
C.4.7	ACTUATOR CONTROL	C-581
	C.4.7.1 MXZ Series	C-581
C.4.8	CAPACITY CORRECTION RATIO CURVE FOR PIPING LENGTH.....	C-582
	C.4.8.1 MXZ-2D/6D, MXZ-2E/3E/4E/5E, MXZ-2F/3F/4F, MXZ-2DM/3DM, MXZ-2HA/3HA	C-582

C.4.1 SPECIFICATIONS

C.4.1.1 Inverter Heat Pump

Indoor Unit				Please refer to ⁽⁴⁾				
Outdoor Unit				MXZ-2F33VF	MXZ-2F42VF	MXZ-2F53VF	MXZ-2F53VFH	
Refrigerant				R32 ⁽¹⁾				
Power Supply	Source			Outdoor power supply				
	Outdoor(V/Phase/Hz)			220-230-240V/Single/50Hz				
Cooling	Capacity	Rated	kW	3.3	4.2	5.3	5.3	
	Input	Rated	kW	0.85	0.98	1.40	1.40	
	Design load			kW	3.3	4.2	5.3	5.3
	Annual electricity consumption ⁽²⁾			kWh/a	188	169	215	215
	SEER ⁽⁴⁾				6.13	8.69	8.63	8.63
			Energy efficiency class ⁽⁴⁾	A++	A+++	A+++	A+++	
Heating	Capacity	Rated	kW	4.0	4.5	6.4	6.4	
	Input	Rated	kW	0.91	0.88	1.56	1.56	
	Design load			kW	2.7	3.2	3.2	3.2
	Declared Capacity	at reference design temperature		kW	2.20	2.70	2.70	2.70
		at bivalent temperature		kW	2.40	2.90	2.90	2.90
		at operation limit temperature		kW	1.80	2.30	2.30	2.10
	Back up heating capacity			kW	0.5	0.5	0.5	0.5
	Annual electricity consumption ⁽²⁾			kWh/a	908	974	973	998
	SCOP ⁽⁴⁾				4.16	4.60	4.60	4.49
			Energy efficiency class ⁽⁴⁾	A+	A++	A++	A+	
Max. Operating Current (Indoor+Outdoor)			A	10.0	12.2	12.2	12.2	
Outdoor Unit	Dimensions	H*W*D	mm	550-800(+69)-285(59.5)				
	Weight		kg	33	37	37	38	
	Air Volume	Cooling	m ³ /min	31.5	28.4	32.7	32.7	
		Heating	m ³ /min	33.1	33.5	34.7	34.7	
	Sound Level (SPL)	Cooling	dB(A)	49	44	46	46	
		Heating	dB(A)	50	50	51	51	
	Sound Level (PWL)	Cooling	dB(A)	60	59	61	61	
Breaker Size		A	15	15	15	15		
Ext.Piping	Port diameter	Liquid	mm	6.35x2	6.35x2	6.35x2	6.35x2	
		Gas	mm	9.52x2	9.52x2	9.52x2	9.52x2	
	Total piping length (Max.)		m	20	30	30	30	
	Each indoor unit piping length (Max.)		m	15	20	20	20	
	Max.Height		m	10	15(10) ⁽³⁾	15(10) ⁽³⁾	15(10) ⁽³⁾	
Chargeless length		m	20	30	30	30		
Guaranteed Operating Range(Outdoor)	Cooling	°C	-10~+46					
	Heating	°C	-15~+24					
Refrigerant/GWP				R32/675 ⁽⁵⁾	R32/675 ⁽⁵⁾	R32/675 ⁽⁵⁾	R32/675 ⁽⁵⁾	
Pre-Charged quantity	Weight	Kg	1.0	1.2	1.2	1.2		
	CO ₂ equivalent	t	0.68	0.81	0.81	0.81		
Max added quantity	Weight	Kg	1.0	1.2	1.2	1.2		
	CO ₂ equivalent	t	0.68	0.81	0.81	0.81		

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 550. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 550 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

The GWP of R32 is 675 in the IPCC 4th Assessment Report.

(*2) Energy consumption based on standard test results.

Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.


(*4) SEER/SCOP values and energy efficiency class are measured when connected to the indoor units listed below.

MXZ-2F33VF → MSZ-AP15VF + MSZ-LN18VG

MXZ-2F42VF → MSZ-LN18VG + MSZ-LN25VG

MXZ-2F53VF(H) → MSZ-LN18VG + MSZ-LN35VG

(*5) This GWP value is based on Regulation(EU) No 517/2014 from IPCC 4th edition,

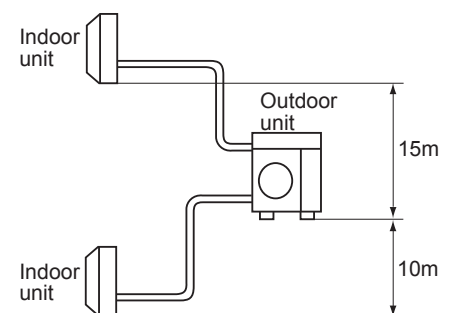

Indoor Unit				Please refer to ⁽⁴⁾			
Outdoor Unit				MXZ-3F54VF2	MXZ-3F68VF2	MXZ-4F72VF2	MXZ-4F80VF2
Refrigerant				R32 ⁽¹⁾			
Power Supply		Source		Outdoor power supply			
		Outdoor(V/Phase/Hz)		220-230-240V/Single/50Hz			
Cooling	Capacity	Rated	kW	5.4	6.8	7.2	8.0
		Min-Max	kW	2.9 - 6.8	2.9 - 8.4	3.7 - 8.8	3.7 - 9.0
	Input	Rated	kW	1.32	1.84	1.85	2.25
	Design load		kW	5.4	6.8	7.2	8.0
	Annual electricity consumption ⁽²⁾		kWh/a	222	299	310	371
SEER ⁽⁴⁾				8.52	7.96	8.13	7.55
	Energy efficiency class ⁽⁴⁾			A+++	A++	A++	A++
Heating	Capacity	Rated	kW	7.0	8.6	8.6	8.8
		Min-Max	kW	2.6 - 9.0	2.6 - 10.6	3.4 - 10.7	3.4 - 11.0
	Input	Rated	kW	1.40	1.91	1.87	2.00
	Design load		kW	5.0	6.8	7.0	7.0
	Declared Capacity	at reference design temperature	kW	4.0	5.5	5.6	5.6
		at bivalent temperature T _{biv}	kW	4.5	6.1	6.2	6.2
		at operation limit temperature T _{ol}	kW	3.2	4.6	4.8	4.8
	Back up heating capacity		kW	1.0	1.3	1.4	1.4
	Annual electricity consumption ⁽²⁾		kWh/a	1520	2312	2410	2410
	SCOP ⁽⁴⁾				4.61	4.12	4.07
Energy efficiency class ⁽⁴⁾				A++	A+	A+	A+
Max. Operating Current (Indoor+Outdoor)			A	18.0	18.0	18.0	18.0
Outdoor Unit	Dimensions	H x W x D	mm	710-840-330 (+66)			
	Weight		kg	58	58	59	59
	Air Volume	Cooling	m ³ /min	31.0	35.4	35.4	40.3
		Heating	m ³ /min	31.0	39.6	42.7	44.1
	Sound Level (SPL)	Cooling	dB(A)	46	48	48	50
		Heating	dB(A)	50	53	54	55
	Sound Level (PWL)	Cooling	dB(A)	60	63	63	65
Breaker Size		A	25	25	25	25	
Ext.Piping	Port diameter	Liquid	mm	6.35 x 3	6.35 x 3	6.35 x 4	6.35 x 4
		Gas	mm	9.52 x 3	9.52 x 3	12.7 x 1+9.52 x 3	12.7 x 1+9.52 x 3
	Total piping length (Max.)	m	50	60	60	60	
	Each indoor unit piping length (Max.)	m	25	25	25	25	
	Max.Height	m	15(10) ⁽³⁾	15(10) ⁽³⁾	15(10) ⁽³⁾	15(10) ⁽³⁾	
	Chargeless length	m	50	60	60	60	
Guaranteed Operating Range(Outdoor)	Cooling	°C	-10 ~ +46				
	Heating	°C	-15 ~ +24				
Refrigerant/GWP				R32/675 ⁽⁵⁾			
Pre-Charged quantity	Weight	Kg	2.4	2.4	2.4	2.4	
	CO ₂ equivalent	t	1.62	1.62	1.62	1.62	
Max added quantity	Weight	Kg	2.4	2.4	2.4	2.4	
	CO ₂ equivalent	t	1.62	1.62	1.62	1.62	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 550. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 550 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

The GWP of R32 is 675 in the IPCC 4th Assessment Report.

(*2) Energy consumption based on standard test results.

Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.

(*4) SEER/SCOP values and energy efficiency class are measured when connected to the indoor units listed below.


MXZ-3F54VF2 → MSZ-LN18VG + MSZ-LN18VG + MSZ-LN18VG

MXZ-3F68VF2 → MSZ-LN18VG + MSZ-LN25VG + MSZ-LN25VG

MXZ-4F72VF2 → MSZ-LN18VG + MSZ-LN18VG + MSZ-LN18VG + MSZ-LN18VG

MXZ-4F80VF2 → MSZ-LN18VG + MSZ-LN18VG + MSZ-LN18VG + MSZ-LN25VG

(*5) This GWP value is based on Regulation(EU) No 517/2014 from IPCC 4th edition,

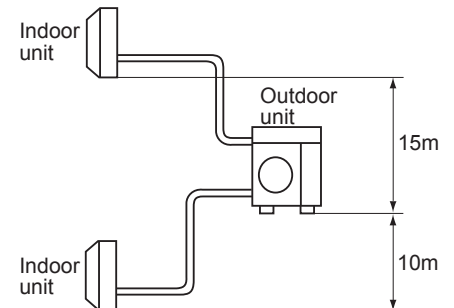

Indoor Unit				Please refer to (*4)				
Outdoor Unit				MXZ-2D33VA	MXZ-2D42VA2	MXZ-2D53VA2	MXZ-2D53VAH2	
Refrigerant				R410A (*1)				
Power Supply				Outdoor power supply				
Outdoor(V/Phase/Hz)				220-230-240V/Single/50Hz				
Cooling	Capacity	Rated	kW	3.3	4.2	5.3	5.3	
	Input	Rated	kW	0.90	1.00	1.54	1.54	
	Design load		kW	3.3	4.2	5.3	5.3	
	Annual electricity consumption (*2)		kWh/a	211	216	262	262	
	SEER (*4)			5.5	6.8	7.1	7.1	
			Energy efficiency class (*4)	A	A++	A++	A++	
Heating	Capacity	Rated	kW	4.0	4.5	6.4	6.4	
	Input	Rated	kW	0.96	0.93	1.70	1.70	
	Design load		kW	2.7	3.2	4.5	4.5	
	Declared Capacity	at reference design temperature		kW	2.1	2.7	3.7	3.6
		at bivalent temperature		kW	2.4	3.0	4.0	4.0
		at operation limit temperature		kW	1.7	2.3	3.3	3.0
	Back up heating capacity		kW	0.6	0.5	0.8	0.9	
	Annual electricity consumption (*2)		kWh/a	926	1065	1507	1546	
	SCOP (*4)			4.1	4.2	4.2	4.1	
				Energy efficiency class (*4)	A+	A+	A+	A+
Operating Current(Max)			A	10.0	12.2	12.2	12.2	
Outdoor Unit	Dimensions	H x W x D	mm	550 x 800(+69) x 285(+59.5)				
	Weight		kg	32	37	37	38	
	Air Volume	Cooling	m ³ /min	32.9	27.7	32.9	32.9	
		Heating	m ³ /min	33.7	33.3	33.3	33.3	
	Sound Level (SPL)	Cooling	dB(A)	49	46	50	50	
		Heating	dB(A)	50	51	53	53	
	Sound Level (PWL)	Cooling	dB(A)	63	60	64	64	
	Breaker Size		A	10	15	15	15	
Ext.Piping	Port diameter	Liquid/Gas	mm	6.35 x 2 / 9.52 x 2	6.35 x 2 / 9.52 x 2	6.35 x 2 / 9.52 x 2	6.35 x 2 / 9.52 x 2	
	Total piping length (Max.)		m	20	30	30	30	
	Each indoor unit piping length (Max.)		m	15	20	20	20	
	Max.Height		m	10	15(10) (*3)	15(10) (*3)	15(10) (*3)	
	Chargeless length		m	20	20	20	20	
Guaranteed Operating Range(Outdoor)		Cooling	°C	-10 ~ +46				
		Heating	°C	-15 ~ +24		-20 ~ +24		


(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.

(*4) SEER/SCOP values and energy efficiency class are measured

- MXZ-2D33VA → MSZ-SF15VA + MSZ-EF18VE
- MXZ-2D42VA2 → MSZ-EF18VE + MSZ-EF25VE
- MXZ-2D53VA2 → MSZ-EF18VE + MSZ-EF35VE
- MXZ-2D53VAH2 → MSZ-EF18VE + MSZ-EF35VE

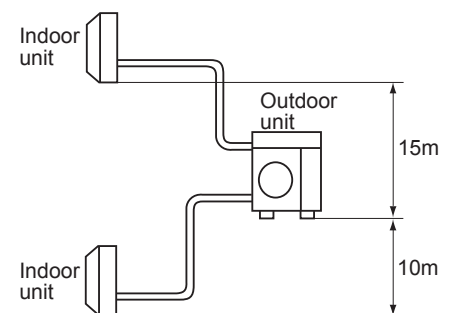

Indoor Unit				Please refer to (*4)			
Outdoor Unit				MXZ-3E54VA	MXZ-3E68VA	MXZ-4E72VA	
Refrigerant				R410A (*1)			
Power Supply				Outdoor power supply			
Source				220-230-240V/Single/50Hz			
Outdoor(V/Phase/Hz)				220-230-240V/Single/50Hz			
Cooling	Capacity	Rated	kW	5.4	6.8	7.2	
	Input	Rated	kW	1.35	2.19	2.25	
	Design load		kW	5.4	6.8	7.2	
	Annual electricity consumption ^(*2)		kWh/a	295	425	443	
	SEER ^(*4)			6.4	5.6	5.7	
			Energy efficiency class ^(*4)	A++	A+	A+	
Heating	Capacity	Rated	kW	7.0	8.6	8.6	
	Input	Rated	kW	1.59	2.38	2.28	
	Design load		kW	5.0	6.8	7.0	
	Declared Capacity	at reference design temperature		kW	4.0	5.4	5.6
		at bivalent temperature		kW	4.5	6.0	6.2
		at operation limit temperature		kW	3.2	4.4	4.7
	Back up heating capacity		kW	1.0	1.4	1.4	
	Annual electricity consumption ^(*2)		kWh/a	1751	2466	2516	
SCOP ^(*4)			4.0	3.9	3.9		
			Energy efficiency class ^(*4)	A+	A	A	
Operating Current(Max)			A	18.0	18.0	18.0	
Outdoor Unit	Dimensions	H x W x D	mm	710 x 840(+30) x 330(+66)			
	Weight		kg	58	58	59	
	Air Volume	Cooling		m ³ /min	42.1	42.1	42.1
		Heating		m ³ /min	43.0	43.0	43.0
	Sound Level (SPL)	Cooling		dB(A)	50	50	50
		Heating		dB(A)	53	53	53
	Sound Level (PWL)	Cooling		dB(A)	64	64	64
Breaker Size		A		25	25	25	
Ext.Piping	Port diameter	Liquid/Gas	mm	6.35 x 3 / 9.52 x 3	6.35 x 3 / 9.52 x 3	6.35 x 4 / 12.7 x 1+9.52 x 3	
	Total piping length (Max.)		m	50	60	60	
	Each indoor unit piping length (Max.)		m	25	25	25	
	Max.Height		m	15(10) ^(*3)	15(10) ^(*3)	15(10) ^(*3)	
	Chargeless length		m	40	40	40	
Guaranteed Operating Range(Outdoor)		Cooling	°C	-10 ~ +46			
		Heating	°C	-15 ~ +24			


(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.

(*4) SEER/SCOP values and energy efficiency class are measured

- MXZ-3E54VA → MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE
- MXZ-3E68VA → MSZ-EF18VE + MSZ-EF25VE + MSZ-EF25VE
- MXZ-4E72VA → MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE

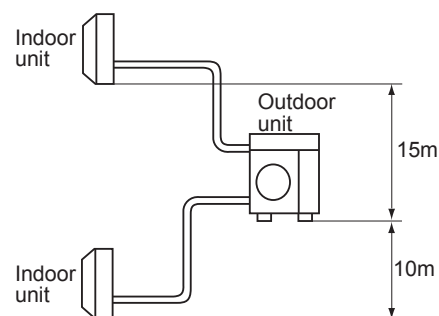


Indoor Unit				Please refer to (*4)		
Outdoor Unit				MXZ-4E83VA	MXZ-5E102VA	
Refrigerant				R410A (*1)		
Power Supply	Source			Outdoor power supply		
	Outdoor(V/Phase/Hz)			220-230-240V/Single/50Hz		
Cooling	Capacity	Rated	kW	8.3	10.2	
	Input	Rated	kW	2.44	3.15	
	Design load		kW	8.3	10.2	
	Annual electricity consumption ^(*2)		kWh/a	460	537	
	SEER ^(*4)			6.3	6.6	
			Energy efficiency class ^(*4)	A++	A++	
Heating	Capacity	Rated	kW	9.3	10.5	
	Input	Rated	kW	2.00	2.34	
	Design load		kW	8.7	8.9	
	Declared Capacity	at reference design temperature		kW	7.1	7.3
		at bivalent temperature		kW	7.8	7.9
		at operation limit temperature		kW	6.0	6.3
	Back up heating capacity		kW	1.6	1.6	
	Annual electricity consumption ^(*2)		kWh/a	2889	2958	
	SCOP ^(*4)			4.2	4.2	
				Energy efficiency class ^(*4)	A+	A+
Operating Current(Max)			A	21.4	21.4	
Outdoor Unit	Dimensions	H x W x D	mm	796 x 950 x 330		
	Weight		kg	63	64	
	Air Volume	Cooling	m ³ /min	55.6	65.1	
		Heating	m ³ /min	55.6	68.0	
	Sound Level (SPL)	Cooling	dB(A)	49	52	
		Heating	dB(A)	51	56	
	Sound Level (PWL)	Cooling	dB(A)	61	65	
Breaker Size		A	25	25		
Ext.Piping	Port diameter	Liquid/Gas	mm	6.35 x 4 / 12.7 x 1+9.52 x 3	6.35 x 5 / 12.7 x 1+9.52 x 4	
	Total piping length (Max.)		m	70	80	
	Each indoor unit piping length (Max.)		m	25	25	
	Max.Height		m	15(10) ^(*3)	15(10) ^(*3)	
	Chargeless length		m	25	0	
Guaranteed Operating Range(Outdoor)	Cooling	°C	-10 ~ +46			
	Heating	°C	-15 ~ +24			

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.

(*4) SEER/SCOP values and energy efficiency class are measured
 MXZ-4E83VA → MSZ-EF18VE + MSZ-EF18VE + MSZ-EF22VE + MSZ-EF25VE
 MXZ-5E102VA → MSZ-EF18VE + MSZ-EF18VE + MSZ-EF22VE + MSZ-EF22VE + MSZ-EF22VE

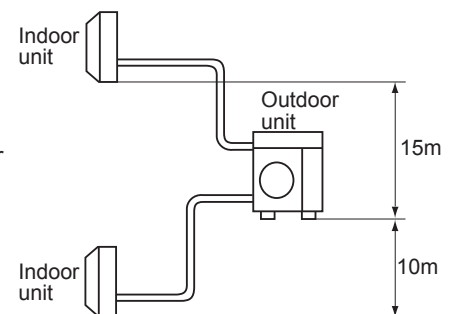

Indoor Unit				Please refer to ^{(*)2}	
Outdoor Unit				MXZ-6D122VA2	
Refrigerant				R410A	
Power Supply	Source			Outdoor power supply	
	Outdoor(V/Phase/Hz)			220-230-240V/Single/50Hz	
Cooling	Capacity	Rated	kW	12.2	
		Min. - Max.	kW	3.5 - 13.5	
	Input ^{(*)1}	Rated	kW	3.66	
	EER ^{(*)2}			3.33	
	EEL Rank			A	
Heating	Capacity	Rated	kW	14.0	
		Min. - Max.	kW	3.5 - 16.5	
	Input ^{(*)1}	Rated	kW	3.31	
	COP ^{(*)2}			4.23	
	EEL Rank			A	
Operating Current(Max) ^{(*)1}			A	26.8	
Total Capacity of all Indoor Units (max)			kW	Please refer to combination table	
Outdoor Unit	Dimensions		H x W x D	mm	1048 x 950 x 330
	Weight			kg	88
	Air Volume	Cooling	m ³ /min	63.0	
		Heating	m ³ /min	77.0	
	Sound Level (SPL)	Cooling	dB(A)	55	
		Heating	dB(A)	57	
	Sound Level (PWL)	Cooling	dB(A)	69	
	Operating Current	Cooling	A	16.8 - 16.1 - 15.4	
		Heating	A	15.2 - 14.5 - 13.9	
	Breaker Size		A	32	
Ext.Piping	Port diameter	Liquid/Gas	mm	6.35 x 6 / 12.7 x 1+9.52 x 5	
	Total piping length (Max.)		m	80	
	Each indoor unit piping length (Max.)		m	25	
	Max.Height		m	15(10) ^{(*)3}	
	Chargeless length		m	30	
Guaranteed Operating Range(Outdoor)		Cooling	°C	-10 ~ +46	
		Heating	°C	-15 ~ +24	


Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 2088. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 2088 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

(*)1 Power input and operating current (max) figures are for outdoor unit only.

(*)2 EER/COP and EEL rank are measured when connected to the indoor units listed below.

MXZ-6D122VA2 → MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE + MSZ-EF18VE + MSZ-EF25VE + MSZ-EF25VE

(*)3 If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.

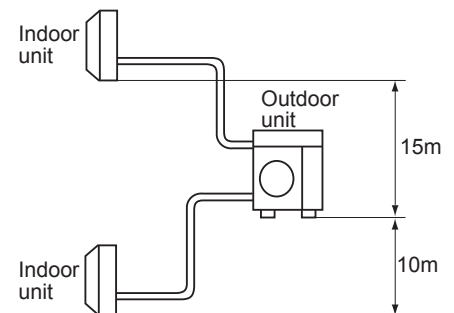

MULTI SYSTEMS SPECIFICATIONS

Indoor Unit				Refer to ^{(*)3}	
Outdoor Unit				MXZ-2DM40VA	MXZ-3DM50VA
Refrigerant				R410A ^{(*)1}	
Power Supply	Source			Outdoor power supply	
	Outdoor (V/Phase/Hz)			230V/Single/50Hz	
Cooling	Capacity	Rated	kW	4.0	5.0
		Min. - Max.	kW	1.1-4.3	2.7-6.5
	Input	Rated	kW	1.05	1.13
	EER ^{(*)3}			3.81	4.42
	EEL Rank ^{(*)3}			A	A
	Annual Electricity Consumption ^{(*)4}		kWh/a	226	283
	SEER ^{(*)3}			6.1	6.1
		Energy efficiency class ^{(*)3}	A++	A++	
Heating (Average Season)	Capacity	Rated	kW	4.3	6.0
		Min. - Max.	kW	1.0-4.7	2.4-7.5
	Input	Rated	kW	1.16	1.31
	COP ^{(*)3}			3.71	4.58
	EEL Rank ^{(*)3}			A	A
	Annual Electricity Consumption ^{(*)4}		kWh/a	1105	1455
	SCOP ^{(*)3}			4.0	3.8
		Energy efficiency class ^{(*)3}	A+	A	
Operating Current (Max.)			A	12.2	18.0
Outdoor Unit	Dimensions		H x W x D	mm	550 x 800(+69) x 285(+59.5) / 710 x 840(+30) x 330(+66)
	Weight			kg	32 / 57
	Air Volume	Cooling		m ³ /min	29.2 / 37.5
		Heating		m ³ /min	31.9 / 39.6
	Sound Level (SPL)	Cooling		dB(A)	48 / 50
		Heating		dB(A)	52 / 53
	Sound Level (PWL)	Cooling		dB(A)	63 / 64
	Operating Current	Cooling		A	5.1 / 5.0
		Heating		A	5.6 / 5.8
Breaker Size			A	15 / 25	
Ext.Piping	Port diameter	Liquid/Gas	mm	6.35 x 2 / 9.52 x 2 / 6.35 x 3 / 9.52 x 3	
	Total piping length (Max.)		m	30 / 50	
	Each indoor unit piping length (Max.)		m	20 / 25	
	Max. Height		m	15(10) ^{(*)2} / 15(10) ^{(*)2}	
	Chargeless length		m	20 / 40	
Guaranteed Operating Range (Outdoor)		Cooling	°C	-10 ~ +46	
		Heating	°C	-15 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

(*2) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.


(*3) SEER/SCOP values and energy efficiency class are measured when connected to the indoor units listed below.

MXZ-2DM40VA → MSZ-DM25VA + MSZ-DM25VA

MXZ-3DM50VA → MSZ-DM25VA + MSZ-DM25VA + MSZ-DM25VA

(*4) Energy consumption based on standard test results.

Actual energy consumption will depend on how the appliance is used and where it is located.

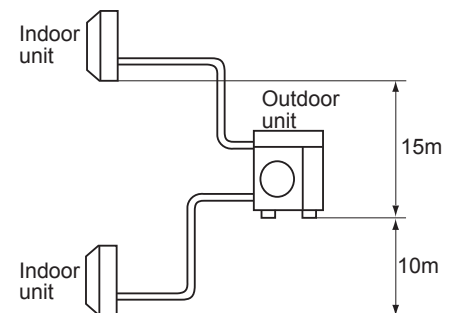

Indoor Unit				Please refer to ^{(*)4}		
Outdoor Unit				MXZ-2HA40VF	MXZ-2HA50VF	MXZ-3HA50VF
Refrigerant				R32 ^{(*)1}		
Power Supply	Source			Outdoor power supply		
	Outdoor(V/Phase/Hz)			220-230-240V/Single/50Hz		
Cooling	Capacity	Rated	kW	4.0	5.0	5.0
		Min-Max	kW	1.1 - 4.3	1.1 - 5.4	2.9 - 6.5
	Input	Rated	kW	1.05	1.52	1.26
	Design load		kW	4.0	5.0	5.0
	Annual electricity consumption ^{(*)2}		kWh/a	172	225	241
	SEER ^{(*)4}			8.12	7.78	7.26
			Energy efficiency class ^{(*)4}		A++	A++
Heating	Capacity	Rated	kW	4.3	6.0	6.0
		Min-Max	kW	1.0 - 4.7	1.0 - 6.4	2.6 - 7.5
	Input	Rated	kW	0.91	1.54	1.30
	Design load		kW	3.2	3.2	4.0
	Declared Capacity	at reference design temperature	kW	2.4	2.4	3.0
		at bivalent temperature	kW	2.9	2.9	3.6
		at operation limit temperature	kW	2.1	2.1	2.6
	Back up heating capacity		kW	0.8	0.8	1.0
	Annual electricity consumption ^{(*)2}		kWh/a	1043	1043	1394
	SCOP ^{(*)4}			4.30	4.30	4.02
		Energy efficiency class ^{(*)4}		A+	A+	A+
Max. Operating Current (Indoor+Outdoor)			A	12.2	12.2	18.0
Outdoor Unit	Dimensions	H x W x D	mm	550-800 (+69)-285 (+59.5)		710-840-330 (+66)
	Weight		kg	37	37	57
	Air Volume	Cooling	m ³ /min	28.4	32.7	31.0
		Heating	m ³ /min	33.5	34.7	29.1
	Sound Level (SPL)	Cooling	dB(A)	44	47	46
		Heating	dB(A)	50	51	50
	Sound Level (PWL)	Cooling	dB(A)	59	64	61
Breaker Size		A	15	15	25	
Ext.Piping	Port diameter	Liquid	mm	6.35 x 2	6.35 x 2	6.35 x 3
		Gas	mm	9.52 x 2	9.52 x 2	9.52 x 3
	Total piping length (Max.)		m	30	30	50
	Each indoor unit piping length (Max.)		m	20	20	25
	Max.Height		m	15(10) ^{(*)3}	15(10) ^{(*)3}	15(10) ^{(*)3}
Guaranteed Operating Range(Outdoor)	Cooling	°C	-10 ~ +46			
	Heating	°C	-15 ~ +24			
Refrigerant/GWP				R32/675 ^{(*)5}	R32/675 ^{(*)5}	R32/675 ^{(*)5}
Pre-Charged quantity	Weight	Kg	0.9	0.9	1.4	
	CO ₂ equivalent	t	0.61	0.61	0.95	
Max added quantity	Weight	Kg	0.9	0.9	1.6	
	CO ₂ equivalent	t	0.61	0.61	1.08	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 550. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 550 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional.

The GWP of R32 is 675 in the IPCC 4th Assessment Report.


(*2) Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

(*3) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.

(*4) SEER/SCOP values and energy efficiency class are measured when connected to the indoor units listed below.

- MXZ-2HA40VF → MSZ-HR25VF + MSZ-HR25VF
- MXZ-2HA50VF → MSZ-HR25VF + MSZ-HR25VF
- MXZ-3HA50VF → MSZ-HR25VF + MSZ-HR25VF + MSZ-HR25VF

(*5) This GWP value is based on Regulation(EU) No 517/2014 from IPCC 4th edition,

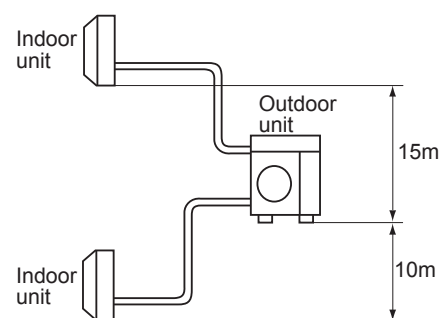

Indoor Unit				Please refer to ^{(*)4}	
Outdoor Unit				MXZ-2E53VAHZ	MXZ-4E83VAHZ
Refrigerant				R410A ^{(*)1}	
Power Supply	Source			Outdoor power supply	
	Outdoor(V/Phase/Hz)			220-230-240V/Single/50Hz	
Cooling	Capacity	Rated	kW	5.3	8.3
		Min. - Max.	kW	1.1-6.0	3.5-9.2
	Input	Rated	kW	1.29	2.25
	Design load		kW	5.3	8.3
	Annual electricity consumption ^{(*)4}		kWh/a	282	447
	SEER ^{(*)3}			6.5	6.5
Heating	Capacity	Rated (7°C)	kW	6.4	9.0
		Min. - Max.	kW	1.0-7.0	3.5-11.6
	Input	Rated	kW	1.36	1.90
	Design load		kW	6.4	10.1
	Declared Capacity	at reference design temperature	kW	6.4	9.0
		at bivalent temperature	kW	6.4	9.0
		at operation limit temperature	kW	2.4	2.5
	Back up heating capacity		kW	0.0	1.1
	Annual electricity consumption ^{(*)4}		kWh/a	2165	3446
	SCOP ^{(*)3}			4.1	4.1
			Energy efficiency class ^{(*)3}	A+	A+
Max. Operating Current (Indoor+Outdoor)			A	15.6	28.0
Outdoor Unit	Dimensions		H x W x D	mm	796 x 950 x 330
	Weight			kg	61
	Air Volume	Cooling	m ³ /min	47.0	63.0
		Heating	m ³ /min	47.0	77.0
	Sound Level (SPL)	Cooling	dB(A)	45	53
		Heating	dB(A)	47	57
	Sound Level (PWL)	Cooling	dB(A)	55	66
Breaker Size		A	16	30	
Ext.Piping	Port diameter	Liquid/Gas	mm	6.35x 2 / 9.52 x 2	6.35 x 4 / 12.7 x 1 + 9.52 x 3
	Total piping length (Max.)		m	30	70
	Each indoor unit piping length (Max.)		m	20	25
	Max.Height		m	15(10) ^{(*)2}	15(10) ^{(*)2}
	Chargeless length		m	20	25
Guaranteed Operating Range(Outdoor)		Cooling	°C	-10 ~ +46	
		Heating	°C	-25 ~ +24	

(*1) Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO₂, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

(*2) If the outdoor unit is installed higher than the indoor unit, max. height is reduced to 10 m.


(*3) SEER/SCOP values and energy efficiency class are measured when connected to the indoor units listed below.

MXZ-2E53VAHZ → MSZ-EF18VE + MSZ-EF35VE

MXZ-4E83VAHZ → MSZ-EF18VE + MSZ-EF18VE + MSZ-EF22VE + MSZ-EF25VE

(*4) Energy consumption based on standard test results.

Actual energy consumption will depend on how the appliance is used and where it is located.

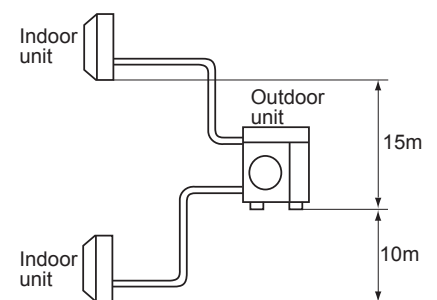


C.4.2 OUTLINES AND DIMENSIONS

C.4.2.1 Inverter Heat Pump

MXZ-2D33VA	MXZ-2F33VF	MXZ-2DM40VA
MXZ-2D42VA2	MXZ-2F42VF	MXZ-2HA40VF
MXZ-2D53VA2	MXZ-2F53VF	MXZ-2HA50VF
MXZ-2D53VAH2	MXZ-2F53VFH	

OUTDOOR UNIT


Unit: mm

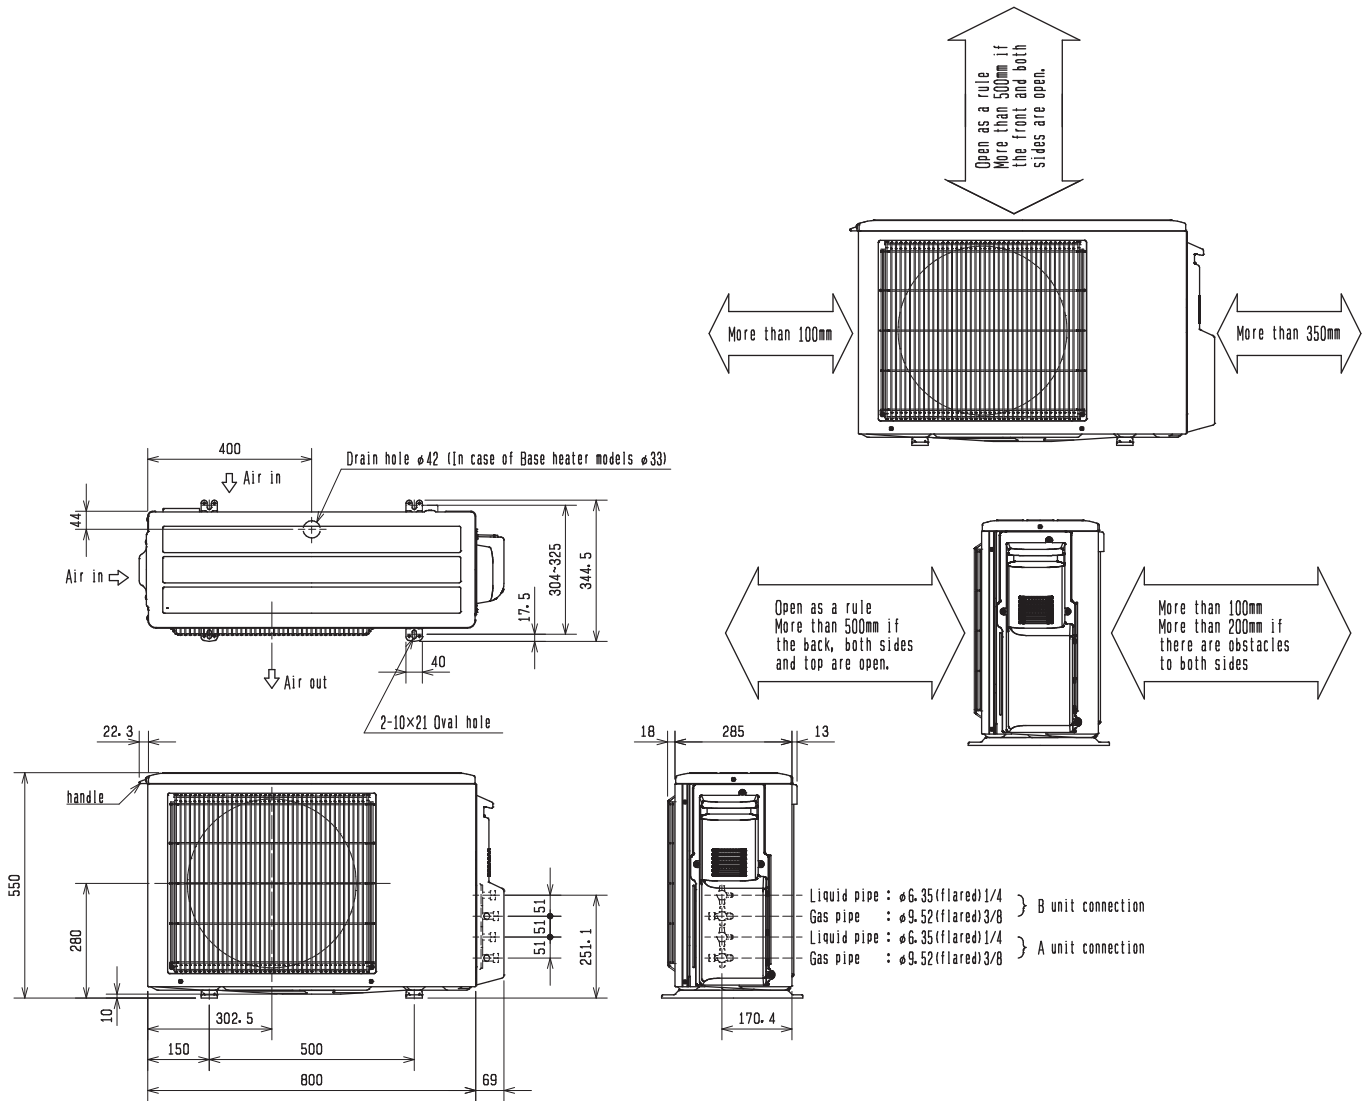

MXZ-3E54VA MXZ-3F54VF2 MXZ-3HA50VF
 MXZ-3E68VA MXZ-3F68VF2


OUTDOOR UNIT

Unit: mm

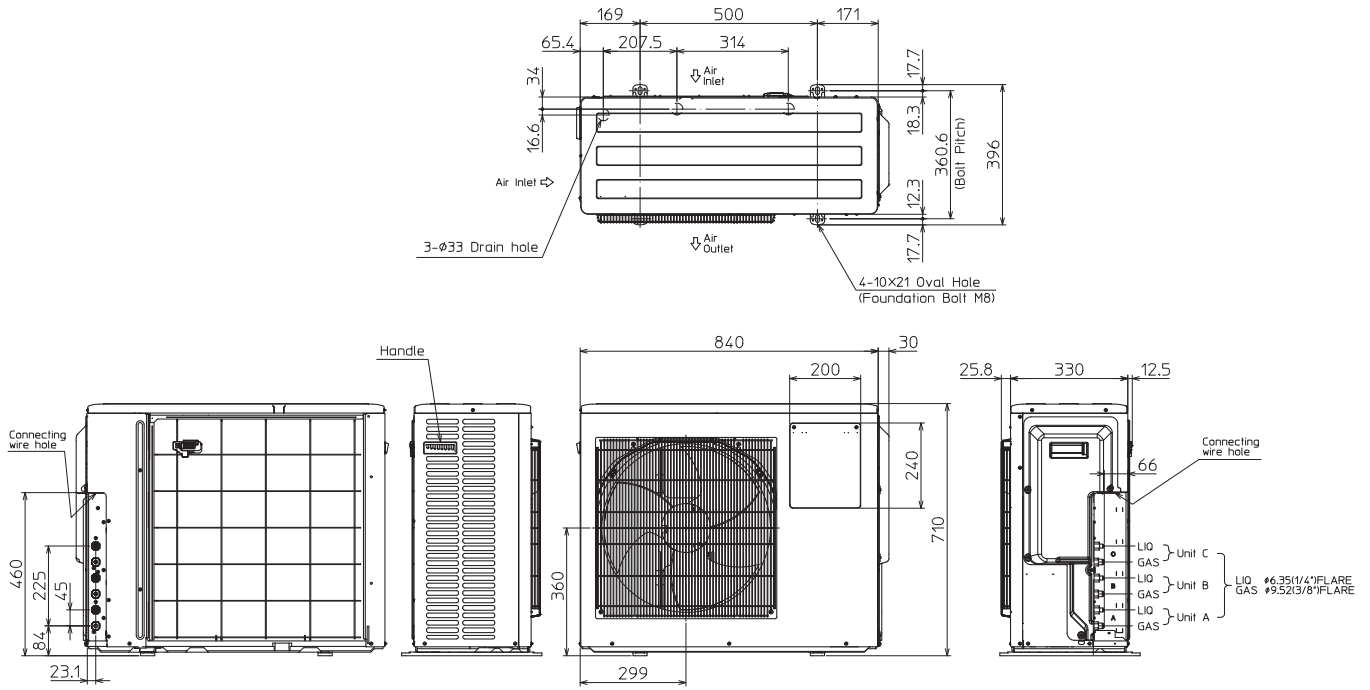


1. Installation space


Note : Leave front and both sides free of obstruction.




2. Service space

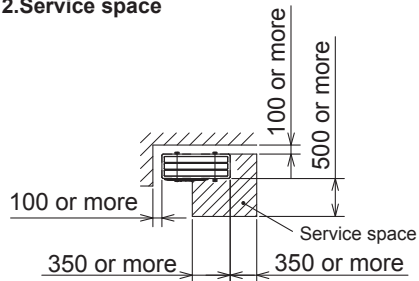

Note : Leave front and overhead free of obstruction.

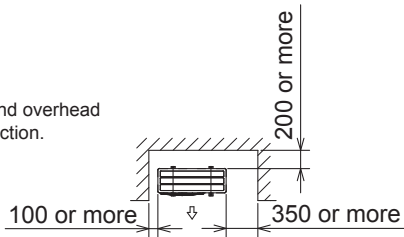


Note : Leave rear, overhead and both sides free of obstruction.



MXZ-4E72VA MXZ-4F72VF2 MXZ-4F80VF2


OUTDOOR UNIT

Unit: mm

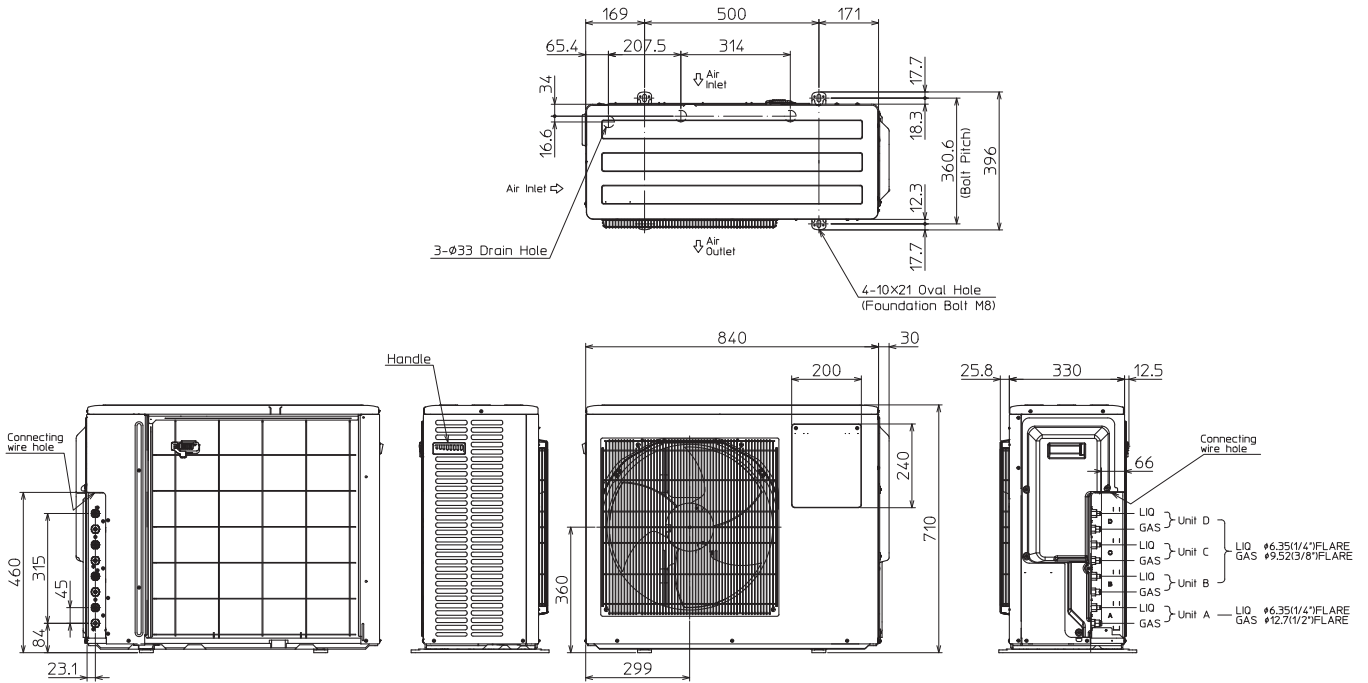


1. Installation space


Note : Leave front and both sides free of obstruction.




Note : Leave front and overhead free of obstruction.

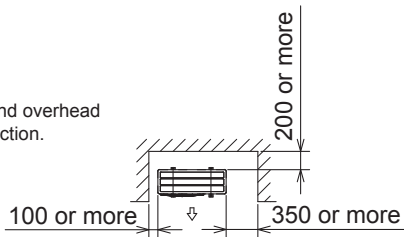

Note : Leave rear, overhead and both sides free of obstruction.




2. Service space

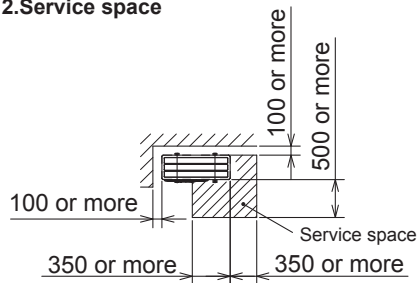

MXZ-4E83VA



OUTDOOR UNIT

Unit: mm

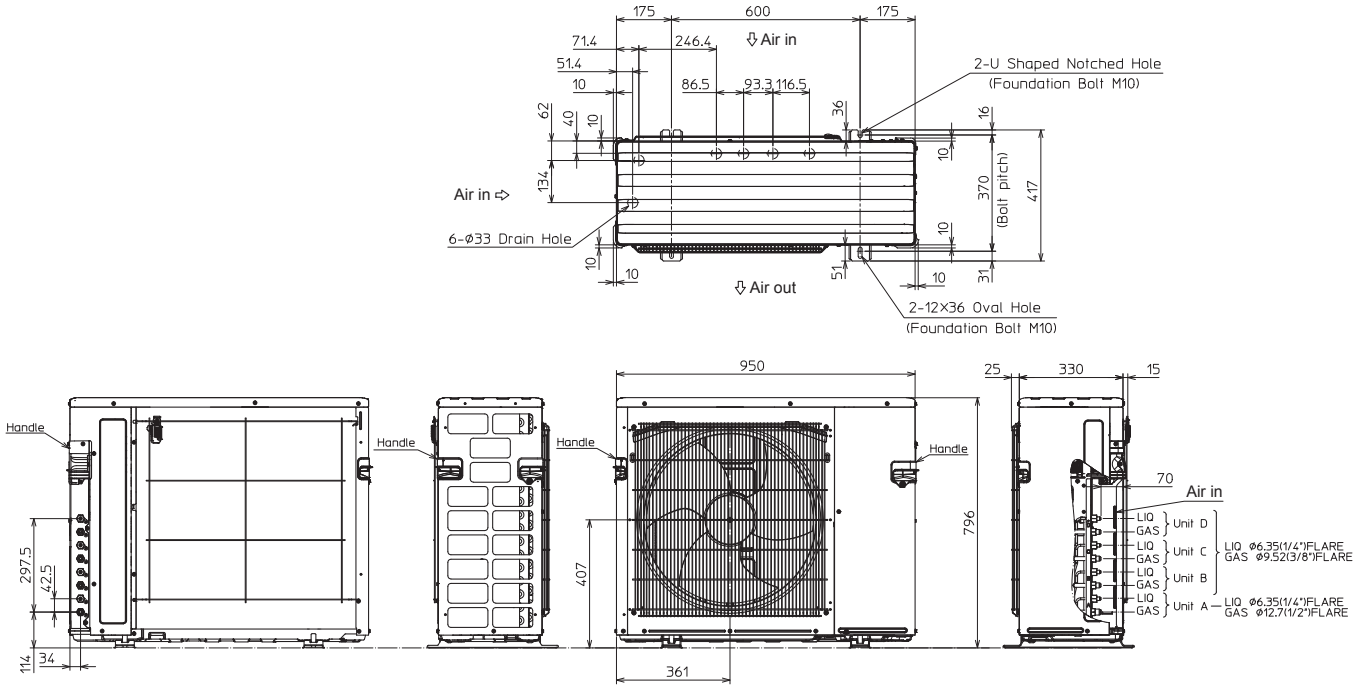

1.FREE SPACE


2.SERVICE SPACE

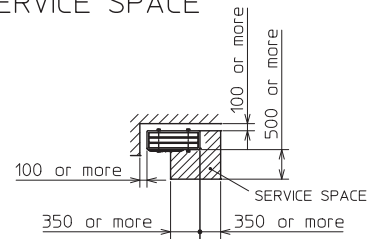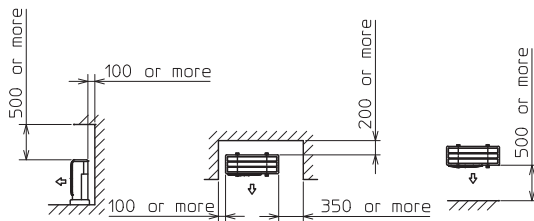


MXZ-5E102VA

OUTDOOR UNIT


Unit: mm

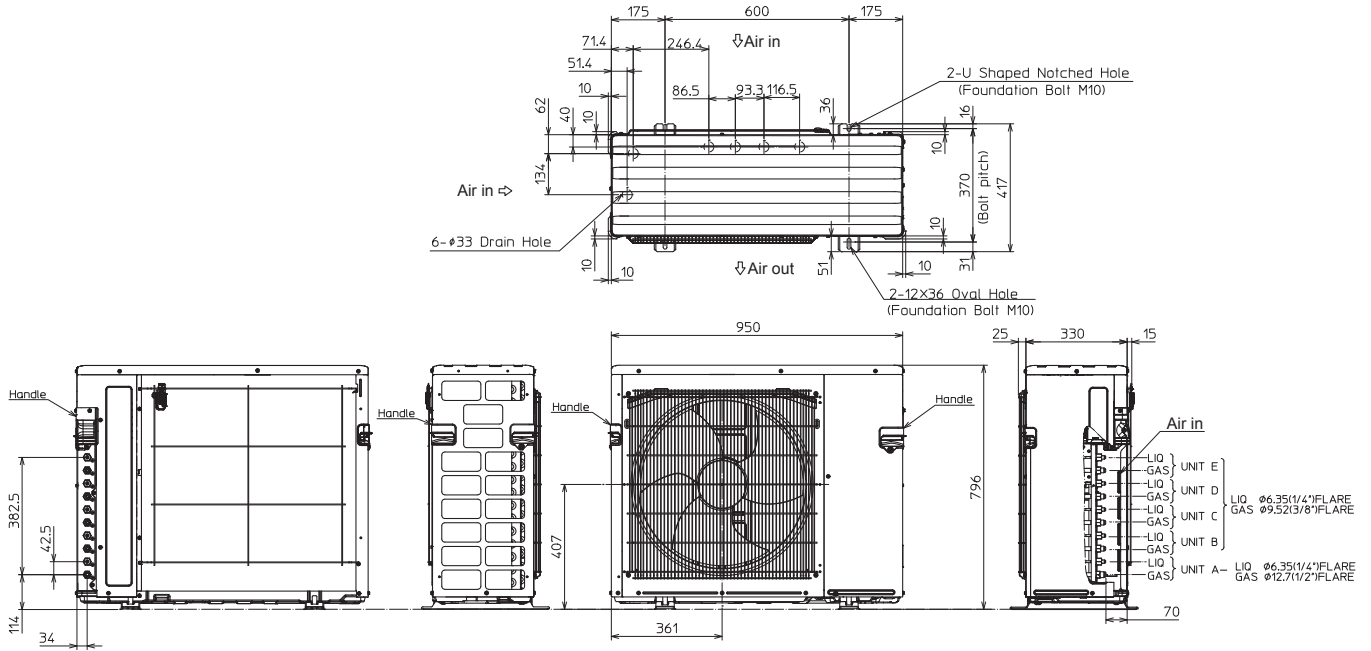

1. FREE SPACE

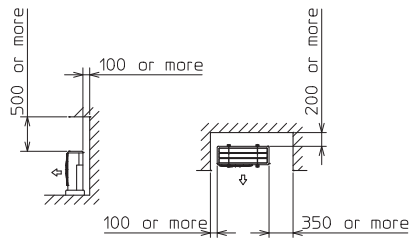


2. SERVICE SPACE

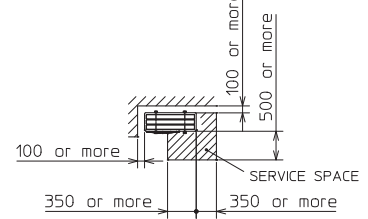


MXZ-6D122VA2

OUTDOOR UNIT


Unit: mm

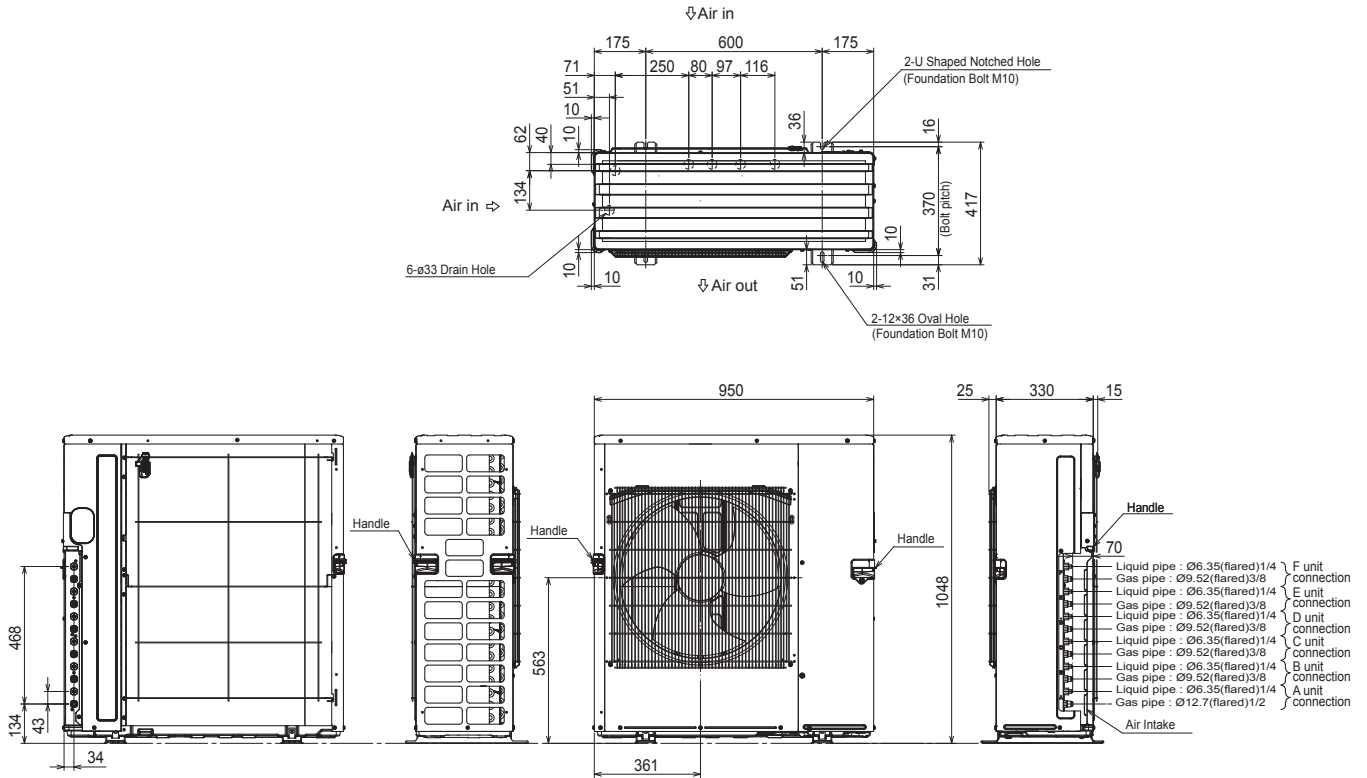

1. FREE SPACE

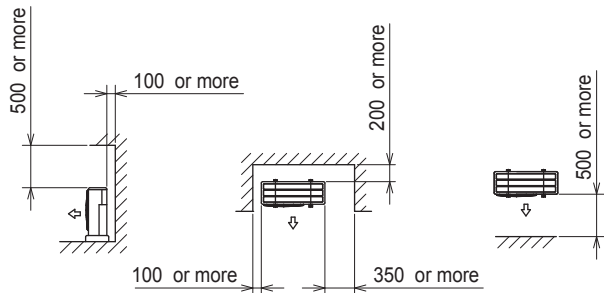


2. SERVICE SPACE

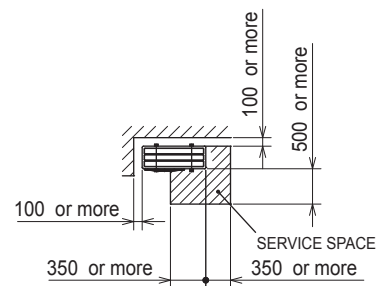

MXZ-3DM50VA


OUTDOOR UNIT

Unit: mm

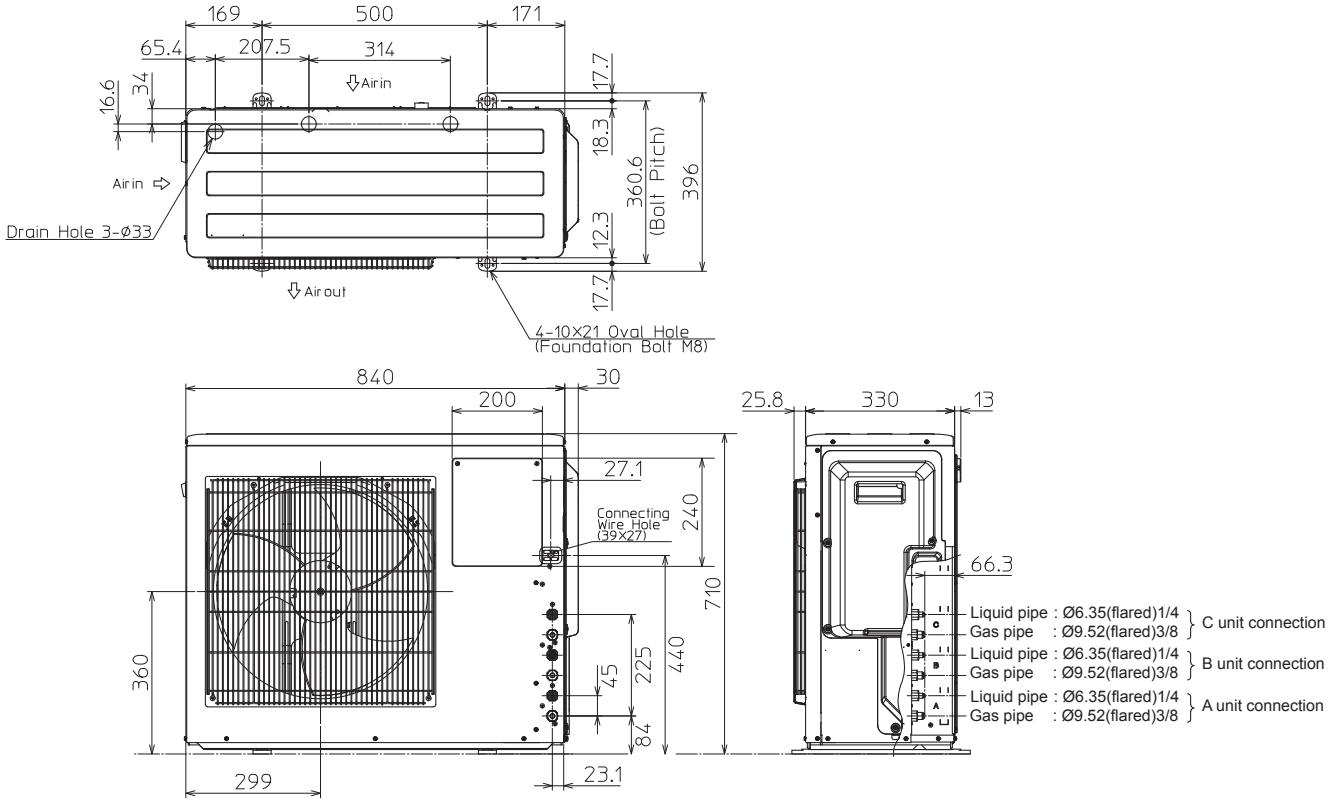


1. Installation space


Note : Leave front and both sides free of obstruction.




Note : Leave front and overhead free of obstruction.

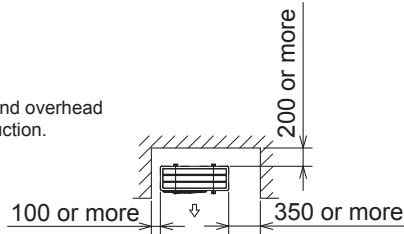

Note : Leave rear, overhead and both sides free of obstruction.




2. Service space

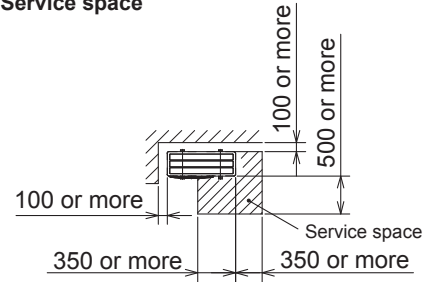


MXZ-2E53VAHZ

OUTDOOR UNIT


Unit: mm

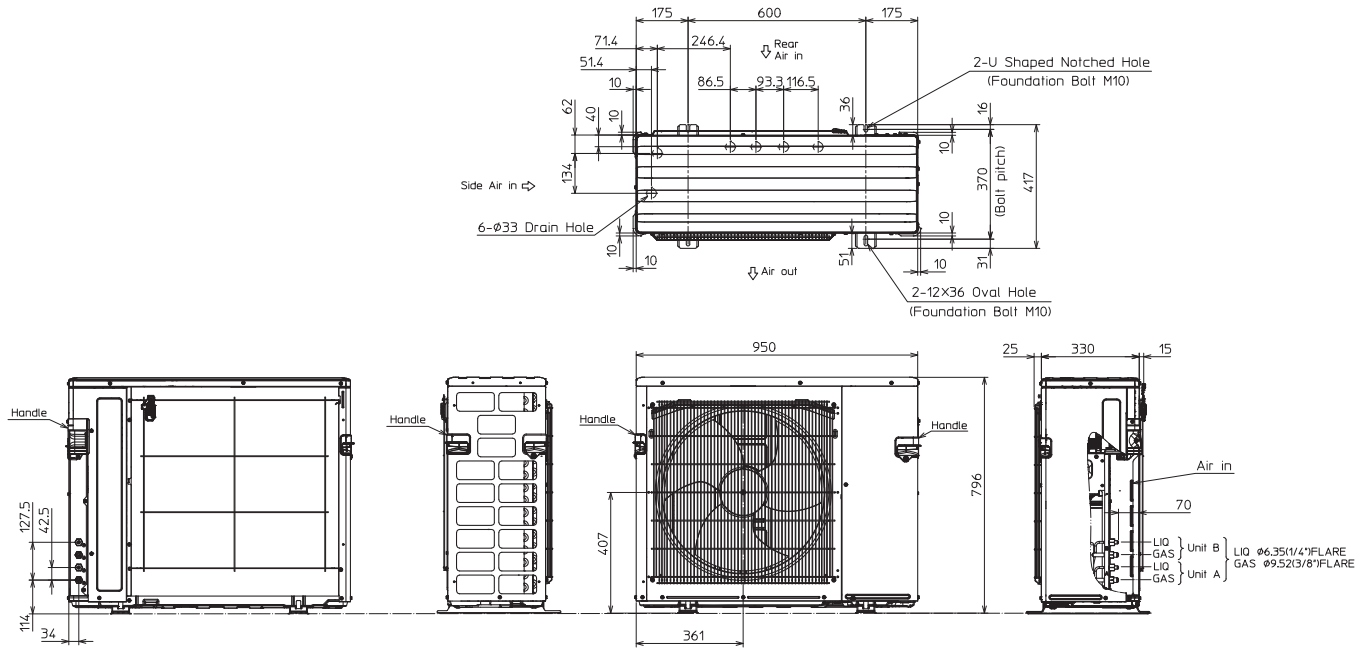

1.FREE SPACE

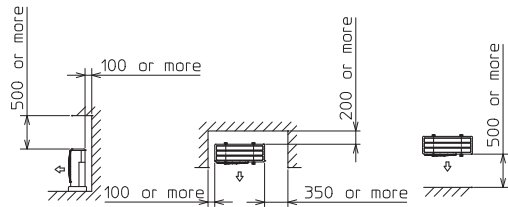


2.SERVICE SPACE

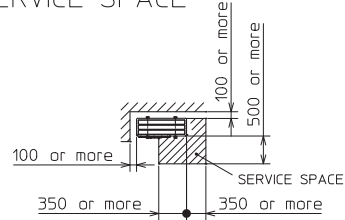


MXZ-4E83VAHZ

OUTDOOR UNIT


Unit: mm

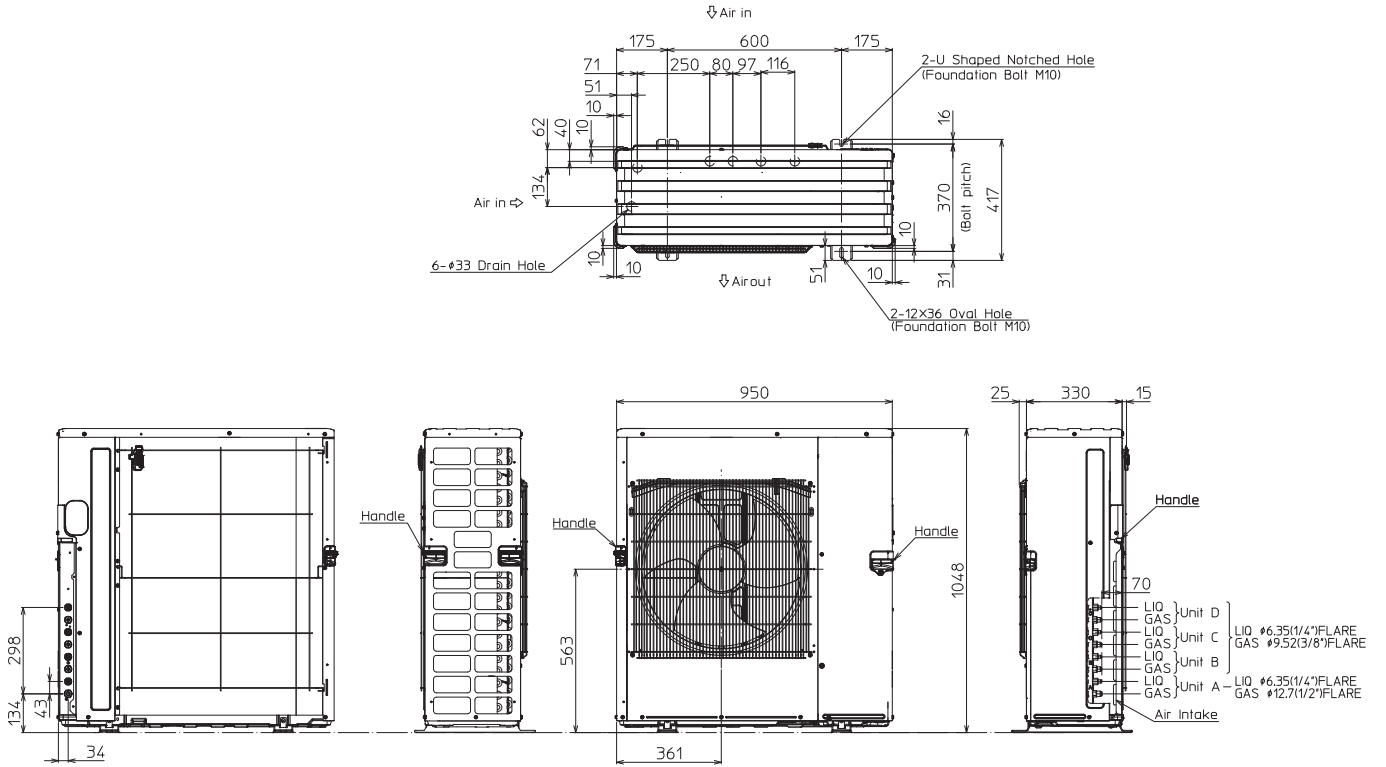

1.FREE SPACE

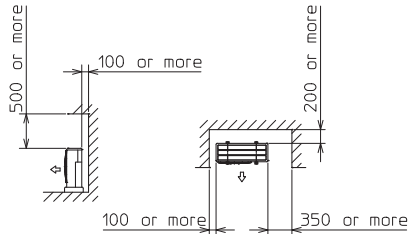

2.SERVICE SPACE

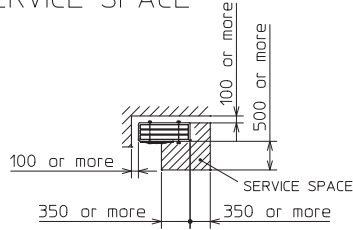


C.4.3 WIRING DIAGRAM

C.4.3.1 Inverter Heat Pump

MXZ-2F33VF MXZ-2F42VF MXZ-2F53VF

OUTDOOR UNIT

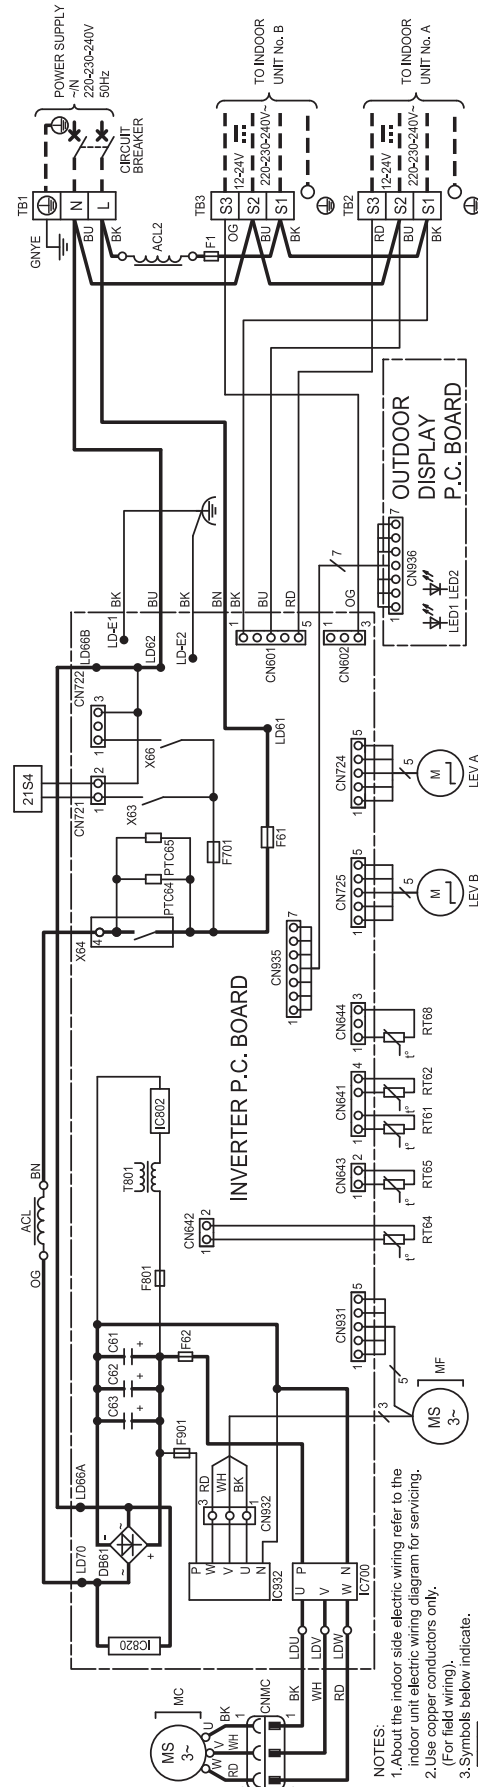


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
ACL, ACL2	REACTOR	IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR
C61-63	SMOOTHING CAPACITOR	LED1, 2	LED	RT65	AMBIENT TEMP. THERMISTOR
DB61	DIODE MODULE	LEV A, B	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F701, 801, 901	FUSE (T3, 15AL250V)	MC	COMPRESSOR	TB1-3	TERMINAL BLOCK
F1	FUSE (T3, 15AL250V)	MF	FAN MOTOR	T801	SWITCHING TRANS
F61	FUSE (T3, 15AL250V)	PTC64, 65	CIRCUIT PROTECTOR	X63, 64, 66	RELAY
F62	FUSE (15A 250V)	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC700, 820, 932	POWER MODULE	RT62	DISCHARGE TEMP. THERMISTOR		

NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only.
 3. Symbols below indicate:
 □ Terminal block
 ○ Connector

WIRING DIAGRAM MULTI SYSTEMS

MXZ-2F53VFH
OUTDOOR UNIT

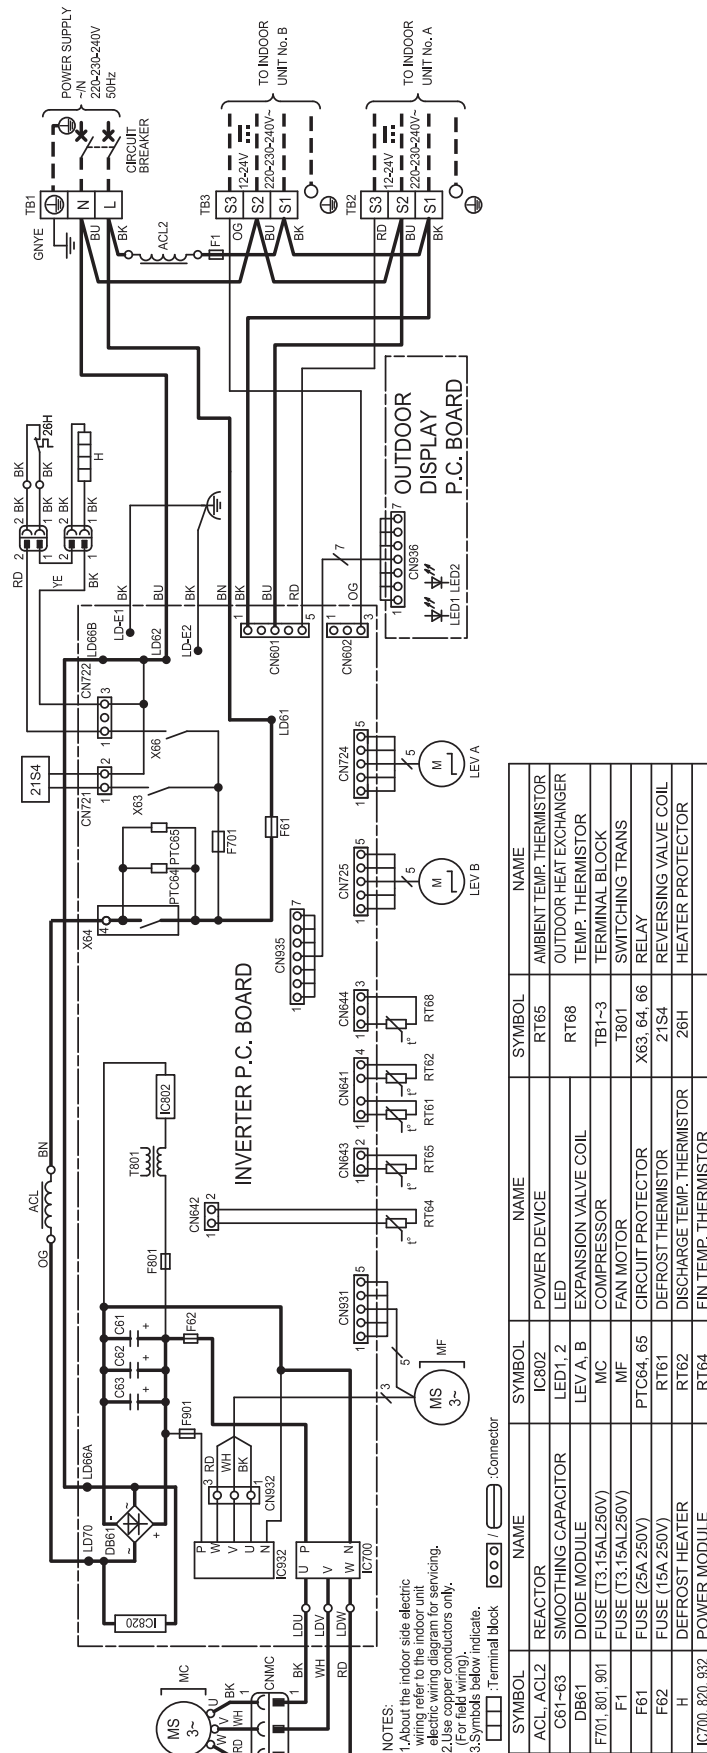


NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only.
 3. Symbols below indicate.
 □ : Terminal block
 ○ : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
ACL, ACL2	REACTOR	IC802	POWER DEVICE	RT65	AMBIENT TEMP. THERMISTOR
C61~63	SMOOTHING CAPACITOR	LED1, 2	LED	RT66	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
DB61	DIODE MODULE	LEV A, B	EXPANSION VALVE COIL	TB1~3	TERMINAL BLOCK
F701, 801, 901	FUSE (T3.15A/250V)	MC	COMPRESSOR	T801	SWITCHING TRANS
F1	FUSE (T3.15A/250V)	MF	FAN MOTOR	X63, 64, 66	RELAY
F61	FUSE (25A 250V)	PTC64, 65	CIRCUIT PROTECTOR	21S4	REVERSING VALVE COIL
F62	FUSE (15A 250V)	RT61	DEFROST THERMISTOR	28H	HEATER PROTECTOR
H	DEFROST HEATER	RT62	DISCHARGE TEMP. THERMISTOR		
IC700, 820, 932	POWER MODULE	RT64	FIN TEMP. THERMISTOR		


MXZ-4F72VF2 MXZ-4F80VF2

OUTDOOR UNIT

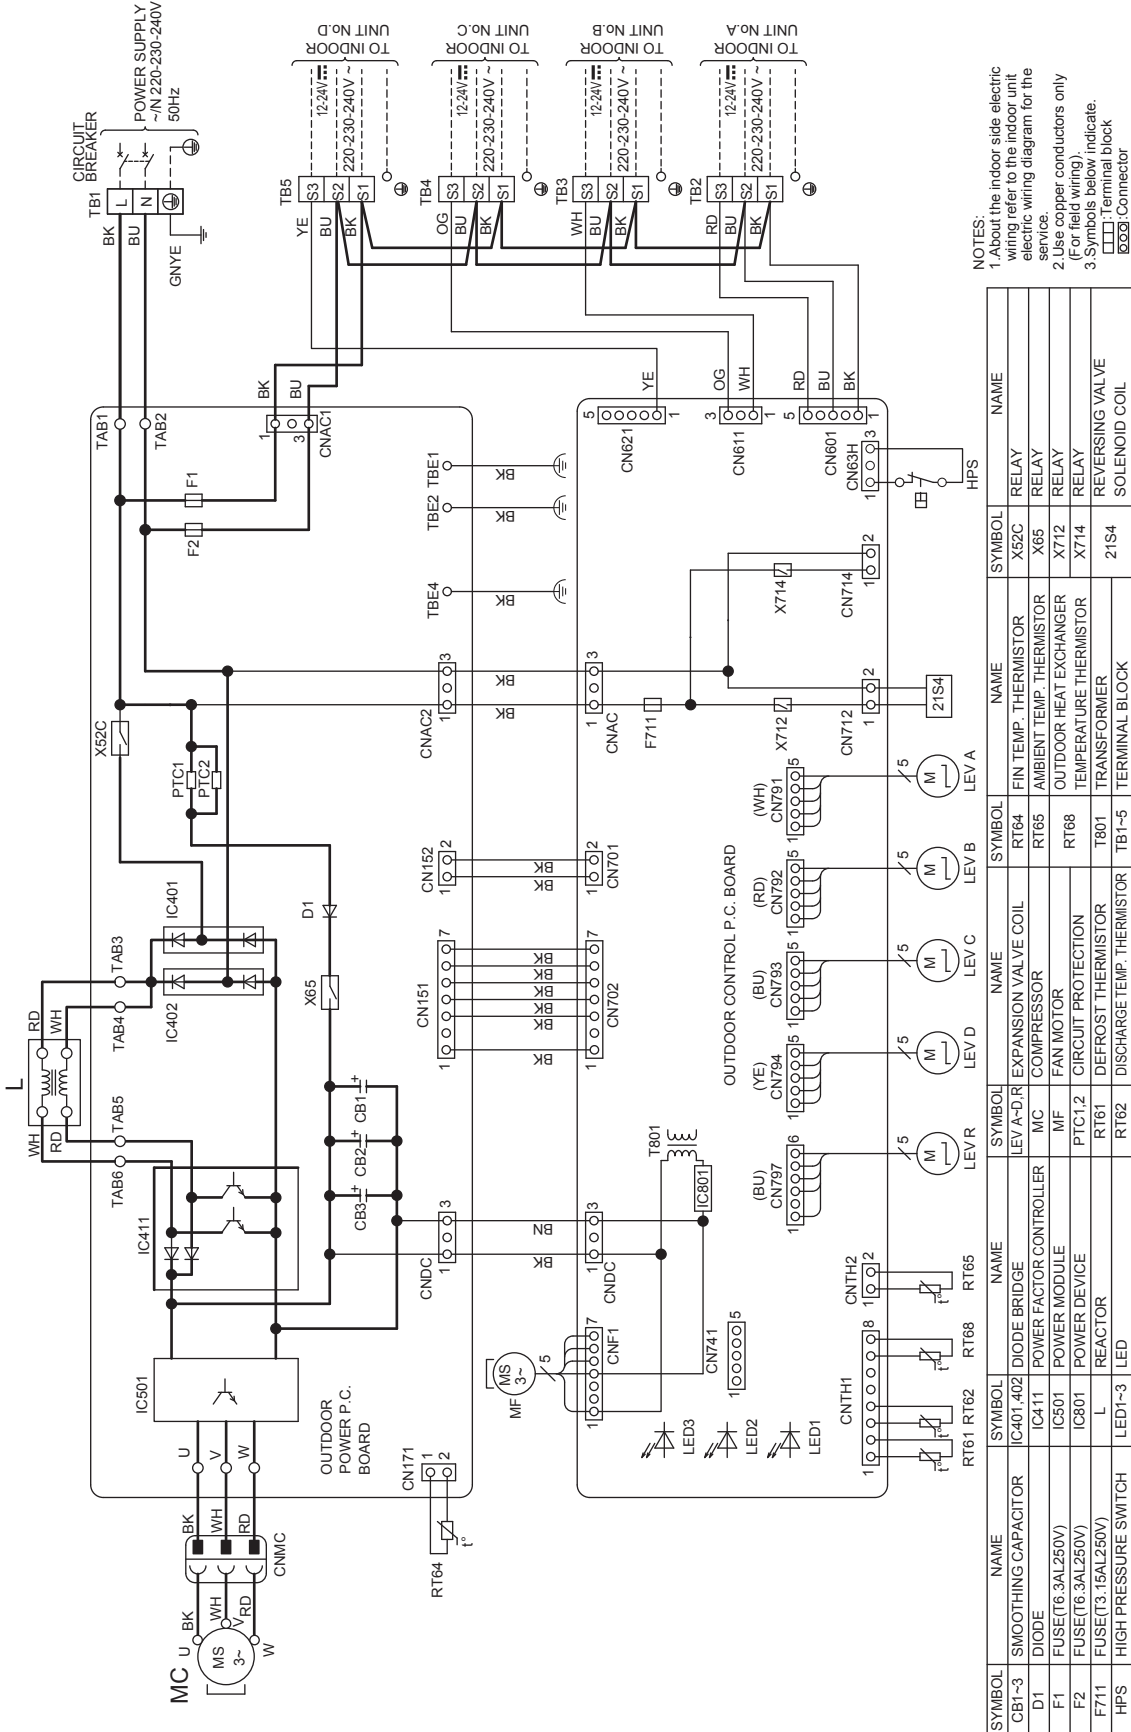

NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for the service.
 2. Use copper conductors only (for field wiring).
 3. Symbols below indicate.
 □ Terminal block
 ○○ Connector

MXZ-2D33VA MXZ-2D42VA2 MXZ-2D53VA2
OUTDOOR UNIT

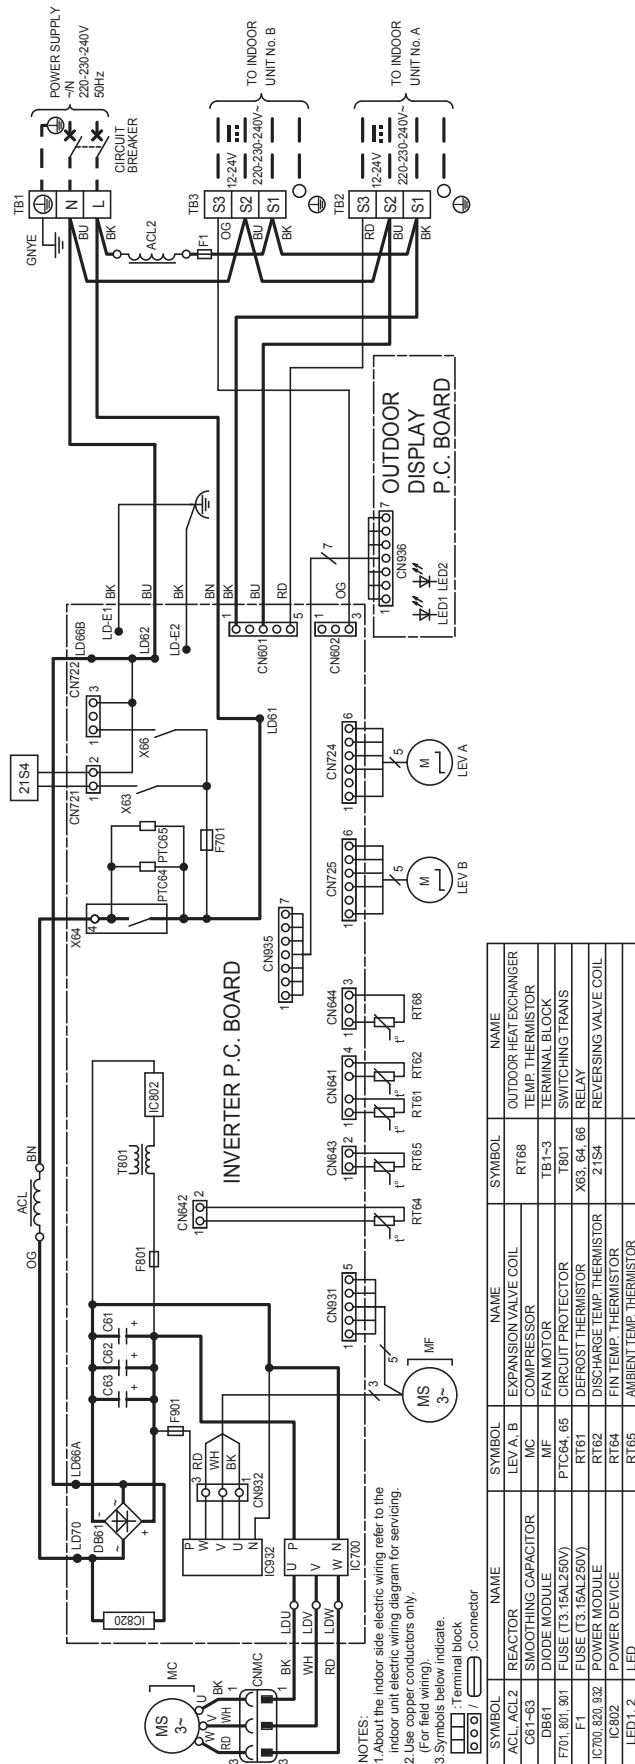


NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only.
 3. Symbols below indicate:
 □ : Terminal block
 ○ : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
ACL	ACL2	LEV A	B	RT68	OUTDOOR HEAT EXCHANGER TEMP THERMISTOR
C61	~C63	MF		TB1-3	TERMINAL BLOCK
DB81		PTC64, 65		T801	SWITCHING TRANS RELAY
F701, 801, 801		RT161		X63, 64, 66	REVERSING VALVE COIL
IC700, 820, 932		RT162		Z1S4	FIN TEMP THERMISTOR
IC802		RT164			
LED1, 2		RT165			

WIRING DIAGRAM
 MULTI SYSTEMS


MXZ-2D53VAH2
OUTDOOR UNIT

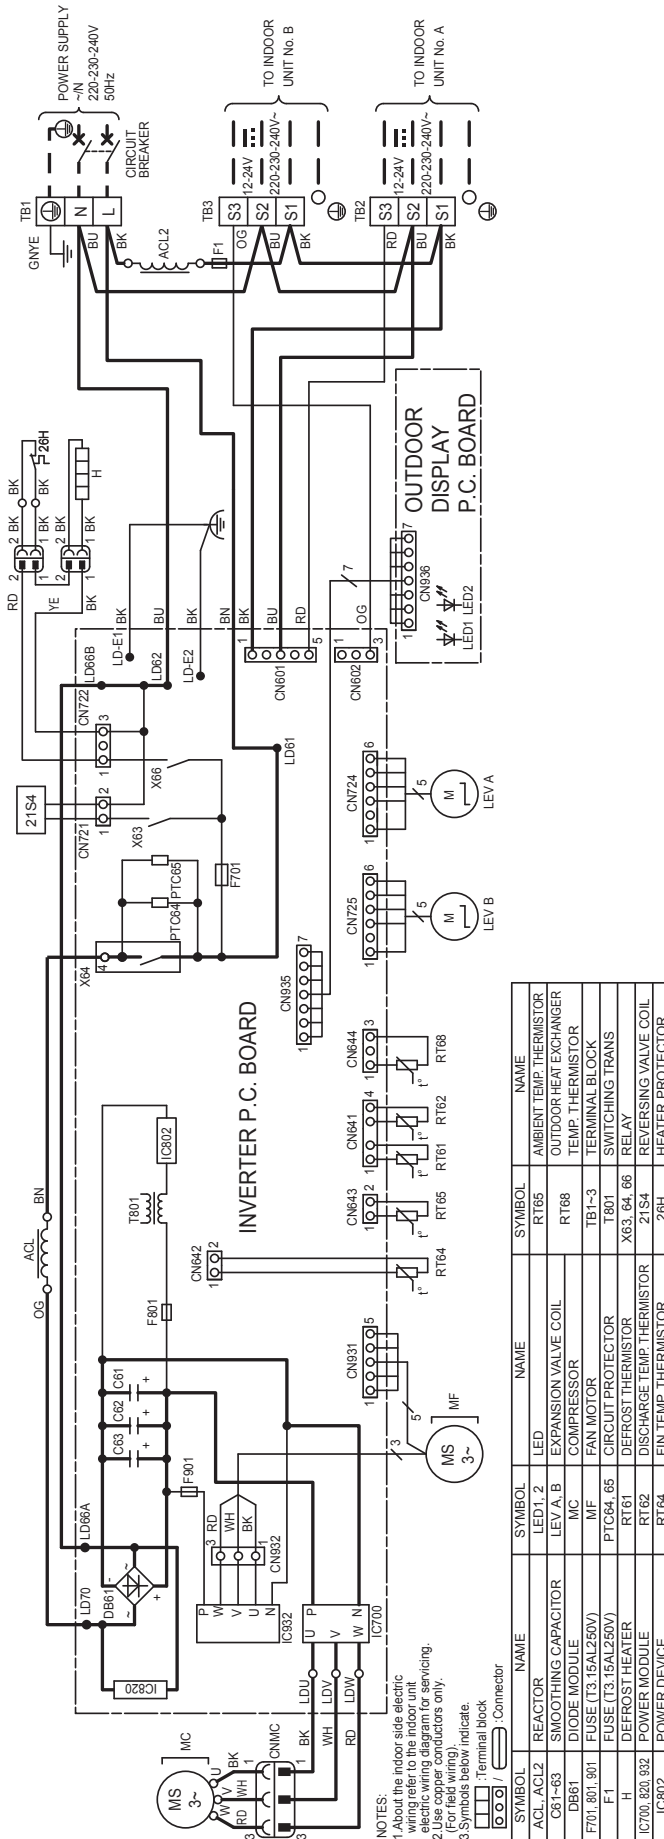

SYMBOL	NAME	SYMBOL	NAME
ACL, ACL2	REACTOR	LED1, 2	AMBIENT TEMP. THERMISTOR
C61~63	SMOOTHING CAPACITOR	LEV A, B	OUTDOOR HEAT EXCHANGER
DB61	DIODE MODULE	MC	TEMP. THERMISTOR
F701, 801, 801	FUSE (T3.15A/250V)	MF	TERMINAL BLOCK
F1	FUSE (T3.15A/250V)	PTC64, 65	SWITCHING TRANS.
H	DEFROST HEATER	RT61	REVERSING VALVE COIL
IC700, 820, 932	POWER MODULE	RT62	DISCHARGE TEMP. THERMISTOR
IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR

MXZ-3E54VA MXZ-3E68VA

OUTDOOR UNIT

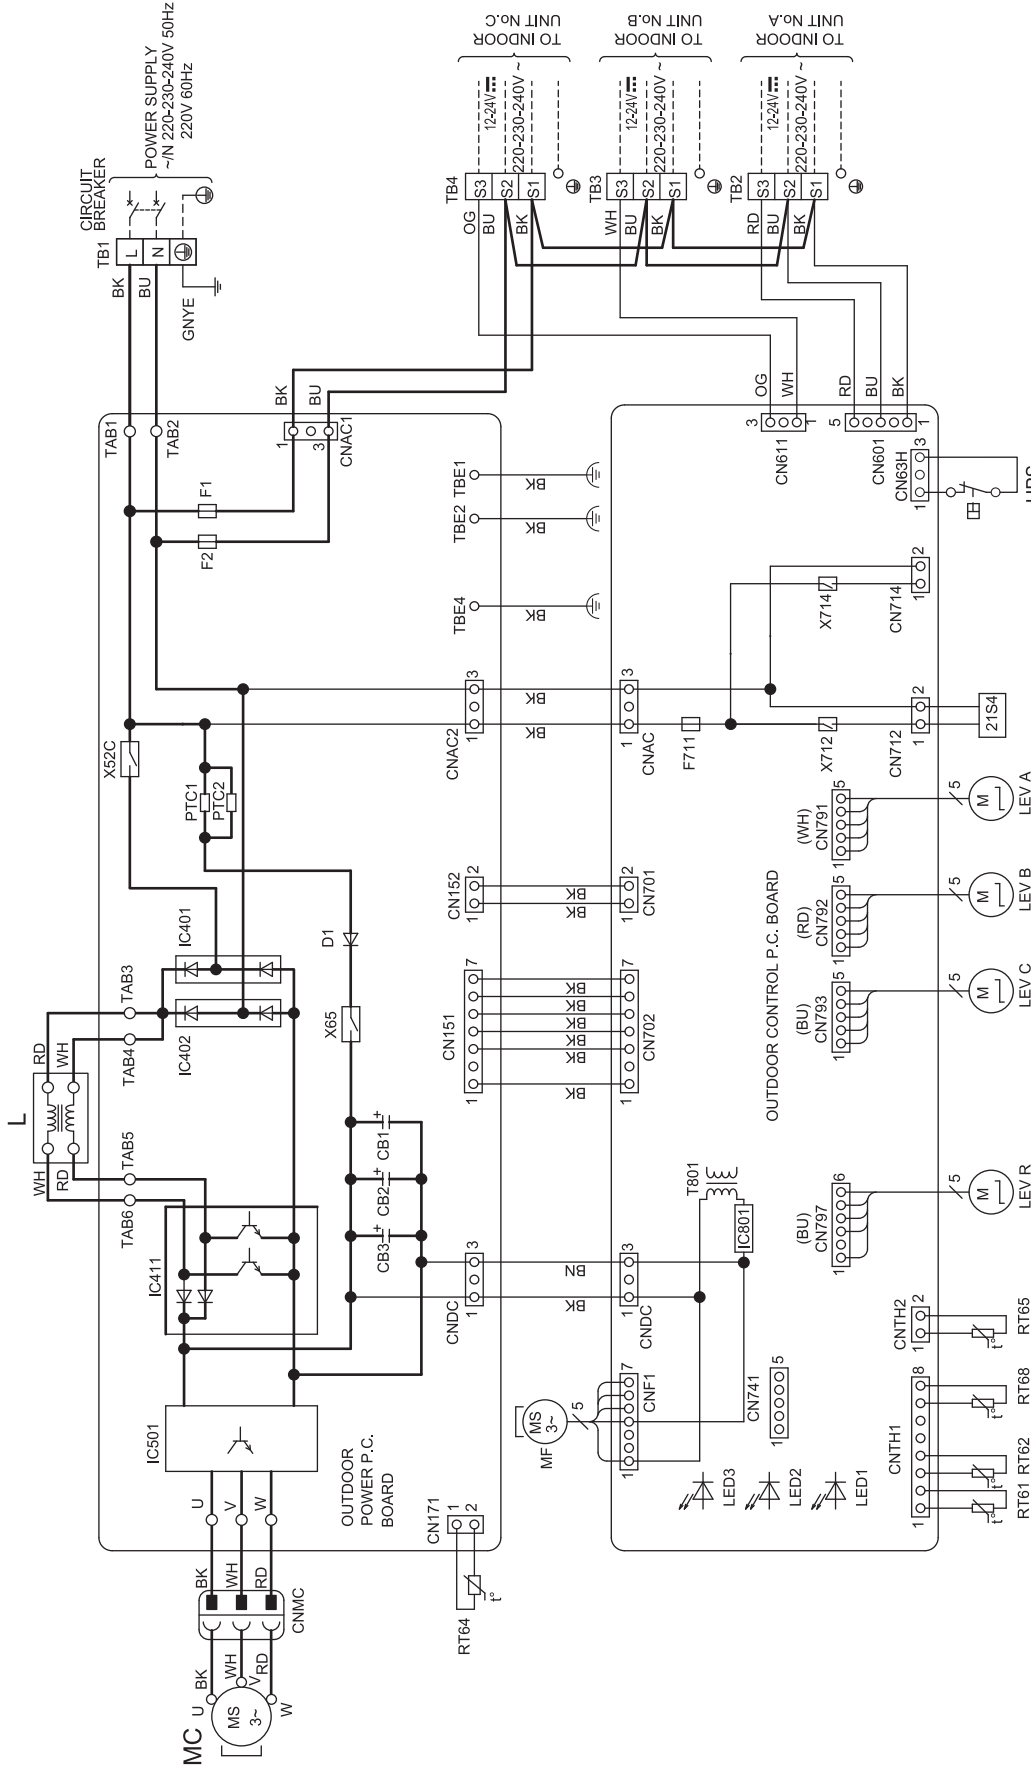


NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only (For field wiring).
 3. Symbols below indicate.
 □: Terminal block
 ○: Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1-3	SMOOTHING CAPACITOR	X52C	RELAY	RT64	EXPANSION VALVE COIL
D1	DIODE	X65	RELAY	RT65	COMPRESSOR
F1	FUSE(T6.3AL250V)	X712	RELAY	RT66	FAN MOTOR
F2	FUSE(T6.3AL250V)	X714	RELAY	PTC1,2	CIRCUIT PROTECTION
F71	FUSE(T3.15AL250V)	21S4	TERMINAL BLOCK	RT61	REACTOR
HPS	HIGH PRESSURE SWITCH			RT62	DISCHARGE TEMP. THERMISTOR
				TB1-4	TERMINAL BLOCK
					SOLENOID COIL

WIRING DIAGRAM
MULTI SYSTEMS

MXZ-4E72VA


OUTDOOR UNIT

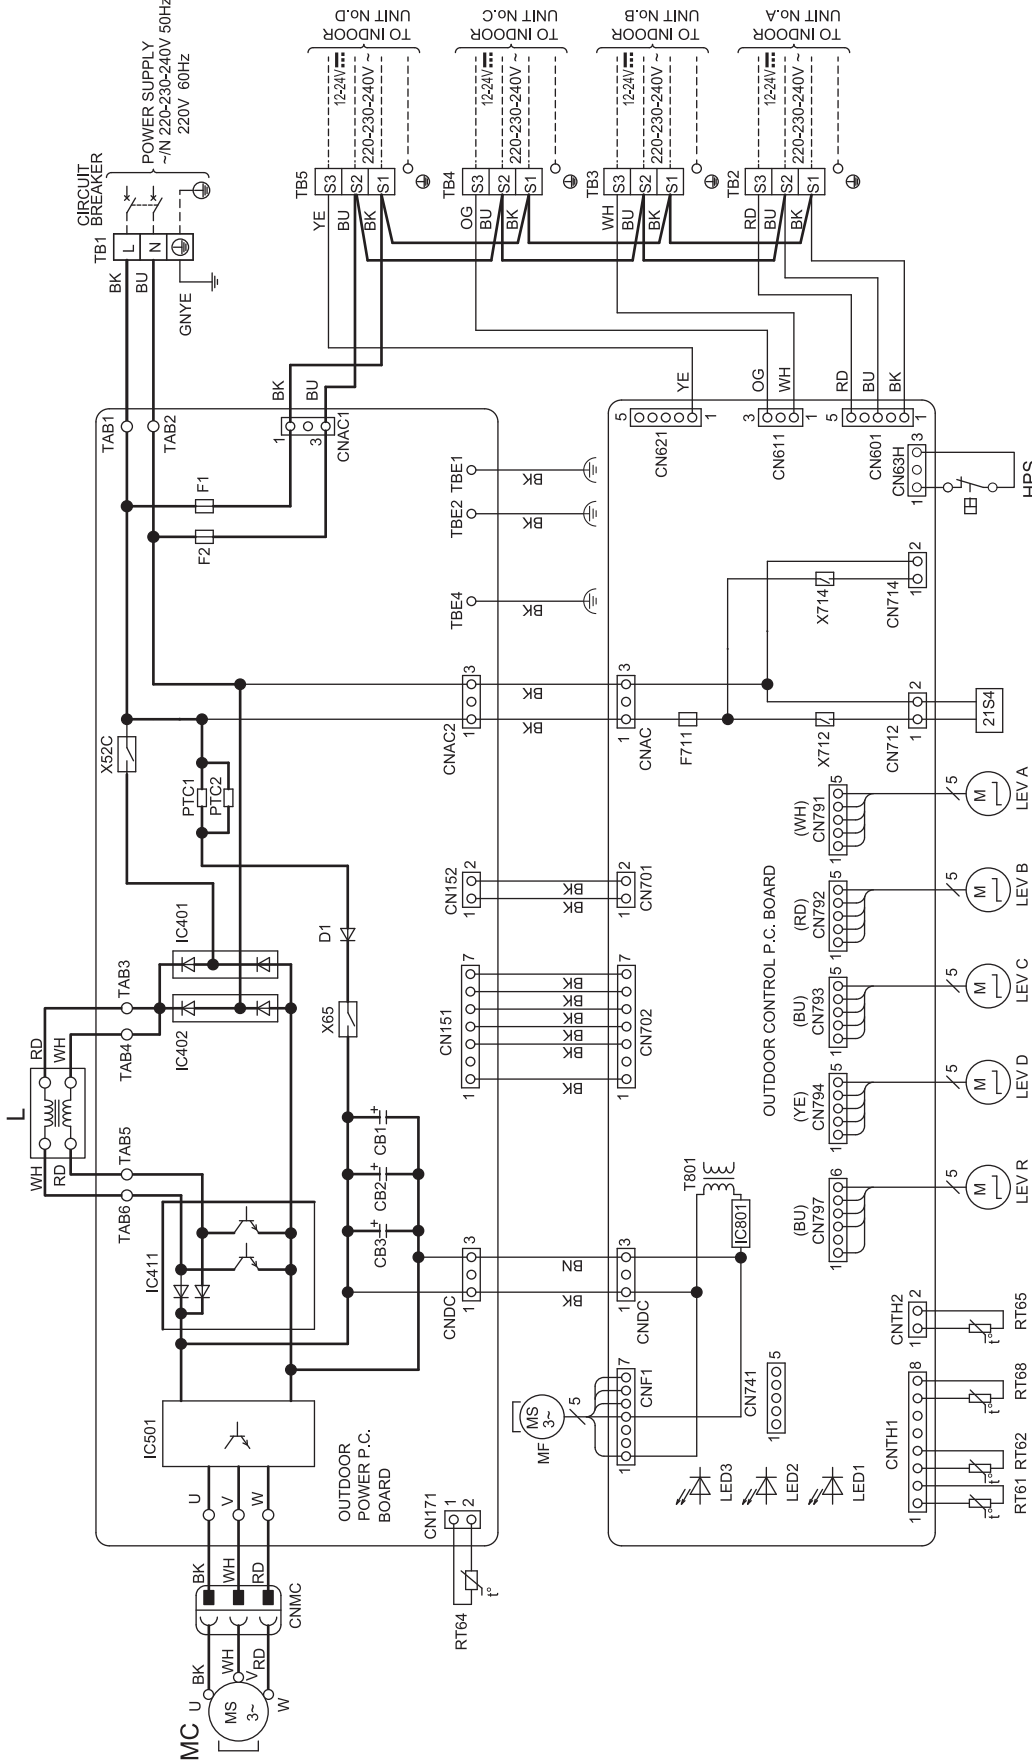

NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only (For field wiring).
 3. Symbols below indicate.
 □ Terminal block
 ○ Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1~3	SMOOTHING CAPACITOR	IC401, 402	DIODE BRIDGE	X52C	RELAY
D1	DIODE	IC411	POWER FACTOR CONTROLLER	X65	RELAY
F1	FUSE(T6.3AL250V)	IC501	POWER MODULE	X712	RELAY
F2	FUSE(T6.3AL250V)	IC801	POWER DEVICE	X714	RELAY
F711	FUSE(T3.75AL250V)	L	REACTOR	TRANSFORMER	REVERSING VALVE
HPS	HIGH PRESSURE SWITCH	LED1~3	LED	21S4	SOLENOID COIL
		MC	COMPRESSOR		
		MF	FAN MOTOR		
		PTC1, 2	CIRCUIT PROTECTION		
		RT61	DEFROST THERMISTOR		
		RT62	DISCHARGE TEMP. THERMISTOR		
		RT64	LEV A-D R. EXPANSION VALVE COIL		
		RT65	LEV A-D R. POWER FACTOR CONTROLLER		
		RT66	LEV A-D R. AMBIENT TEMP. THERMISTOR		
		RT68	LEV A-D R. OUTDOOR HEAT EXCHANGER		
		RT69	LEV A-D R. TEMPERATURE THERMISTOR		
		RT70	LEV A-D R. TRANSFORMER		
		RT71	LEV A-D R. TERMINAL BLOCK		
		RT72	LEV A-D R. FIN TEMP. THERMISTOR		
		RT73	LEV A-D R. AMBIENT TEMP. THERMISTOR		
		RT74	LEV A-D R. OUTDOOR HEAT EXCHANGER		
		RT75	LEV A-D R. TEMPERATURE THERMISTOR		
		RT76	LEV A-D R. TRANSFORMER		
		RT77	LEV A-D R. TERMINAL BLOCK		
		RT78	LEV A-D R. FIN TEMP. THERMISTOR		
		RT79	LEV A-D R. AMBIENT TEMP. THERMISTOR		
		RT80	LEV A-D R. OUTDOOR HEAT EXCHANGER		
		RT81	LEV A-D R. TEMPERATURE THERMISTOR		
		RT82	LEV A-D R. TRANSFORMER		
		RT83	LEV A-D R. TERMINAL BLOCK		
		RT84	LEV A-D R. FIN TEMP. THERMISTOR		
		RT85	LEV A-D R. AMBIENT TEMP. THERMISTOR		
		RT86	LEV A-D R. OUTDOOR HEAT EXCHANGER		
		RT87	LEV A-D R. TEMPERATURE THERMISTOR		
		RT88	LEV A-D R. TRANSFORMER		
		RT89	LEV A-D R. TERMINAL BLOCK		
		RT90	LEV A-D R. FIN TEMP. THERMISTOR		
		RT91	LEV A-D R. AMBIENT TEMP. THERMISTOR		
		RT92	LEV A-D R. OUTDOOR HEAT EXCHANGER		
		RT93	LEV A-D R. TEMPERATURE THERMISTOR		
		RT94	LEV A-D R. TRANSFORMER		
		RT95	LEV A-D R. TERMINAL BLOCK		
		RT96	LEV A-D R. FIN TEMP. THERMISTOR		
		RT97	LEV A-D R. AMBIENT TEMP. THERMISTOR		
		RT98	LEV A-D R. OUTDOOR HEAT EXCHANGER		
		RT99	LEV A-D R. TEMPERATURE THERMISTOR		
		RT100	LEV A-D R. TRANSFORMER		
		RT101	LEV A-D R. TERMINAL BLOCK		

MXZ-4E83VA
OUTDOOR UNIT

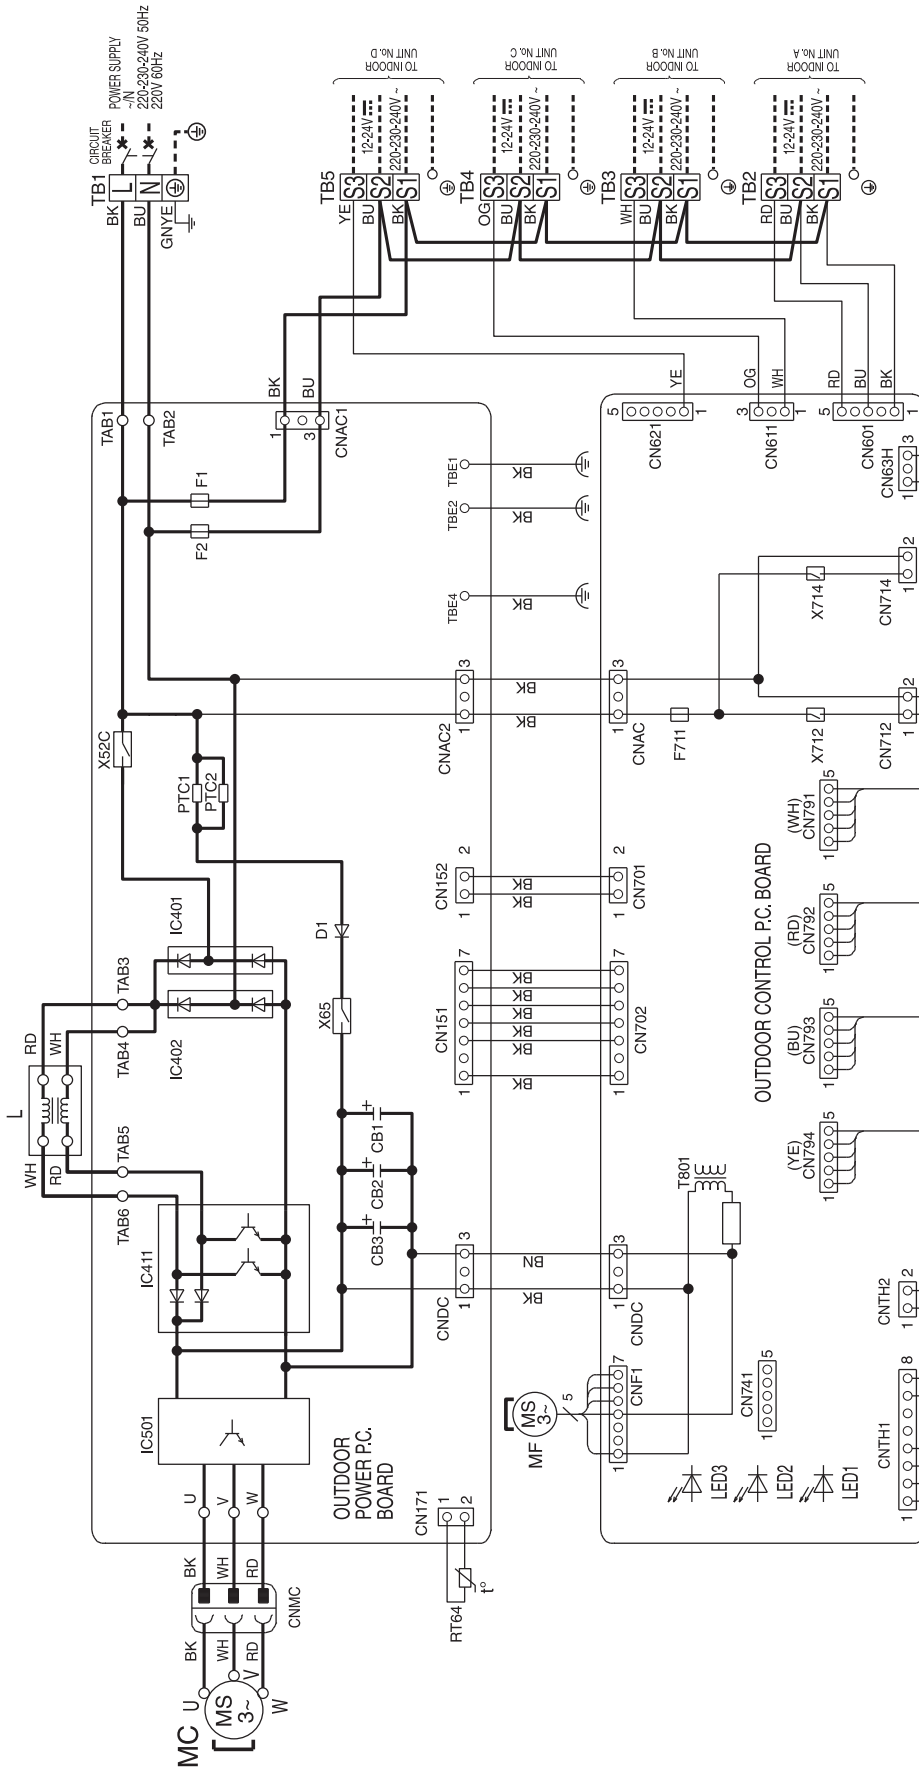


- NOTES:
- About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 - Use copper conductors only for field wiring.
 - Symbols below indicate:
 □ : Terminal block
 ○ : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1-3	SMOOTHING CAPACITOR	IC401, 402	DIODE BRIDGE	RT64	FIN TEMP. THERMISTOR
D1	DIODE	IC411	POWER FACTOR CONTROLLER	RT65	AMBIENT TEMP. THERMISTOR
F1	FUSE (T6.3AL 250V)	IC501	POWER MODULE	RT68	OUTDOOR HEAT EXCHANGER
F2	FUSE (T6.3AL 250V)	IC801	POWER DEVICE	PTC1, 2	TEMPERATURE THERMISTOR
F711	FUSE (T3.15AL 250V)	L	REACTOR	RT61	DEFROST THERMISTOR
HPS	HIGH PRESSURE SWITCH	LED1-3	LED	RT62	DISCHARGE TEMP. THERMISTOR
		LEV A-D	EXPANSION VALVE COIL	LEV A	SOLENOID COIL
		MC	COMPRESSOR	LEV B	
		MF	FAN MOTOR	LEV C	
		PTC1, 2	CIRCUIT PROTECTION	LEV D	
		RT61	REACTOR		
		RT62	DISCHARGE TEMP. THERMISTOR		
		RT64	FIN TEMP. THERMISTOR		
		RT65	AMBIENT TEMP. THERMISTOR		
		RT68	OUTDOOR HEAT EXCHANGER		
		X712	TEMPERATURE THERMISTOR		
		X714	TEMPERATURE THERMISTOR		
		21S4	SOLENOID COIL		

MULTI SYSTEMS WIRING DIAGRAM

MXZ-5E102VA

OUTDOOR UNIT

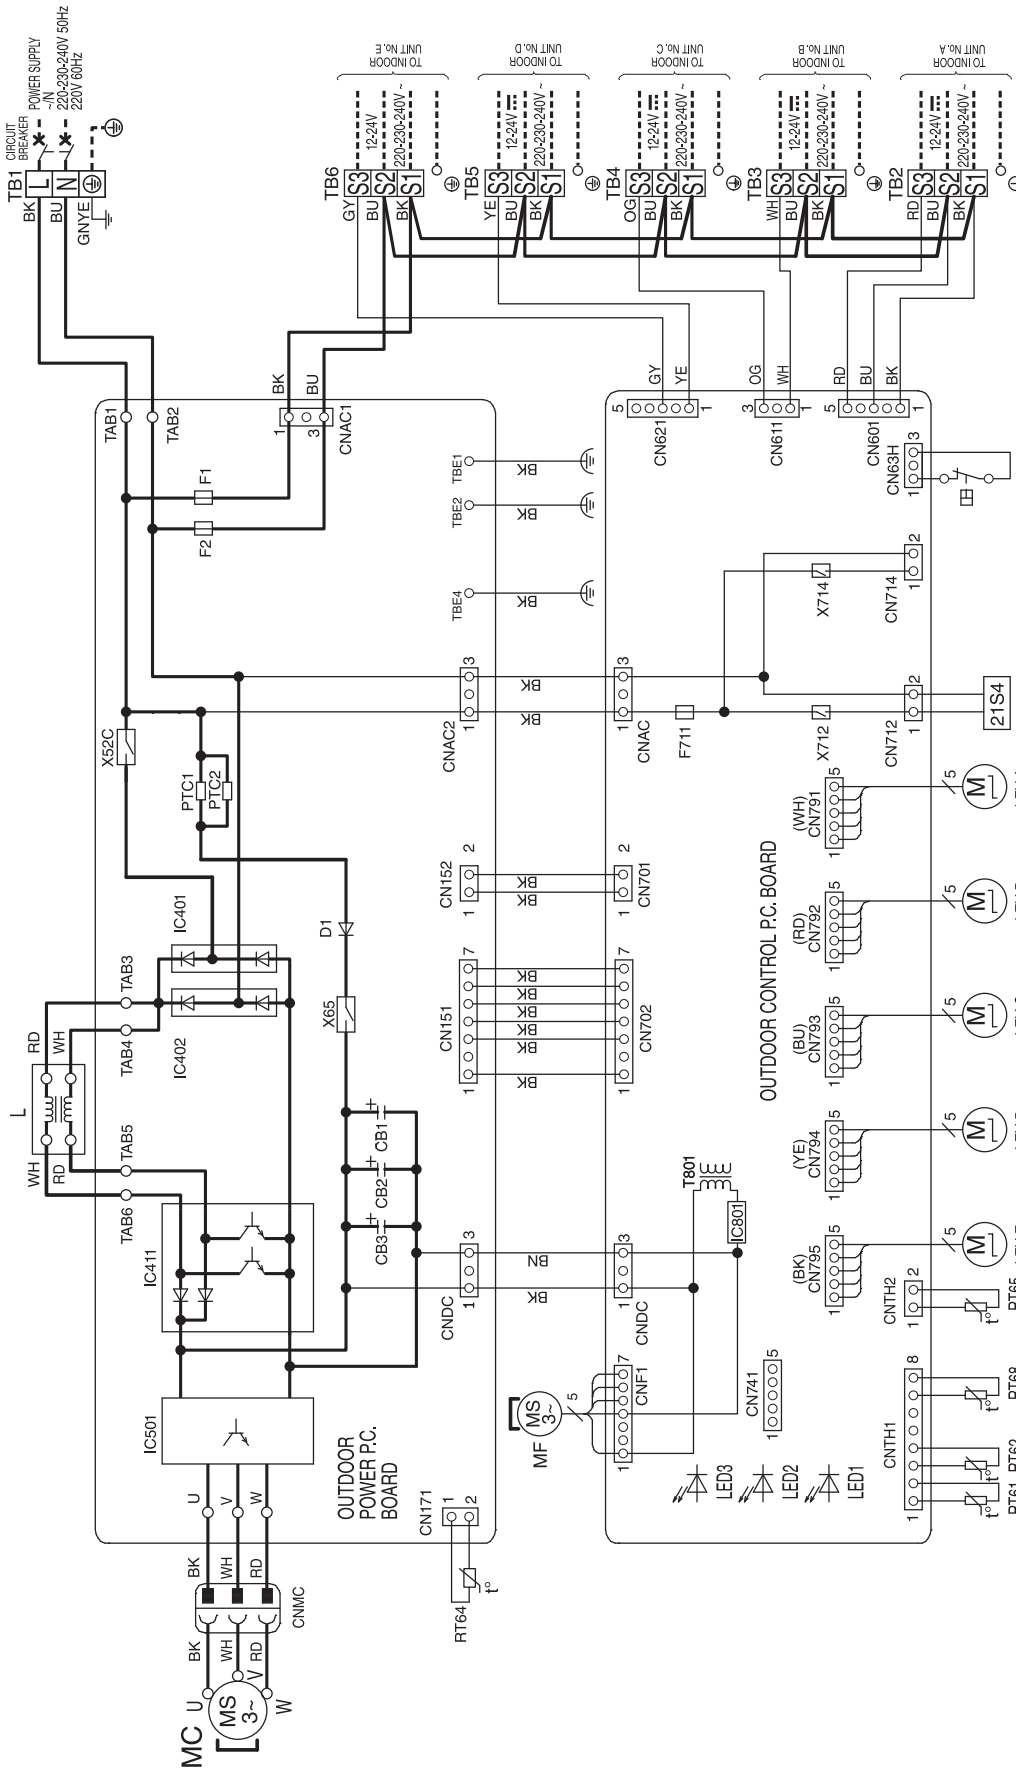


- NOTES:
1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only (For field wiring).
 3. Symbols below indicate.
 - : Terminal block
 - : Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1-3	SMOOTHING CAPACITOR	IC401, 402	DIODE BRIDGE	RT64	DISCHARGE TEMP.THERMISTOR	X52C	RELAY
D1	DIODE	IC411	POWER FACTOR CONTROLLER	RT65	AMBIENT TEMP.THERMISTOR	X65	RELAY
F1	FUSE (T6.3AL 250V)	IC501	POWER MODULE	RT66	OUTDOOR HEAT EXCHANGER	X712	RELAY
F2	FUSE (T6.3AL 250V)	IC801	POWER DEVICE	PTC1, 2	CIRCUIT PROTECTION	X714	RELAY
F711	FUSE (T3.15AL 250V)	L	REACTOR	RT61	DEFROST THERMISTOR	X714	RELAY
HPS	HIGH PRESSURE SWITCH	LED1-3	LED	RT62	DISCHARGE TEMP.THERMISTOR	21S4	SOLENOID COIL

MXZ-6D122VA2
OUTDOOR UNIT


TO INDOOR UNIT No.A
TO INDOOR UNIT No.B
TO INDOOR UNIT No.C
TO INDOOR UNIT No.D
TO INDOOR UNIT No.E
TO INDOOR UNIT No.F
POWER SUPPLY -/N 220-230-240V 50Hz

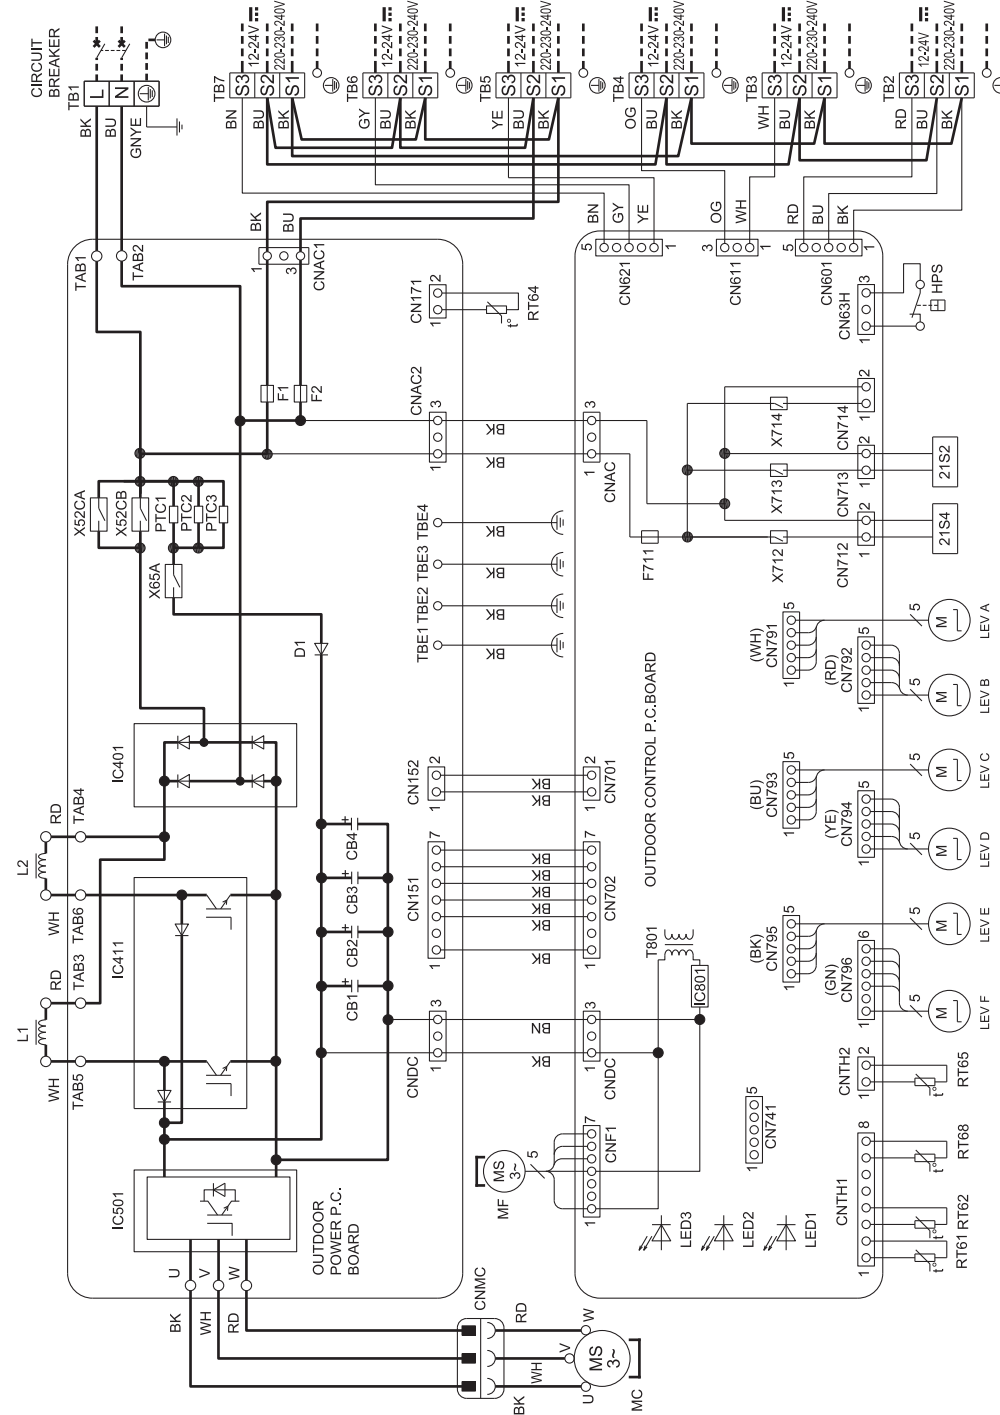

NOTES:
1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
2. Use copper conductors only (For field wiring).
3. Symbols below indicate:
□ □ □ □ : Terminal block
□ □ □ □ : Connector

SYMBOL	NAME	SYMBOL	NAME
CB1-4	SMOOTHING CAPACITOR	RT61	DEFROST THERMISTOR
D1	DIODE	RT62	DISCHARGE TEMP.THERMISTOR
F1,F2	FUSE(T6.3A/250V)	RT64	FIN TEMP.THERMISTOR
F711	FUSE(T3.15A/250V)	RT65	AMBIENT TEMP.THERMISTOR
HPS	HIGH PRESSURE SWITCH	RT68	OUTDOOR HEAT EXCHANGER TEMPERATURE THERMISTOR
IC401	DIODE BRIDGE	T801	TRANSFORMER
IC411	POWER MODULE	TB1-7	TERMINAL BLOCK
IC501	POWER DEVICE	X52CA B	RELAY
L1,L2	REACTOR	X65A	RELAY
LED1-3	LED	X712	RELAY
LEV-A-F	EXPANSION VALVE COIL	X713	RELAY
MC	COMPRESSOR	X714	RELAY
MF	FAN MOTOR	21S2	2WAY VALVE SOLENOID COIL
PTC1-3	CIRCUIT PROTECTION	21S4	REVERSING VALVE SOLENOID COIL


MXZ-2DM40VA
OUTDOOR UNIT

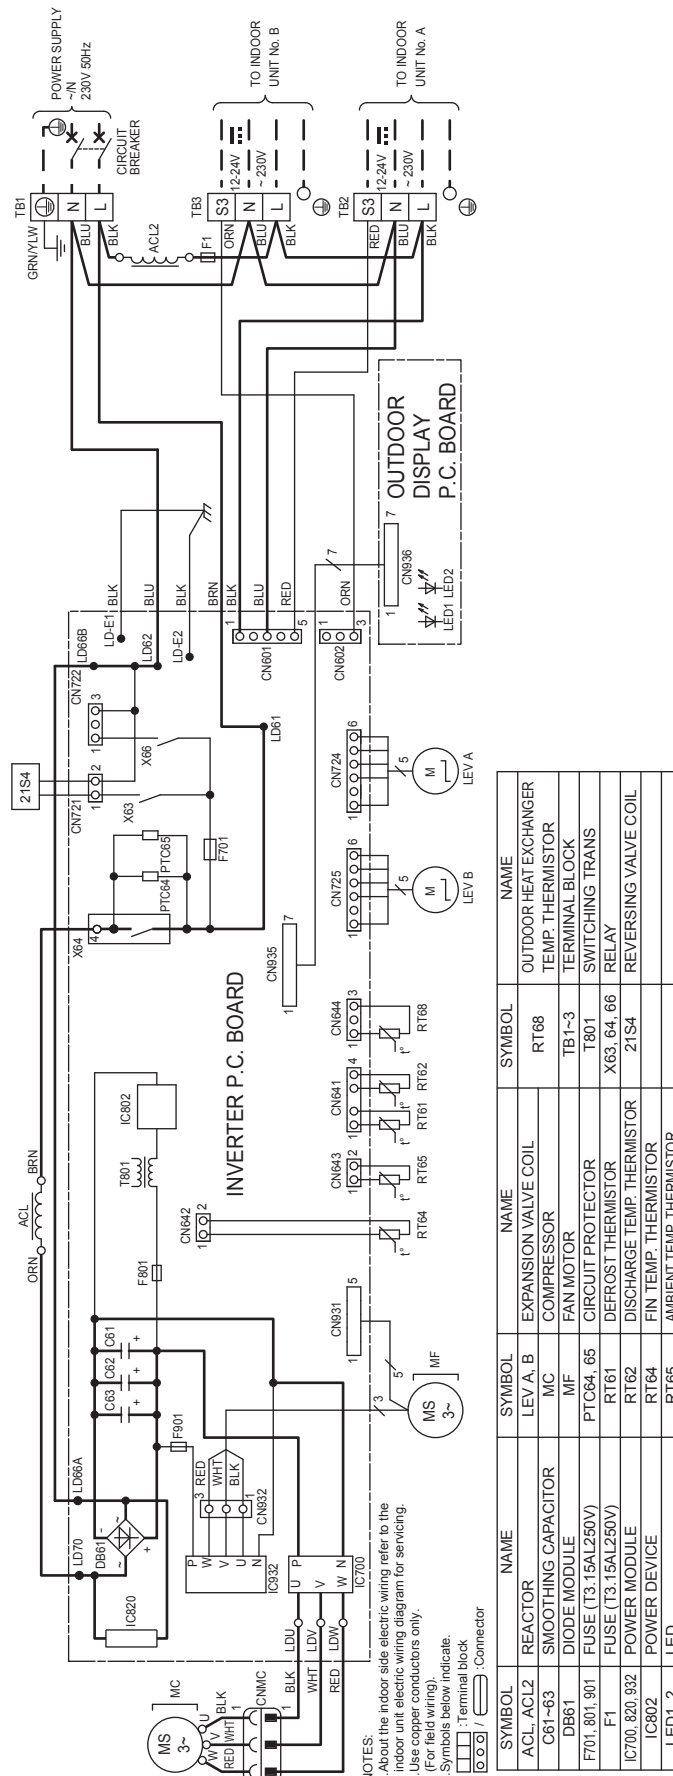

NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only.
 3. Symbols below indicate.

Terminal block
 Connector


MXZ-2HA40VF MXZ-2HA50VF
OUTDOOR UNIT

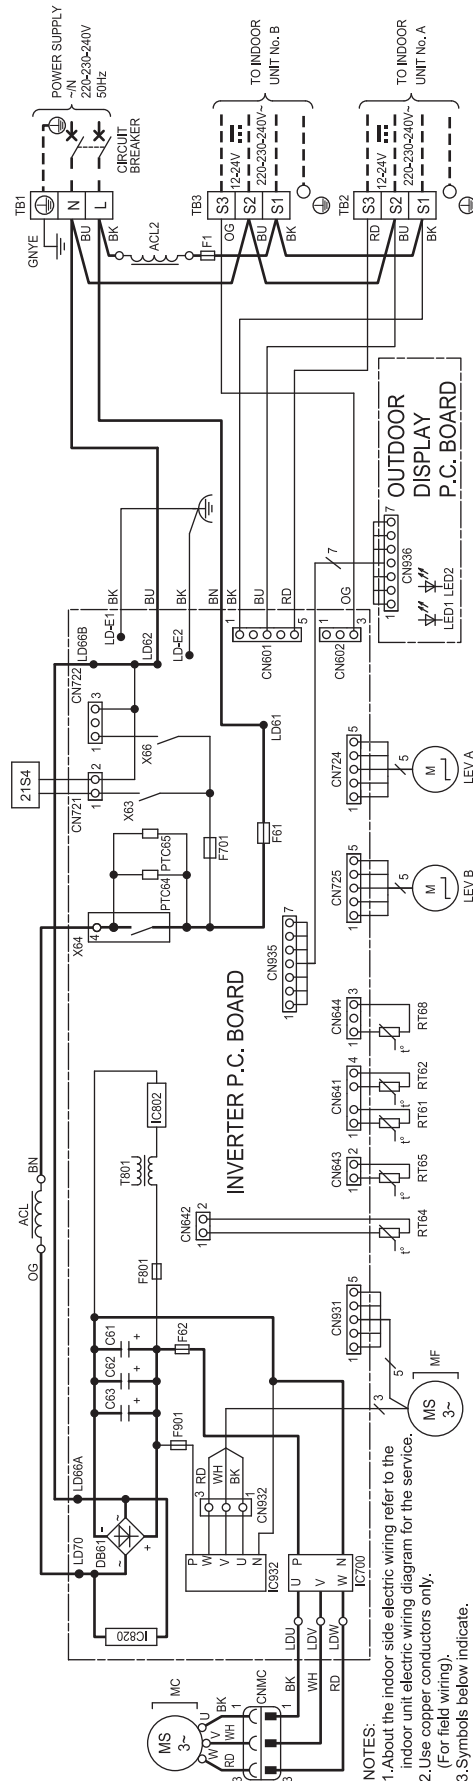

NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for the service. (For field wiring).
 2. Use copper conductors only.
 3. Symbols below indicate.
 □: Terminal block
 ○: Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
ACL, ACL2	REACTOR	IC802	POWER DEVICE	RT64	FIN TEMP. THERMISTOR
C61-63	SMOOTHING CAPACITOR	LED1, 2	LED	RT65	AMBIENT TEMP. THERMISTOR
DB61	DIODE MODULE	LEV A, B	EXPANSION VALVE COIL	RT68	OUTDOOR HEAT EXCHANGER TEMP. THERMISTOR
F701, 801, 901	FUSE (T3.15A/250V)	MC	COMPRESSOR	TB1-3	TERMINAL BLOCK
F1	FUSE (T3.15A/250V)	MF	FAN MOTOR	T801	TRANSFORMER
F61	FUSE (25A 250V)	PTC64, 65	CIRCUIT PROTECTOR	X63, 64, 66	REVERSING VALVE COIL
F62	FUSE (15A 250V)	RT61	DEFROST THERMISTOR	21S4	REVERSING VALVE COIL
IC700, 820, 932	POWER MODULE	RT62	DISCHARGE TEMP. THERMISTOR		


MXZ-3HA50VF
OUTDOOR UNIT

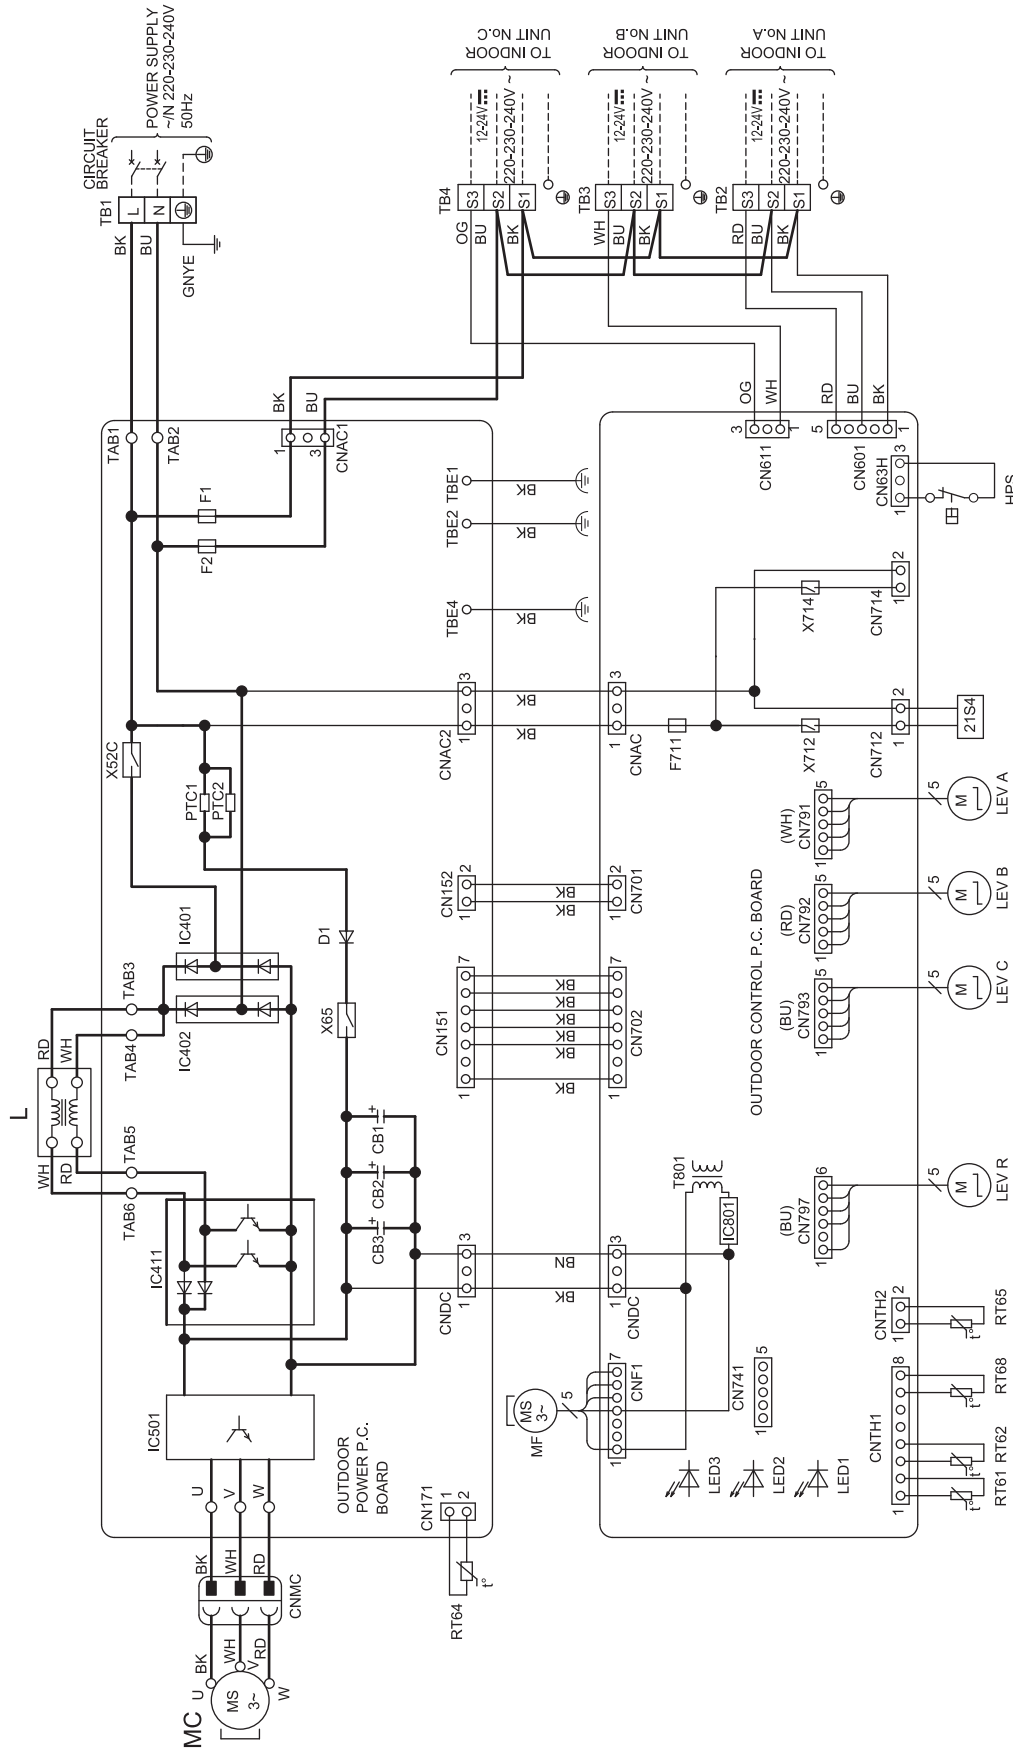

NOTES:
 1. About the indoor side electric wiring refer to the indoor unit electric wiring diagram for the service.
 2. Use copper conductors only (For field wiring).
 3. Symbols below indicate.
 □ Terminal block
 ○ Connector

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1-3	SMOOTHING CAPACITOR	IC401,402	DIODE BRIDGE	LEV A-CR	EXPANSION VALVE COIL	X52C	RELAY
D1	DIODE	IC411	POWER FACTOR CONTROLLER	RT64	FIN TEMP. THERMISTOR	X62C	RELAY
F1	FUSE(T6.3AL250V)	IC501	POWER MODULE	MC	COMPRESSOR	X65	RELAY
F2	FUSE(T6.3AL250V)	IC801	POWER DEVICE	MF	FAN MOTOR	X712	RELAY
F711	FUSE(T6.3AL250V)	L	REACTOR	PTC1,2	CIRCUIT PROTECTOR	X714	RELAY
HPS	HIGH PRESSURE SWITCH	LED1-3	LED	RT61	DEFROST THERMISTOR	TRANSFORMER	REVERSING VALVE
				RT62	DISCHARGE TEMP. THERMISTOR	TB1-4	TERMINAL BLOCK
						21S4	SOLENOID COIL

MXZ-2E53VAHZ
OUTDOOR UNIT

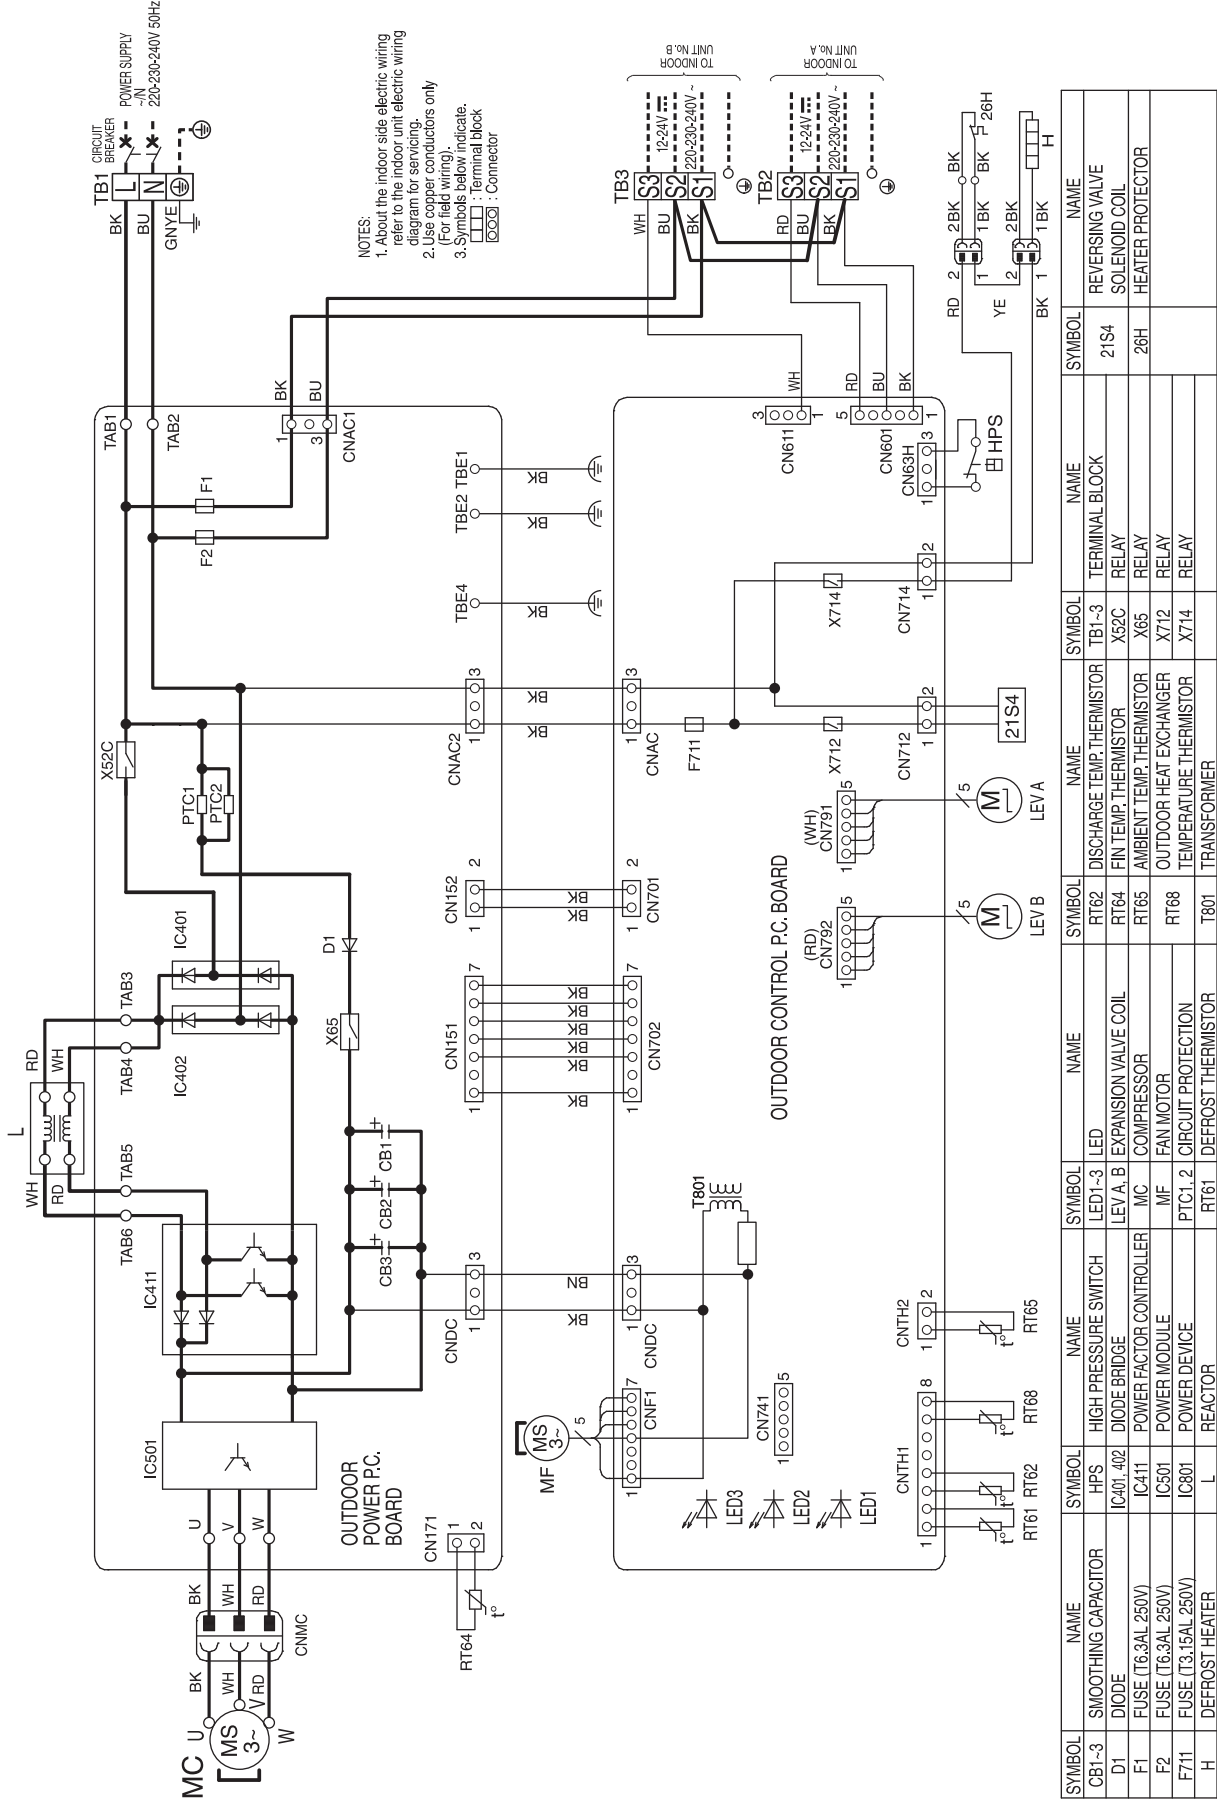


SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
CB1-3	SMOOTHING CAPACITOR	HPS	HIGH PRESSURE SWITCH	TB1-3	TERMINAL BLOCK		
D1	DIODE	IC401, 402	DIODE BRIDGE	X62C	RELAY	21S4	REVERSING VALVE SOLENOID COIL
F1	FUSE (T6.3AL 250V)	IC411	POWER FACTOR CONTROLLER	X65	RELAY	28H	HEATER PROTECTOR
F2	FUSE (T6.3AL 250V)	IC501	POWER MODULE	X712	RELAY		
F711	FUSE (T3.15AL 250V)	IC801	POWER DEVICE	X714	RELAY		
H	DEFROST HEATER	L	REACTOR	T801	TRANSFORMER		

C.4.4 REFRIGERANT SYSTEM DIAGRAM

C.4.4.1 Inverter Heat Pump


Unit: mm

MXZ-2F33VF

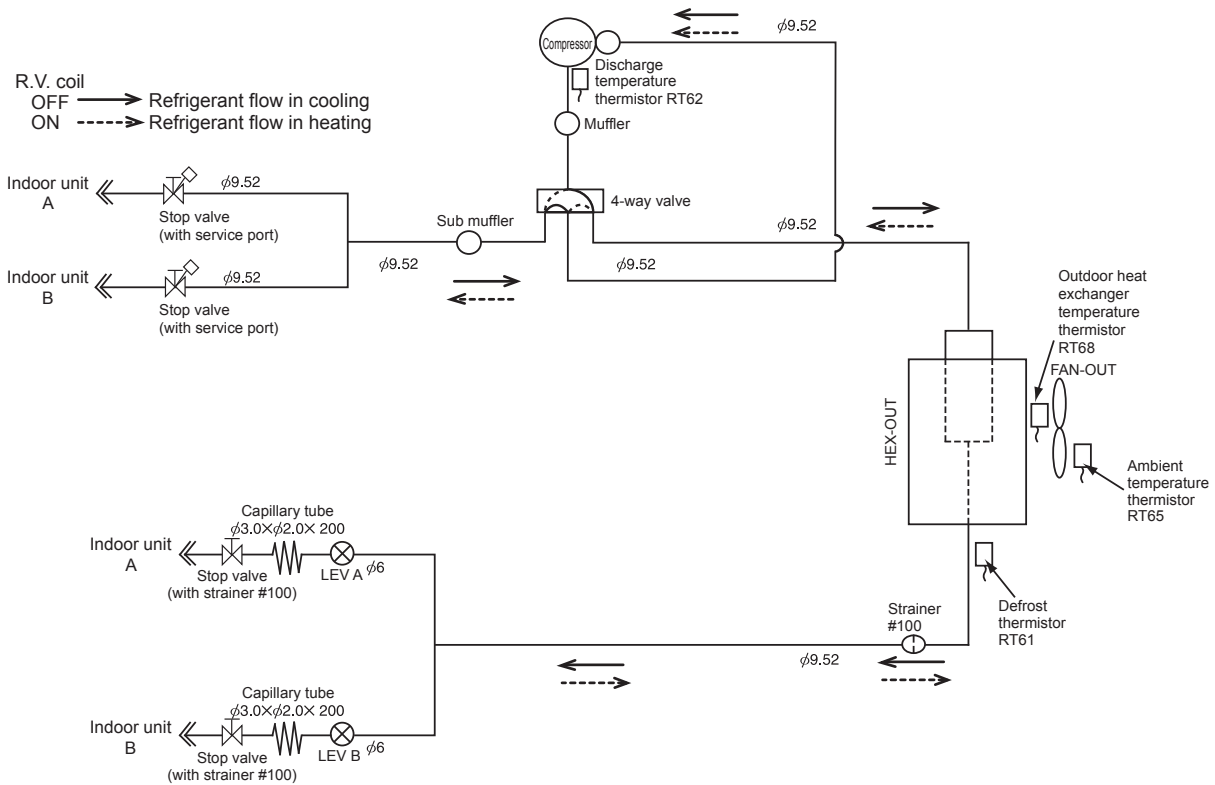

MXZ-2F42VF MXZ-2F53VF MXZ-2F53VFH MXZ-2HA40VF MXZ-2HA50VF


Unit: mm

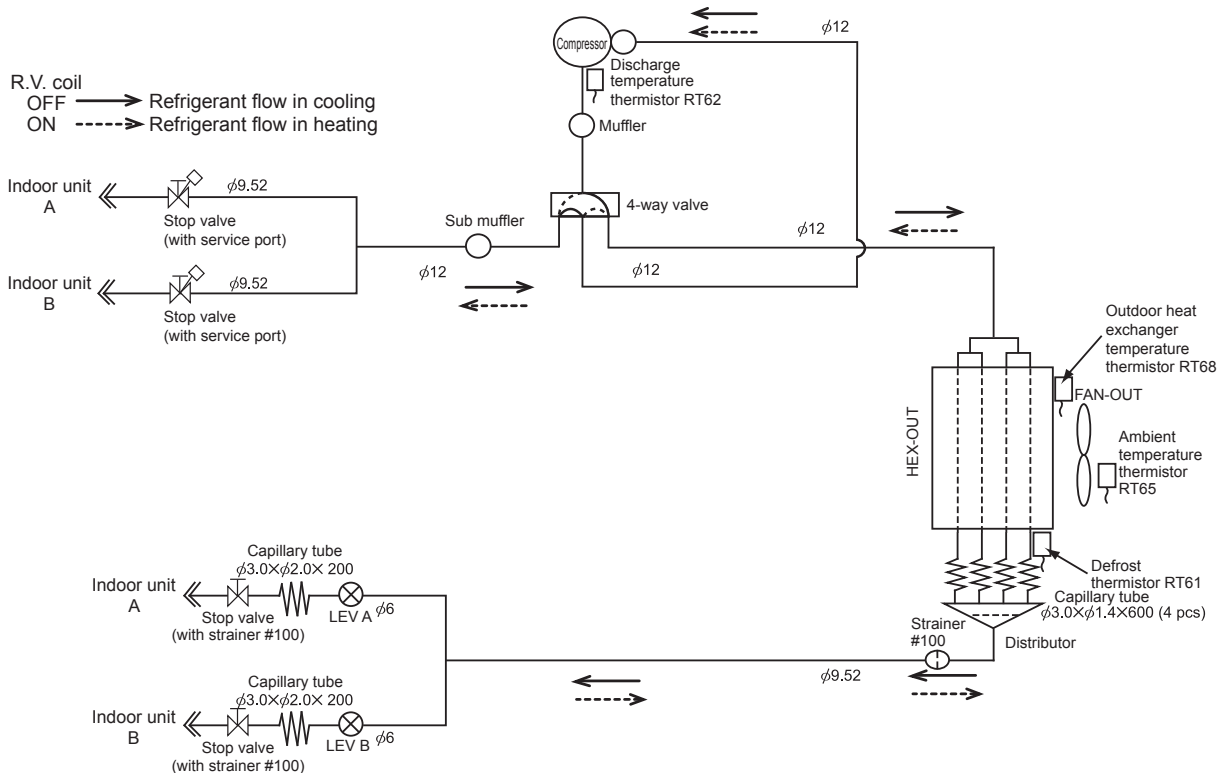

MULTI SYSTEMS REFRIGERANT SYSTEM DIAGRAM


MXZ-3F54VF2 MXZ-3F68VF2 MXZ-3HA50VF

Unit: mm

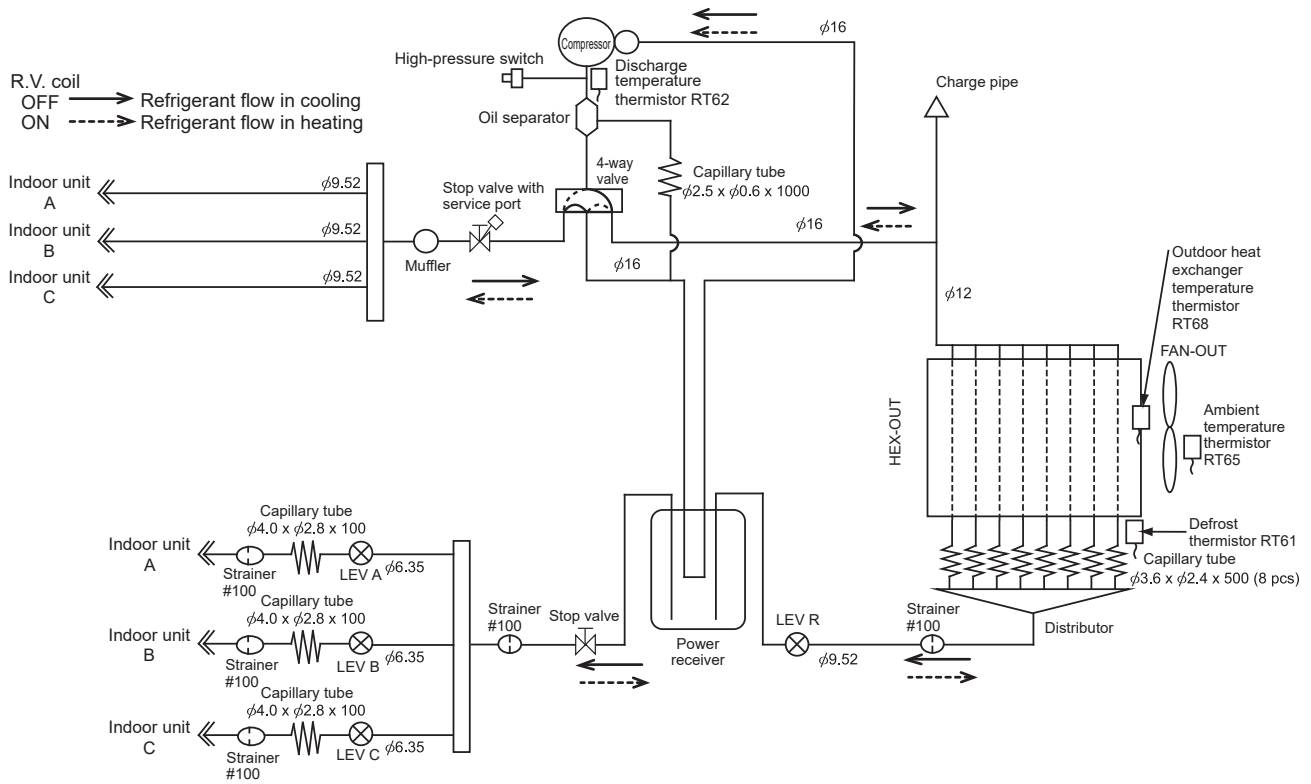

MXZ-4F72VF2 MXZ-4F80VF2


Unit: mm

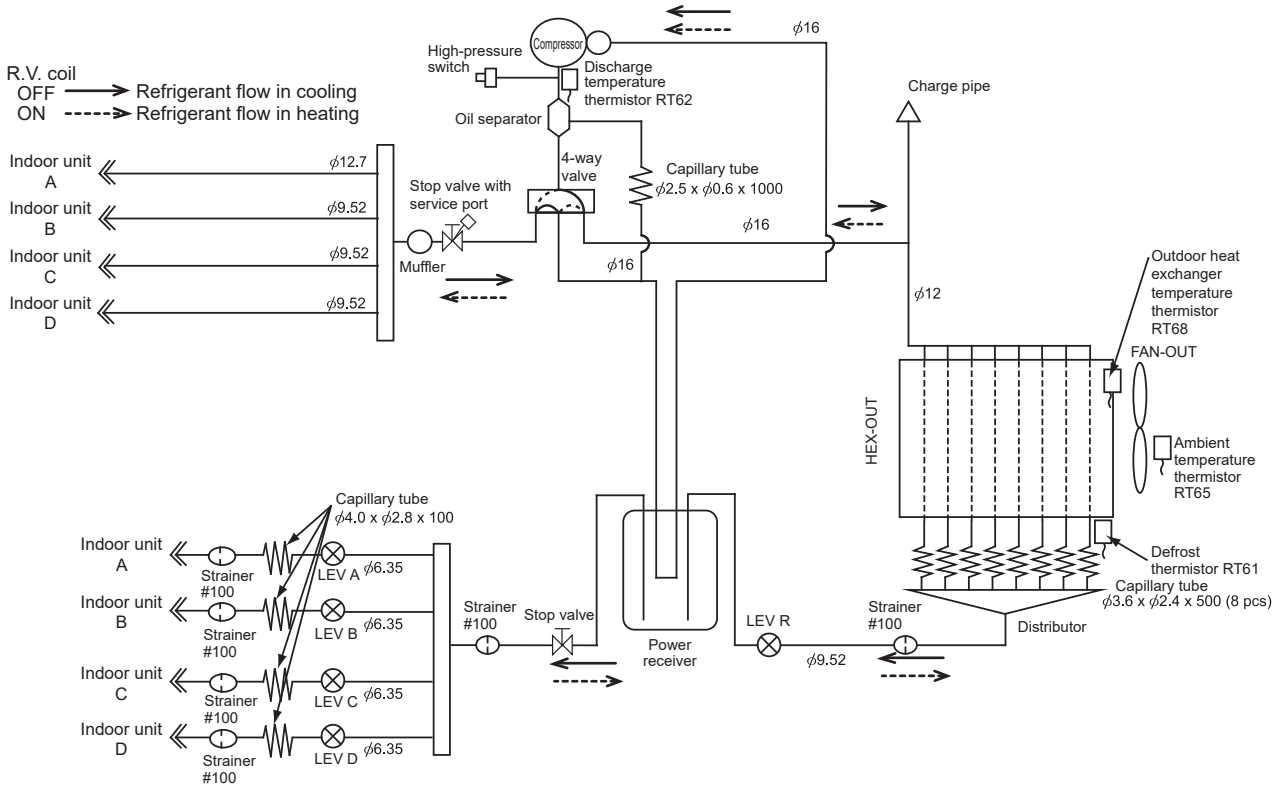

REFRIGERANT SYSTEM DIAGRAM MULTI SYSTEMS


MXZ-2D33VA

Unit: mm

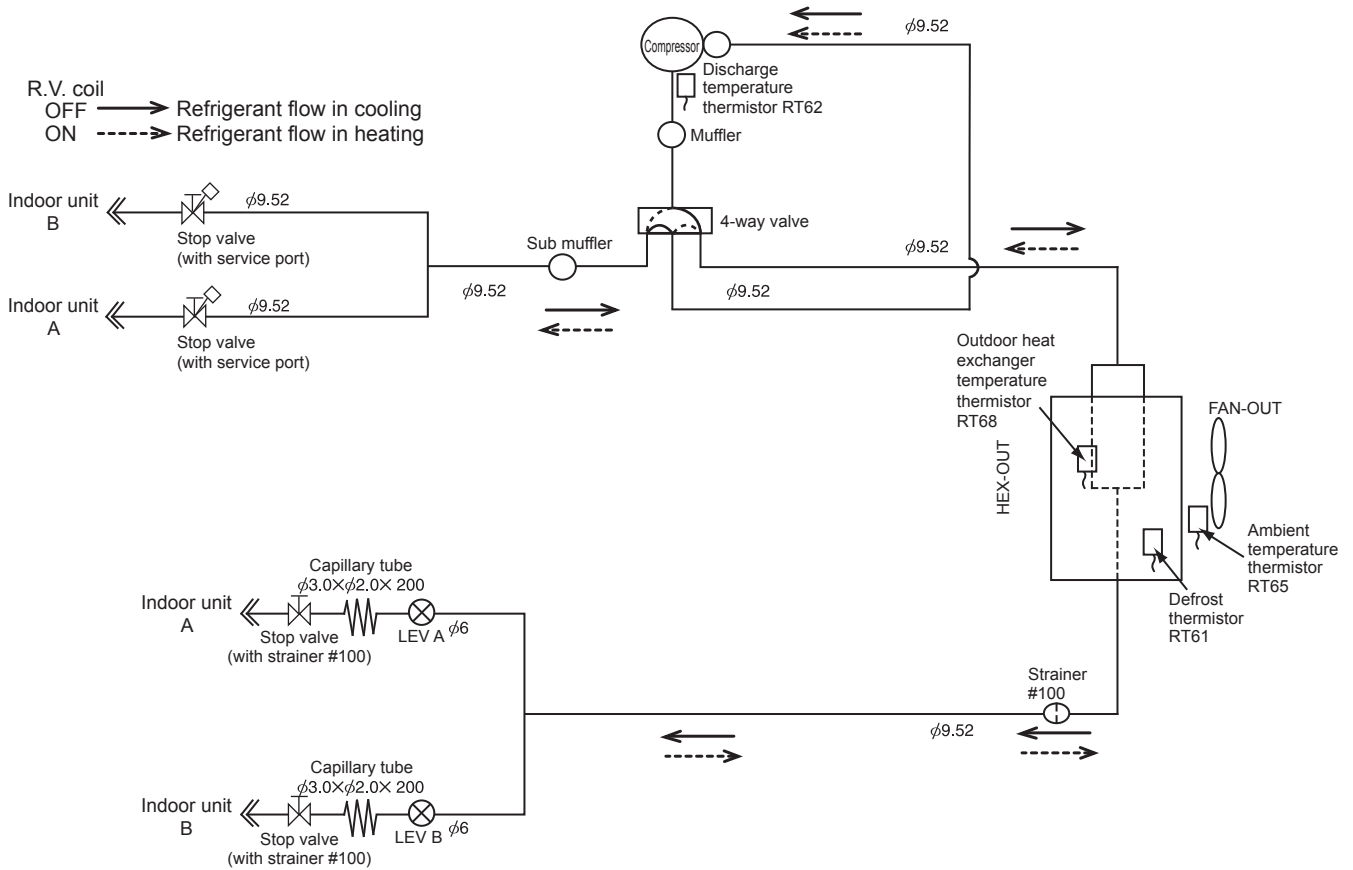

MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2


Unit: mm

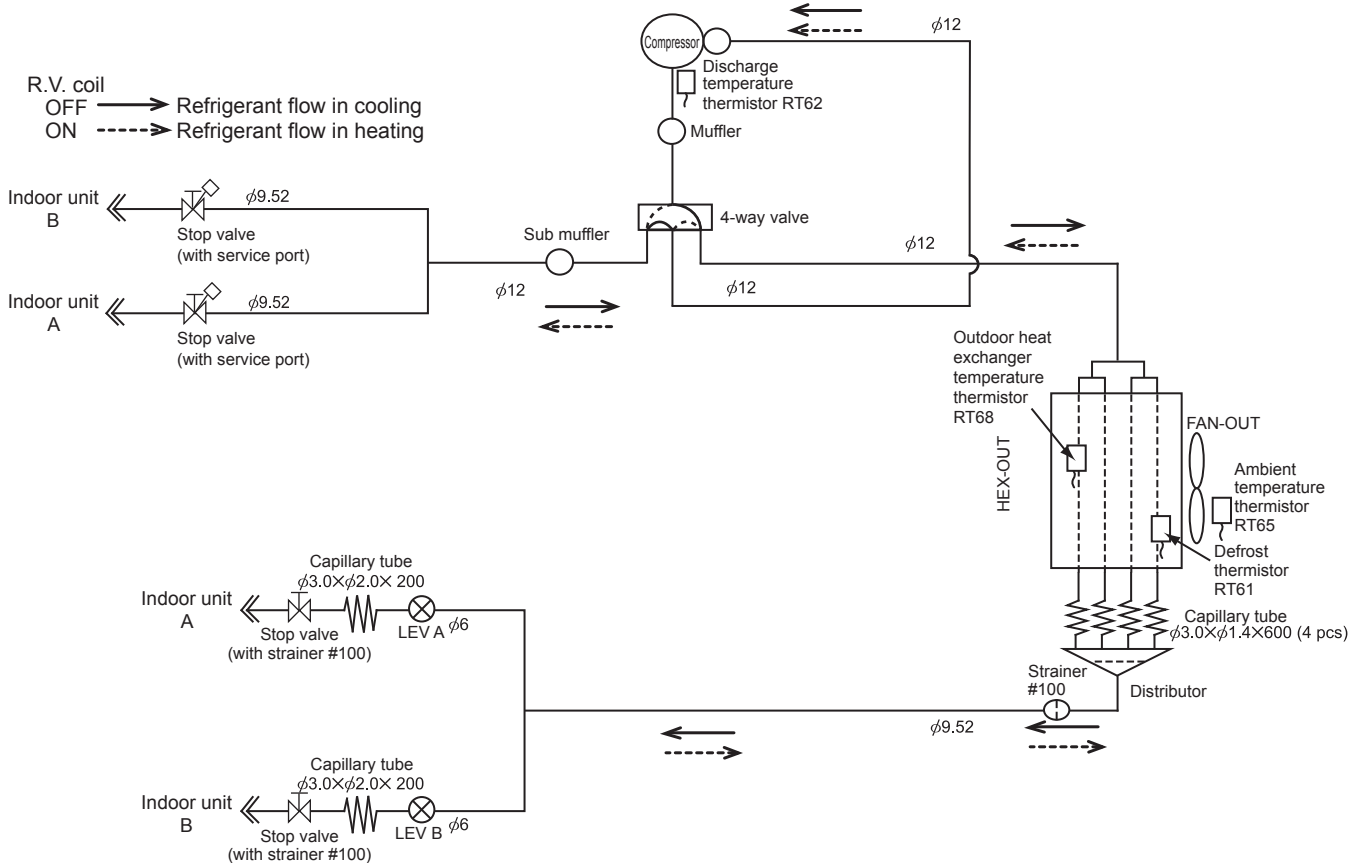

MULTI SYSTEMS REFRIGERANT SYSTEM DIAGRAM


MXZ-3E54VA MXZ-3E68VA

Unit: mm

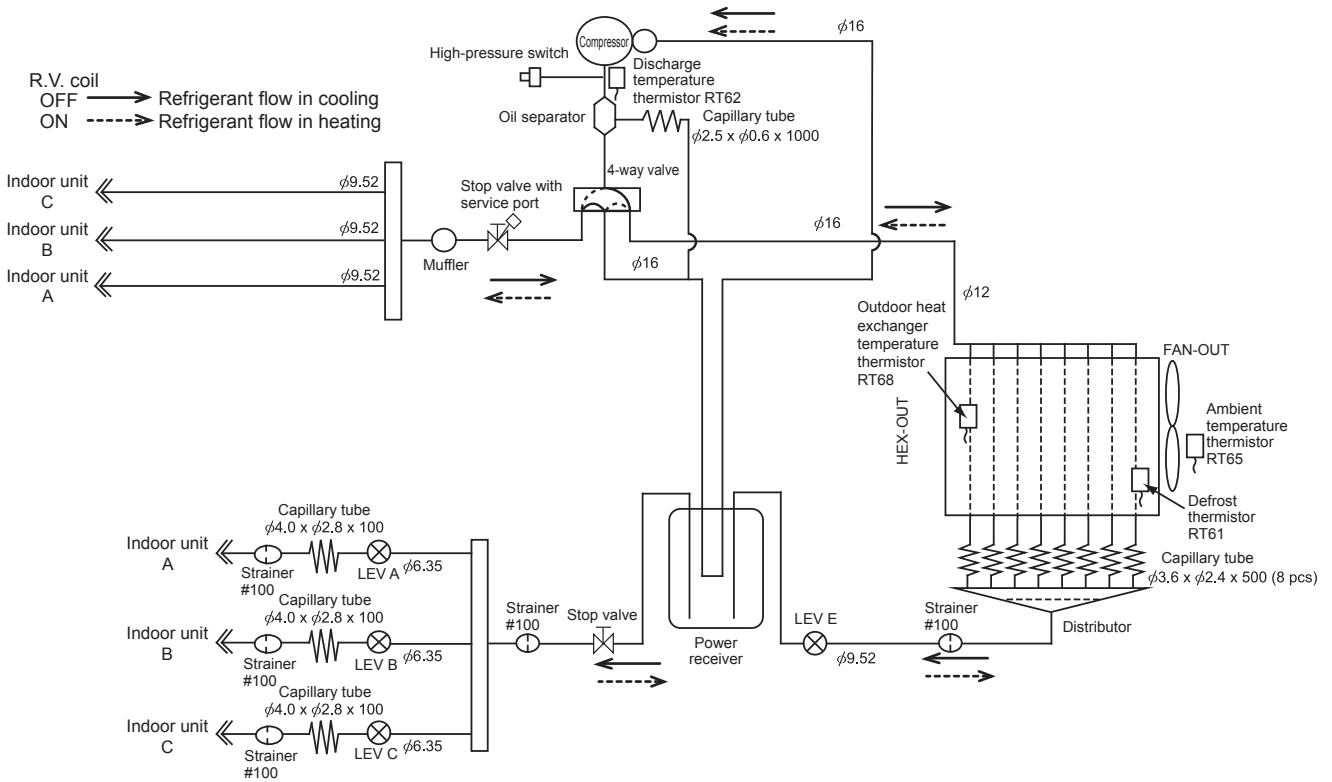

MXZ-4E72VA

Unit: mm

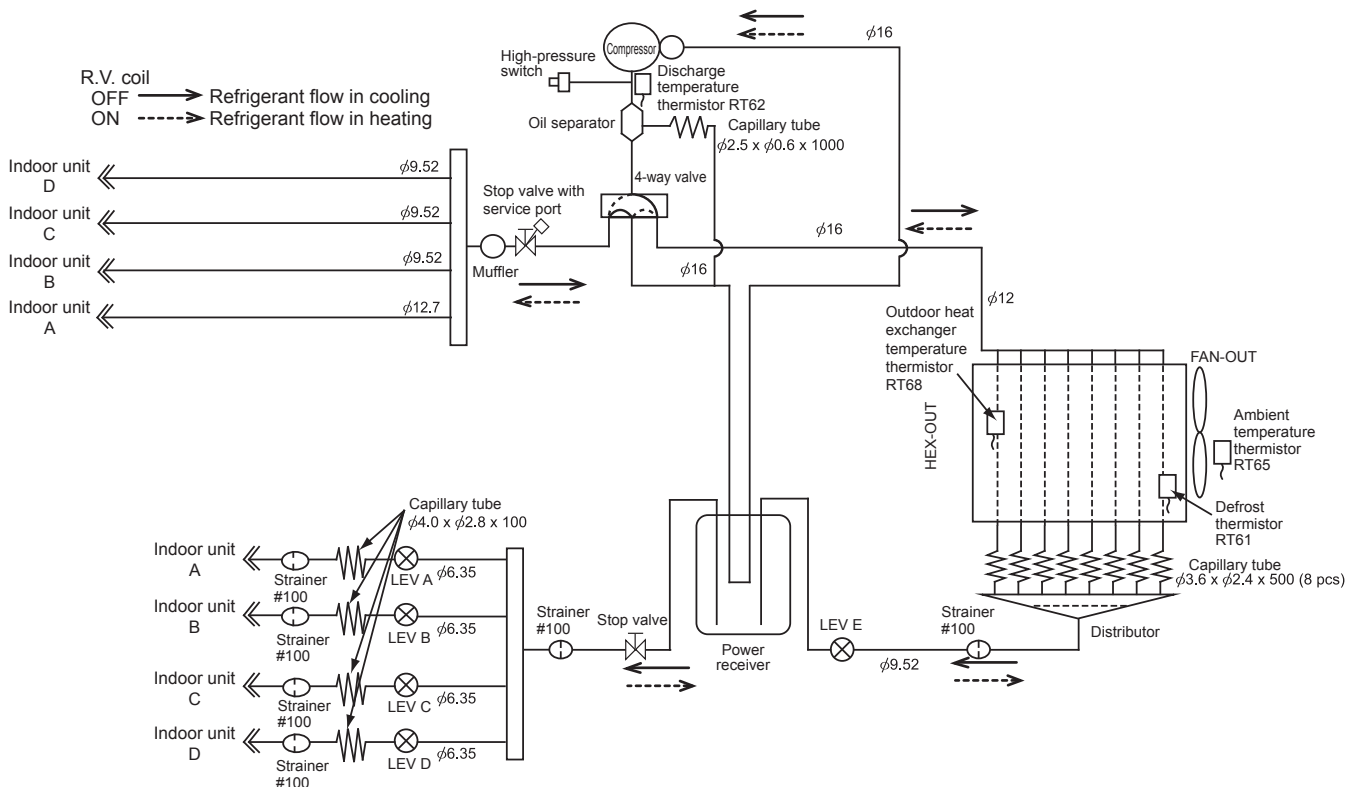


REFRIGERANT SYSTEM DIAGRAM MULTI SYSTEMS

MXZ-4E83VA

Unit: mm


R.V.coil
 OFF → Refrigerant flow in heating
 ON - - - - - Refrigerant flow in cooling

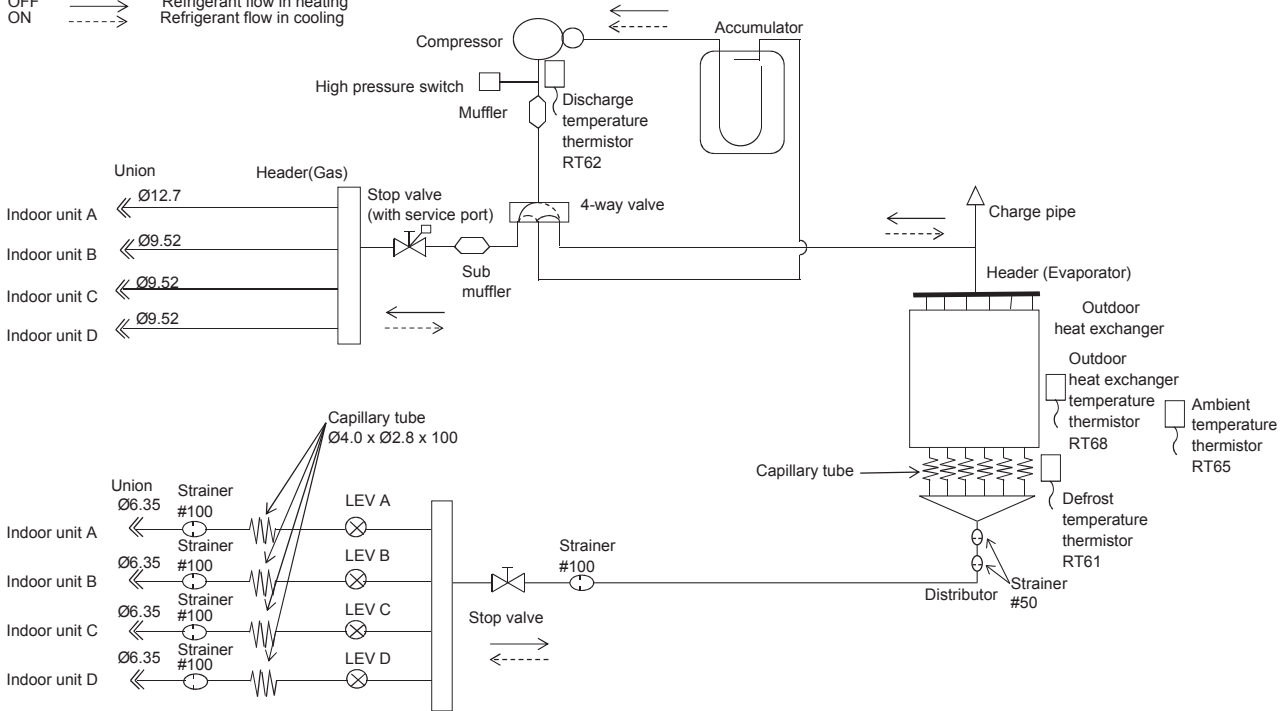

MXZ-5E102VA

Unit: mm


R.V.coil
 OFF → Refrigerant flow in heating
 ON - - - - - Refrigerant flow in cooling

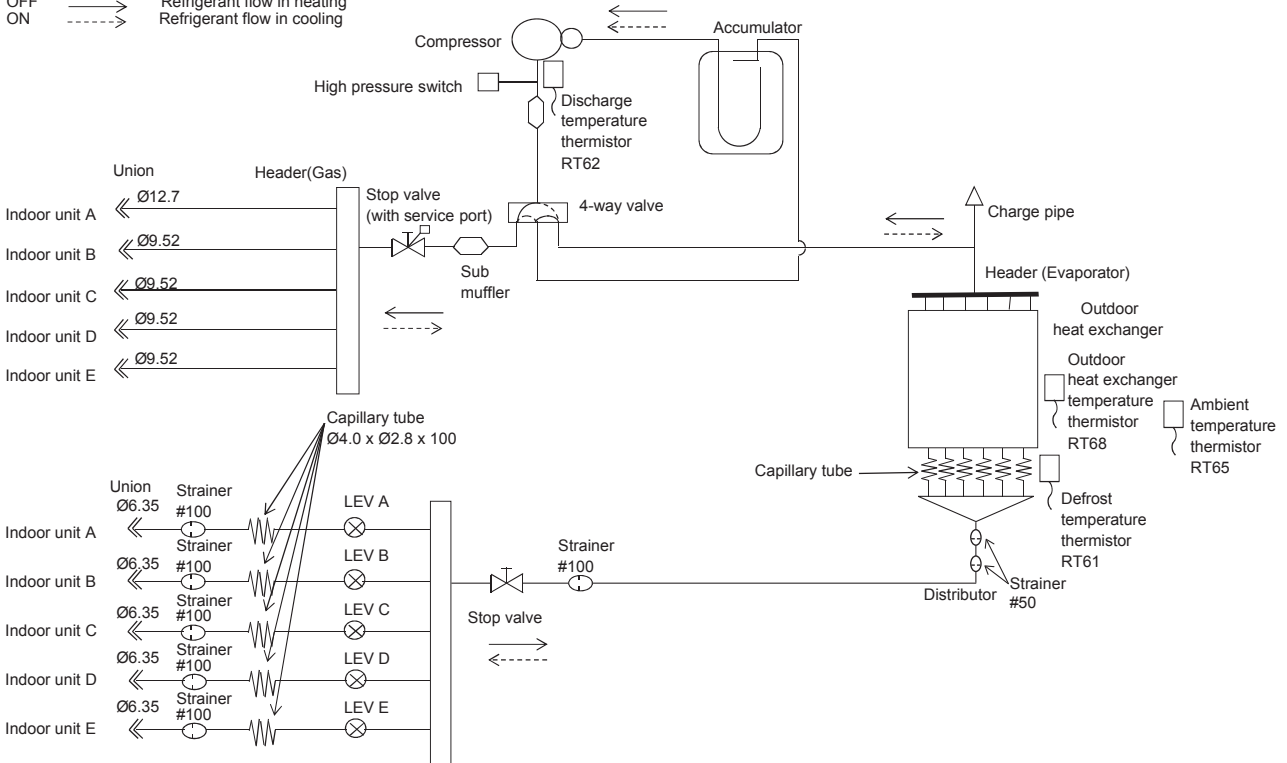

MULTI SYSTEMS REFRIGERANT SYSTEM DIAGRAM


MXZ-6D122VA2

Unit: mm

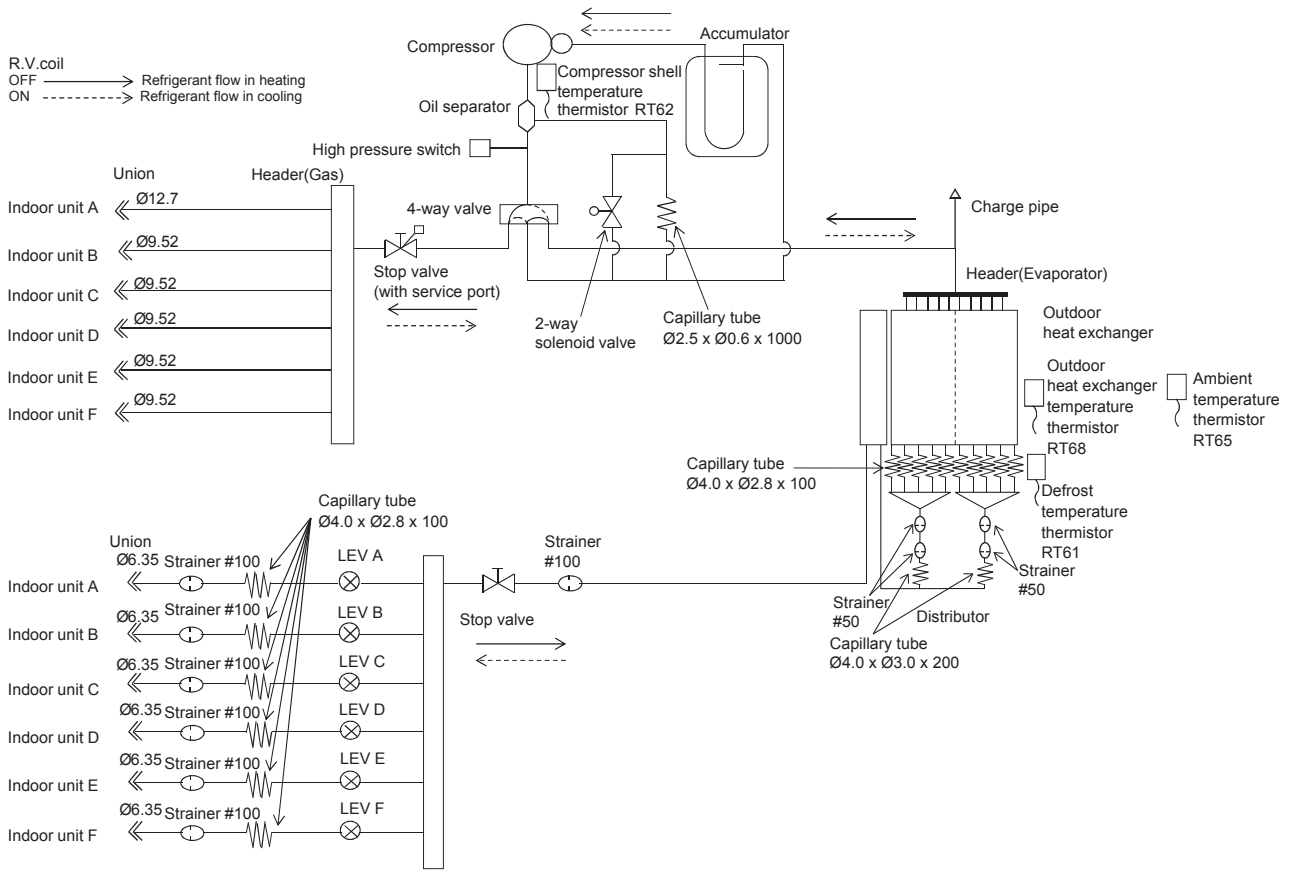


MXZ-2DM40VA

Unit: mm

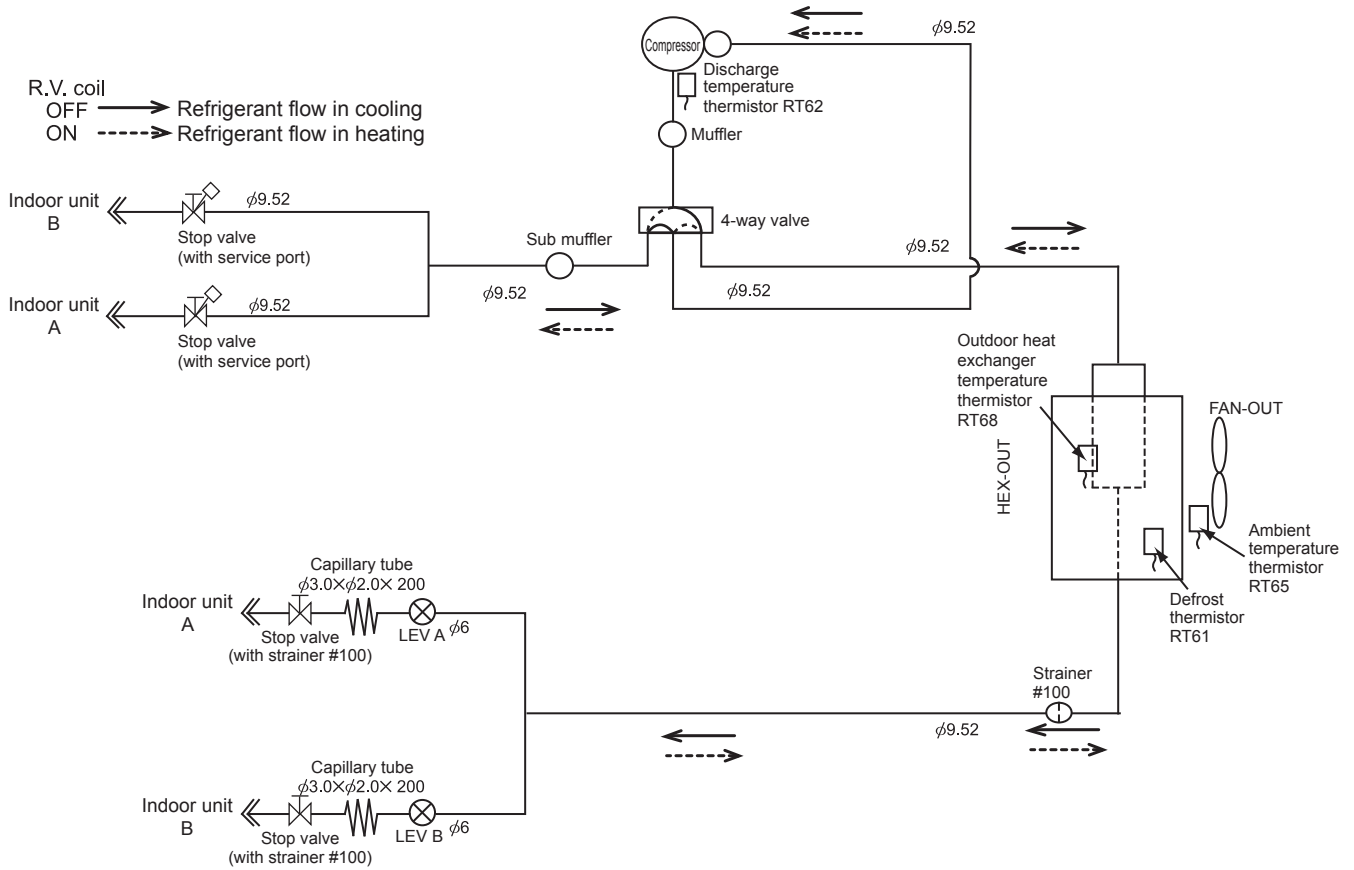

MXZ-3DM50VA


Unit: mm

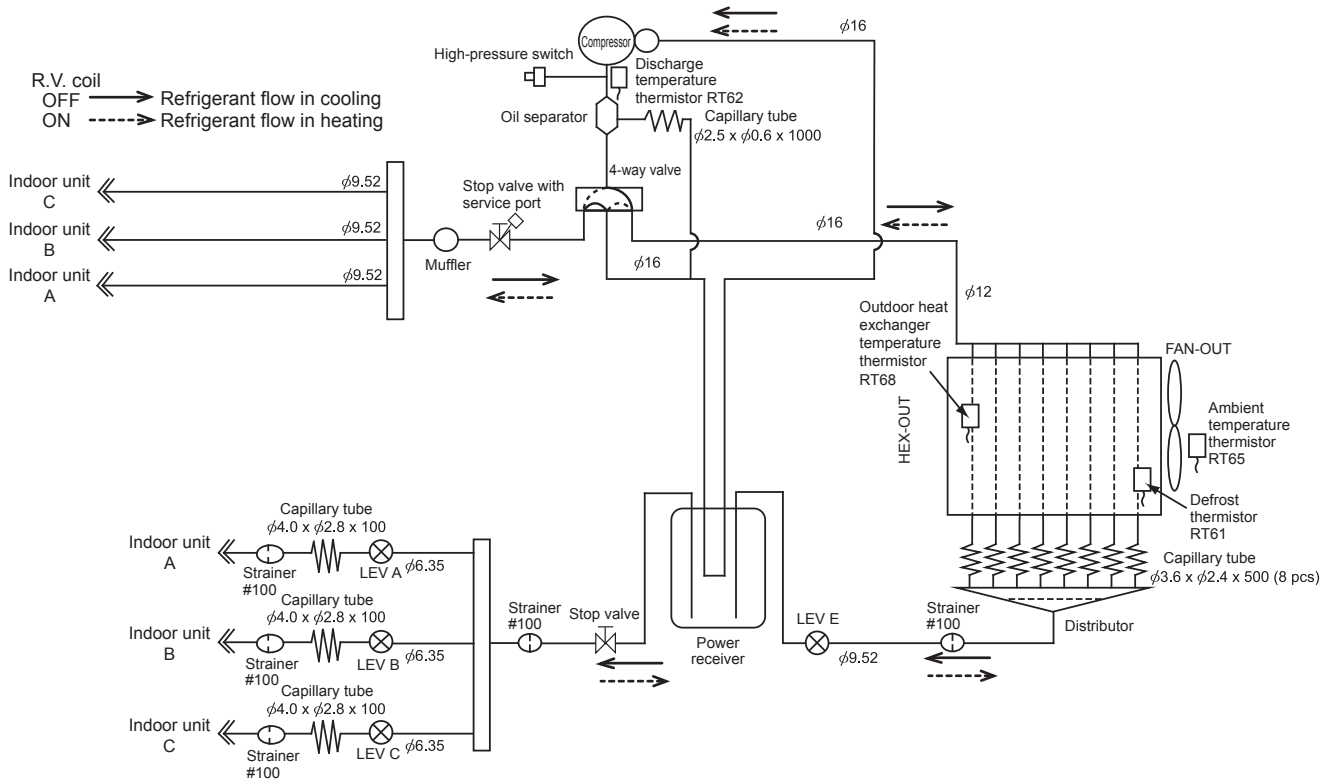

MULTI SYSTEMS REFRIGERANT SYSTEM DIAGRAM


MXZ-2E53VAHZ

Unit: mm

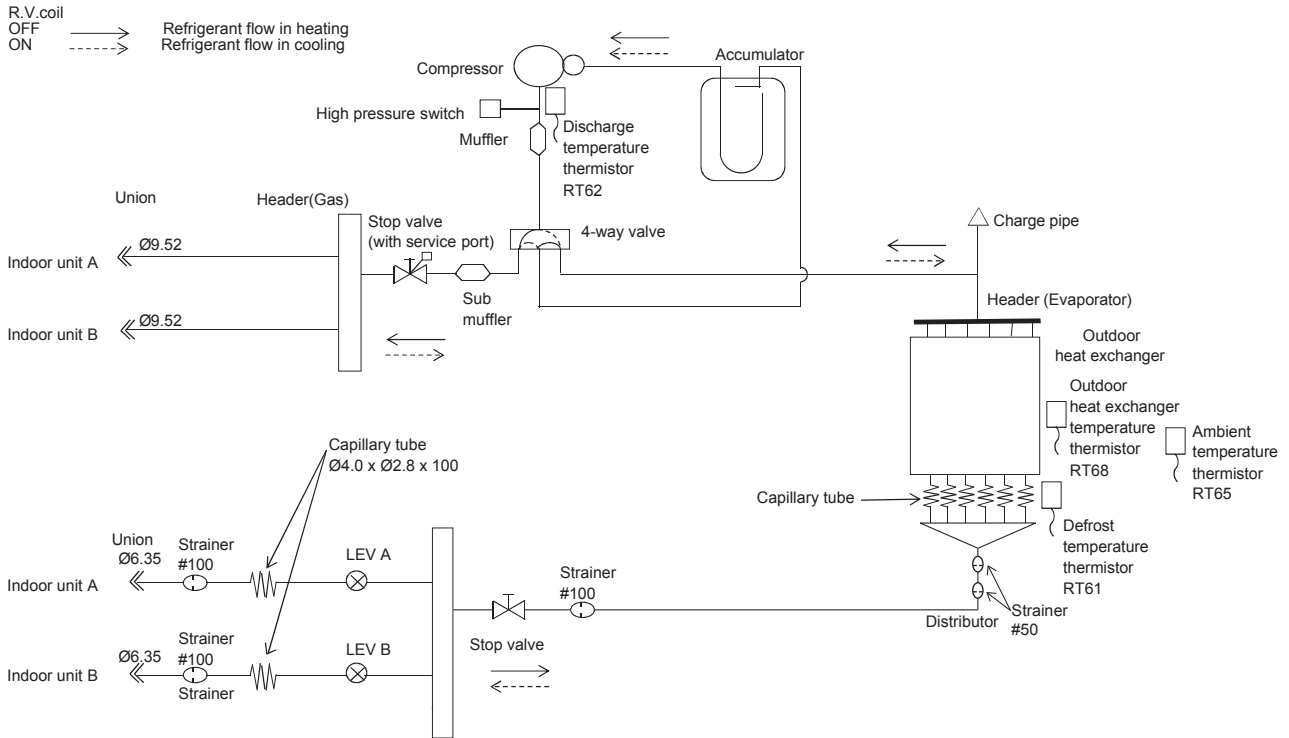

MXZ-4E83VAHZ

Unit: mm

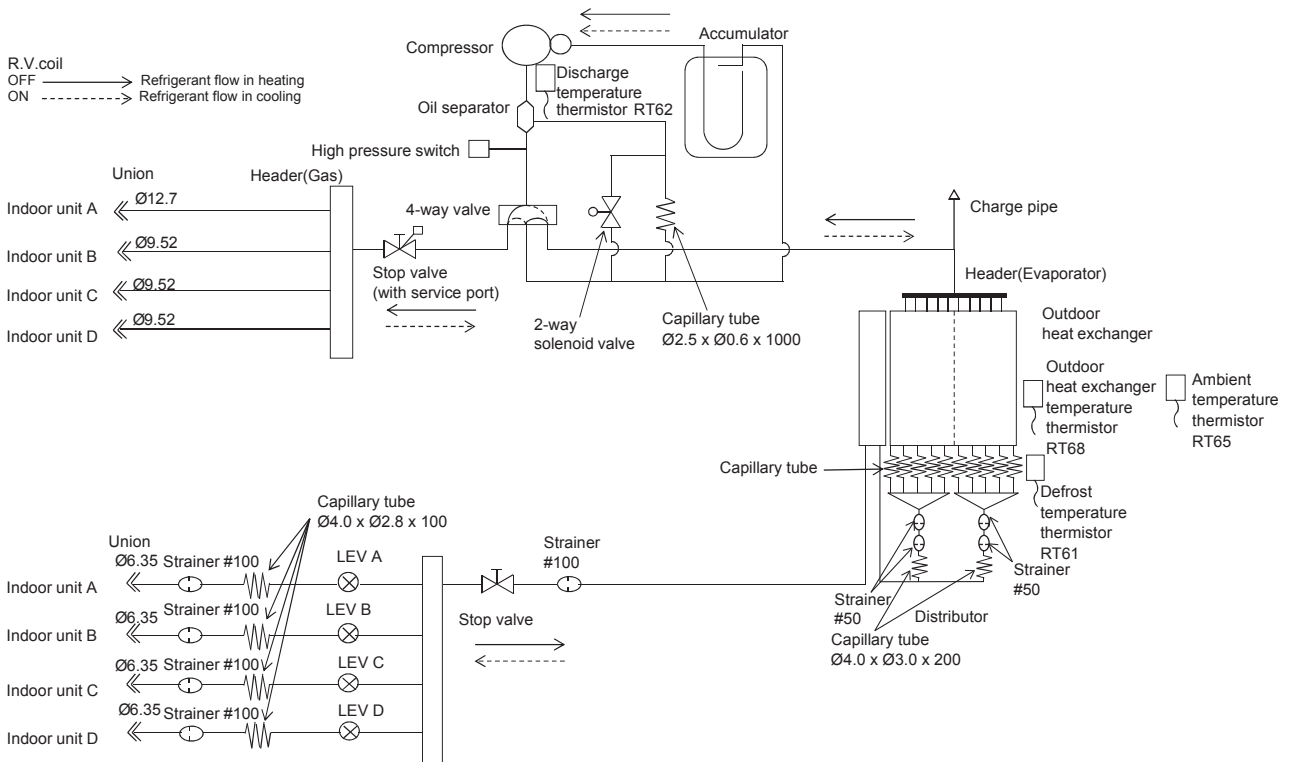

REFRIGERANT SYSTEM DIAGRAM MULTI SYSTEMS

**C.4.4.2 Refrigerant Pipe Length and Pipe Size
MXZ-2F33VF**


MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b)	15 m
Total piping length (a+b)	20 m
Bending point for each unit	15
Total bending point	20

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 2 unit total)
	20 m
1,000	0

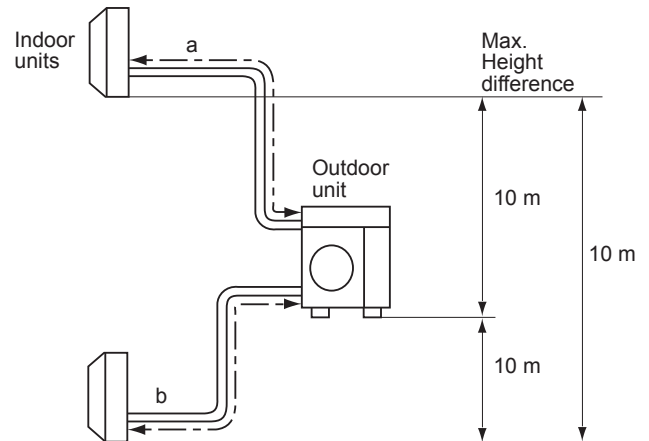

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-2F42VF MXZ-2F53VF MXZ-2F53VFH MXZ-2HA40VF MXZ-2HA50VF


MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b)	20 m
Total piping length (a+b)	30 m
Bending point for each unit	30
Total bending point	20

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Model name	Outdoor unit precharged (g)	Refrigerant piping length (one way, 2 unit total)
		30 m
MXZ-2F42VF MXZ-2F53VF MXZ-2F53VFH	1,200	0
MXZ-2HA40VF MXZ-2HA50VF	900	

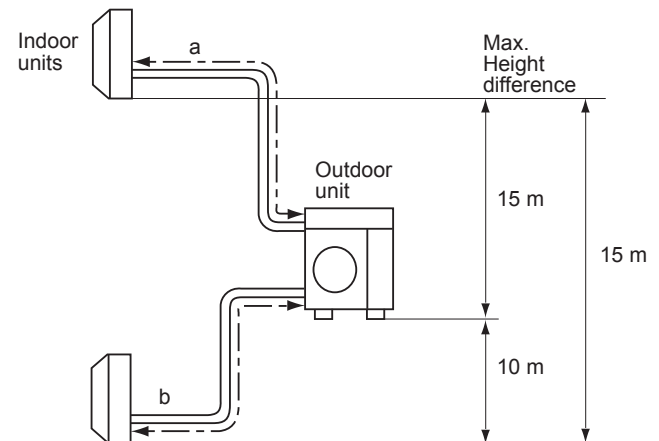

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- For **MXZ-2F53VF** and **MXZ-2F53VFH**, when diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-3F54VF2 MXZ-3HA50VF

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c)	25 m
Total piping length (a+b+c)	50 m
Bending point for each unit	25
Total bending point	50

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

MXZ-3F54VF2


Outdoor unit precharged (g)	Refrigerant piping length (one way, 3 unit total)	
	40 m	50 m
2,400	0	200

MXZ-3HA50VF

Outdoor unit precharged (g)	Refrigerant piping length (one way, 3 unit total)	
	40 m	50 m
1,400	0	200

Calculation: $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 40)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

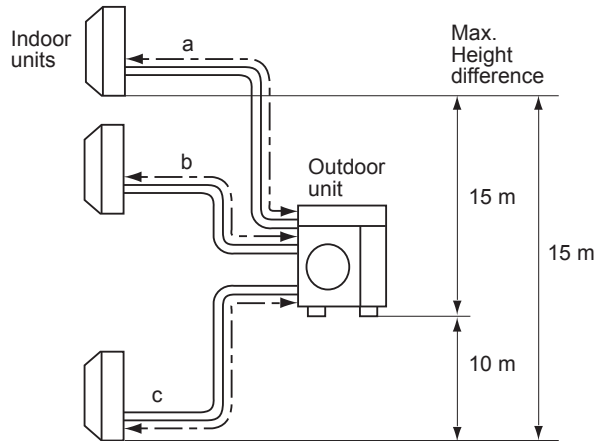

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-3F68VF2


MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c)	25 m
Total piping length (a+b+c)	60 m
Bending point for each unit	25
Total bending point	60

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 3 unit total)	
	60 m	
2,400	0	

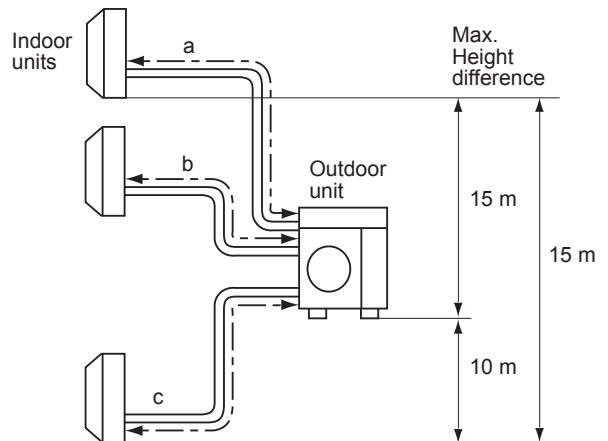

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)
	Gas	9.52(3/8)

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

MXZ-4F72VF2 MXZ-4F80VF2


MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	60 m
Bending point for each unit	25
Total bending point	60

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 4 unit total)
	60 m
2,400	0

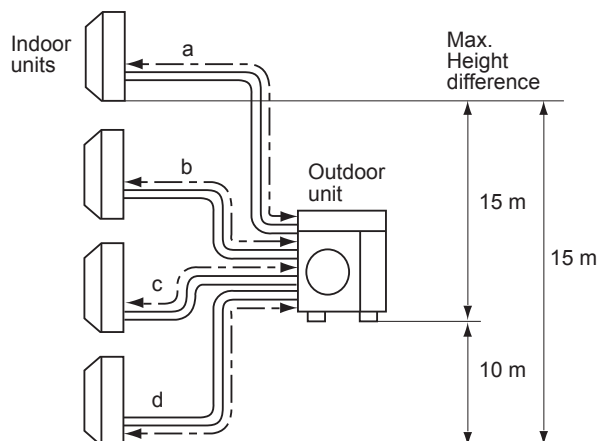

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	12.7(1/2)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit D	Liquid	6.35(1/4)
	Gas	9.52(3/8)

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

MXZ-2D33VA


MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b)	15 m
Total piping length (a+b)	20 m
Bending point for each unit	15
Total bending point	20

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 2 unit total)
	20 m
1,150	0

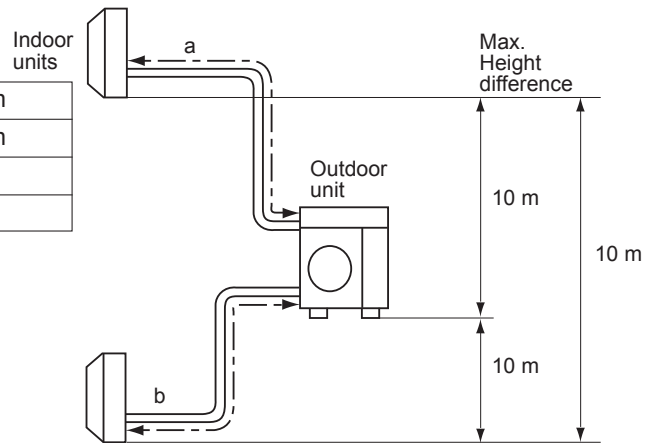

WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT

No. of MFZ-KJ indoor units	Refrigerant piping length (L)		Maximum amount of refrigerant
	~ 20 m		
None	Charge-less (1,150 g)		1,150 g
1 unit	100 g additional charge (1,250 g)		1,250 g
2 units	Not available		-

Unit: mm (inch)

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b)	20 m
Total piping length (a+b)	30 m
Bending point for each unit	20
Total bending point	30

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 2 unit total)	
	20 m	30 m
1,300	0	200

Calculation : $X_g = 20 \text{ g/m} \times (\text{Refrigerant piping length(m)} - 20)$

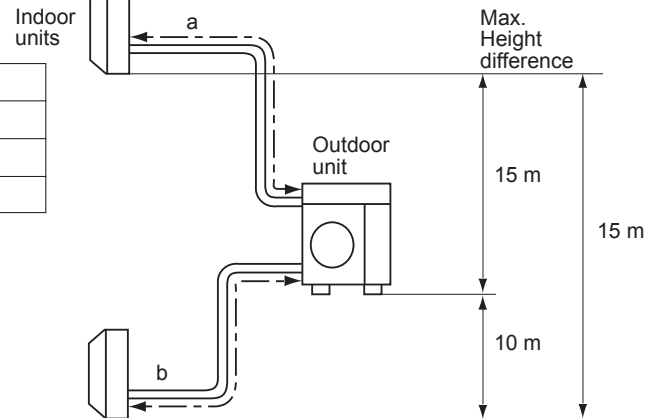

WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT

No. of MFZ-KJ indoor units	Refrigerant piping length (L)		Maximum amount of refrigerant
	~ 20 m	~ 30 m	
None	Charge-less (1,300 g)	$(L-20) \times 20 \text{ g/m}$	1,500 g
1 unit	100 g additional charge (1,400 g)	$100 \text{ g} + (L-20) \times 20 \text{ g/m}$	1,600 g
2 units	200 g additional charge (1,500 g)	$200 \text{ g} + (L-20) \times 20 \text{ g/m}$	1,700 g

Unit: mm (inch)

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)

REFRIGERANT SYSTEM DIAGRAM MULTI SYSTEMS

MXZ-3E54VA MXZ-3E68VA

MAX REFRIGERANT PIPING LENGTH


	3E54	3E68
Piping length each indoor unit (a, b, c)	25 m	25 m
Total piping length (a+b+c)	50 m	60 m
Bending point for each unit	25	25
Total bending point	50	60

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 3 unit total)		
	40 m	50 m	60 m
2,700	0	200	400

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 40)$

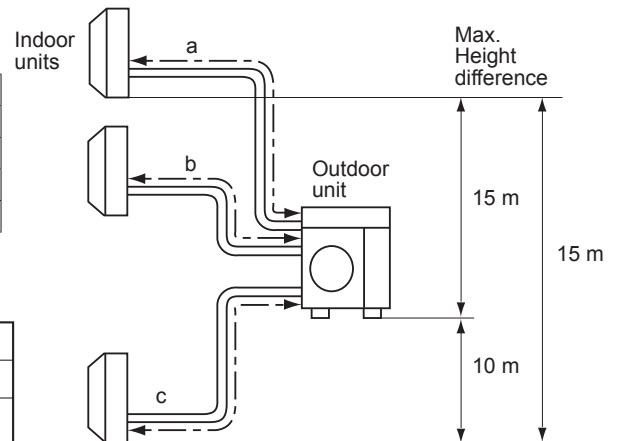

**WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT
MXZ-3E54VA**

No. of MFZ-KJ indoor units	Refrigerant piping length (L)		Maximum amount of refrigerant
	~ 40 m	~ 50 m	
None	Charge-less (2,700 g)	$(L-40) \times 20 \text{ g/m}$	2,900 g
1 unit	100 g additional charge (2,800 g)	$100 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,000 g
2 units	200 g additional charge (2,900 g)	$200 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,100 g
3 units	300 g additional charge (3,000 g)	$300 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,200 g

**WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT
MXZ-3E68VA**

No. of MFZ-KJ indoor units	Refrigerant piping length (L)		Maximum amount of refrigerant
	~ 40 m	~ 60 m	
None	Charge-less (2,700 g)	$(L-40) \times 20 \text{ g/m}$	3,100 g
1 unit	100 g additional charge (2,800 g)	$100 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,200 g
2 units	200 g additional charge (2,900 g)	$200 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,300 g
3 units	300 g additional charge (3,000 g)	$300 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,400 g

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the table below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-4E72VA

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	60 m
Bending point for each unit	25
Total bending point	60

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 4 unit total)		
	40 m	50 m	60 m
2,700	0	200	400

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 40)$

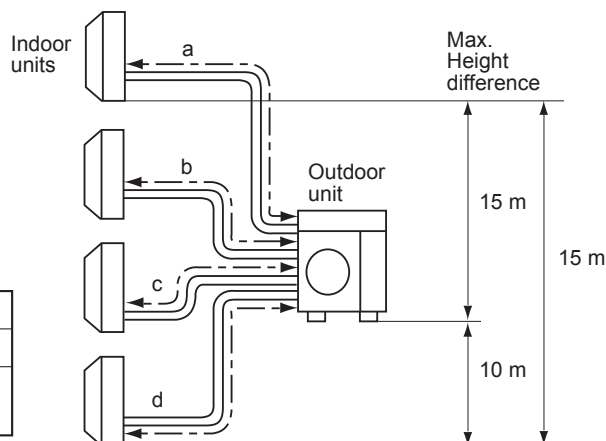

WHEN CONNECTING TO MFZ-KJ SERIES INDOOR UNIT

No. of MFZ-KJ indoor units	Refrigerant piping length (L)		Maximum amount of refrigerant
	~ 40 m	~ 60 m	
None	Charge-less (2,700 g)	$(L-40) \times 20 \text{ g/m}$	3,100 g
1 unit	100 g additional charge (2,800 g)	$100 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,200 g
2 units	200 g additional charge (2,900 g)	$200 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,300 g
3 units	300 g additional charge (3,000 g)	$300 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,400 g
4 units	400 g additional charge (3,100 g)	$400 \text{ g} + (L-40) \times 20 \text{ g/m}$	3,500 g

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the table below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

Unit: mm (inch)

Outdoor unit union diameter			Outdoor unit union diameter		
For			For		
Indoor unit A	Liquid	6.35(1/4)	Indoor unit C	Liquid	6.35(1/4)
	Gas	12.7(1/2)		Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)	Indoor unit D	Liquid	6.35(1/4)
	Gas	9.52(3/8)		Gas	9.52(3/8)

MXZ-4E83VA

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	70 m
Bending point for each unit	25
Total bending point	70


*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 4 unit total)			
	25 m	40 m	55 m	70 m
2,990	0	300	600	900

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 25)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe.

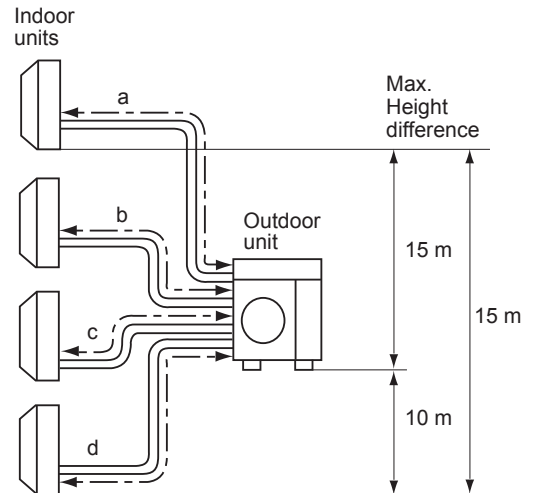

Unit: mm (inch)

Outdoor unit union diameter			Outdoor unit union diameter		
For			For		
Indoor unit A	Liquid	6.35(1/4)	Indoor unit C	Liquid	6.35(1/4)
	Gas	12.7(1/2)		Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)	Indoor unit D	Liquid	6.35(1/4)
	Gas	9.52(3/8)		Gas	9.52(3/8)

MXZ-5E102VA

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c, d,e)	25 m
Total piping length (a+b+c+d+e)	80 m
Bending point for each unit	25
Total bending point	80


*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 5 unit total)				
	0 m	20 m	40 m	60 m	80 m
2,990	0	400	800	1,200	1,600

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 0)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe.

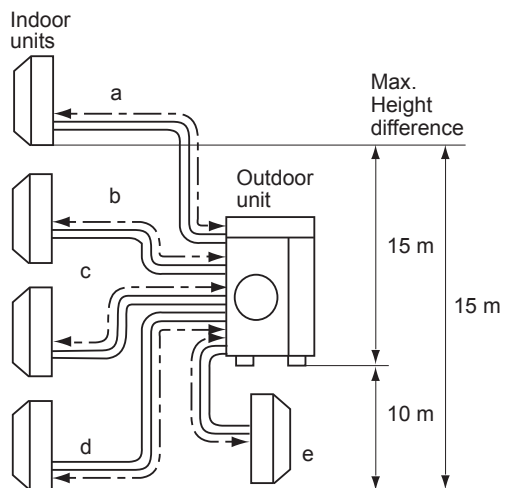

Unit: mm (inch)

Outdoor unit union diameter			Outdoor unit union diameter		
For			For		
Indoor unit A	Liquid	6.35(1/4)	Indoor unit D	Liquid	6.35(1/4)
	Gas	12.7(1/2)		Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)	Indoor unit E	Liquid	6.35(1/4)
	Gas	9.52(3/8)		Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)			
	Gas	9.52(3/8)			

MXZ-6D122VA2

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c, d, e)	25 m
Total piping length (a+b+c+d+e)	80 m
Bending point for each unit	25
Total bending point	80


*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 5 unit total)				
	40 m	50 m	60 m	70 m	80 m
4,000	200	400	600	800	1000

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 30)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe.

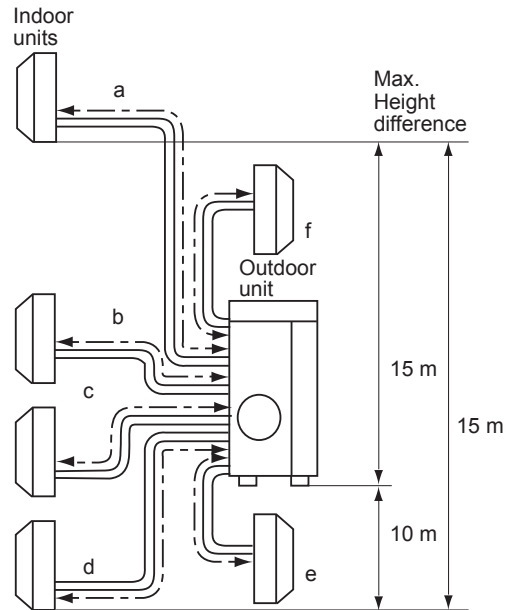

Unit: mm (inch)


Outdoor unit union diameter			Outdoor unit union diameter		
For			For		
Indoor unit A	Liquid	6.35(1/4)	Indoor unit D	Liquid	6.35(1/4)
	Gas	12.7(1/2)		Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)	Indoor unit E	Liquid	6.35(1/4)
	Gas	9.52(3/8)		Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)	Indoor unit F	Liquid	6.35(1/4)
	Gas	9.52(3/8)		Gas	9.52(3/8)

MXZ-2DM40VA

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b)	20 m
Total piping length (a+b)	30 m
Bending point for each unit	20
Total bending point	30

*It is irrelevant which unit is higher.

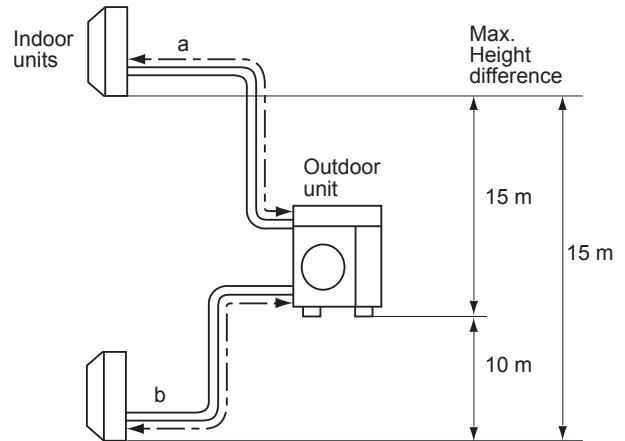

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 2 unit total)	
	20 m	30 m
950	0	200

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 20)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-3DM50VA

MAX REFRIGERANT PIPING LENGTH


Piping length each indoor unit (a, b, c)	25 m
Total piping length (a+b+c)	50 m
Bending point for each unit	25
Total bending point	50

*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 3 unit total)	
	40 m	50 m
2,700	0	200

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 40)$

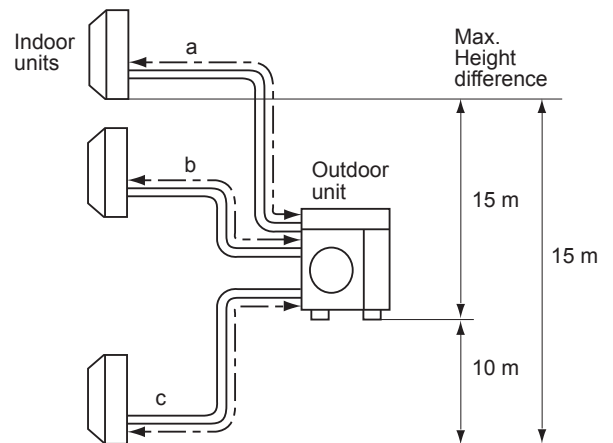

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit C	Liquid	6.35(1/4)
	Gas	9.52(3/8)

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the right table.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe.

MXZ-2E53VAHZ

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b)	20 m
Total piping length (a+b)	30 m
Bending point for each unit	20
Total bending point	30


*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 2 unit total)		
	20 m	25 m	30 m
2,000	0	100	200

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 20)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe.

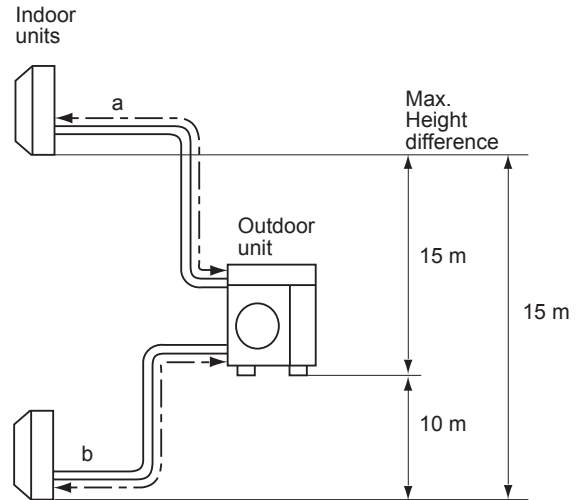

Unit: mm (inch)

Outdoor unit union diameter		
For		
Indoor unit A	Liquid	6.35(1/4)
	Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)
	Gas	9.52(3/8)

MXZ-4E83VAHZ

MAX REFRIGERANT PIPING LENGTH

Piping length each indoor unit (a, b, c, d)	25 m
Total piping length (a+b+c+d)	70 m
Bending point for each unit	25
Total bending point	70


*It is irrelevant which unit is higher.

ADDITIONAL REFRIGERANT CHARGE

Outdoor unit precharged (g)	Refrigerant piping length (one way, 4 unit total)			
	25 m	40 m	55 m	70 m
3,900	0	300	600	900

Calculation : $Xg = 20 \text{ g/m} \times (\text{Refrigerant piping length (m)} - 25)$

- Refrigerant pipe diameter is different according to indoor unit to be connected. When using extension pipes, refer to the tables below.
- When diameter of refrigerant pipe is different from that of outdoor unit union, use optional Different-diameter pipe. For further information on Different-diameter pipe.

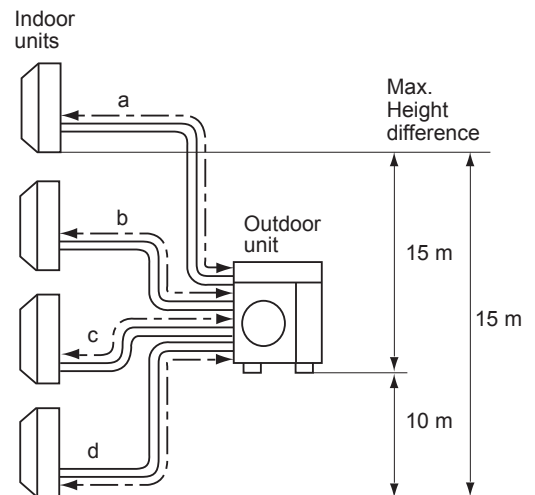

Unit: mm (inch)



Outdoor unit union diameter			Outdoor unit union diameter		
For			For		
Indoor unit A	Liquid	6.35(1/4)	Indoor unit C	Liquid	6.35(1/4)
	Gas	12.7(1/2)		Gas	9.52(3/8)
Indoor unit B	Liquid	6.35(1/4)	Indoor unit D	Liquid	6.35(1/4)
	Gas	9.52(3/8)		Gas	9.52(3/8)

C.4.5 PERFORMANCE CURVES



C.4.5.1 Inverter Heat Pump CAPACITY AND THE INPUT CURVES

MXZ-2F33VF MXZ-2F42VF MXZ-2F53VF MXZ-2F53VFH

5.8	4.1	7.4	5.2	5.9	8.7	11.1	12.8
5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.5
4.5	3.2	5.7	4.0	4.6	6.6	8.3	9.5
4.0	2.9	5.1	3.6	4.1	5.9	7.5	8.5
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6
2.8	2.0	3.5	2.4	2.8	4.0	5.0	5.6
15 class	18 class	20 class	22 class	25 class	35 class (MXZ-2F42VF)	42 class (MXZ-2F53)	50 class (MXZ-2F53)

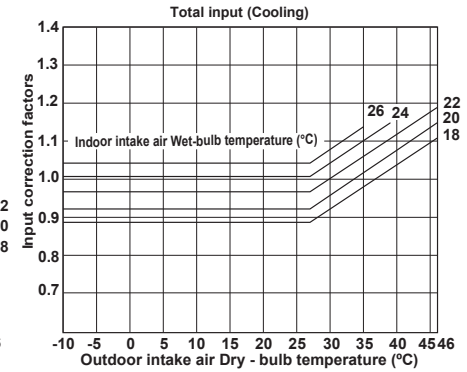
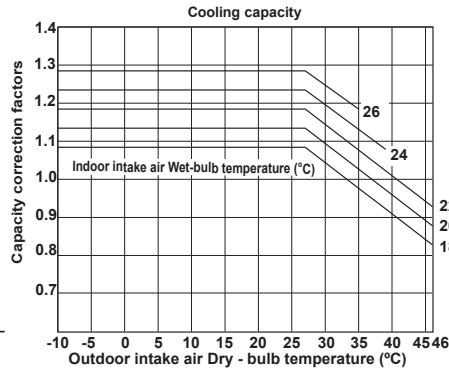


17.6	19.5	21.2	19.5	21.3	22.2	26.6	26.7
16.3	18.1	19.7	18.1	19.8	20.6	24.7	24.8
15.1	16.7	18.2	16.7	18.3	19.0	22.8	22.9
13.8	15.3	16.7	15.3	16.7	17.4	20.9	21.0
12.6	13.9	15.2	13.9	15.2	15.8	19.0	19.1
11.3	12.6	13.6	12.6	13.7	14.3	17.1	17.1
10.1	11.2	12.1	11.2	12.2	12.7	15.2	15.2
8.8	9.8	10.6	9.8	10.7	11.1	13.3	13.3
7.5	8.4	9.1	8.4	9.1	9.5	11.4	11.4
6.3	7.0	7.6	7.0	7.6	7.9	9.5	9.5
5.0	5.6	6.1	5.6	6.1	6.3	7.6	7.6
15 class	18 class	20 class	22 class	25 class	35 class (MXZ-2F42VF)	42 class (MXZ-2F53)	50 class (MXZ-2F53)

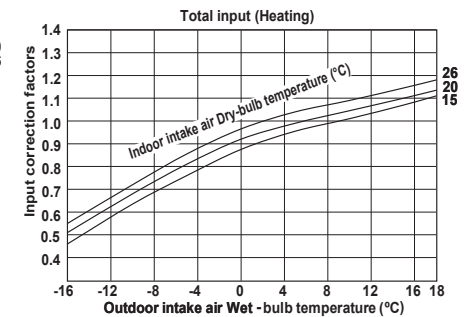
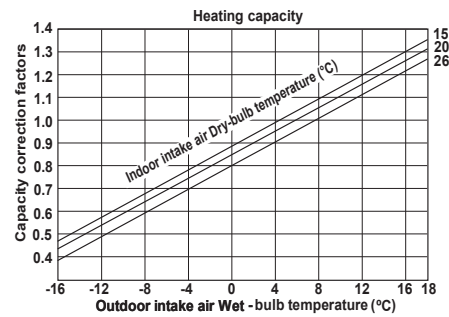


MXZ-3F54VF2 MXZ-3F68VF2 MXZ-4F72VF2 MXZ-4F80VF2

5.8	4.1	7.4	5.2	5.9	8.7	11.1	12.8	8.7
5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.5	7.3
4.5	3.2	5.7	4.0	4.6	6.6	8.3	9.5	6.6
4.0	2.9	5.1	3.6	4.1	5.9	7.5	8.5	5.9
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6
2.8	2.0	3.5	2.4	2.8	4.0	5.0	5.6	4.0
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class

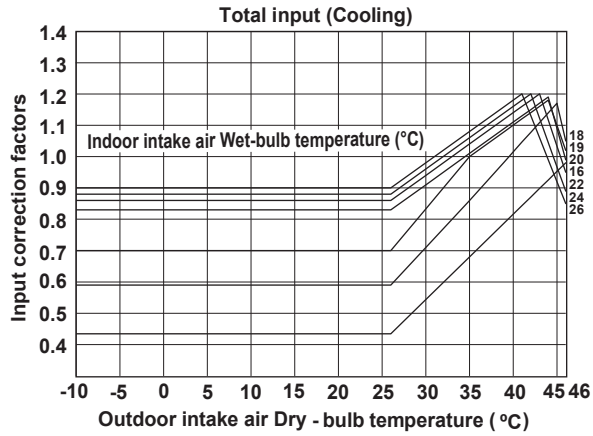
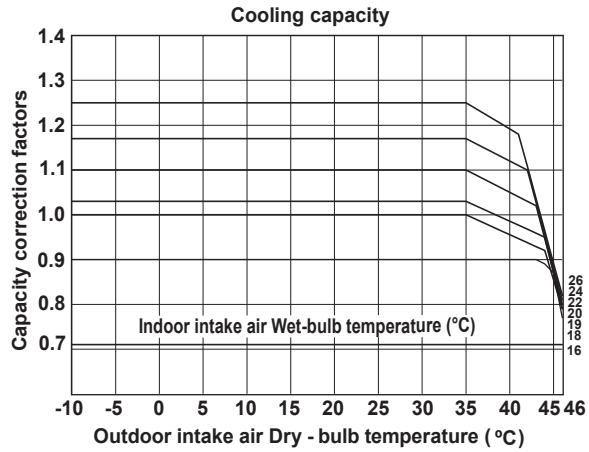


17.6	19.5	21.2	19.5	21.3	22.2	29.9	38.4	30.9
16.3	18.1	19.7	18.1	19.8	20.6	27.8	35.7	28.7
15.1	16.7	18.2	16.7	18.3	19.0	25.7	32.9	26.5
13.8	15.3	16.7	15.3	16.7	17.4	23.5	30.2	24.3
12.6	13.9	15.2	13.9	15.2	15.8	21.4	27.4	22.1
11.3	12.6	13.6	12.6	13.7	14.3	19.2	24.7	19.9
10.1	11.2	12.1	11.2	12.2	12.7	17.1	21.9	17.7
8.8	9.8	10.6	9.8	10.7	11.1	15.0	19.2	15.5
7.5	8.4	9.1	8.4	9.1	9.5	12.8	16.5	13.2
6.3	7.0	7.6	7.0	7.6	7.9	10.7	13.7	11.0
5.0	5.6	6.1	5.6	6.1	6.3	8.6	11.0	8.8
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class

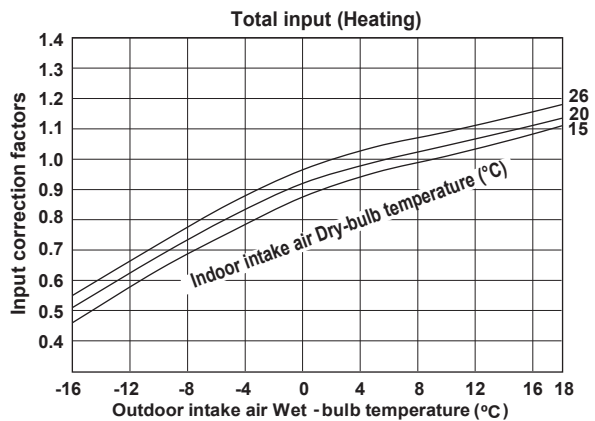
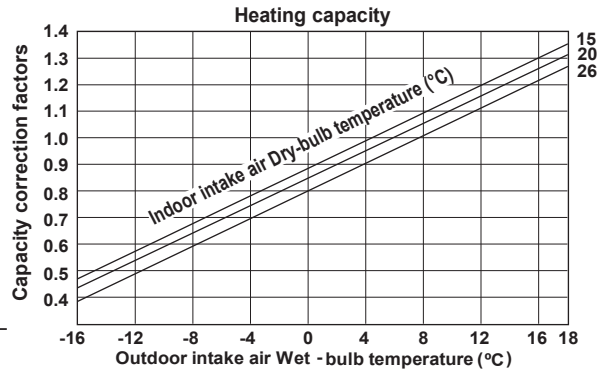


MXZ-2D33VA MXZ-2D42VA2
MXZ-2D53VA2 MXZ-2D53VAH2

Indoor air Wet-bulb temperature difference (°C)	5.8	4.1	7.4	5.2	6.0	8.8	10.9	11.2
	5.4	3.8	6.8	4.8	5.5	8.0	10.0	10.2
	4.9	3.5	6.2	4.4	5.0	7.3	9.1	9.3
	4.5	3.2	5.7	4.0	4.6	6.6	8.2	8.4
	4.0	2.9	5.1	3.6	4.1	6.0	7.3	7.5
	3.6	2.6	4.5	3.2	3.7	5.3	6.5	6.7
15 class								
18 class								
20 class								
22 class								
25 class								
35 class (MXZ-2D40S3)								
42 class (MXZ-2D53)								
50 class (MXZ-2D53)								

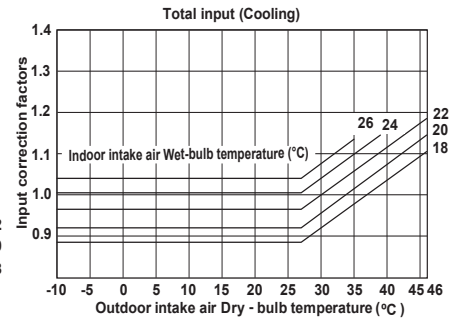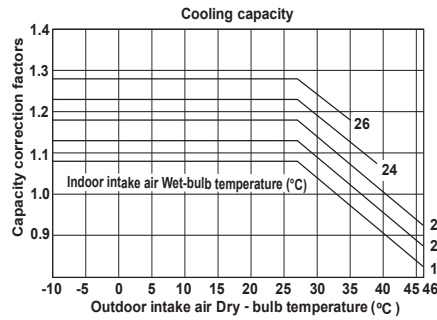


Indoor air Dry-bulb temperature difference (°C)	18.6	20.4	22.7	20.4	22.8	23.6	28.5	28.7
	17.2	19.0	20.9	19.0	21.0	21.9	26.5	26.6
	15.8	17.6	19.1	17.6	19.2	20.2	24.5	24.5
	14.4	16.1	17.5	16.1	17.6	18.3	22.2	22.3
	13.1	14.5	15.9	14.5	16.0	16.6	20.2	20.2
	11.7	13.0	14.2	13.0	14.2	14.8	18.0	18.0
	10.3	11.6	12.6	11.6	12.6	13.2	16.0	16.0
	9.0	10.0	11.0	10.0	11.1	11.5	13.8	13.8
	7.7	8.6	9.3	8.6	9.4	9.8	11.8	11.9
	6.4	7.2	7.6	7.2	7.7	8.1	9.8	10.0
	5.1	5.8	5.9	5.8	6.0	6.4	7.8	8.1
15 class								
18 class								
20 class								
22 class								
25 class								
35 class (MXZ-2D40S3)								
42 class (MXZ-2D53)								
50 class (MXZ-2D53)								

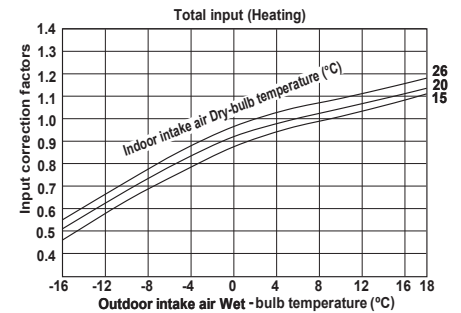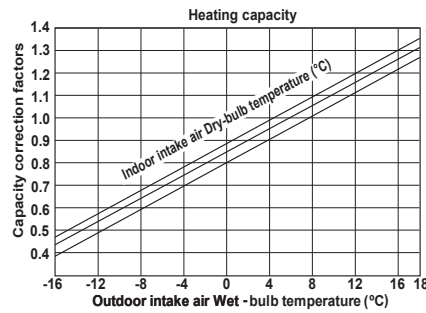


MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA


5.8	3.8	7.3	7.8	8.5	9.7	8.7	11.9	12.4
5.3	3.5	6.7	7.1	7.8	8.8	8.0	10.8	11.3
4.8	3.2	6.0	6.4	7.0	7.9	7.2	9.7	10.1
4.3	2.9	5.4	5.8	6.3	7.1	6.5	8.7	9.0
3.9	2.6	4.8	5.1	5.6	6.3	5.7	7.7	8.0
3.5	2.3	4.2	4.4	4.9	5.5	4.9	6.7	7.0
3.1	2.0	3.6	3.7	4.2	4.7	4.1	5.7	6.0
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class

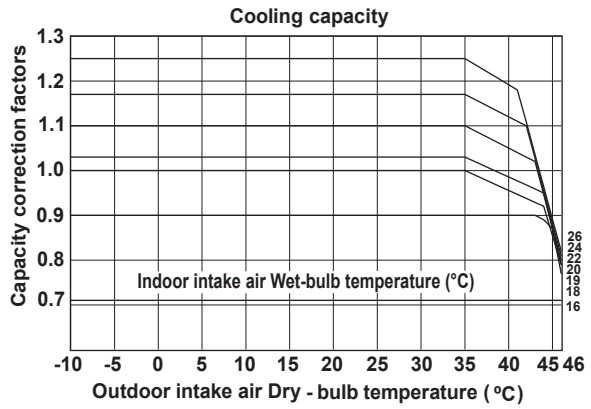


5.8	3.8	7.3	7.8	8.5	9.7	8.7	11.9	12.4
5.3	3.5	6.7	7.1	7.8	8.8	8.0	10.8	11.3
4.8	3.2	6.0	6.4	7.0	7.9	7.2	9.7	10.1
4.3	2.9	5.4	5.8	6.3	7.1	6.5	8.7	9.0
3.9	2.6	4.8	5.1	5.6	6.3	5.7	7.7	8.0
3.5	2.3	4.2	4.4	4.9	5.5	4.9	6.7	7.0
3.1	2.0	3.6	3.7	4.2	4.7	4.1	5.7	6.0
2.7	1.7	3.0	3.0	3.5	3.9	3.3	4.7	5.0
2.3	1.4	2.4	2.3	2.8	3.1	2.5	3.7	4.0
1.9	1.1	1.8	1.6	2.1	2.3	1.7	2.7	3.0
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class

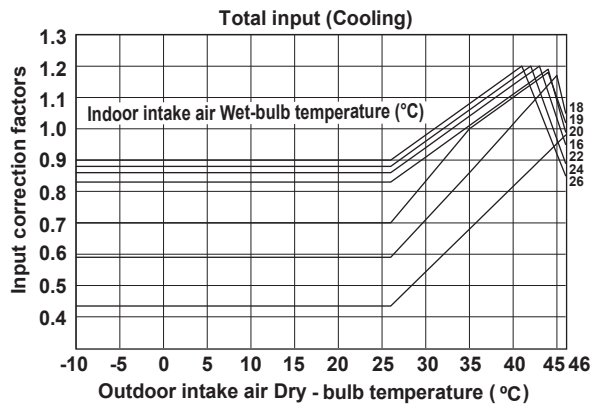

18.4	20.4	21.2	27.4	25.8	27.9	29.1	33.8	34.4
17.1	19.0	19.7	25.4	24.0	25.9	27.0	31.4	31.9
15.8	17.6	18.2	23.4	22.2	23.9	24.9	29.0	29.4
14.5	16.1	16.7	21.5	20.3	21.9	22.8	26.6	27.0
13.2	14.5	15.2	19.5	18.5	19.9	20.7	24.1	24.5
11.8	13.0	13.6	17.6	16.6	17.9	18.7	21.7	22.1
10.5	11.6	12.1	15.6	14.8	15.9	16.6	19.3	19.6
9.2	10.0	10.6	13.7	12.9	13.9	14.5	16.9	17.2
7.9	8.6	9.1	11.7	11.1	12.0	12.4	14.5	14.7
6.6	7.2	7.6	9.7	9.3	10.1	10.3	12.1	12.2
5.3	5.8	6.1	7.7	7.5	8.2	8.2	9.7	9.7
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class

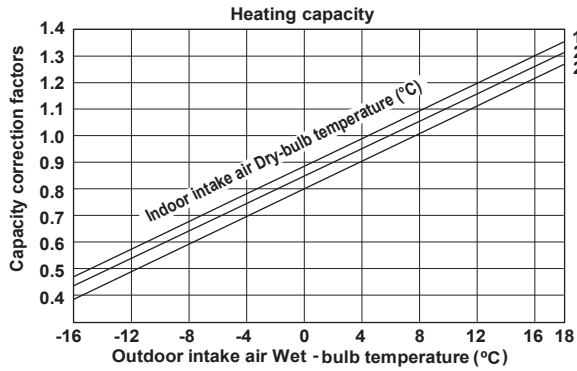


17.1	19.0	19.7	25.4	24.0	25.9	27.0	31.4	31.9
15.8	17.6	18.2	23.4	22.2	23.9	24.9	29.0	29.4
14.5	16.1	16.7	21.5	20.3	21.9	22.8	26.6	27.0
13.2	14.5	15.2	19.5	18.5	19.9	20.7	24.1	24.5
11.8	13.0	13.6	17.6	16.6	17.9	18.7	21.7	22.1
10.5	11.6	12.1	15.6	14.8	15.9	16.6	19.3	19.6
9.2	10.0	10.6	13.7	12.9	13.9	14.5	16.9	17.2
7.9	8.6	9.1	11.7	11.1	12.0	12.4	14.5	14.7
6.6	7.2	7.6	9.7	9.3	10.1	10.3	12.1	12.2
5.3	5.8	6.1	7.7	7.5	8.2	8.2	9.7	9.7
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class

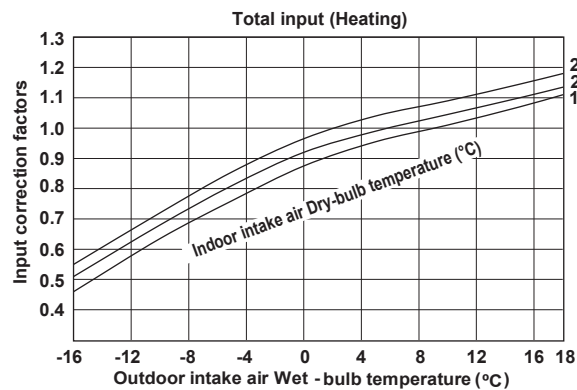


MXZ-4E83VA MXZ-5E102VA


5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0	8.2
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6	7.3	7.5
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5	6.6	6.8
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5	6.0	6.1
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3	5.4
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6	4.7
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6	4.0	4.1
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

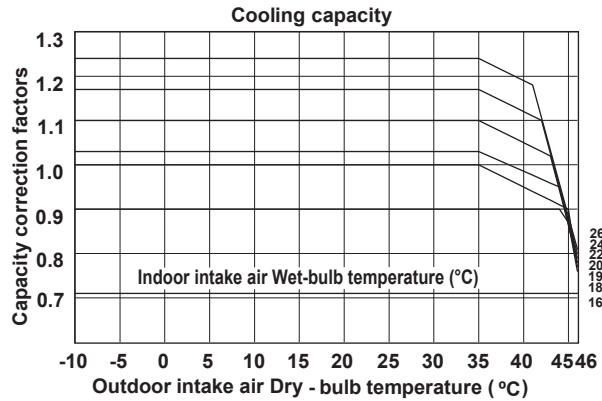


5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0	8.2
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6	7.3	7.5
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5	6.6	6.8
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5	6.0	6.1
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3	5.4
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6	4.7
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6	4.0	4.1
2.3	1.7	2.9	2.1	2.0	3.4	4.2	4.8	3.4	3.5
1.9	1.4	2.4	1.7	2.0	2.8	3.5	3.9	2.8	2.9
1.5	1.1	1.9	1.4	1.6	2.2	2.7	3.1	2.2	2.3
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

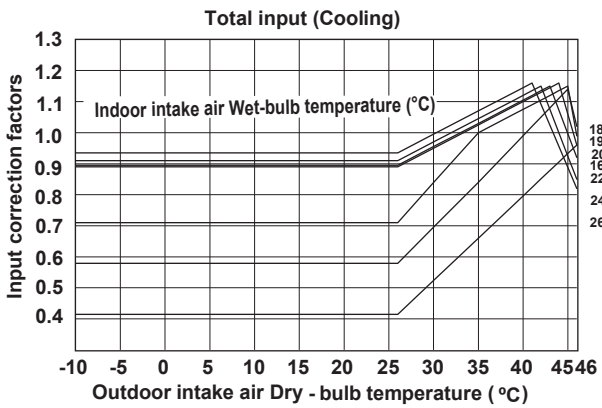

18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1	22.3	28.3
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8	20.7	26.3
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5	19.1	24.3
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2	17.5	22.3
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7	15.7	20.0
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4	14.2	18.0
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1	12.6	16.0
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9	11.0	14.0
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4	9.3	11.9
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2	7.8	9.9
5.1	5.5	6.1	5.5	5.5	6.4	8.7	9.0	6.2	7.9
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

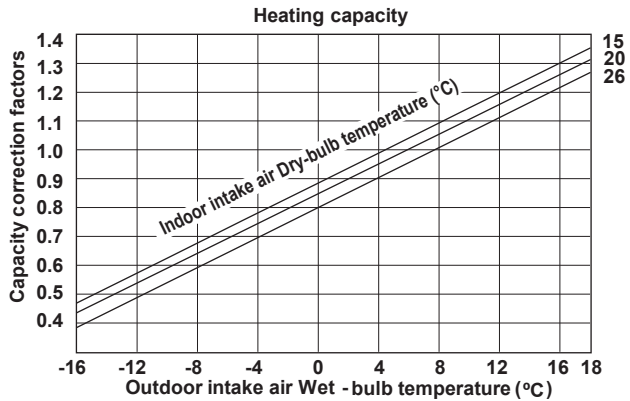


17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8	20.7	26.3
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5	19.1	24.3
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2	17.5	22.3
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7	15.7	20.0
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4	14.2	18.0
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1	12.6	16.0
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9	11.0	14.0
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4	9.3	11.9
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2	7.8	9.9
5.1	5.5	6.1	5.5	5.5	6.4	8.7	9.0	6.2	7.9
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

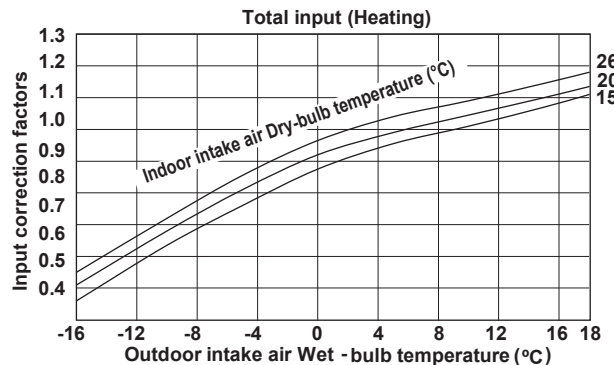


MXZ-6D122VA2


5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0	8.2
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6	7.3	7.5
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5	6.6	6.8
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5	6.0	6.1
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3	5.4
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6	4.7
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6	4.0	4.1
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

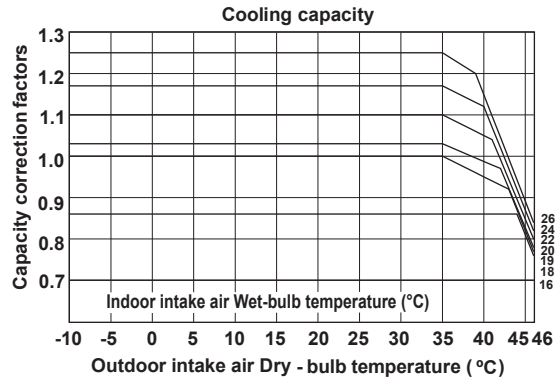


5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0	8.2
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6	7.3	7.5
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5	6.6	6.8
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5	6.0	6.1
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3	5.4
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6	4.7
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6	4.0	4.1
2.3	1.7	2.9	2.1	2.0	3.4	4.2	4.8	3.4	3.5
1.9	1.4	2.4	1.7	2.0	2.8	3.5	3.9	2.8	2.9
1.5	1.1	1.9	1.4	1.6	2.2	2.7	3.1	2.2	2.3
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

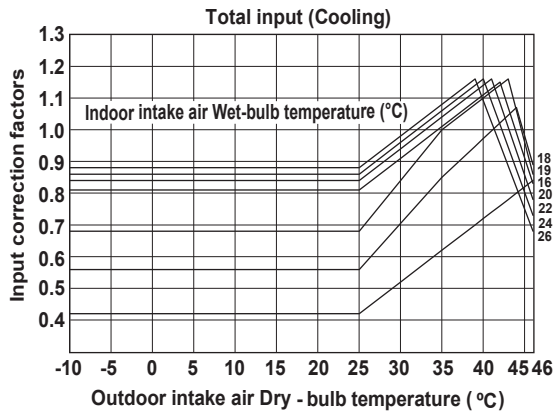

18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1	22.3	28.3
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8	20.7	26.3
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5	19.1	24.3
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2	17.5	22.3
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7	15.7	20.0
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4	14.2	18.0
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1	12.6	16.0
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9	11.0	14.0
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4	9.3	11.9
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2	7.8	9.9
5.1	5.5	6.1	5.5	5.5	6.4	8.7	9.0	6.2	7.9
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

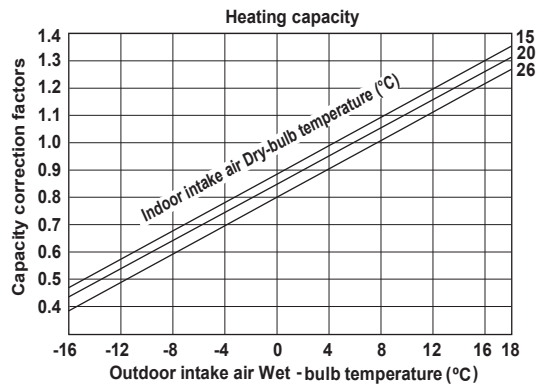


18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1	22.3	28.3
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8	20.7	26.3
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5	19.1	24.3
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2	17.5	22.3
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7	15.7	20.0
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4	14.2	18.0
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1	12.6	16.0
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9	11.0	14.0
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4	9.3	11.9
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2	7.8	9.9
5.1	5.5	6.1	5.5	5.5	6.4	8.7	9.0	6.2	7.9
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

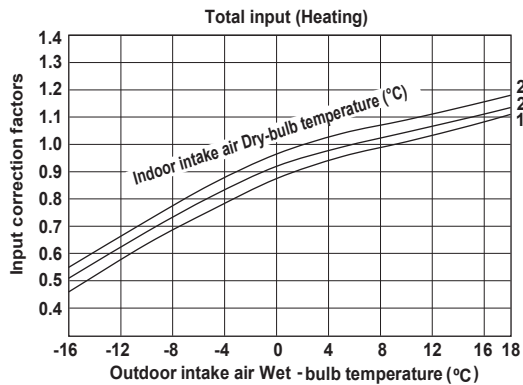


MXZ-2DM40VA


Indoor air Wet-bulb temperature difference (°C)	6.7	7.4
	6.1	6.8
	5.6	6.2
	5.1	5.6
	4.6	5.1
	4.1	4.5
	25 class	35 class

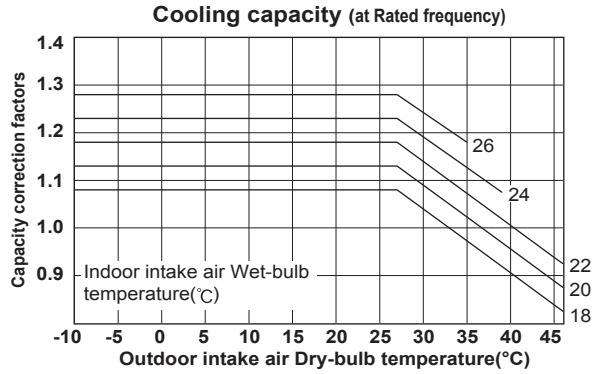


Indoor air Wet-bulb temperature difference (°C)	6.1	6.8
	5.6	6.2
	5.1	5.6
	4.6	5.1
	4.1	4.5
	25 class	35 class

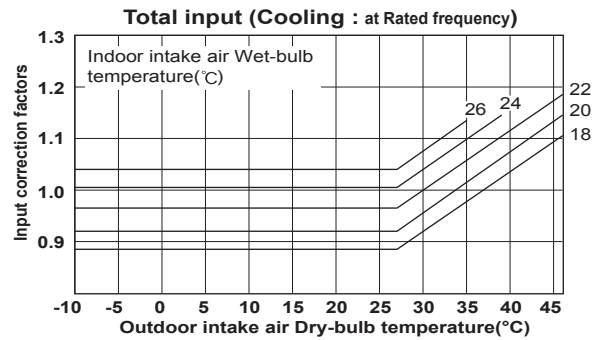

Indoor air Dry-bulb temperature difference (°C)	22.2	24.6
	20.6	22.9
	19.0	21.1
	17.4	19.3
	15.8	17.6
	14.3	15.8
	12.7	14.1
	11.1	12.3
	9.5	10.5
	7.9	8.8
	6.3	7.0
	25 class	35 class

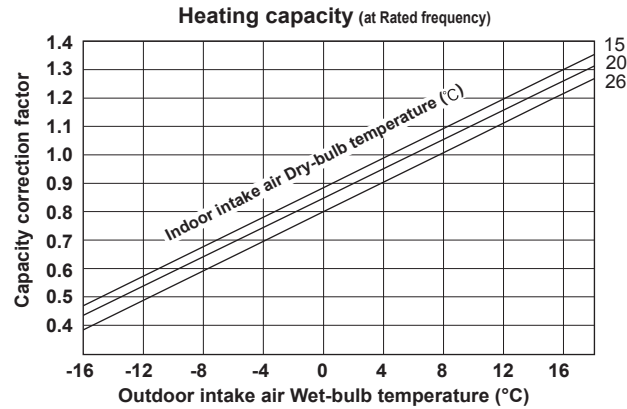


Indoor air Dry-bulb temperature difference (°C)	20.6	22.9
	19.0	21.1
	17.4	19.3
	15.8	17.6
	14.3	15.8
	12.7	14.1
	11.1	12.3
	9.5	10.5
	7.9	8.8
	6.3	7.0
	25 class	35 class

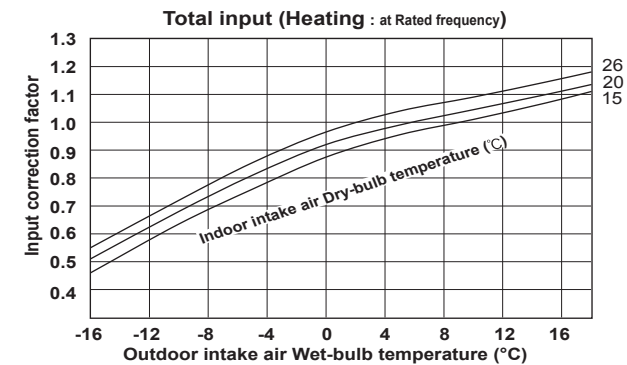


MXZ-3DM50VA


Indoor air Wet-bulb temperature difference (°C)	6.7	7.4	10.5
	6.1	6.8	9.6
	5.6	6.2	8.7
	5.1	5.6	7.9
	4.6	5.1	7.1
	4.1	4.5	6.3
	25 class	35 class	50 class

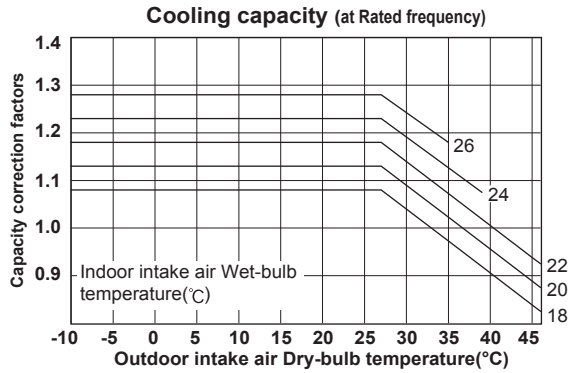


Indoor air Wet-bulb temperature difference (°C)	6.1	6.8	9.6
	5.6	6.2	8.7
	5.1	5.6	7.9
	4.6	5.1	7.1
	4.1	4.5	6.3
	25 class	35 class	50 class

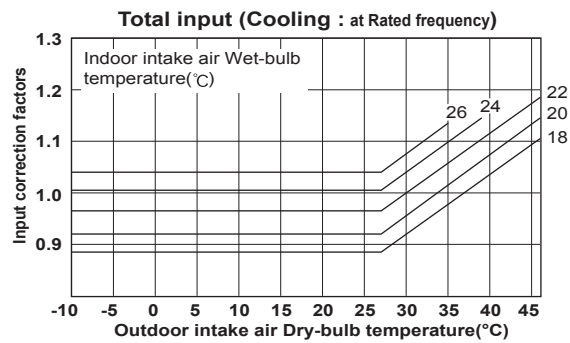

Indoor air Dry-bulb temperature difference (°C)	22.2	24.6	26.6
	20.6	22.9	24.7
	19.0	21.1	22.8
	17.4	19.3	20.9
	15.8	17.6	19.0
	14.3	15.8	17.1
	12.7	14.1	15.2
	11.1	12.3	13.3
	9.5	10.5	11.4
	7.9	8.8	9.5
	6.3	7.0	7.6
	25 class	35 class	50 class


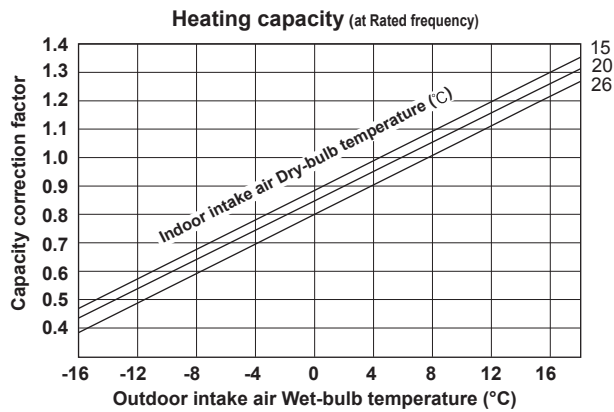


Indoor air Dry-bulb temperature difference (°C)	20.6	22.9	24.7
	19.0	21.1	22.8
	17.4	19.3	20.9
	15.8	17.6	19.0
	14.3	15.8	17.1
	12.7	14.1	15.2
	11.1	12.3	13.3
	9.5	10.5	11.4
	7.9	8.8	9.5
	6.3	7.0	7.6
	25 class	35 class	50 class


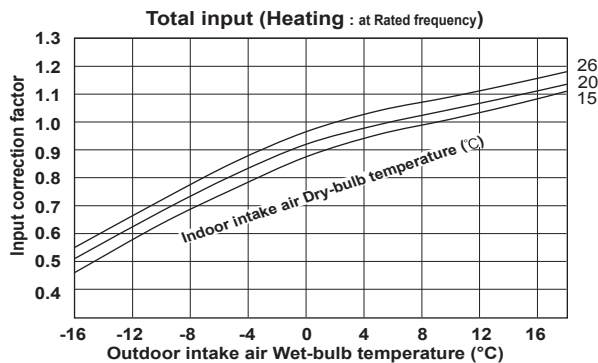


MXZ-2HA40VF MXZ-2HA50VF

Indoor air Wet-bulb temperature difference (°C)	25 class	35 class	42 class (MXZ-2HA40VF)
5.9		8.7	11.1
5.5		8.0	10.2
5.0		7.3	9.3
4.6		6.6	8.3
4.1		5.9	7.5
3.7		5.3	6.6
3.2		4.6	5.8
2.8		4.0	5.0

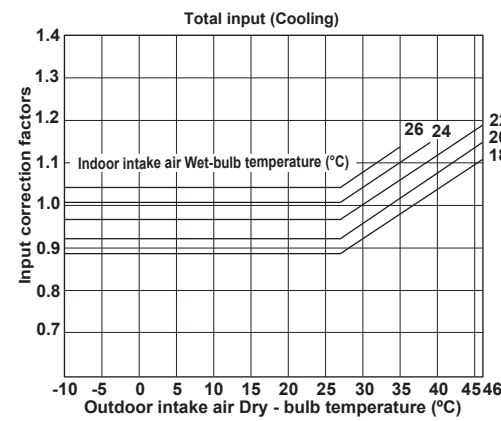
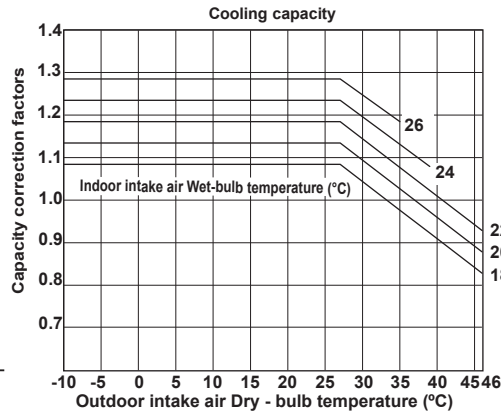


Indoor air Dry-bulb temperature difference (°C)	25 class	35 class	42 class (MXZ-2HA50VF)
21.3		22.2	26.6
19.8		20.6	24.7
18.3		19.0	22.8
16.7		17.4	20.9
15.2		15.8	19.0
13.7		14.3	17.1
12.2		12.7	15.2
10.7		11.1	13.3
9.1		9.5	11.4
7.6		7.9	9.5
6.1		6.3	7.6

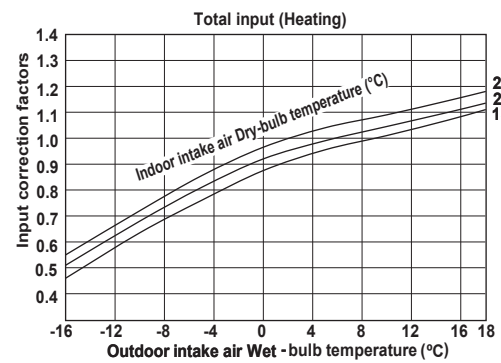
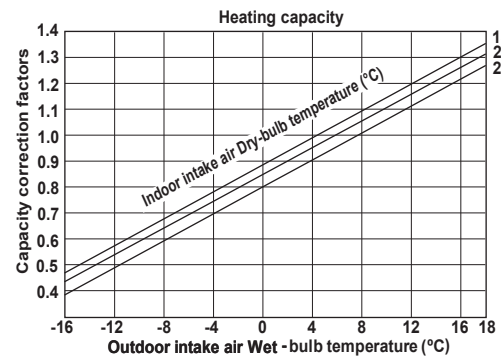


MXZ-3HA50VF

5.9	8.7	11.1	12.8
5.5	8.0	10.2	11.6
5.0	7.3	9.3	10.5
4.6	6.6	8.3	9.5
4.1	5.9	7.5	8.5
3.7	5.3	6.6	7.5
3.2	4.6	5.8	6.6
2.8	4.0	5.0	5.6
25 class	35 class	42 class	50 class

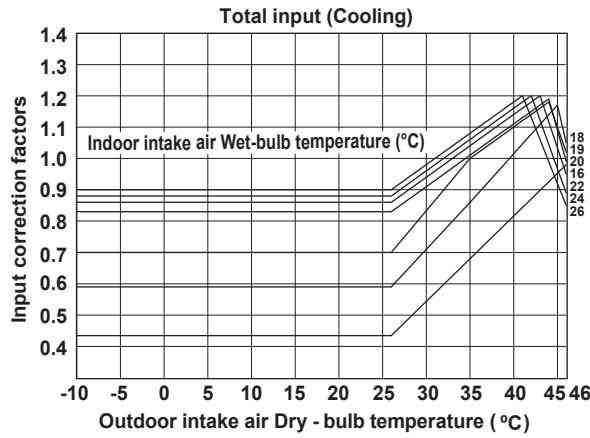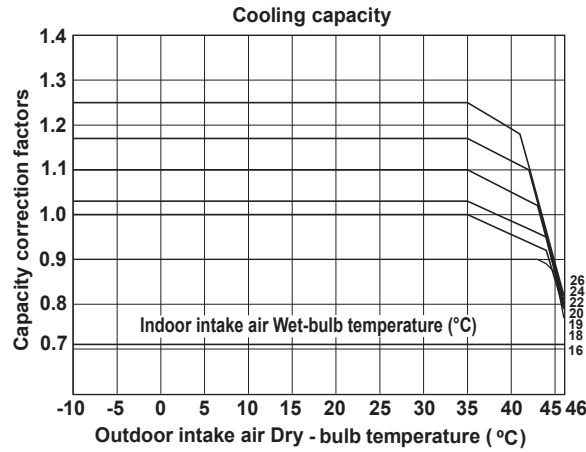


21.3	22.2	29.9	38.4
19.8	20.6	27.8	35.7
18.3	19.0	25.7	32.9
16.7	17.4	23.5	30.2
15.2	15.8	21.4	27.4
13.7	14.3	19.2	24.7
12.2	12.7	17.1	21.9
10.7	11.1	15.0	19.2
9.1	9.5	12.8	16.5
7.6	7.9	10.7	13.7
6.1	6.3	8.6	11.0
25 class	35 class	42 class	50 class

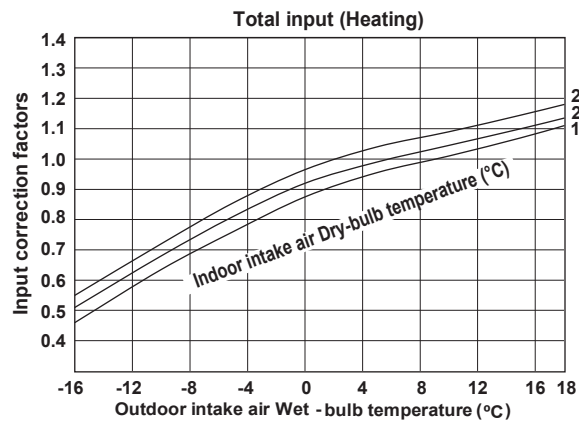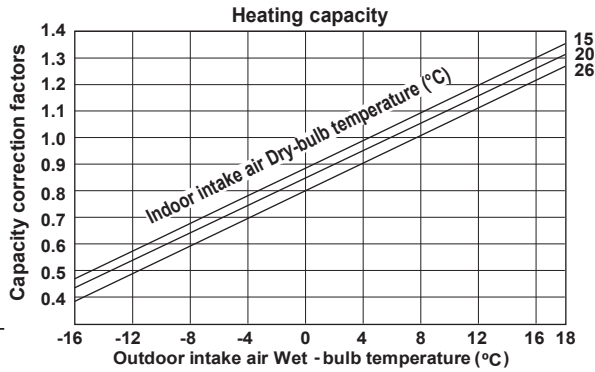


MXZ-2E53VAHZ


5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class

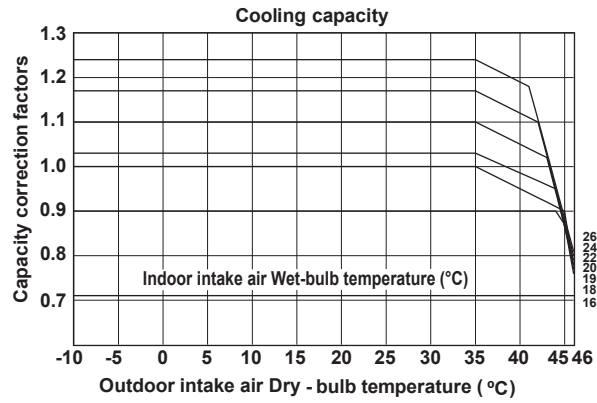


5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6
2.3	1.7	2.9	2.1	2.0	3.4	4.2	4.8
1.9	1.4	2.4	1.7	2.0	2.8	3.5	3.9
1.5	1.1	1.9	1.4	1.6	2.2	2.7	3.1
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class

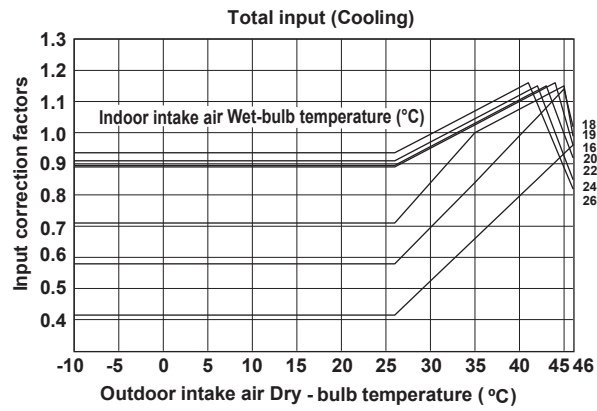

18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class

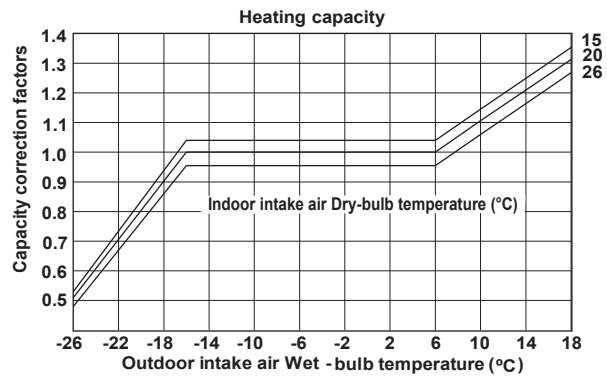

22.2	24.2	26.5	24.2	24.2	27.8	37.7	39.0
20.9	22.7	25.0	22.7	22.7	26.2	35.5	36.7
19.6	21.2	23.5	21.2	21.2	24.6	33.3	34.4
18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class

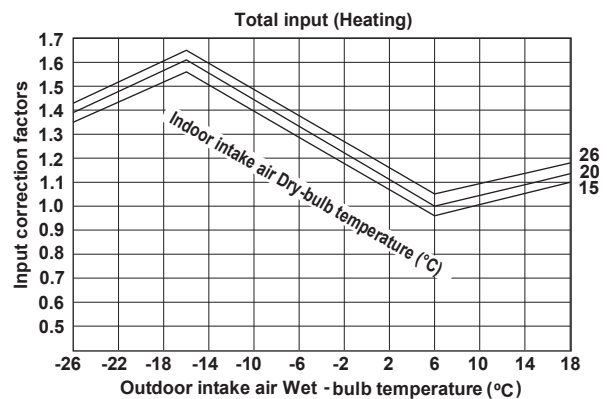





MXZ-4E83VAHZ

5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0	8.2
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6	7.3	7.5
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5	6.6	6.8
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5	6.0	6.1
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3	5.4
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6	4.7
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6	4.0	4.1
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

5.4	3.8	6.8	4.8	5.5	8.0	10.2	11.6	8.0	8.2
4.9	3.5	6.2	4.4	5.0	7.3	9.3	10.6	7.3	7.5
4.5	3.2	5.7	4.0	4.6	6.6	8.4	9.5	6.6	6.8
4.0	2.9	5.1	3.6	4.1	6.0	7.5	8.5	6.0	6.1
3.6	2.6	4.5	3.2	3.7	5.3	6.6	7.5	5.3	5.4
3.2	2.3	4.0	2.8	3.2	4.6	5.8	6.6	4.6	4.7
2.8	2.0	3.5	2.5	2.8	4.0	5.0	5.6	4.0	4.1
2.3	1.7	2.9	2.1	2.0	3.4	4.2	4.8	3.4	3.5
1.9	1.4	2.4	1.7	2.0	2.8	3.5	3.9	2.8	2.9
1.5	1.1	1.9	1.4	1.6	2.2	2.7	3.1	2.2	2.3
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1	22.3	28.3
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8	20.7	26.3
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5	19.1	24.3
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2	17.5	22.3
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7	15.7	20.0
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4	14.2	18.0
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1	12.6	16.0
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9	11.0	14.0
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4	9.3	11.9
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2	7.8	9.9
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class


22.2	24.2	26.5	24.2	24.2	27.8	37.7	39.0	27.1	34.3
20.9	22.7	25.0	22.7	22.7	26.2	35.5	36.7	25.5	32.3
19.6	21.2	23.5	21.2	21.2	24.6	33.3	34.4	23.9	30.3
18.3	19.7	22.0	19.7	19.7	23.0	31.1	32.1	22.3	28.3
17.0	18.2	20.5	18.2	18.2	21.4	28.9	29.8	20.7	26.3
15.7	16.8	18.9	16.8	16.8	19.7	26.6	27.5	19.1	24.3
14.4	15.4	17.3	15.4	15.4	18.1	24.4	25.2	17.5	22.3
12.9	13.9	15.6	13.9	13.9	16.3	21.9	22.7	15.7	20.0
11.6	12.5	14.0	12.5	12.5	14.6	19.7	20.4	14.2	18.0
10.3	11.1	12.4	11.1	11.1	13.0	17.6	18.1	12.6	16.0
9.0	9.7	10.9	9.7	9.7	11.4	15.4	15.9	11.0	14.0
7.7	8.2	9.2	8.2	8.2	9.6	13.0	13.4	9.3	11.9
6.4	6.9	7.7	6.9	6.9	8.0	10.8	11.2	7.8	9.9
15 class	18 class	20 class	22 class	25 class	35 class	42 class	50 class	60 class	71 class

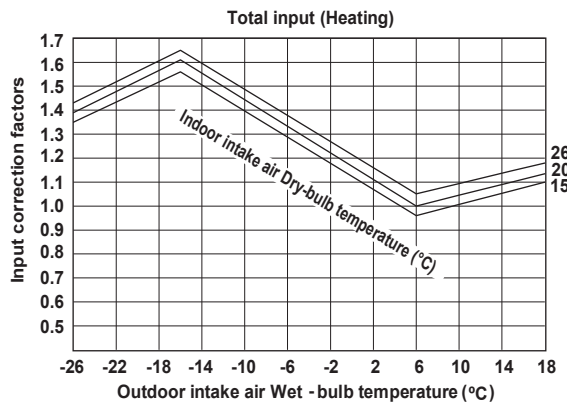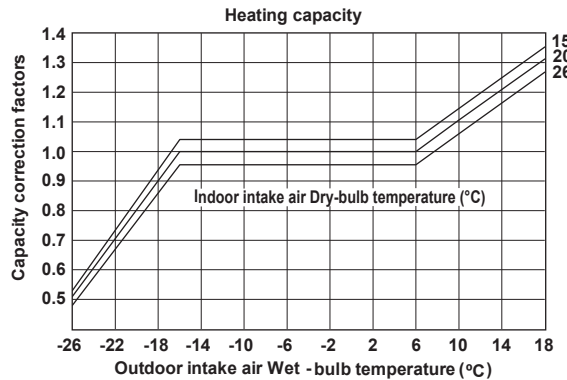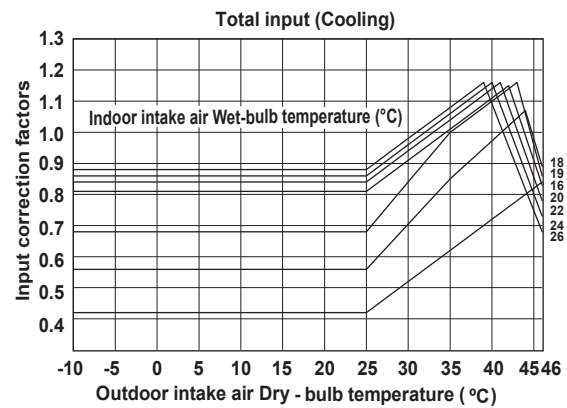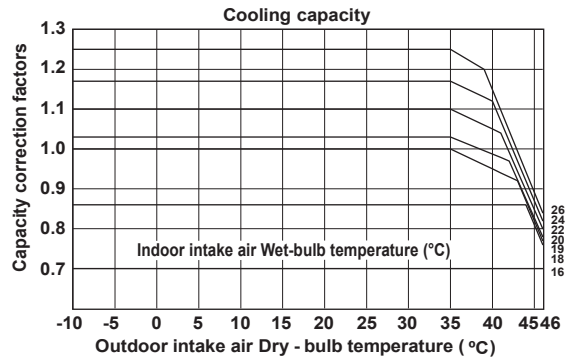


PERFORMANCE CURVES MULTI SYSTEMS

CAPACITY AND INPUT CORRECTION BY INVERTER OUTPUT FREQUENCY
MXZ-2F33VF


1. 15-class unit in single operation

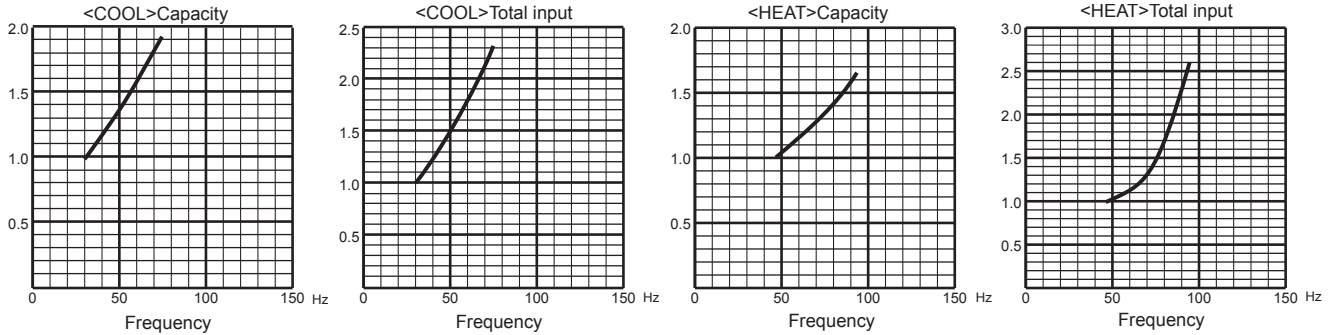


2. 18-class unit in single operation

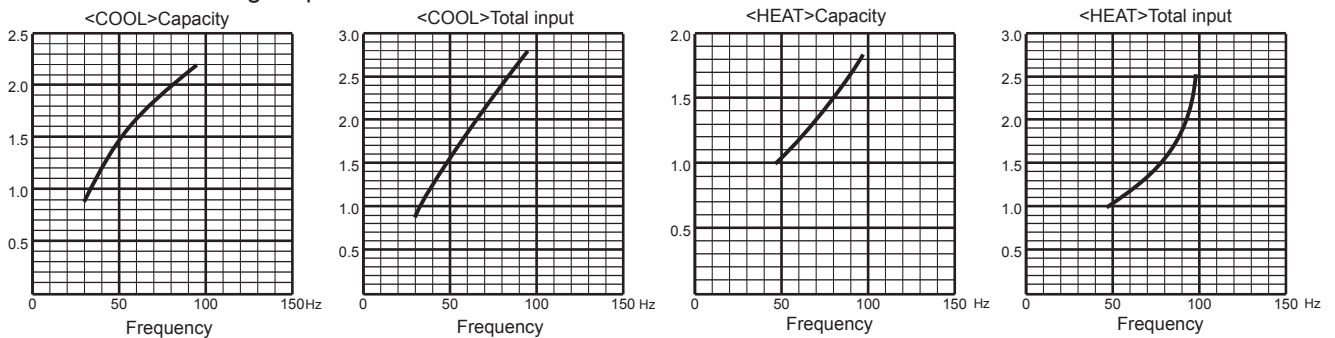


3. 20-class unit in single operation

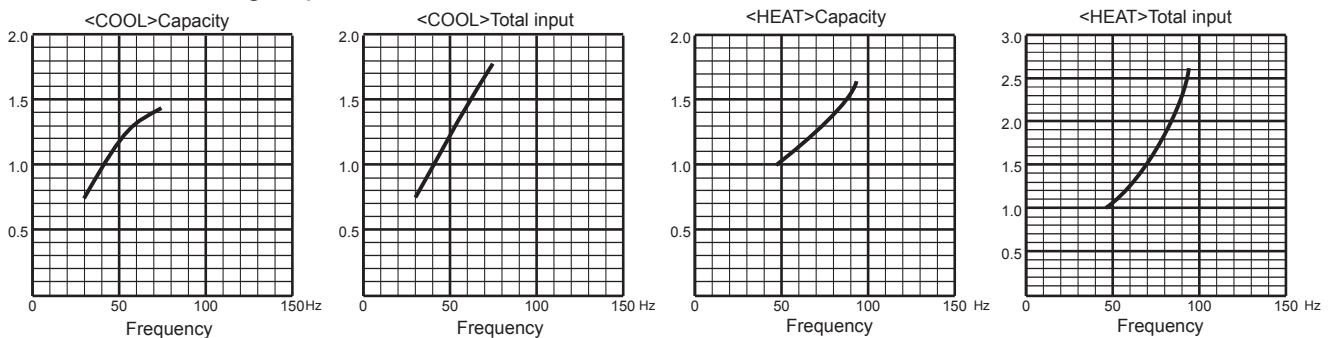

4. 22-class unit in single operation

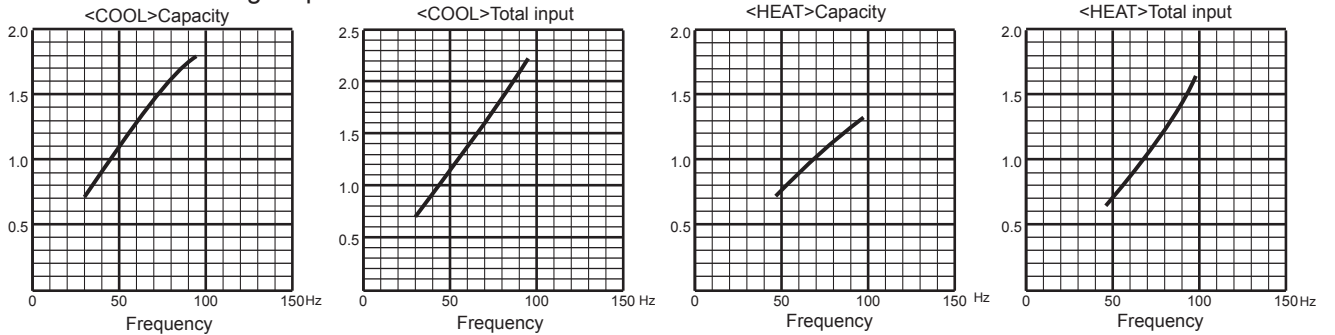


5. 25-class unit in single operation

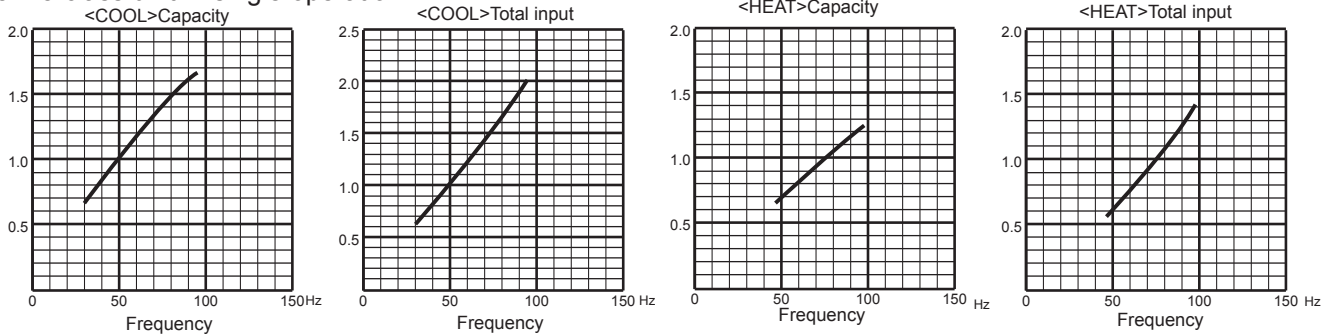


MXZ-2F42VF


1. 15-class unit in single operation

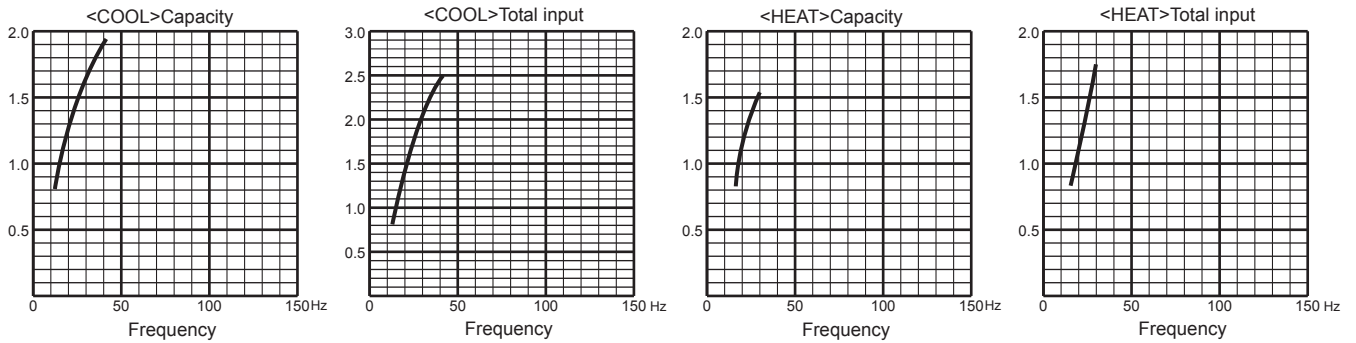


2. 18-class unit in single operation

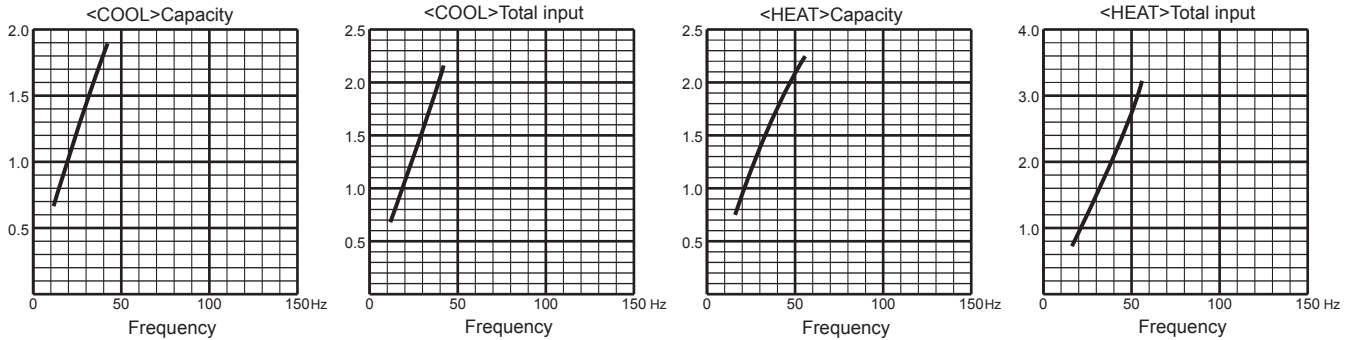


3. 20-class unit in single operation

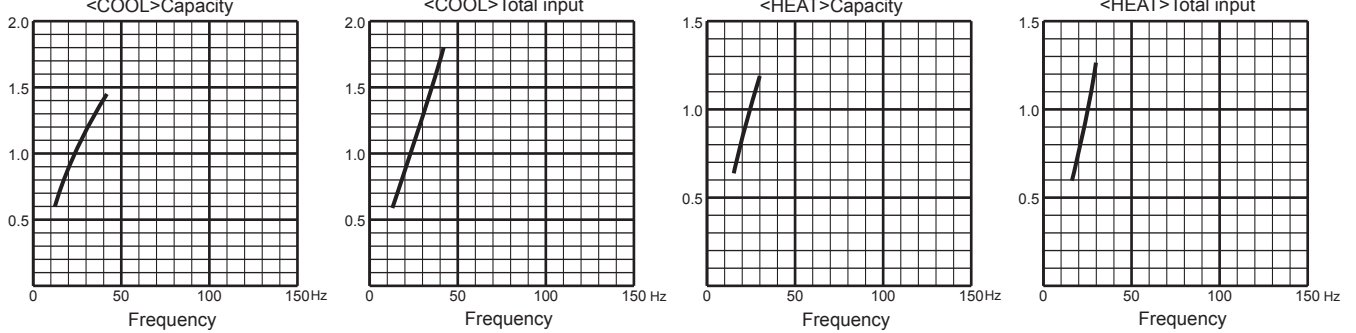

4. 22-class unit in single operation

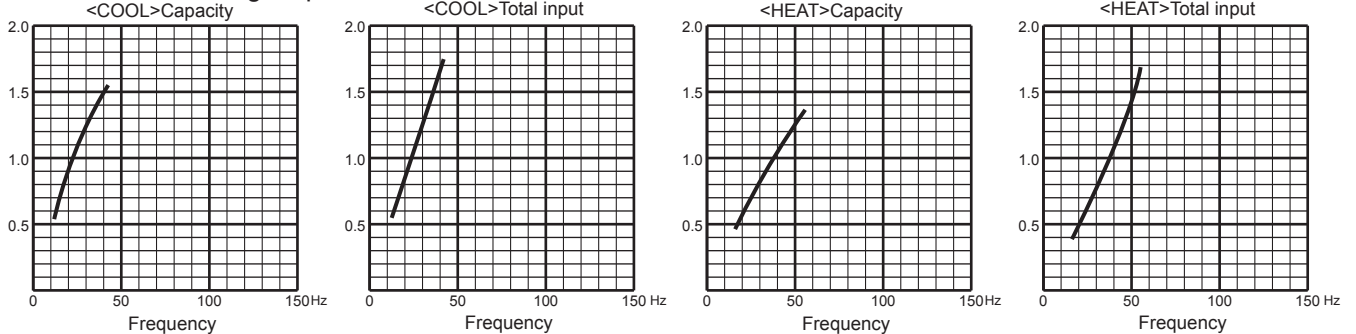


5. 25-class unit in single operation

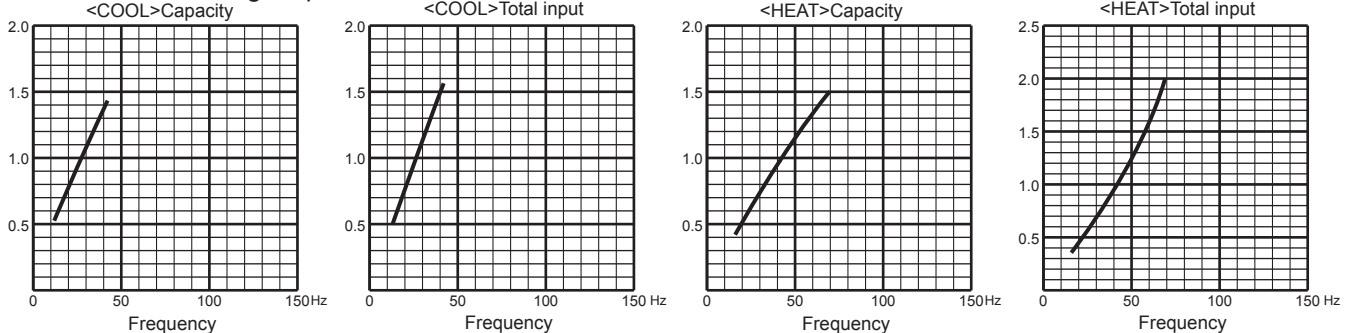

PERFORMANCE CURVES MULTI SYSTEMS


MXZ-2F42VF

6. 35-class unit in single operation

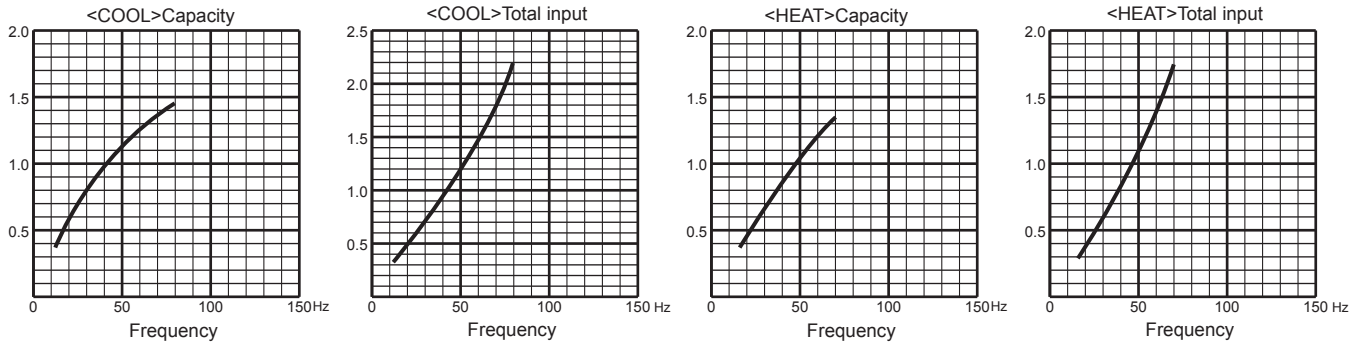


MXZ-2F53VF MXZ-2F53VFH


1. 15-class unit in single operation

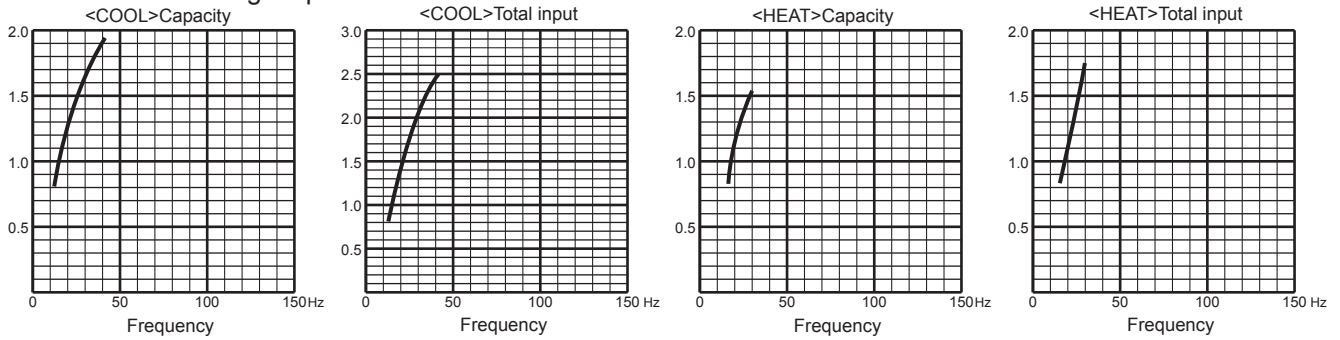


2. 18-class unit in single operation

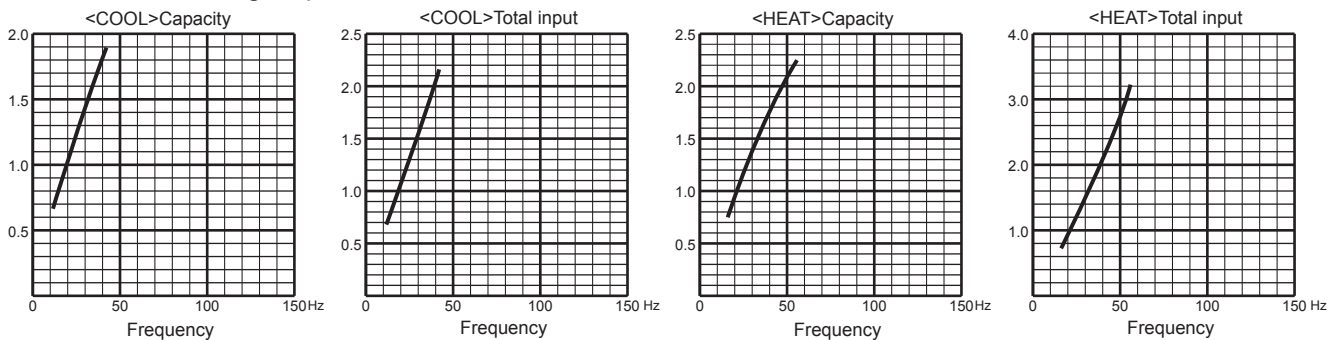

3. 20-class unit in single operation

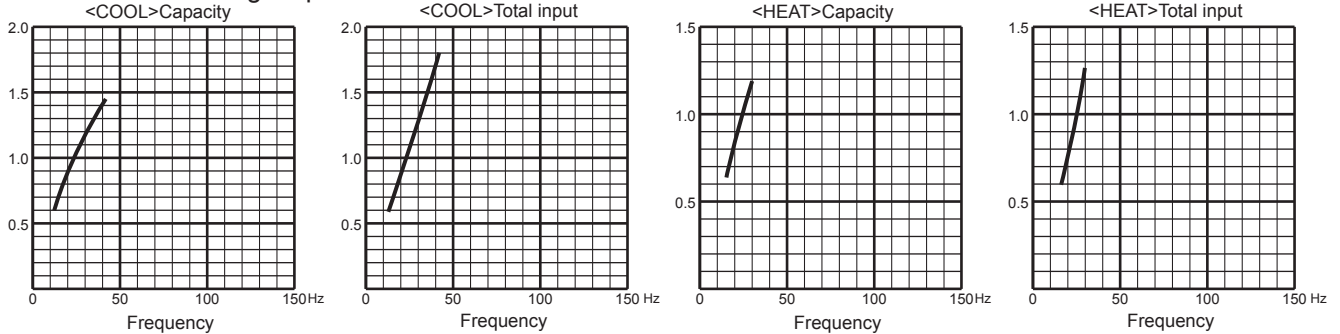


4. 22-class unit in single operation

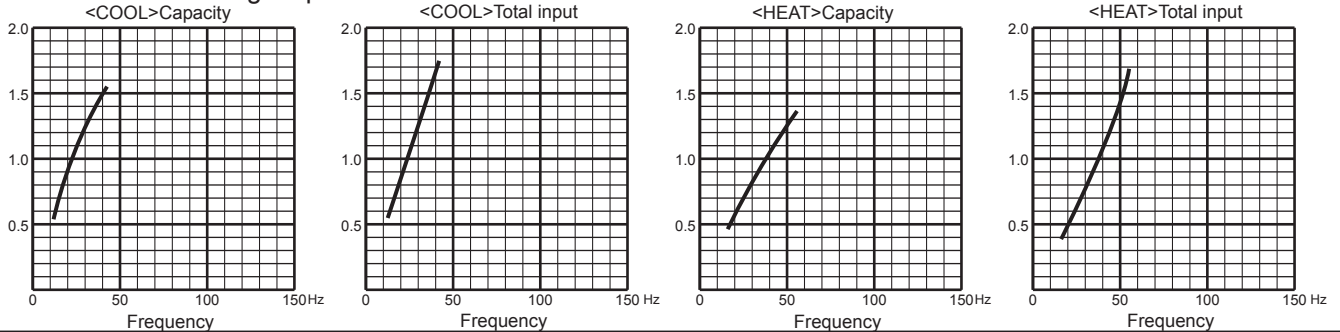


MXZ-2F53VF MXZ-2F53VFH


5. 25-class unit in single operation

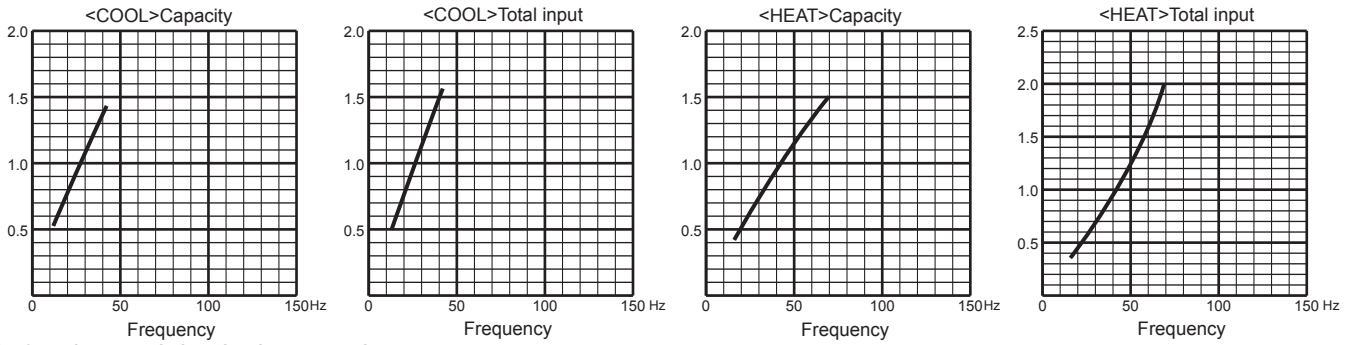


6. 35-class unit in single operation

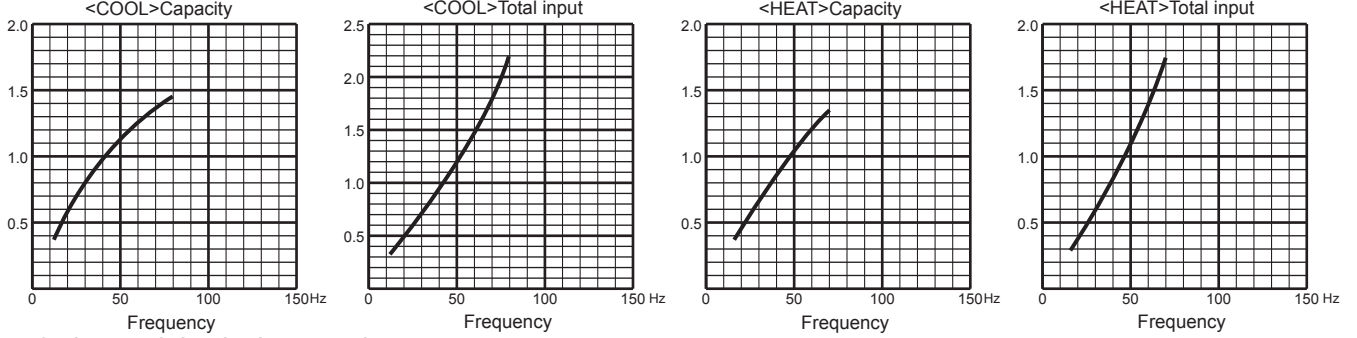

7. 42-class unit in single operation

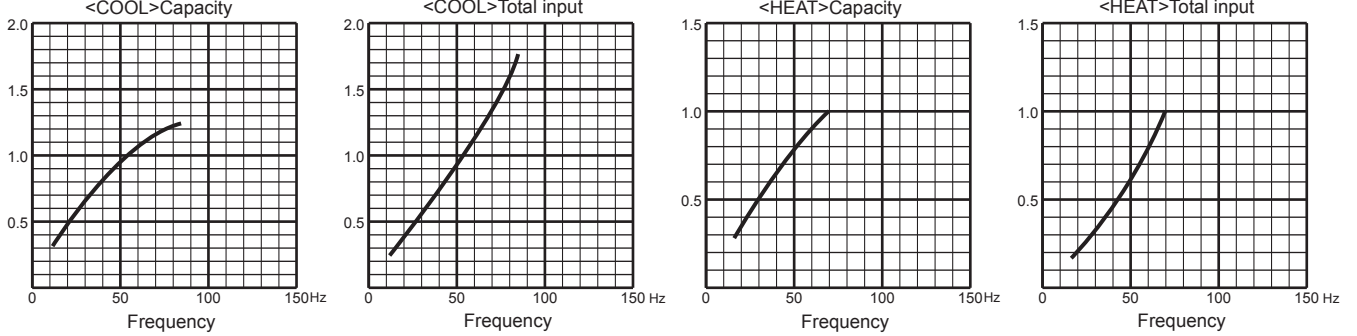


8. 50-class unit in single operation

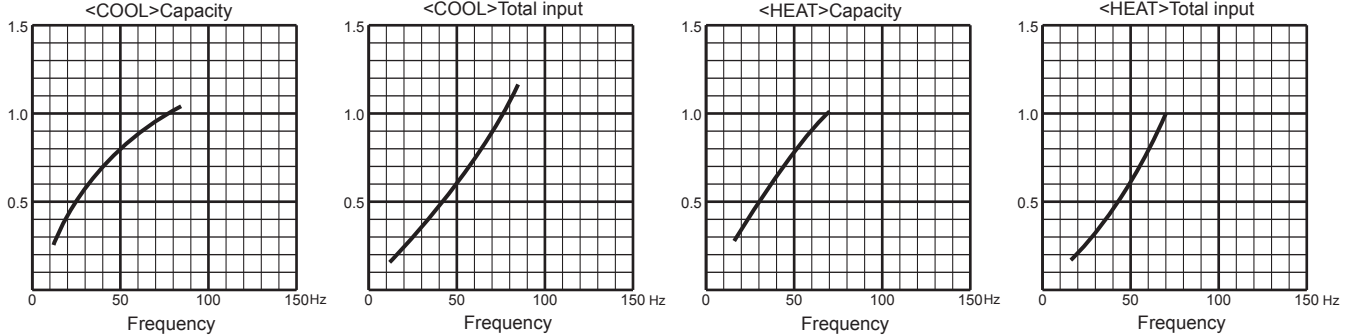


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-3F54VF2


1. 15-class unit in single operation

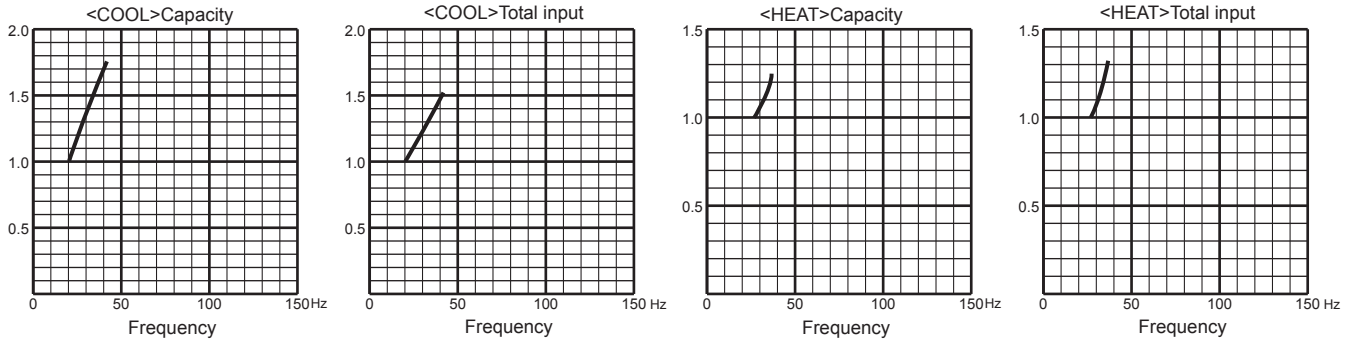


2. 18-class unit in single operation

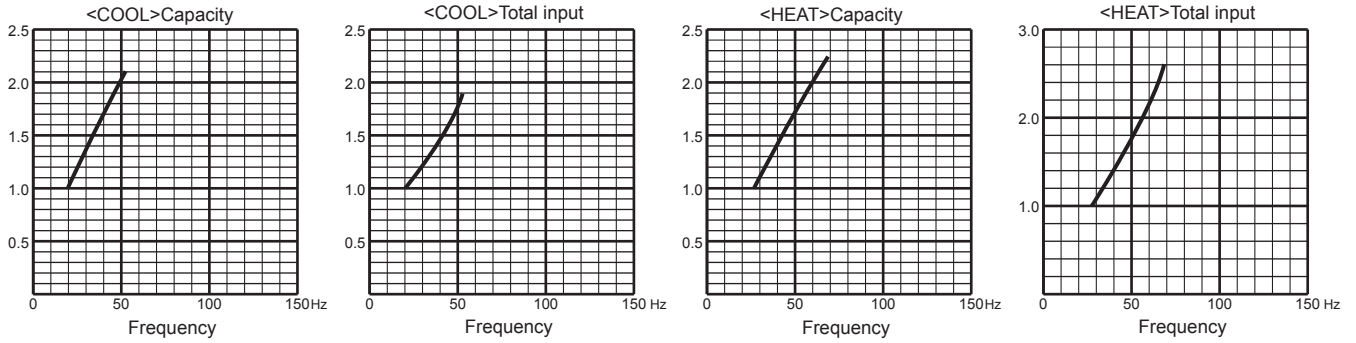

3. 20-class unit in single operation

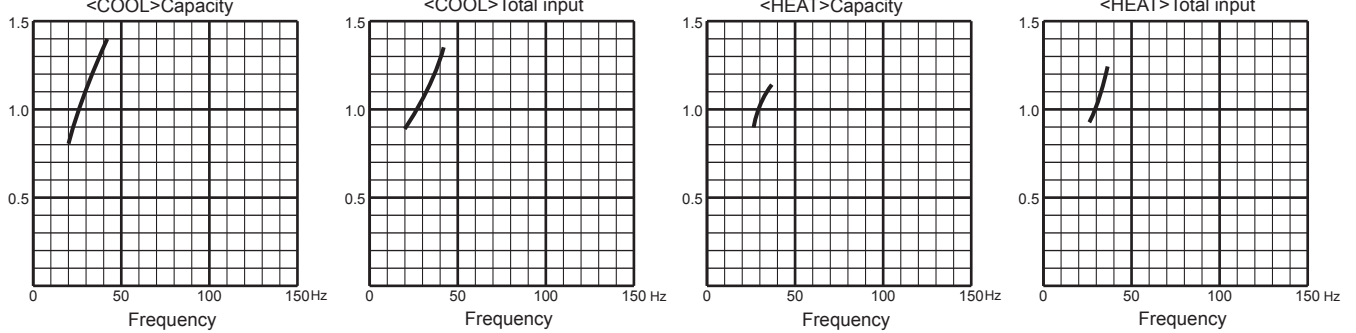


4. 22-class unit in single operation

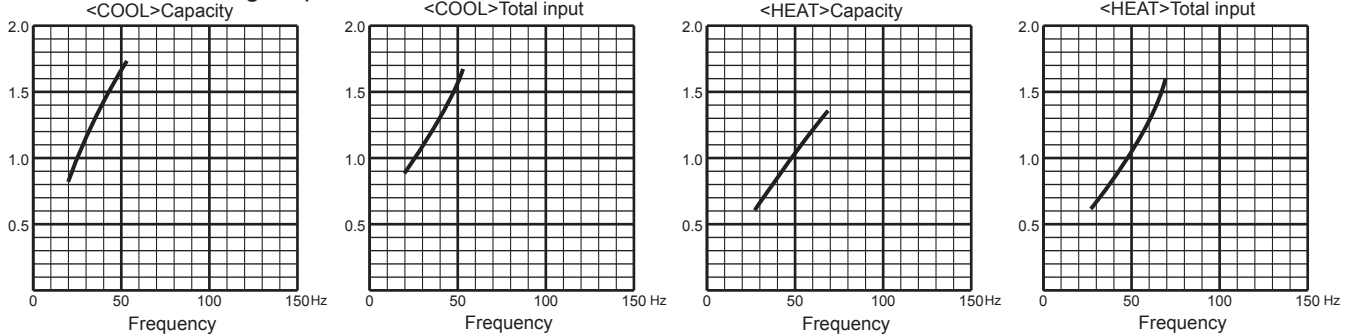


MXZ-3F54VF2


5. 25-class unit in single operation

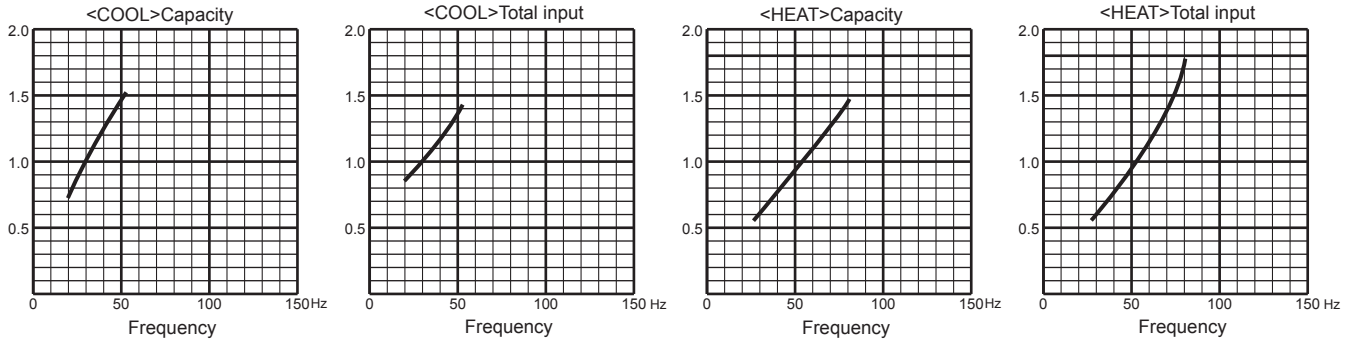


6. 35-class unit in single operation

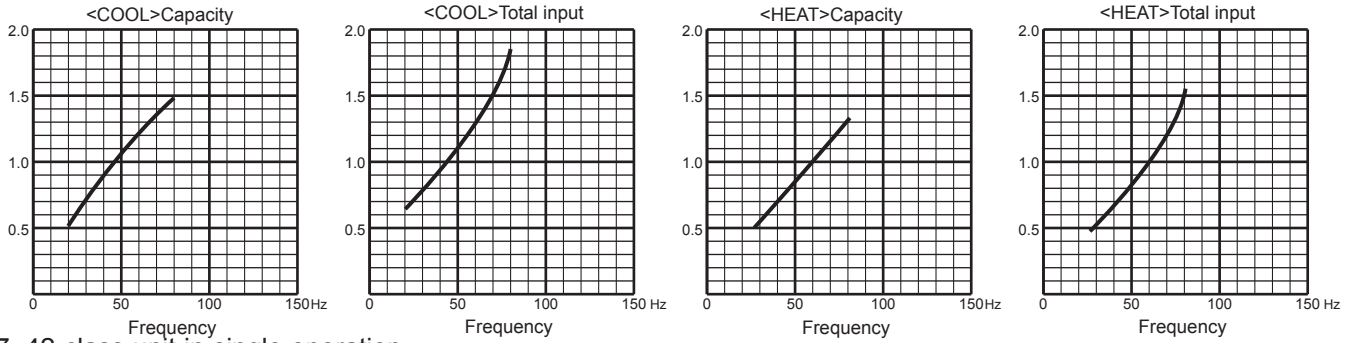

7. 42-class unit in single operation

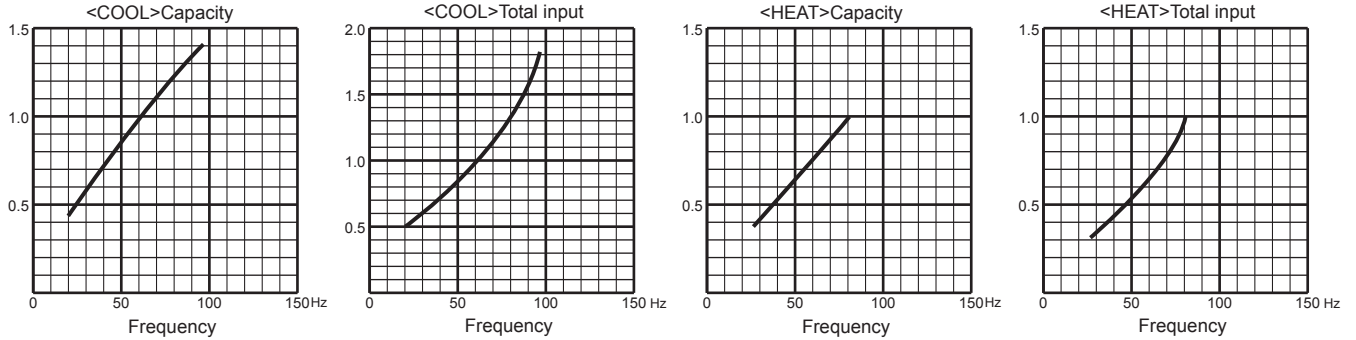


8. 50-class unit in single operation

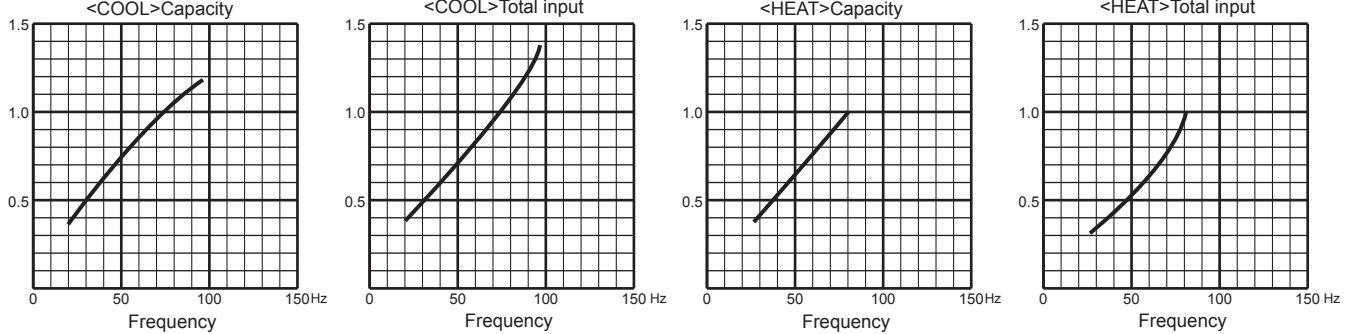


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-3F68VF2


1. 15-class unit in single operation

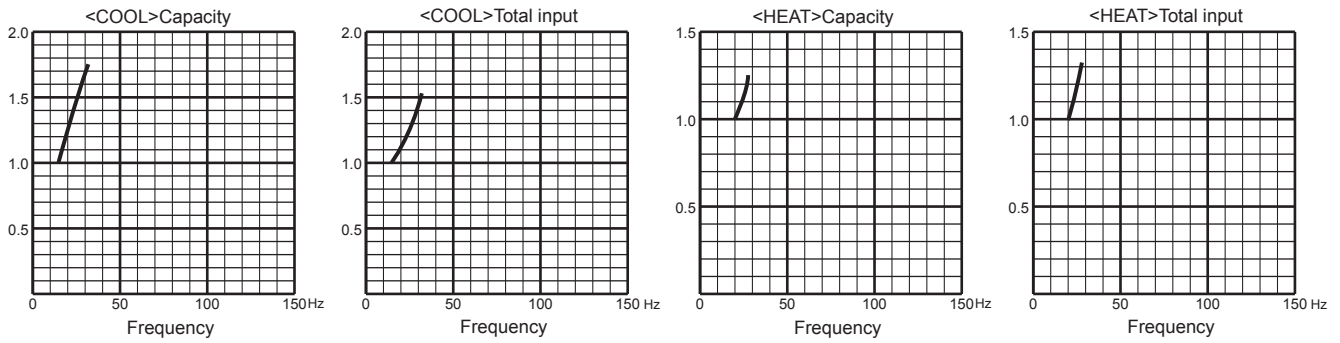


2. 18-class unit in single operation

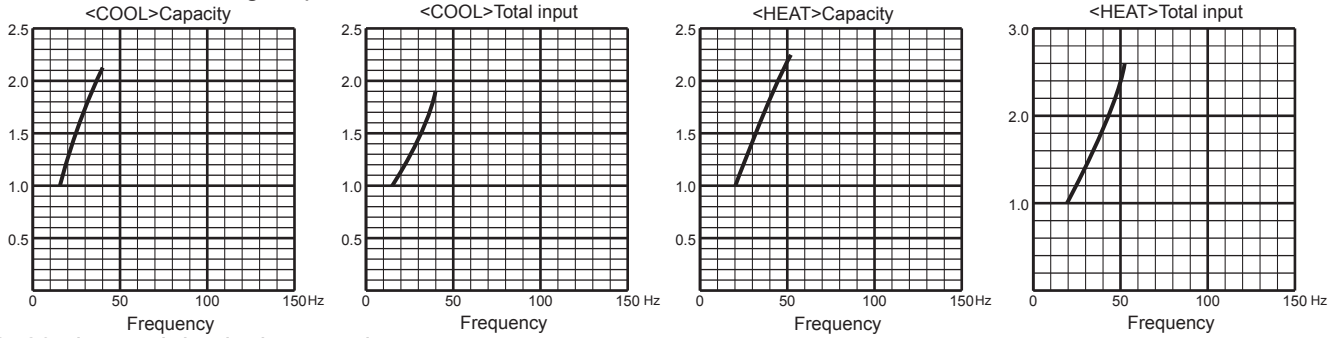


3. 20-class unit in single operation

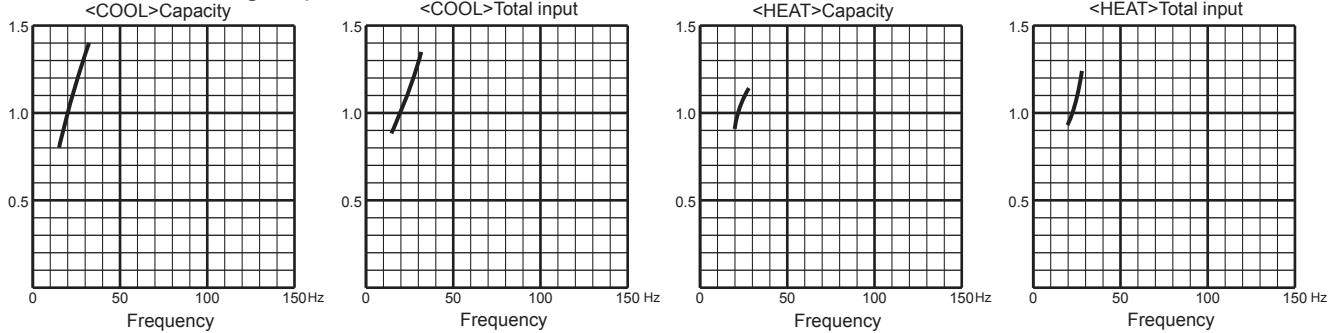

4. 22-class unit in single operation

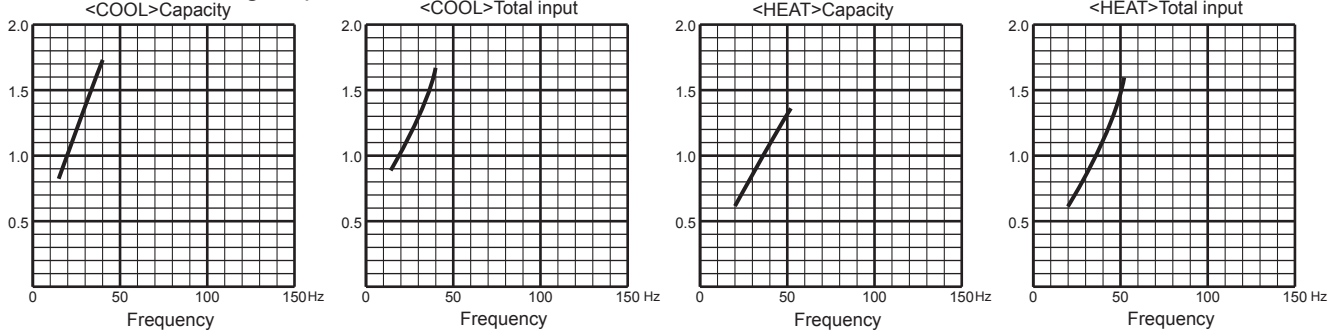


5. 25-class unit in single operation

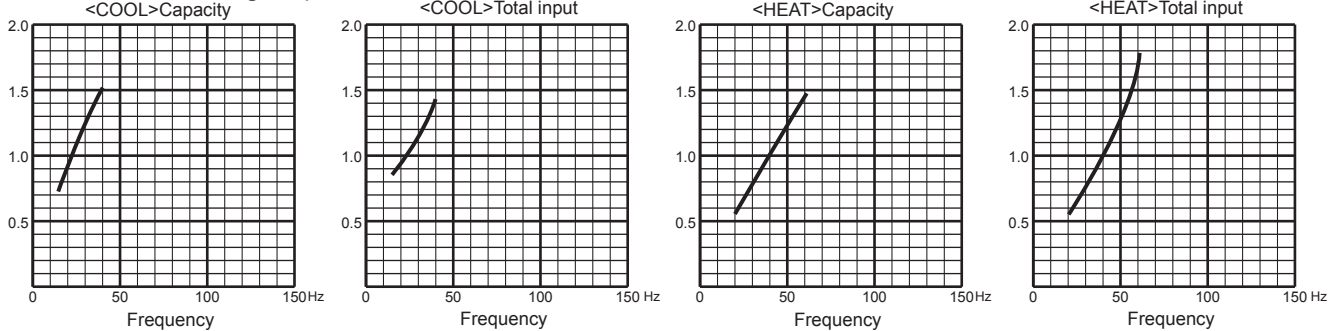


MXZ-3F68VF2


6. 35-class unit in single operation

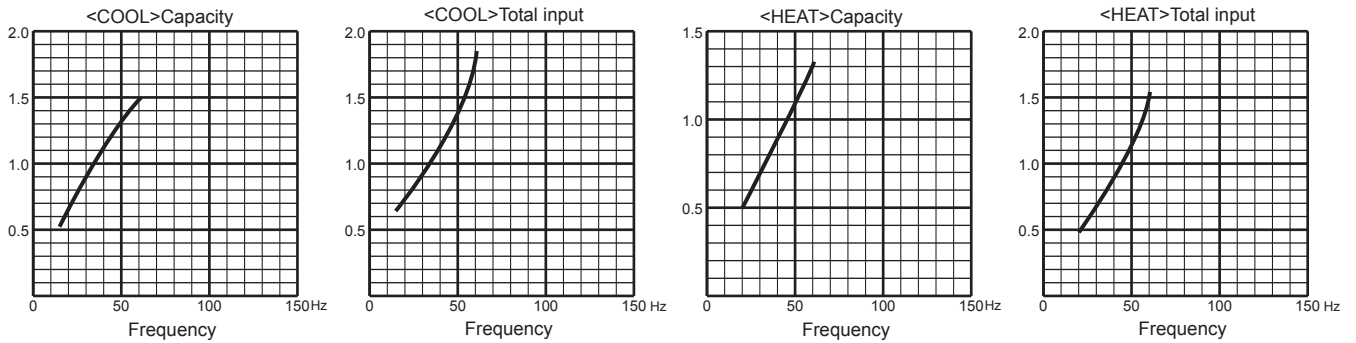


7. 42-class unit in single operation

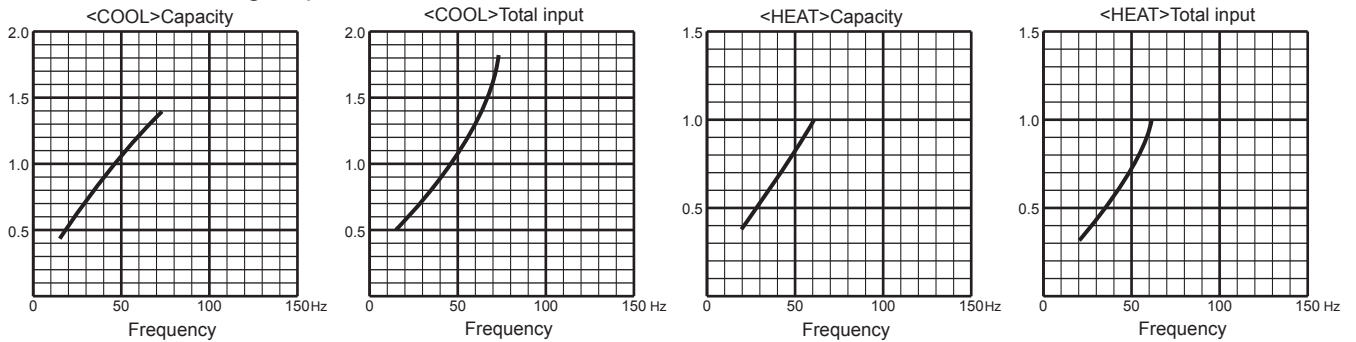

8. 50-class unit in single operation

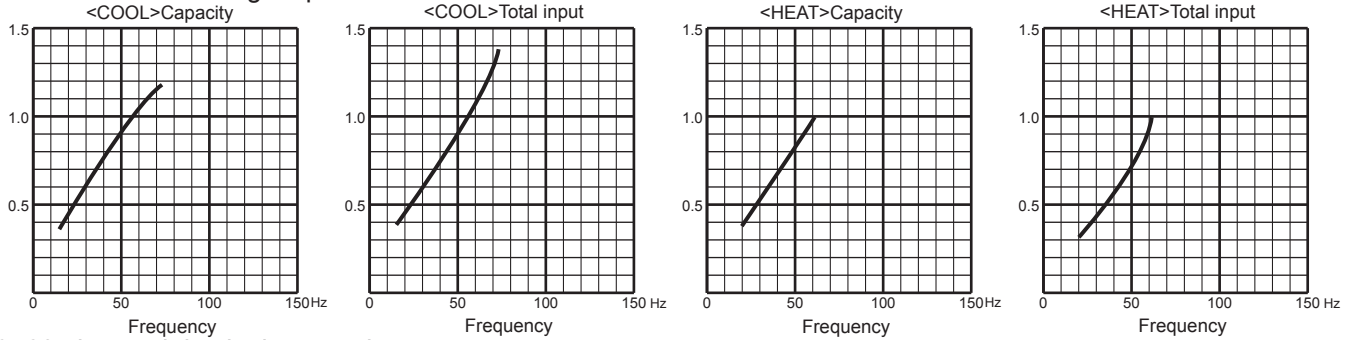


9. 60-class unit in single operation

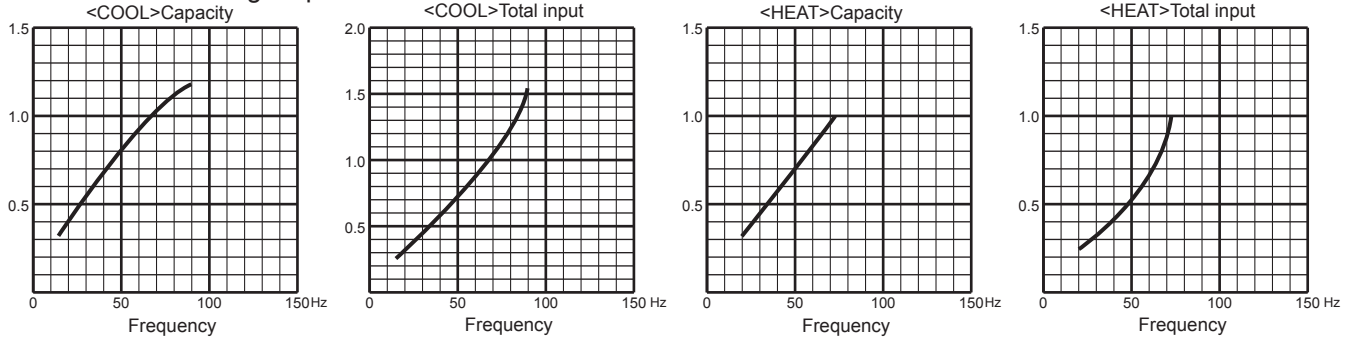


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-4F72VF2


1. 15-class unit in single operation

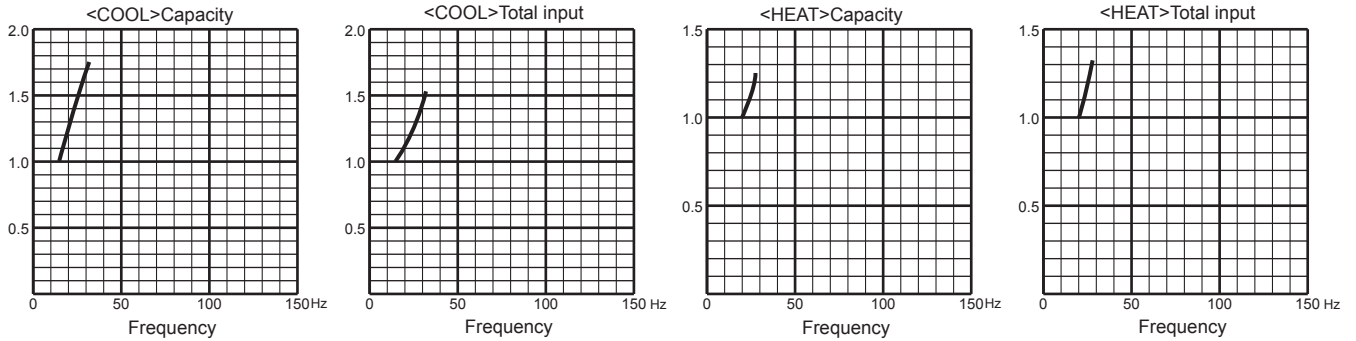


2. 18-class unit in single operation

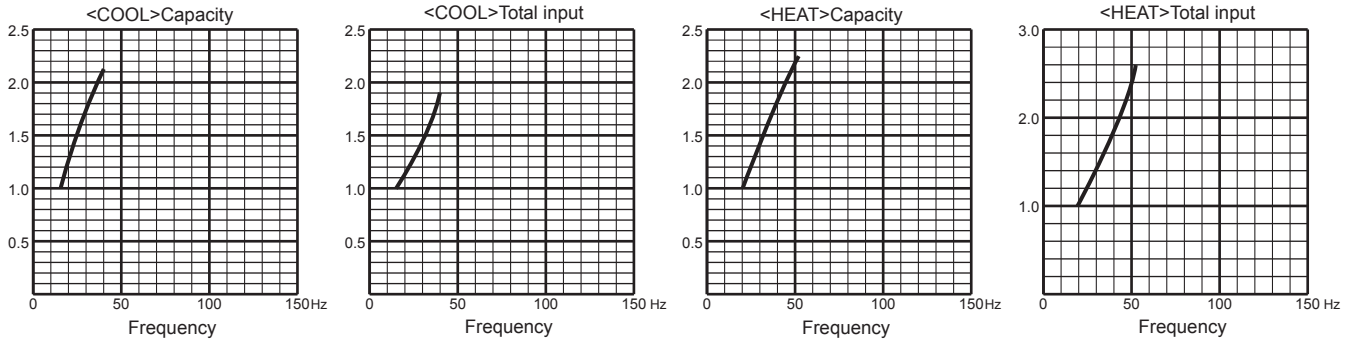


3. 20-class unit in single operation

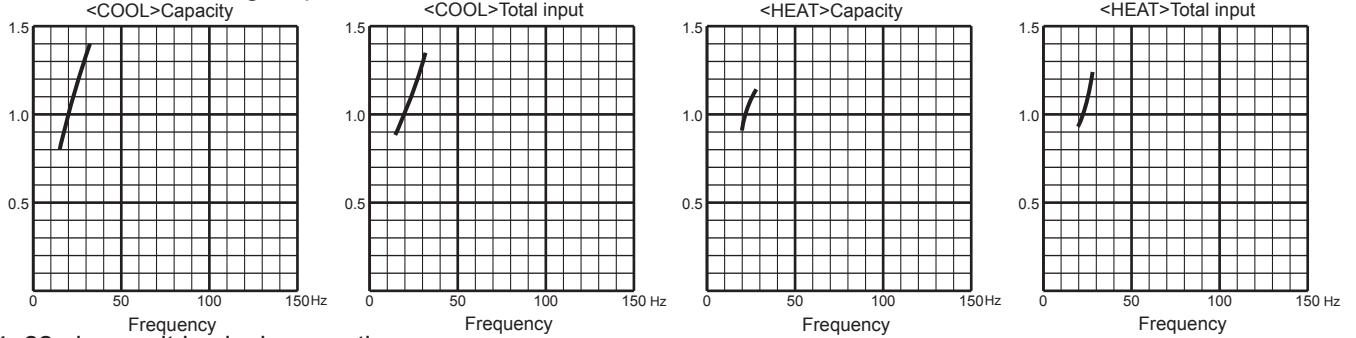

4. 22-class unit in single operation

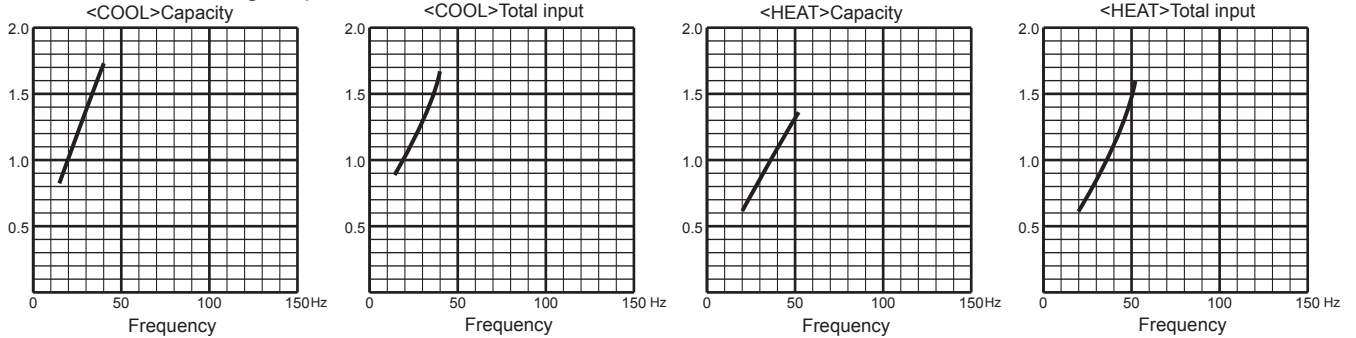


5. 25-class unit in single operation

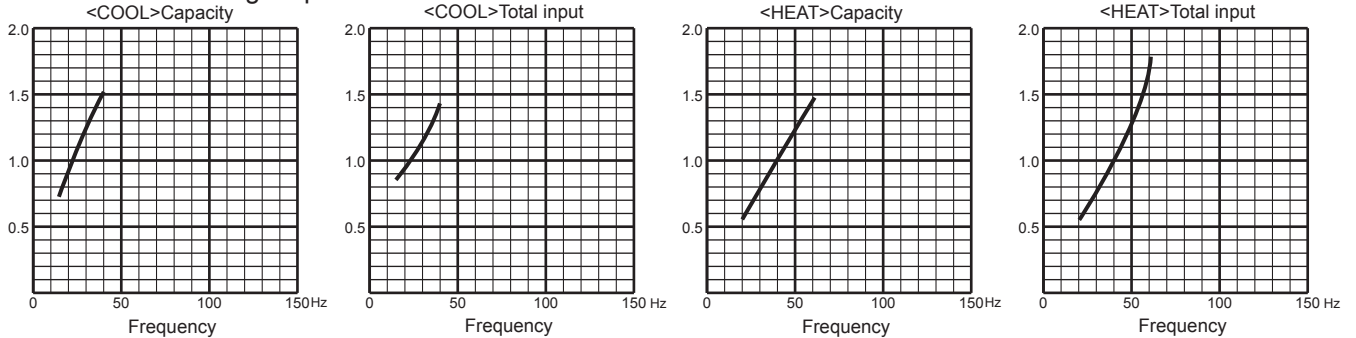


MXZ-4F72VF2


6. 35-class unit in single operation

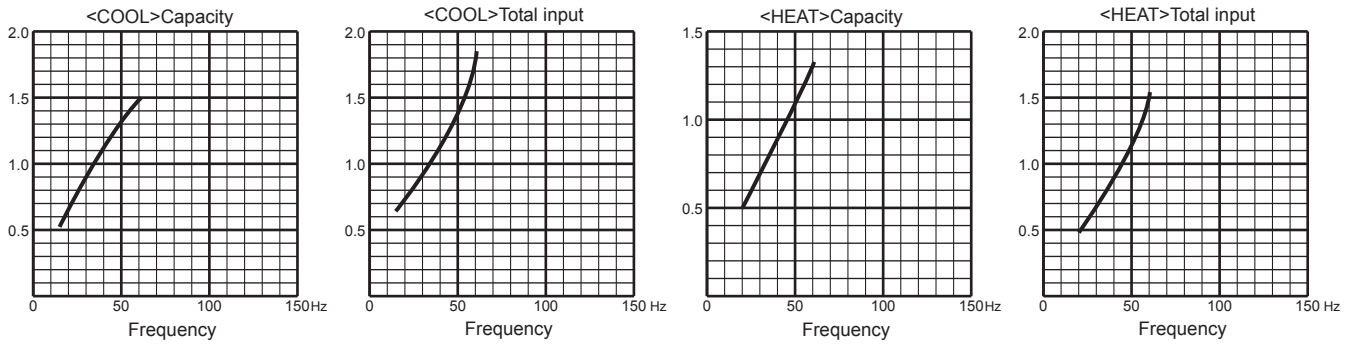


7. 42-class unit in single operation

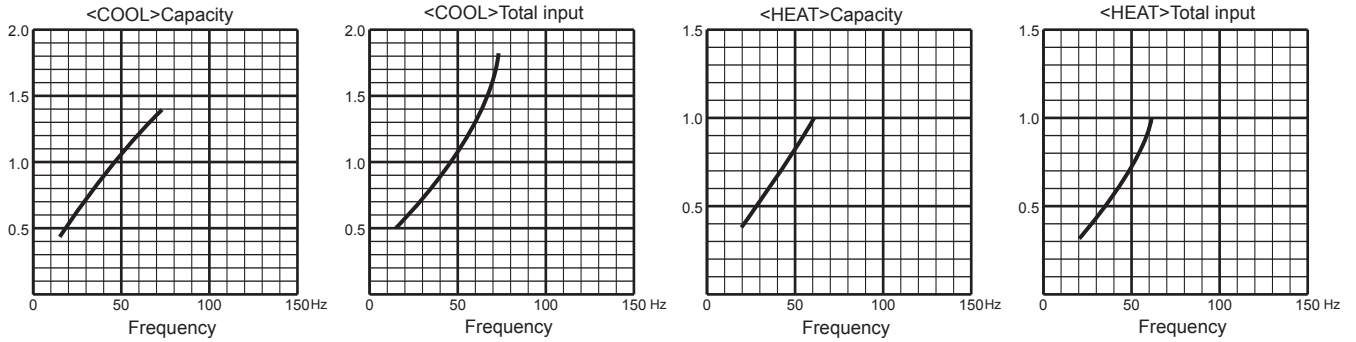

8. 50-class unit in single operation

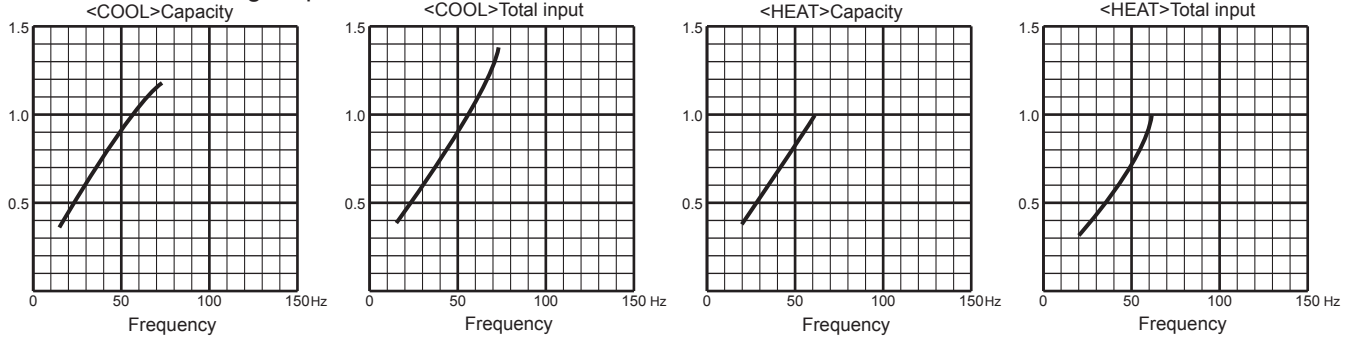


9. 60-class unit in single operation

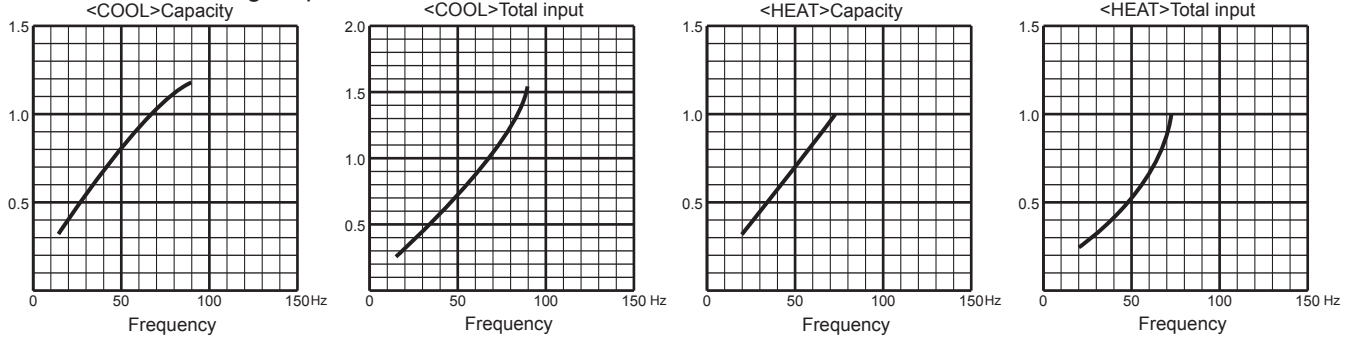


MXZ-4F80VF2


1. 15-class unit in single operation

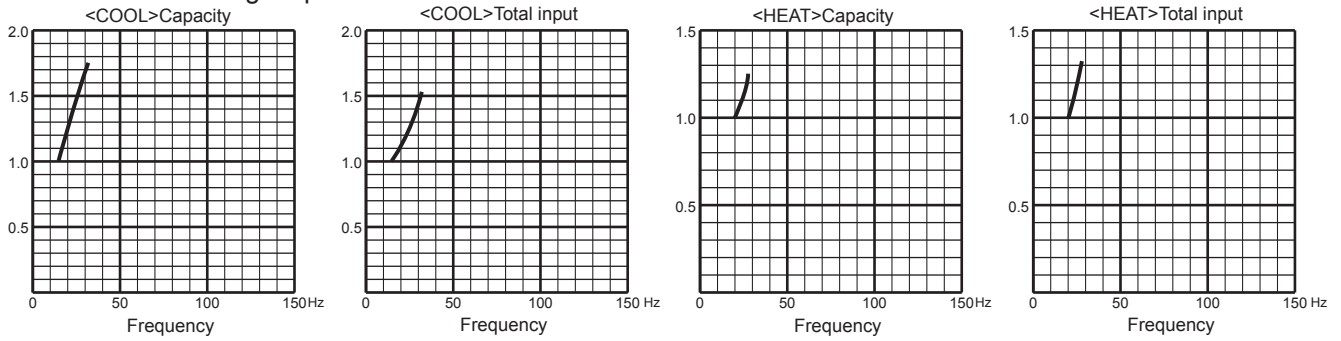


2. 18-class unit in single operation

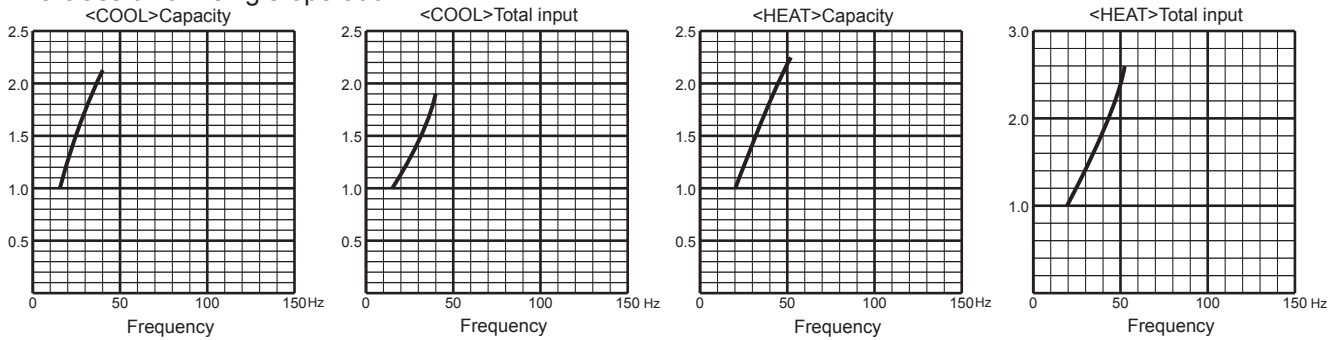


3. 20-class unit in single operation

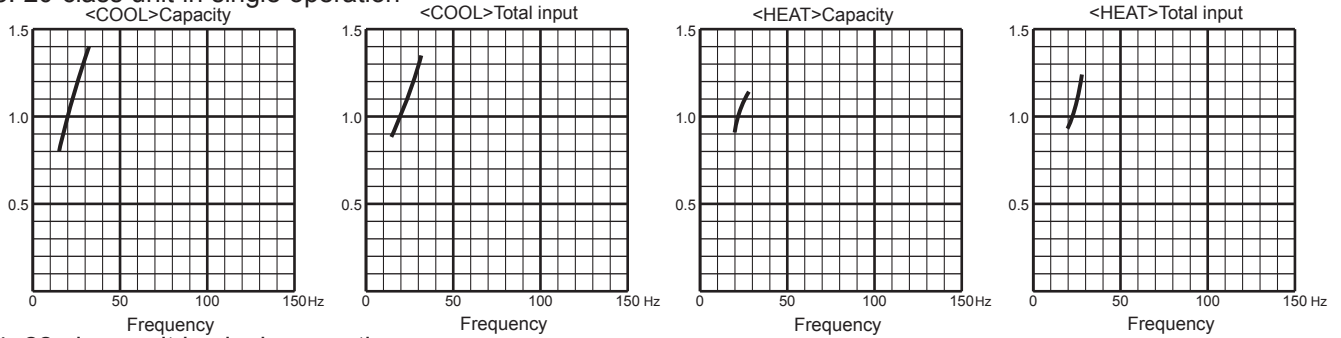

4. 22-class unit in single operation

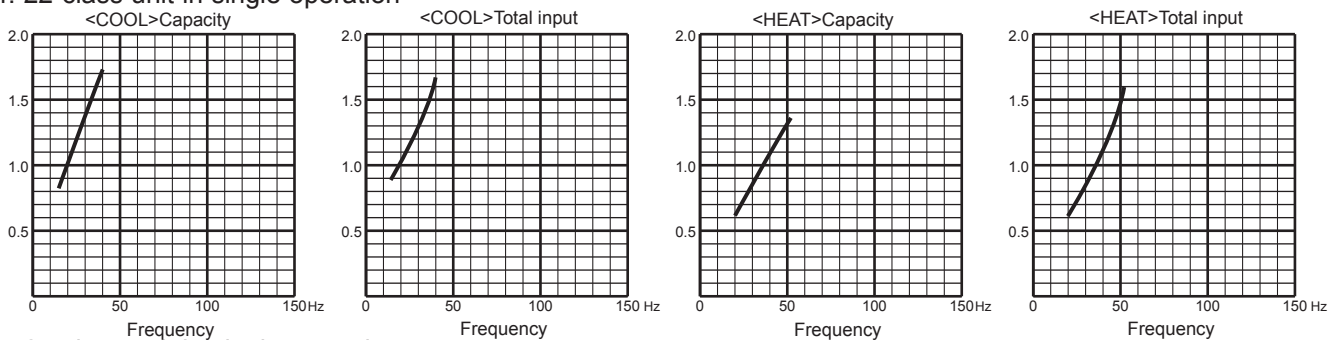


5. 25-class unit in single operation

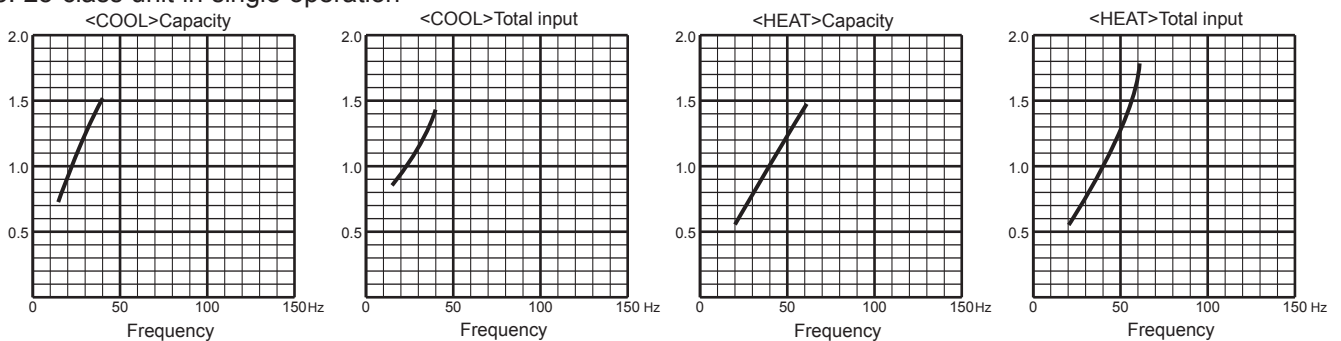


MXZ-4F80VF2


6. 35-class unit in single operation

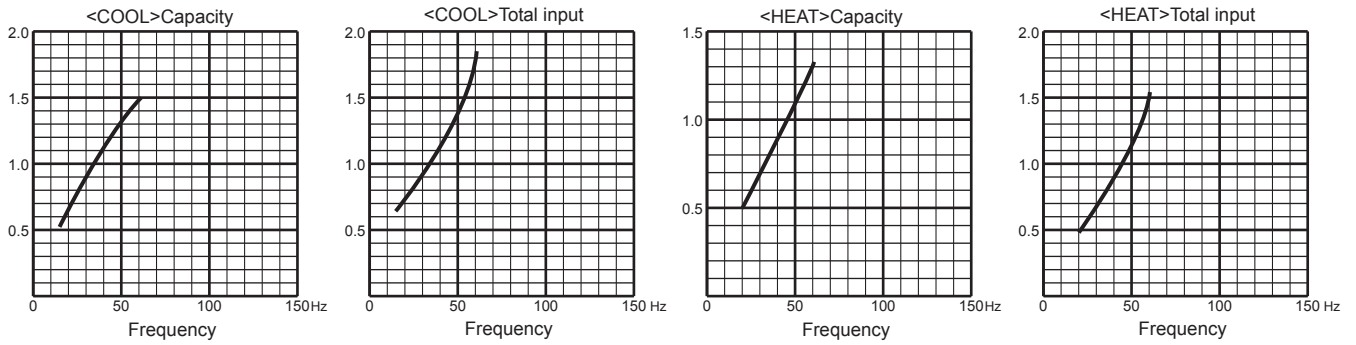


7. 42-class unit in single operation

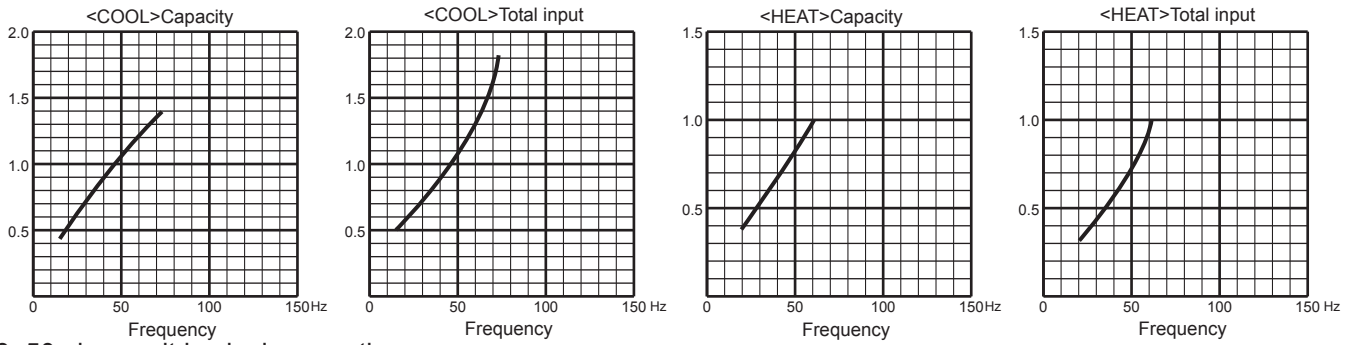

8. 50-class unit in single operation

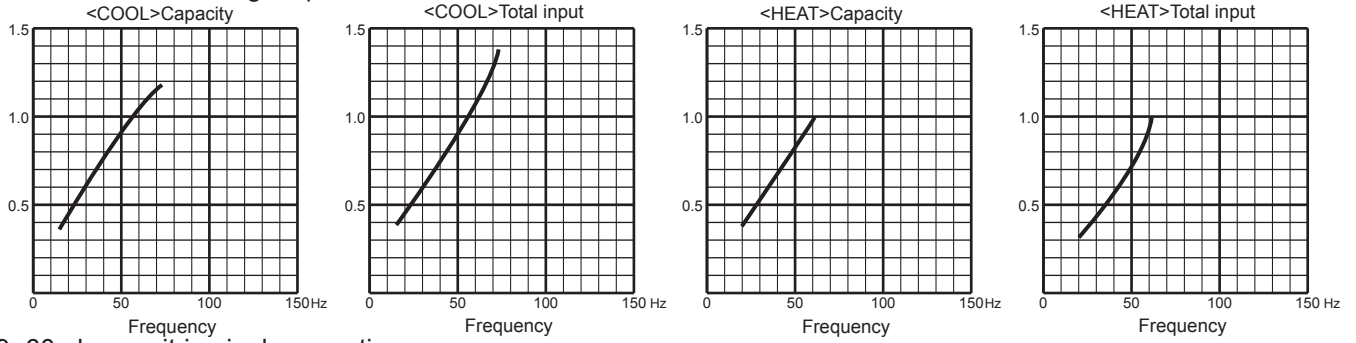


9. 60-class unit in single operation

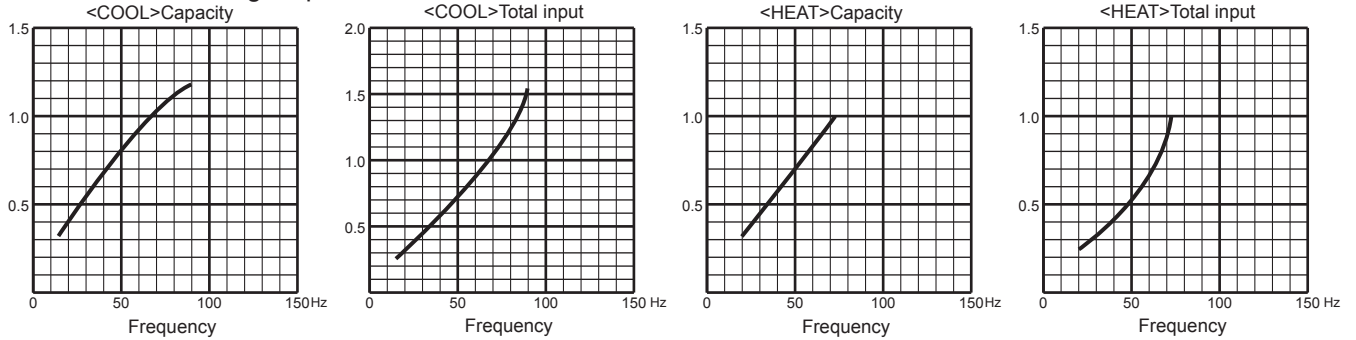


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-2D33VA


1. 15-class unit in single operation

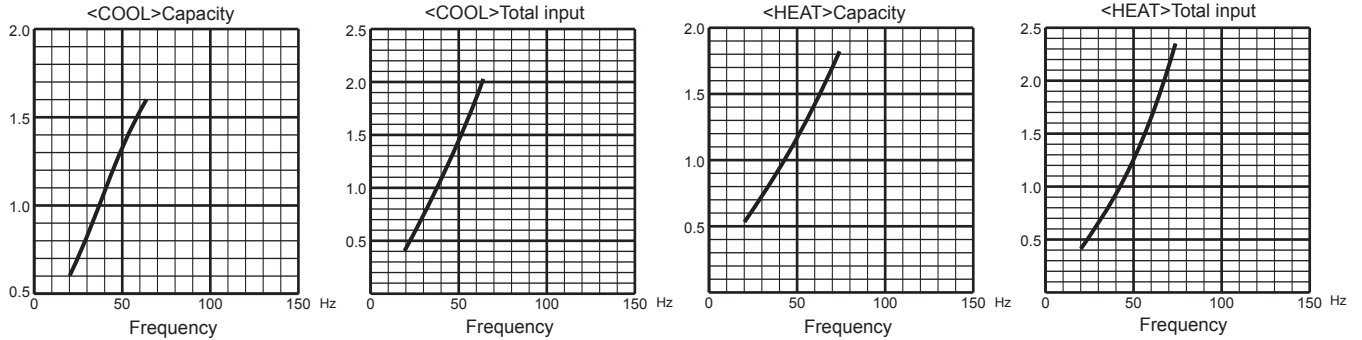


2. 18-class unit in single operation

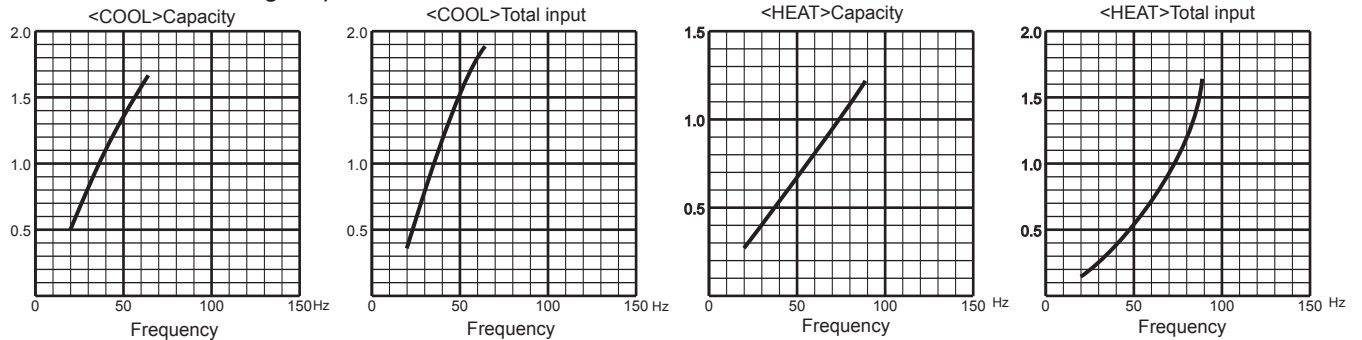


3. 20-class unit in single operation

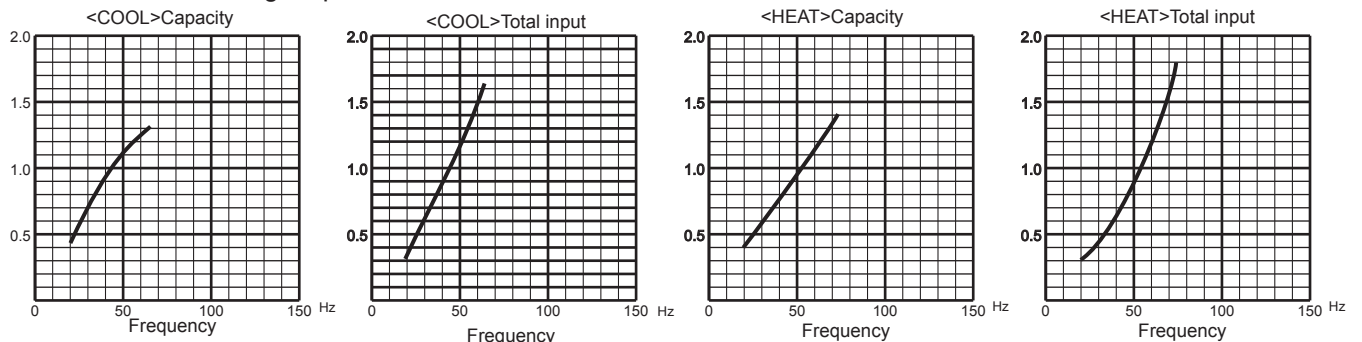

4. 22-class unit in single operation

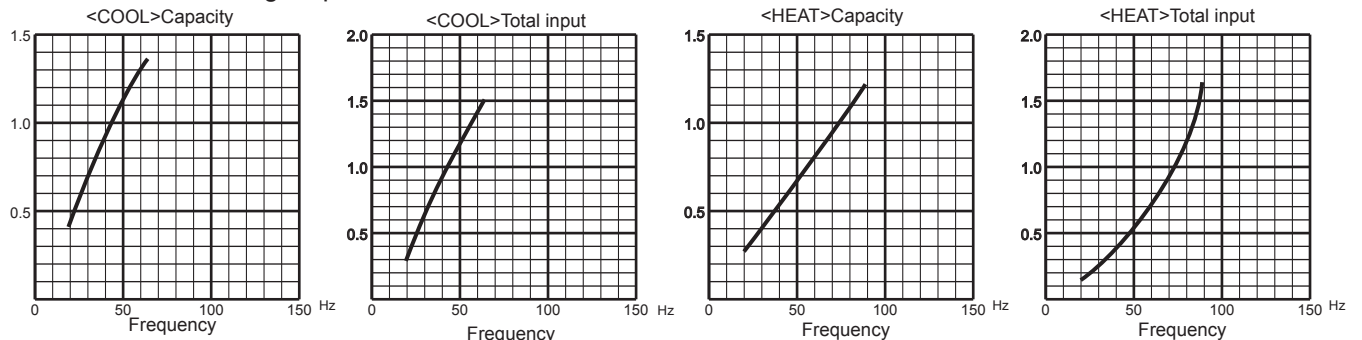


5. 25-class unit in single operation

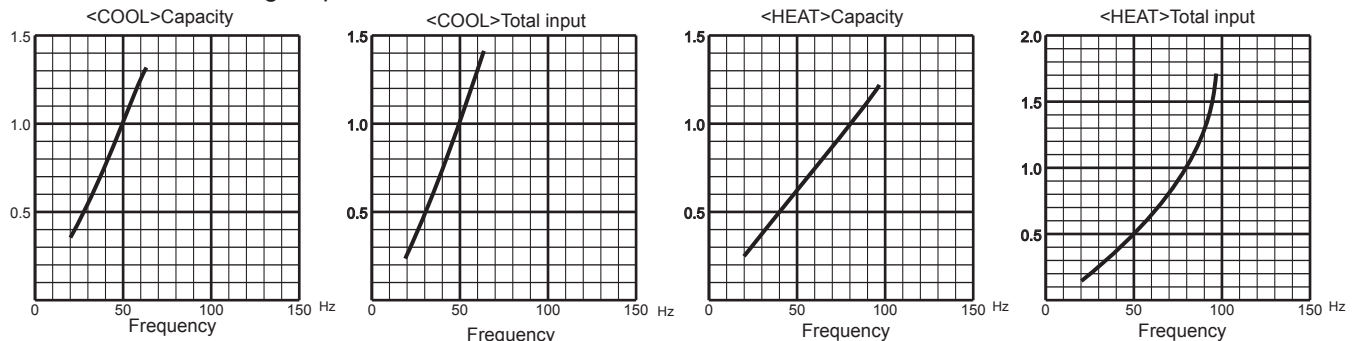


MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2


1. 15-class unit in single operation

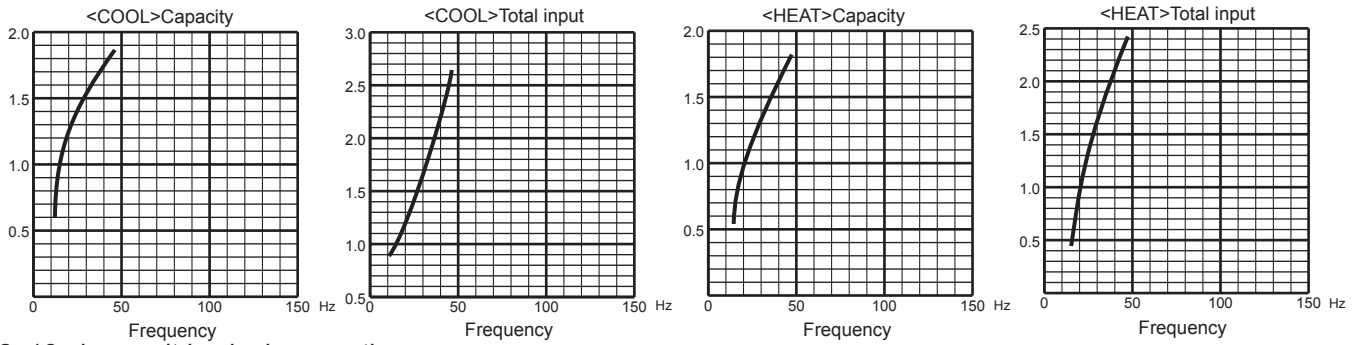


2. 18-class unit in single operation

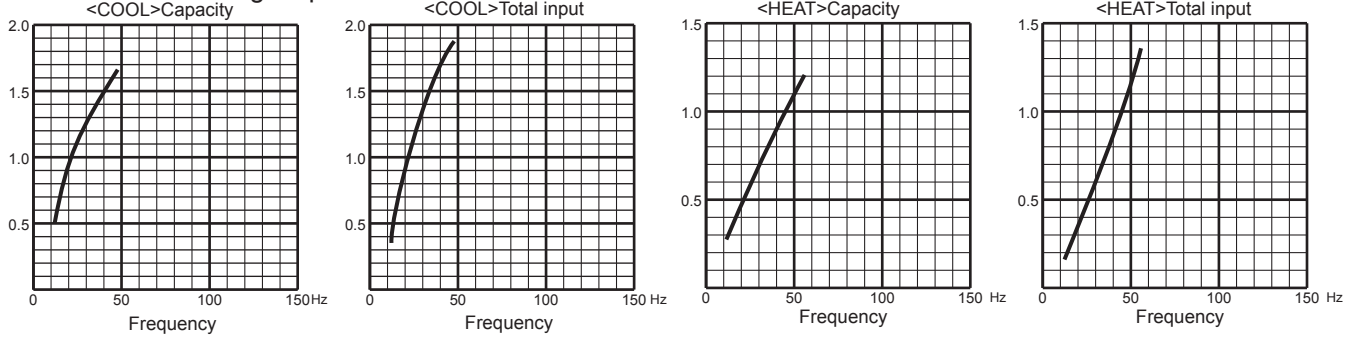

3. 20-class unit in single operation

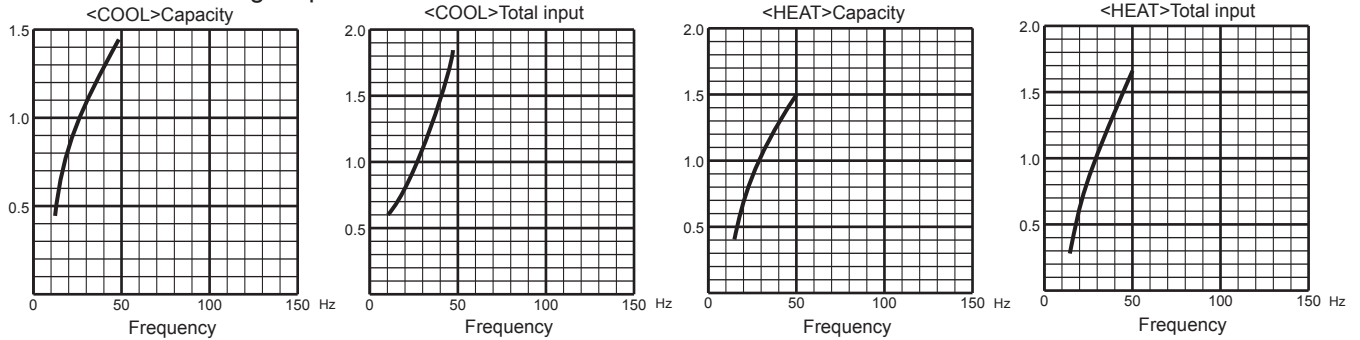


4. 22-class unit in single operation

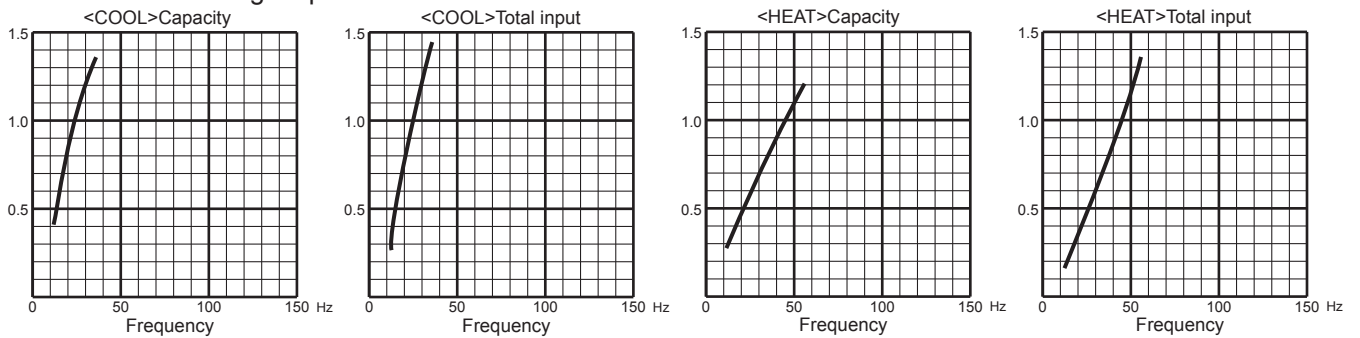


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2


5. 25-class unit in single operation

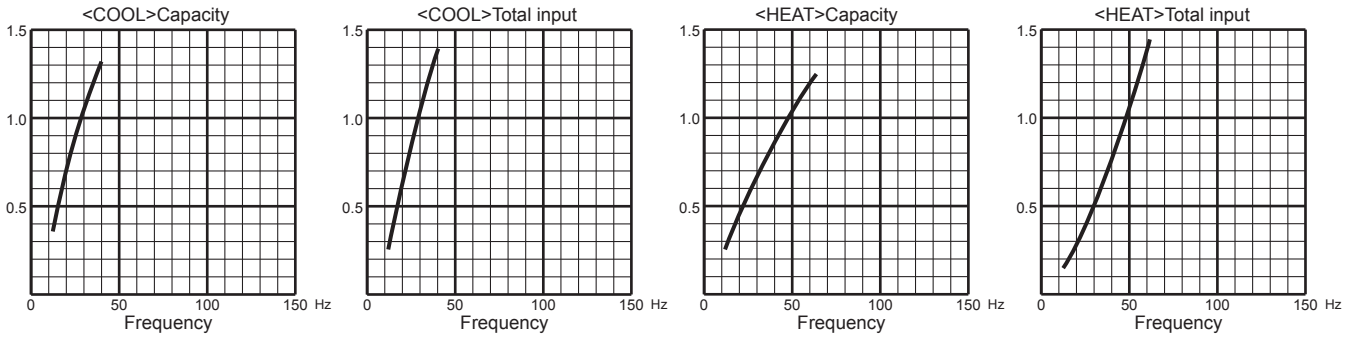


6. 35-class unit in single operation

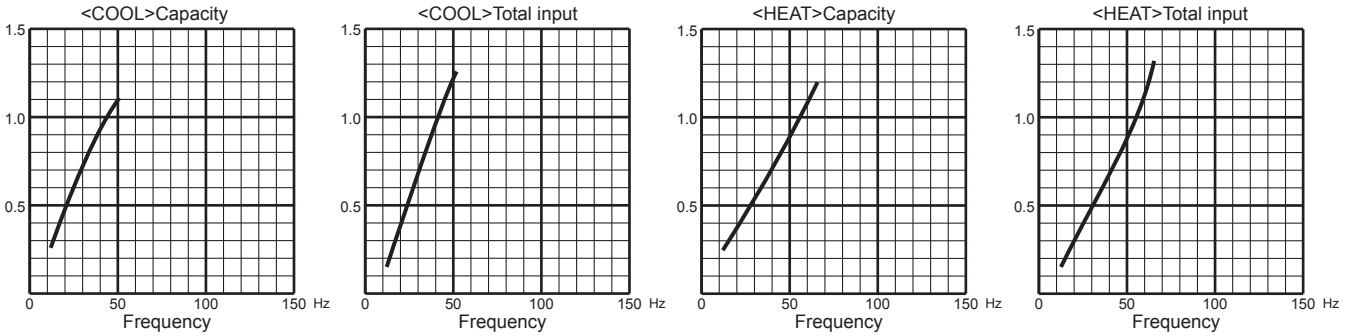

7. 42-class unit in single operation

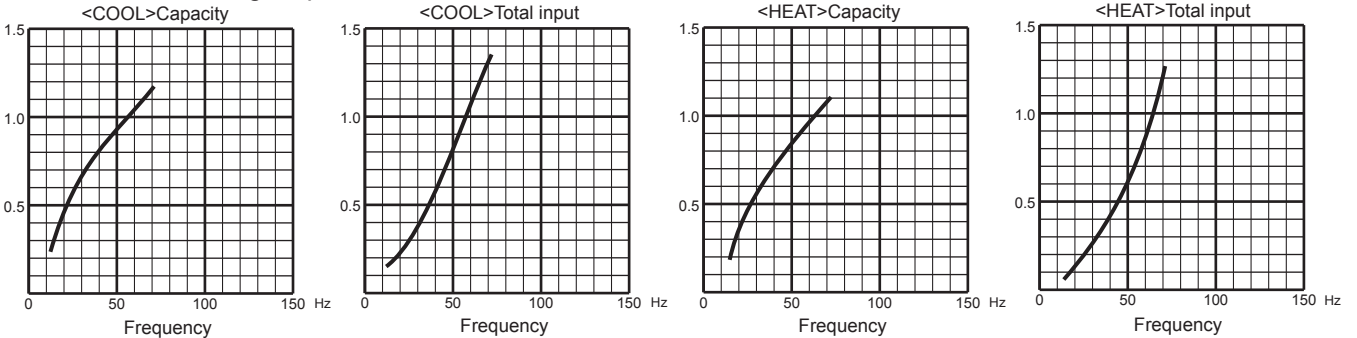


8. 50-class unit in single operation

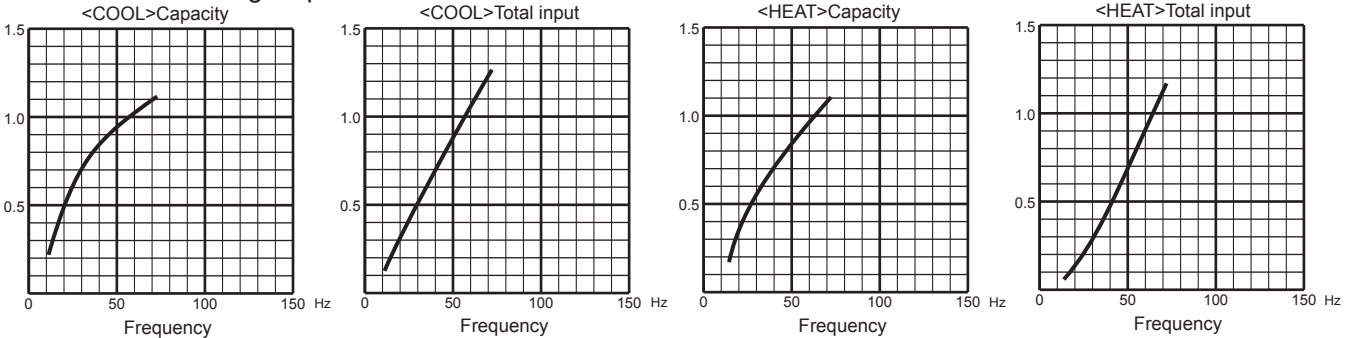


MXZ-3E54VA


1. 15-class unit in single operation

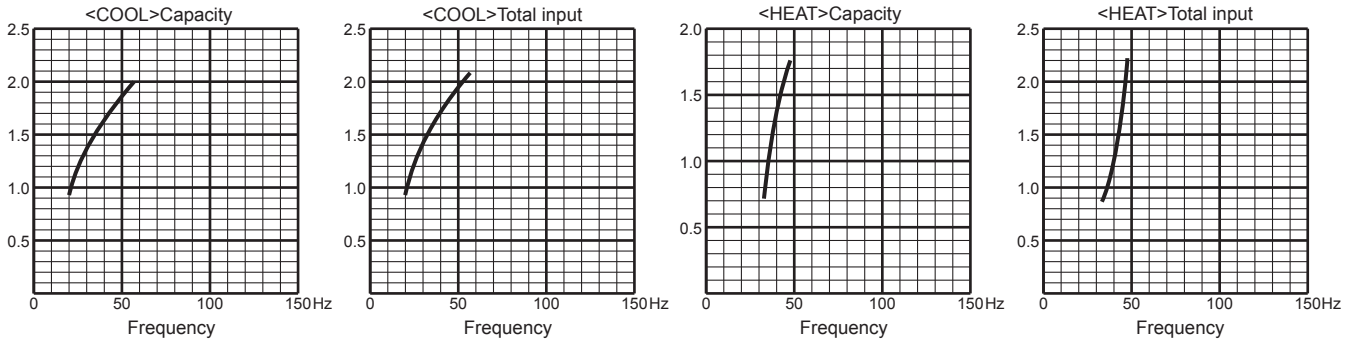


2. 18-class unit in single operation

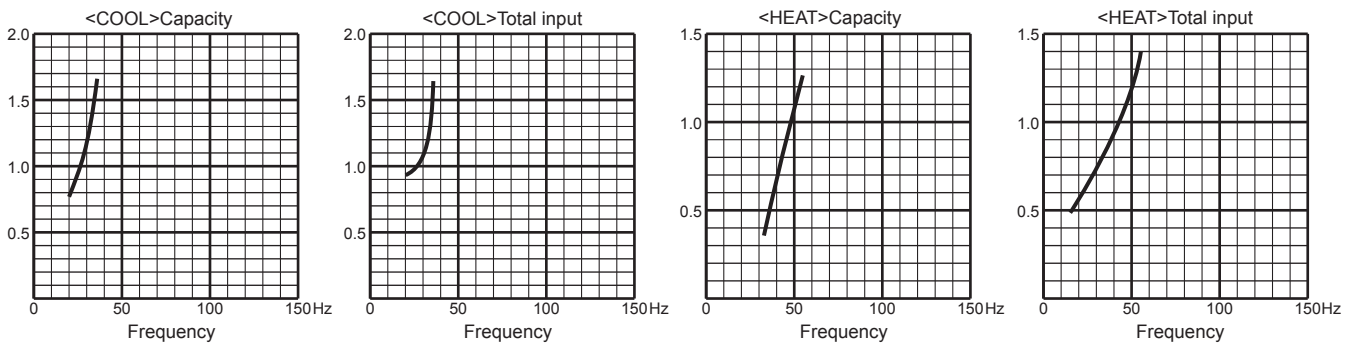

3. 20-class unit in single operation

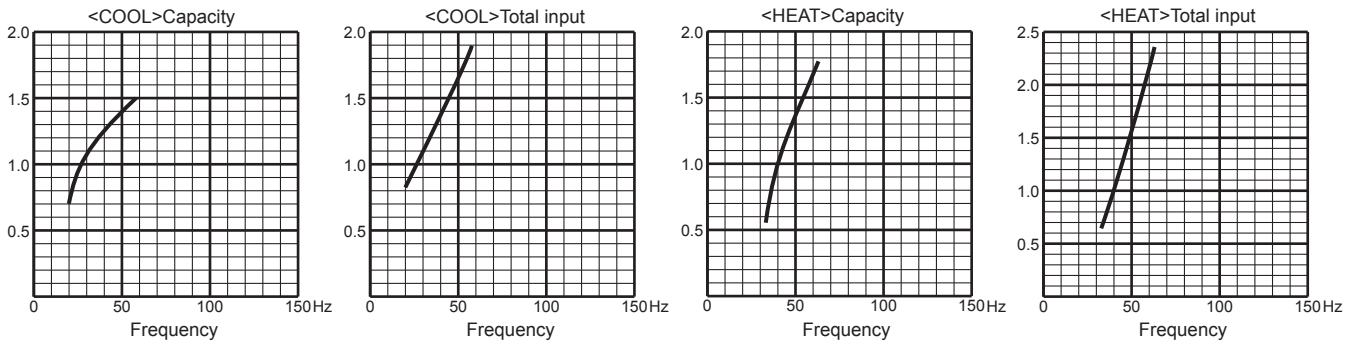


4. 22-class unit in single operation

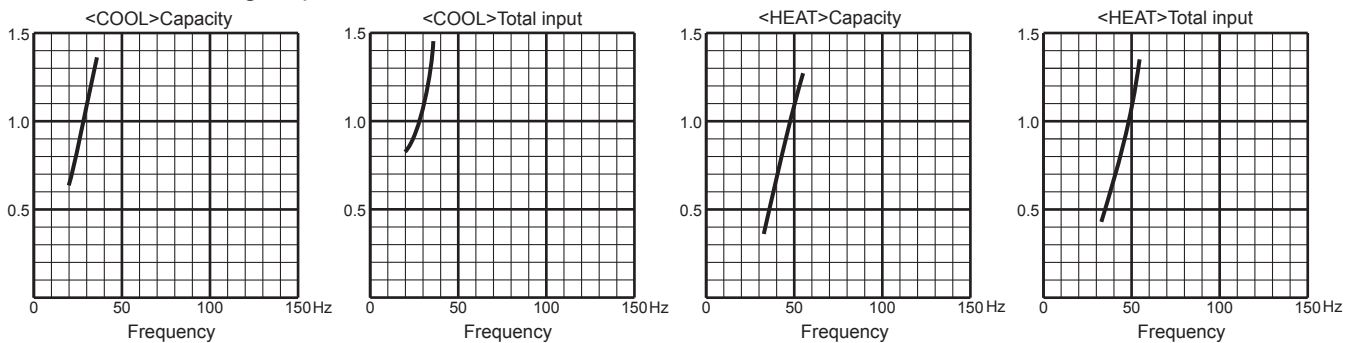


MXZ-3E54VA


5. 25-class unit in single operation

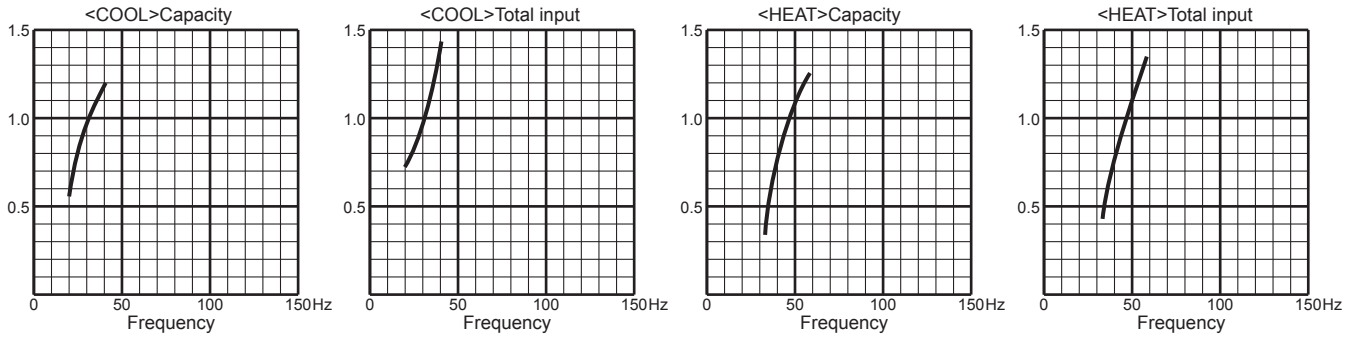


6. 35-class unit in single operation

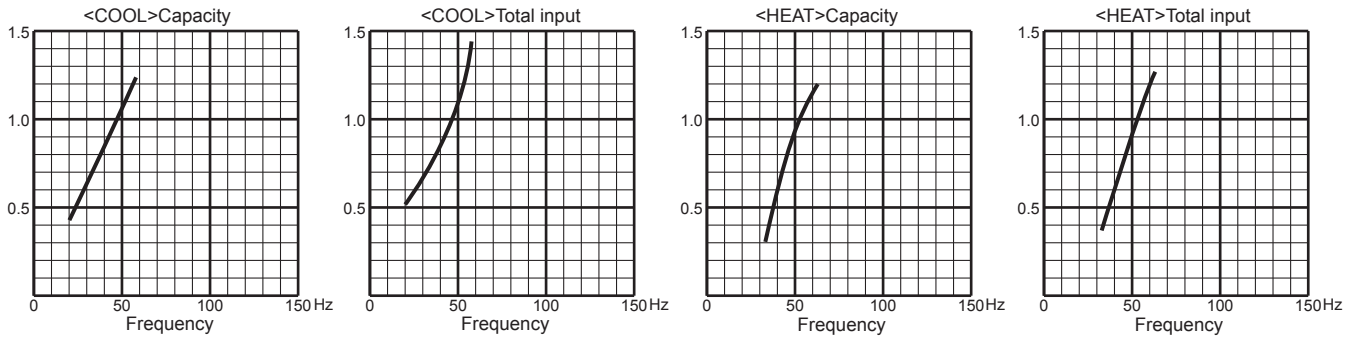

7. 42-class unit in single operation

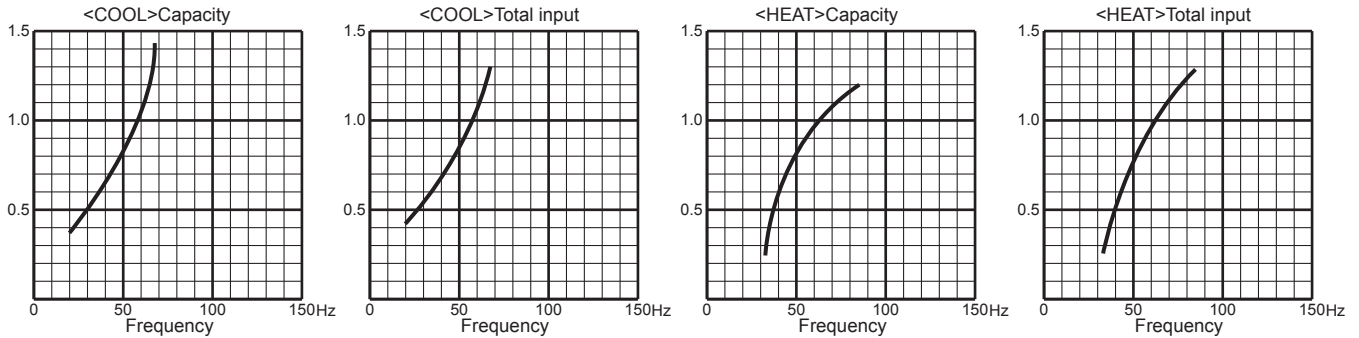


8. 50-class unit in single operation

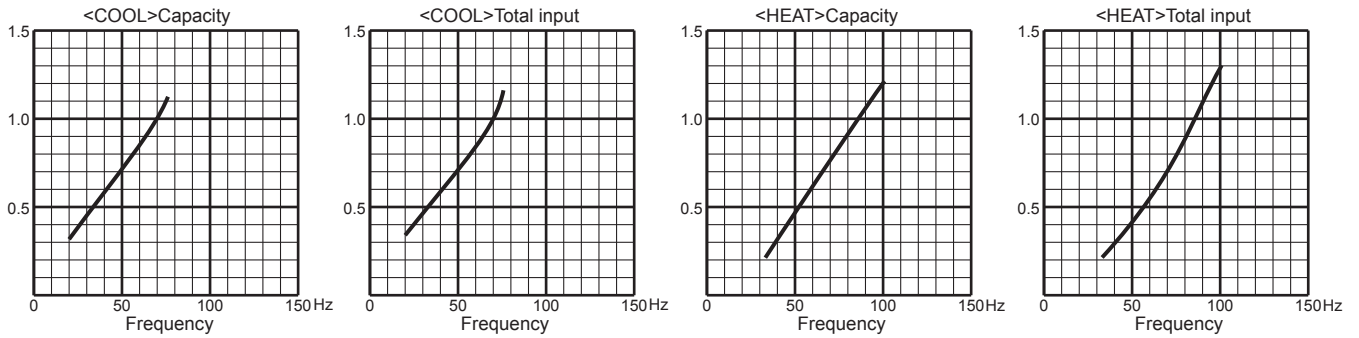


MXZ-3E68VA


1. 15-class unit in single operation

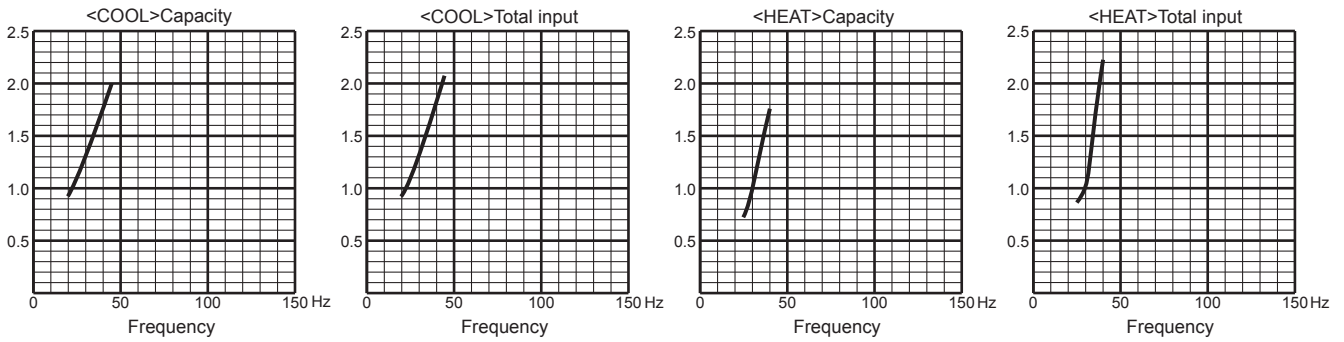


2. 18-class unit in single operation

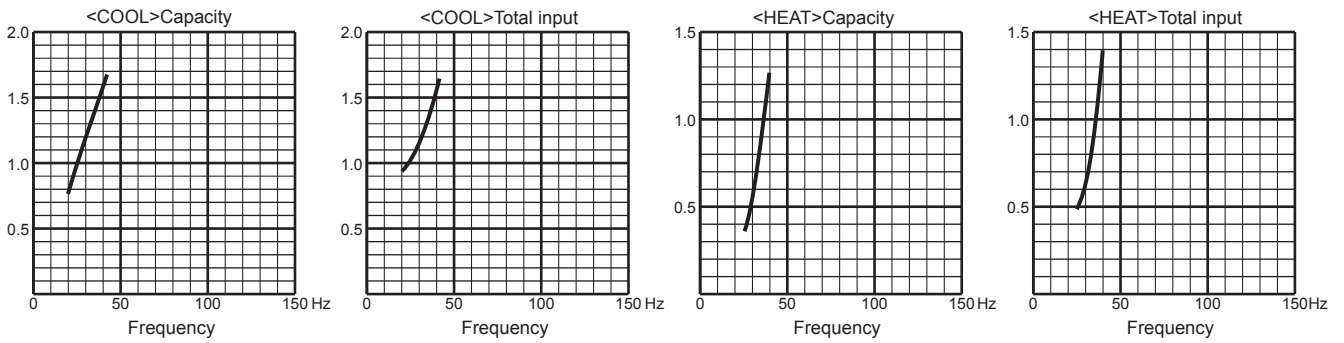


3. 20-class unit in single operation

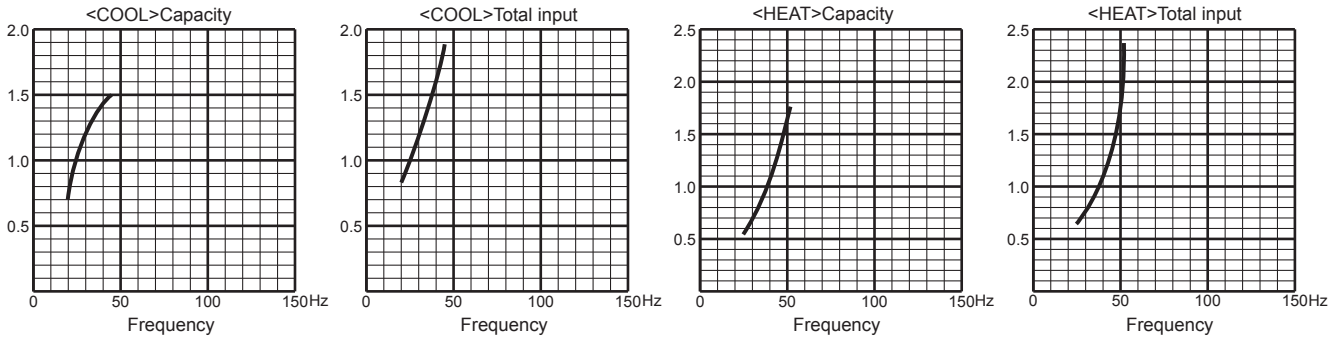

4. 22-class unit in single operation

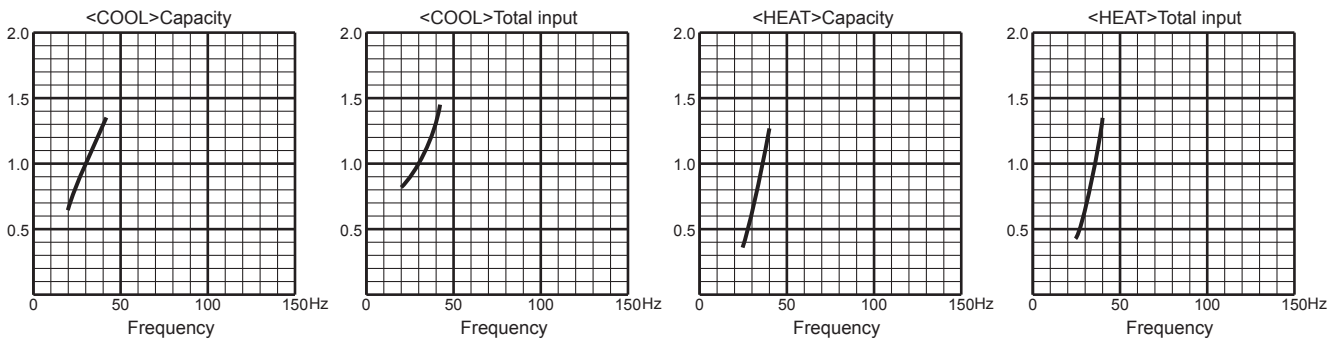


5. 25-class unit in single operation

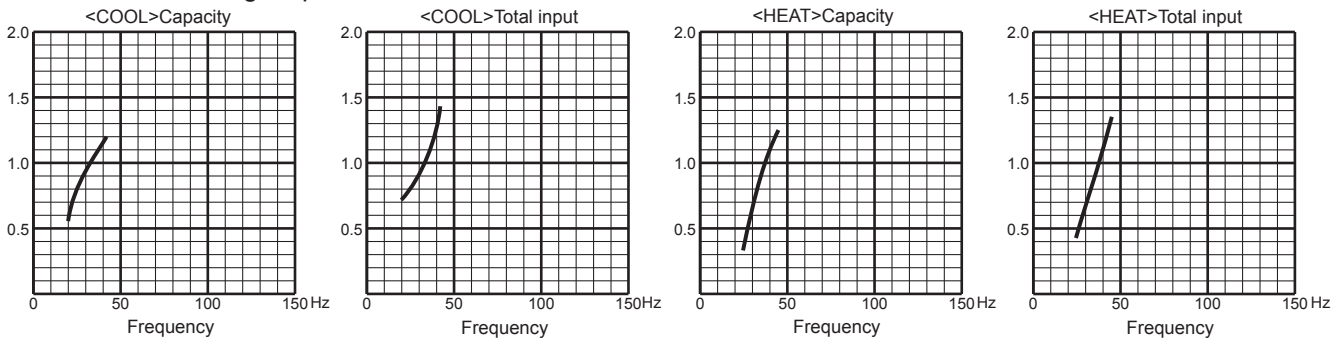


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-3E68VA


6. 35-class unit in single operation

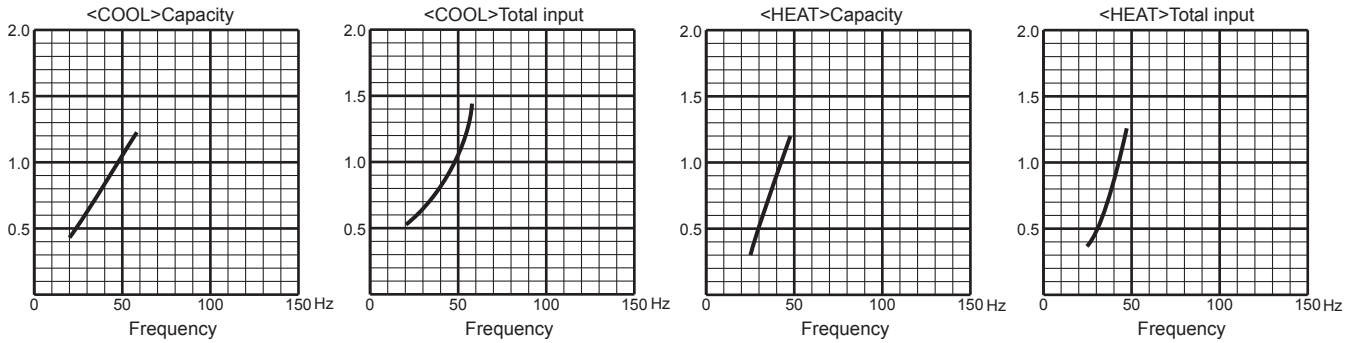


7. 42-class unit in single operation

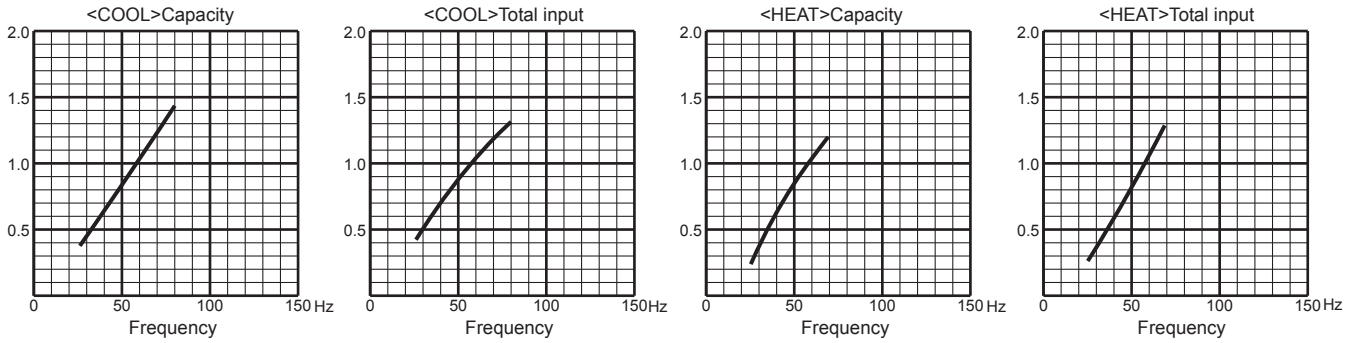

8. 50-class unit in single operation

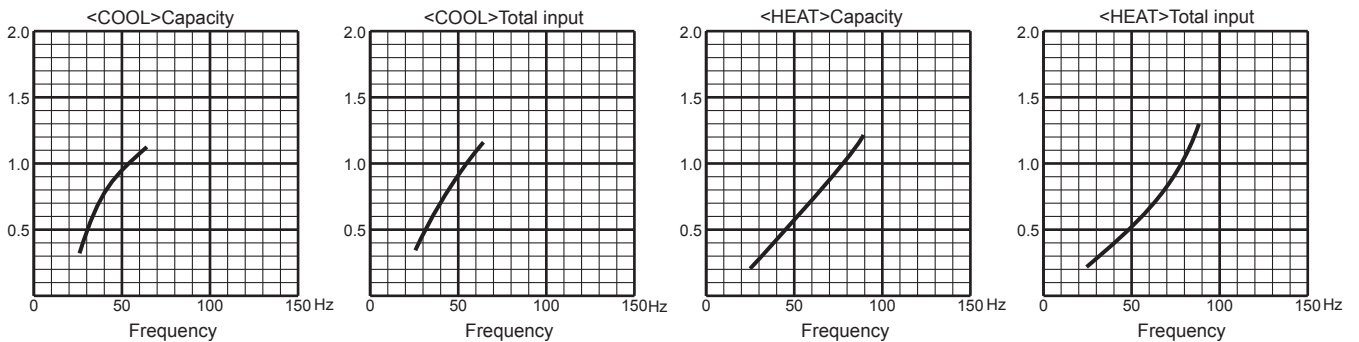


9. 60-class unit in single operation

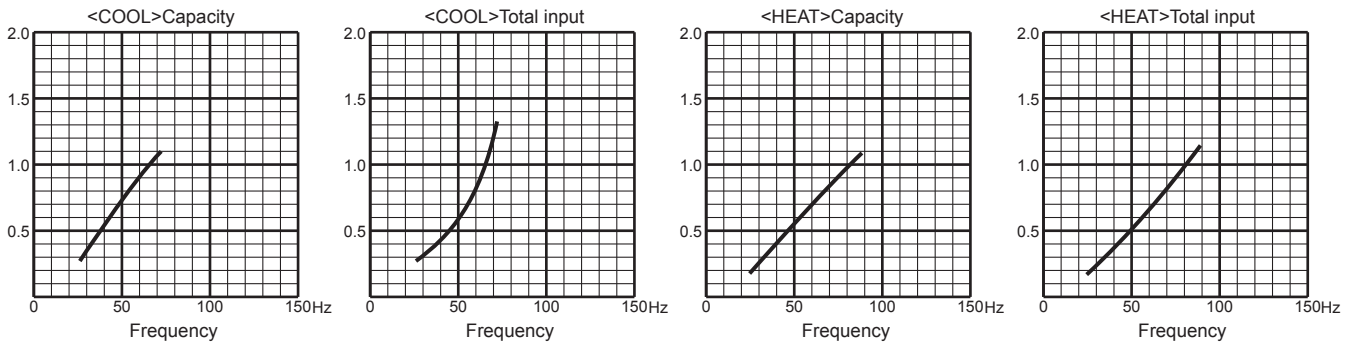


MXZ-4E72VA


1. 15-class unit in single operation

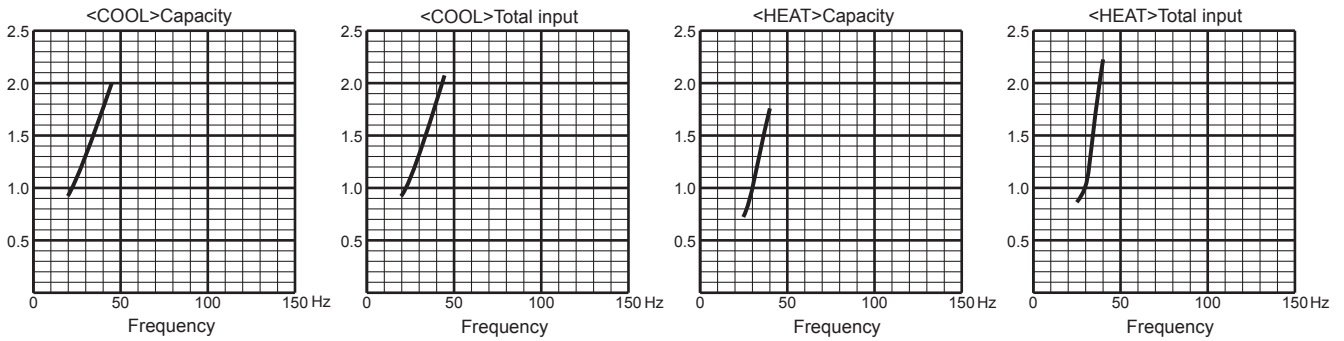


2. 18-class unit in single operation

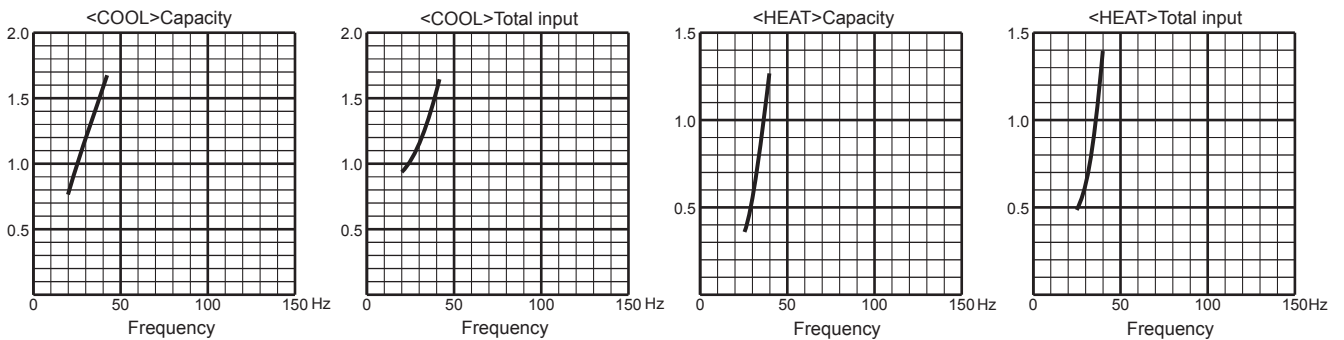


3. 20-class unit in single operation

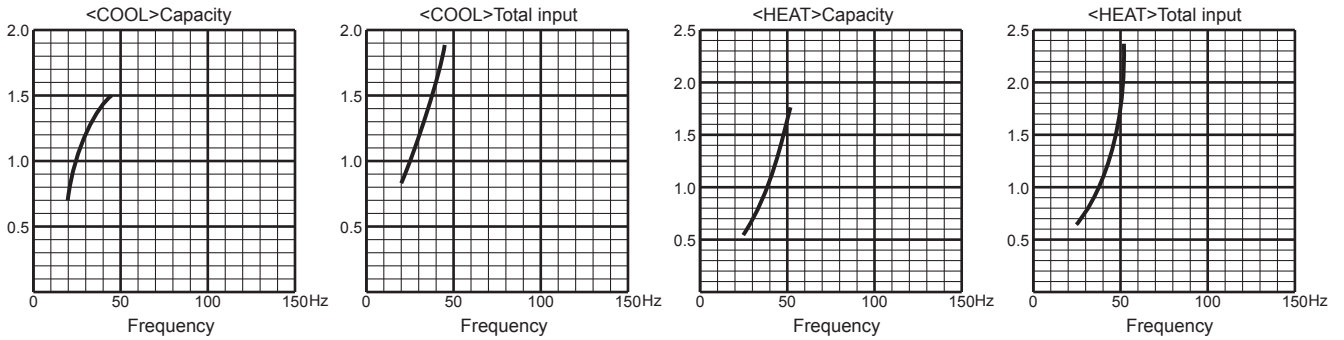

4. 22-class unit in single operation

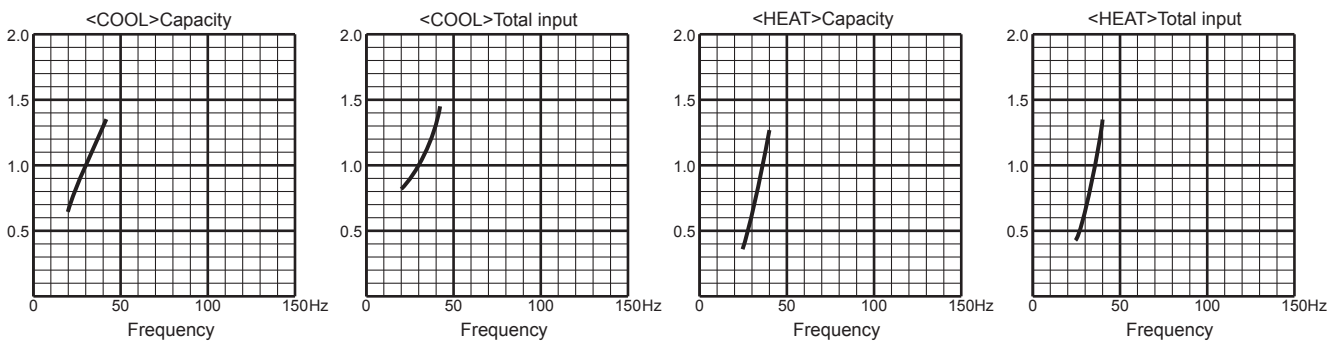


5. 25-class unit in single operation

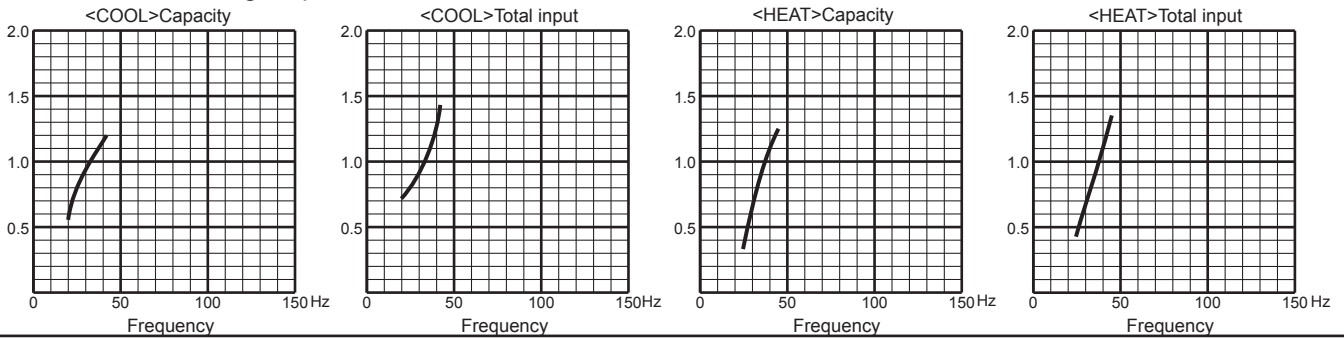


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-4E72VA


6. 35-class unit in single operation

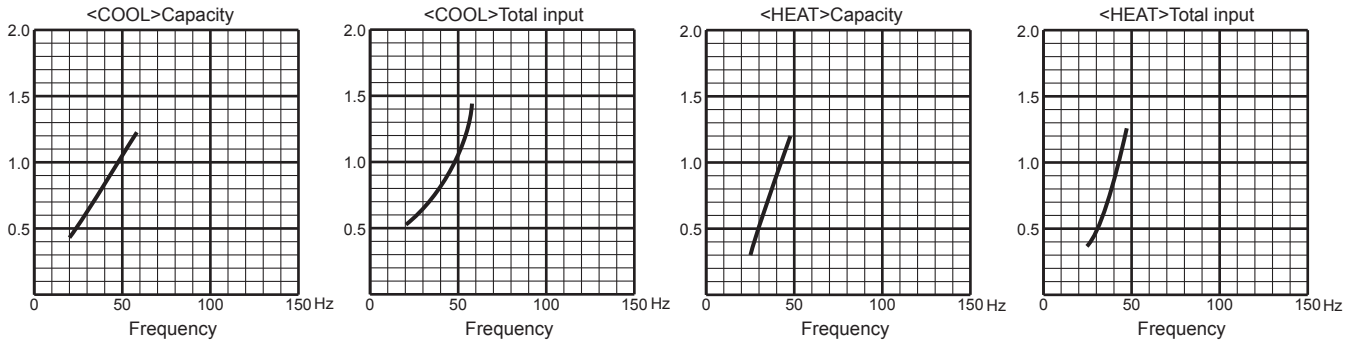


7. 42-class unit in single operation

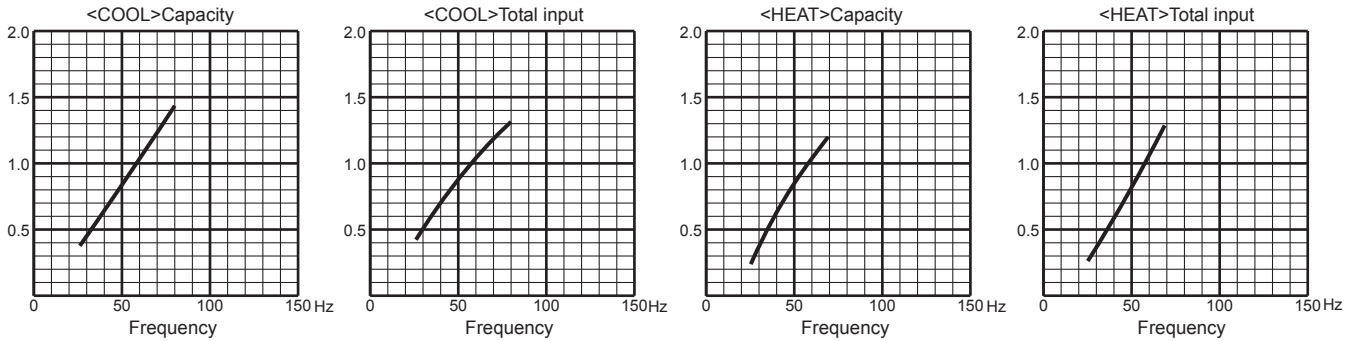

8. 50-class unit in single operation

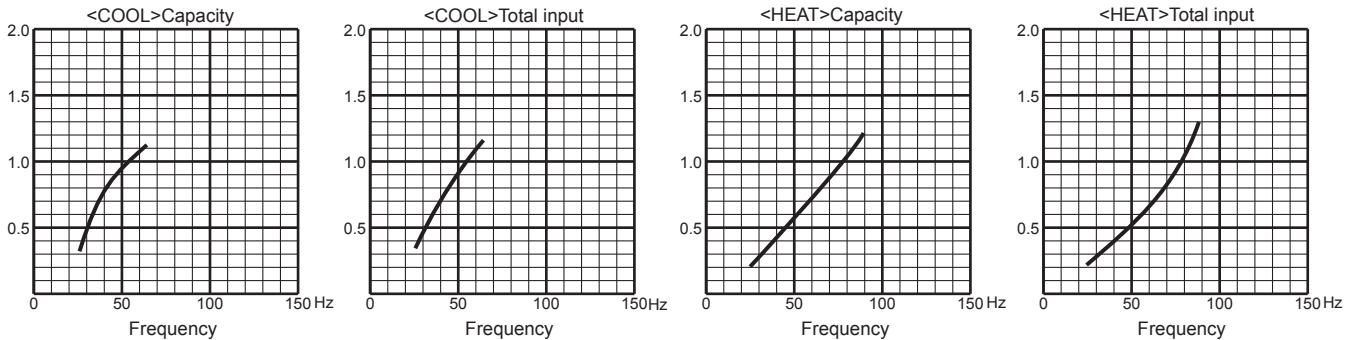


9. 60-class unit in single operation

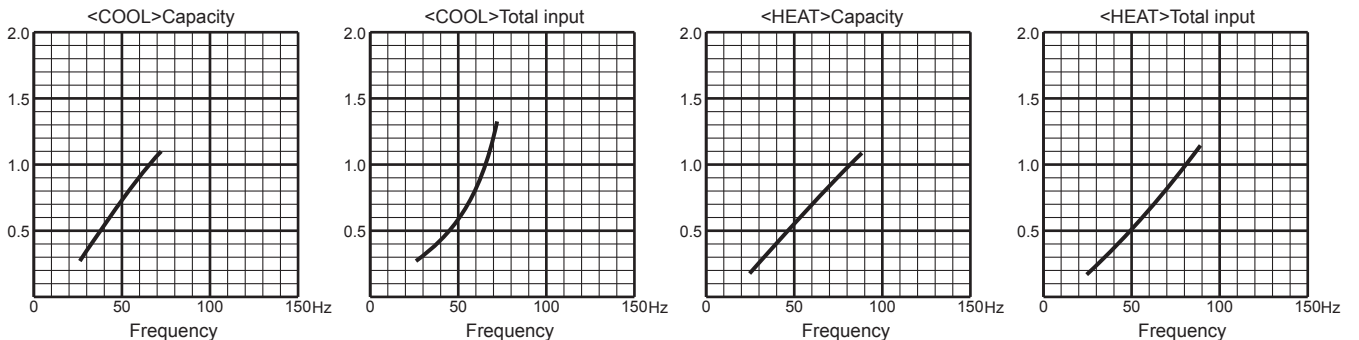


MXZ-4E83VA


1. 15-class unit in single operation

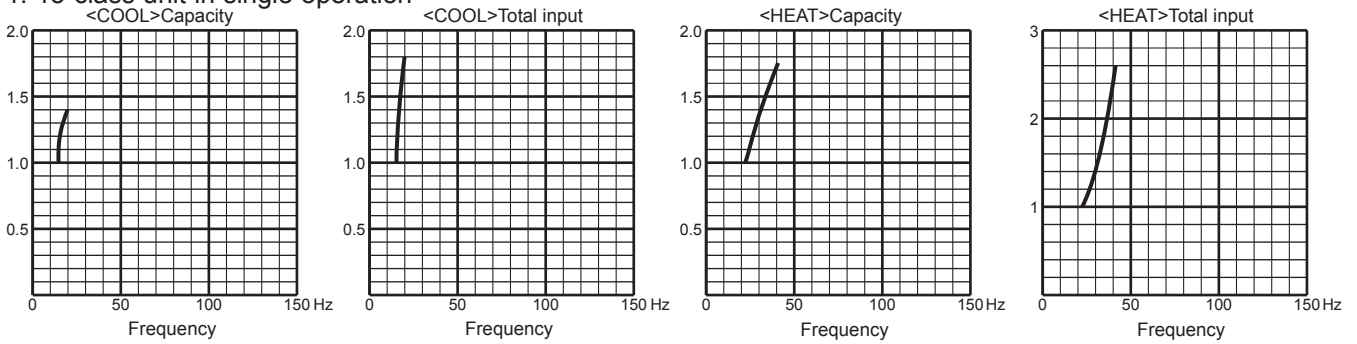


2. 18-class unit in single operation

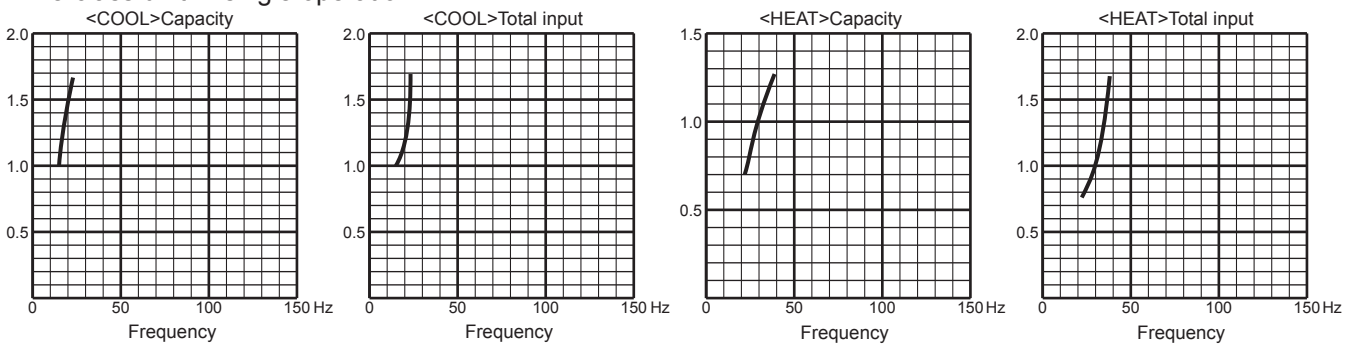


3. 20-class unit in single operation

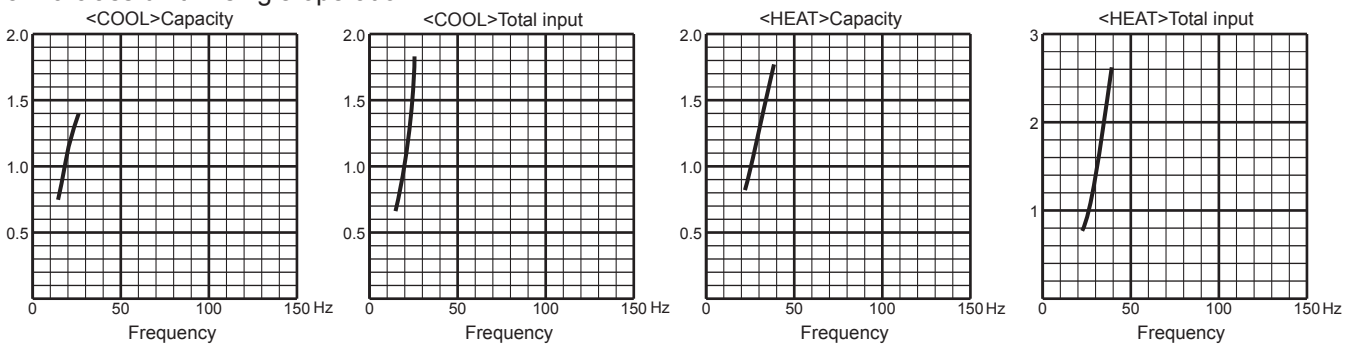

4. 22-class unit in single operation

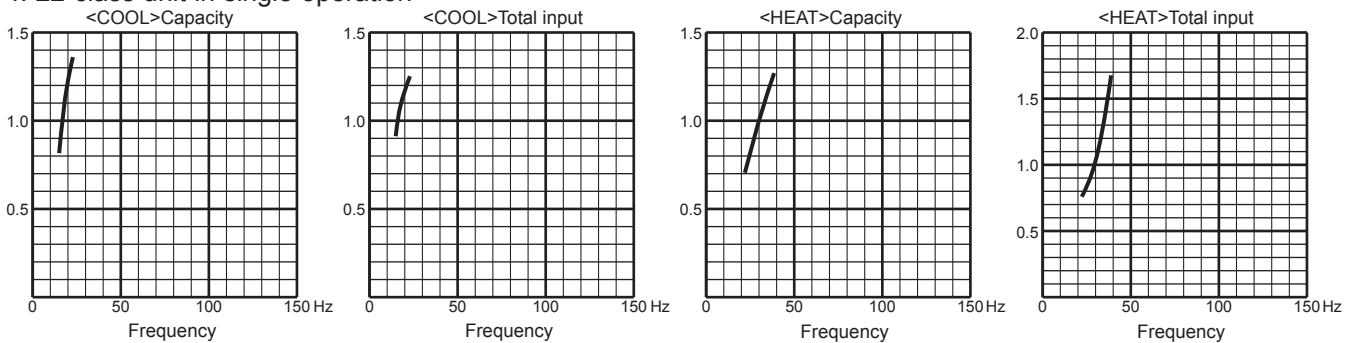


5. 25-class unit in single operation

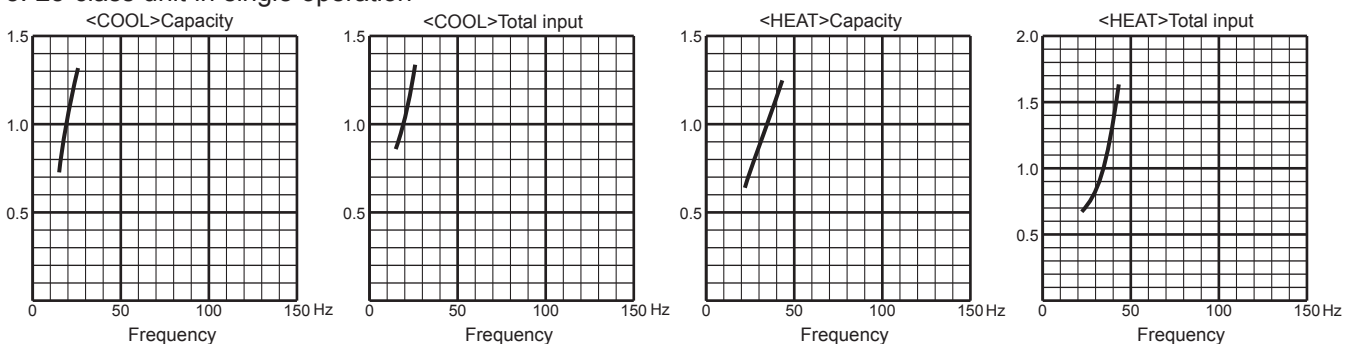


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-4E83VA


6. 35-class unit in single operation

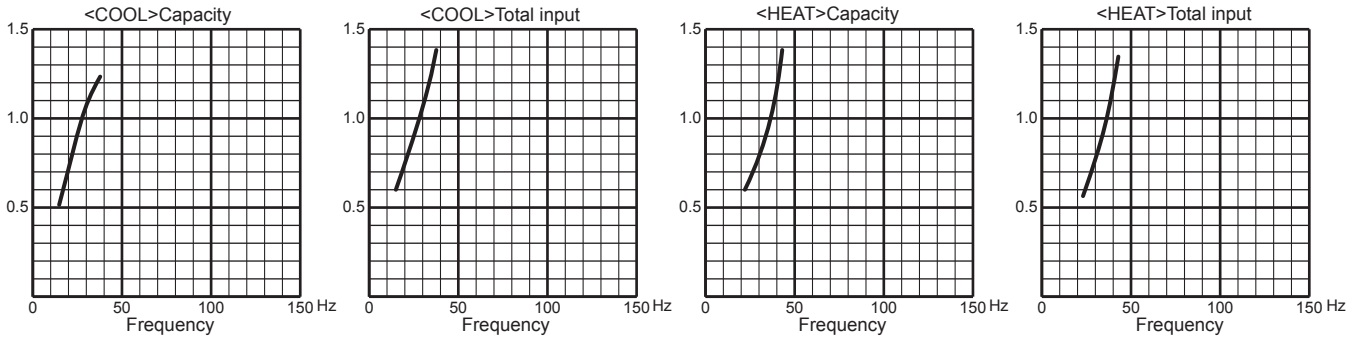


7. 42-class unit in single operation

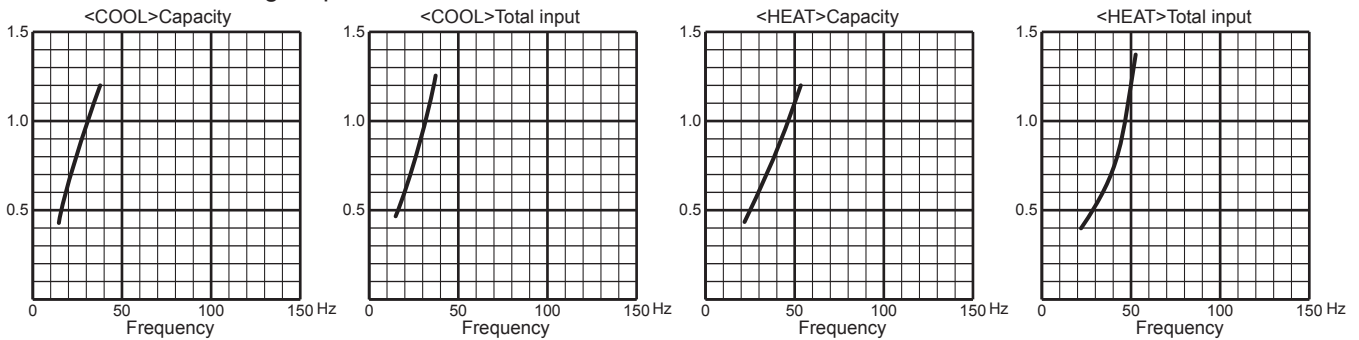


8. 50-class unit in single operation

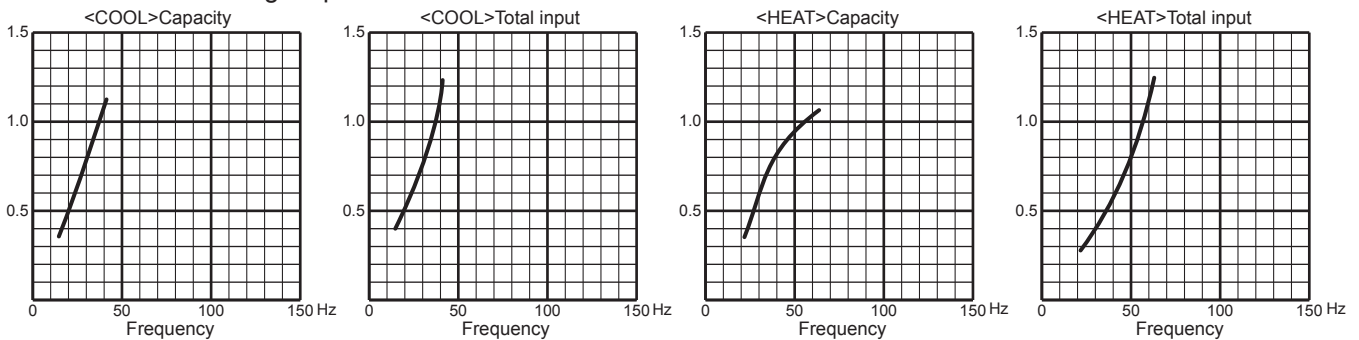

9. 60-class unit in single operation

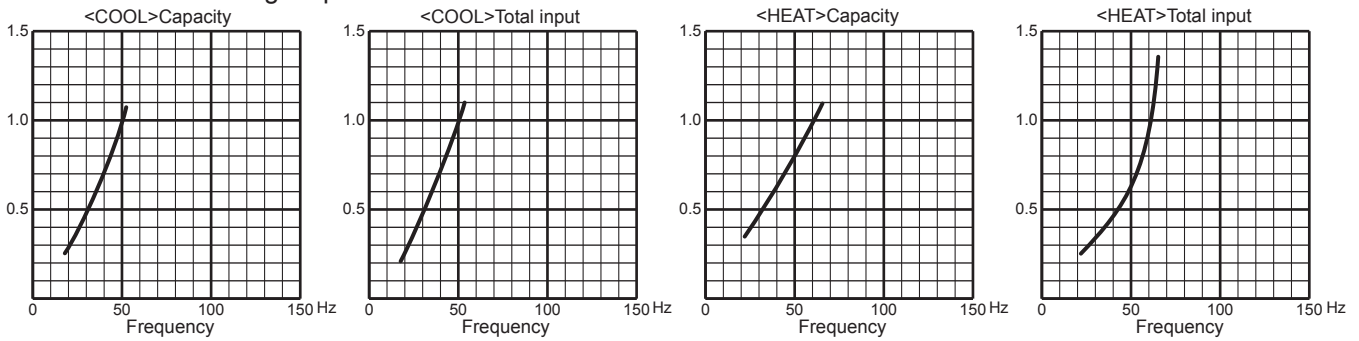


10. 71-class unit in single operation

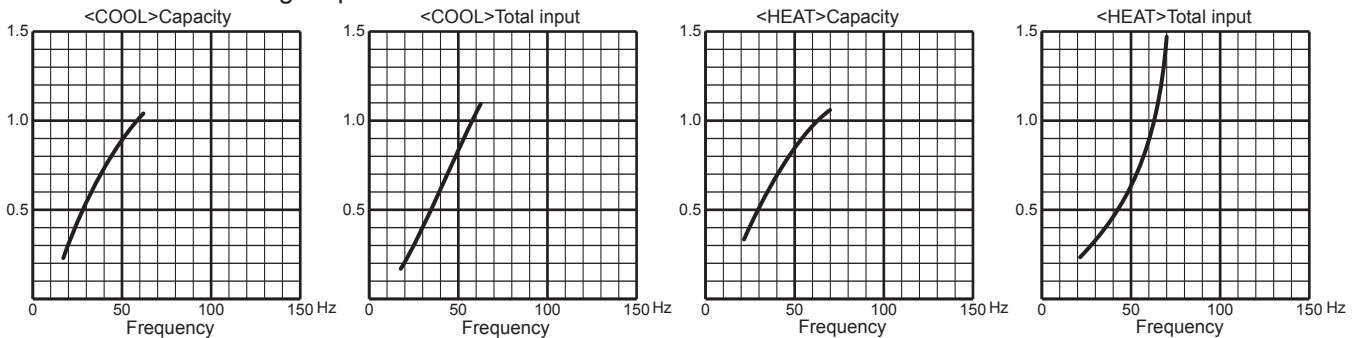


MXZ-5E102VA


1. 15-class unit in single operation

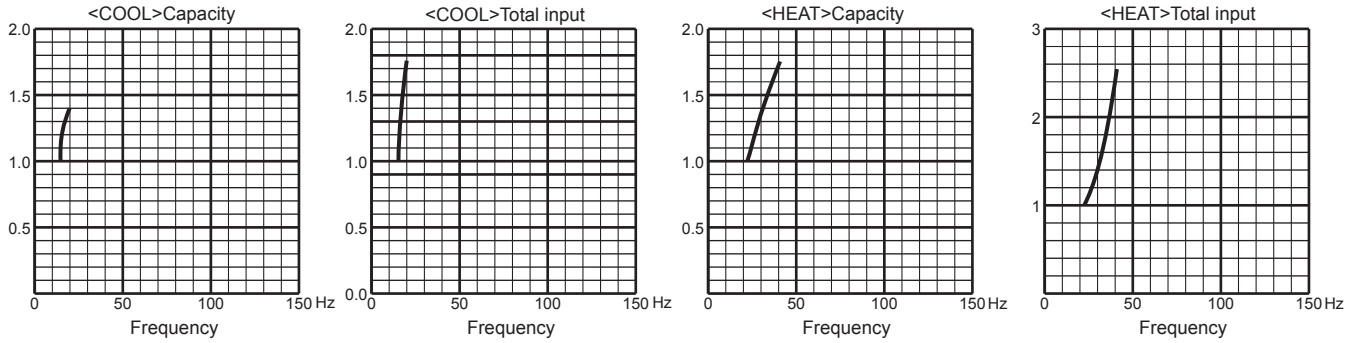


2. 18-class unit in single operation

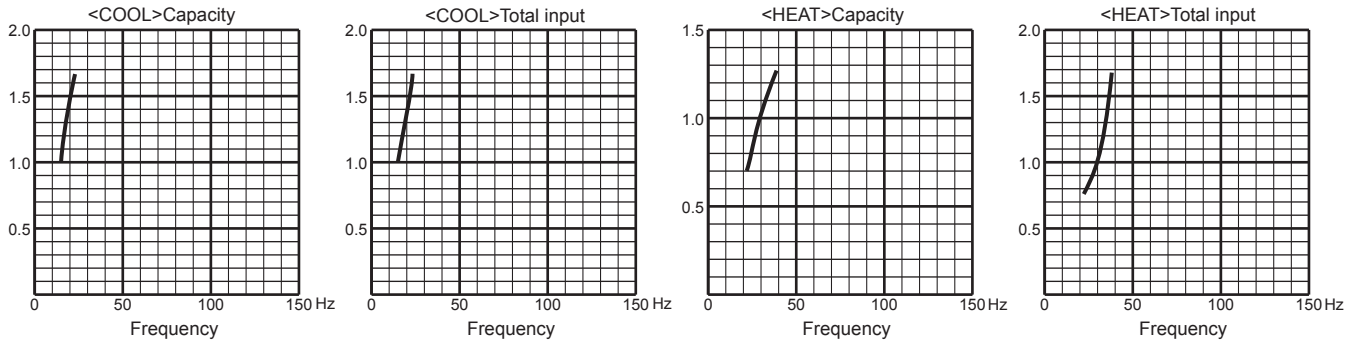


3. 20-class unit in single operation

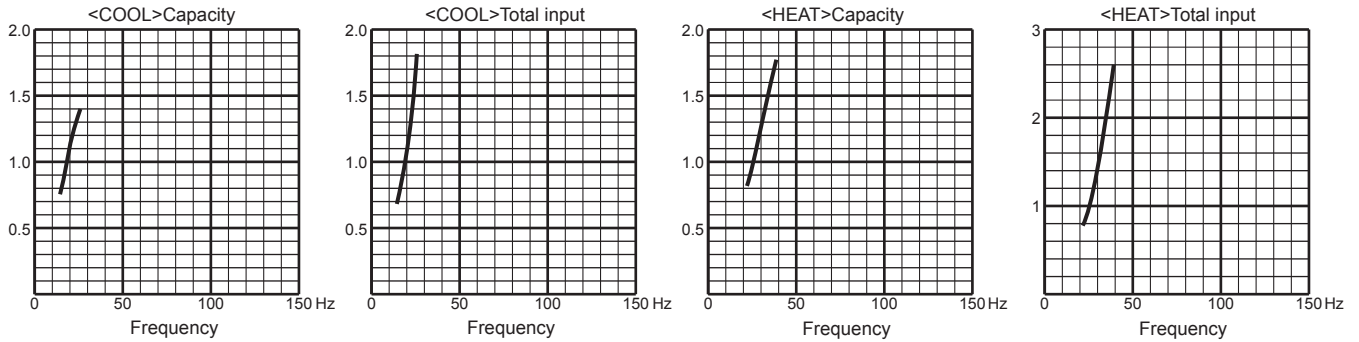

4. 22-class unit in single operation

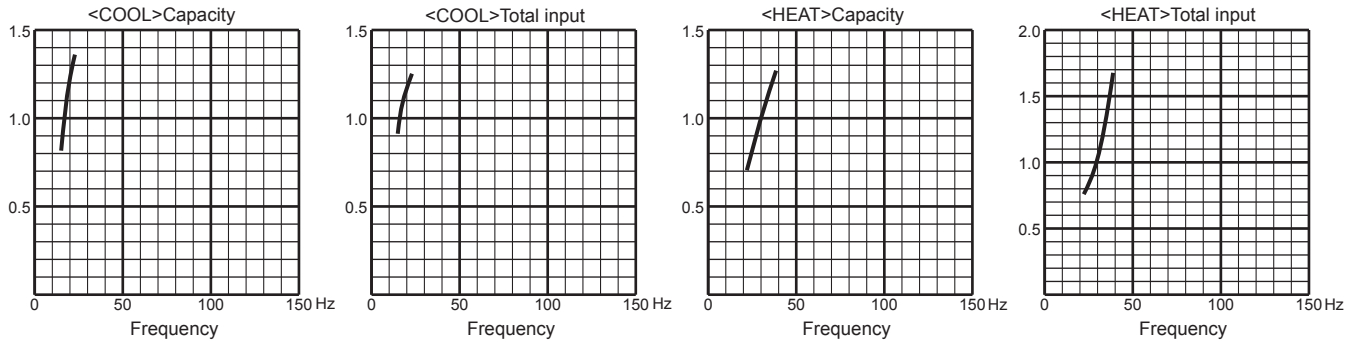


5. 25-class unit in single operation

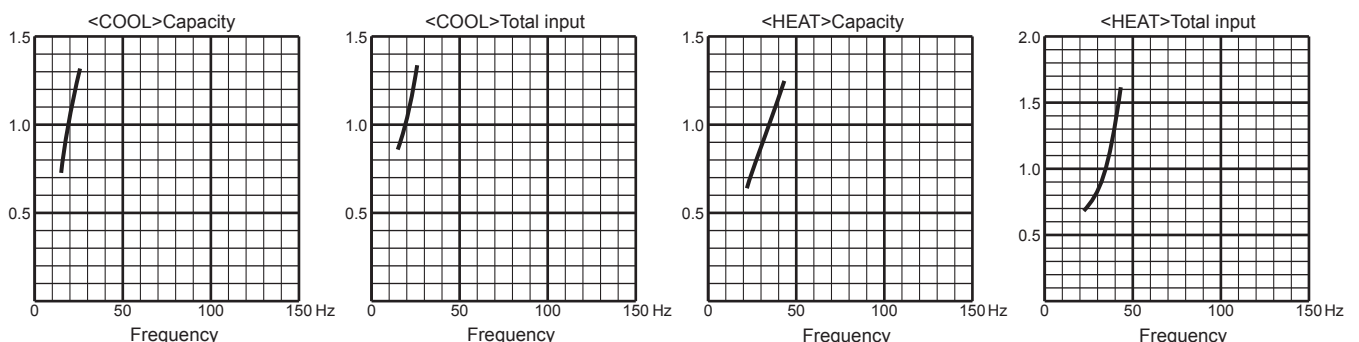


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-5E102VA


6. 35-class unit in single operation

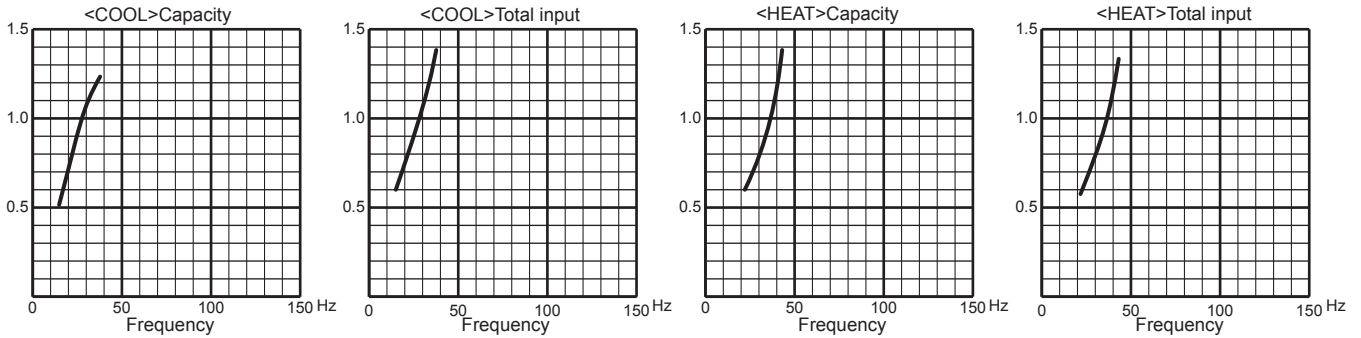


7. 42-class unit in single operation

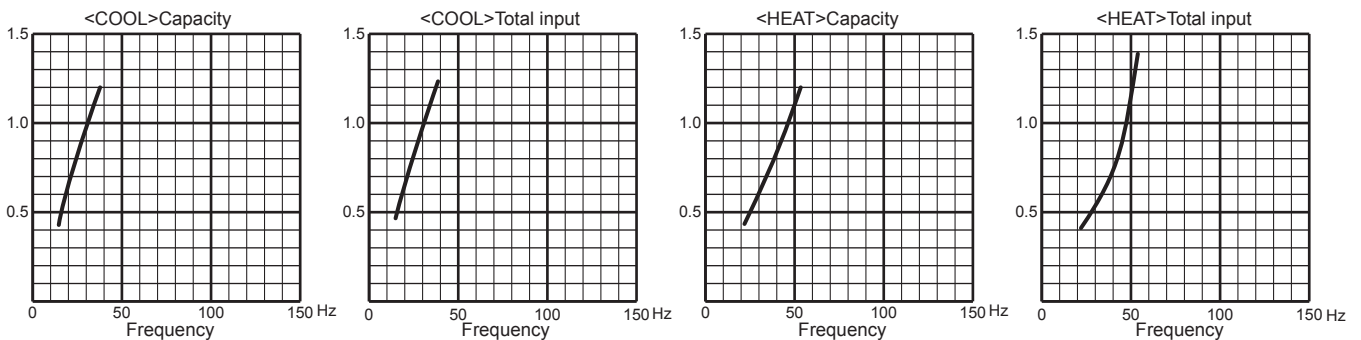


8. 50-class unit in single operation

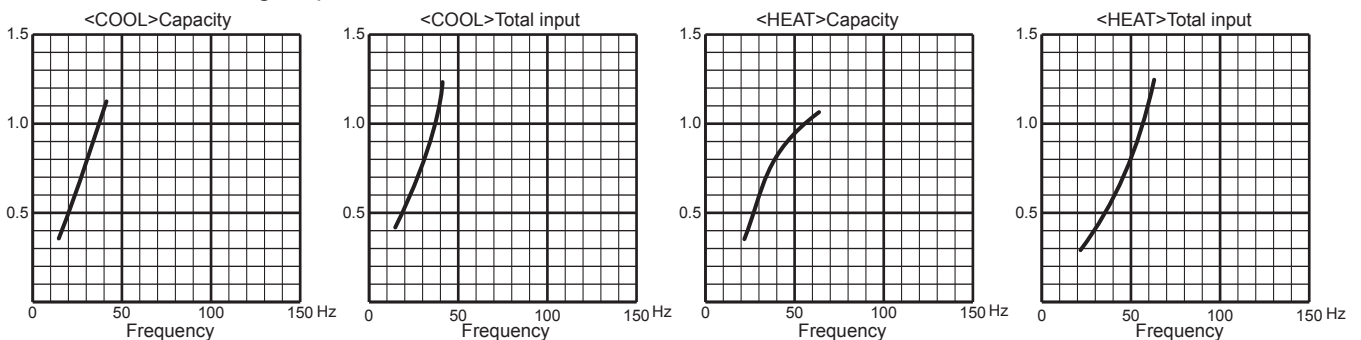

9. 60-class unit in single operation

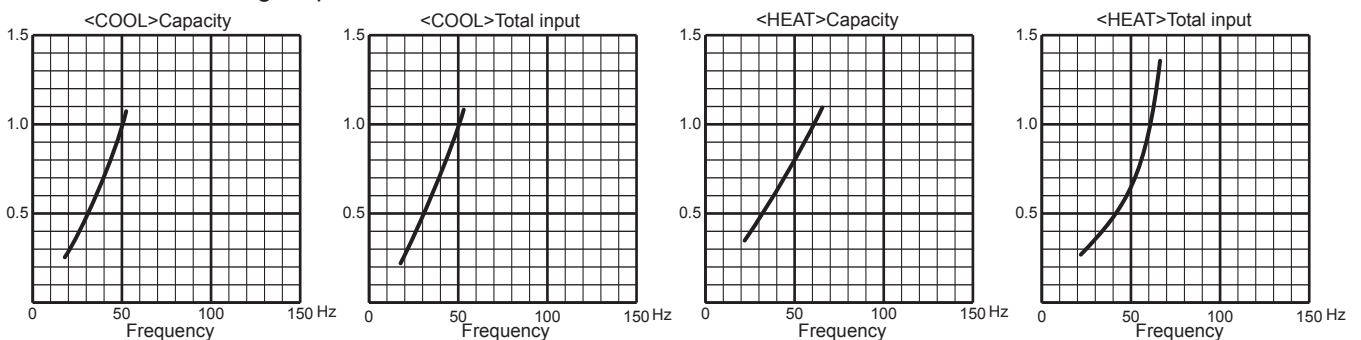


10. 71-class unit in single operation

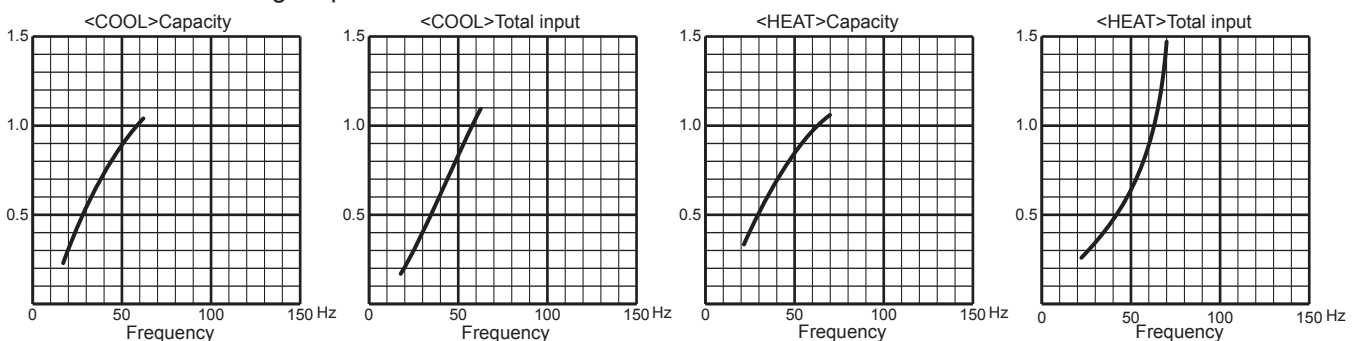


MXZ-6D122VA2


1. 15-class unit in single operation

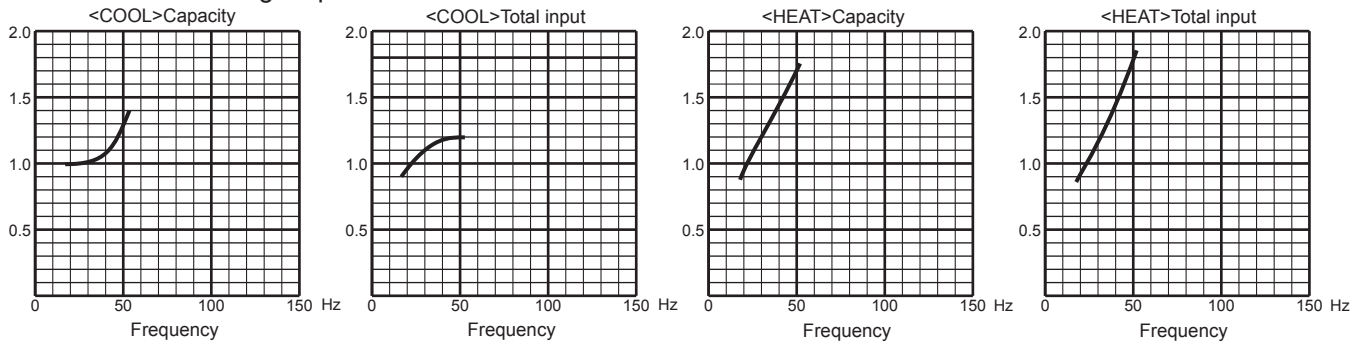


2. 18-class unit in single operation

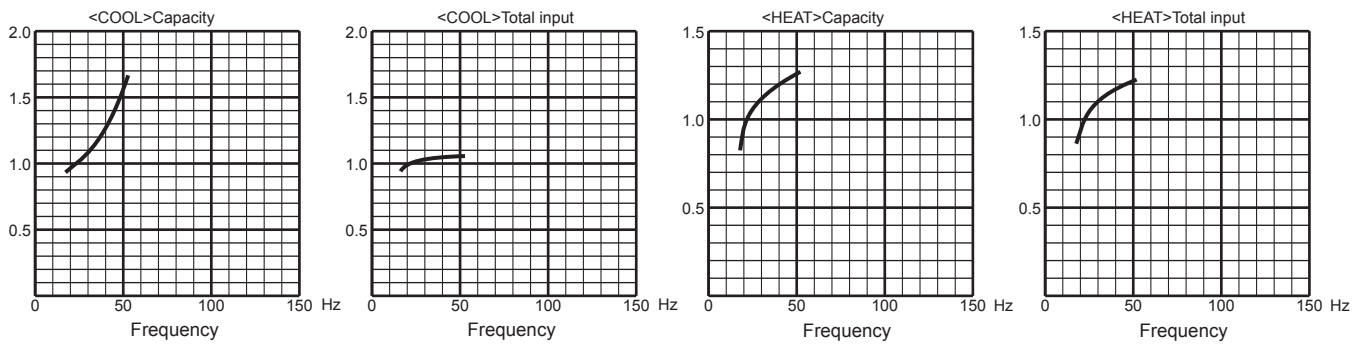


3. 20-class unit in single operation

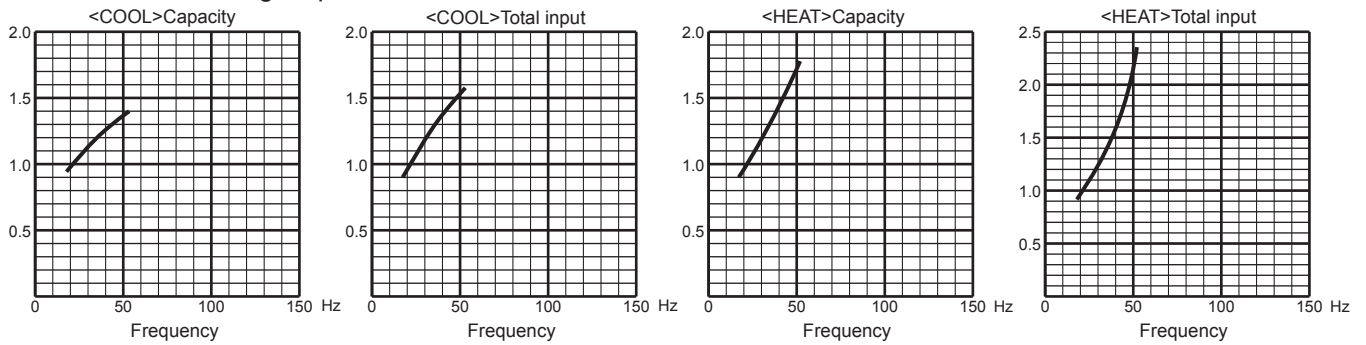

4. 22-class unit in single operation

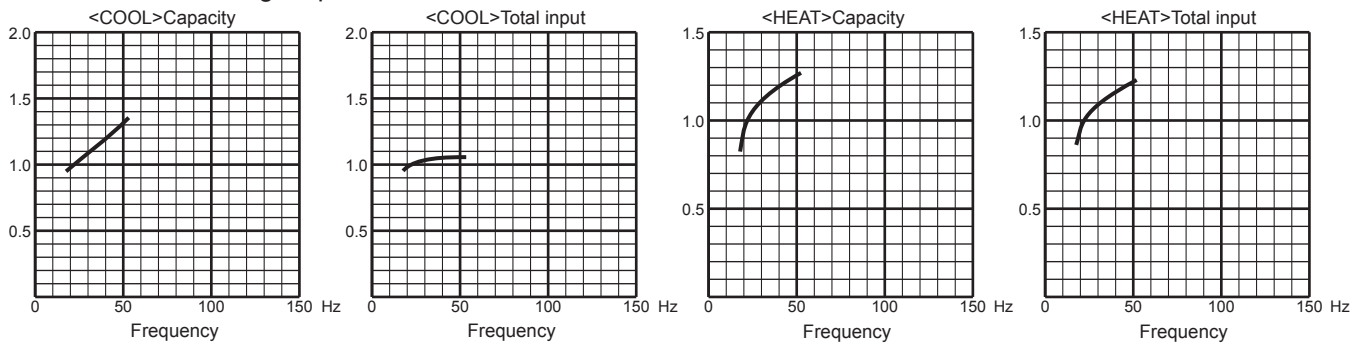


5. 25-class unit in single operation

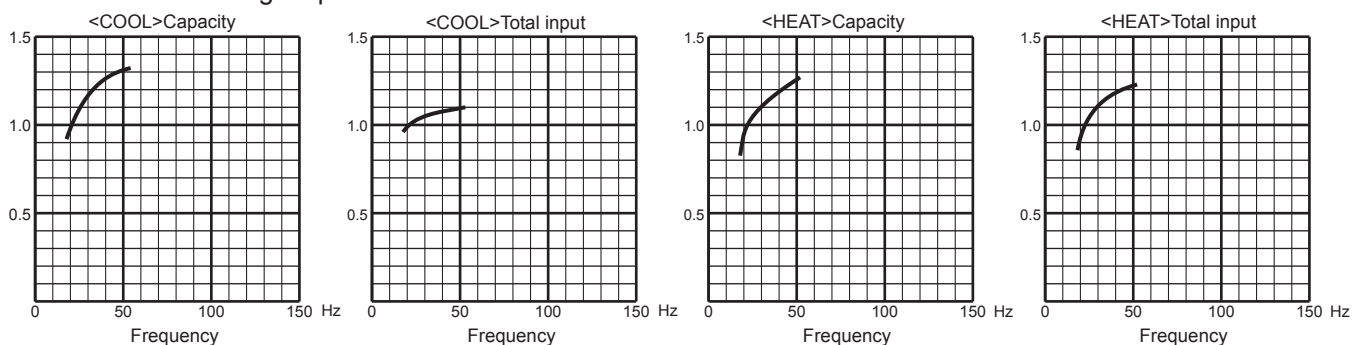


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-6D122VA2


6. 35-class unit in single operation

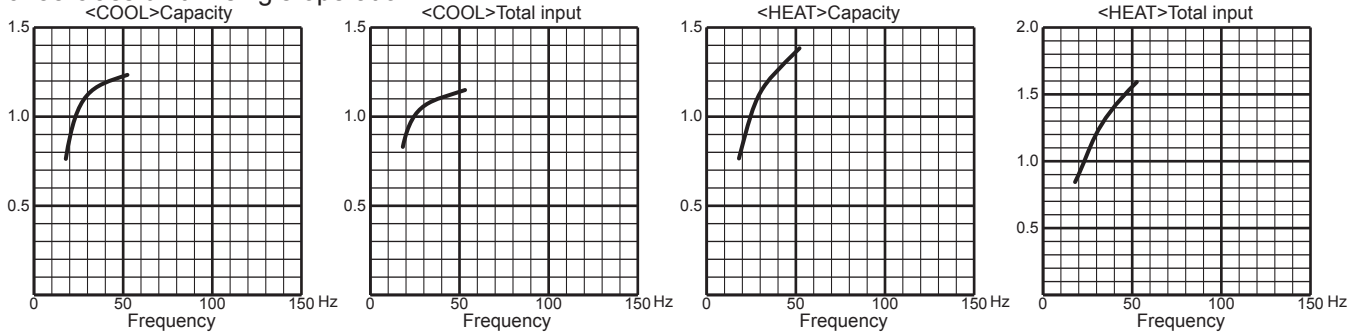


7. 42-class unit in single operation

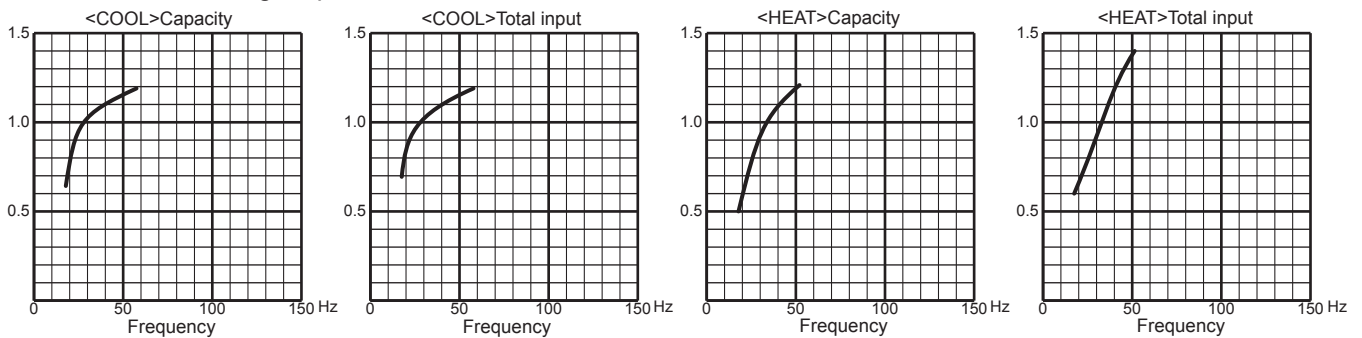


8. 50-class unit in single operation

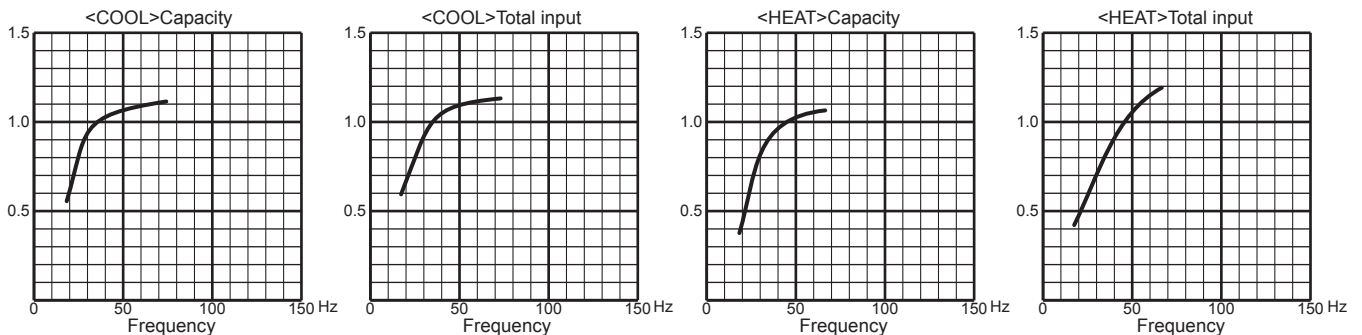

9. 60-class unit in single operation

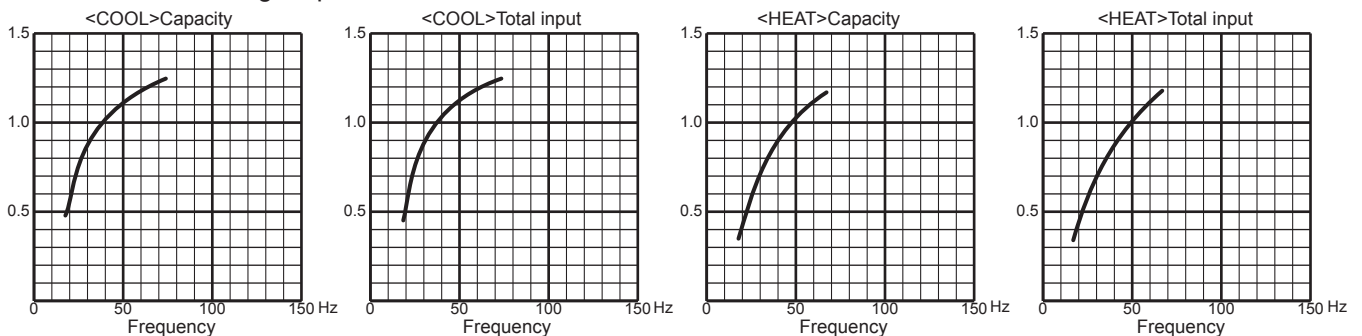


10. 71-class unit in single operation

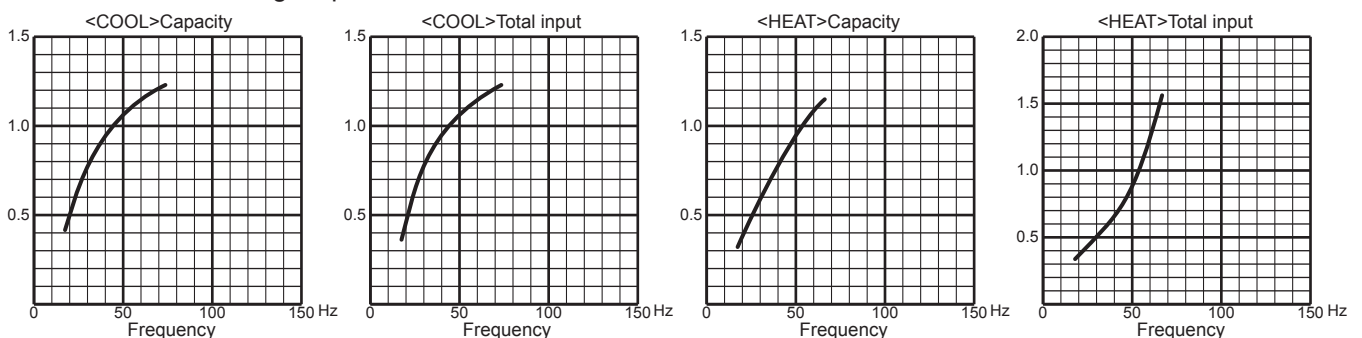


MXZ-2DM40VA

1. 25-class unit in single operation

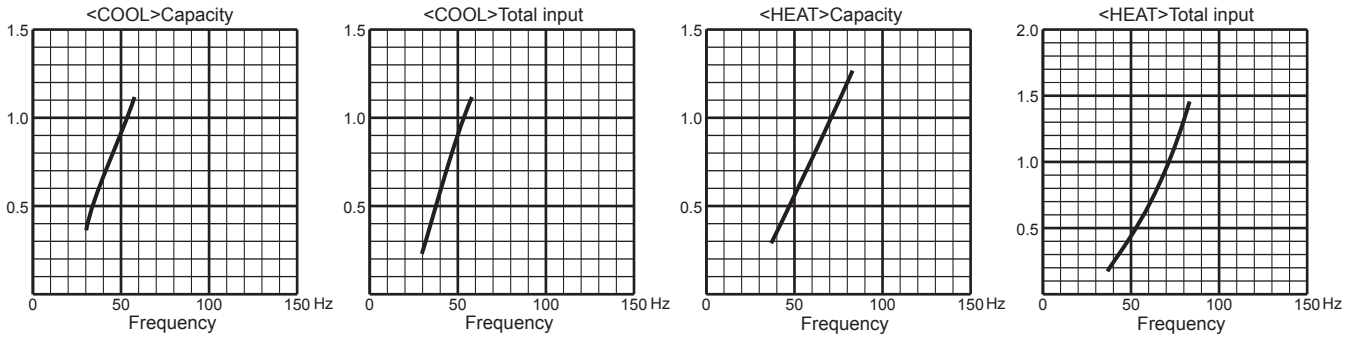


2. 35-class unit in single operation

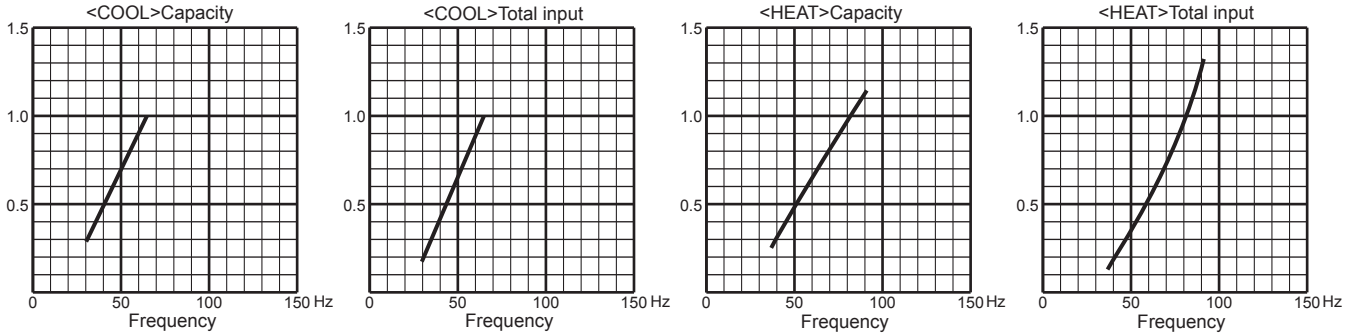


MXZ-3DM50VA


1. 25-class unit in single operation

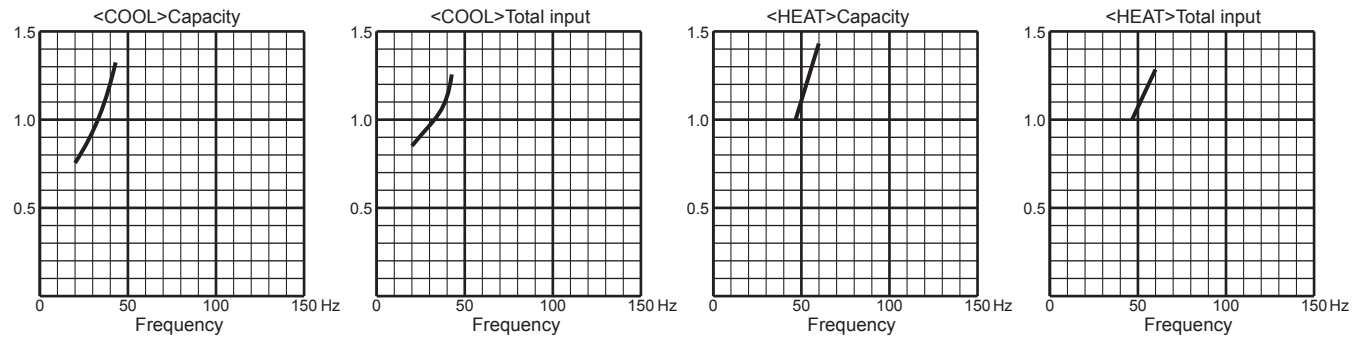

2. 35-class unit in single operation

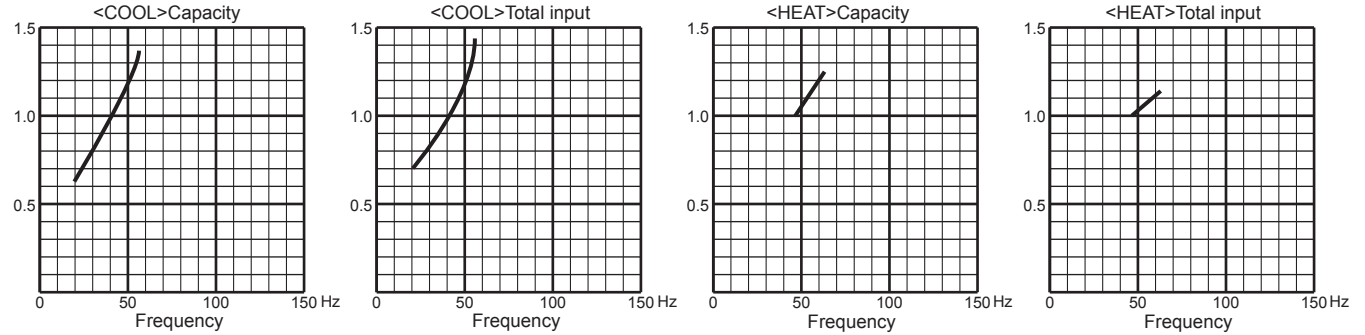


3. 50-class unit in single operation

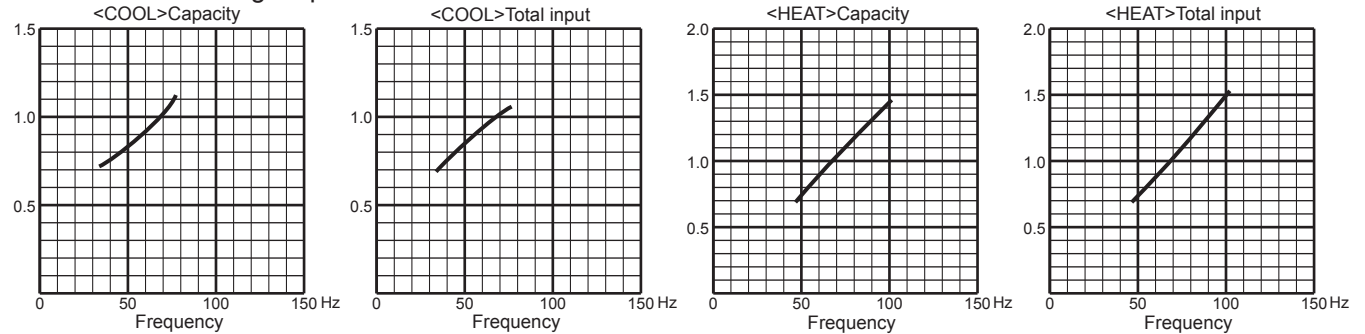


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-2HA40VF

1. 25-class unit in single operation

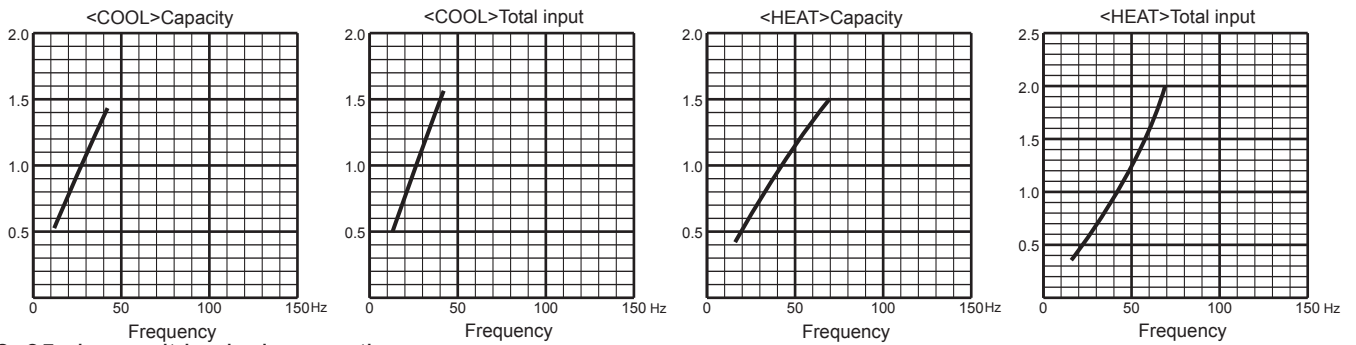


2. 35-class unit in single operation

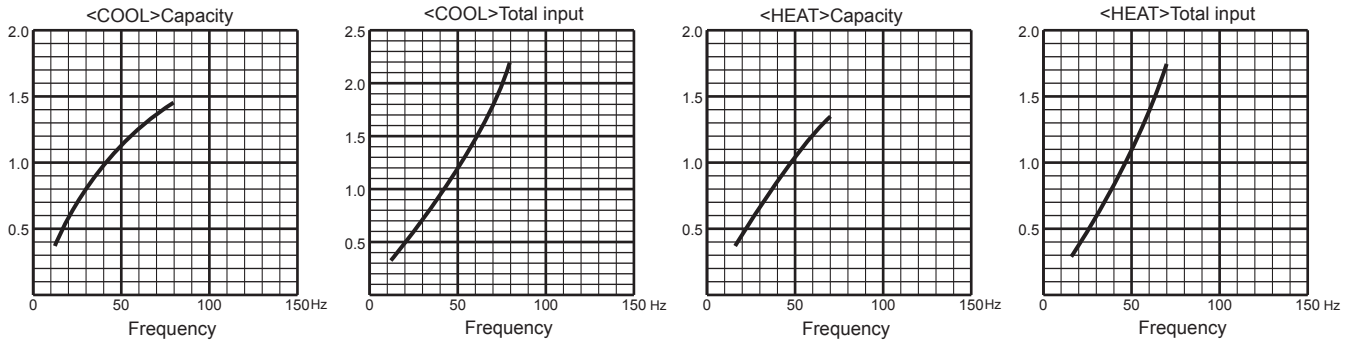


MXZ-2HA50VF


1. 25-class unit in single operation

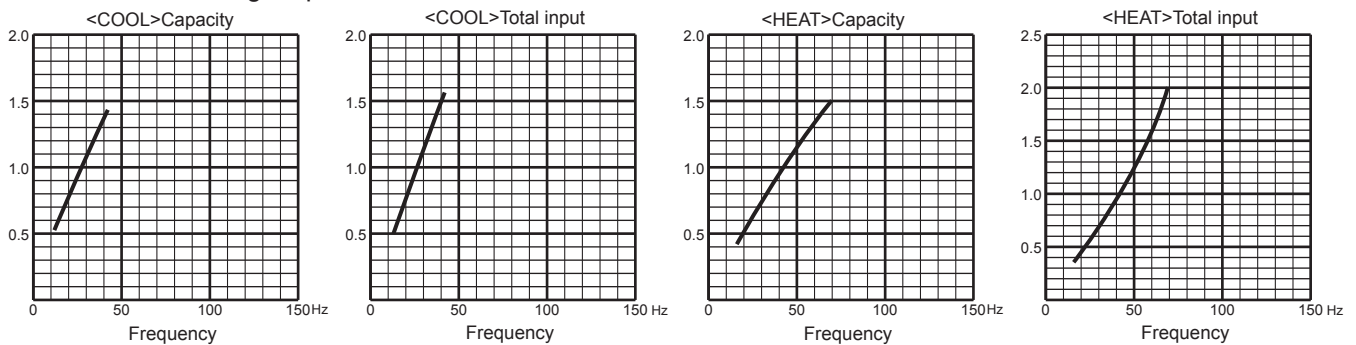

2. 35-class unit in single operation

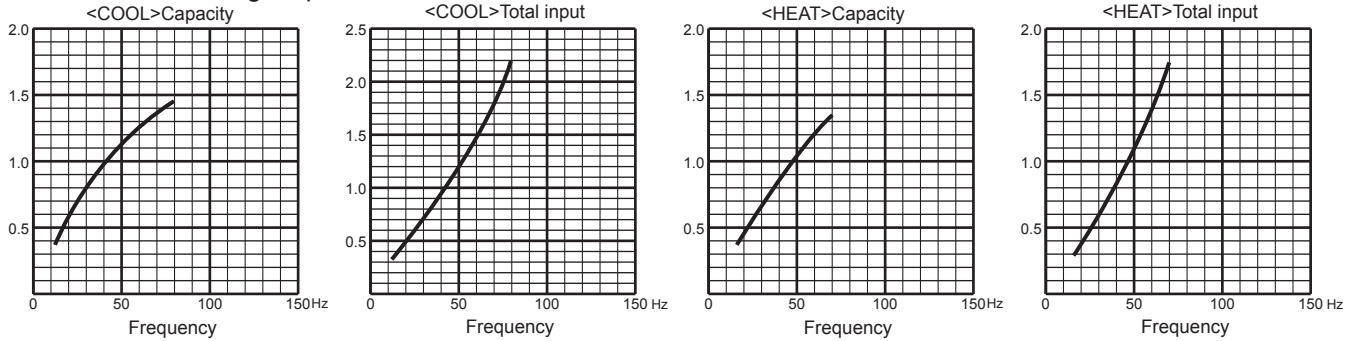


3. 42-class unit in single operation

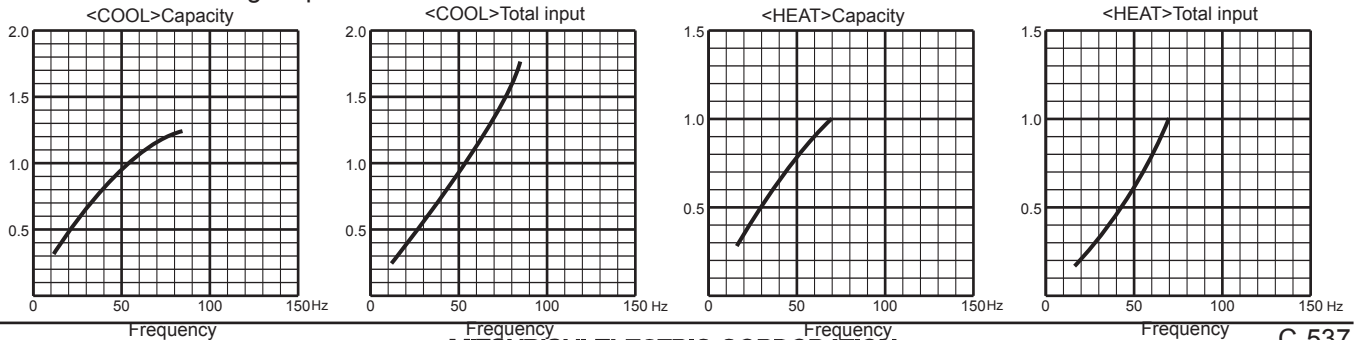


MXZ-3HA50VF


1. 25-class unit in single operation

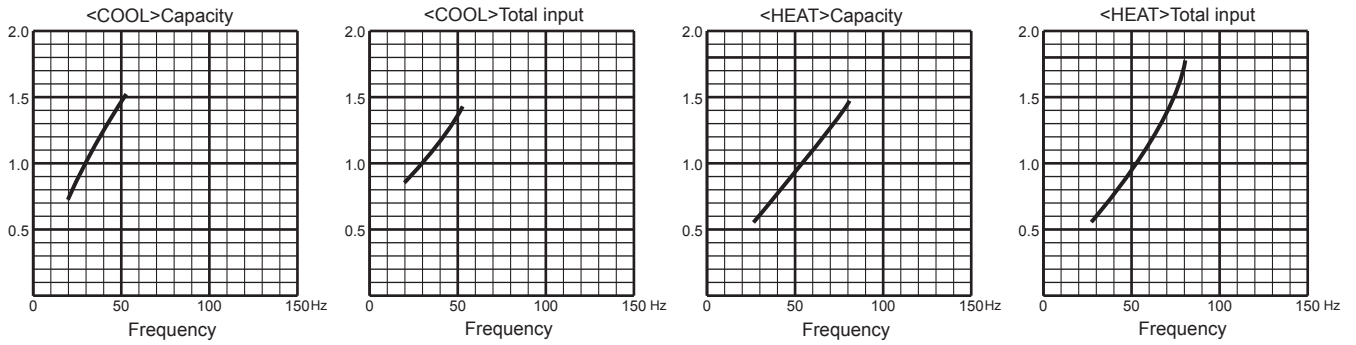


2. 35-class unit in single operation

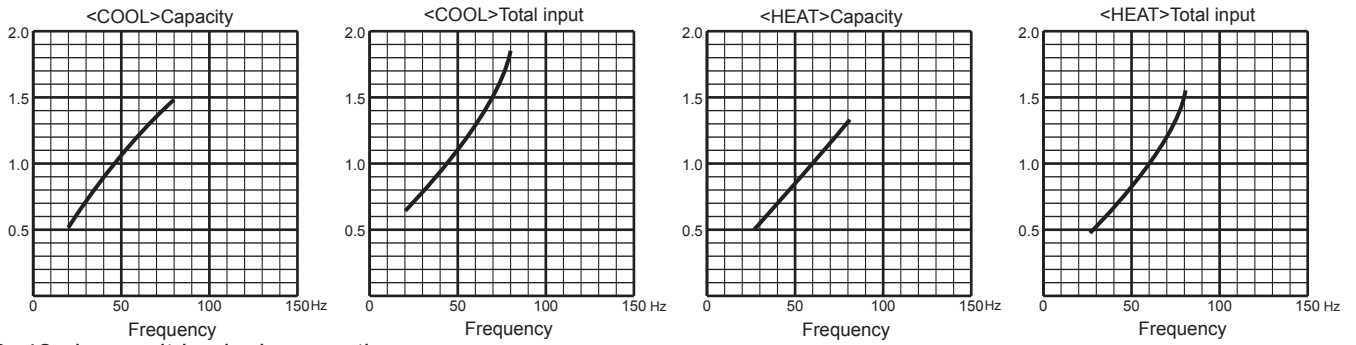

3. 42-class unit in single operation

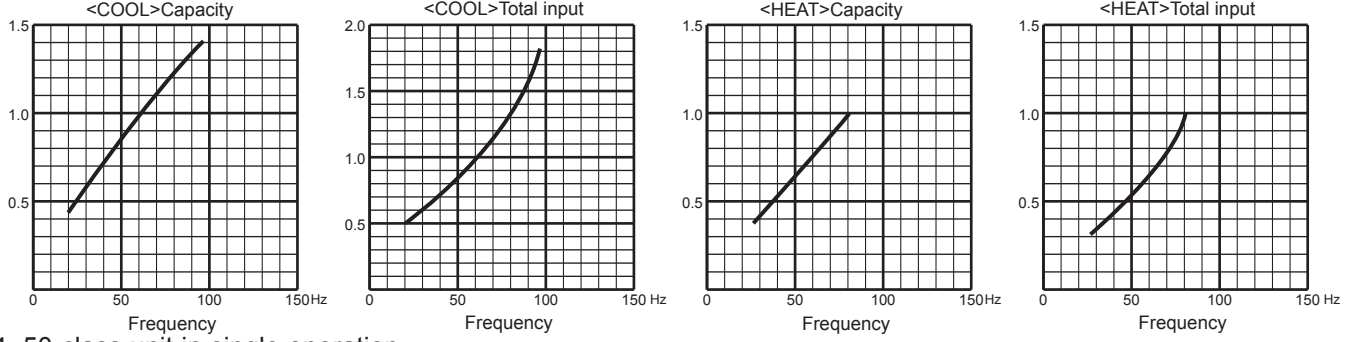


4. 50-class unit in single operation

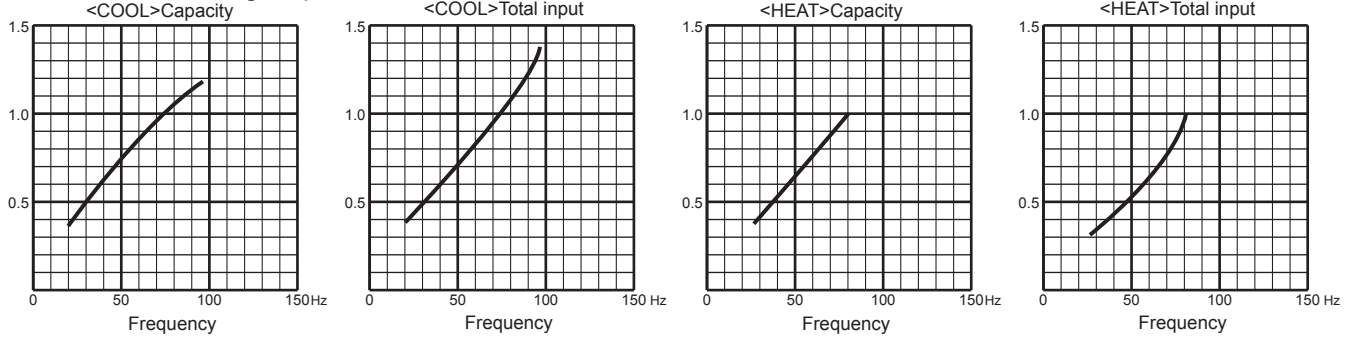


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-2E53VAHZ


1. 15-class unit in single operation

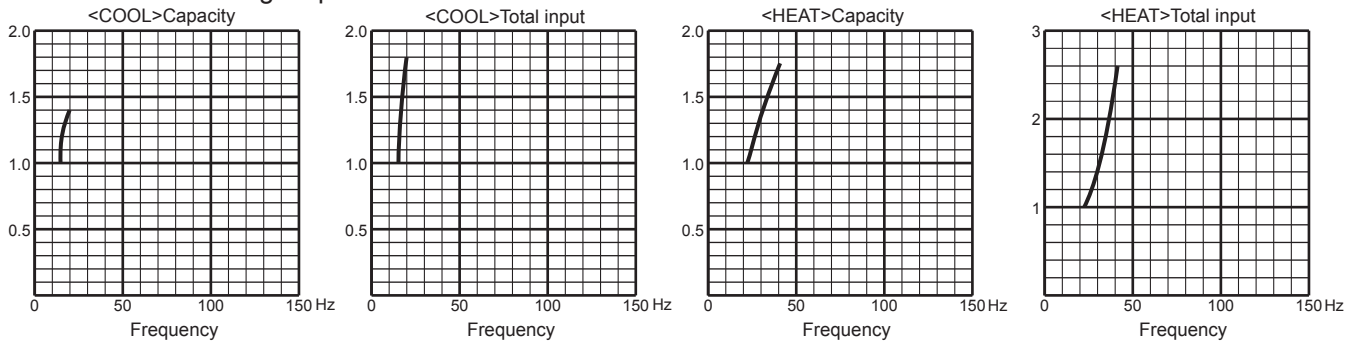


2. 18-class unit in single operation

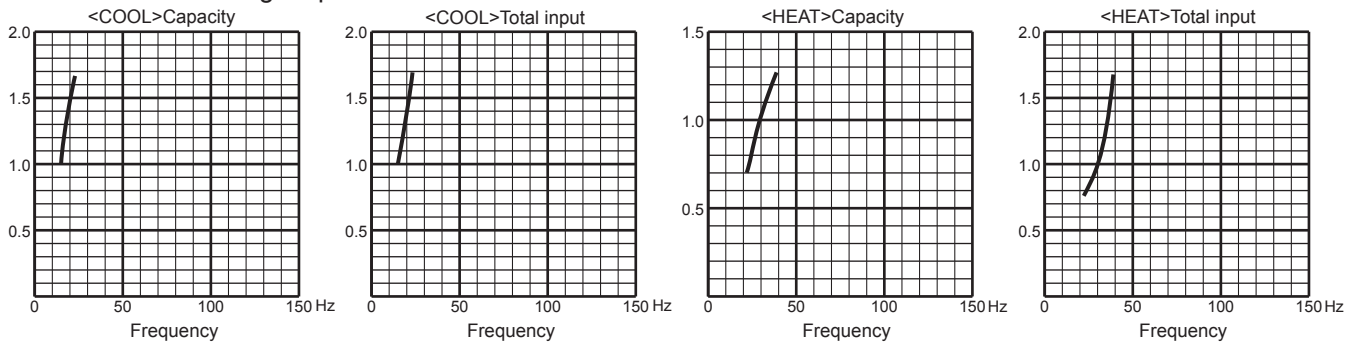


3. 20-class unit in single operation

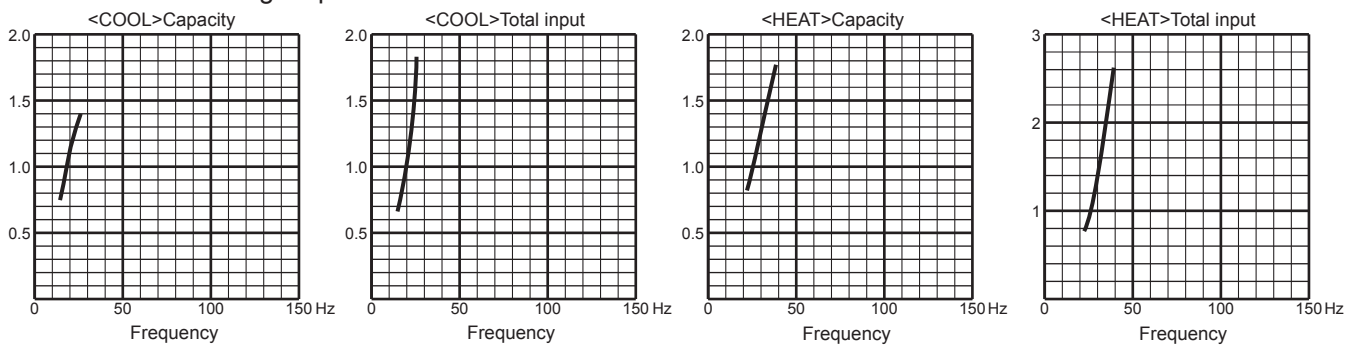

4. 22-class unit in single operation

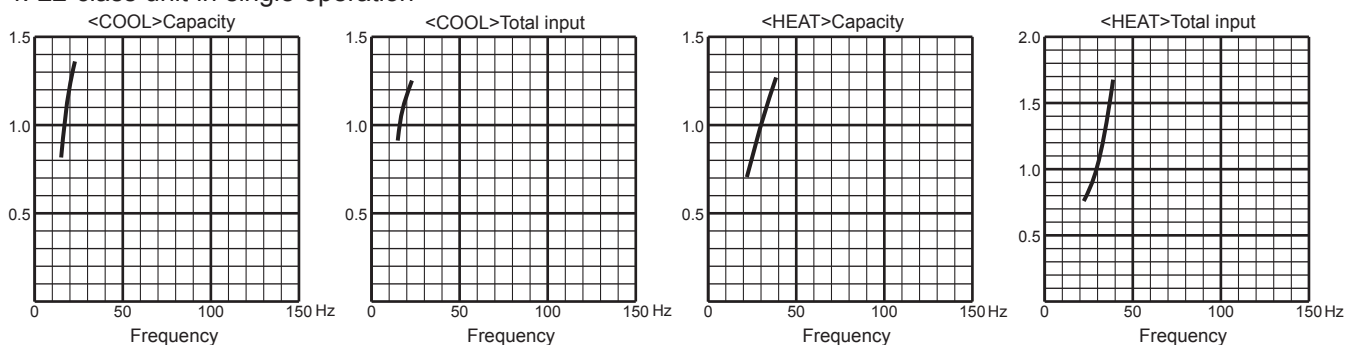


5. 25-class unit in single operation

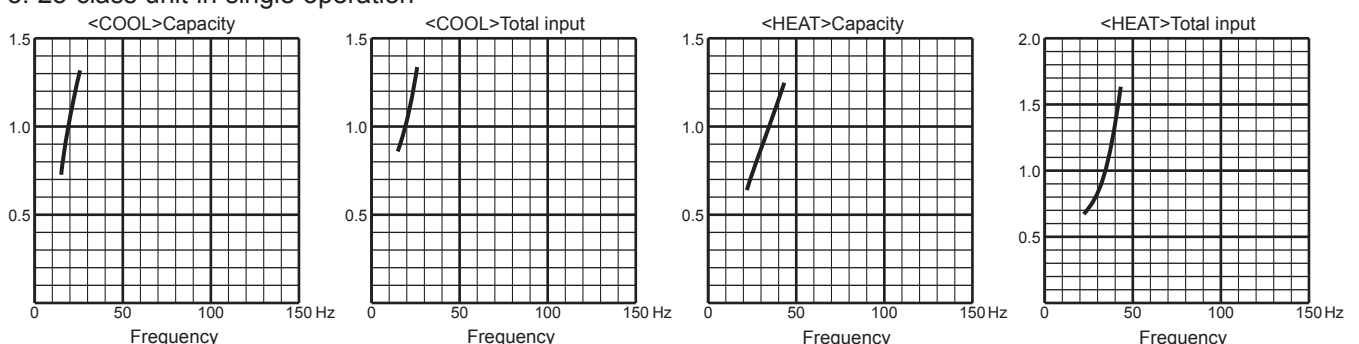


MXZ-2E53VAHZ


6. 35-class unit in single operation

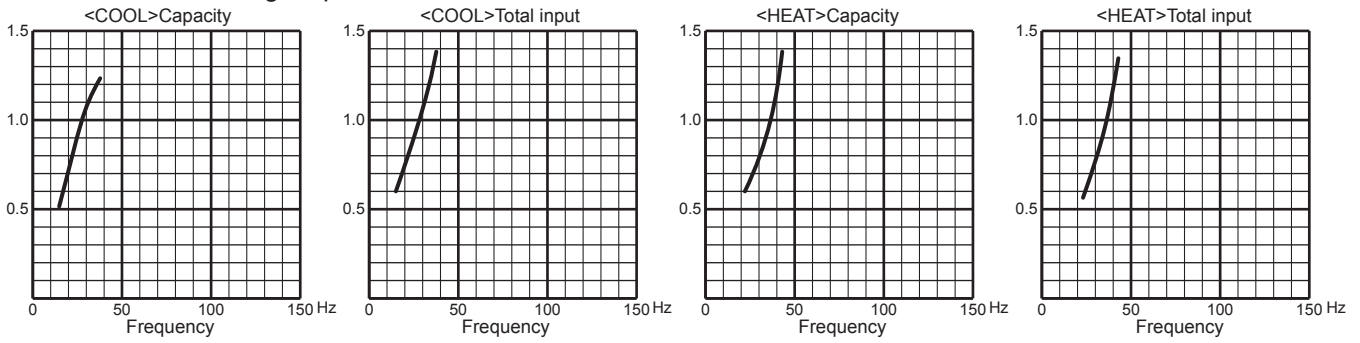

7. 42-class unit in single operation

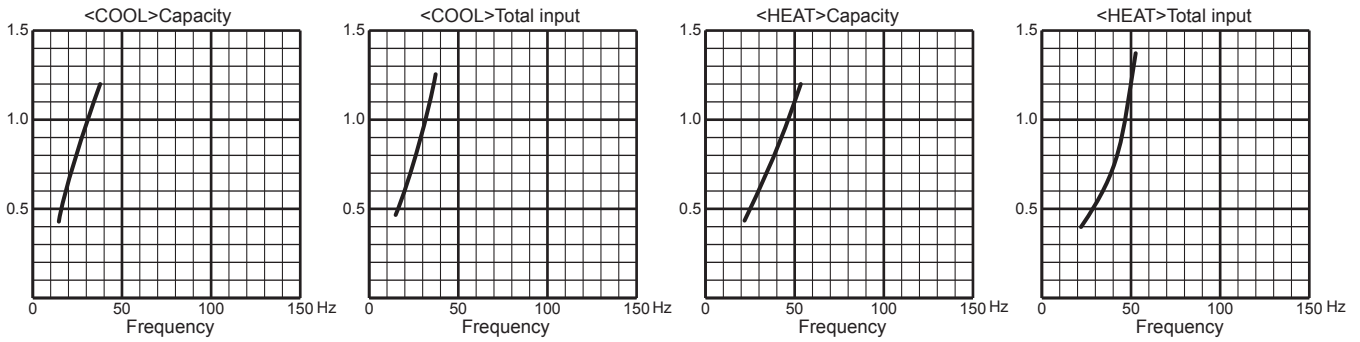


8. 50-class unit in single operation

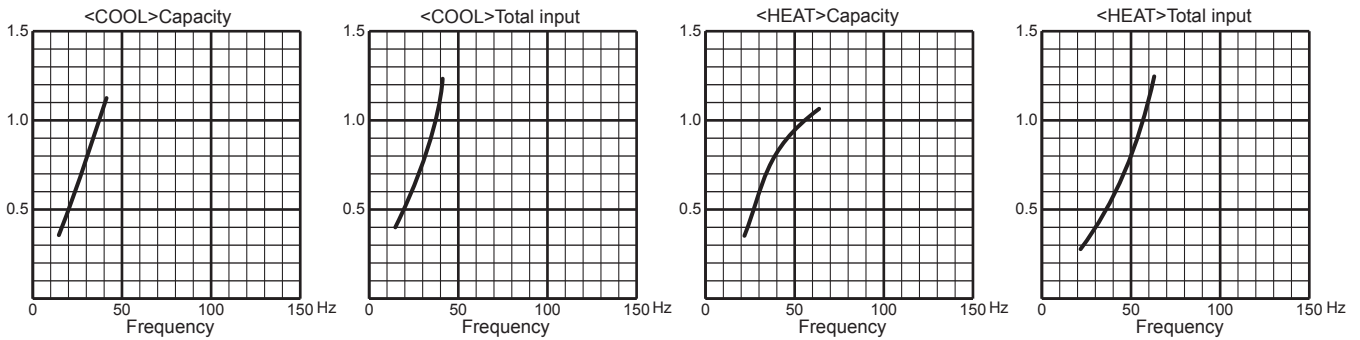


MXZ-4E83VAHZ


1. 15-class unit in single operation

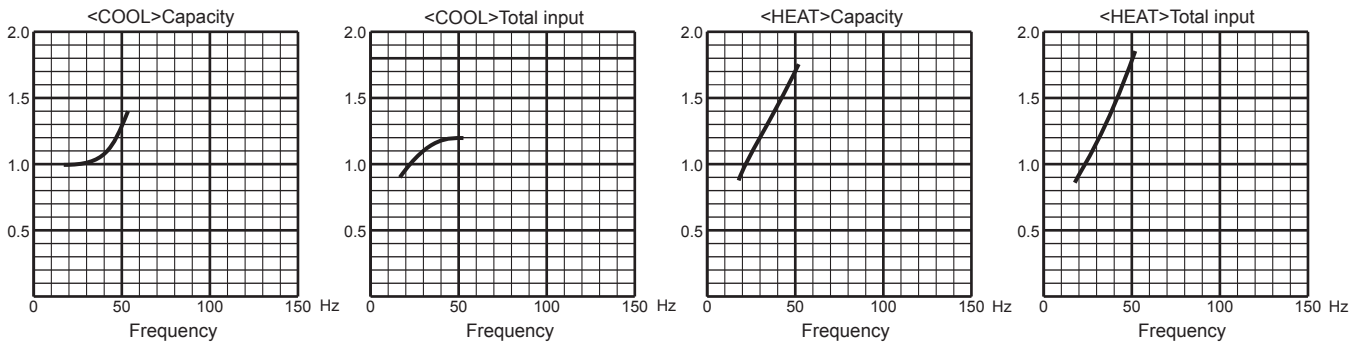


2. 18-class unit in single operation

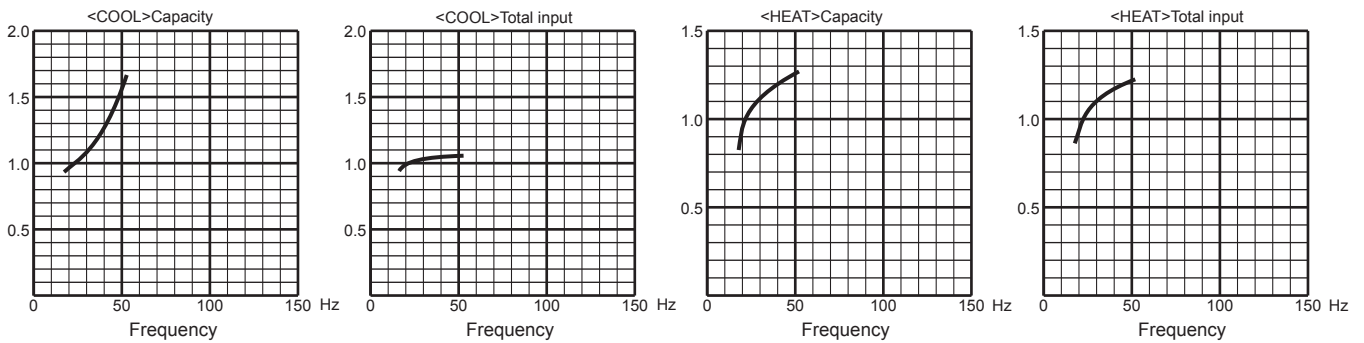


3. 20-class unit in single operation

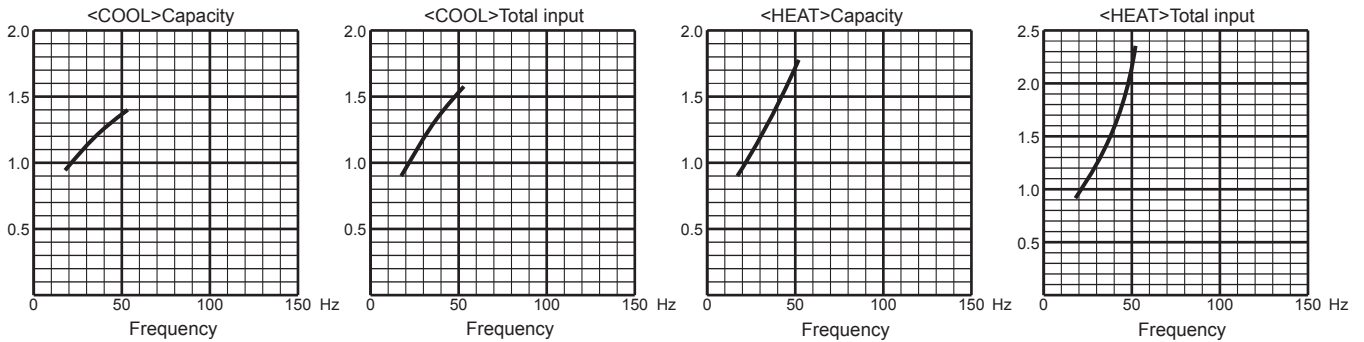

4. 22-class unit in single operation

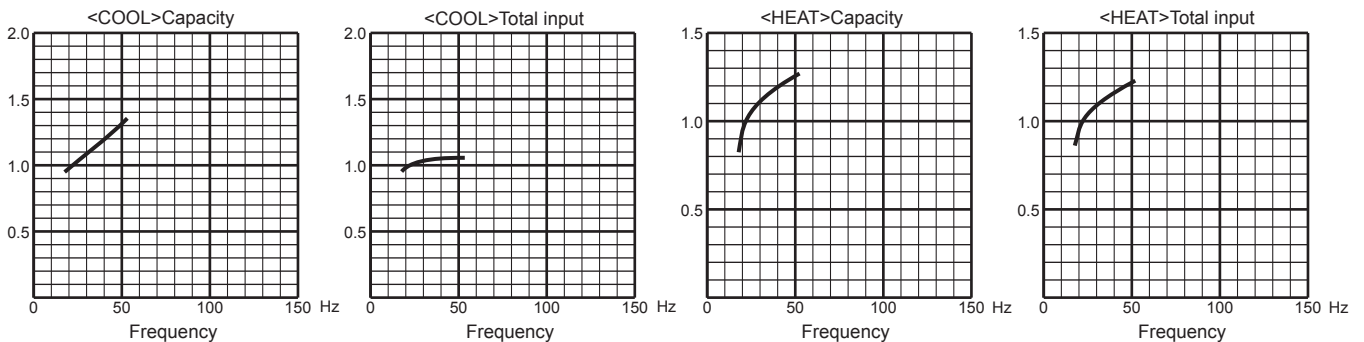


5. 25-class unit in single operation

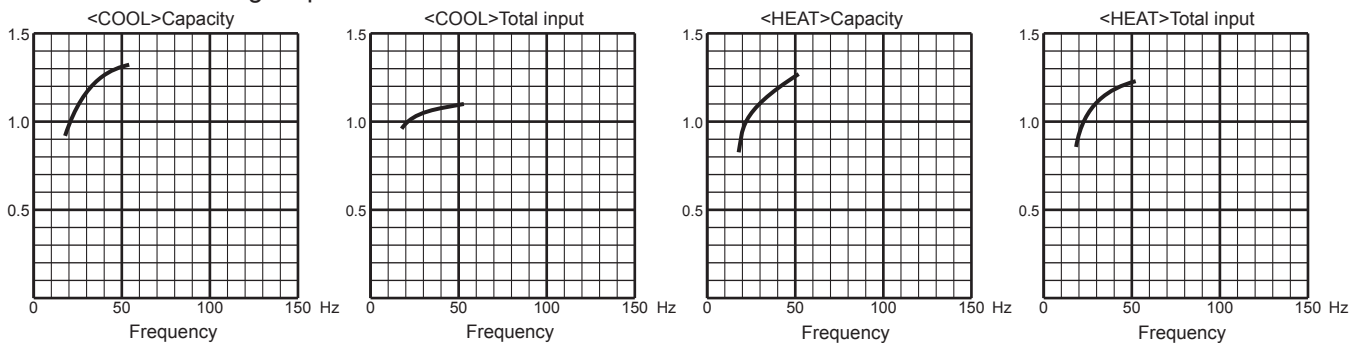


MXZ-4E83VAHZ


6. 35-class unit in single operation

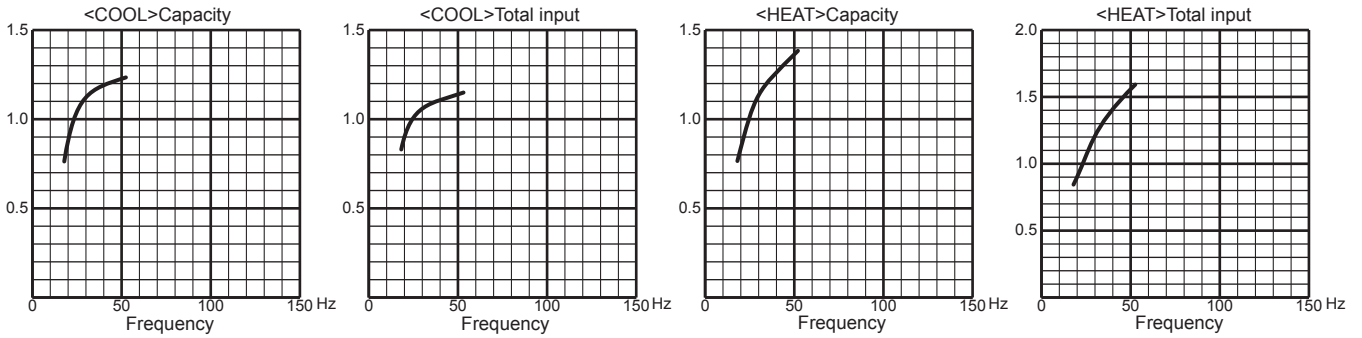


7. 42-class unit in single operation

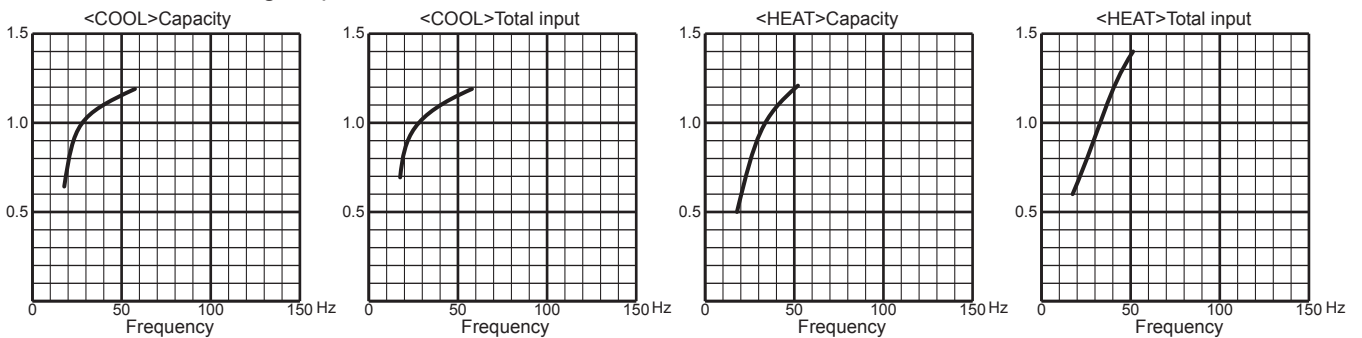


8. 50-class unit in single operation

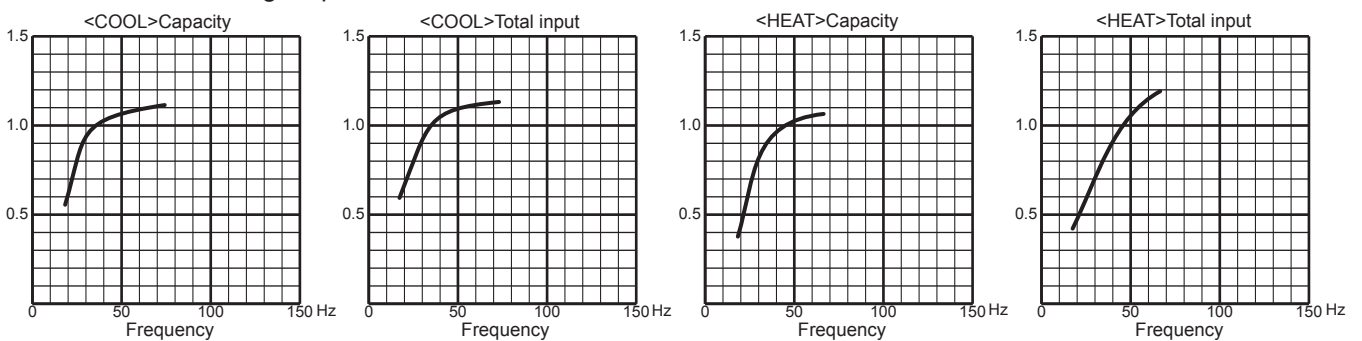

9. 60-class unit in single operation

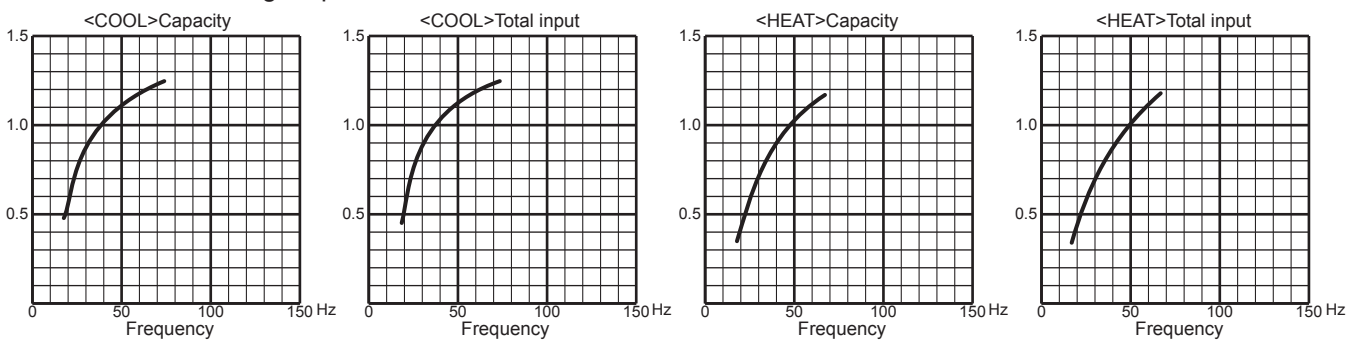

10. 71-class unit in single operation

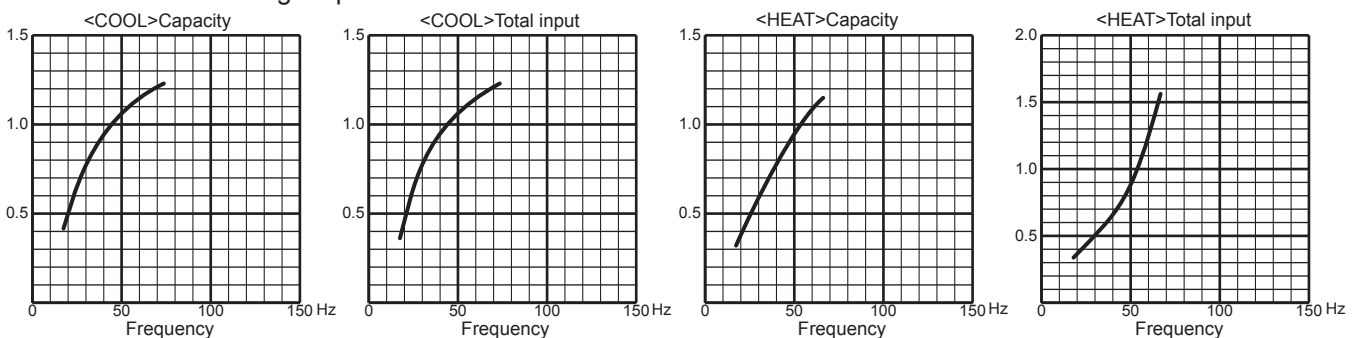

PERFORMANCE CURVES MULTI SYSTEMS

TEST RUN OPERATION (How to operate fixed-frequency operation)

1. Press EMERGENCY OPERATION switch to COOL or HEAT mode (COOL: Press once, HEAT: Press twice).
2. Test run operation starts and continues to operate for 30 minutes.
3. Compressor operates at rated frequency.
4. Indoor fan operates at High speed.
5. After 30 minutes, test run operation finishes and EMERGENCY OPERATION starts (Operation frequency of compressor varies).
6. To cancel test run operation (EMERGENCY OPERATION), press EMERGENCY OPERATION switch or any button on remote controller.

OUTDOOR LOW PRESSURE AND OUTDOOR UNIT CURRENT (single operation)

NOTE: The unit of pressure has been changed to MPa on the international system of units (SI unit system).

The conversion factor is: **1 (MPa [Gauge]) = 10.2 (kgf/cm² [Gauge])**


COOL operation

- ① Both indoor and outdoor unit are under the same temperature/humidity condition.
- ② Operation: TEST RUN OPERATION


Dry-bulb temperature (°C)	Relative humidity (%)
20	50
25	60
30	70

MXZ-2F33VF


1. 15-class unit in single operation

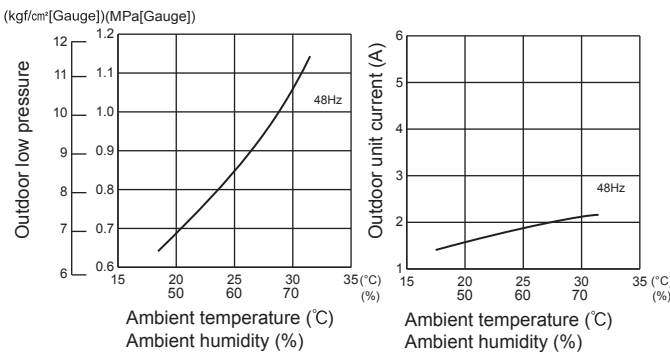


2. 18-class unit in single operation

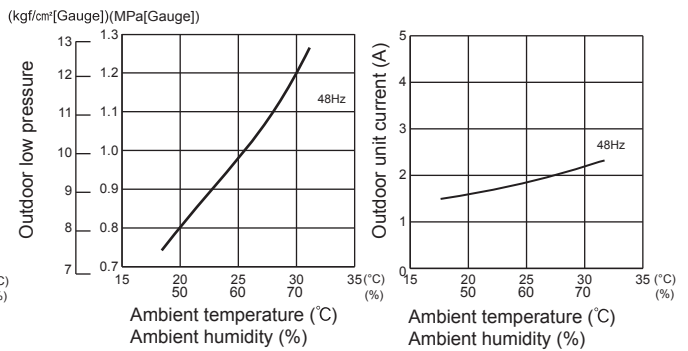


3. 20-class unit in single operation

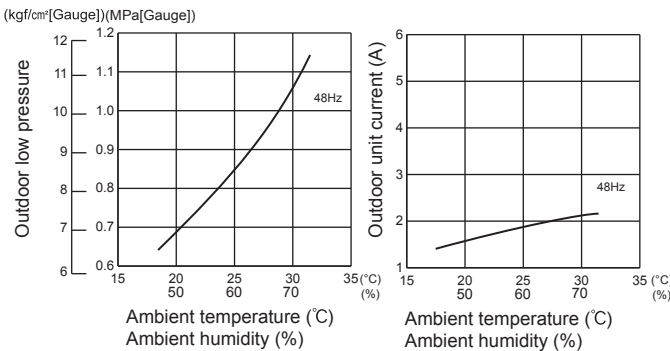

4. 22-class unit in single operation

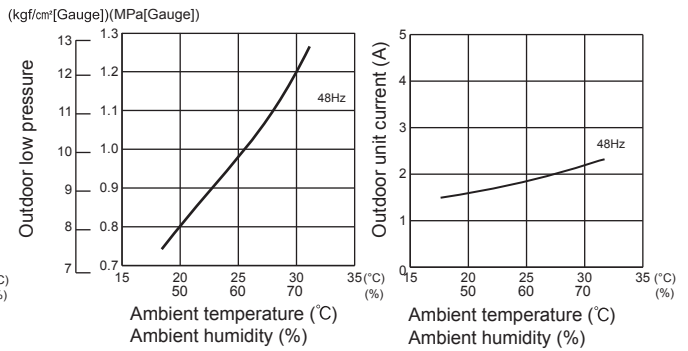


5. 25-class unit in single operation

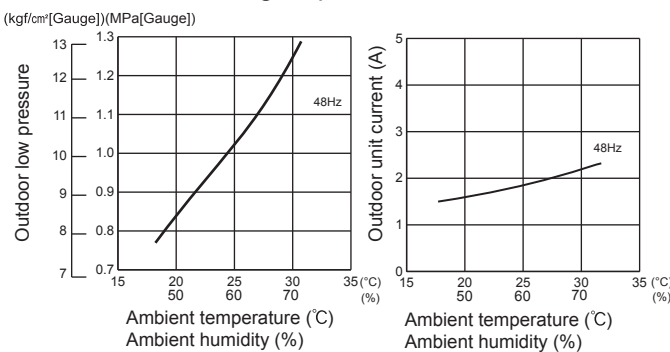


MXZ-2F42VF


1. 15-class unit in single operation

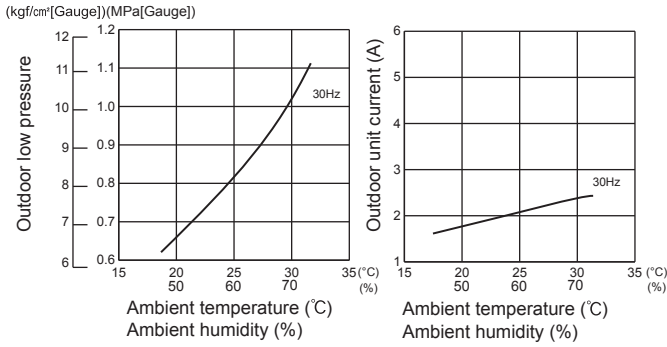


2. 18-class unit in single operation

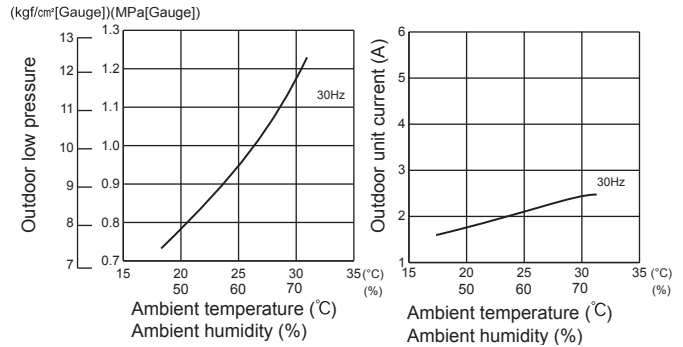


3. 20-class unit in single operation

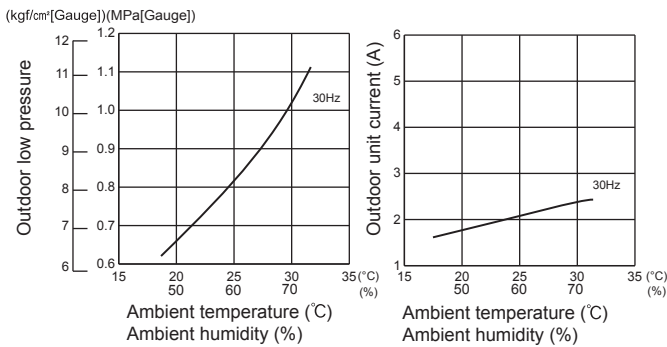


4. 22-class unit in single operation

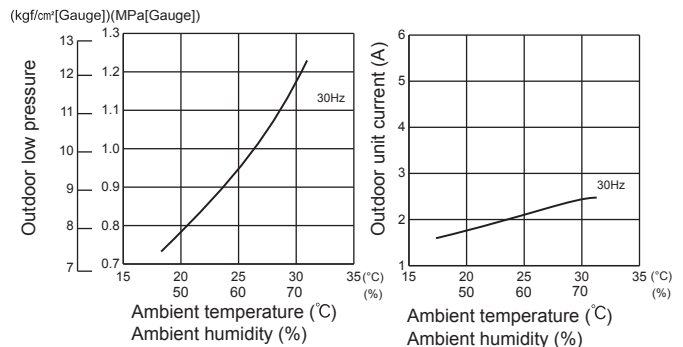

5. 25-class unit in single operation

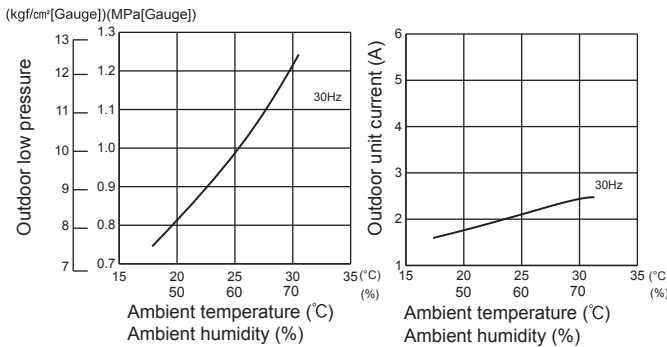


6. 35-class unit in single operation

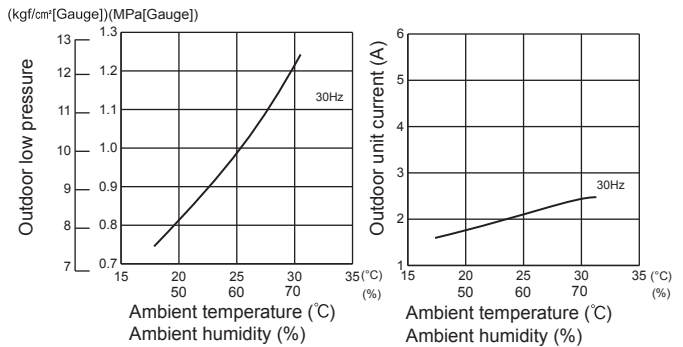


MXZ-2F53VF MXZ-2F53VFH

1. 15-class unit in single operation

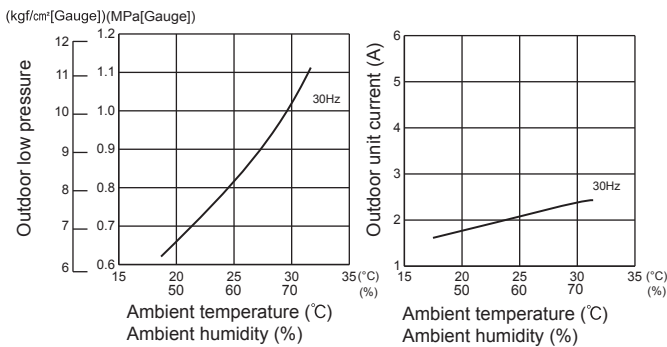


2. 18-class unit in single operation

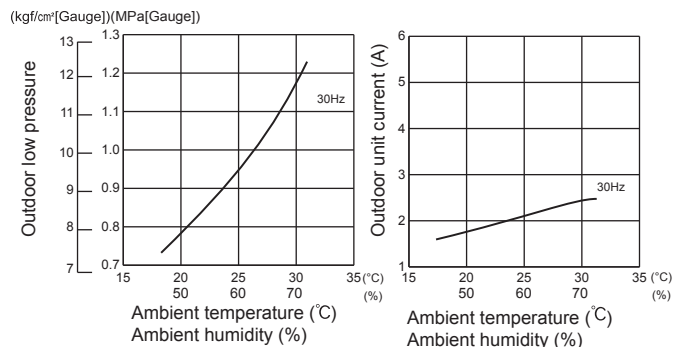


PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-2F53VF MXZ-2F53VFH


3. 20-class unit in single operation

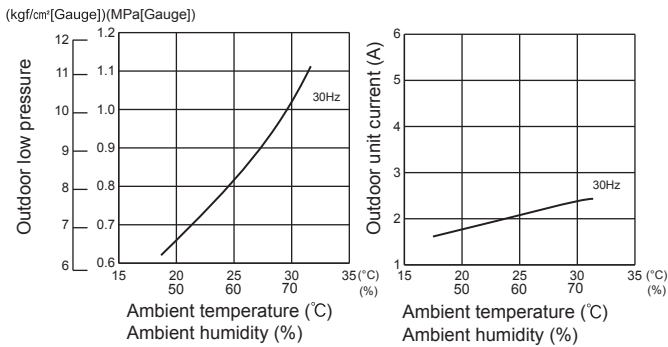


4. 22-class unit in single operation

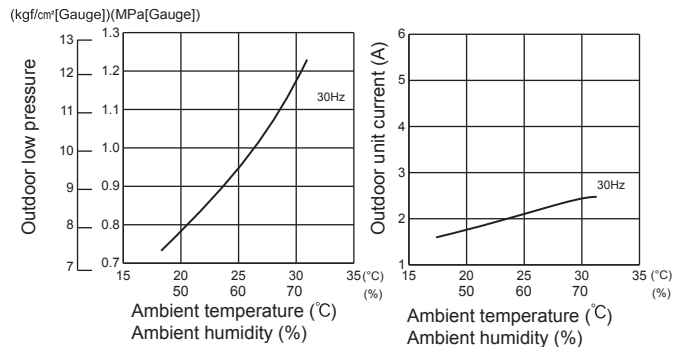


5. 25-class unit in single operation

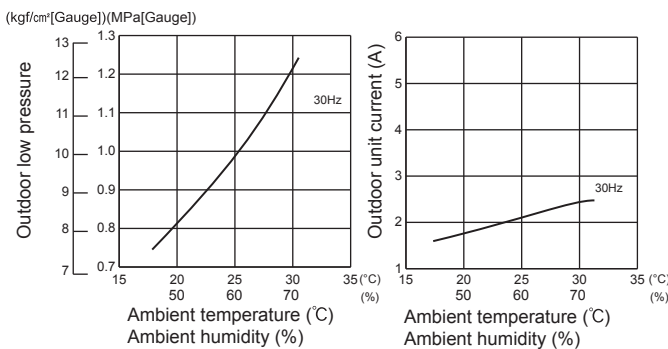


6. 35-class unit in single operation

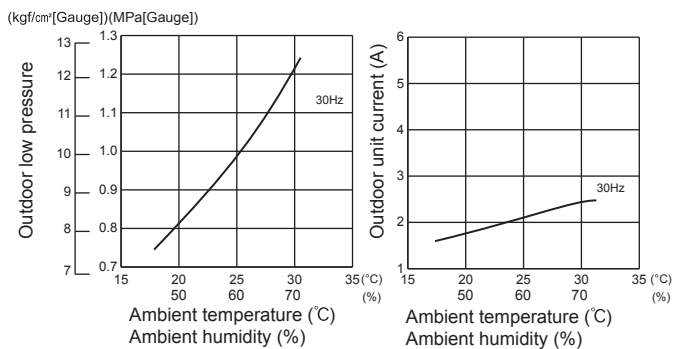

7. 42-class unit in single operation

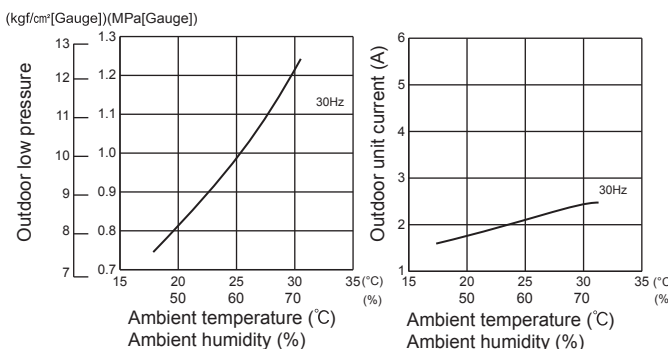


8. 50-class unit in single operation

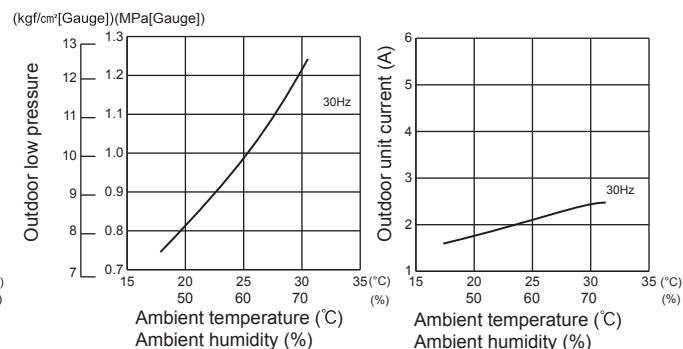


MXZ-3F54VF2

1. 15-class unit in single operation

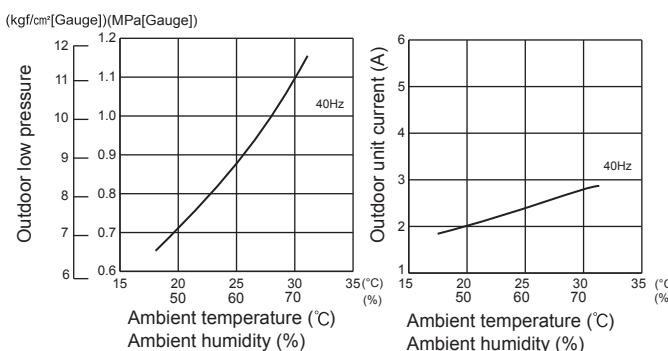


2. 18-class unit in single operation

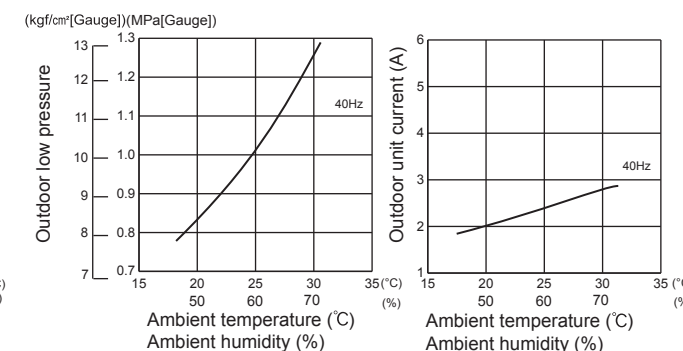


MXZ-3F54VF2


3. 20-class unit in single operation

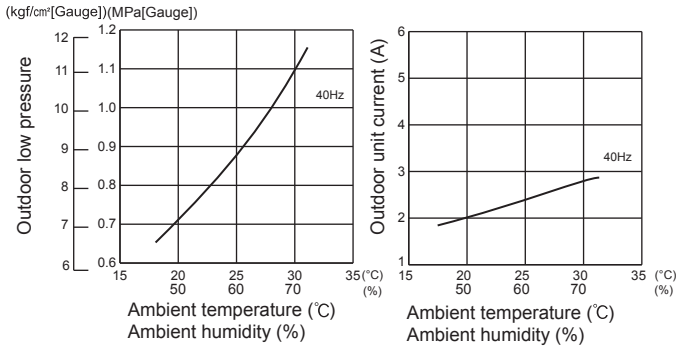


4. 22-class unit in single operation

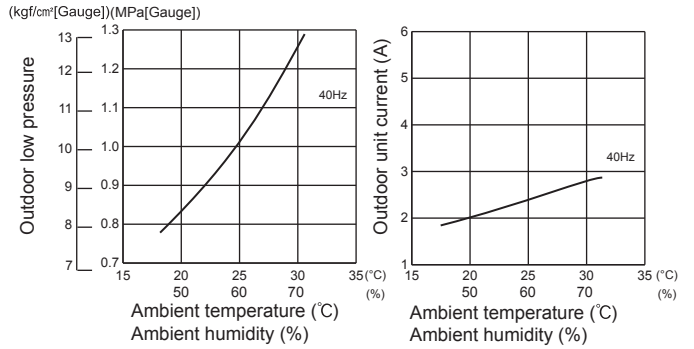


5. 25-class unit in single operation

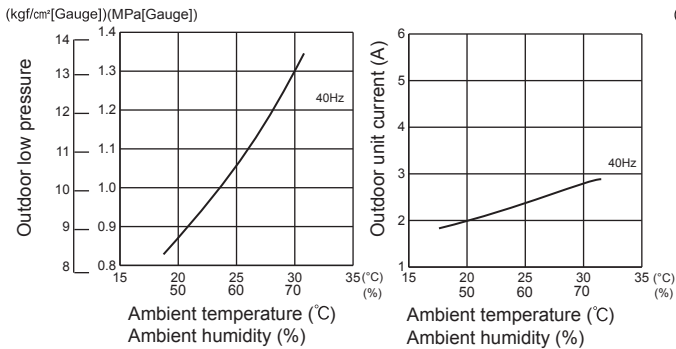


6. 35-class unit in single operation

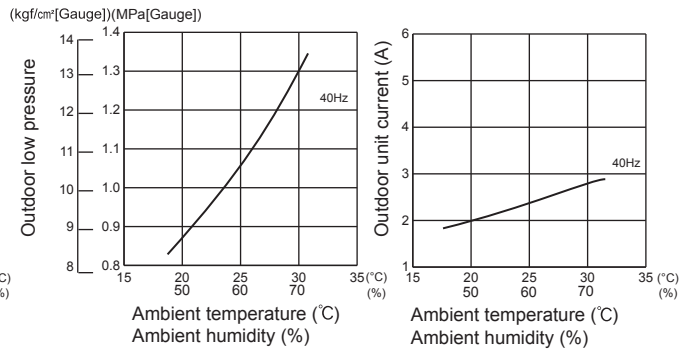

7. 42-class unit in single operation

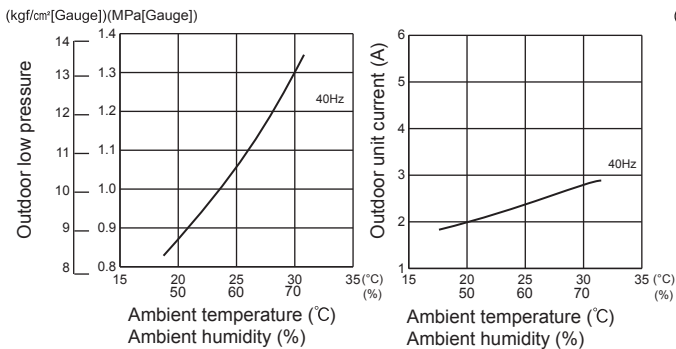


8. 50-class unit in single operation

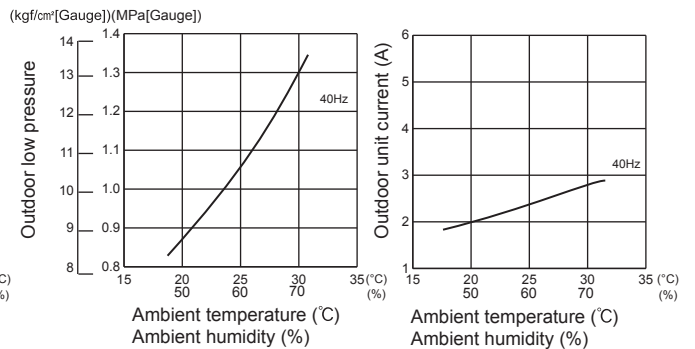


MXZ-3F68VF2 MXZ-4F72VF2

1. 15-class unit in single operation

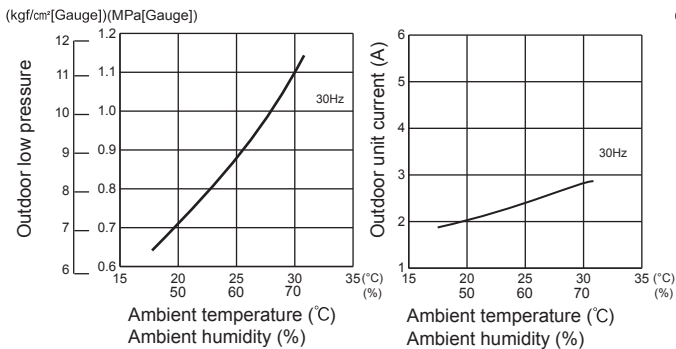


2. 18-class unit in single operation

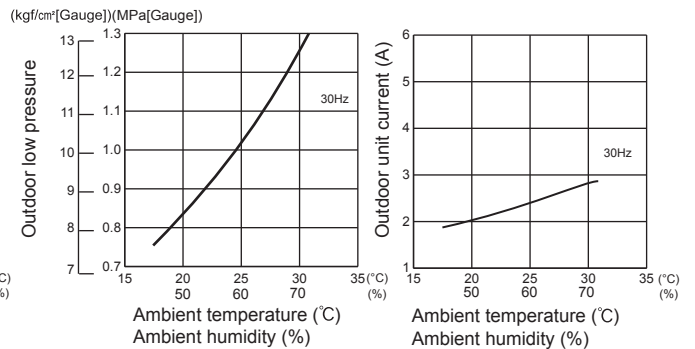


MXZ-3F68VF2 MXZ-4F72VF2


3. 20-class unit in single operation

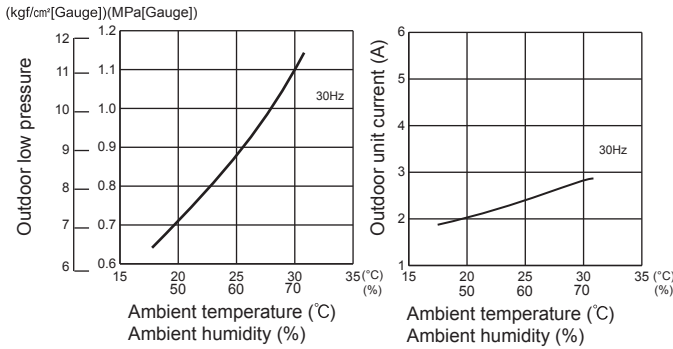


4. 22-class unit in single operation

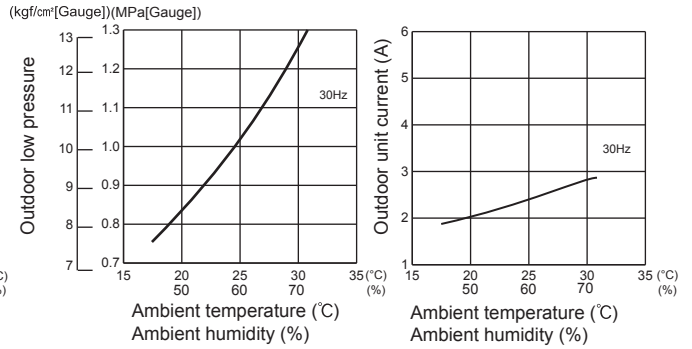


5. 25-class unit in single operation

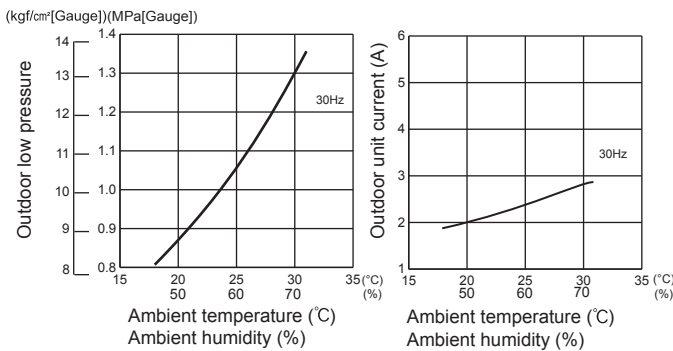


6. 35-class unit in single operation

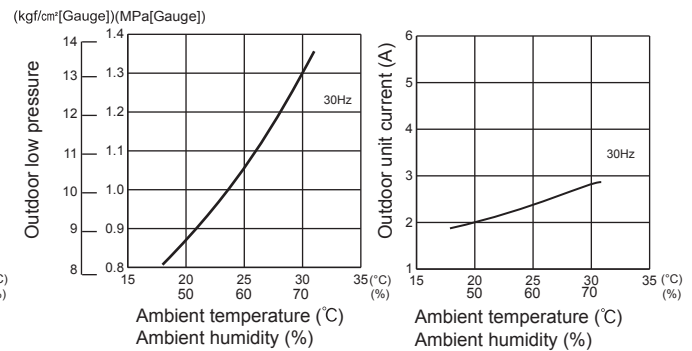


7. 42-class unit in single operation

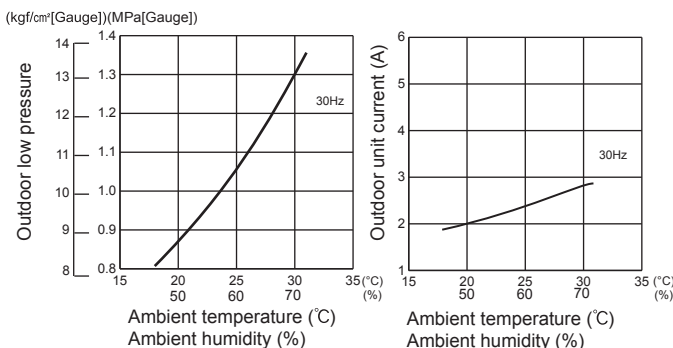

8. 50-class unit in single operation

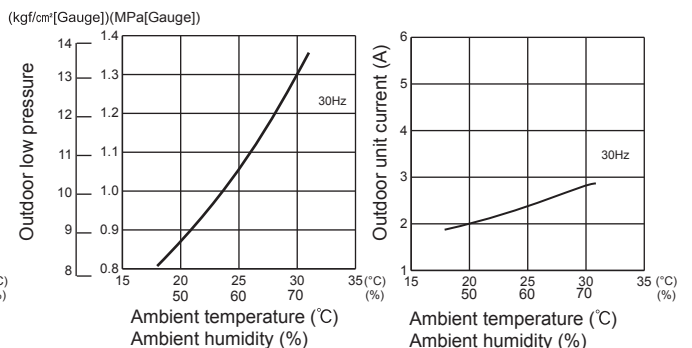


9. 60-class unit in single operation

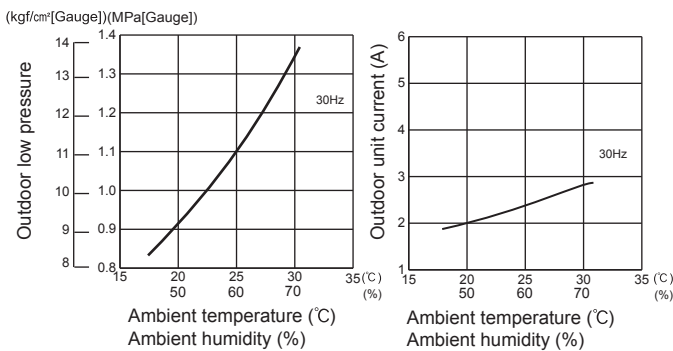


MXZ-4F80VF2


1. 15-class unit in single operation

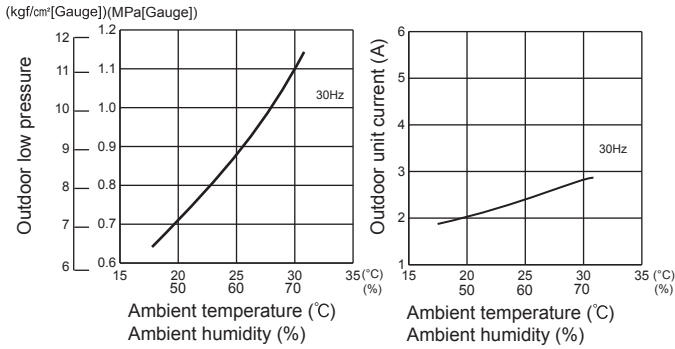


2. 18-class unit in single operation

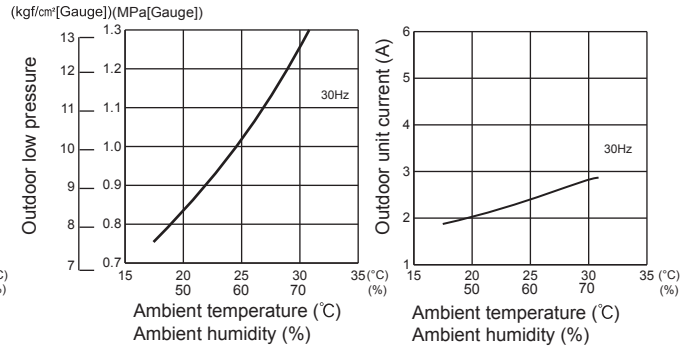


3. 20-class unit in single operation

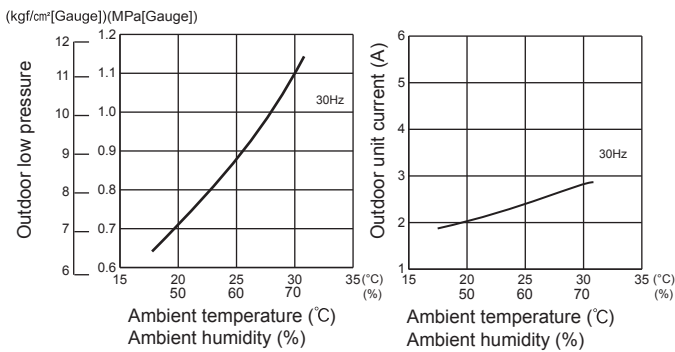


4. 22-class unit in single operation

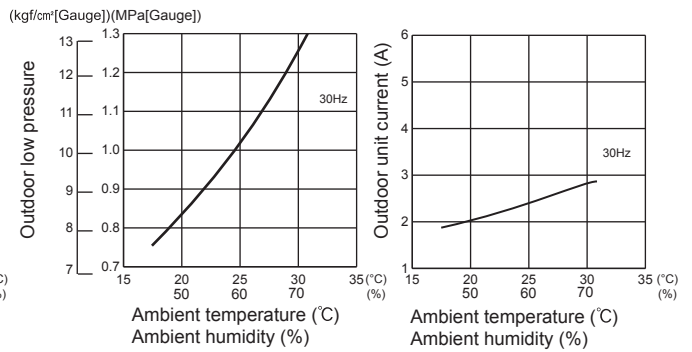


5. 25-class unit in single operation

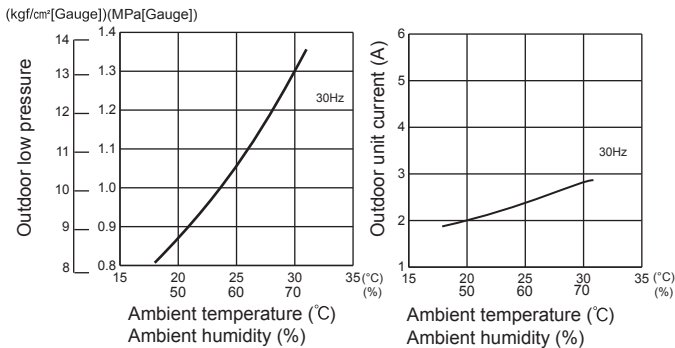


6. 35-class unit in single operation

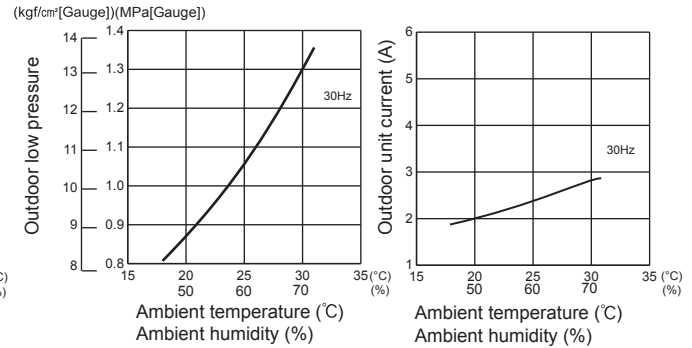

7. 42-class unit in single operation

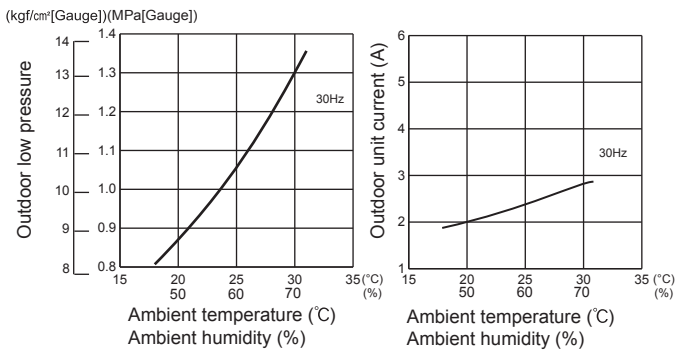


8. 50-class unit in single operation

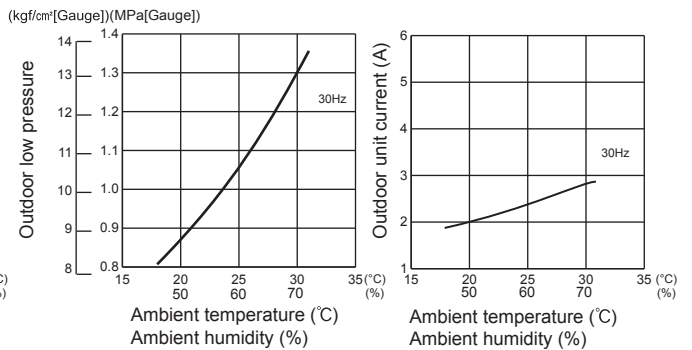


MXZ-4F80VF2

9. 60-class unit in single operation

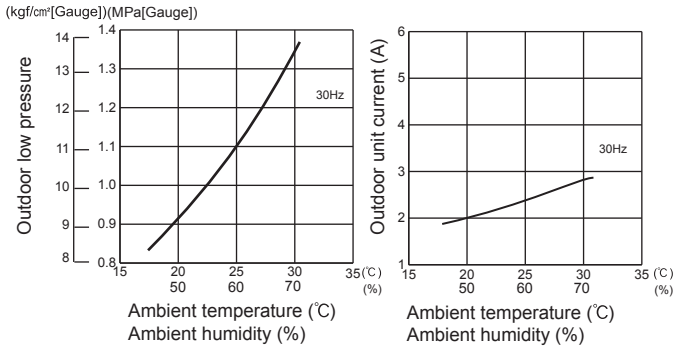


MXZ-2D33VA


1. 15-class unit in single operation

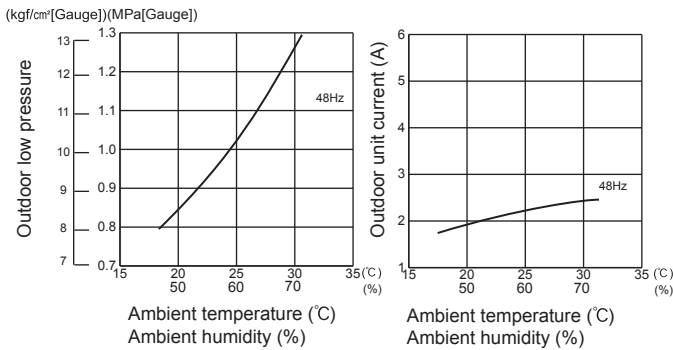


2. 18-class unit in single operation

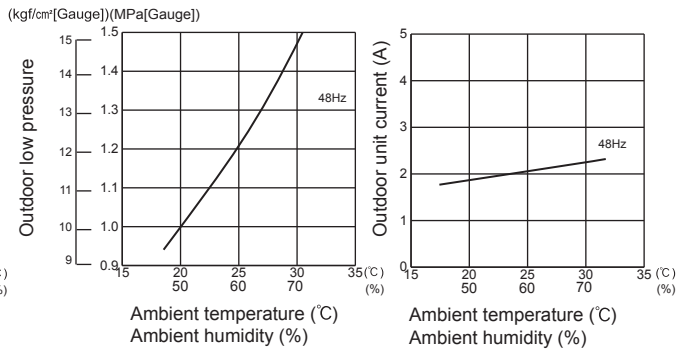


3. 20-class unit in single operation

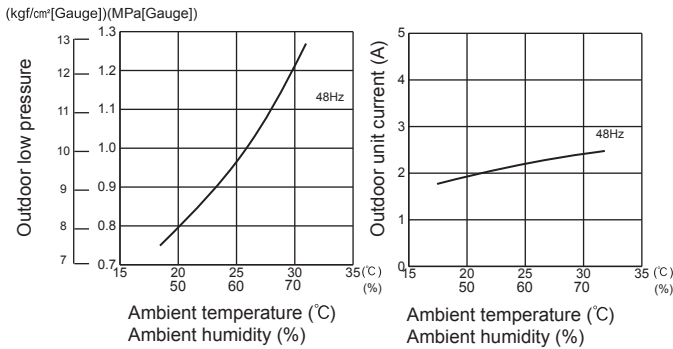

4. 22-class unit in single operation

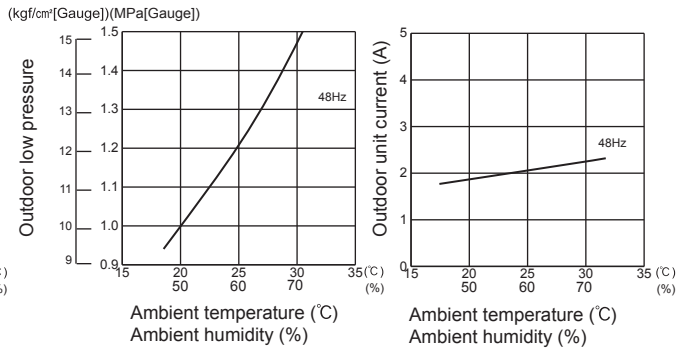


5. 25-class unit in single operation

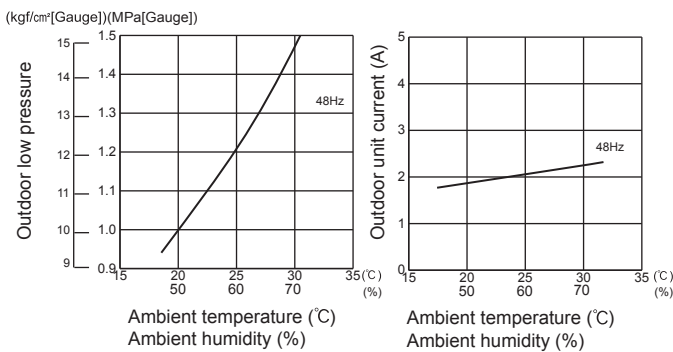


MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2


1. 15-class unit in single operation

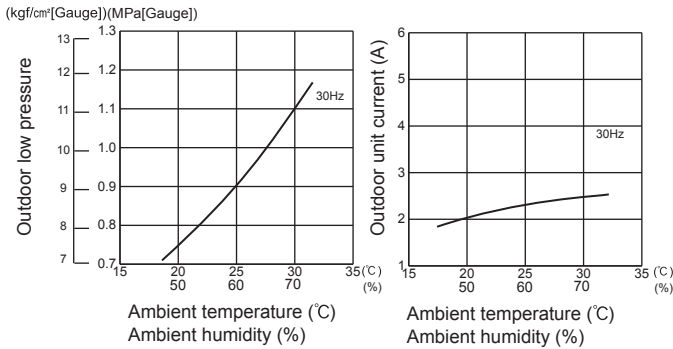


2. 18-class unit in single operation

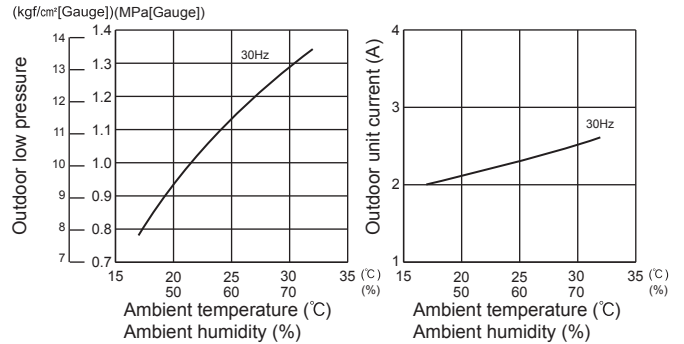


3. 20-class unit in single operation

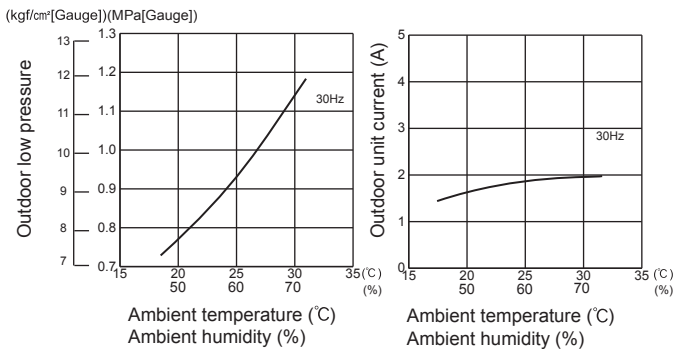


4. 22-class unit in single operation

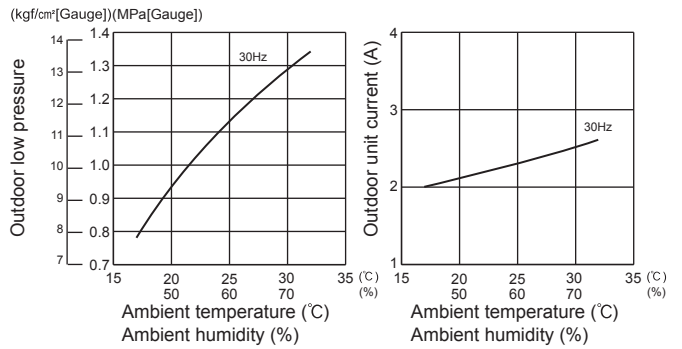


5. 25-class unit in single operation

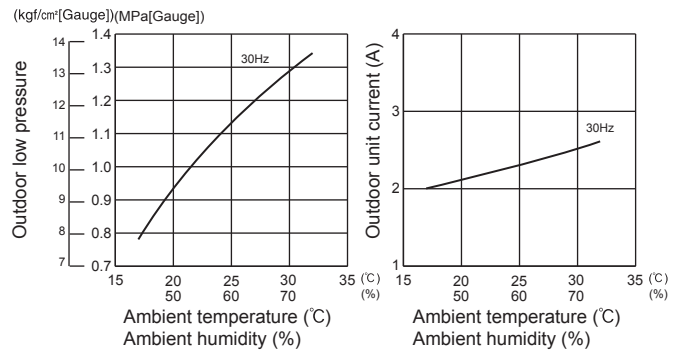


6. 35-class unit in single operation

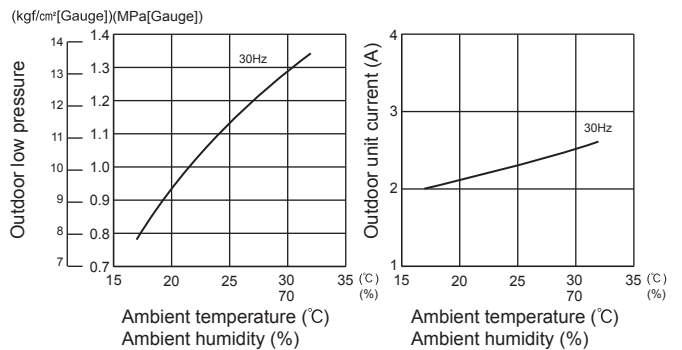

7. 42-class unit in single operation

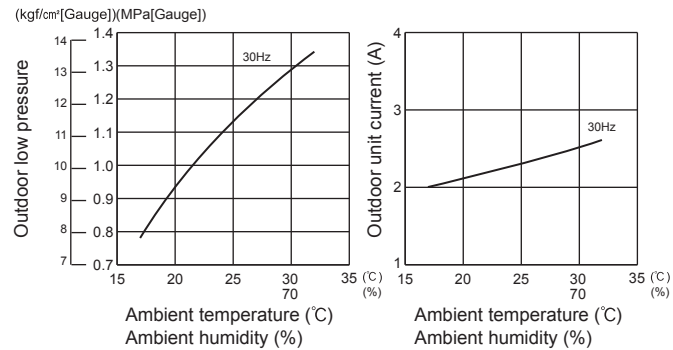


8. 50-class unit in single operation

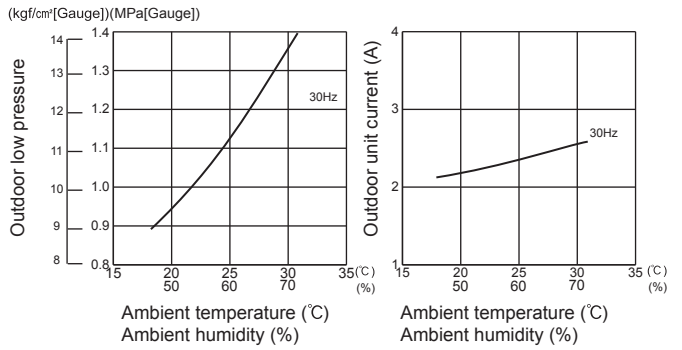


MXZ-3E54VA


1. 15-class unit in single operation

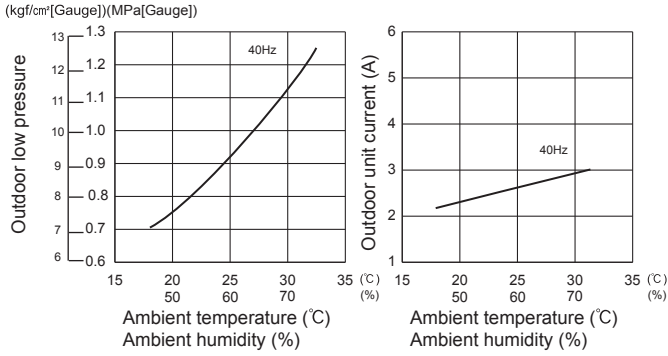


2. 18-class unit in single operation

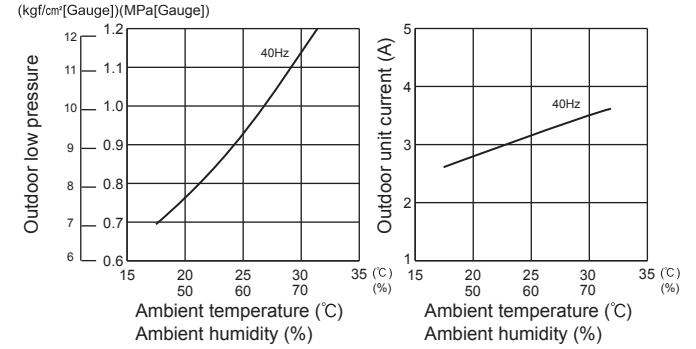


3. 20-class unit in single operation

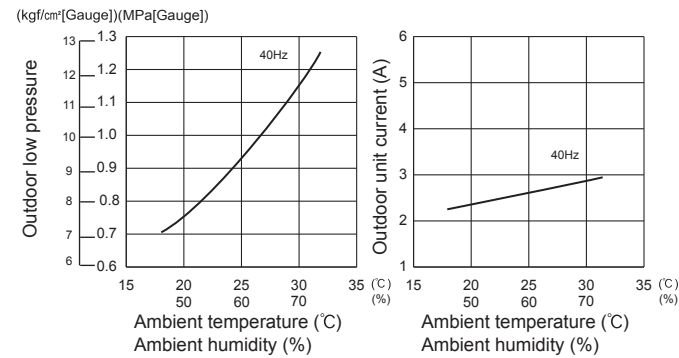


4. 22-class unit in single operation

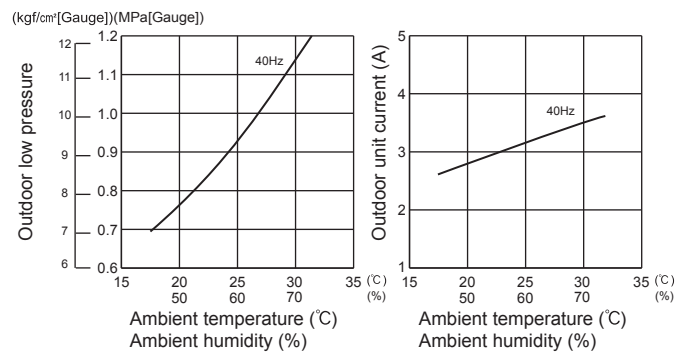


5. 25-class unit in single operation

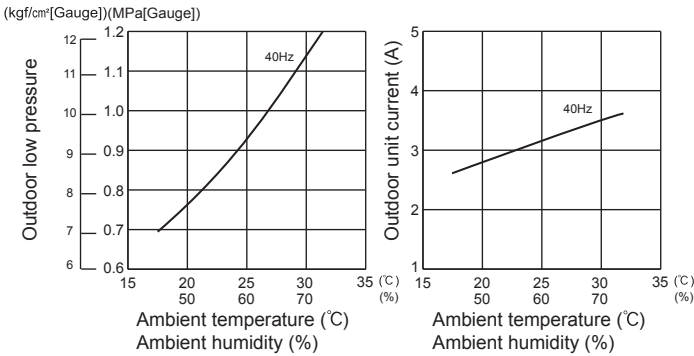


6. 35-class unit in single operation

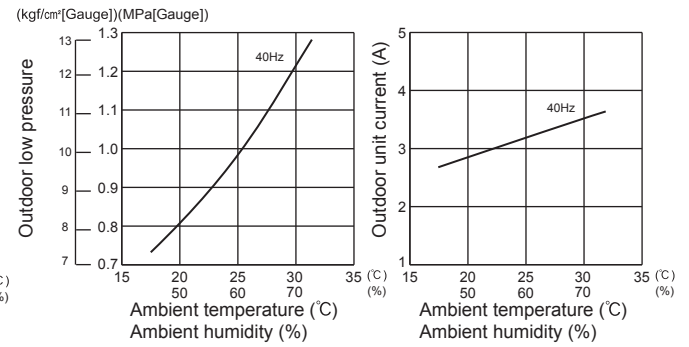

7. 42-class unit in single operation

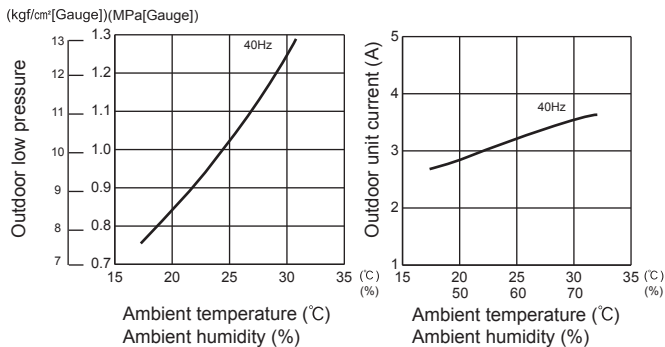


8. 50-class unit in single operation

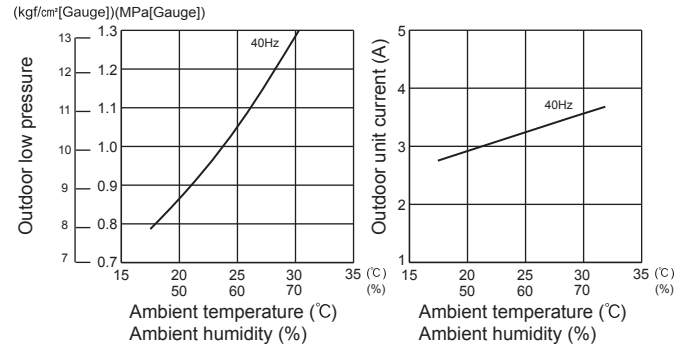


MXZ-3E68VA MXZ-4E72VA

9. 60-class unit in single operation

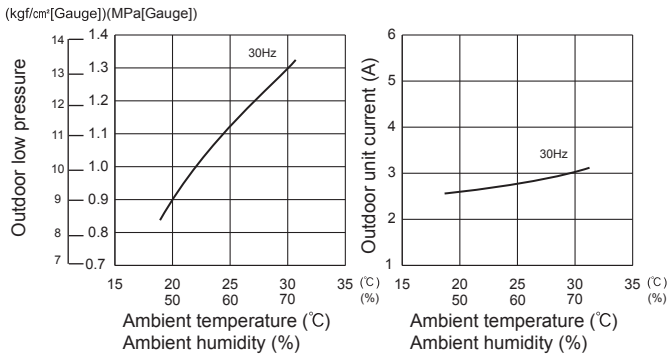


MXZ-4E83VA


1. 15-class unit in single operation

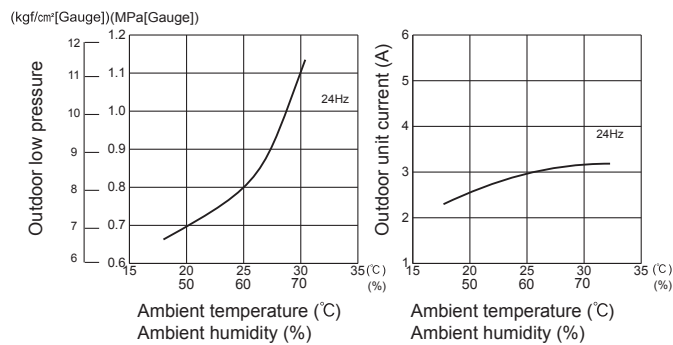


2. 18-class unit in single operation

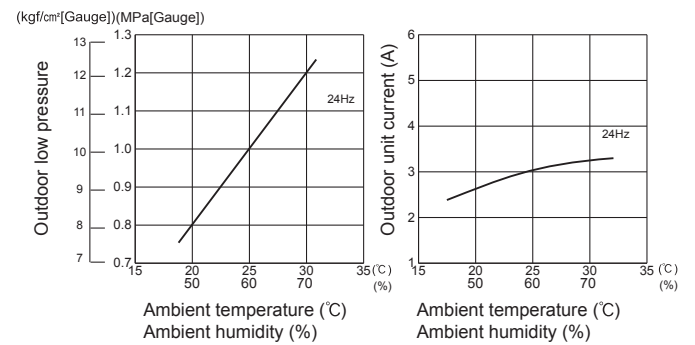


3. 20-class unit in single operation

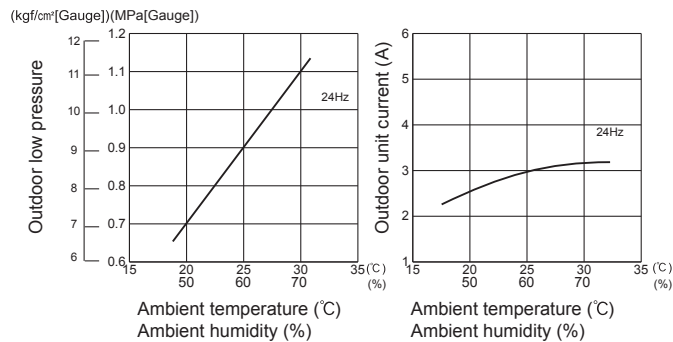


4. 22-class unit in single operation

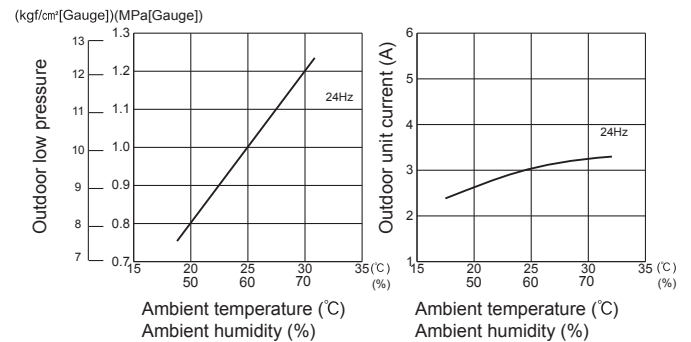

5. 25-class unit in single operation

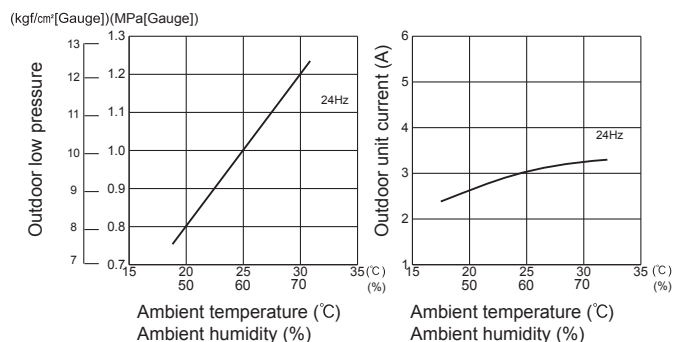


6. 35-class unit in single operation

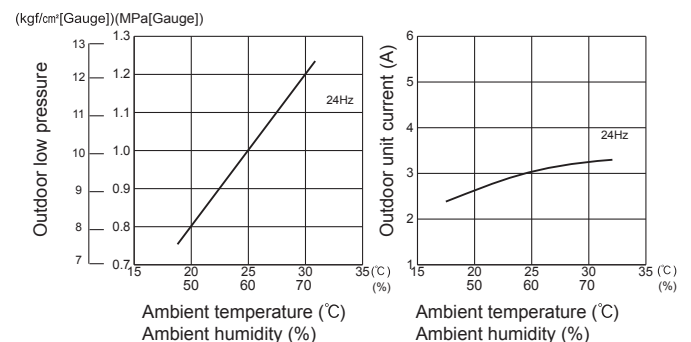


MXZ-4E83VA


7. 42-class unit in single operation

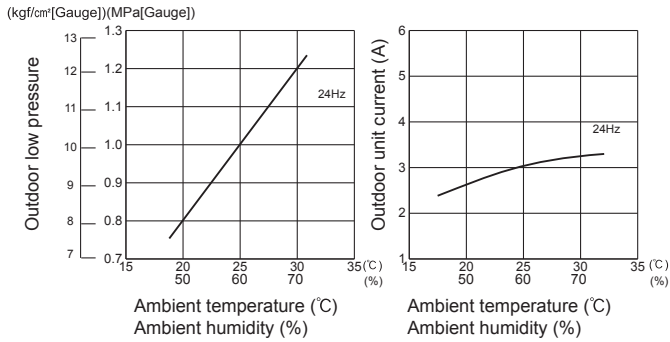


8. 50-class unit in single operation

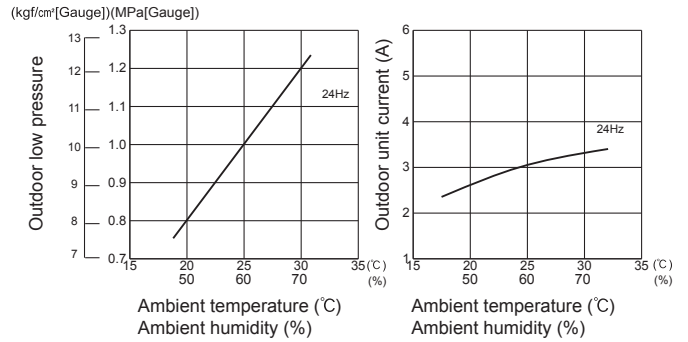

9. 60-class unit in single operation

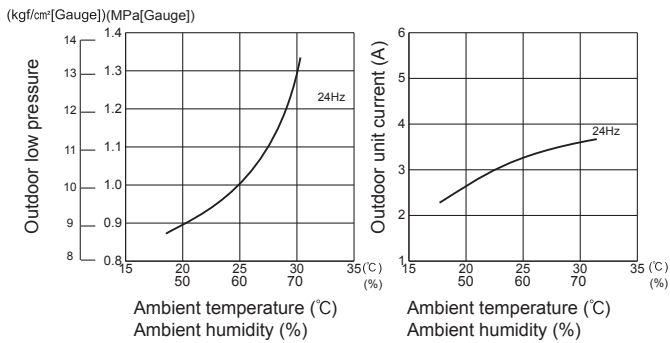


10. 71-class unit in single operation

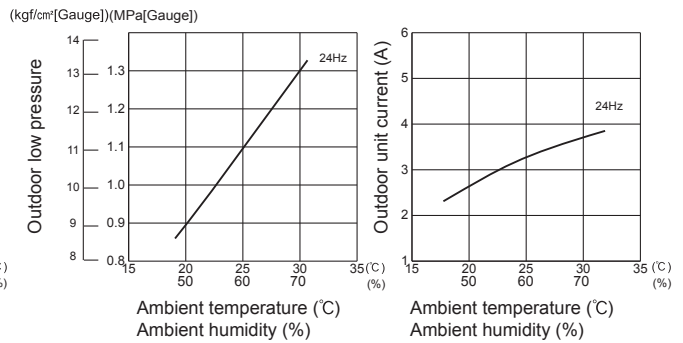


MXZ-5E102VA


1. 15-class unit in single operation

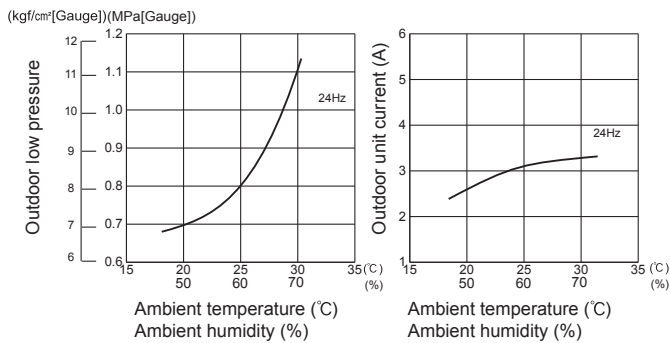


2. 18-class unit in single operation

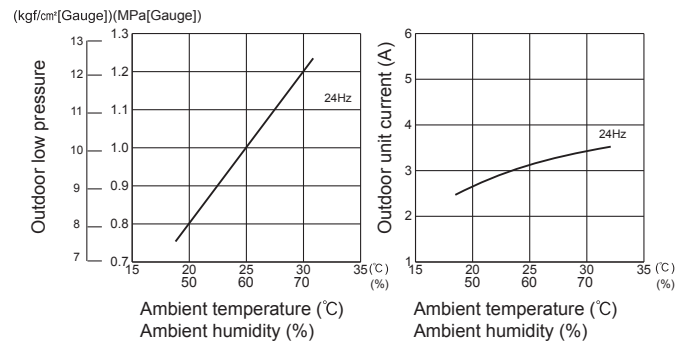

3. 20-class unit in single operation

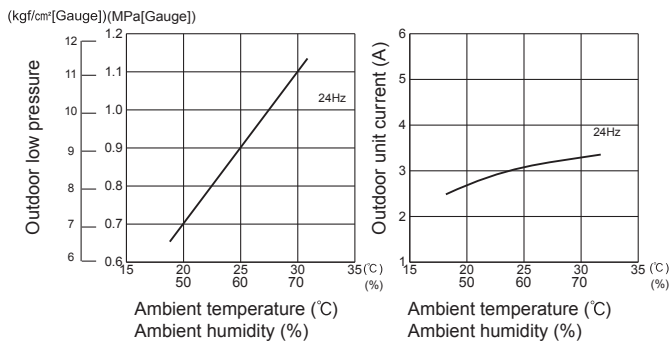


4. 22-class unit in single operation

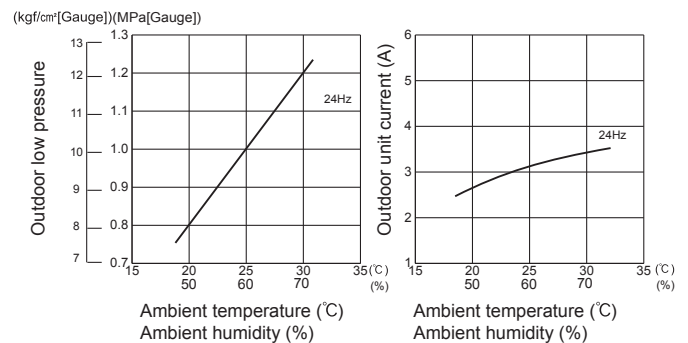


MXZ-5E102VA


5. 25-class unit in single operation

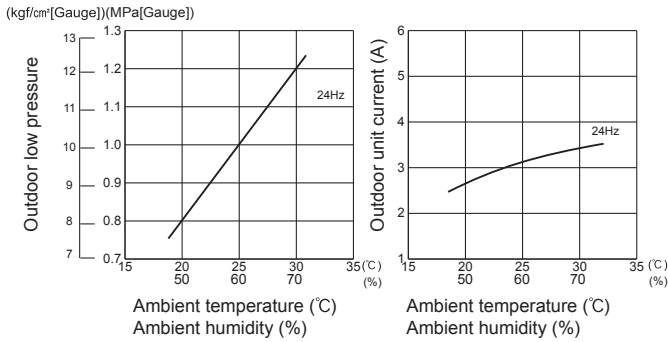


6. 35-class unit in single operation

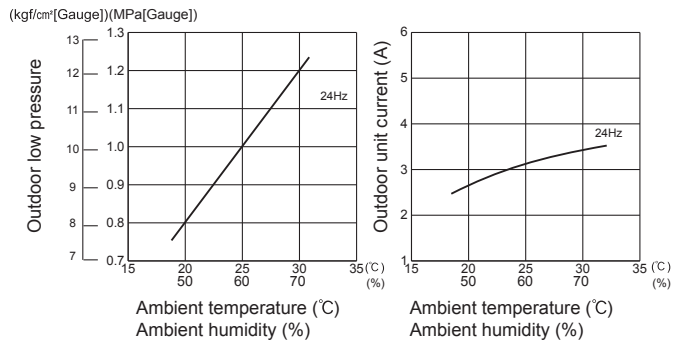


7. 42-class unit in single operation

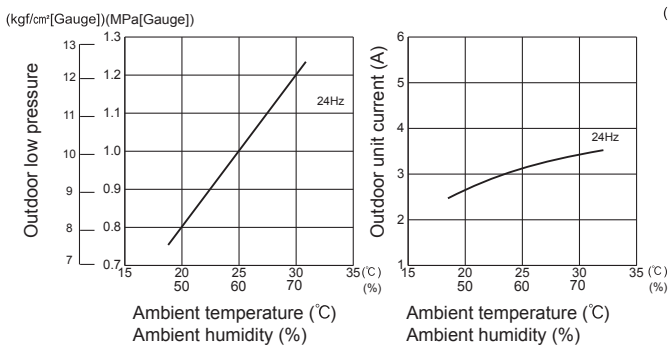


8. 50-class unit in single operation

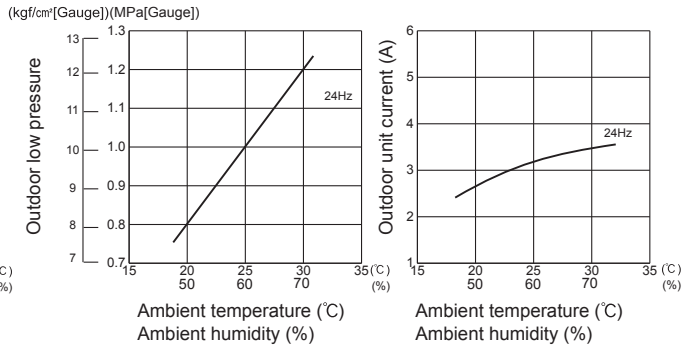

9. 60-class unit in single operation

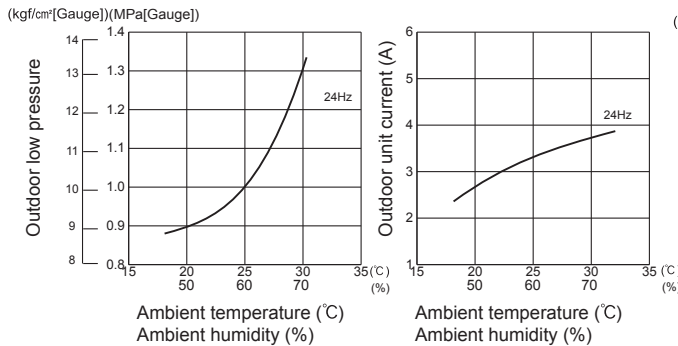


10. 71-class unit in single operation

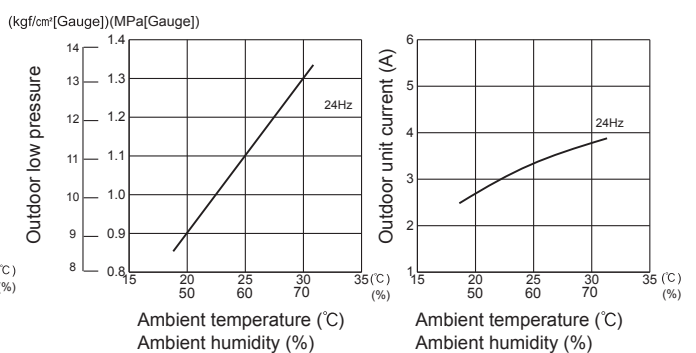


MXZ-6D122VA2

1. 15-class unit in single operation

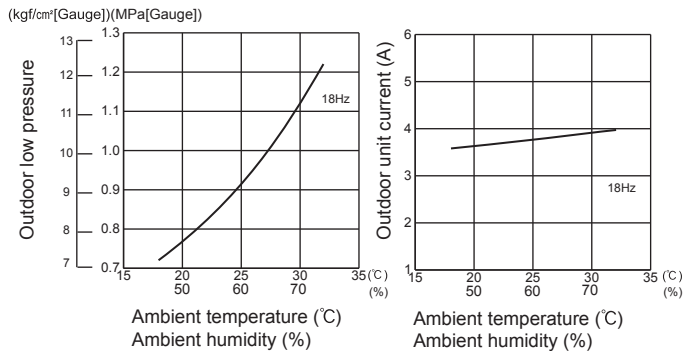


2. 18-class unit in single operation

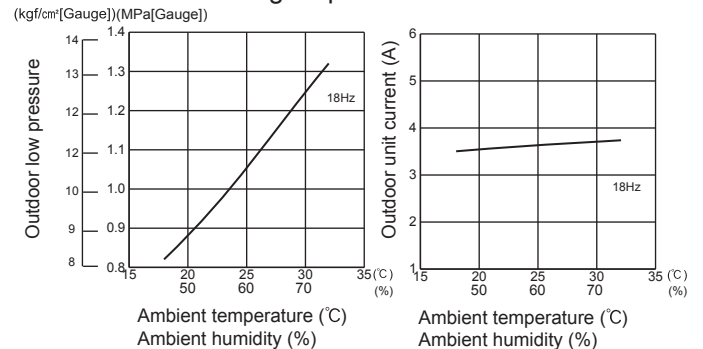


MXZ-6D122VA2


3. 20-class unit in single operation

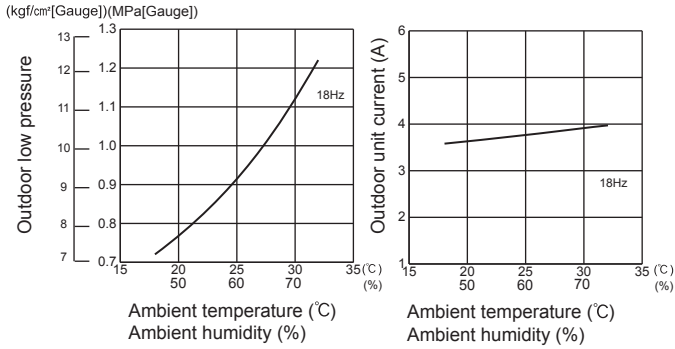


4. 22-class unit in single operation

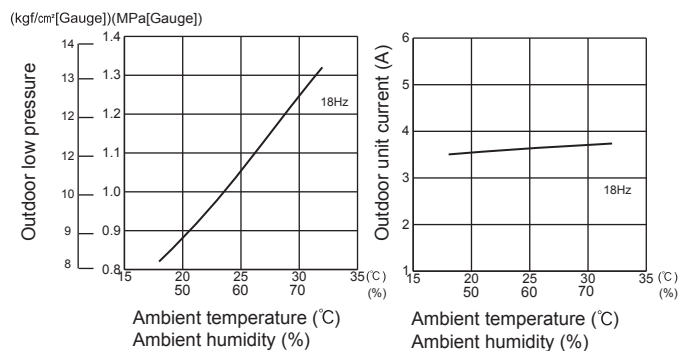


5. 25-class unit in single operation

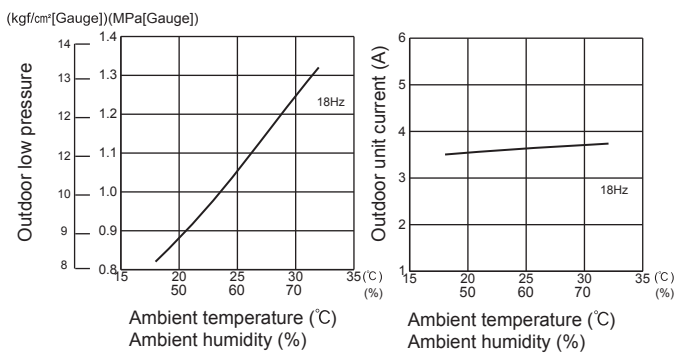


6. 35-class unit in single operation

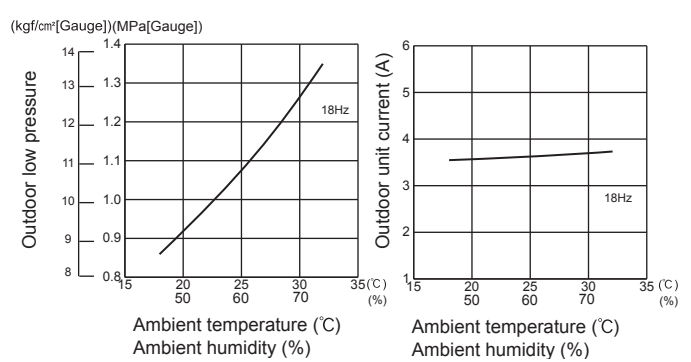


7. 42-class unit in single operation

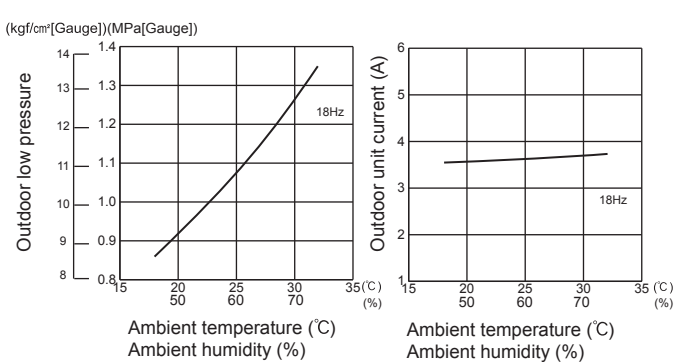


8. 50-class unit in single operation

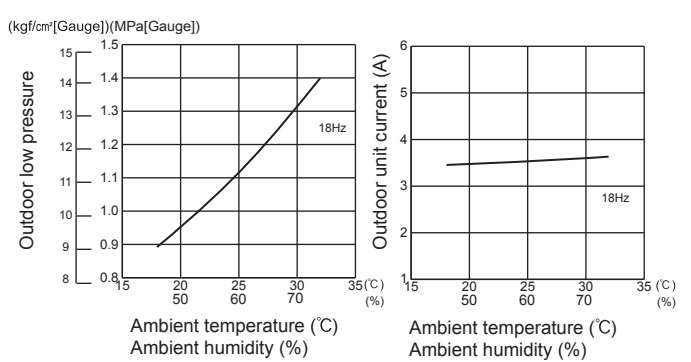

9. 60-class unit in single operation

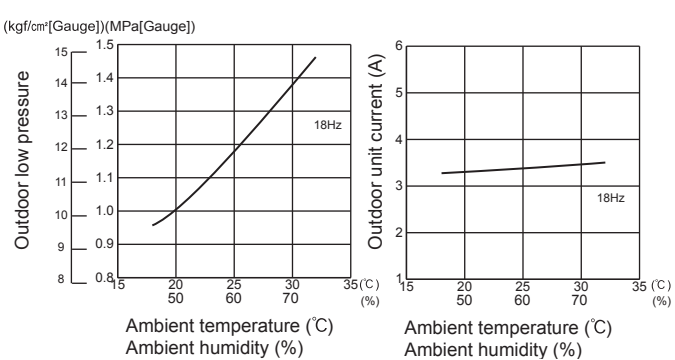


10. 71-class unit in single operation

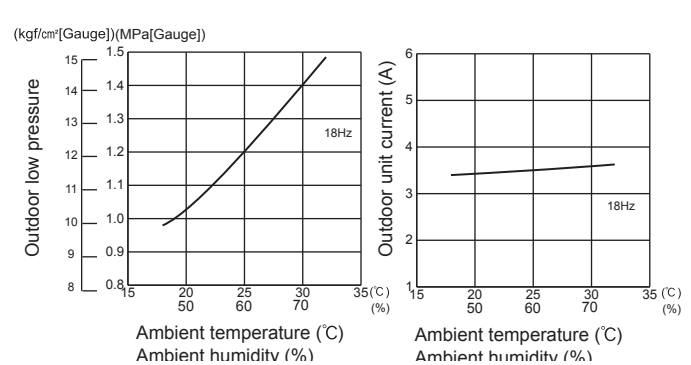


MXZ-2DM40VA

1. 25-class unit in single operation

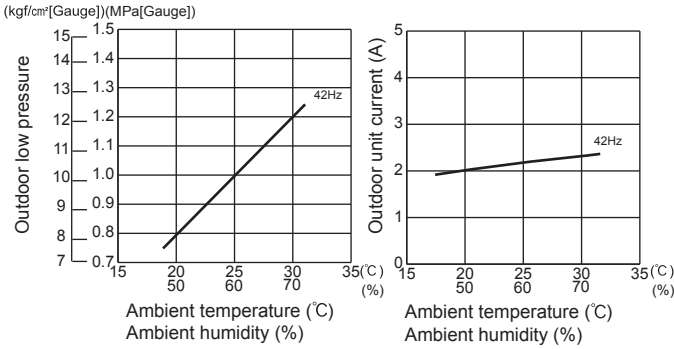


2. 35-class unit in single operation

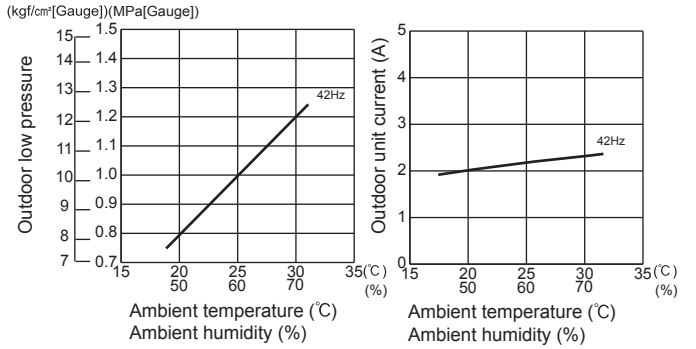


MXZ-3DM50VA


1. 25-class unit in single operation

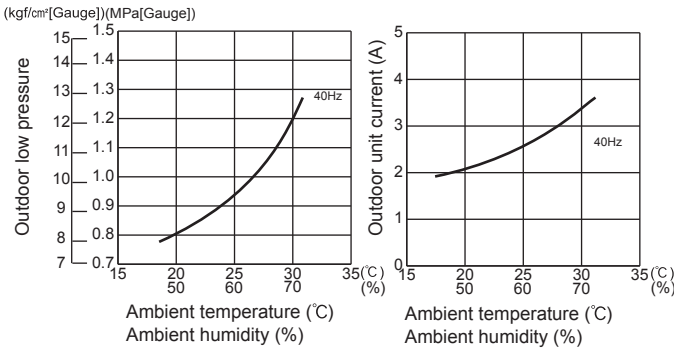

2. 35-class unit in single operation

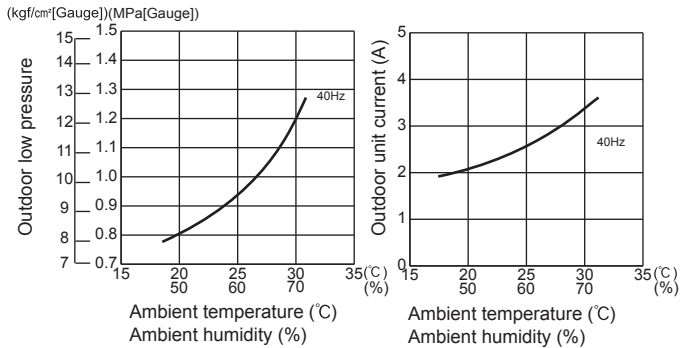


3. 50-class unit in single operation

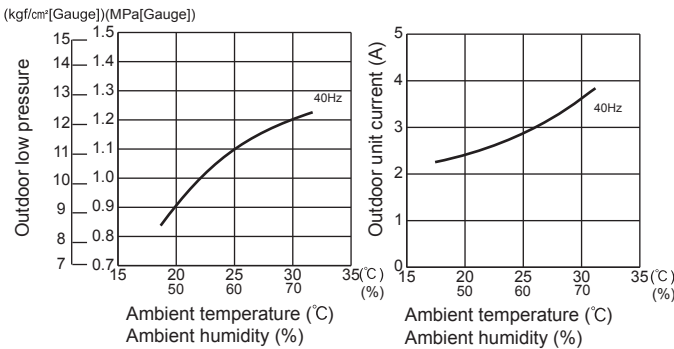


MXZ-2HA40VF

1. 25-class unit in single operation

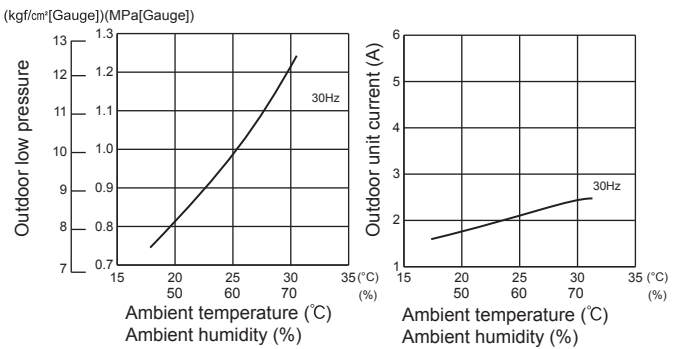


2. 35-class unit in single operation

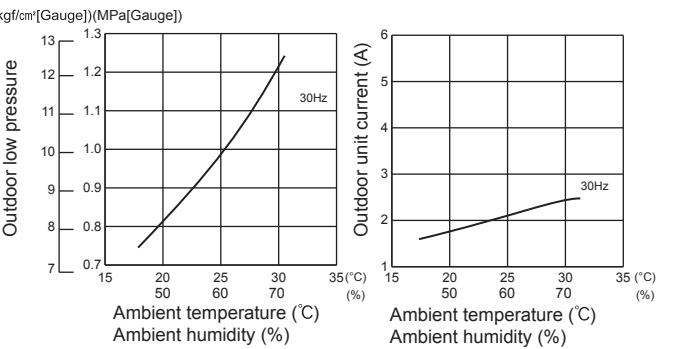


MXZ-2HA50VF


1. 25-class unit in single operation

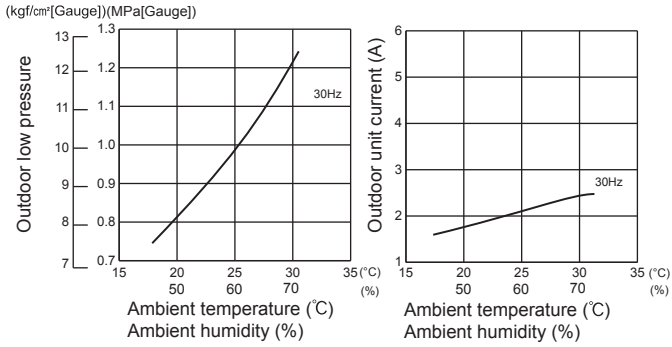

2. 35-class unit in single operation

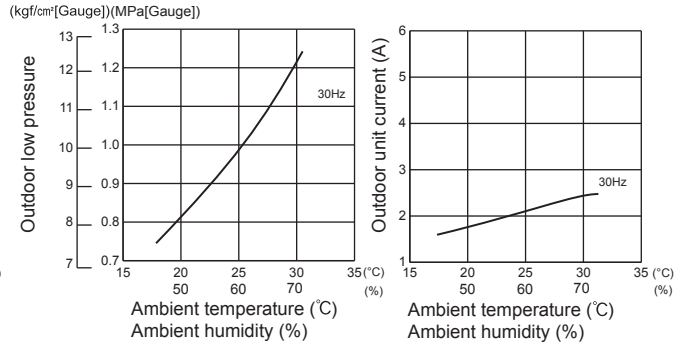


3. 42-class unit in single operation

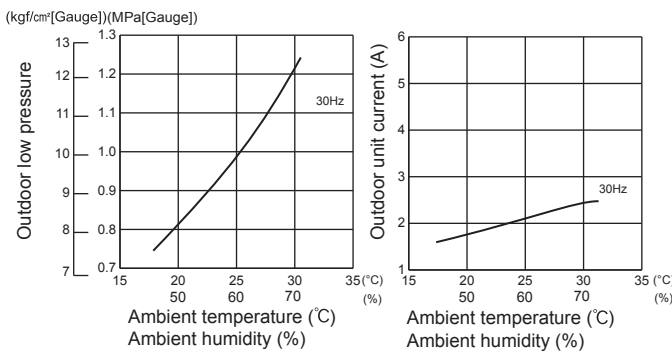


MXZ-3HA50VF


1. 25-class unit in single operation

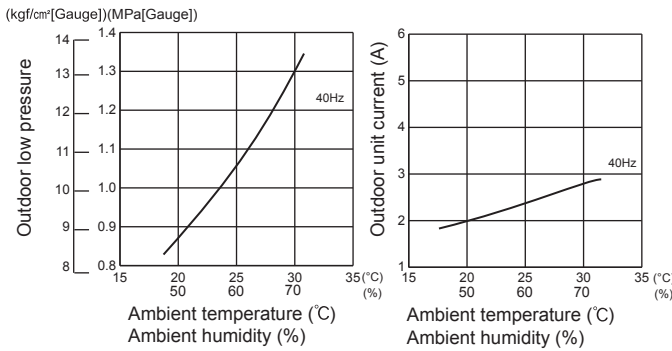


2. 35-class unit in single operation

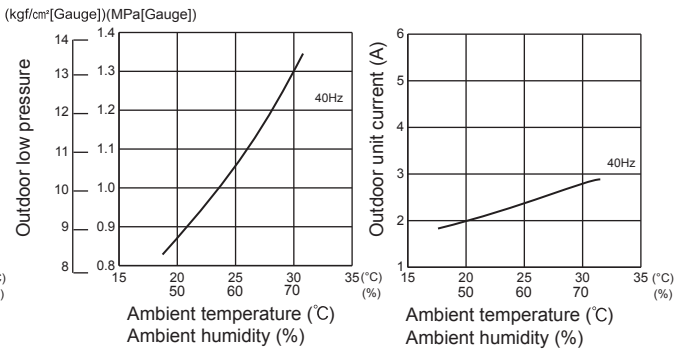

3. 42-class unit in single operation

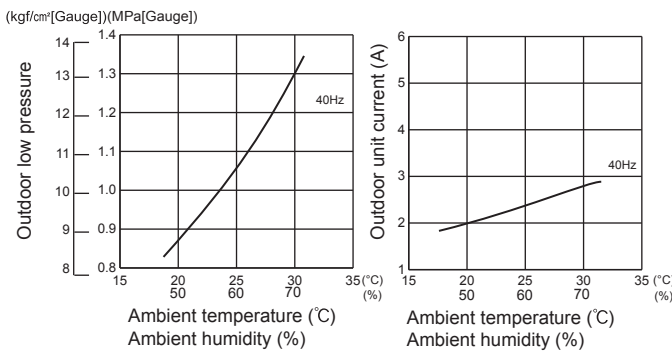


4. 50-class unit in single operation

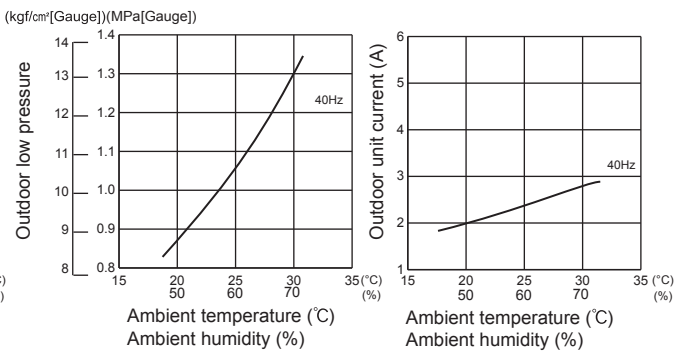


MXZ-2E53VAHZ


1. 15-class unit in single operation

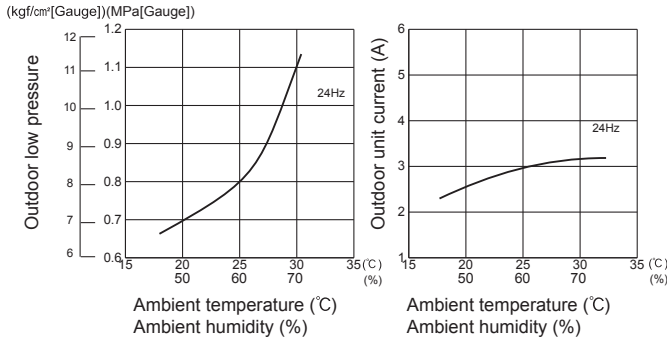


2. 18-class unit in single operation

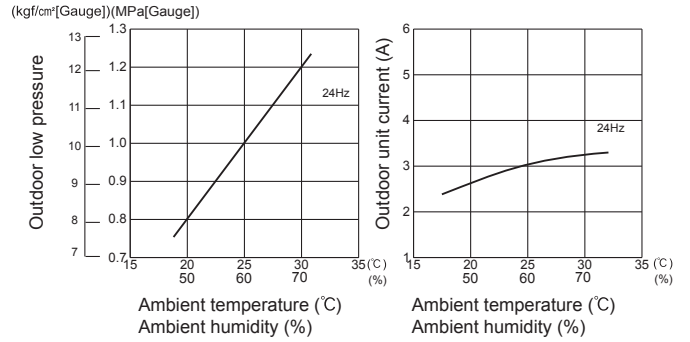


3. 20-class unit in single operation

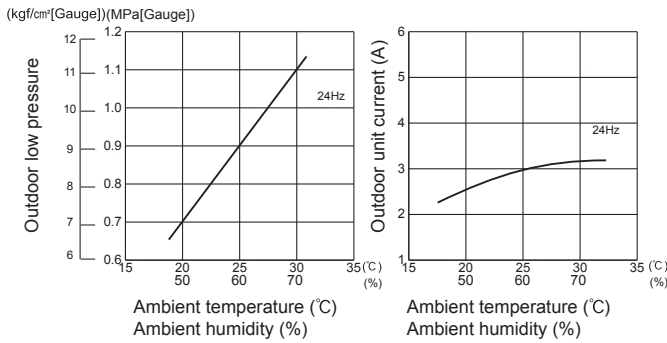


4. 22-class unit in single operation

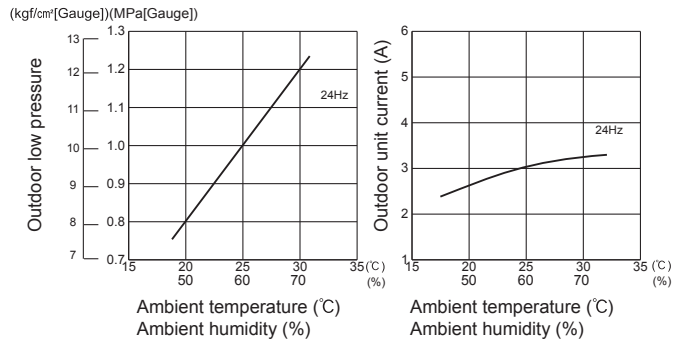


5. 25-class unit in single operation

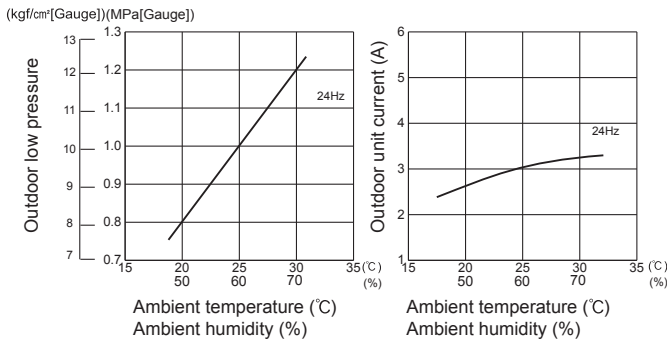


6. 35-class unit in single operation

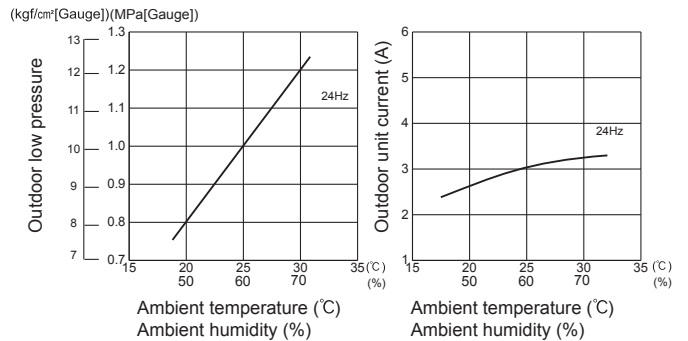

7. 42-class unit in single operation

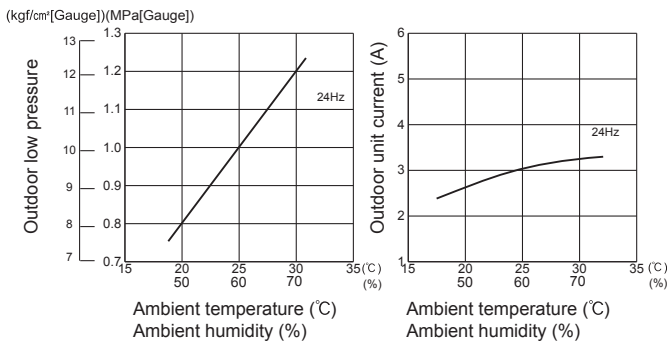


8. 50-class unit in single operation

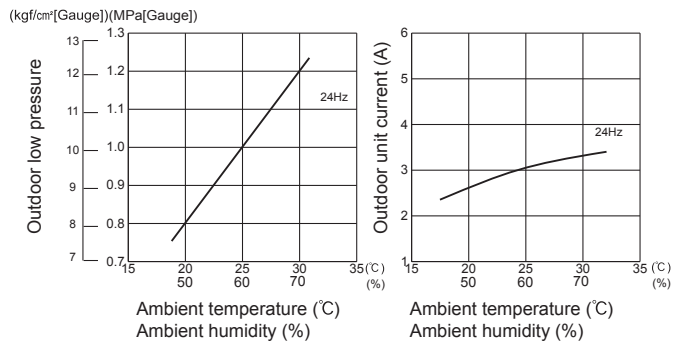


MXZ-4E83VAHZ


1. 15-class unit in single operation

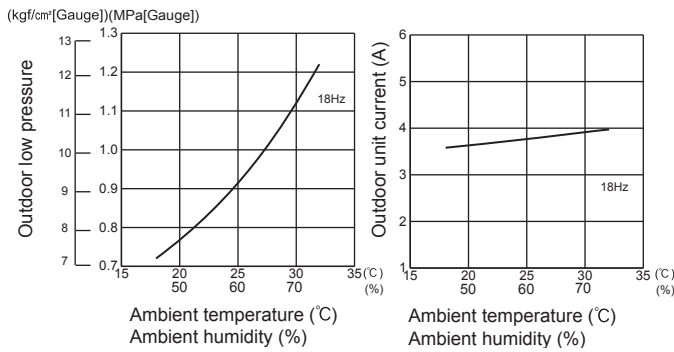


2. 18-class unit in single operation

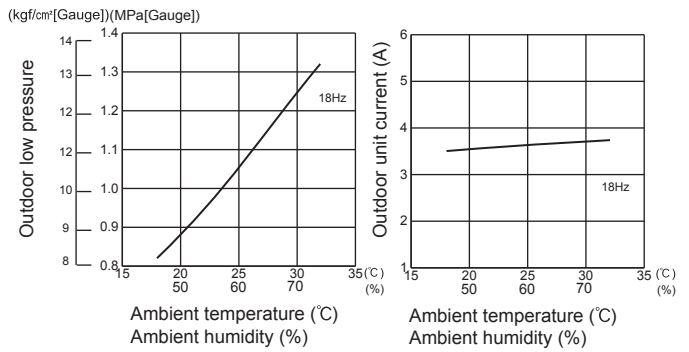


3. 20-class unit in single operation

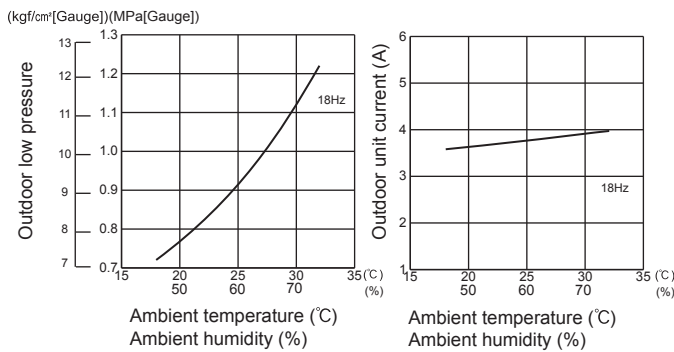


4. 22-class unit in single operation

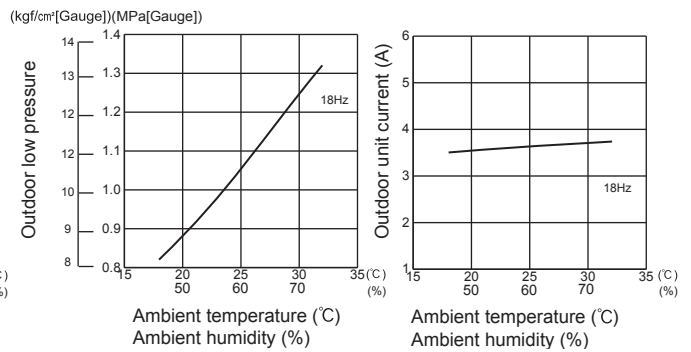


5. 25-class unit in single operation

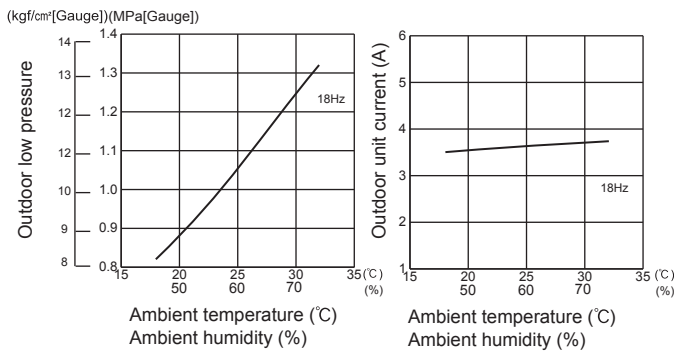


6. 35-class unit in single operation

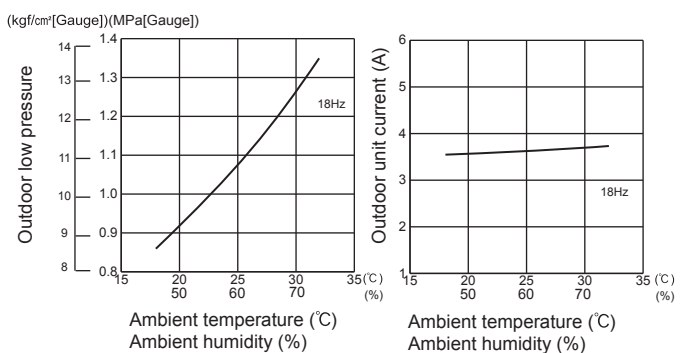

7. 42-class unit in single operation

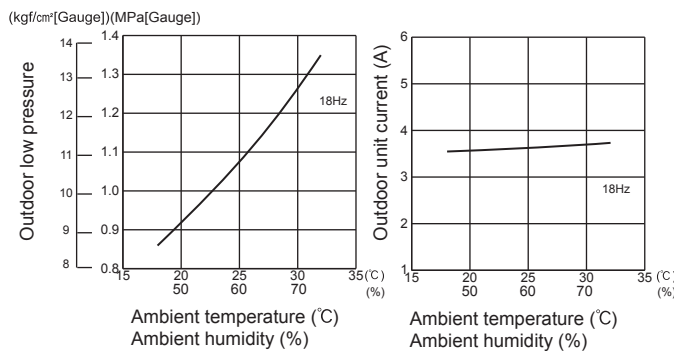


8. 50-class unit in single operation

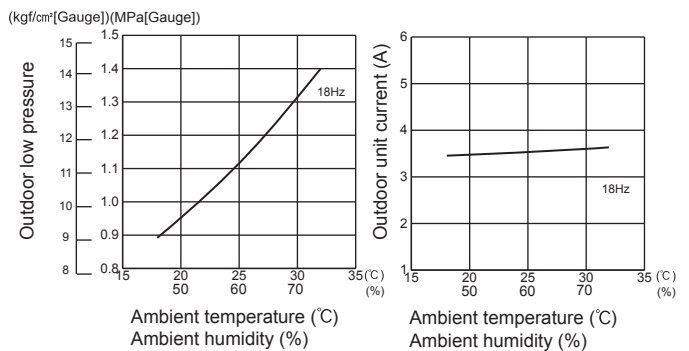


PERFORMANCE CURVES MULTI SYSTEMS

MXZ-4E83VAHZ

9. 60-class unit in single operation

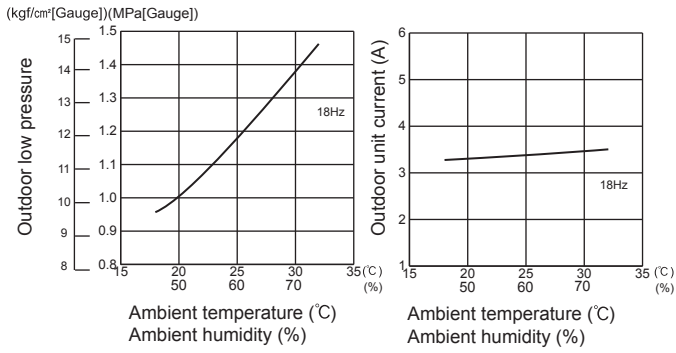

10. 71-class unit in single operation

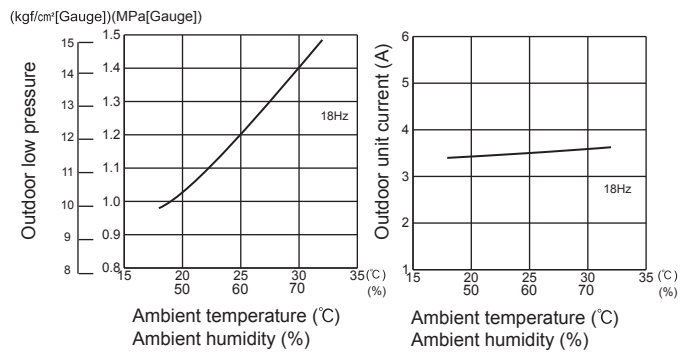

HEAT operation


① Condition:

	Indoor	Outdoor			
Dry bulb temperature (°C)	20.0	2	7	15	20.0
Wet bulb temperature (°C)	14.5	1	6	12	14.5


② Operation: TEST RUN OPERATION

MXZ-2F33VF


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation



4. 22-class unit in single operation




5. 25-class unit in single operation




MXZ-2F42VF


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation



5. 25-class unit in single operation




6. 35-class unit in single operation




MXZ-2F53VF MXZ-2F53VFH


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation



7. 42-class unit in single operation




8. 50-class unit in single operation




MXZ-3F54VF2


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation



5. 25-class unit in single operation




6. 35-class unit in single operation




MXZ-3F54VF2

7. 42-class unit in single operation




8. 50-class unit in single operation




MXZ-3F68VF2 MXZ-4F72VF2


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation




7. 42-class unit in single operation



8. 50-class unit in single operation




9. 60-class unit in single operation




MXZ-4F80VF2


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation




7. 42-class unit in single operation



8. 50-class unit in single operation




9. 60-class unit in single operation




MXZ-2D33VA


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation



4. 22-class unit in single operation




5. 25-class unit in single operation




MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation



7. 42-class unit in single operation




8. 50-class unit in single operation




MXZ-3E54VA


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation

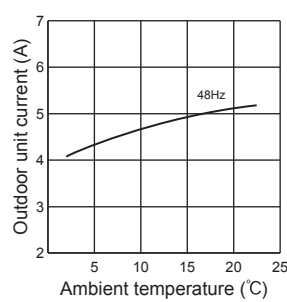


6. 35-class unit in single operation

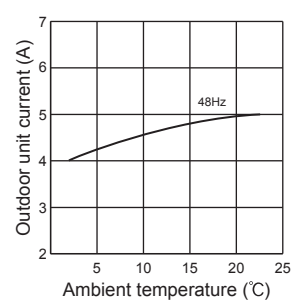

7. 42-class unit in single operation




8. 50-class unit in single operation

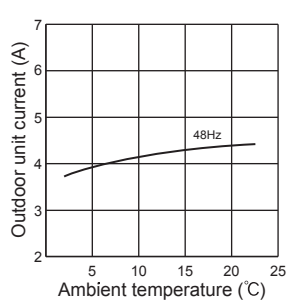


MXZ-3E68VA MXZ-4E72VA


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation



5. 25-class unit in single operation




6. 35-class unit in single operation




MXZ-3E68VA MXZ-4E72VA


7. 42-class unit in single operation



8. 50-class unit in single operation




9. 60-class unit in single operation




MXZ-4E83VA


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation




7. 42-class unit in single operation




8. 50-class unit in single operation



9. 60-class unit in single operation




10. 71-class unit in single operation




MXZ-5E102VA


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation




7. 42-class unit in single operation




8. 50-class unit in single operation



9. 60-class unit in single operation




10. 71-class unit in single operation




MXZ-6D122VA2


1. 15-class unit in single operation




2. 20-class unit in single operation




3. 18-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation




7. 42-class unit in single operation




8. 50-class unit in single operation



9. 60-class unit in single operation



10. 71-class unit in single operation





PERFORMANCE CURVES
MULTI SYSTEMS

MXZ-2DM40VA

1. 25-class unit in single operation

2. 35-class unit in single operation






MXZ-3DM50VA

1. 25-class unit in single operation

2. 35-class unit in single operation



3. 50-class unit in single operation



MXZ-2HA40VF

1. 25-class unit in single operation

2. 35-class unit in single operation






MXZ-2HA50VF

1. 25-class unit in single operation


2. 35-class unit in single operation

3. 42-class unit in single operation




MXZ-3HA50VF


1. 25-class unit in single operation




2. 35-class unit in single operation



3. 42-class unit in single operation




4. 50-class unit in single operation




MXZ-2E53VAHZ


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation



7. 42-class unit in single operation




8. 50-class unit in single operation




MXZ-4E83VAHZ


1. 15-class unit in single operation




2. 18-class unit in single operation




3. 20-class unit in single operation




4. 22-class unit in single operation




5. 25-class unit in single operation




6. 35-class unit in single operation




7. 42-class unit in single operation




8. 50-class unit in single operation



9. 60-class unit in single operation



10. 71-class unit in single operation




C.4.6 NOISE CRITERIA CURVES

C.4.6.1 Inverter Heat Pump


MXZ-2F33VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	49	●—●
High	Heating	50	○—○

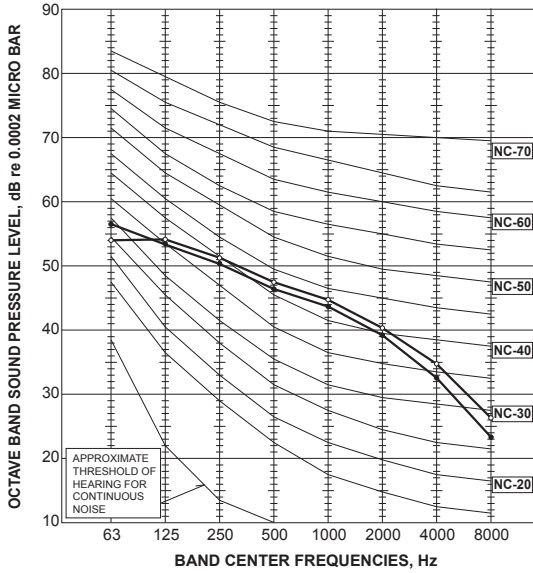


MXZ-2F42VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	44	●—●
High	Heating	50	○—○

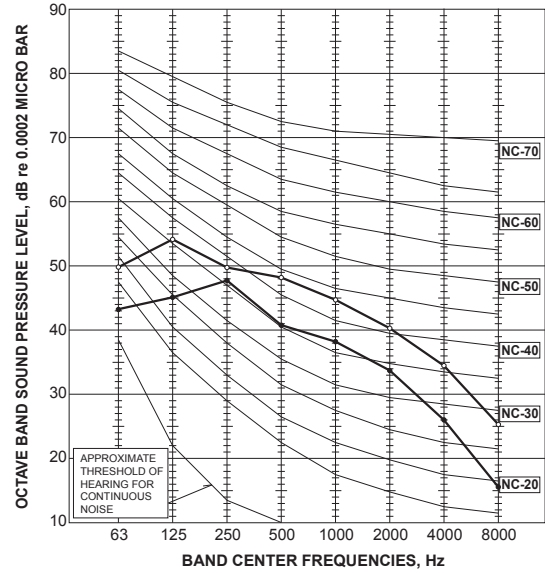


MXZ-2F53VF MXZ-2F53VFH

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	46	●—●
High	Heating	51	○—○

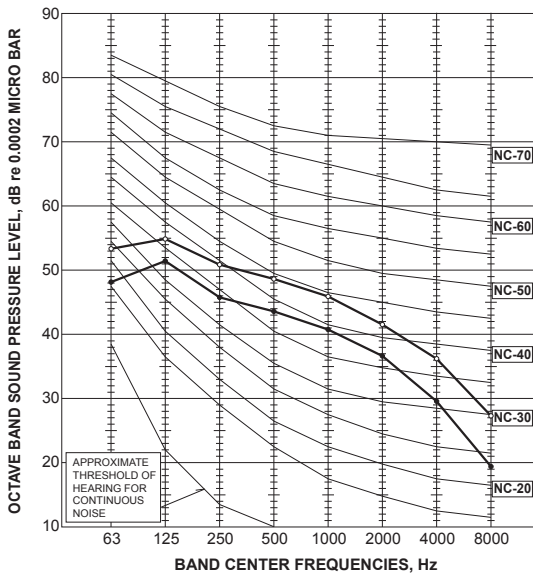

MXZ-3F54VF2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	46	●—●
High	Heating	50	○—○

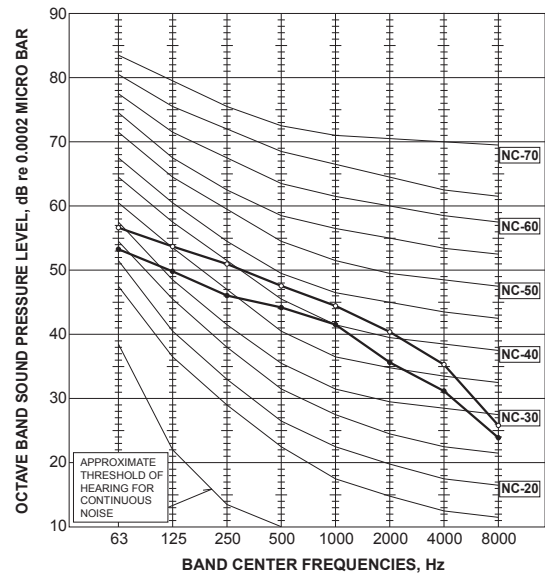


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


MXZ-3F68VF2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	48	●—●
High	Heating	53	○—○

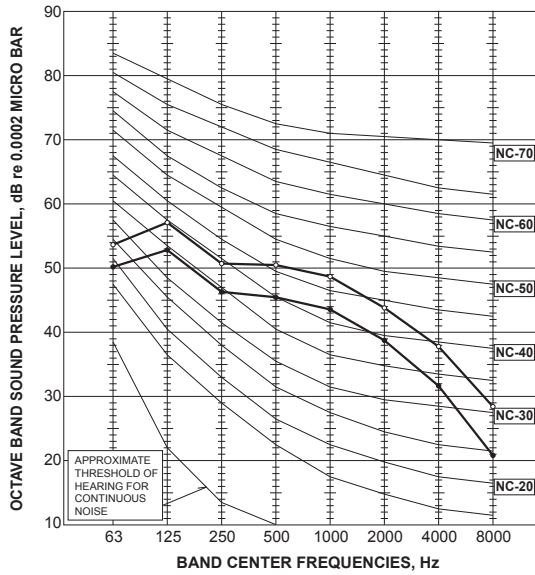


MXZ-4F72VF2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	48	●—●
High	Heating	54	○—○

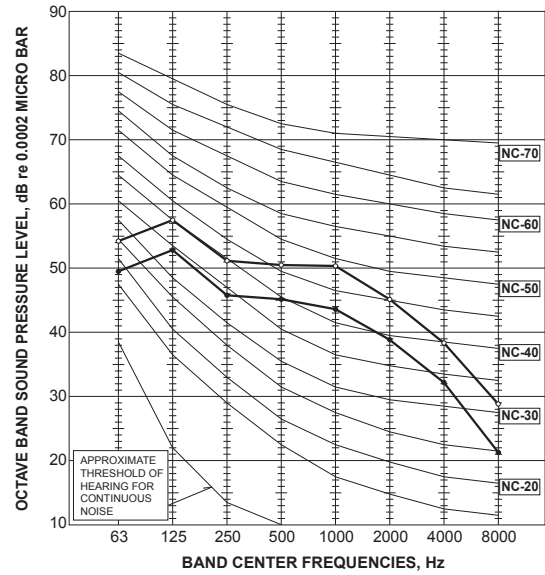

MXZ-4F80VF2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	50	●—●
High	Heating	55	○—○

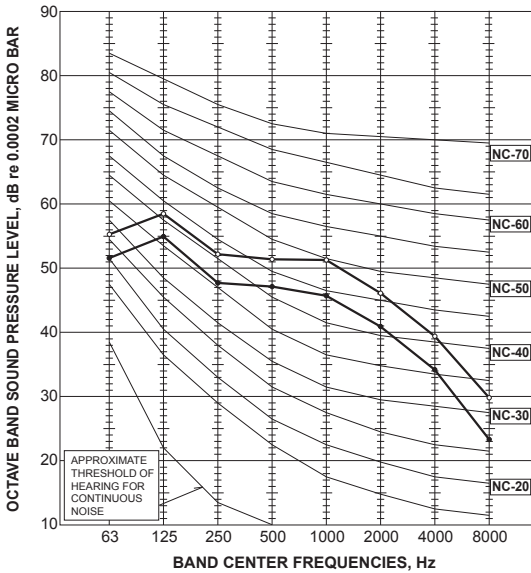


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


MXZ-2D33VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	49	●—●
High	Heating	50	○—○

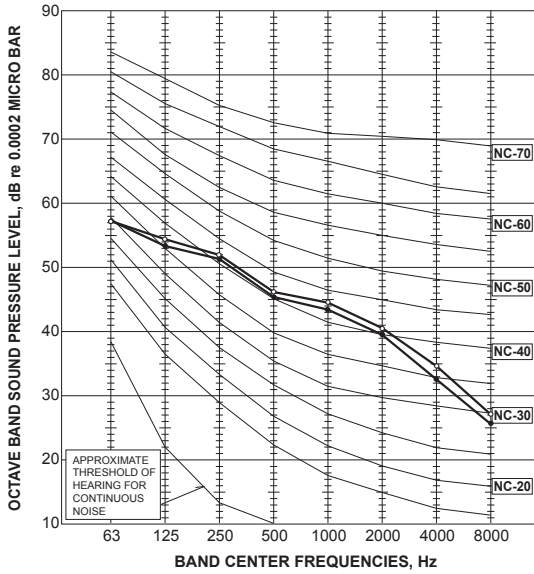


MXZ-2D42VA2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	46	●—●
High	Heating	51	○—○

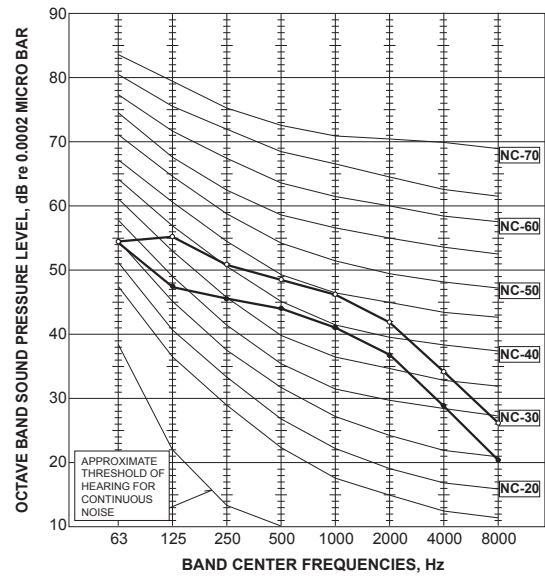


MXZ-2D53VA2
MXZ-2D53VAH2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	50	●—●
High	Heating	53	○—○

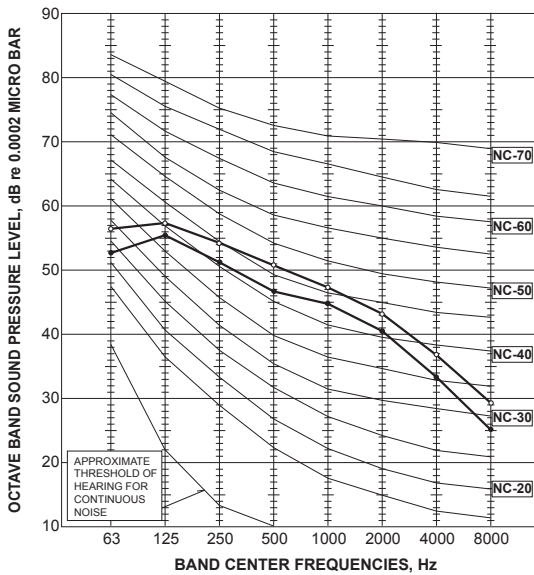

MXZ-3E54VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	50	●—●
High	Heating	53	○—○

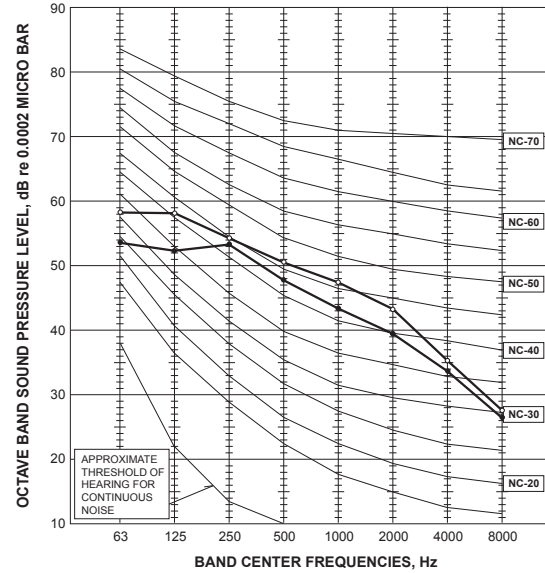


NOISE CRITERIA CURVES MULTI SYSTEMS

<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


MXZ-3E68VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	50	●—●
High	Heating	53	○—○

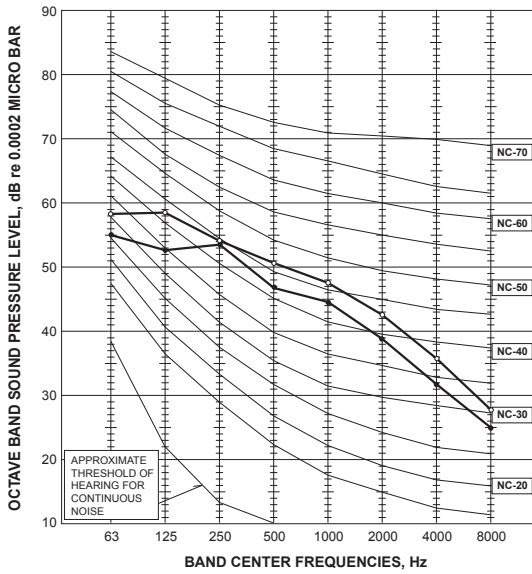


MXZ-4E72VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	50	●—●
High	Heating	53	○—○

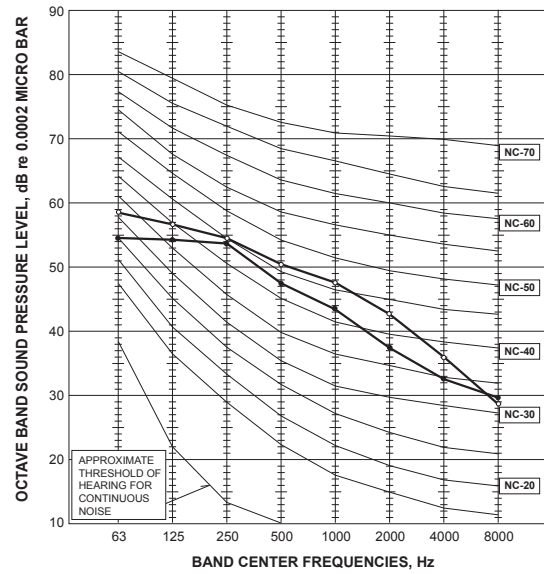


MXZ-4E83VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	49	●—●
High	Heating	51	○—○

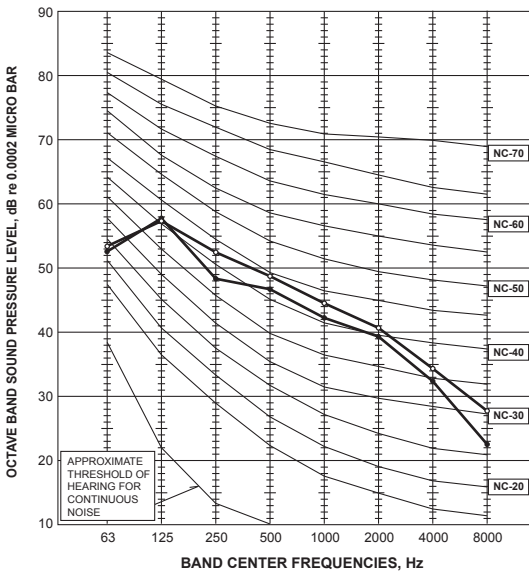

MXZ-5E102VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	52	●—●
High	Heating	56	○—○

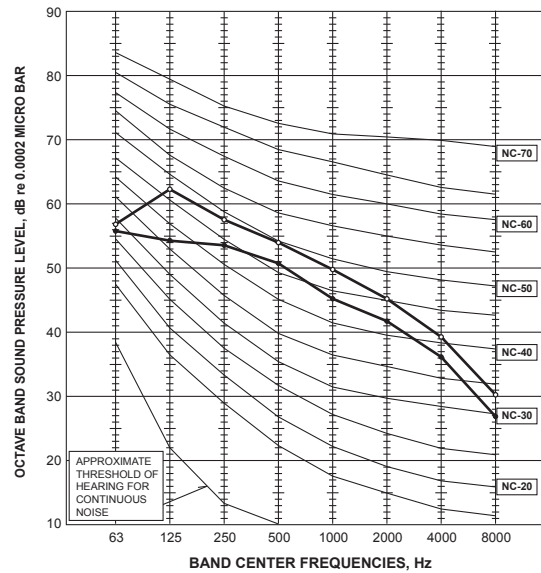


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

MXZ-6D122VA2

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	55	●—●
High	Heating	57	○—○

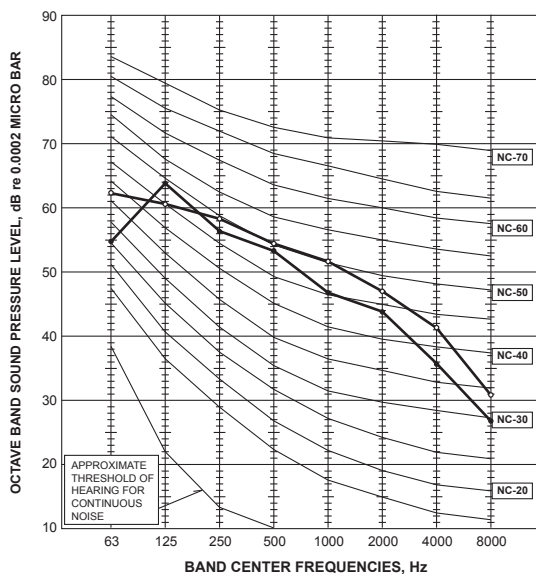


NOISE CRITERIA CURVES
MULTI SYSTEMS

<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


MXZ-2DM40VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	48	●—●
High	Heating	52	○—○

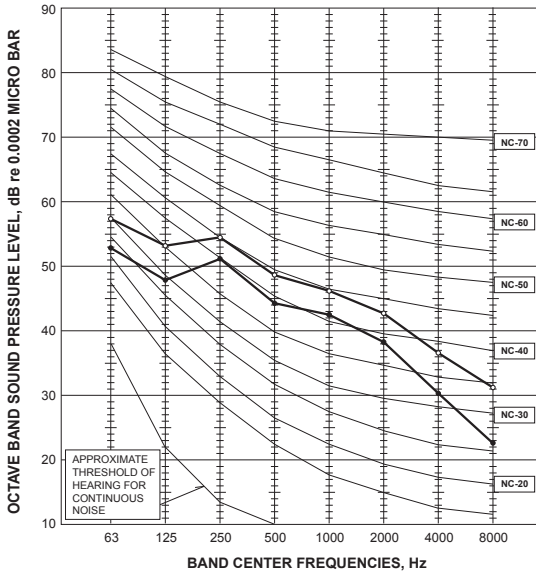


MXZ-3DM50VA

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	50	●—●
High	Heating	53	○—○

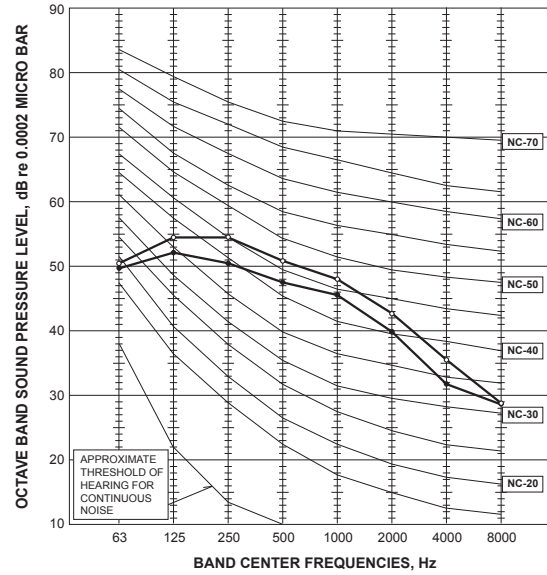


MXZ-2HA40VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	44	●—●
High	Heating	50	○—○

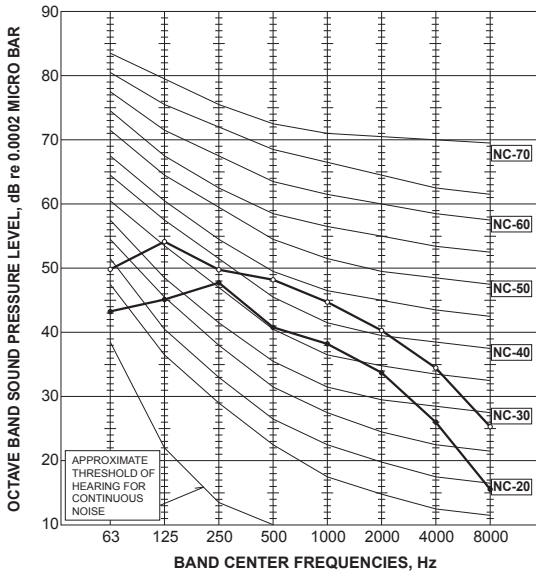

MXZ-2HA50VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	47	●—●
High	Heating	51	○—○

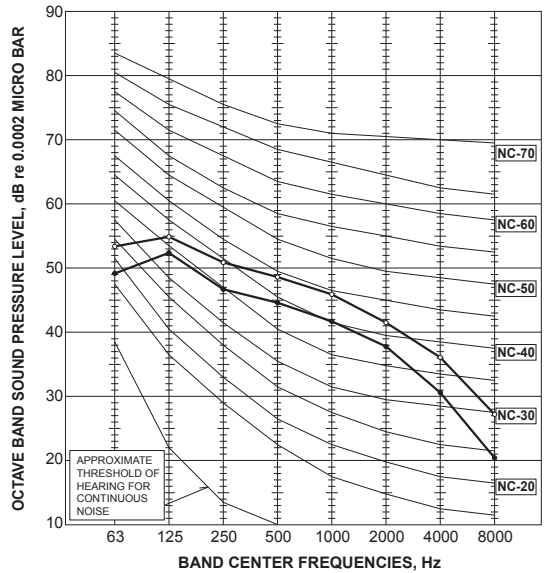


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


MXZ-3HA50VF

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	46	●—●
High	Heating	50	○—○

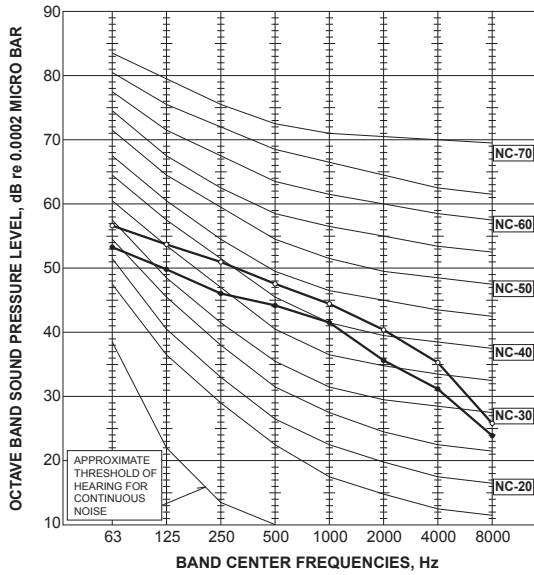



MXZ-2E53VAHZ

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	45	●—●
High	Heating	47	○—○

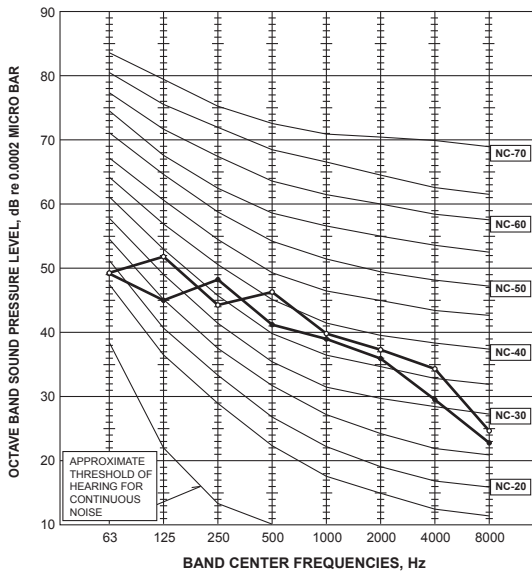

MXZ-4E83VAHZ

FAN SPEED	FUNCTION	SPL(dB(A))	LINE
High	Cooling	53	●—●
High	Heating	57	○—○

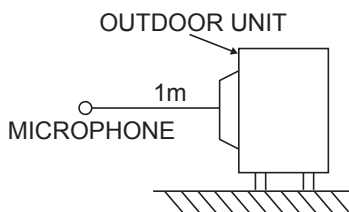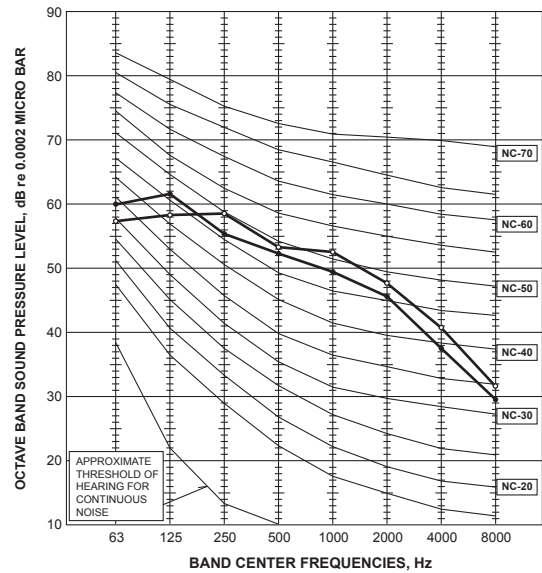

Test conditions

Cooling :Dry-bulb temperature 35°C Wet-bulb temperature 24°C
 Heating :Dry-bulb temperature 7°C Wet-bulb temperature 6°C

<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

C.4.7 ACTUATOR CONTROL

C.4.7.1 MXZ Series

MXZ-2D33VA MXZ-2D42VA2 MXZ-2D53VA2 MXZ-2D53VAH2

MXZ-6D122VA2

MXZ-2F33VF MXZ-2F42VF MXZ-2F53VF MXZ-2F53VFH

MXZ-2DM40VA MXZ-3DM50VA MXZ-2HA40VF MXZ-2HA50VF

Relation between main sensor and actuator

Sensor	Purpose	Actuator				
		Compressor	LEV	Outdoor fan motor	R.V. coil	Defrost heater ※1
Discharge temperature thermistor	Protection	○	○			
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				
	Heating: High pressure protection	○	○			
Defrost thermistor	Heating: Defrosting	○	○	○	○	
Fin temperature thermistor	Protection	○		○		
Ambient temperature thermistor	Control/Protection	○	○	○		
	Heating: Defrosting (Heater)					○
Outdoor heat exchanger temperature thermistor	Cooling: Control/Protection	○	○	○		
Capacity code	Control	○	○			

※1 MXZ-2D53VAH2, MXZ-2F53VFH

MXZ-3E54VA MXZ-3E68VA MXZ-4E72VA

MXZ-3F54VF2 MXZ-3F68VF2 MXZ-4F72VF2 MXZ-4F80VF2

MXZ-4E83VA MXZ-5E102VA MXZ-2E53VAHZ MXZ-4E83VAHZ

MXZ-3HA50VF

Relation between main sensor and actuator

Sensor	Purpose	Actuator					
		Compressor	LEV	Outdoor fan motor	4-way valve	2-way solenoid valve ※1	Defrost heater ※2
Discharge temperature thermistor	Protection	○	○			○	
Indoor coil temperature thermistor	Cooling: Coil frost prevention	○				○	
	Heating: High pressure protection	○	○				
Defrost thermistor	Heating: Defrosting	○	○	○	○		
Fin temperature thermistor	Protection	○		○			
Ambient temperature thermistor	Control/Protection	○	○	○		○	
	Heating: Defrosting (Heater)						○
Outdoor heat exchanger temperature thermistor	Cooling: Control/Protection	○	○	○		○	
Capacity code	Control	○	○				


※1 MXZ-4E83VAHZ

※2 MXZ-2E53VAHZ, MXZ-4E83VAHZ


C.4.8 CAPACITY CORRECTION RATIO CURVE FOR PIPING LENGTH

C.4.8.1 MXZ-2D/6D, MXZ-2E/3E/4E/5E, MXZ-2F/3F/4F, MXZ-2DM/3DM, MXZ-2HA/3HA

Correction ratio of capacity according to the length of piping (cooling)

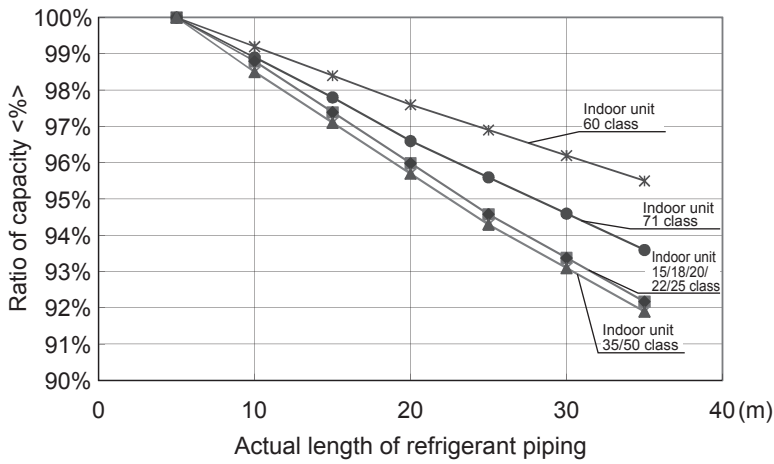

Correction ratio of capacity according to the length of piping (heating)

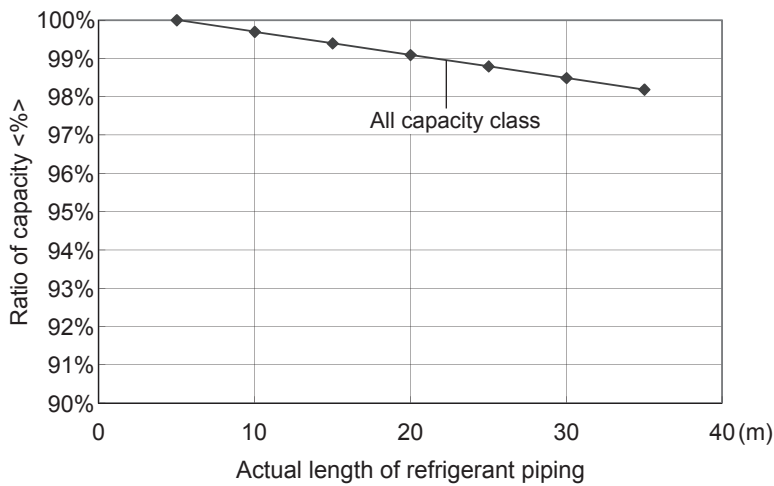

The length intended for the capacity calculation, which counts the length of refrigerant piping and the number of bends, is called actual length.

[Length of refrigerant piping (m) + (Number of bends × 0.3 m) = Actual length of refrigerant piping (m)]