

BC CONTROLLERS

CMB-M104/106V-J1

CITY MULTI


R32 

At the heart of both the R2 and WR2 Series, the BC controller makes simultaneous heating and cooling possible. Improved system efficiency is achieved when energy is transferred intelligently around the building.

Key Features:

- Allows unique 2-pipe heat recovery application
- Simultaneous heating and cooling
- Instructs the heat source unit/outdoor unit on the amount of refrigerant (liquid or gas) that is required to achieve the requested cooling or heating requirements
- Slim profile for more flexible installation
- Easy servicing and maintenance access through underside drain pan
- Brazed connections



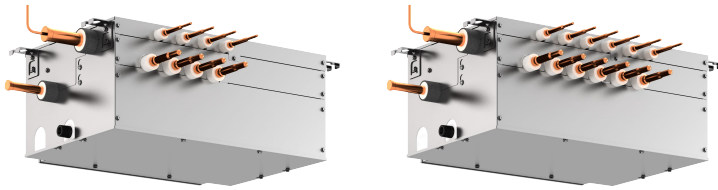


BC CONTROLLERS		CMB-M104V-J1	CMB-M106V-J1
NUMBER OF CONNECTIONS		4	6
WEIGHT (kg)		26	29
DIMENSIONS (mm)	Width	596	596
	Depth	476	476
	Height	250	250
ELECTRICAL SUPPLY		220-240v, 50Hz	220-240v, 50Hz
PHASE		Single	Single
POWER INPUT (kW)		0.076	0.11
RUNNING CURRENT (A)		0.34	0.48
FUSE RATING (BS88) - HRC (A)		6	6
MAINS CABLE NO. CORES		3	3


Note: CMB-M-V-J1 units are for use with PURY-EM200-300YNW-A1, PURY-M200-300YNW-A1, PURY-EP200-350YNW-A, PURY-P200-350YNW-A & PORY-P200-300YLM-A units only.

CMB-M104/106V-J1 DIMENSIONS

UPPER VIEW

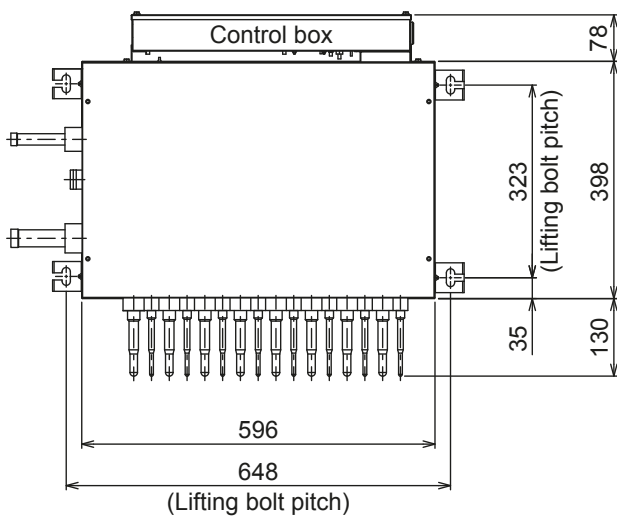


SIDE VIEW

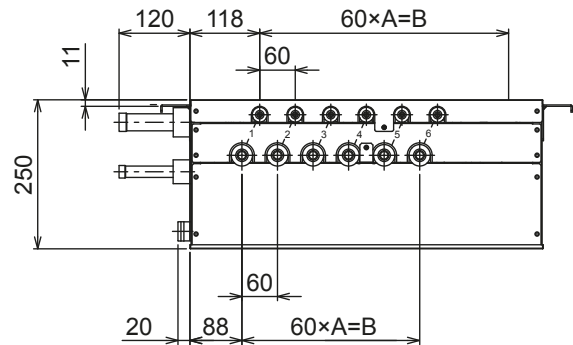

	A	B
CMB-M104V-J1	3	180
CMB-M106V-J1	5	300



Telephone: 01707 282880
 email: air.conditioning@meuk.mee.com
les.mitsubishielectric.co.uk



UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. Telephone: 01707 282880 Fax: 01707 278881
 IRELAND Mitsubishi Electric Europe, Westgate Business Park, Ballymount, Dublin 24, Ireland. Telephone: (01) 419 8890 Fax: (01) 419 8890 International code: (003531)

Country of origin: United Kingdom - Japan - Thailand - Malaysia. ©Mitsubishi Electric Europe 2019. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: The fuse rating is for guidance only. Please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R32 (GWP:675), R407C (GWP:1774) or R134a (GWP:1430). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows. R410A (GWP:1975), R32 (GWP:550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of November 2019

