



The **MAC-567IF** provides remote cloud control and monitoring via MELCloud for Ecodan FTC5, either locally or remotely by PC, Mac, Tablet or Smartphone via the Internet.

Key Features

- Wi-Fi interface for MELCloud solution
- New Wi-Fi app (access point) pairing

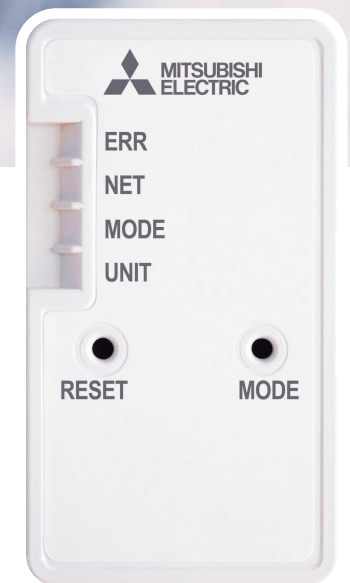


Air Conditioning | Heating
Ventilation | Controls

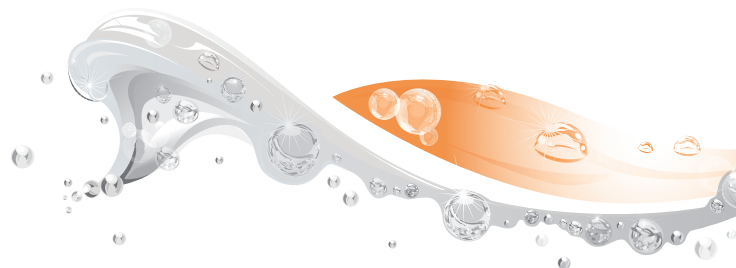

ecodan[®]
Renewable Heating Technology

WI-FI INTERFACE		MAC-567IF
DESCRIPTION		Wi-Fi Interface
CONNECT TO		Indoor Unit
MAX NUMBER OF UNITS		1
COMPATIBILITY		Ecodan FTC5
POWER SUPPLY		From indoor unit
DIMENSIONS (WXDXH) MM		79 x 18.5 x 44
CONTROL	On/Off	✓
	Mode	✓
	Heating Setpoint	✓
	Hot Water Boost	✓
	2-Zone Control	✓
	Holiday Mode	✓
	Timer	✓
	Frost Protection	✓
MONITOR	On/Off	✓
	Mode	✓
	Heating Setpoint	✓
	Tank Temperature	✓
	Tank Target Temperature	✓
	Outside Temperature	✓
	Fault Codes	✓
	Consumed Electrical Energy	✓
	Produced Heat Energy	✓


MAC-567IF

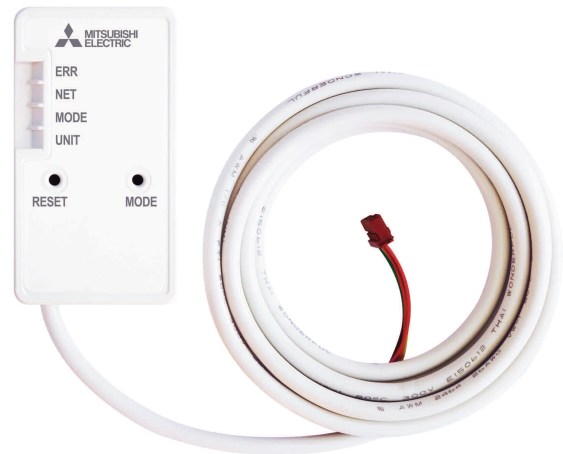

SYSTEM DIAGRAM



DIMENSIONS

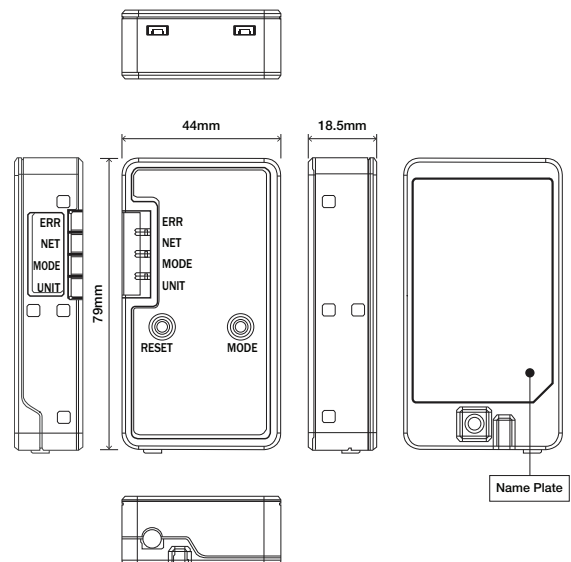

Telephone: 01707 282880
email: heating@meuk.mee.com web: heating.mitsubishielectric.co.uk

UNITED KINGDOM Mitsubishi Electric Europe Living Environmental Systems Division
Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England General Enquiries Telephone: 01707 282880 Fax: 01707 278881
IRELAND Mitsubishi Electric Europe Westgate Business Park, Ballymount, Dublin 24, Ireland
Telephone: Dublin (01) 419 8800 Fax: Dublin (01) 419 8890 International code: (003531)

Country of origin: United Kingdom – Japan – Thailand – Malaysia. ©Mitsubishi Electric Europe 2017. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.



Note: The fuse rating is for guidance only. Please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air-conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A(GWP:2088), R32(GWP:675), R407C (GWP:1774) or R134a (GWP:1430). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows: R410A(GWP:1975), R32(GWP: 550), R407C (GWP:1650) or R134a (GWP:1300).



www.greengateway.mitsubishielectric.co.uk

Mitsubishi Electric UK's commitment to the environment

Follow us @meuk_Jes
Follow us @green_gateway

Mitsubishi Electric
Living Environmental Systems UK

mitsubishielectric2

Effective as of August 2017