



Lossnay Energy Recovery Ventilator

MODELS:

LGH-15RVX3-E

LGH-25RVX3-E

LGH-35RVX3-E

LGH-50RVX3-E

LGH-65RVX3-E

LGH-80RVX3-E

LGH-100RVX3-E

LGH-160RVX3-E

LGH-200RVX3-E

Operating Instructions

For the user

Please read this manual carefully before use for proper and safe use.

Do not attempt to install the product by yourself.

1. Safety precautions


The following signs indicate that death or serious injury may be caused by failure to heed the precautions described below.

 WARNING		Incorrect handling could cause serious injury or death.
 Prohibited	Do not turn the unit on or off when flammable gas has leaked. It could catch fire or cause explosion with sparks released from electrical components. Open windows to ventilate.	
 Do not disassemble	Do not modify or disassemble. It could cause fire, electric shock or injury.	
 Do not wet	Do not apply water to the unit and remote controller. Electrical shock can result.	
 Do not touch	Do not poke your fingers or sticks into the air intake and outlet while the product is operating. Failure to heed this warning may result in injury.	
 Wet hands prohibited	Do not operate with wet hands. Electrical shock can result.	
 The instructions given must be followed.	Use the specified power supply and voltage. Use of incorrect power supply could cause fire or electric shock.	
	Make sure the power supply isolator is turned off before starting maintenance. It could cause electric shock or injury if it is turned on.	
	When any abnormal conditions (burning smell, water leakage or others) are observed, stop operation, turn off the power supply isolator and consult your dealer. Continuing operation under such conditions could cause, electric shock, fire, or damage.	
	Do not touch the product for at least 5 minutes after the power is shut off. Electrical shock can result.	


 CAUTION		Incorrect handling could cause injury or damage to property or household effects.
 Prohibited	Do not place a burning appliance in a place where it is exposed directly to the wind from Lossnay. It could cause an accident as a result of incomplete combustion.	
	Do not operate with the "BY-PASS" when heating the room in winter. Condensed water may drip from the unit and wet the surface of ceiling.	
	Do not use at a place where exposed to high temperatures (40°C or higher), naked flames, or in environment with heavy fumes. It could cause fire.	
	Do not use in an environment such as a chemical factory, where hazardous gases such as acidic gases, alkaline gases, organic solvent fumes, paint fumes, or gases containing corrosive components are generated. It could malfunction.	
 The instructions given must be followed.	Securely install parts after maintenance. It could cause injury if parts fall.	
	Put on gloves during maintenance. It could cause injury.	
	Make sure the power supply isolator is turned off when Lossnay is not used for a long period of time. It could cause electric shock, power leakage, or fire as a result of deteriorated insulation.	
	When outdoor temperature becomes lower than -10°C, the supply fan starts intermittent operation for defrosting operation. -10°C to -15°C : Intermittent operation 10min OFF, 60min ON. -15°C or less : Intermittent operation 55 min OFF, 5 min ON.	
	Other than EU countries: This appliance is not intended for use by persons (including children) with reduced physical sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the appliance by a person responsible for their safety. Children should be supervised to ensure that they do not play with the appliance.	
	EU countries: This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved. Children shall not play with the appliance. Cleaning and user maintenance shall not be made by children without supervision.	

2. Names of the parts

Models 15 to 100RVX3

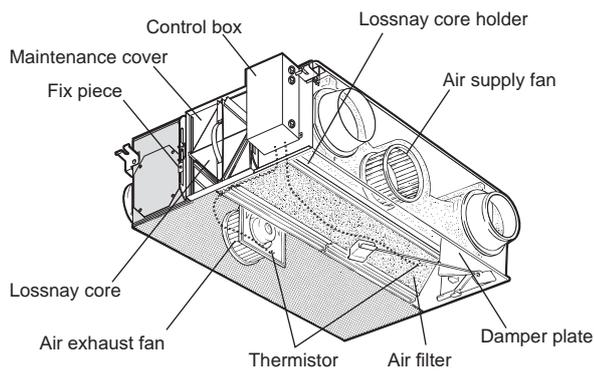

Models 160 and 200RVX3

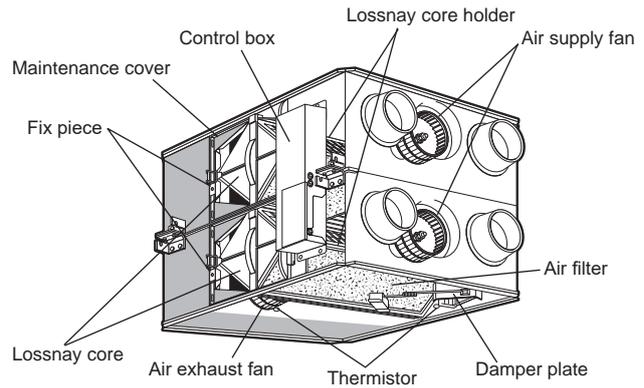

3. Operation

Lossnay can be connected with Lossnay remote controller (PZ-62DR-EA/EB), and other Systems (City Multi, Mr. Slim, Central controller (MELANS))

Following shows the use of PZ-62DR-EA/EB. Please refer to the manuals for the other systems.

For connection of a Lossnay remote controller (PZ-62DR-EA/EB)

If the Lossnay's operation is linked with the operation of an external device such as an air conditioner, the method of use will differ, so carry out the appropriate operation in accordance with the following table. Also, please see the installation and user manual for the Lossnay remote controller (PZ-62DR-EA/EB).


<Not connected to an external device>

Example of System	Operation	Function
<p>Lossnay</p> <p>Remote Controller (Optional parts) (PZ-62DR-EA/EB)</p> <p>Power Supply</p>	Run using the remote controller.	If 2 remote controllers are used, the last touch has priority.

<Connected to an external device>

<p>Lossnay</p> <p>Remote Controller (Optional parts) (PZ-62DR-EA/EB)</p> <p>Power Supply</p> <p>External device</p> <p>Operation switch for the external device</p>	Lossnay unit can be turned ON or OFF when the signal from external device is connected to Lossnay ON/OFF terminal.	If you would like to turn ON the Lossnay alone while the external device is OFF, operate it by the Lossnay remote controller.
<p>Lossnay</p> <p>Power Supply</p> <p>External device</p> <p>Operation switch for the external device</p>		The fan speed is fixed on fan speed 4. (factory setting) The ventilation mode is "Auto Ventilation Mode".


■ Display and Function button (PZ-62DR-EA/EB)

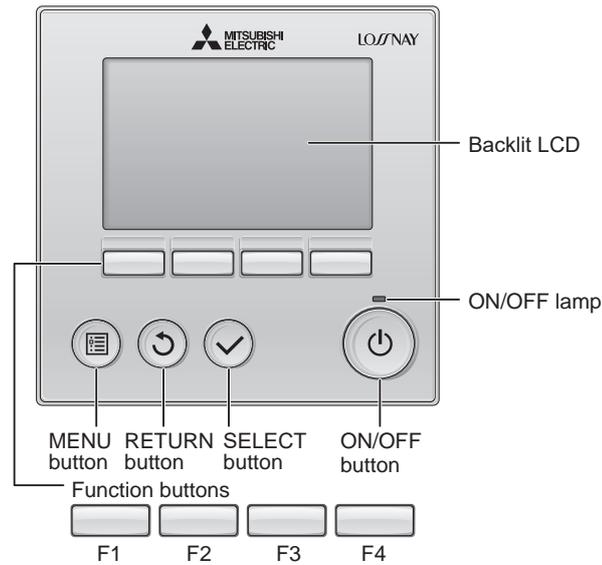


■ LOSSNAY ENERGY RECOVERY VENTILATE setting

Both fresh air supply and return air pass through the energy recovery cores. Energy recovery ventilation makes the fresh air temperature close to the indoor temperature in the winter and the summer season.

Models 15 to 100RVX3

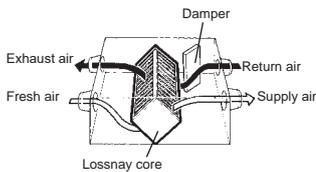


Models 160 and 200RVX3

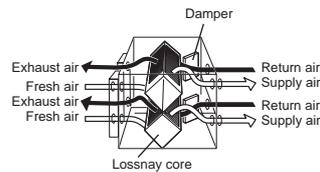


■ BY-PASS VENTILATE setting

The fresh air passes through the Lossnay cores and the return room air is exhausted direct. Lossnay By-pass ventilate is normally operated during the spring/autumn season.

Models 15 to 100RVX3

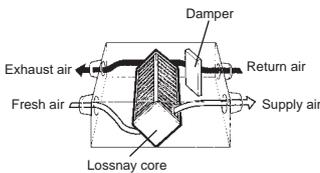

Models 160 and 200RVX3

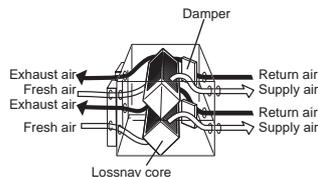

■ AUTOMATIC VENTILATION setting

The automatic ventilation mode automatically provides the correct ventilation for the conditions in the room. The following shows the effect "By-pass" ventilation will have under various conditions.

1. Reduces cooling load

If the air outside is cooler than the air inside the building during the cooling season (such as early morning or at night), "By-pass" ventilation will draw in the cooler outside air and reduce the cooling load on the system.

2. Night purge

"By-pass" ventilation can be used to release hot air from inside the building that has accumulated in buildings a business district during the hot summer season.

3. Office equipment room cooling

During cold season, fresh air can be drawn in and used as is to cool rooms where the temperature has risen due to the use of office equipment.

⚠ CAUTION

- In the case of "By-pass" ventilation, the supply air temperature slightly rises more than the outside air temperature because of the heat effect around the ducts or the unit motors.

■ CO₂ sensor control

When CO₂ sensor is connected, "Auto" fan speed can be selected. In "Auto" mode, the fan speed changes automatically according to the CO₂ sensor concentration.

4. Maintenance

Remove all dust and dirt on air filters and Lossnay cores at regular intervals in order to prevent a deterioration in the Lossnay functions.

Guideline:

- Clean the air filters once a year. (or when  are indicated on the remote controller)
- Clean the Lossnay cores once two years.
(Clean the Lossnay cores once a year if possible.)
(Frequency should be increased depending on the extent of dirt.)

WARNING

- **Make sure the power supply isolator is turned off before starting maintenance.**
It could cause electric shock or injury if it is turned on.
- **Do not touch the product for at least 5 minutes after the power is shut off.**
Electrical shock can result.
- **For vertical installation, observe 4.4 Additional precautions for vertical installation.**


CAUTION

- **Put on gloves during maintenance.**
It could cause injury.
- **Securely install parts after maintenance.**
It could cause injury if parts fall.

4.1 Removing the parts

1) Maintenance cover

1. Loosen the black screw of fix piece.
2. Slide the fix piece down.
3. Open hinge wire.

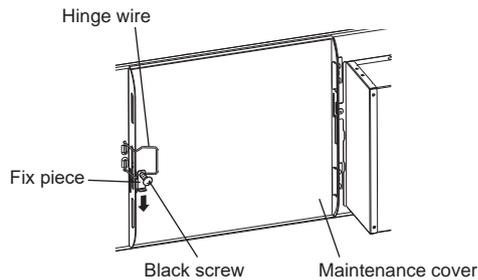


Note

- **Don't forget to fix Hinge wire and fix piece after any procedure, cleaning filters or cores.**


2) Air filters

Withdraw air filters.

Models 15 to 100RVX3



Models 160 and 200RVX3

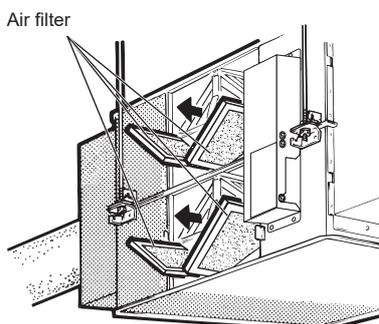

Note


- **When the unit is installed upside down, air filters are positioned upper Lossnay cores.**

3) Lossnay cores


Withdraw Lossnay cores.

Hold the handle and draw the Lossnay cores out from the unit.

Models 15 to 100RVX3

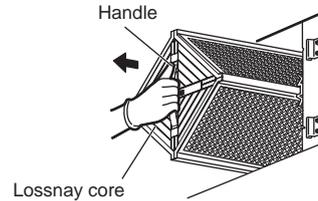


Models 160 and 200RVX3

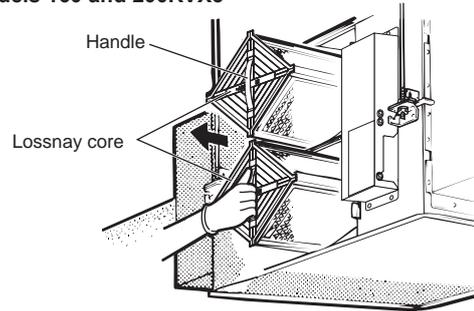

4.2 Cleaning the parts

1) Air filters

Use a vacuum cleaner to remove light dust. To remove stubborn dirt, wash in a mild solution of detergent and lukewarm water. (under 40°C)



CAUTION


- **Never wash the filters in very hot water and never wash them by rubbing them.**
- **Do not dry the filters by exposing them to a flame.**
- **Replace the filter with a new one which can be got as an optional parts.**

2) Lossnay cores

Use a vacuum cleaner to suck up the dust and dirt on the exposed surfaces of the Lossnay cores.

Use a soft brush only to clean exposed surface areas.

Do NOT wash in water.

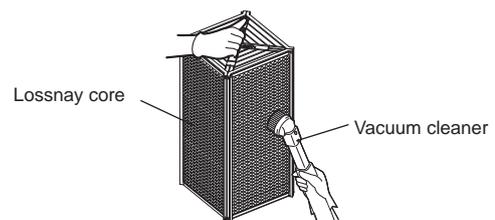


CAUTION

- **Do not use the hard nozzle of the vacuum cleaner. It may damage the exposed surfaces of the Lossnay cores.**
- **Under no circumstances should the Lossnay cores be washed in water.**

4.3 Assembly after maintenance

Bearing in mind the following points, assemble the parts following the sequence for their removal in reverse. Check the fix piece does not slide off the hinge wire by the black screw.

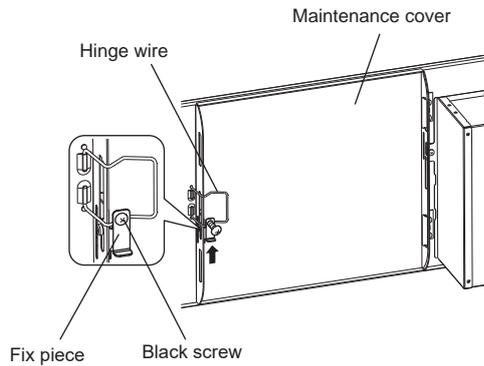

- Arrange the Lossnay core with the air filter side downward. When the unit is installed upside down, air filters are positioned upper Lossnay cores.
- The filter has front and back side. Set the arrow mark on the filters as the air flow direction.

Note

- If  are indicated on the remote controller, turn off the indication, after maintenance.

4.4 Additional precautions for vertical installation

- When unit is installed vertically, follow below instructions. For items not described in this section, follow the instructions in other sections.
- Do not touch the unit where it is not related with the maintenance work.
- Do not place anything on the unit.
- Do not lean on, or put your weight on the product. There is a risk of product deformation or injury.
- When inserting or removing Lossnay cores, securely hold the handle until the end and insert or remove them one by one. Otherwise, some parts might be damaged.

5. Specifications

Model name	Input power (W)	Air volume		Static pressure (Pa)	Temperature exchange efficiency (%)	Noise (dB) 1.5 m below the unit	Weight (kg)
		(m ³ /h)	(L/S)				
LGH-15RVX3-E	55	150	42	120	73.5	27	20
LGH-25RVX3-E	75	250	69	120	75.5	30.5	22
LGH-35RVX3-E	120	350	97	160	75	30.5	30
LGH-50RVX3-E	185	500	139	150	70.5	35	33
LGH-65RVX3-E	245	650	181	150	72.5	37.5	41
LGH-80RVX3-E	343	800	222	170	75	39	47
LGH-100RVX3-E	438	1000	278	190	75.5	40	53
LGH-160RVX3-E	687	1600	444	170	75	41	96
LGH-200RVX3-E	855	2000	556	170	76.5	41.5	108

* The above values apply during Lossnay ventilation when the fan speed is set to Fan speed 4 at the rating pressure loss, 230 V / 50Hz and horizontal installation.

* For the specifications at the other frequency or voltages, contact your dealer.

* The values given in the table for the noise level reflect the levels measured at a position 1.5 meters directly under the unit in an anechoic chamber.

* Noise change or increase may occur because of the Bypass-Automatic function or Automatic fan speed change by timer setting and/or other functions.

* Temperature Exchange efficiency (%) are based on winter condition.

* For detail specification, contact your dealer or check specification sheet.

* On-site commissioning measurements by pitot tube method could be as much 20% different from ISO test room conditions. If the measuring point is close to sources of turbulence like bends, contractions and dampers etc, it is difficult to measure air volume correctly. A straight duct length more than 10D (D=duct diameter) from the source of turbulence is recommended for correct measurement. On-site measurement should therefore be performed in accordance with BSRIA guideline (Commissioning Air System. Application procedures for buildings AG3/89.3(2001))

6. After-sales servicing

Consult with your dealer about the after-sales services provided for this Lossnay product.

If you hear strange sounds, if no air is blown out or if some other trouble occurs, switch off the power and contact your dealer. Consult with your dealer concerning the cost of inspection or repair work.

■ Recommended inspection and maintenance

After several years of use, the following might occur. We recommend inspection and maintenance by a professional.

- Entry of dust due to deterioration of filters
- Abnormal noise or vibration due to the motor reaching the end of its service life
- Air leakage due to the Lossnay core reaching the end of its service life

The following are consumables:

- Motor
- Supply air filter
- Exhaust air filter
- Lossnay core
- Circuit board
- Thermistor

■ Repair costs include technical fee, cost of parts, (and business trip charges), etc.

Attentive inspection	Inspect your unit of good service!	
	<p>Have you noticed?</p> <ul style="list-style-type: none"> ● Fan do not run when the unit is turned on. ● Abnormal noises or vibrations while the unit is running ● Retarded or irregular rotations (Motors are component which requires maintenance.) ● Burnt odor ● Corroded or damaged mounting parts or location 	 <div style="background-color: black; color: white; padding: 5px; display: inline-block;">Stop running.</div> <p style="font-size: small;">Turn off the unit. Then, contact your dealer for prevention of failure or hazard. The dealer should appraise the possible cost.</p>

MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE:

TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN