


MODEL		LGH-160RVX3-E				SIGN	
Heat exchange system		Energy recovery ventilating system					
Heat exchanger (Lossnay core)		Special treated paper plate heat exchanger					
Cladding		Galvanized steel sheet					
Motor		EC motor					
Filter		Non-woven fabrics filter (ISO 16890 Coarse 60%)					
Surrounding air condition		0°C to 40 °C, 80%RH or less					
Suction air condition		Lower than 40°C, 80%RH.					
Supply fan operation under low outdoor temperature		-10°C to -15°C : Intermittent operation 60 min ON, 10 min OFF -15°C or less : Sensing operation 55 min OFF, 5 min ON					
Weight		96kg					
Electrical power supply		220-240V/50Hz, 220V/60Hz					
Fan speed		4	3	2	1	Test condition	
Default Airflow setting		100%	75%	50%	25%		
Input power [W]		687	324	128	45	EN13053: 2019	
Airflow [m <sup>3</sup> /h]		1600	1200	800	400		
Airflow [L/s]		444	333	222	111		
Specific fan power [W/(L/s)]		1.55	0.97	0.58	0.41		
External static pressure [Pa]		170	96	43	11	EN308: 2022	
Temp. exchange efficiency [%]		Heating	75.0	76.5	78.0		80.0
		Cooling	65.0	70.0	75.5		78.0
Enthalpy exchange efficiency [%]		Heating	62.0	65.0	70.5		73.5
		Cooling	54.5	58.5	65.0	70.5	
Noise [dB]		41.0	35.0	26.0	18.0	A-weighted sound pressure level	
Exhaust Air Transfer Ratio [%]		5.0				EN308: 2022 / FS3	
External leakage [%]		5.0				EN1886: 2007/ Nominal flow rate	
Insulation resistance		10MΩ or more					
Dielectric strength		AC 1000V 1 minute					
Maximum current [A]		4.74					

#### ■ Characteristic curve

Dotted lines of fan curve means unmeasurable area with EN13053: 2019.

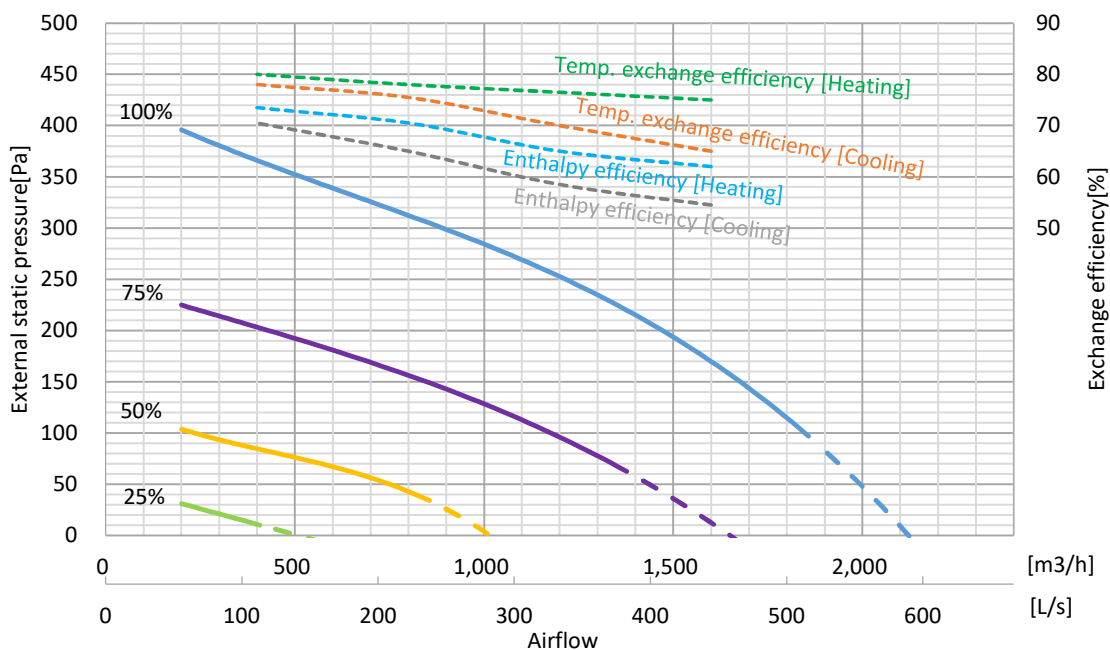


#### ■ Attention

- The input power, the efficiency and the noise are based on the rating air volume, and 230V/50Hz. Noise (A-weighted sound pressure level) is measured 1.5m off from the center of the unit in an anechoic chamber.
- Heat recovery ventilation mode starts automatically while detecting OA temperature lower than 8°C, even Bypass mode is selected. Remote controller continues to display "Bypass ventilation" in this case.
- Do not use the booster fan to exceed airflow rate/pressure shown in Q-H diagram of the unit.
- It is prohibited to use the unit where salt, sulphur or hot spring steam damage is expected.
- Do not use with acid, alkalis, organic solvent, oil mist, paint, or harmful gas as pesticide, corrosive gas, etc.
- In cold area or strong wind area, outdoor air may enter the unit because of the pressure difference or external wind even when the unit stops. It is recommended to install an electrically damper to block outdoor air in such cases.
- Avoid to install air inlets and outlets where insects are likely to gather like a place near interior or exterior lights. In that case, select hoods or louvers which have repellent net.

※Specifications may be subject to change without notice.

SPECIFICATIONS	DATE	TYPE	CEILING RECESSED LOSSNAY	
	24-Oct-23	MODEL	LGH-160RVX3-E	
<b>MITSUBISHI ELECTRIC CORPORATION</b>	NUMBER	<b>N22HHGU0008A</b>	1/4	

## ■ Outline drawings

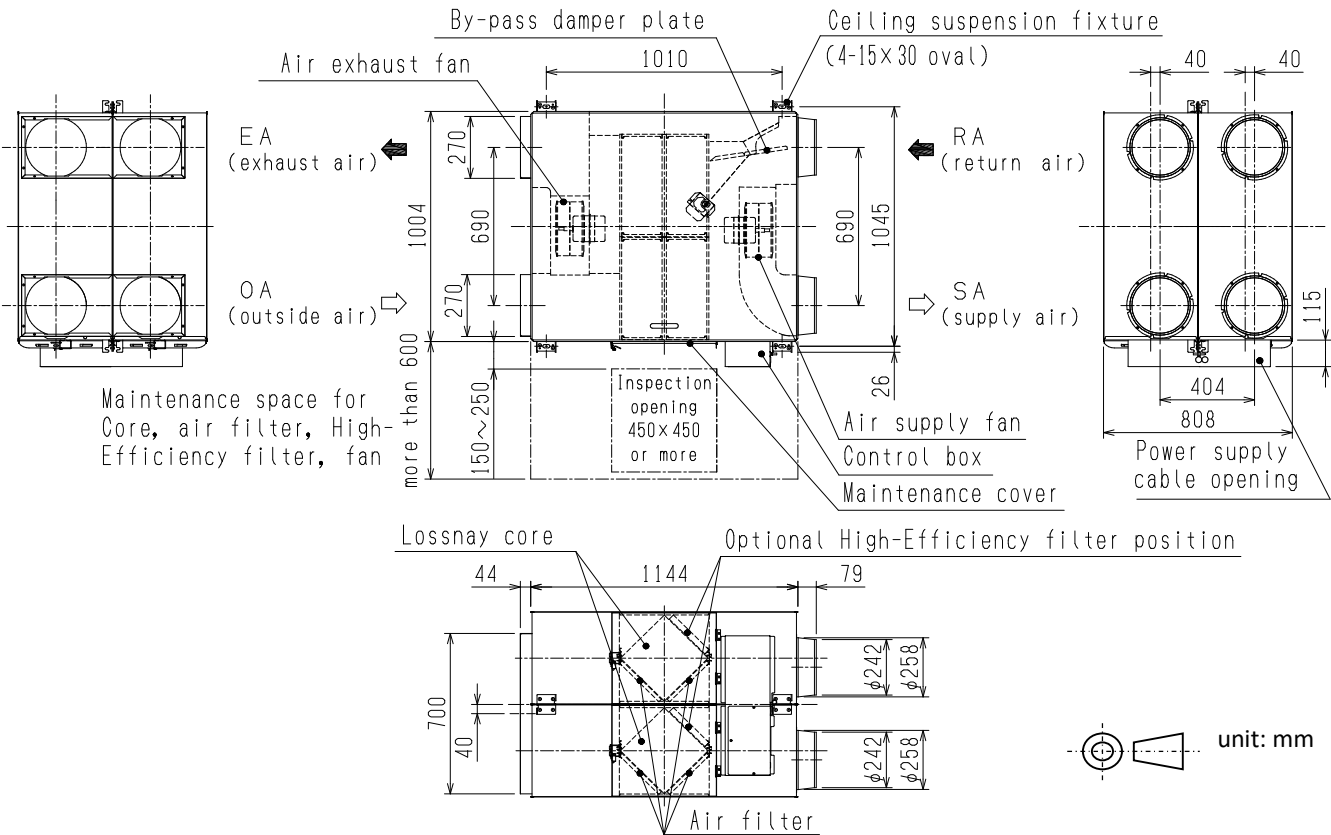


## ■ Caution for installation

1. Do not modify the unit as it may cause malfunction.
2. Install the anchor bolts to ensure the product's weight or earthquake load. Correctly rated wire/chain may also be used.
3. Leave sufficient space and make inspection opening (450 × 450mm or more) for the filter and Lossnay core removal side for maintenance purpose.
4. Take care in locating air inlet to prevent intake of dirty air or disgusting smell from exhaust gas of factory, air from rubbish disposal, etc.
5. Take care as below to prevent from condensation.
  - ① The outdoor side (OA, EA) and SA ducts must be heat-insulated in order to prevent from condensation.
  - ② If the ambient temperature around the Lossnay unit is close to outdoor condition, it is recommended to insulate RA and SA ducts and additional insulation foam on the unit surface.
  - ③ Condensation and freezing may occur on the Lossnay unit surface, because of the outdoor air condition or humidity condition above the ceiling. A supplemental insulation foam for the unit surface is necessary in that case.
  - ④ When the supply air is set twice as much as the exhaust air or more by airflow function, the Lossnay body indoor side and SA duct must be put additional insulation. Without additional insulation, it could cause condensation and water drop from the unit.
6. Do not install this product in a place where it is exposed to ultraviolet light. UV may be damage covering insulation.
7. Outdoor air may enter the Lossnay owing to the pressure difference between indoor and outdoor or external winds even when the product is not operated. It is recommended to install an electrically operated damper to block the outdoor air.
8. Install louvers or covers for OA inlet & EA outlet to prevent rainwater from entering the Lossnay unit. The outdoor side duct (OA and EA) shall decline by 1/30 or more downward to outdoor.
9. When RA duct is not installed and RA is suctioned directly from the unit surrounding space, a repellent net is necessary for the RA inlet to prevent large size dust or something from intruding into the unit.
10. Take precautions when using the product in a quiet location.
11. Do not use under high temperature and humidity condition. Condensation will occur and water will gather inside the Lossnay cores under high temperature and humidity condition, such as warm swimming pool, bathroom, greenhouse or foggy place.
12. Thermistors are built only in the lower unit. Lossnay unit controls its operation according to the lower unit detecting temperature. Even when actual return air temperature between the upper and the lower unit is different, Lossnay operates according to the lower unit temperature.

※Specifications may be subject to change without notice.

OUTLINE DRAWINGS	DATE	TYPE MODEL	CEILING RECESSED LOSSNAY	
	24-Oct-23		LGH-160RVX3-E	
MITSUBISHI ELECTRIC CORPORATION		NUMBER	N22HHGU0008A	2/4

## ■ Wiring diagrams

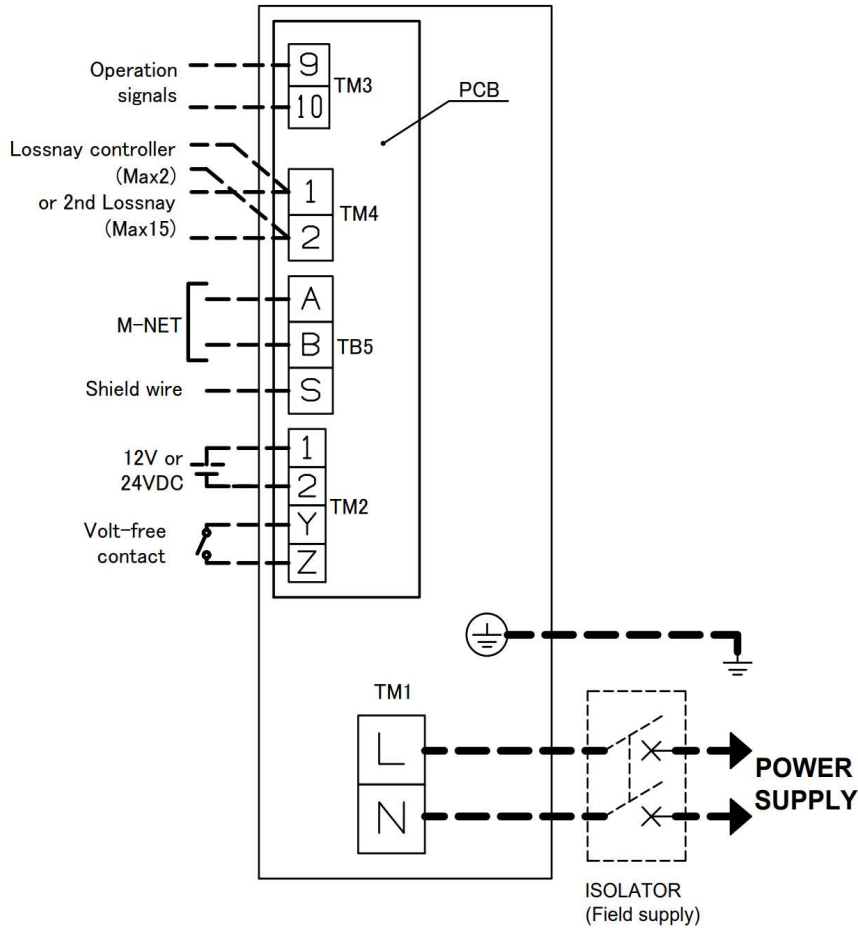

## ■ Caution for electrical work

1. Make sure to ground and install an all-pole electrical leakage isolator securely.
2. Select proper circuit breaker according to the electrical current on the 1st page.  
Always use a current leakage breaker that is compatible with higher harmonics as this unit is equipped with an inverter.  
The use of an inadequate breaker can cause the incorrect operation of inverter.
3. Perform electrical installation to meet appropriate regulations and standards.
4. Always use double insulated cable for the transmission cables.
5. Wiring work must be performed by qualified professionals.
6. All supply circuits must be disconnected before obtaining access to the terminal devices.
7. When only Lossnay units are used in M-NET, power supply unit is required to connect to centralized controller.  
Number of power supply units or the transmission boosters should correspond with the connected Lossnay units.
8. In the case of installing a duct heater interlocked with Lossnay, be sure to observe the following:
  - ① Choose a OA pre-heater which can control the heater outlet air temperature even both the air flow is maximum and minimum. Otherwise it could fall the supply fan into intermittent operation.
  - ② Select a duct heater in compliance with local and national laws, ordinances, and standards.  
Select a duct heater that is tested by a certification body.
  - ③ Always select a heater that is equipped with a non-self-resetting safety device.
  - ④ Do not directly supply power from the Lossnay unit to the duct heater. Doing so could cause fire.
  - ⑤ Install a circuit breaker for the duct heater in compliance with all applicable laws, ordinances, and standards.
  - ⑥ Install the duct heater separated from the product by a distance of 2 m or more.
  - ⑦ Ensure that the duct heater and Lossnay are wired and that the Lossnay function settings have been configured, and then always check operation by trial operation.
9. With this product, the wiring installation method will vary according to the design of the system.  
Refer to the installation manual for more detail.

※Specifications may be subject to change without notice.

WIRING DIAGRAMS	DATE	TYPE MODEL	CEILING RECESSED LOSSNAY	
	24-Oct-23		LGH-160RVX3-E	
<b>MITSUBISHI ELECTRIC CORPORATION</b>	NUMBER	<b>N22HHGU0008A</b>	3/4	

■ Maintenance and lifetime

Remove all dust and dirt on air filters and Lossnay cores at regular intervals to prevent from a deterioration in the Lossnay function.

Refer to each model's operation instructions for the suggested maintenance period and methods.

General indication of lifetime of the main parts is as below. Time below is unrelated to guaranteed period for service.

And parts exchange period varies with usage condition.

Lossnay cores	: Around 10 years with maintenance at stated periods.
Air Filters	: Around 5 years with maintenance at stated periods
High efficiency filters	: 3,000 hours
Motor	: 30,000 hours
Circuit board	: 25,000 hours
Thermistor	: Around 5 years

■ Other notes

Refer to each model's operation instructions for the suggested maintenance period and methods. General indication of lifetime of the main parts is as below. Time below is unrelated to guaranteed period for service. And parts exchange period varies with usage condition.

Measurements by pitot tube on site could be as much 20% difference from JIS test room conditions. If the measuring point is

close to sources of turbulence like bends, contractions and dampers etc., it is difficult to measure air volume correctly.

A straight duct length more than 10D (D=duct diameter) from the source of turbulence is recommended for correct measurement. On-site measurement should therefore be measured in accordance with BSRIA guideline (Commissioning

Air Systems. Application procedures for buildings AG3/89.3(2001)).

※Specifications may be subject to change without notice.

SAFTY NOTES	DATE	TYPE MODEL	CEILING RECESSED LOSSNAY	
	24-Oct-23		LGH-160RVX3-E	
<b>MITSUBISHI ELECTRIC CORPORATION</b>	NUMBER	<b>N22HHGU0008A</b>	4/4	