


ECOV-X37/X55VA

CIBSE TM65 Embodied Carbon Mid-level Calculation

Assesment Date:	13th April 2023
Assessor / Organisation:	RI / Mitsubishi Electric LES UK
Contact:	embodied.carbon@meuk.mee.com

Embodied Carbon with 'Mid-level TM65 Calculation' Method (kg CO₂e) Total: 2,678

	Evaporation Temperature (ET)	
	-10°C	-30°C
ECOV-X37VA Embodied Carbon per kW (kgCO ₂ e/kW):	296	521
ECOV-X55VA Embodied Carbon per kW (kgCO ₂ e/kW):	167	337

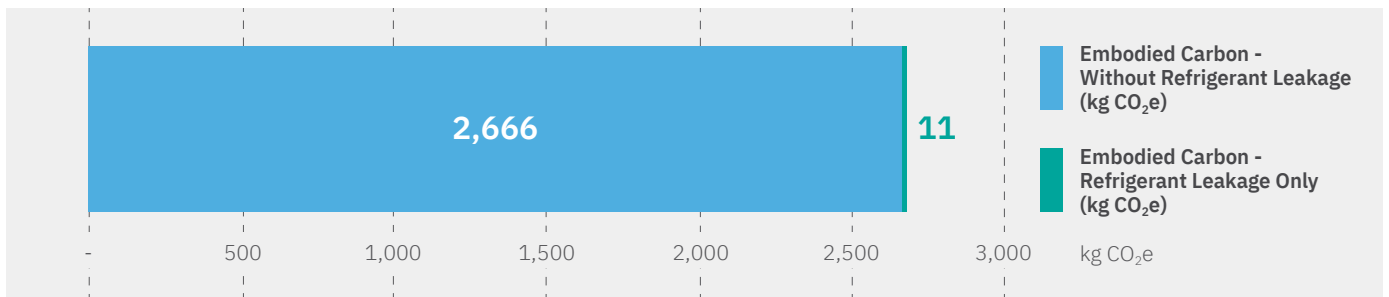

ECOV-X37/X55VA - Product Information

Type of product	Condenser Unit
Capacity of equipment (kW)*	
ECOV-X37VA	10 (-10°C ET) / 5.07 (-30°C ET)
ECOV-X55VA	16 (-10°C ET) / 7.95 (-30°C ET)
Product weight (kg)	290
Material breakdown for at least 95% of the product weight? (Y/N)	Y
Service life of the product (years)	15
Type of refrigerant	R744
Refrigerant GWP	1
Energy consumption of the factory per unit of product (kWh)	15.26
Location of manufacture	Asia
Product Complexity	Category 3: High



*Refrigeration capacity conditions as per product catalogue.

ECOV-X37/X55VA

CIBSE TM65 Embodied Carbon Mid-level Calculation

Embodied Carbon Results Breakdown (kg CO₂e)

A1: Material extraction	1,506
A2: Transport	230
A3: Manufacturing	52
A4: Transport to Site	67
B1: Use	11
B3: Repair	186
C1: Deconstruction	0
C2: Transport	4
C3: Waste Processing	4
C4: Disposal	1

Embodied Carbon Results - without Refrigerant Leakage (kg CO₂e)

A1-C4 (excluding B1,C1)	2,051
A1-C4 with Buffer Factor (excluding B1, C1)	2,666

Embodied Carbon Result - Refrigerant Leakage Only (kg CO₂e)

B1 (Refrigerant leakage during use) + C1 (Refrigerant leakage end of life)	11
--	----

Assumptions

A1: Material carbon coefficient source	TM65 Table 2.1 & The ICE Database
B1: Refrigerant annual leakage rate (%)	6
C1: Refrigerant end of life recovery rate (%)	97
B3: Materials replaced as part of repair (%)	10 (TM65 Assumption)
C4: Percentage of product going to landfill (%)	30 (TM65 Assumption)



Telephone: 01707 282880
email: embodied.carbon@meuk.mee.com
les.mitsubishielectric.co.uk



@meuk_les
@green_gateway



Mitsubishi Electric Living
Environmental Systems UK



Mitsubishi Electric
Cooling and Heating UK



mitsubishielectricuk_les



Mitsubishi Electric Living
Environmental Systems UK



thehub.mitsubishielectric.co.uk

UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. Telephone: 01707 282880 Fax: 01707 278881
IRELAND Mitsubishi Electric Europe, Westgate Business Park, Ballymount, Dublin 24, Ireland. Telephone: (01) 419 8800 Fax: (01) 419 8890 International code: (003531)

Country of origin: United Kingdom - Japan - Thailand - Malaysia. ©Mitsubishi Electric Europe 2023. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: The fuse rating is for guidance only. Please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R32 (GWP:675), R407C (GWP:1774), R134a (GWP:1430), R513A (GWP:631), R454B (GWP:466), R1234ze (GWP:7) or R1234yf (GWP:4). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows. R410A (GWP:1975), R32 (GWP:550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of October 2023

