


# MECH-iF-G05 0802

## CIBSE TM65 Embodied Carbon Mid-level Calculation


<b>Assesment Date:</b>	23rd May 2024
<b>Assessor / Organisation:</b>	Mitsubishi Electric UK
<b>Contact:</b>	embodied.carbon@meuk.mee.com

**Embodied Carbon with 'Mid-level TM65 Calculation' Method (kg CO<sub>2</sub>e) Total:** 99,558

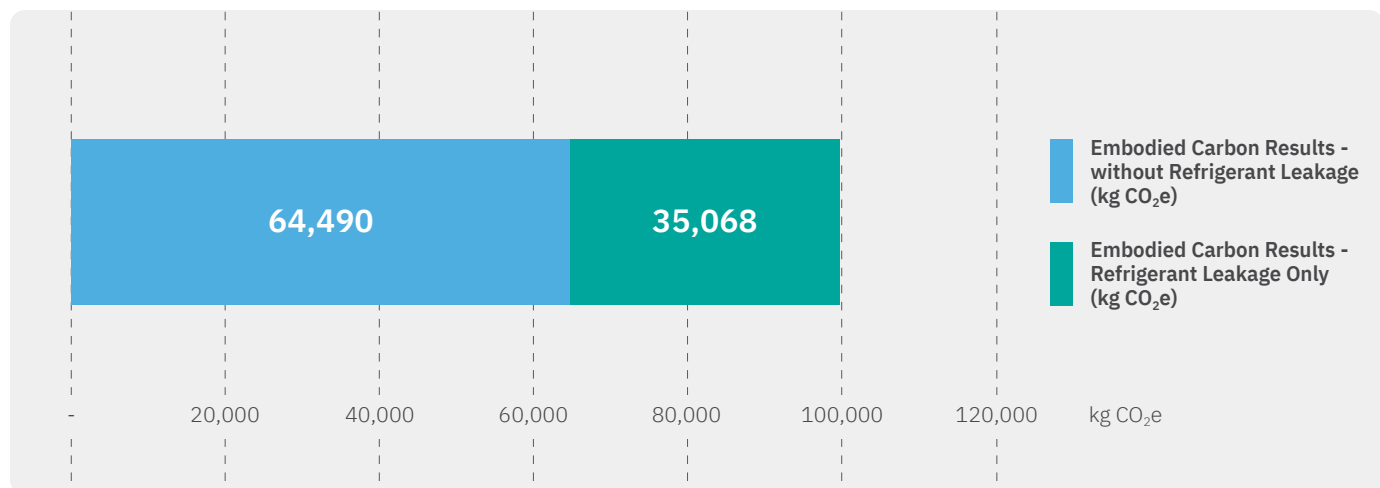

### MECH-iF-G05 0802 - Product Information

Type of product	Chiller
Capacity of equipment (kW)	814.1
Product weight (kg)	7,600
Material breakdown for at least 95% of the product weight? (Y/N)	Y
Service life of the product (years)	17.5
Type of refrigerant	R513A
Refrigerant GWP	573
Energy consumption of the factory per unit of product (kWh)	3,112
Location of manufacture	Europe
Product Complexity	Category 3: High

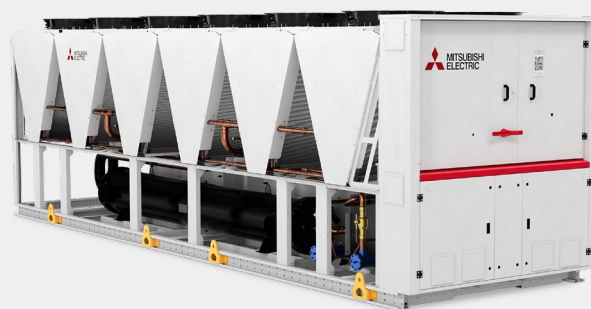



# MECH-iF-G05 0802

## CIBSE TM65 Embodied Carbon Mid-level Calculation

### Embodied Carbon Results Breakdown (kg CO<sub>2</sub>e)

A1: Material extraction	38,188
A2: Transport	176
A3: Manufacturing	4,232
A4: Transport to Site	1,481
B1: Use	34,094
B3: Repair	4,510
C1: Deconstruction	974
C2: Transport	98
C3: Waste Processing	902
C4: Disposal	20

### Embodied Carbon Results - without Refrigerant Leakage (kg CO<sub>2</sub>e)

A1-C4 (excluding B1,C1)	49,608
A1-C4 with Buffer Factor (excluding B1, C1)	64,490

### Embodied Carbon Result - Refrigerant Leakage Only (kg CO<sub>2</sub>e)


B1 (Refrigerant leakage during use) + C1 (Refrigerant leakage end of life)	35,068
--	--------

### Assumptions

A1: Material carbon coefficient source	TM65 Table 2.1 & The ICE Database
B1: Refrigerant annual leakage rate (%)	2 (TM65 Assumption)
C1: Refrigerant end of life recovery rate (%)	99 (TM65 Assumption)
B3: Materials replaced as part of repair (%)	10 (TM65 Assumption)
C4: Percentage of product going to landfill (%)	30 (TM65 Assumption)



Telephone: 01707 282880  
email: [embodied.carbon@meuk.mee.com](mailto:embodied.carbon@meuk.mee.com)  
[les.mitsubishielectric.co.uk](http://les.mitsubishielectric.co.uk)



UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. Telephone: 01707 282880

IRELAND Mitsubishi Electric Europe, Westgate Business Park, Ballymount, Dublin 24, Ireland. Telephone: (01) 419 8800 International code: (003531)

Country of origin: United Kingdom - Italy - Turkey - Japan - Thailand - Malaysia. ©Mitsubishi Electric Europe 2024. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: The fuse rating is for guidance only and please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R290 (GWP:3), R32 (GWP:675), R407C (GWP:1774), R134a (GWP:1430), R513A (GWP:631), R454B (GWP:466), R454C (GWP:148), R1234ze (GWP:7) or R1234yf (GWP:4). \*These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows. R410A (GWP:1975), R32 (GWP:550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of May 2024

