

Ecodan R290 12kW Air Source Heat Pump

CIBSE TM65 Embodied Carbon Mid-level Calculation




Assesment Date: 13th December 2024
Assessor / Organisation: Mitsubishi Electric Residential Product Marketing
Contact: embodied.carbon@meuk.mee.com

Embodied Carbon with 'Mid-level TM65 Calculation' Method (kg CO₂e) Total:

937

	Capacities (kW)*	12
Embodied Carbon Result per kW (kg CO ₂ e/kW):		78.09

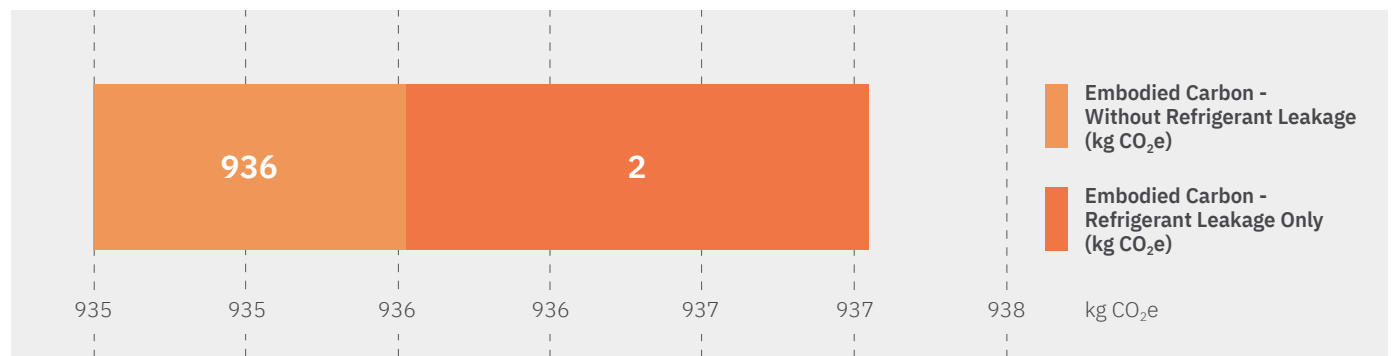

PUZ- WZ120VAA - Product Information

Type of product	A2W Heat Pump
Capacity of equipment (kW)	12.00
Product weight (kg)	119.50
Material breakdown for at least 95% of the product weight? (Y/N)	Y
Service life of the product (years)	15
Type of refrigerant	R290
Refrigerant GWP*	3
Energy consumption of the factory per unit of product (kWh)	26.66
Location of manufacture	UK
Product Complexity	Category 3: High

*Nominal cooling capacity conditions as per data book



Ecodan R290 12kW Air Source Heat Pump

CIBSE TM65 Embodied Carbon Mid-level Calculation



Embodied Carbon Results Breakdown (kg CO₂e)

A1: Material extraction	518
A2: Transport	94
A3: Manufacturing	32
A4: Transport to Site	1
B1: Use	1
B3: Repair	65
C1: Deconstruction	0
C2: Transport	2
C3: Waste Processing	8
C4: Disposal	0

Embodied Carbon Results - without Refrigerant Leakage (kg CO₂e)

A1-C4 (excluding B1,C1)	720
A1-C4 with Buffer Factor (excluding B1, C1)	936

Embodied Carbon Result - Refrigerant Leakage Only (kg CO₂e)

B1 (Refrigerant leakage during use) + C1 (Refrigerant leakage end of life)	2
--	---

Assumptions

A1: Material carbon coefficient source	TM65 Table 2.1 & The ICE Database
B1: Refrigerant annual leakage rate (%)	2
C1: Refrigerant end of life recovery rate (%)	99
B3: Materials replaced as part of repair (%)	10 (TM65 Assumption)
C4: Percentage of product going to landfill (%)	30



Telephone: 01707 282880
email: embodied.carbon@meuk.mee.com
les.mitsubishielectric.co.uk



@Ecodanheating



Mitsubishi Electric
Heating UK



Mitsubishi Electric
Heating UK



Mitsubishi Electric Ecodan



Mitsubishi Electric
Heating UK



thehub.mitsubishielectric.co.uk

UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. Telephone: 01707 282880

IRELAND Mitsubishi Electric Europe, Plunkett House, Grange Castle Business Park, Nangor Road, Dublin 22, Ireland. Telephone: (00353) 1 4198800 Email: sales.info@meir.mee.com Web: les.mitsubishielectric.ie

Country of origin: United Kingdom - Italy - Turkey - Japan - Thailand - Malaysia. ©Mitsubishi Electric Europe 2025. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: The fuse rating is for guidance only and please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R290 (GWP:3), R32 (GWP:675), R407C (GWP:1774), R134a (GWP:1430), R513A (GWP:631), R454B (GWP:466), R454C (GWP:148), R1234ze (GWP:7) or R1234yf (GWP:4). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows. R410A (GWP:1975), R32 (GWP:550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of January 2025

