


TX2-W-G04 /H 1914

CIBSE TM65 Embodied Carbon Mid-level Calculation

Assesment Date: 3rd September 2025
Assessor / Organisation: Mitsubishi Electric LES UK
Contact: embodied.carbon@meuk.mee.com

Embodied Carbon with 'Mid-level TM65 Calculation' Method (kg CO₂e) Total:

67,706

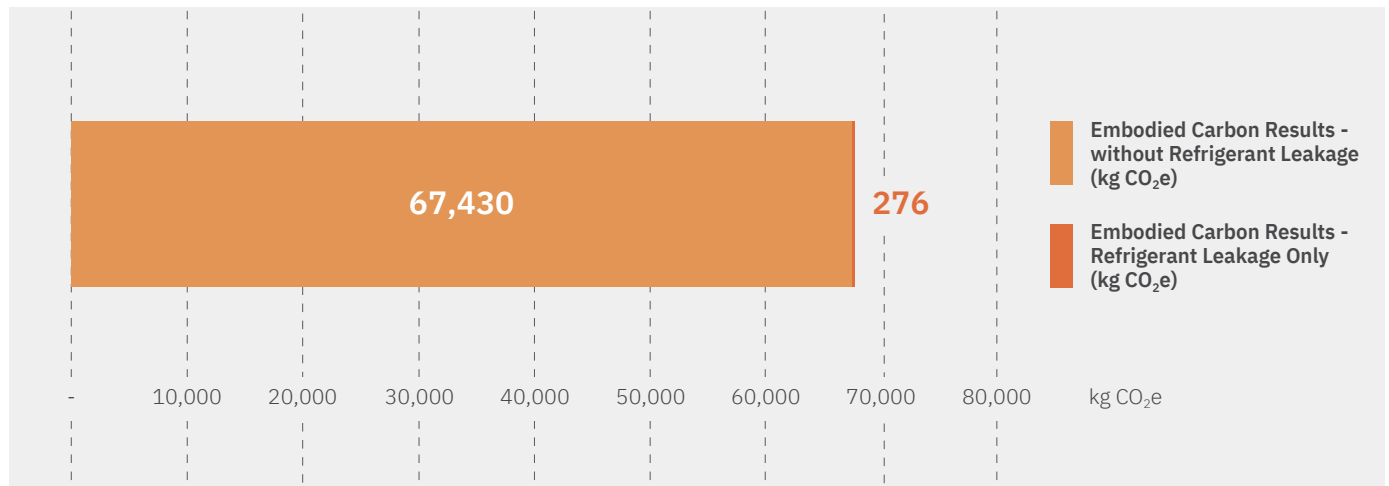

TX2-W-G04 /H 1914 - Product Information

Type of product	W2W Heat Pump
Capacity of equipment (kW)	2342
Product weight (kg)	10130
Material breakdown for at least 95% of the product weight? (Y/N)	Y
Service life of the product (years)	15
Type of refrigerant	HF01234ze
Refrigerant GWP	1
Energy consumption of the factory per unit of product (kWh)	2916.8
Location of manufacture	Europe
Product Complexity	Category 3: High



TX2-W-G04 /H 1914

CIBSE TM65 Embodied Carbon Mid-level Calculation



Embodied Carbon Results Breakdown (kg CO₂e)

A1: Material extraction	40,002
A2: Transport	234
A3: Manufacturing	3,967
A4: Transport to Site	1,958
B1: Use	267
B3: Repair	4,715
C1: Deconstruction	9
C2: Transport	122
C3: Waste Processing	846
C4: Disposal	25

Embodied Carbon Results - without Refrigerant Leakage (kg CO₂e)

A1-C4 (excluding B1,C1)	51,869
A1-C4 with Buffer Factor (excluding B1, C1)	67,430

Embodied Carbon Result - Refrigerant Leakage Only (kg CO₂e)

B1 (Refrigerant leakage during use) + C1 (Refrigerant leakage end of life)	276
--	-----

Assumptions

A1: Material carbon coefficient source	TM65 Table 2.1 & The ICE Database
B1: Refrigerant annual leakage rate (%)	2
C1: Refrigerant end of life recovery rate (%)	99
B3: Materials replaced as part of repair (%)	10 (TM65 Assumption)
C4: Percentage of product going to landfill (%)	30